



EOP-4a PRIMARY CONTAINMENT GAS CONTROL

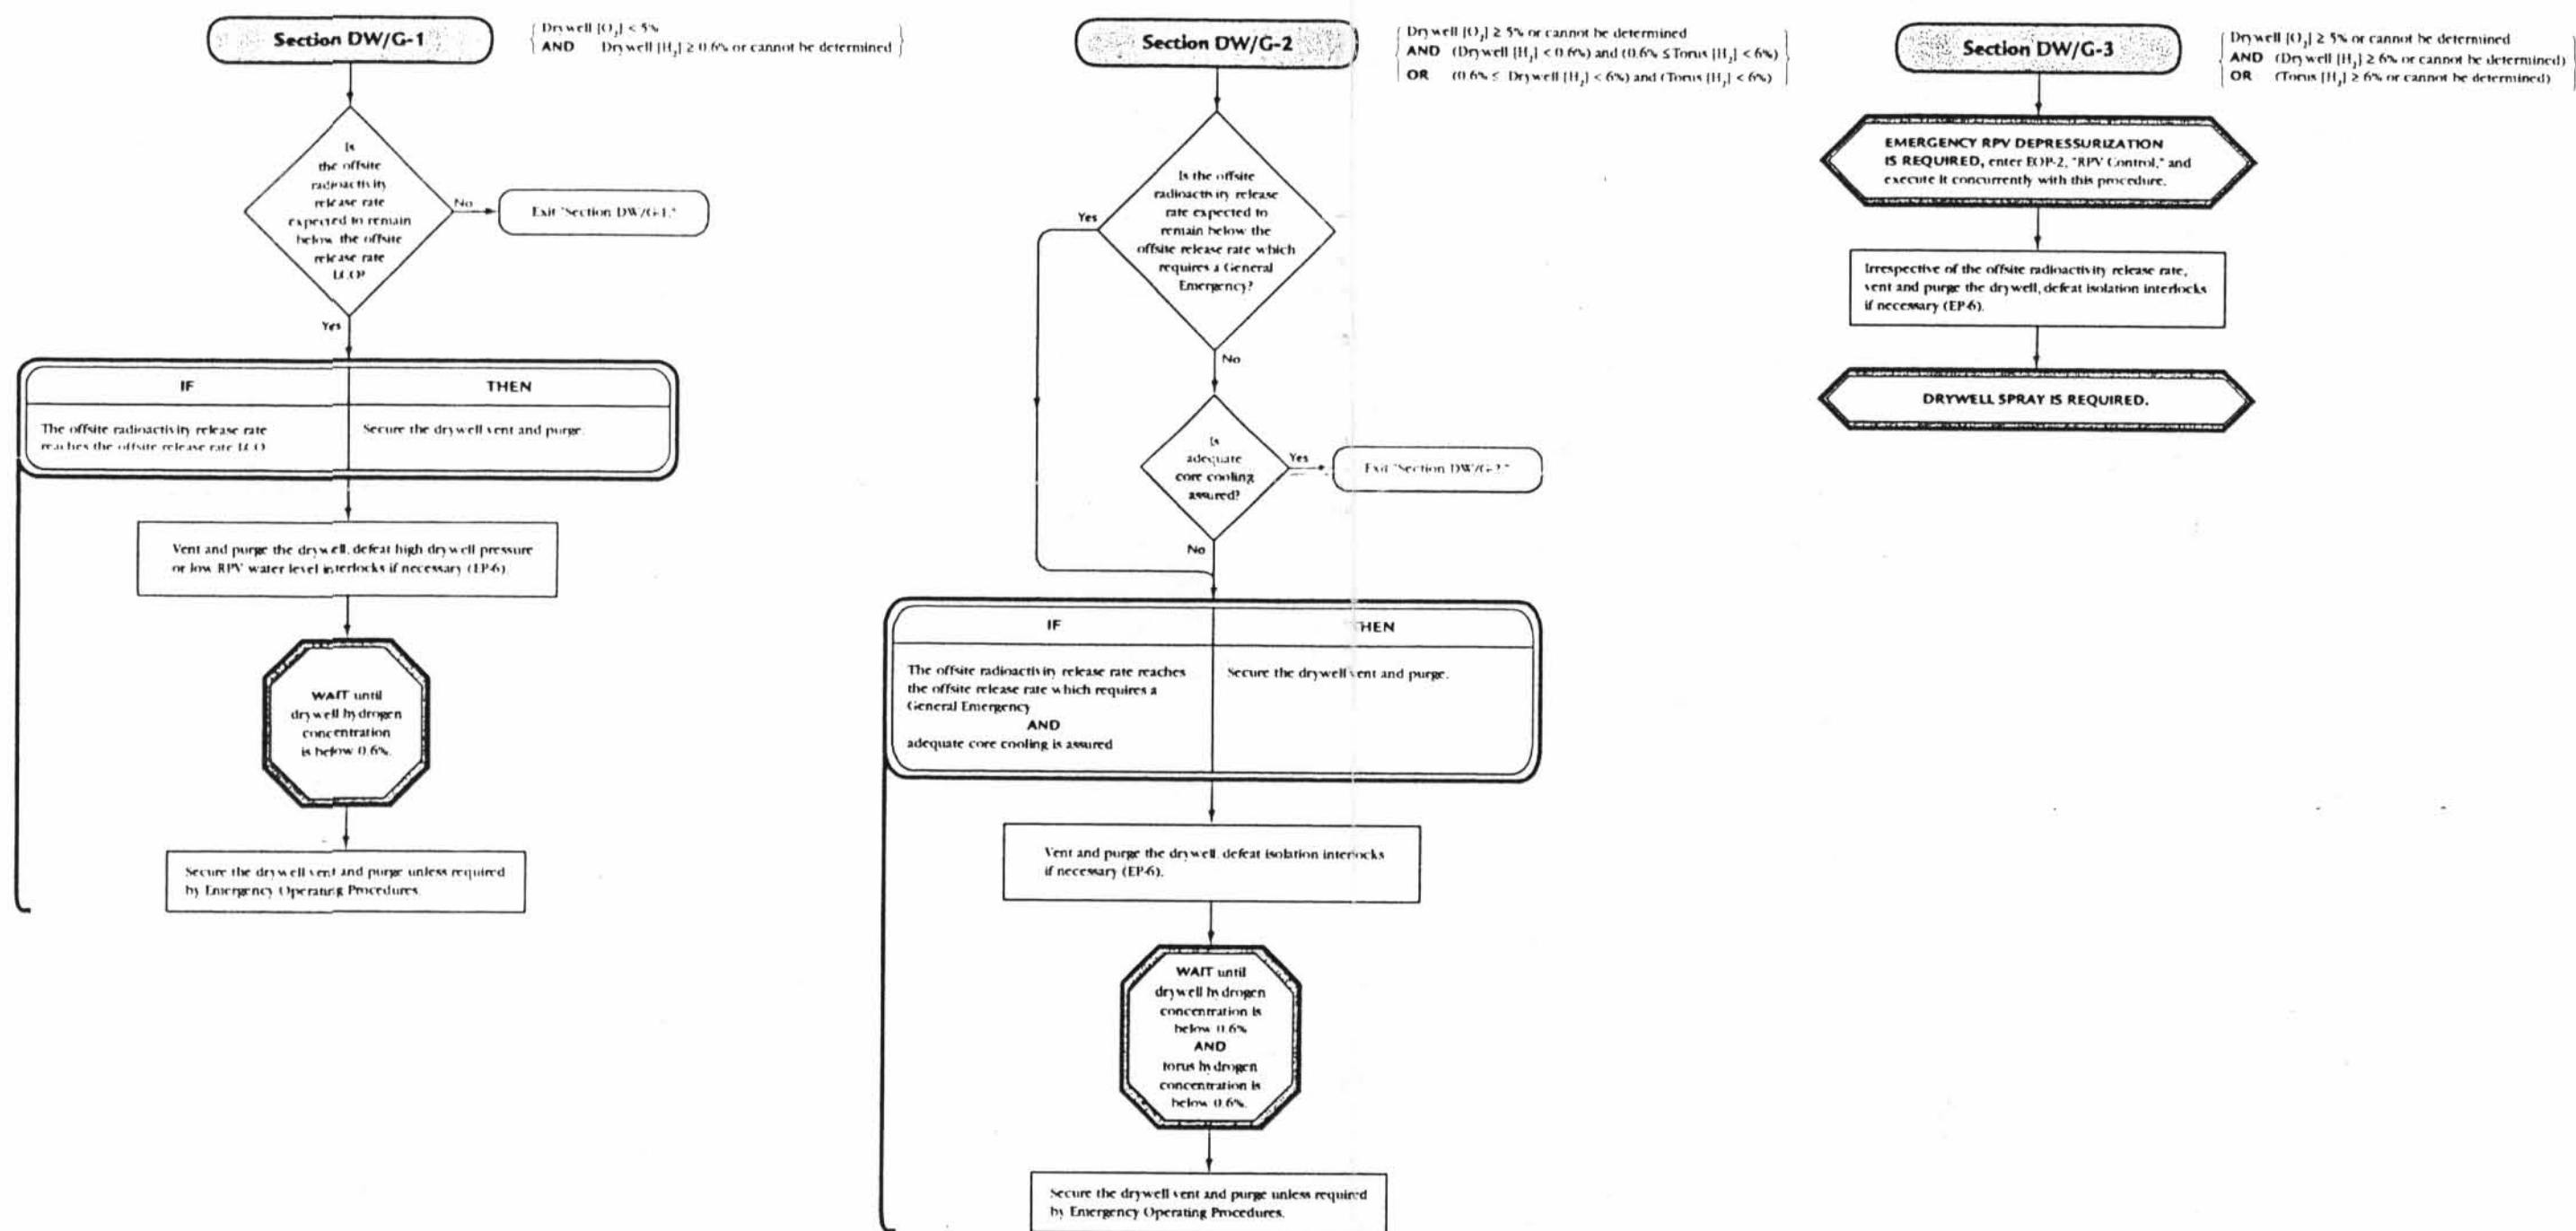

Drywell Gas Control

Torus Gas Control

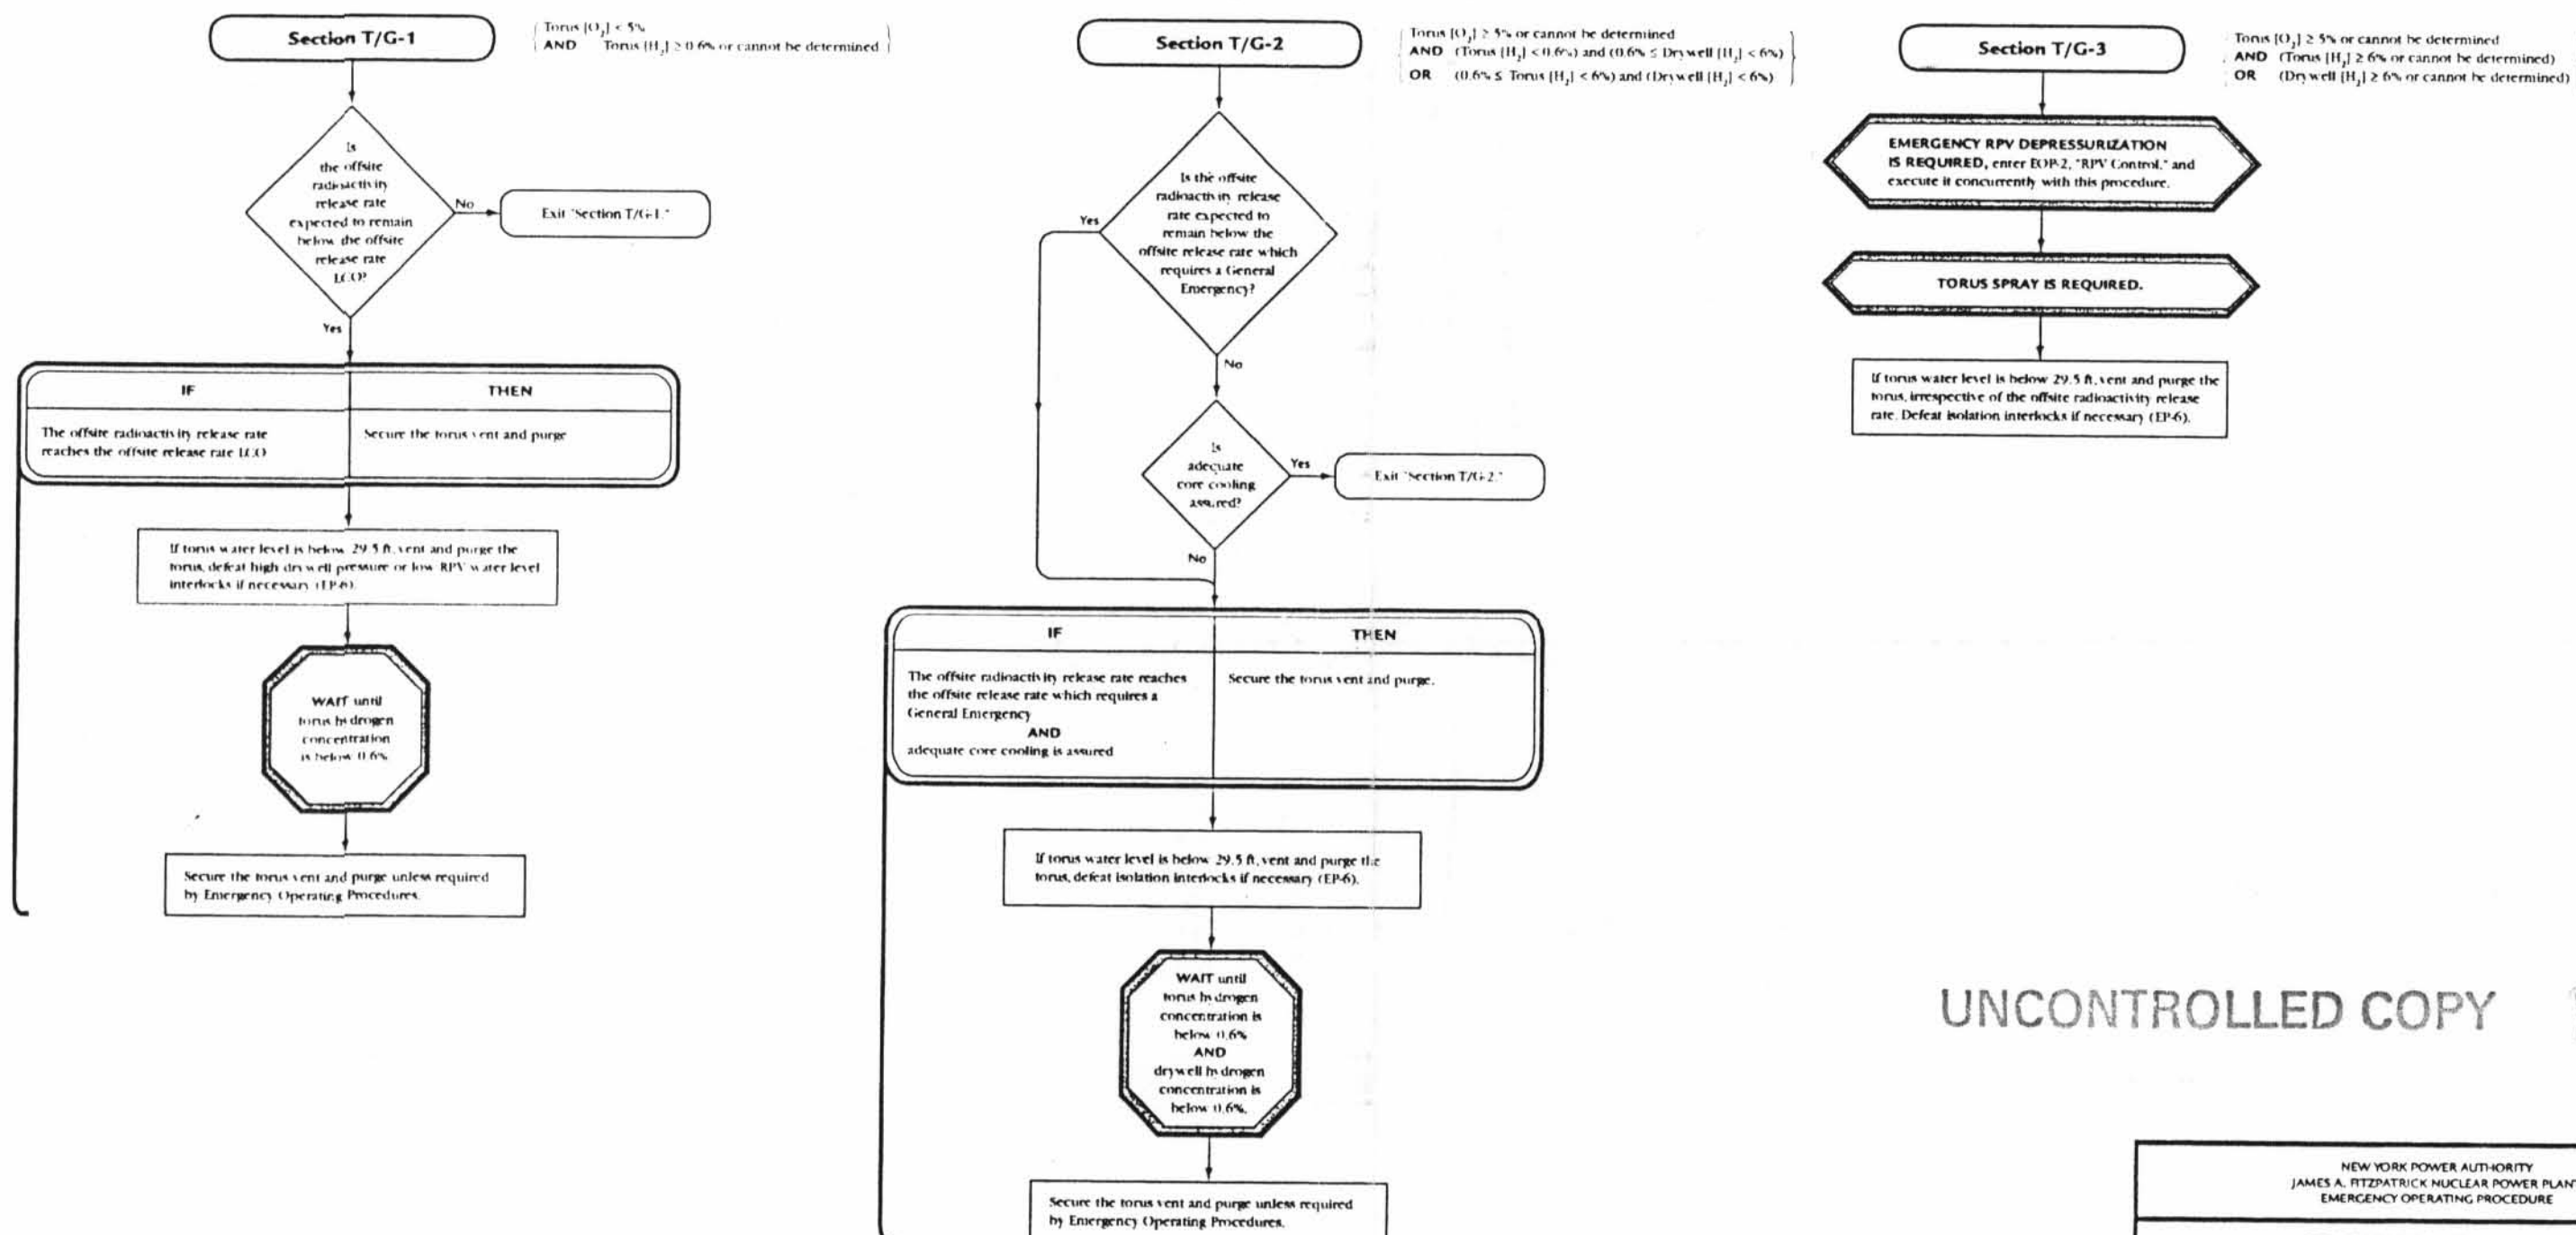

UNCONTROLLED COPY 10

NEW YORK POWER AUTHORITY
 JAMES A. FITZPATRICK NUCLEAR POWER PLANT
 EMERGENCY OPERATING PROCEDURE

PRIMARY CONTAINMENT
 GAS CONTROL

EOP-4a

Rev. 5

13 Dec 98

D-1