



Entergy Operations, Inc.
17265 River Road
Killona, LA 70066
Tel 504 739 6379

Everett P. Perkins, Jr.
Director, Nuclear Safety Assurance
Waterford 3

W3F1-2000-0060
A4.05
PR

July 25, 2000

U.S. Nuclear Regulatory Commission
ATTN: Document Control Desk
Washington, D.C. 20555

Subject: Waterford 3 SES
Docket No. 50-382
License No. NPF-38
Waterford 3 Cycle 10 Core Operating Limits Report

Gentlemen:

Waterford 3 Technical Specification 6.9.1.11.3 requires submittal of the Core Operating Limits Report (COLR) for each reload cycle. Revision 2 of the COLR for Waterford 3 Cycle 10 was submitted on February 4, 2000, by letter W3F1-00-0012.

Please find attached Revision 3 of the COLR for Cycle 10. In Revision 3, Methodologies Item 5 was revised to reflect the new ABB-CE Small Break Loss of Coolant Accident evaluation model approved by the NRC in Waterford 3 Technical Specification Amendment 158.

This letter contains no commitments.

Very truly yours,

A handwritten signature in cursive script, reading "Everett P. Perkins, Jr.", with a long horizontal flourish extending to the right.

E.P. Perkins, Jr.
Director,
Nuclear Safety Assurance

EPP/ELL/RLW/rtk
Attachment: Core Operating Limits Report

cc: E.W. Merschoff, NRC Region IV, N. Kalyanam, NRC-NRR,
J. Smith, N.S. Reynolds, NRC Resident Inspectors Office

A001


ENTERGY OPERATIONS


WATERFORD 3


CORE OPERATING LIMITS REPORT


FOR CYCLE 10

REVISION 3

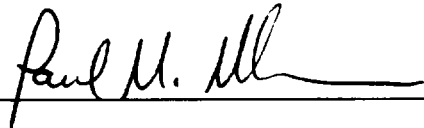Prepared by: P.M. Melancon 

Reviewed by: E. L. Lemke  4/25/00

Approved by: J. B. Holman  4/25/00
Safety & Engineering Analysis

Approved by: A. E. Wemett  for AEW 4/25/00
Licensing

WATERFORD 3
CORE OPERATING LIMITS REPORT
CYCLE 10, REVISION 3

<u>INDEX</u>	<u>Page</u>
I. INTRODUCTION	5
II. AFFECTED TECHNICAL SPECIFICATIONS	6
3.1.1.1 Shutdown Margin - Any Full Length CEA Withdrawn	COLR 3/4 1-1
3.1.1.2 Shutdown Margin - All Full Length CEAs Fully Inserted	COLR 3/4 1-3
3.1.1.3 Moderator Temperature Coefficient	COLR 3/4 1-4
3.1.2.9 Boron Dilution	COLR 3/4 1-15
3.1.3.1 Movable Control Assemblies - CEA Position	COLR 3/4 1-18
3.1.3.6 Regulating CEA Group Insertion Limits	COLR 3/4 1-25
3.1.3.7 Part Length CEA Group Insertion Limits	COLR 3/4 1-28
3.2.1 Linear Heat Rate	COLR 3/4 2-1
3.2.3 Azimuthal Power Tilt - T_q	COLR 3/4 2-4
3.2.4 DNBR Margin	COLR 3/4 2-6
3.2.7 Axial Shape Index	COLR 3/4 2-12
3.9.1 Boron Concentration	COLR 3/4 9-1

LIST OF FIGURES	PAGE
COLR Figure 1. Shutdown Margin Versus Cold Leg Temperature	COLR 3/4 1-3A
COLR Figure 2. Moderator Temperature Coefficient Versus % of Rated Thermal Power	COLR 3/4 1-4A
COLR Figure 2A Cold Leg Temperature versus % of Rated Thermal Power Critical Boron Concentration (CBC) Less than or Equal to 153 and greater than 100 ppm	COLR 3/4 1-4B
COLR Figure 2B Cold Leg Temperature versus % of Rated Thermal Power Critical Boron Concentration (CBC) Less than or Equal to 100 and greater than 50 ppm	COLR 3/4 1-4C
COLR Figure 2C Cold Leg Temperature versus % of Rated Thermal Power Critical Boron Concentration (CBC) Less than or Equal to 50 ppm	COLR 3/4 1-4D
COLR Figure 3. Required Power Reduction After Single CEA Deviation	COLR 3/4 1-18A
COLR Figure 4. Regulating CEA Group Insertion Limits Versus Thermal Power	COLR 3/4 1-25A
COLR Figure 5. Part Length CEA Group Insertion Limits Versus Thermal Power	COLR 3/4 1-28A
COLR Figure 6. Allowable Peak Linear Heat Rate Versus T _c (COLSS in Service)	COLR 3/4 2-1A
COLR Figure 7. Allowable Peak Linear Heat Rate Versus T _c (COLSS Out of Service)	COLR 3/4 2-1B
COLR Figure 8. Allowable DNBR with Any CEAC Operable (COLSS Out of Service)	COLR 3/4 2-6A
COLR Figure 9. Allowable DNBR with No CEAC(s) Operable (COLSS Out of Service)	COLR 3/4 2-6B

LIST OF TABLES

PAGE

COLR Table 1.	Required Monitoring Frequencies for Backup Boron Dilution Detection as a Function of Operating Charging Pumps and Plant Operational Modes for K_{eff} Greater Than 0.98.	COLR 3/4 1-15A
COLR Table 2.	Required Monitoring Frequencies for Backup Boron Dilution Detection as a Function of Operating Charging Pumps and Plant Operational Modes for K_{eff} Greater Than 0.97 and Less Than or Equal to 0.98.	COLR 3/4 1-15B
COLR Table 3.	Required Monitoring Frequencies for Backup Boron Dilution Detection as a Function of Operating Charging Pumps and Plant Operational Modes for K_{eff} Greater Than 0.96 and Less Than or Equal to 0.97.	COLR 3/4 1-15C
COLR Table 4.	Required Monitoring Frequencies for Backup Boron Dilution Detection as a Function of Operating Charging Pumps and Plant Operational Modes for K_{eff} Greater Than 0.95 and Less Than or Equal to 0.96.	COLR 3/4 1-15D
COLR Table 5.	Required Monitoring Frequencies for Backup Boron Dilution Detection as a Function of Operating Charging Pumps and Plant Operational Modes for K_{eff} Less Than or Equal to 0.95.	COLR 3/4 1-15E

III. METHODOLOGIES

36

WATERFORD 3
CORE OPERATING LIMITS REPORT
CYCLE 10, REVISION 3

I. INTRODUCTION

This CORE OPERATING LIMITS REPORT (COLR) has been prepared in accordance with the requirements of Waterford 3 Technical Specification 6.9.5 for Waterford 3 Cycle 10. The core operating limits have been developed using the NRC approved methodologies specified in Section III. This is Revision 3 of the Cycle 10 COLR.

Changes between Cycle 10, Revision 2, and Cycle 10, Revision 3, included in this revision are:

Revised Section III, Methodologies, Item 5, to reflect the new ABB-CE Small Break LOCA evaluation model approved by the NRC in Waterford 3 Technical Specification Amendment 158.

II. AFFECTED TECHNICAL SPECIFICATIONS

CORE OPERATING LIMITS REPORT

SHUTDOWN MARGIN - ANY FULL LENGTH CEA WITHDRAWN


- 3.1.1.1 The SHUTDOWN MARGIN shall be greater than or equal to 5.15% $\Delta k/k$ when T_{avg} is greater than 200 °F or 2.0% $\Delta k/k$ when T_{avg} is less than or equal to 200 °F.

CORE OPERATING LIMITS REPORT

SHUTDOWN MARGIN - ALL FULL LENGTH CEAs FULLY INSERTED

3.1.1.2 The SHUTDOWN MARGIN shall be maintained within the region of acceptable operation of COLR Figure 1.

Shutdown Margin Versus Cold Leg Temperature

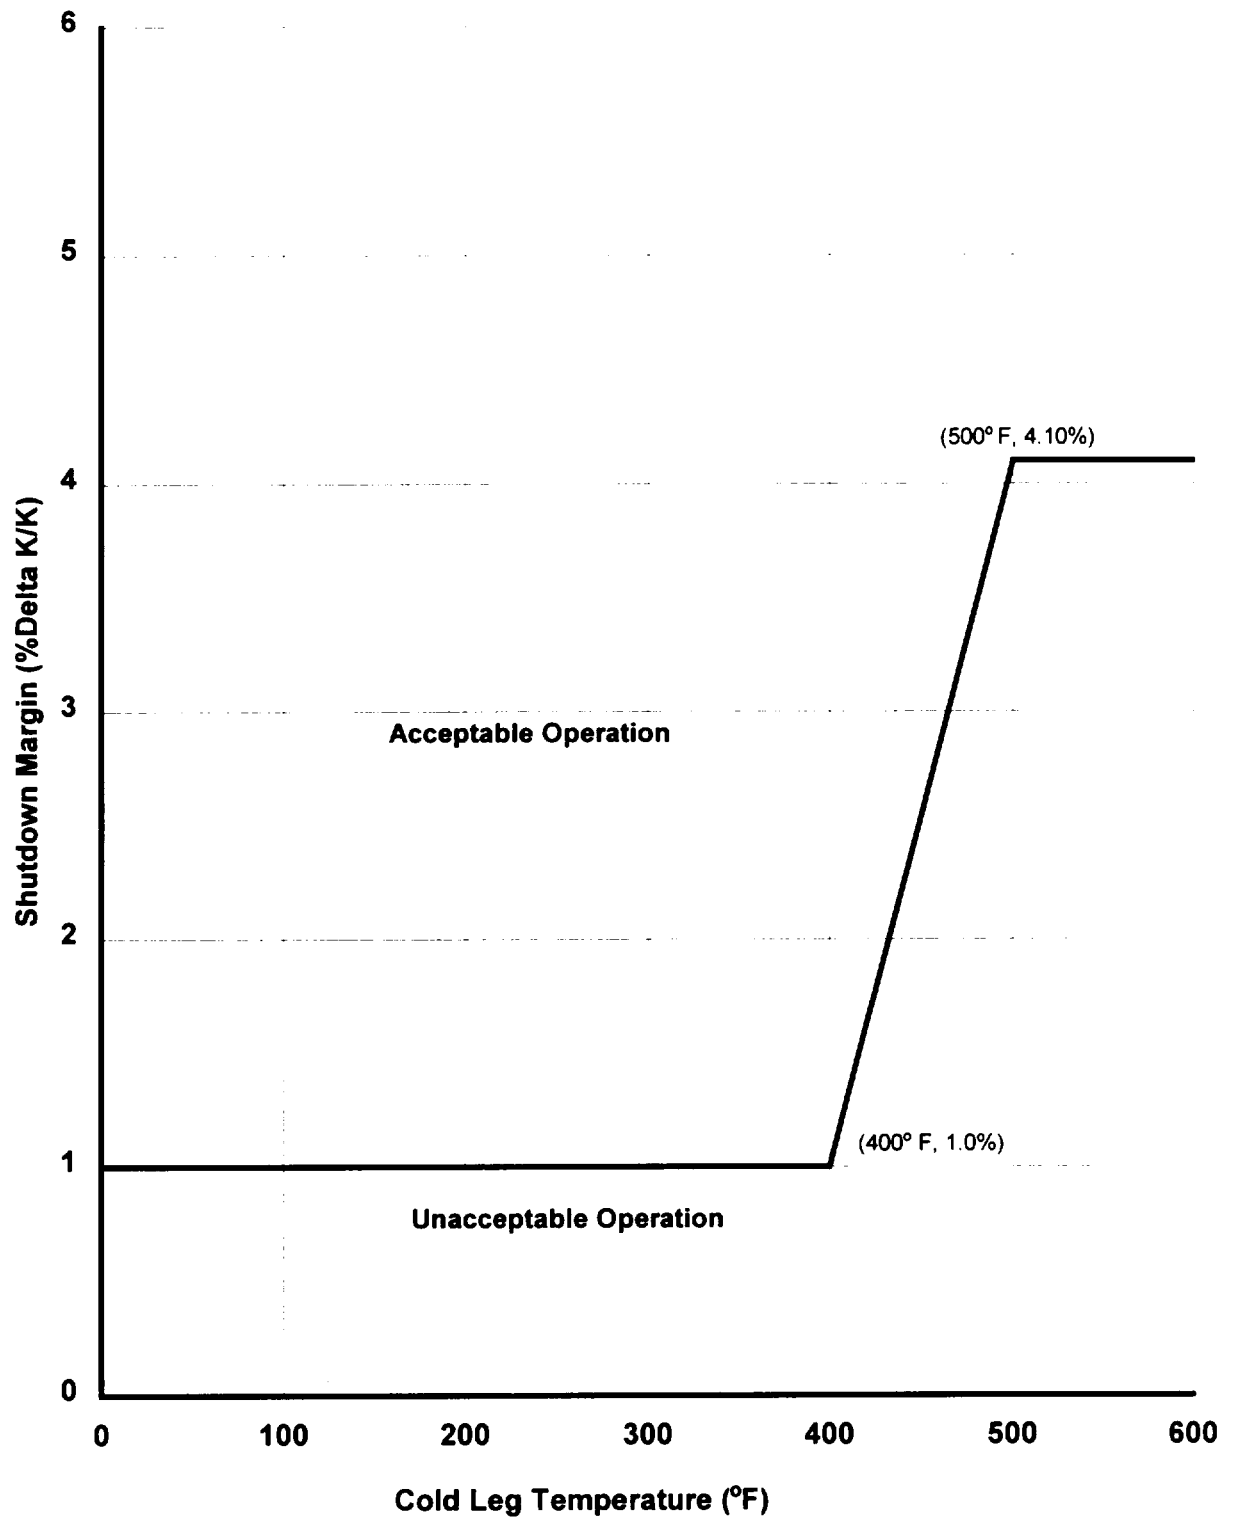

COLR Figure 1

CORE OPERATING LIMITS REPORT


MODERATOR TEMPERATURE COEFFICIENT

3.1.1.3 The Moderator Temperature Coefficient (MTC) shall be maintained within the region of acceptable operation of COLR Figure 2.

Restrictions: To maintain the Cycle 10 MTC limits within COLR Figure 2 at a power level greater than 70% rated thermal power, the plant operation shall meet the following restrictions:


- With the Critical Boron Concentration (CBC) less than or equal to 153 ppm and greater than 100 ppm, the COLR Figure 2A cold leg temperature and power restrictions shall be maintained within the region of acceptable operation.
- With the CBC less than or equal to 100 ppm and greater than 50 ppm, the COLR Figure 2B cold leg temperature and power restrictions shall be maintained within the region of acceptable operation.
- With the CBC less than or equal to 50 ppm, the COLR Figure 2C cold leg temperature and power restrictions shall be maintained within the region of acceptable operation.

Moderator Temperature Coefficient Versus % of Rated Thermal Power

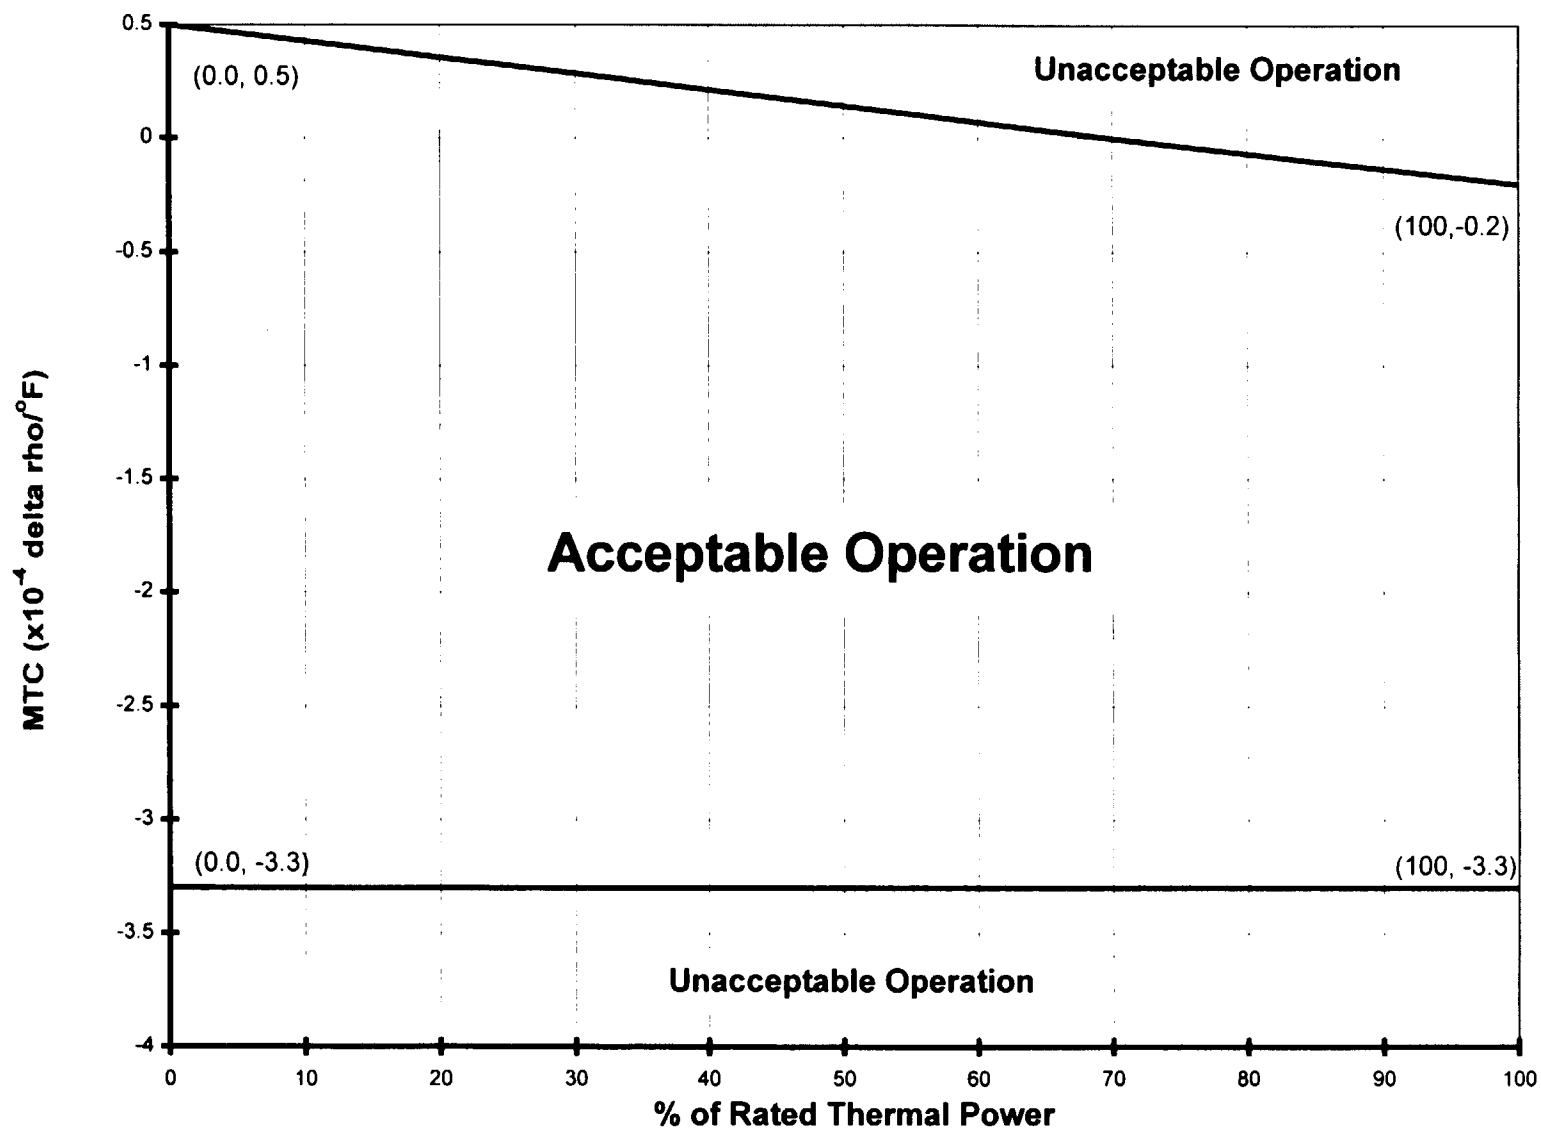


COLR Figure 2

Cold Leg Temperature versus % of Rated Thermal Power
Critical Boron Concentration (CBC) Less than or Equal to 153 ppm and Greater than 100 ppm
(153 ppm \geq CBC > 100 ppm)

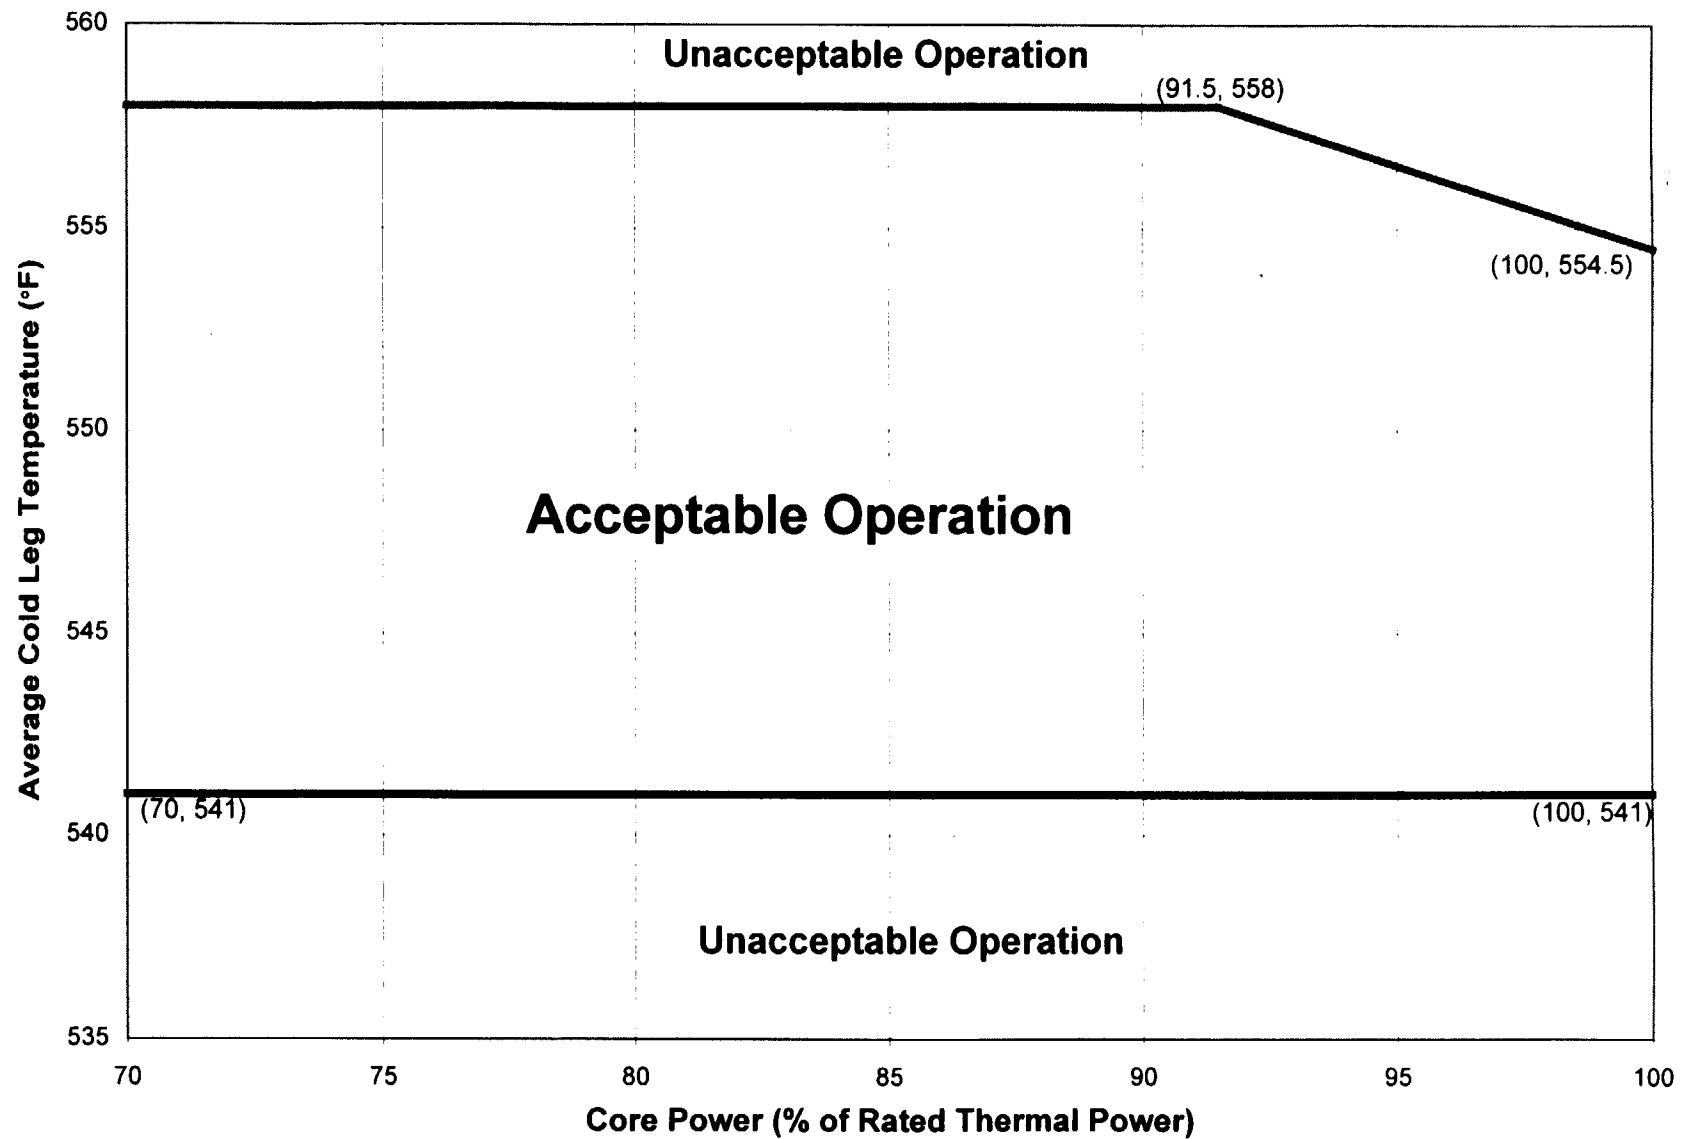


COLR Figure 2A

Cold Leg Temperature versus % of Rated Thermal Power
Critical Boron Concentration (CBC) Less than or Equal to 100 ppm and Greater than 50 ppm
(100 ppm \geq CBC > 50 ppm)

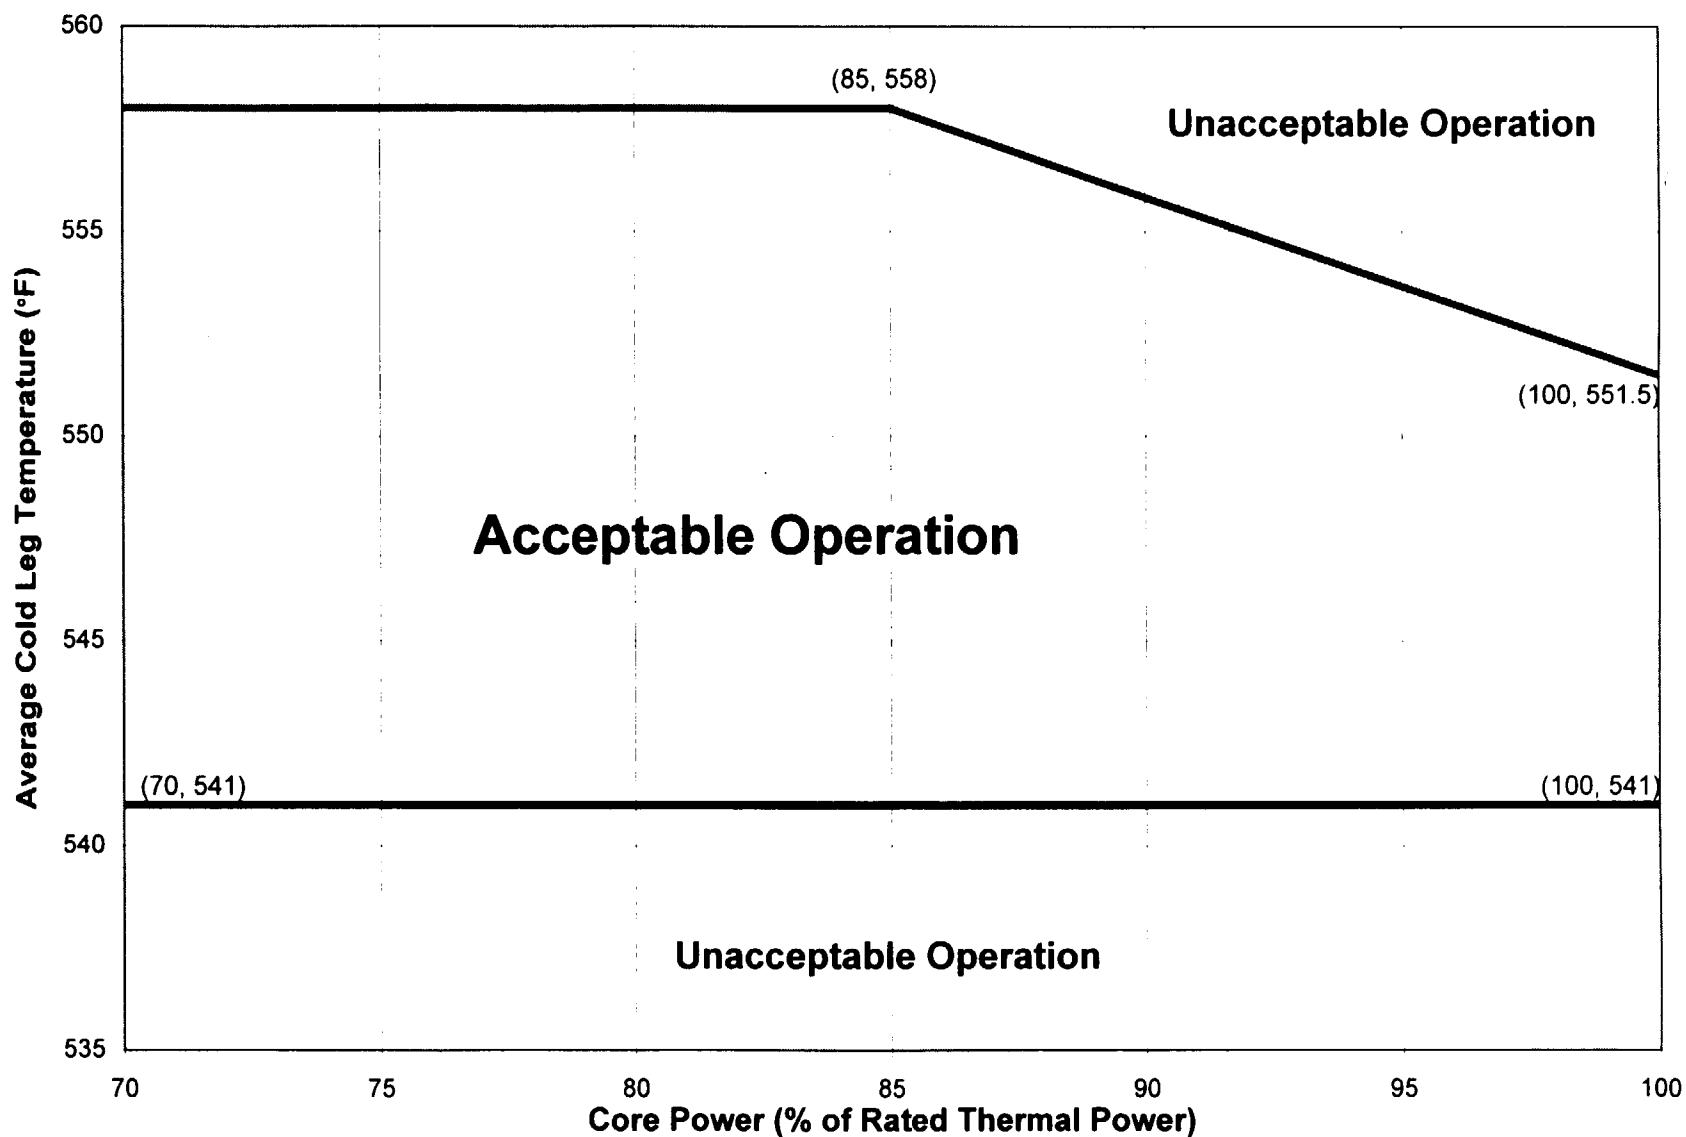

COLR Figure 2B

**Cold Leg Temperature versus % of Rated Thermal Power
Critical Boron Concentration (CBC) Less than or Equal to 50 ppm
(CBC ≤ 50 ppm)**

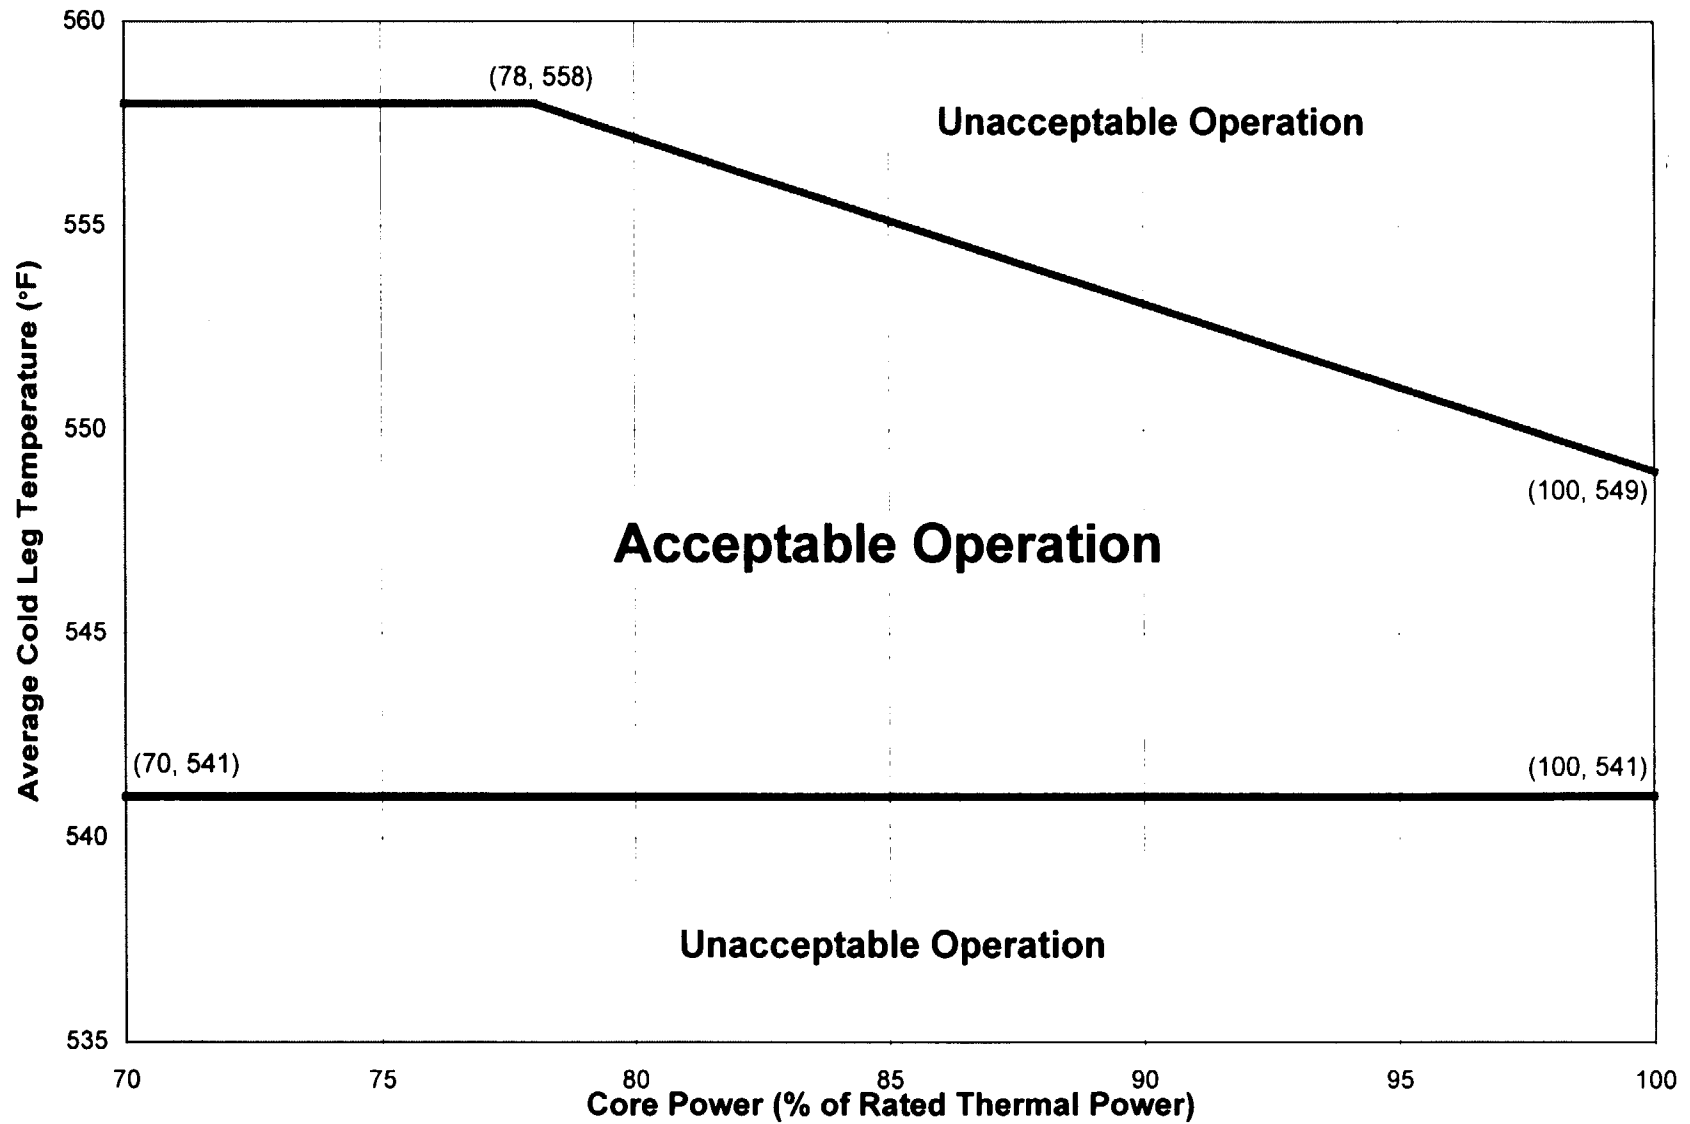

COLR Figure 2C

CORE OPERATING LIMITS REPORT

BORON DILUTION

3.1.2.9 See COLR Tables 1 through 5 for required RCS boron concentration monitoring frequencies and Charging Pump operation limits.

SURVEILLANCE REQUIREMENTS

Each required boron dilution alarm shall be adjusted to less than or equal to twice (2x) the existing neutron flux (cps) at the following frequencies:

- a. No sooner than one half hour after shutdown.
- b. At least once per hour if the reactor has been shutdown < 10 hours.
- c. At least once per 5 hours if the reactor has been shut down \geq 10 hours but < 25 hours.
- d. At least once per 24 hours if the reactor has been shut down \geq 25 hours but < 21 days.
- e. At least once per 7 days if the reactor has been shut down \geq 21 days.

COLR TABLE 1

REQUIRED MONITORING FREQUENCIES FOR BACKUP BORON
DILUTION DETECTION AS A FUNCTION OF OPERATING
CHARGING PUMPS AND PLANT OPERATIONAL MODES FOR
 K_{eff} GREATER THAN 0.98

$K_{eff} > 0.98$

OPERATIONAL MODE	Number of Operating Charging Pumps [*]			
	0	1	2	3
3	12 hours	0.75 hours	Operation not allowed ^{**}	
4	12 hours	Operation not allowed ^{**}		
5 RCS filled	8 hours	Operation not allowed ^{**}		
5 RCS partially drained	8 hours	Operation not allowed ^{**}		
6	Operation not allowed ^{**}			

^{*} Charging pump OPERABILITY for any period of time shall constitute OPERABILITY for the entire monitoring frequency.

^{**} The precluded number of charging pumps shall be verified to be inoperable by racking out their motor circuit breakers.

COLR TABLE 2

REQUIRED MONITORING FREQUENCIES FOR BACKUP BORON
DILUTION DETECTION AS A FUNCTION OF OPERATING
CHARGING PUMPS AND PLANT OPERATIONAL MODES FOR
 K_{eff} GREATER THAN 0.97 AND LESS THAN OR EQUAL TO 0.98

$$0.98 \geq K_{eff} > 0.97$$

OPERATIONAL MODE	Number of Operating Charging Pumps [*]			
	0	1	2	3
3	12 hours	2.0 hours	0.5 hours	Operation not allowed ^{**}
4	12 hours	0.75 hours	Operation not allowed ^{**}	
5 RCS filled	8 hours	0.75 hours	Operation not allowed ^{**}	
5 RCS partially drained	8 hours	0.5 hours	Operation not allowed ^{**}	
6	Operation not allowed ^{**}			

^{*} Charging pump OPERABILITY for any period of time shall constitute OPERABILITY for the entire monitoring frequency.

^{**} The precluded number of charging pumps shall be verified to be inoperable by racking out their motor circuit breakers.

COLR TABLE 3

REQUIRED MONITORING FREQUENCIES FOR BACKUP BORON
DILUTION DETECTION AS A FUNCTION OF OPERATING
CHARGING PUMPS AND PLANT OPERATIONAL MODES FOR
 K_{eff} GREATER THAN 0.96 AND LESS THAN OR EQUAL TO 0.97

$$0.97 \geq K_{eff} > 0.96$$

OPERATIONAL MODE	Number of Operating Charging Pumps*			
	0	1	2	3
3	12 hours	3.0 hours	1.25 hours	0.5 hours
4	12 hours	1.5 hours	Operation not allowed**	
5 RCS filled	8 hours	1.5 hours	Operation not allowed**	
5 RCS partially drained	8 hours	0.75 hours	Operation not allowed**	
6	Operation not allowed**			

^{*} Charging pump OPERABILITY for any period of time shall constitute OPERABILITY for the entire monitoring frequency.

^{**} The precluded number of charging pumps shall be verified to be inoperable by racking out their motor circuit breakers.

COLR TABLE 4

REQUIRED MONITORING FREQUENCIES FOR BACKUP BORON
DILUTION DETECTION AS A FUNCTION OF OPERATING
CHARGING PUMPS AND PLANT OPERATIONAL MODES FOR
 K_{eff} GREATER THAN 0.95 AND LESS THAN OR EQUAL TO 0.96

$$0.96 \geq K_{eff} > 0.95$$

OPERATIONAL MODE	Number of Operating Charging Pumps [*]			
	0	1	2	3
3	12 hours	4.0 hours	2.0 hours	1.0 hours
4	12 hours	2.25 hours	0.75 hours	Operation not allowed ^{**}
5 RCS filled	8 hours	2.0 hours	0.75 hours	Operation not allowed ^{**}
5 RCS partially drained	8 hours	2.0 hours	0.5 hours	Operation not allowed ^{**}
6	Operation not allowed ^{**}			

^{*} Charging pump OPERABILITY for any period of time shall constitute OPERABILITY for the entire monitoring frequency.

^{**} The precluded number of charging pumps shall be verified to be inoperable by racking out their motor circuit breakers.

COLR TABLE 5

REQUIRED MONITORING FREQUENCIES FOR BACKUP BORON
DILUTION DETECTION AS A FUNCTION OF OPERATING
CHARGING PUMPS AND PLANT OPERATIONAL MODES FOR
 K_{eff} LESS THAN OR EQUAL TO 0.95

$$K_{eff} \leq 0.95$$

OPERATIONAL MODE	Number of Operating Charging Pumps*			
	0	1	2	3
3	12 hours	5.0 hours	2.0 hours	1.0 hours
4	12 hours	2.75 hours	1.0 hours	Operation not allowed**
5 RCS filled	8 hours	3.0 hours	1.0 hours	0.5 hours
5 RCS partially drained	8 hours	2.5 hours	0.75 hours	Operation not allowed**
6	24 hours	2.25 hours	0.5 hours	Operation not allowed**


* Charging pump OPERABILITY for any period of time shall constitute OPERABILITY for the entire monitoring frequency.

** The precluded number of charging pumps shall be verified to be inoperable by racking out their motor circuit breakers.

CORE OPERATING LIMITS REPORT

MOVABLE CONTROL ASSEMBLIES - CEA POSITION

- 3.1.3.1.a With one full-length or part-length CEA trippable but misaligned from any other CEA in its group by more than 19 inches, operation in MODES 1 and 2 may continue, provided that core power is reduced in accordance with COLR Figure 3.
- 3.1.3.1.b With one or more full-length or part-length CEAs trippable but misaligned from any other CEAs in its group by more than 7 inches but less than or equal to 19 inches, operation in MODES 1 and 2 may continue, provided that core power is reduced in accordance with COLR Figure 3.

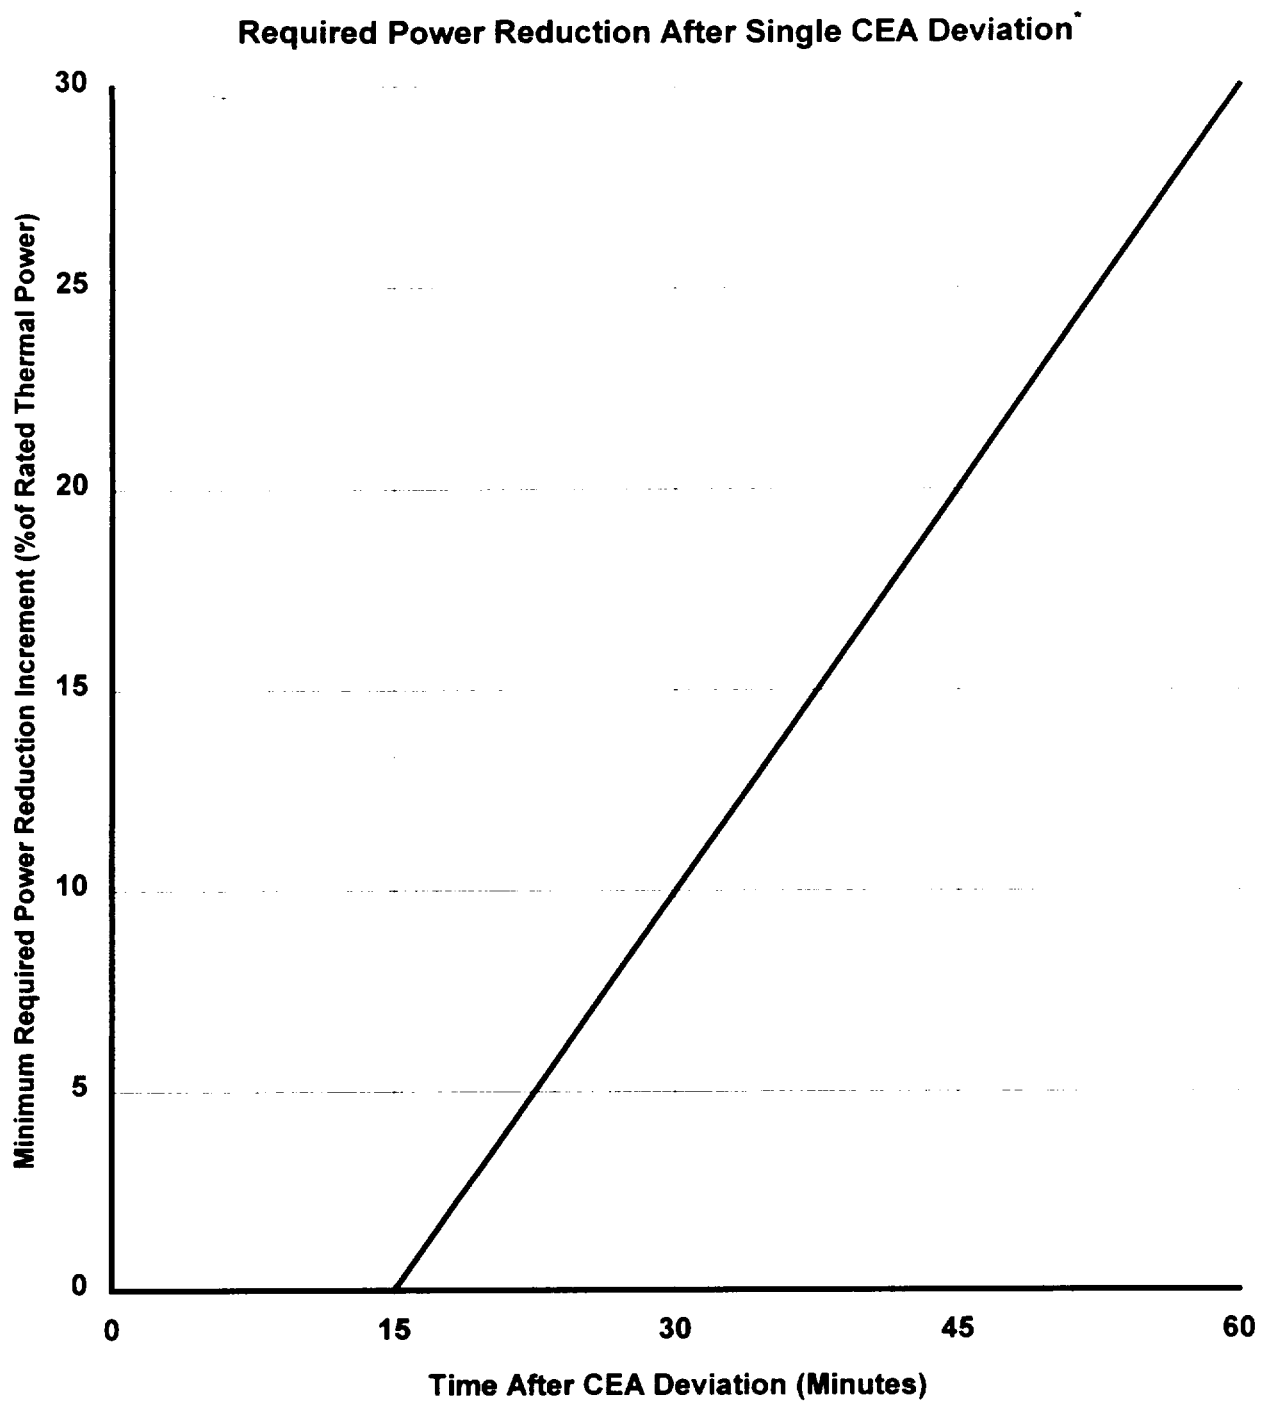


COLR Figure 3

* When thermal power is reduced to 60% of rated thermal power per this limit curve, further reduction is not required by this technical specification.

CORE OPERATING LIMITS REPORT
REGULATING CEA GROUP INSERTION LIMITS

3.1.3.6 The regulating CEA groups shall be limited to the withdrawal sequence and to the insertion limits shown on COLR Figure 4.

Regulating CEA Group Insertion Limits Versus Thermal Power

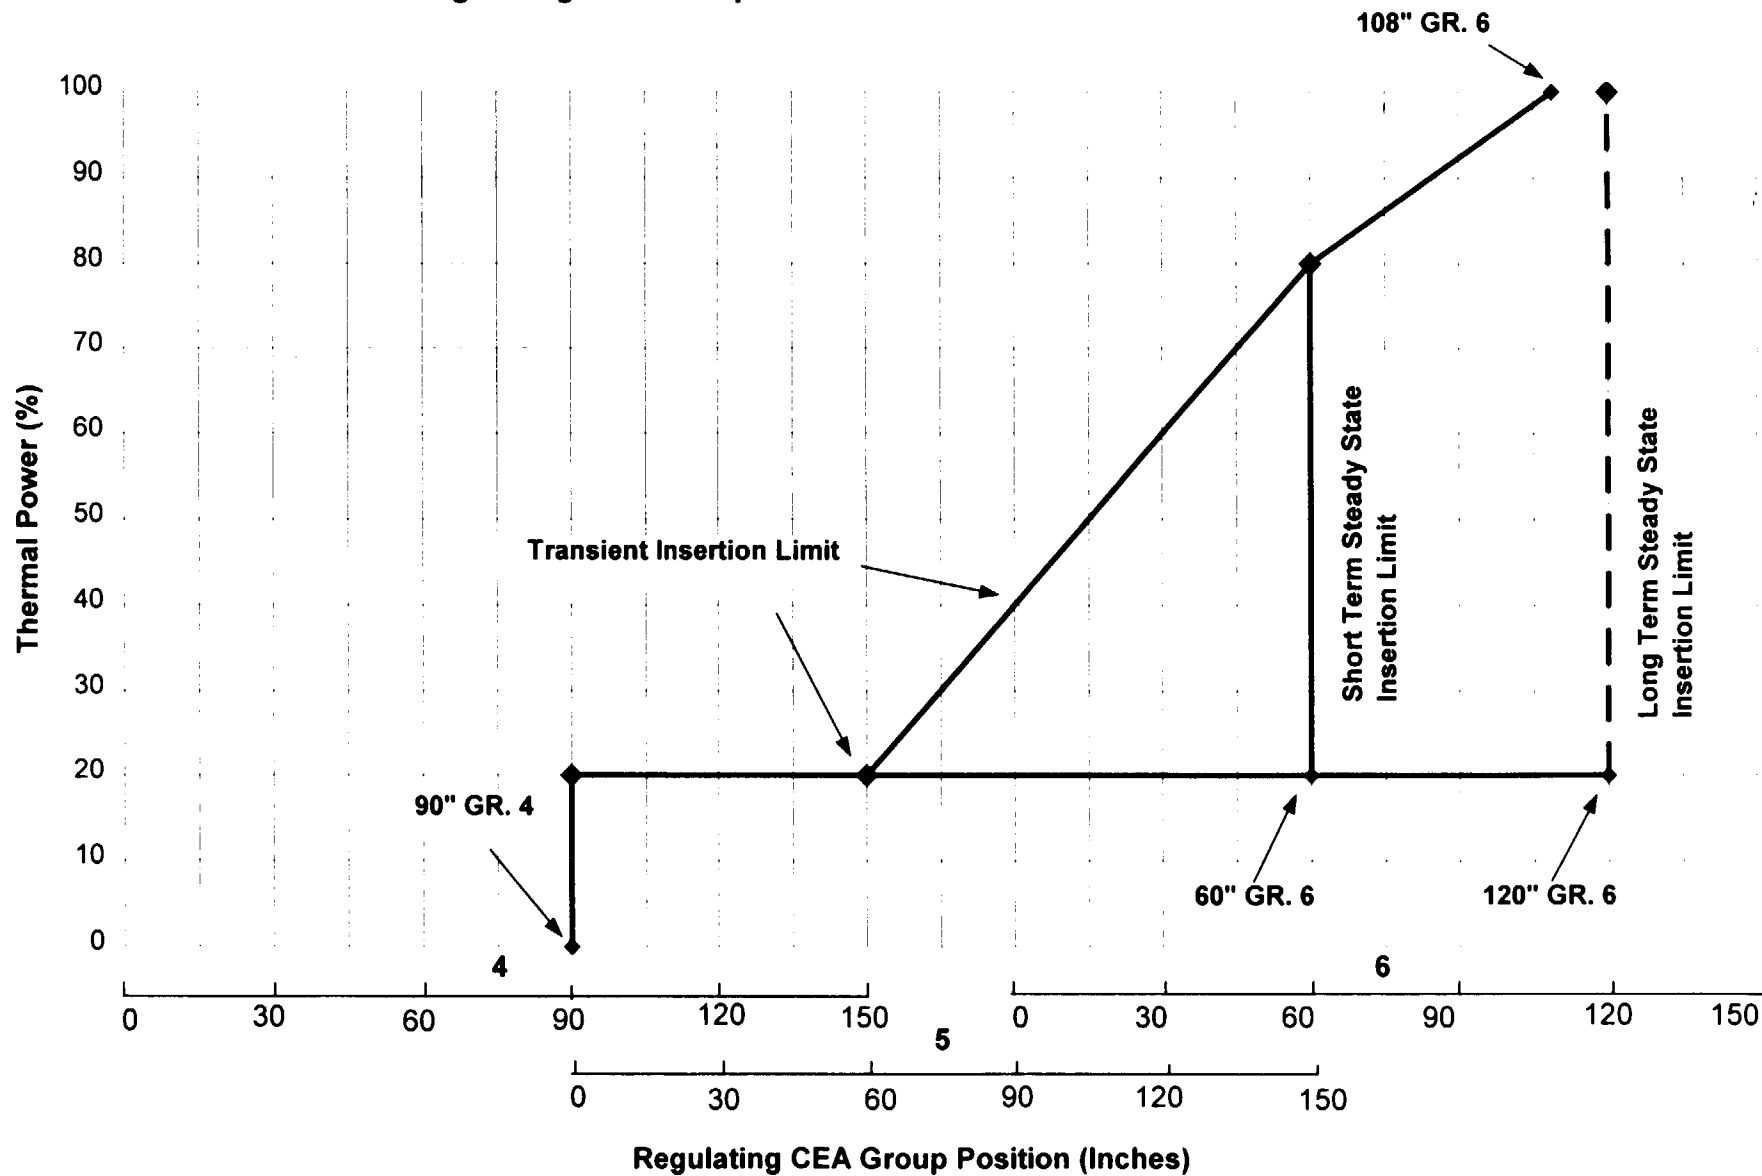


COLR Figure 4

CORE OPERATING LIMITS REPORT

PART LENGTH CEA GROUP INSERTION LIMITS

- 3.1.3.7 The part length CEA group shall be limited to the insertion limits shown on COLR Figure 5.

Part Length CEA Group Insertion Limits Versus Thermal Power

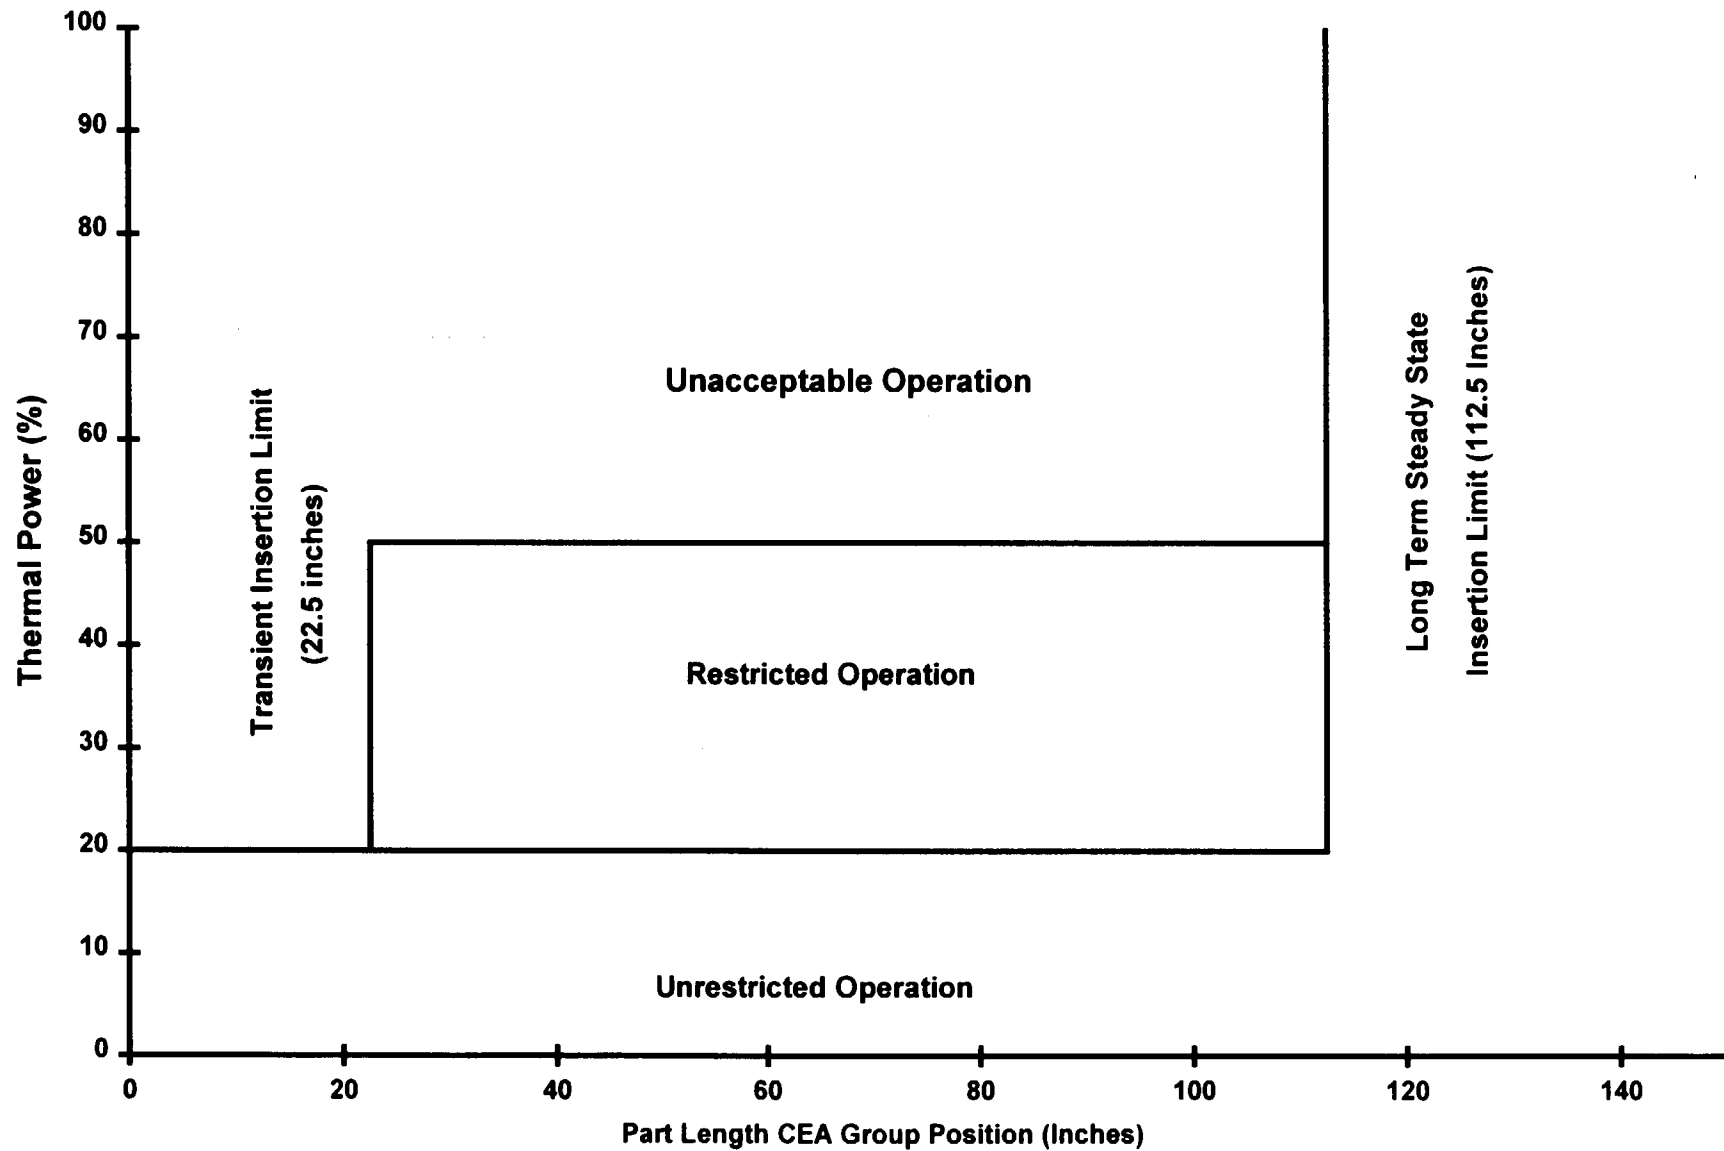

COLR Figure 5


CORE OPERATING LIMITS REPORT

LINEAR HEAT RATE


3.2.1 The linear heat rate shall be maintained:

- a. Within the region of acceptable operation of COLR Figure 6, when COLSS is in service.
- b. Within the region of acceptable operation of COLR Figure 7, when COLSS is out of service.

**Allowable Peak Linear Heat Rate Versus Tc
(COLSS in Service)**

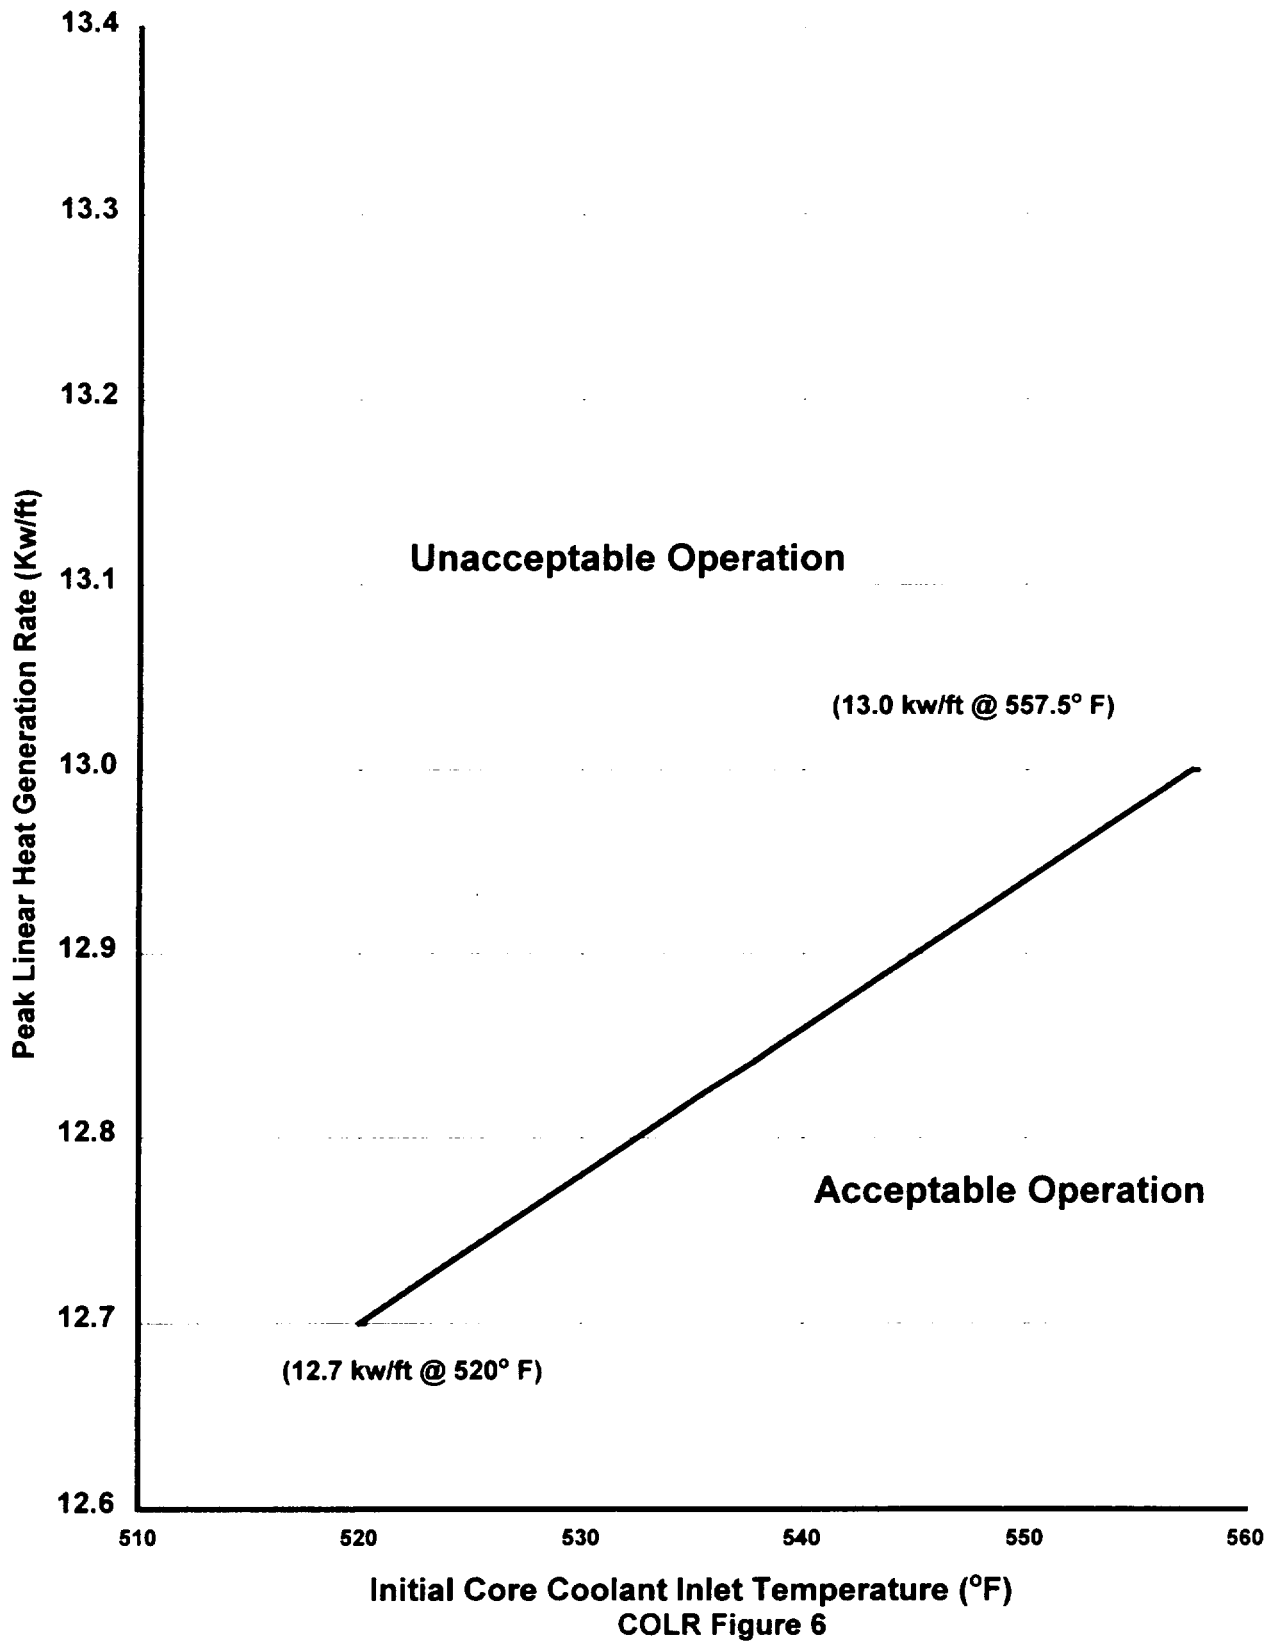

**Allowable Peak Linear Heat Rate Versus Tc
(COLSS Out of Service)**

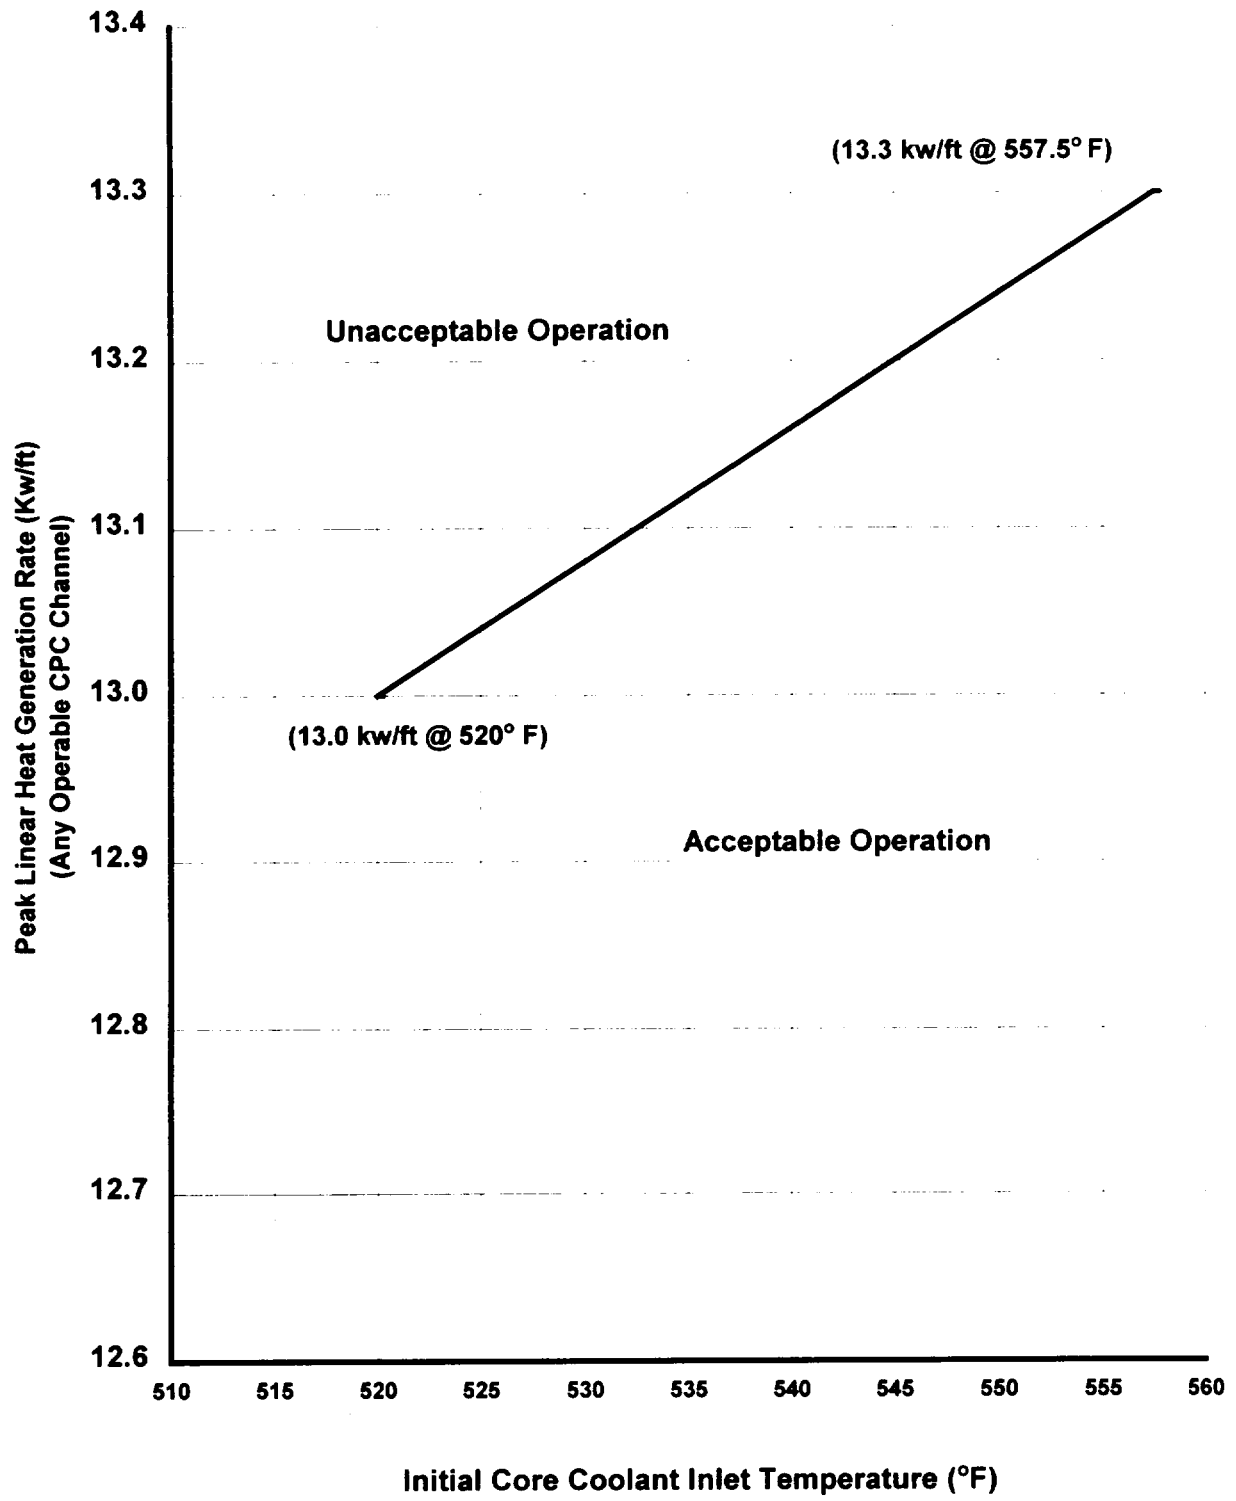

COLR Figure 7

CORE OPERATING LIMITS REPORT

AZIMUTHAL POWER TILT- T_q

3.2.3 The measured AZIMUTHAL POWER TILT shall be maintained ≤ 0.03 .


CORE OPERATING LIMITS REPORT

DNBR MARGIN


3.2.4 The DNBR margin shall be maintained by one of the following methods:

- a) When COLSS is in service and neither CEAC is operable: maintain COLSS calculated core power less than or equal to COLSS calculated core power operating limit based on DNBR decreased by 13% RATED THERMAL POWER.
- b) When COLSS is out of service and at least one CEAC is operable: operate within the region of acceptable operation shown on COLR Figure 8, using any operable CPC channel.
- c) When COLSS is out of service and neither CEAC is operable: operate within the region of acceptable operation shown on COLR Figure 9, using any operable CPC channel.

**Allowable DNBR with Any CEAC Operable
(COLSS Out of Service)**

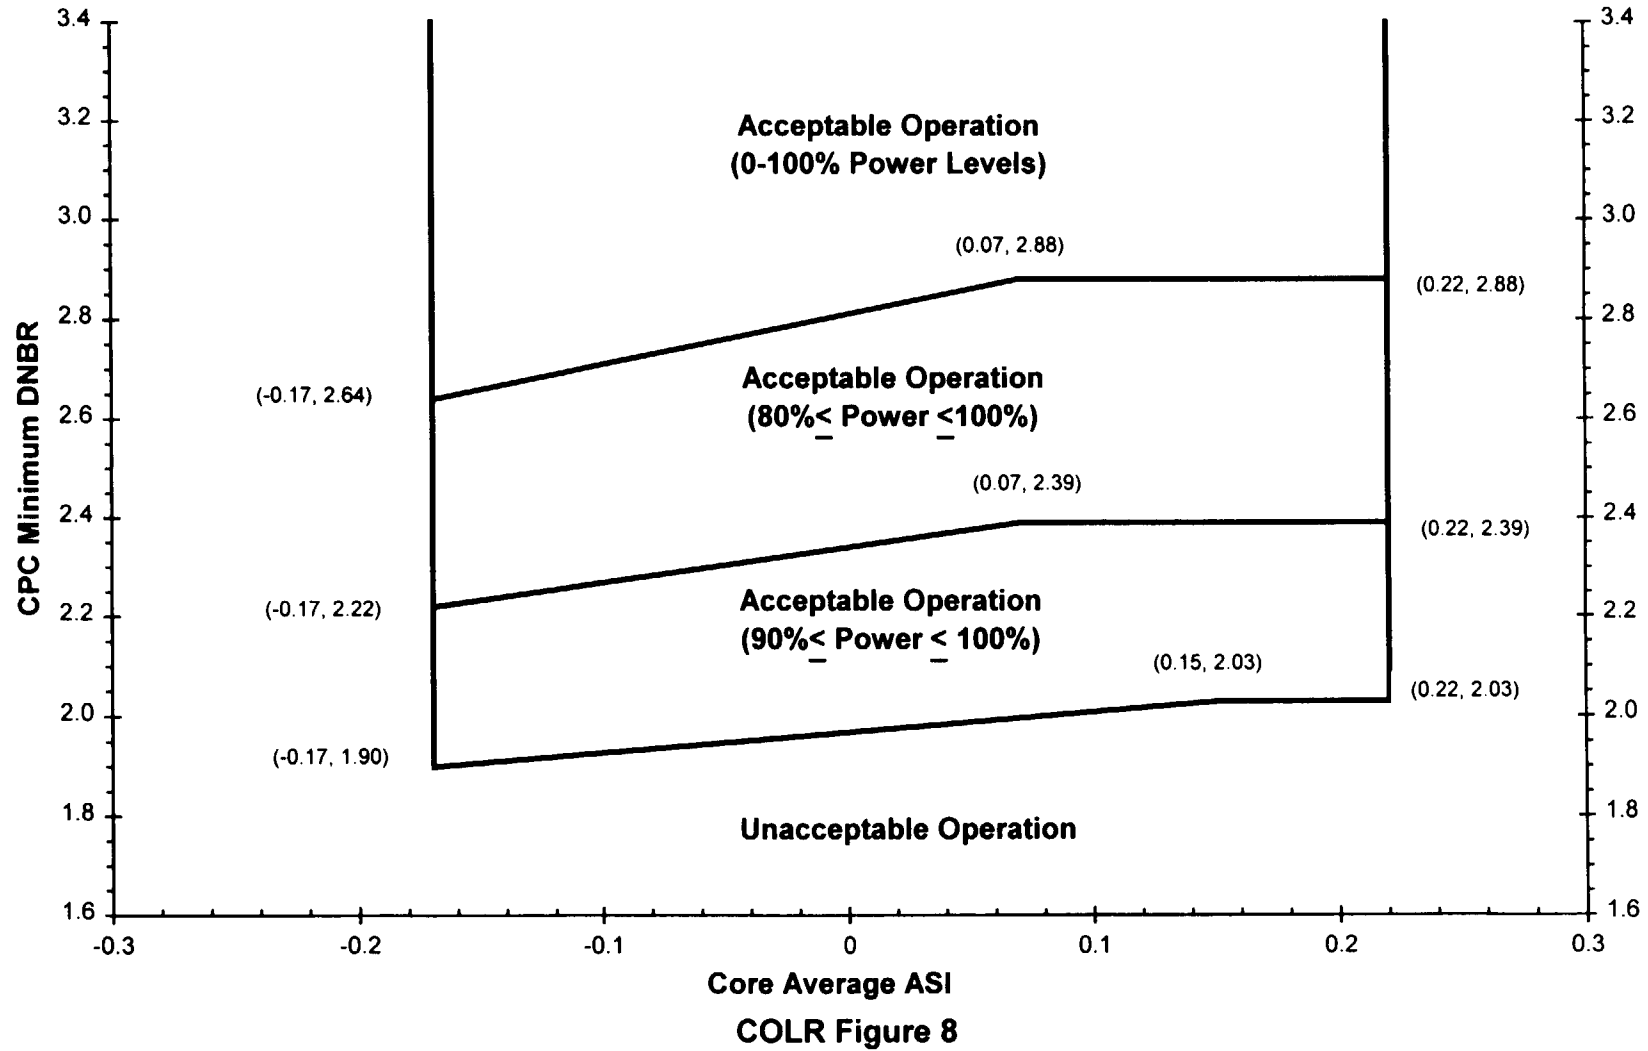

**Allowable DNBR With No CEAC(s) Operable
(COLSS Out of Service)**

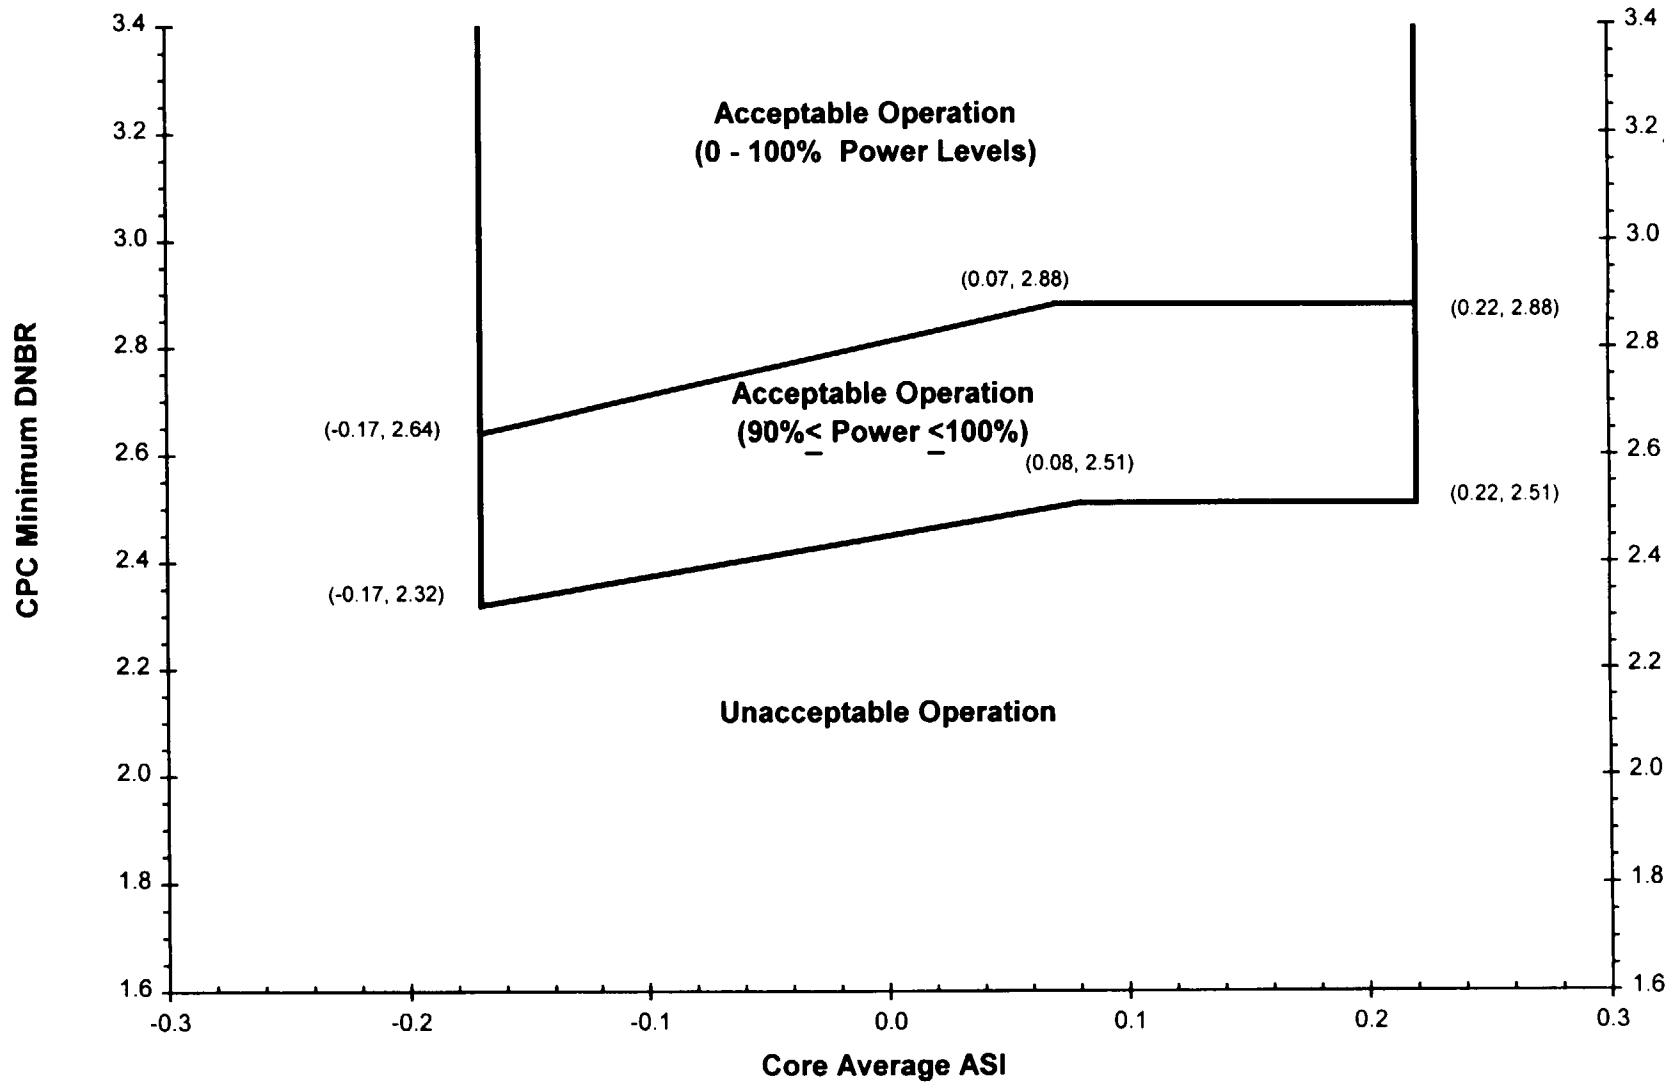

COLR Figure 9

CORE OPERATING LIMITS REPORT

AXIAL SHAPE INDEX

3.2.7 The AXIAL SHAPE INDEX (ASI) shall be maintained within the following limits:

COLSS Operable

$-0.224 \leq \text{ASI} \leq +0.263$ for THERMAL POWERS $\geq 70\%$ of RATED THERMAL POWER

$-0.26 \leq \text{ASI} \leq +0.26$ for THERMAL POWERS $< 70\%$ of RATED THERMAL POWER

COLSS Out of Service

$-0.17 \leq \text{ASI} \leq +0.22$ for THERMAL POWERS from 20% to 100% of RATED THERMAL POWER

CORE OPERATING LIMITS REPORT

BORON CONCENTRATION

- 3.9.1 While in Mode 6, the RCS boron concentration shall be maintained sufficient to ensure that the more restrictive of the following reactivity conditions is met:
- a. Either K_{eff} of 0.95 or less, or
 - b. A boron concentration of greater than or equal to 2050 ppm.

III. METHODOLOGIES

The analytical methods used to determine the core operating limits listed above are those previously reviewed and approved by the NRC in:

1. "The ROCS and DIT Computer Codes for Nuclear Design," CENPD-266-P-A, April 1983; and "C-E Methodology for Core Designs Containing Gadolinia-Urania Burnable Absorber," CENPD-275-P-A, May 1988. Methodology for the limit on Shutdown Margins, MTC, and the Regulating CEA Insertion Limits.
2. "C-E Method for Control Element Assembly Ejection Analysis," CENPD-0190-A, January 1976. Methodology for the Regulating CEA Insertion Limits and Azimuthal Power Tilt.
3. "Modified Statistical Combination of Uncertainties" CEN-356(V)-P-A, May 1988, Methodology for the limits on the DNBR Margin and the ASI.
4. "Calculative Methods for the C-E Large Break LOCA Calculation Model For The Analysis of C-E and W Designed NSSS," CENPD-132, Supplement 3-P-A, June 1985. Methodology for the limits on the MTC, Linear Heat Rate, Azimuthal Power Tilt and ASI.
5. "Calculative Methods for the ABB-CE Small Break LOCA Evaluation Model," CENPD-137-P, August 1974: Supplement 2-P-A, April 1998. (Methodology for Specification 3.1.1.3 for MTC, 3.2.1 for Linear Heat Rate, 3.2.3 for Azimuthal Power Tilt, and 3.2.7 for ASI).
6. "CESEC - Digital Simulation of a Combustion Engineering Nuclear Steam Supply System", CENPD-107, December 1981. Methodology for the limits on the Shutdown Margins, MTC, Movable Control Assemblies - CEA Position, Regulating CEA Insertion Limits, Part Length CEA Insertion Limits and Azimuthal Power Tilt.