

G.HACHE, C. GRANDJEAN

34

Development of an embrittlement criterion for Zr1%Nb cladding applicable to loss-of-coolant accident in LWRs and comparison with zircaloy.

To establish an embrittlement criterion for Zr1%Nb cladding applicable to hypothetical loss-of-coolant accident (LOCA) in light-water reactors (LWRs), the available information, mainly from Germany, Russia and Hungary, was reviewed. The results of isothermal steam-oxidation tests performed between 1000 and 1200°C show that, despite a very slightly lower weight gain than for zircaloy:

- The oxygen-stabilised α phase layer thickness and the cumulative thickness of the oxide and α phases layers are larger than for zircaloy ;
- The oxygen content in the β phase, deduced from hardness measurements, is higher than for zircaloy ;
- To summarise, oxygen is more uniformly distributed than for zircaloy ;
- Under unlimited steam supply conditions, the hydrogen pick-up is significantly higher than for zircaloy.

All these parameters are known to be embrittlement factors for zirconium alloys. The results of ring compression tests and tensile tests, conducted at several load temperatures from these steam-oxidised specimens, show that the nil ductility temperature can be very well linearly correlated with the weight gain or equivalent oxidation rate ECR. The application of the 1973 ECCS Rule making-hearing methodology to these results lead to a provisional criterion for the total oxidation limit of 6 percent of the wall thickness associated with the use of the Bochvar Institute's weight gain correlation, compared to 17 percent associated with the use of the Baker-Just correlation for zircaloy. The difference comes mainly from the hydrogen pick-up. As for zircaloy, the most limiting phase is the post-quench phase of the LOCA under hydraulic, seismic or handling loadings ; the quench phase at the Leidenfrost temperature is not limiting when the thermal shock loading is applied, without additional axial constraints.

Thermal Shock Tests for Hydrided Zircaloy Cladding Tube

**M.TANIMOTO, F.NAGASE
and H.UETSUKA**

**Fuel Safety Research Laboratory
Department of Reactor Safety Research
JAERI**

November 13-14,2000

Prepared for 24th NSRR Technical Review Meeting, Tokyo, Japan

1

JAERI


Outline of presentation

- **Objective**
- **Experimental method**
- **Results**
- **Summary**

Objective

To investigate failure-bearing capability of the cladding during thermal shock taking into account of the whole LOCA sequence


including rod-burst, oxidation and reflooding.

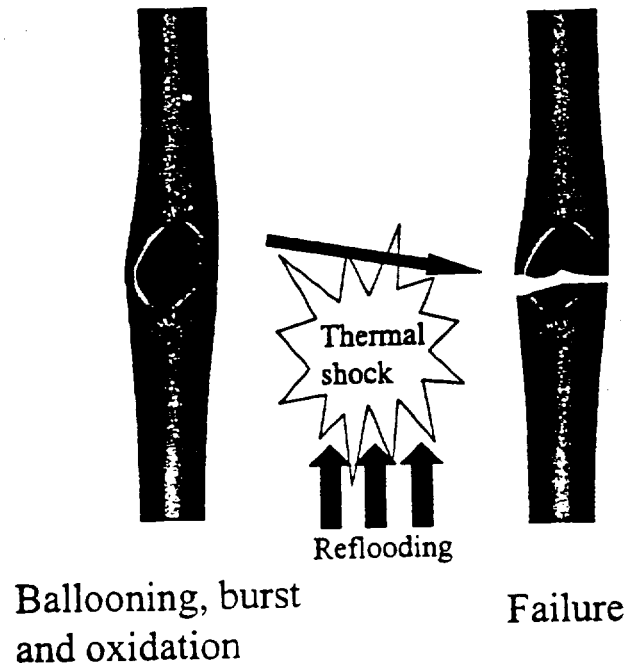

3

JAERI

Thermal shock test

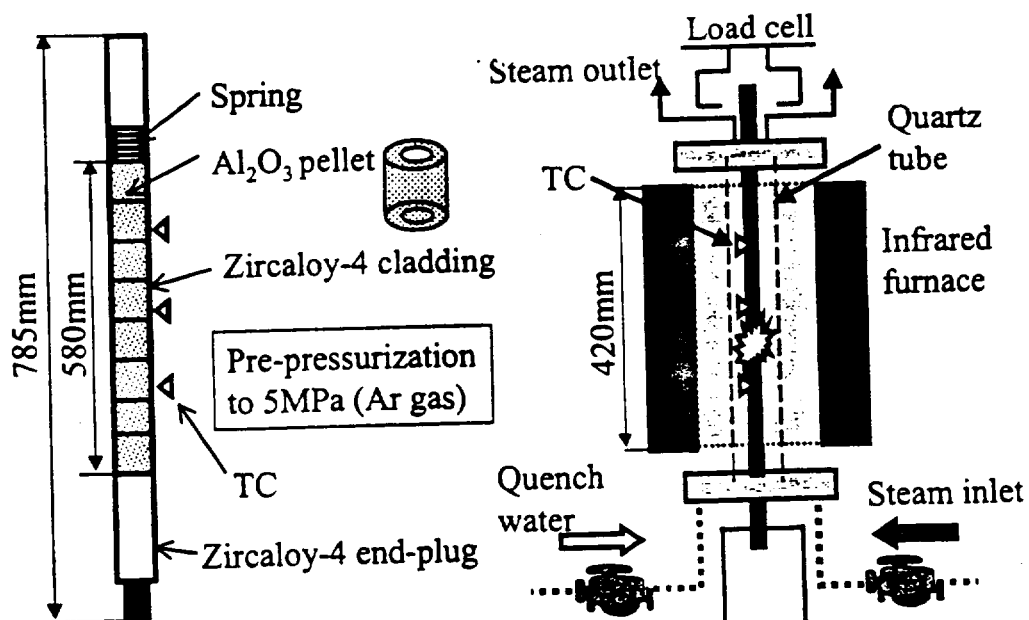

4


Sample and oxidation condition

Parameters	Present test condition	Plan
Cladding (Wall thickness, pre-oxidation, pre-hydriding, irradiation)	Unirradiated	Irradiated cladding
	Zircaloy-4 PWR cladding, 0.57mm thick [As-received Pre-hydrided :400~600wtppm]	Thinned cladding BWR cladding
Oxidation temperature	1050K—1550K	
Oxidation time	100s—7500s	
Oxidation amount	5—65% ECR*	


* ECR : Equivalent Cladding Reacted (Proportion of oxide layer thickness assuming that all of absorbed oxygen forms stoichiometric ZrO_2)

5

History of cladding temperature

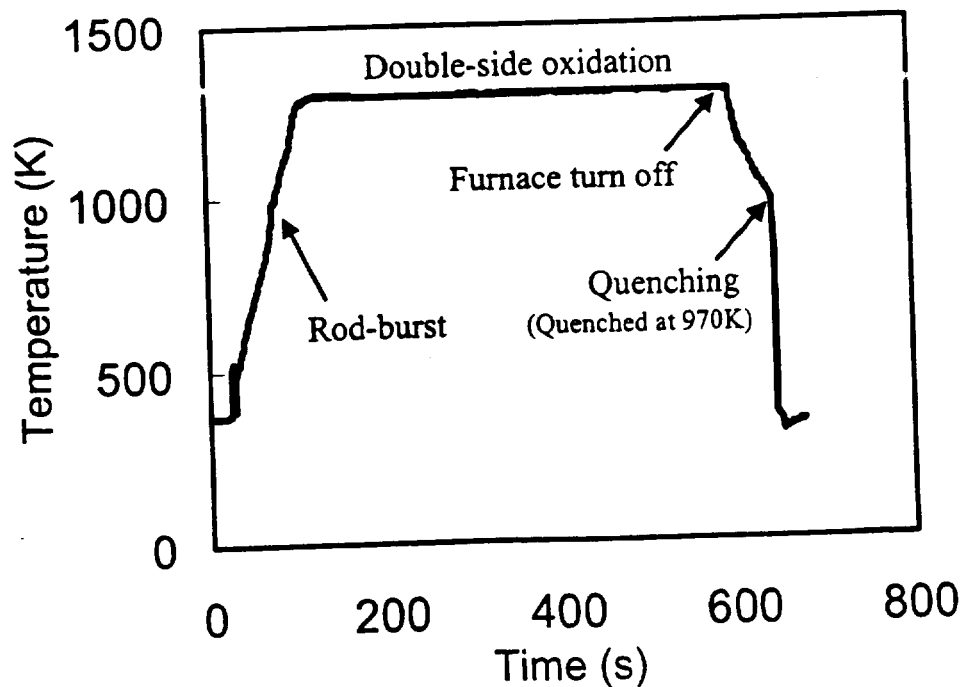


Post-test examination

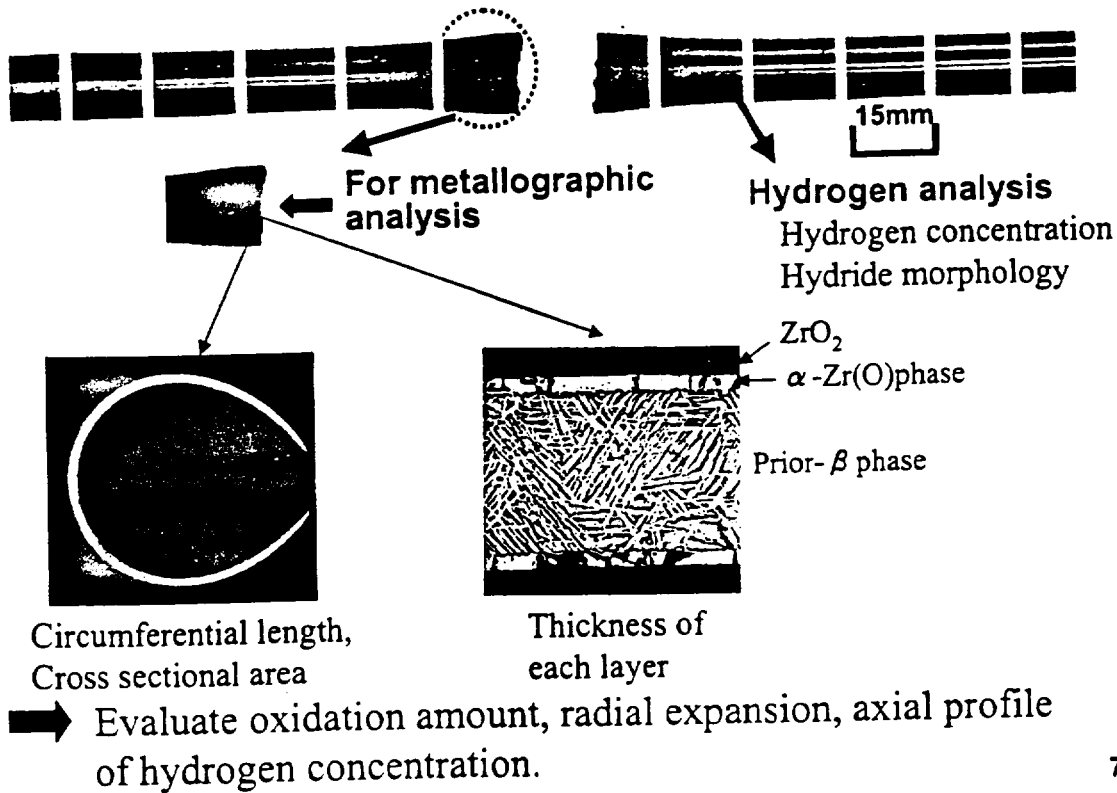

7


Post-test appearance

Type (a)

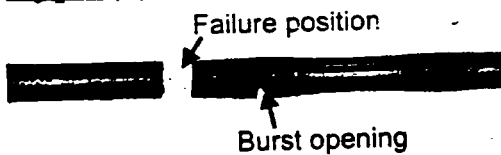



Indicating large influence of
significant hydrided by inner
surface oxidation

Type (b)

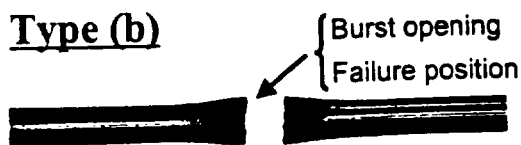


Suggesting influence of reduction
of cladding wall thickness and
double side oxidation

As-received

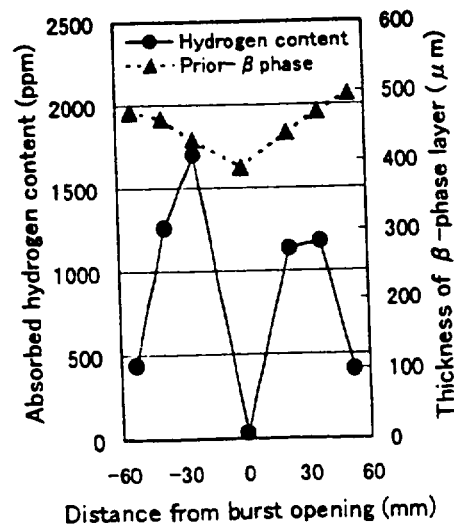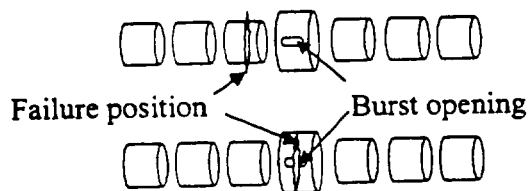

8


Failure map(1/2) -No restraint condition-

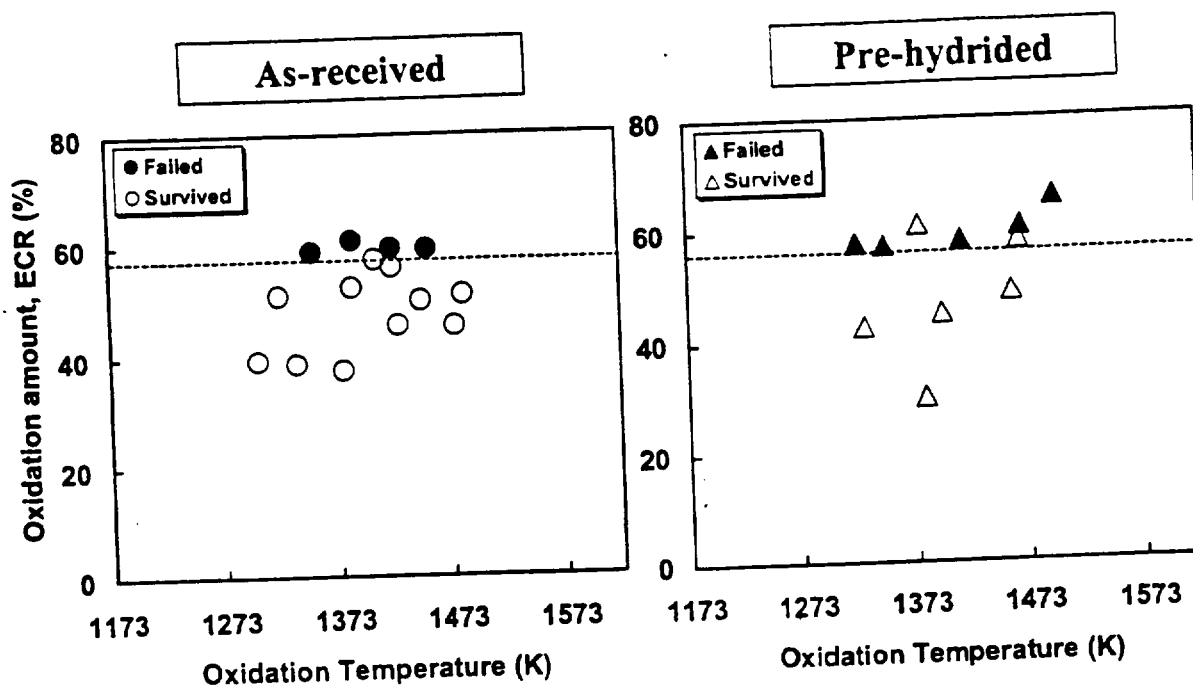

ECR was calculated with the Baker-Just equation taking account of double sided oxidation after rupture and increase of circumference by ballooning.


9

Cladding temperature and load at fracture under Restraint condition

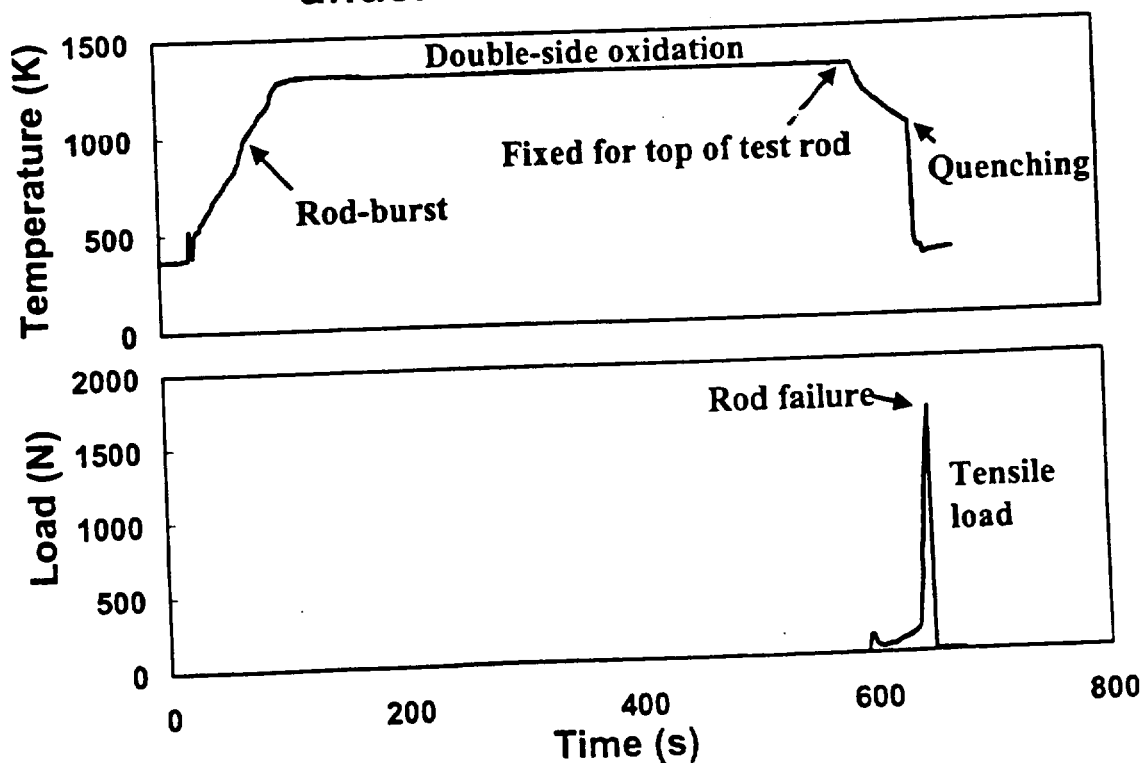

10


Failure map(2/2) -Restraint condition-

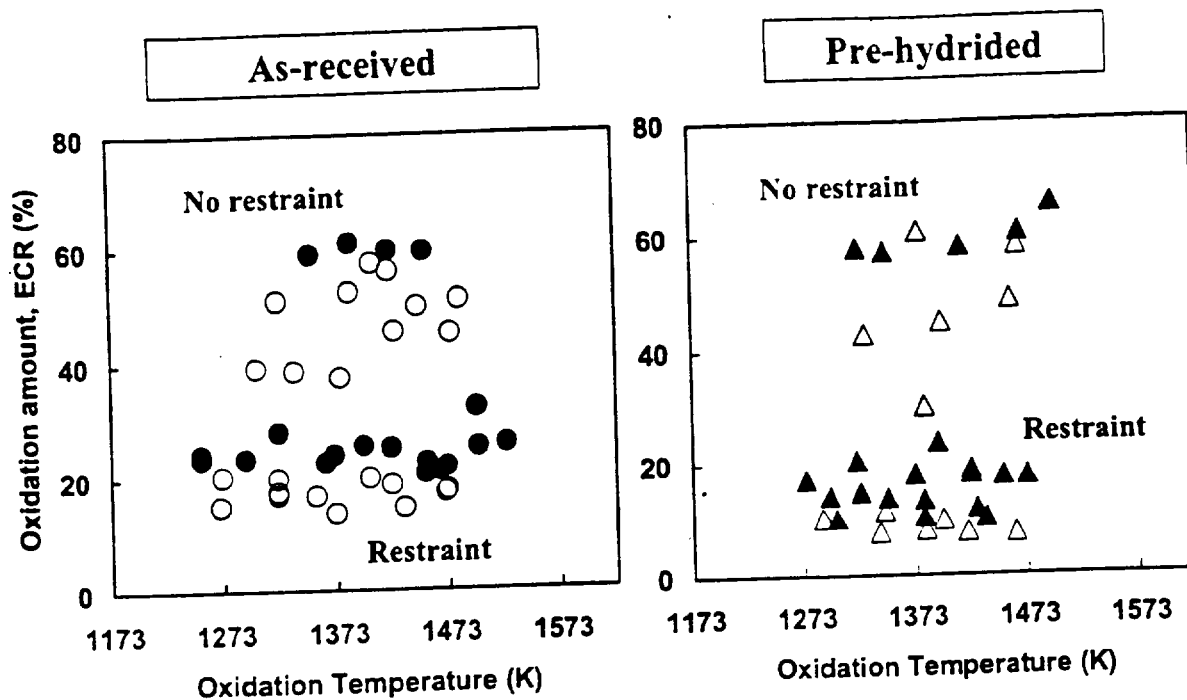

ECR was calculated with the Baker-Just equation taking account of double sided oxidation after rupture and increase of circumference by ballooning.


11

Axial profile of hydrogen content and thickness of prior- β phase under Restraint conditions

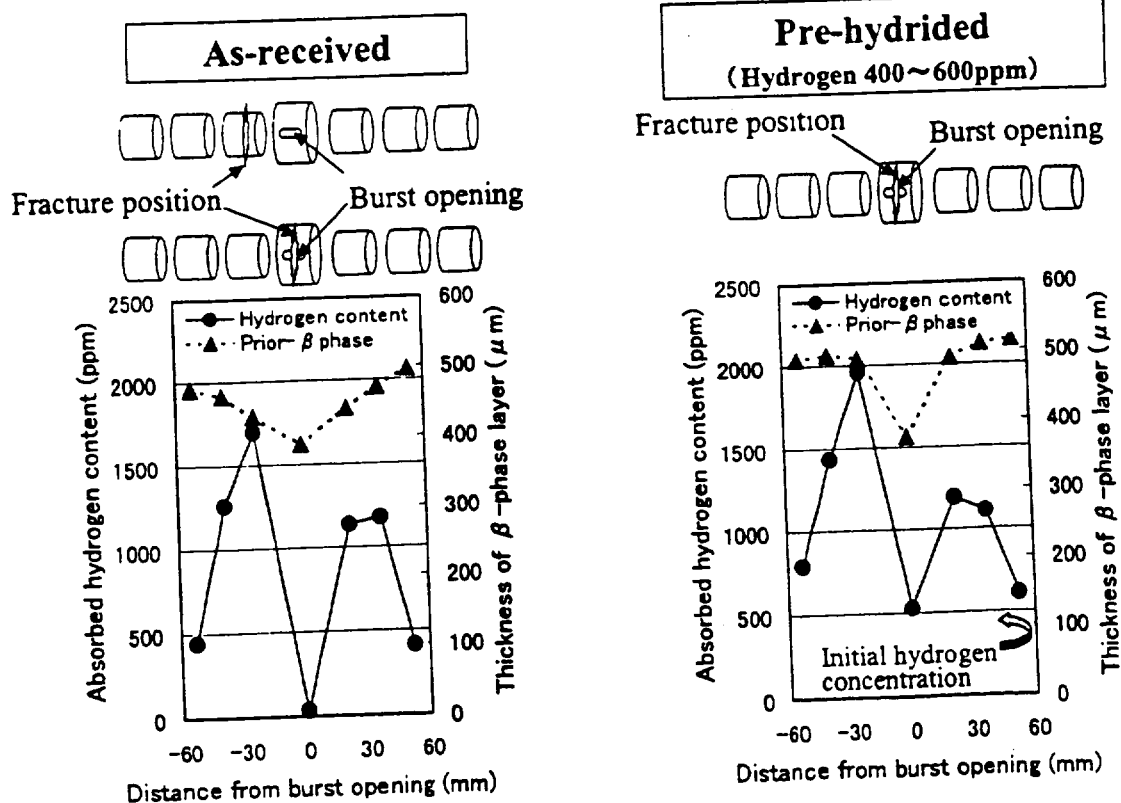


12


Failure position

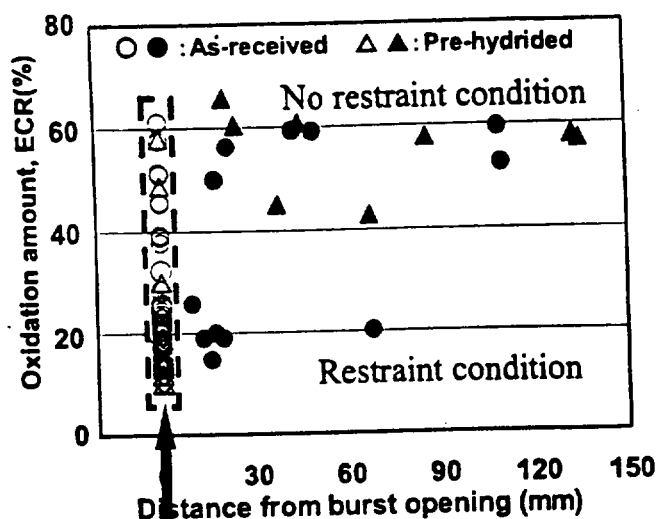


Type (a): ● ▲

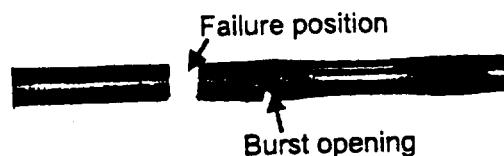

Indicating large influence of significant hydrided by inner surface oxidation

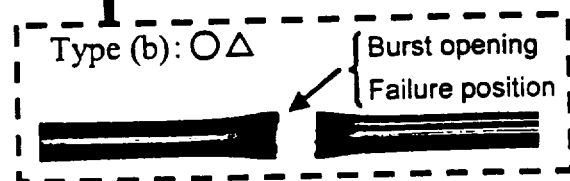


Suggesting influence of thinner cladding wall

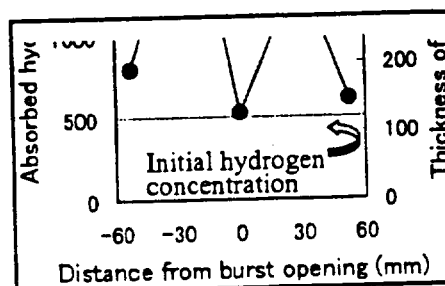


13

Influence of axial restraint on failure boundary

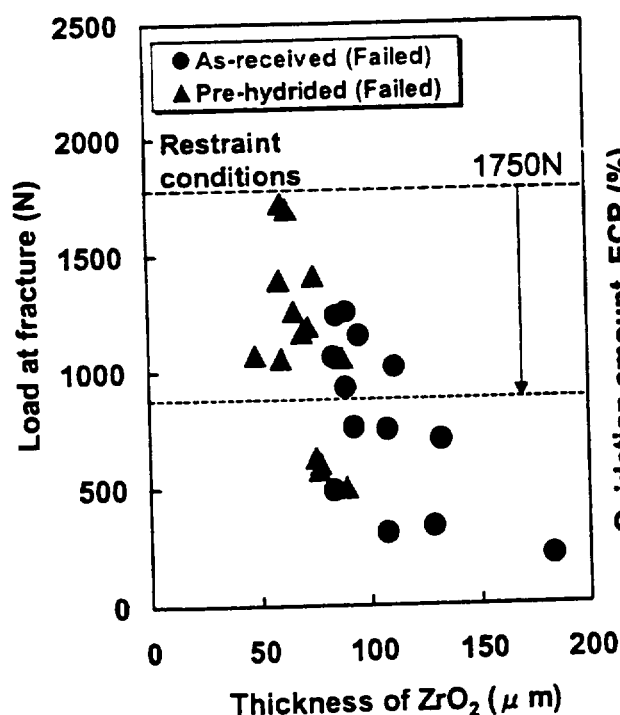

Load fracture measured in the tests under restraint condition as a function of ZrO_2 thickness.

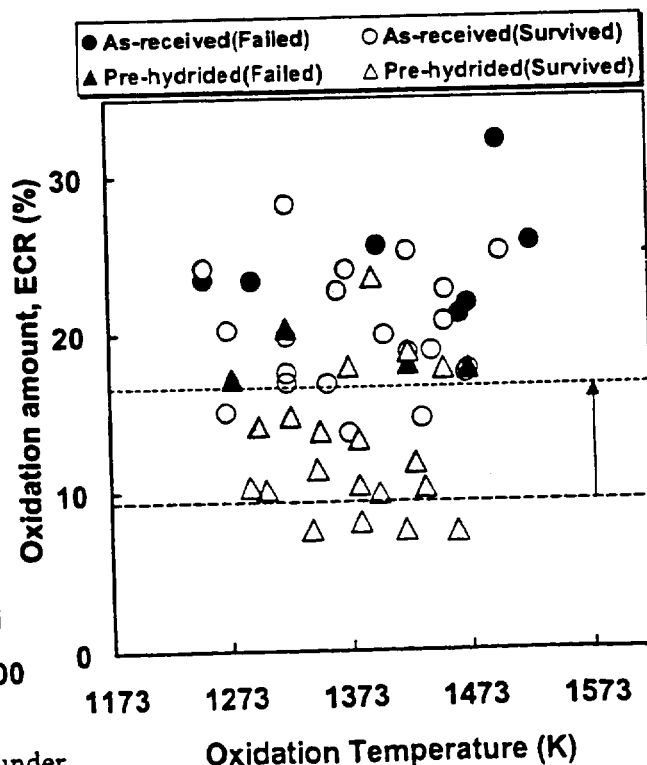

14

Summary

- Integral thermal shock tests have been performed with as-received and pre-hydrided (400~600 wtppm) Zircaloy-4 claddings, simulating rod-burst, double-side oxidation and quench by reflooding.
- Following information was obtained on thermal shock failure behavior including
 - Position of rod failure on quench
 - Axial hydrogen profile
 - Load at fracture under full restraint condition
 - Oxidation condition of thermal shock failure
- Influence of axial restraint during quench became larger in pre-hydride cladding.