


TITLE  
RACK 25-18  
FIRST MADE FOR BROWN PERRY UNIT 1, 2, 3 (CDR HYD SYS)  
PURCHASED PART DRAWING  
FCF 237X906

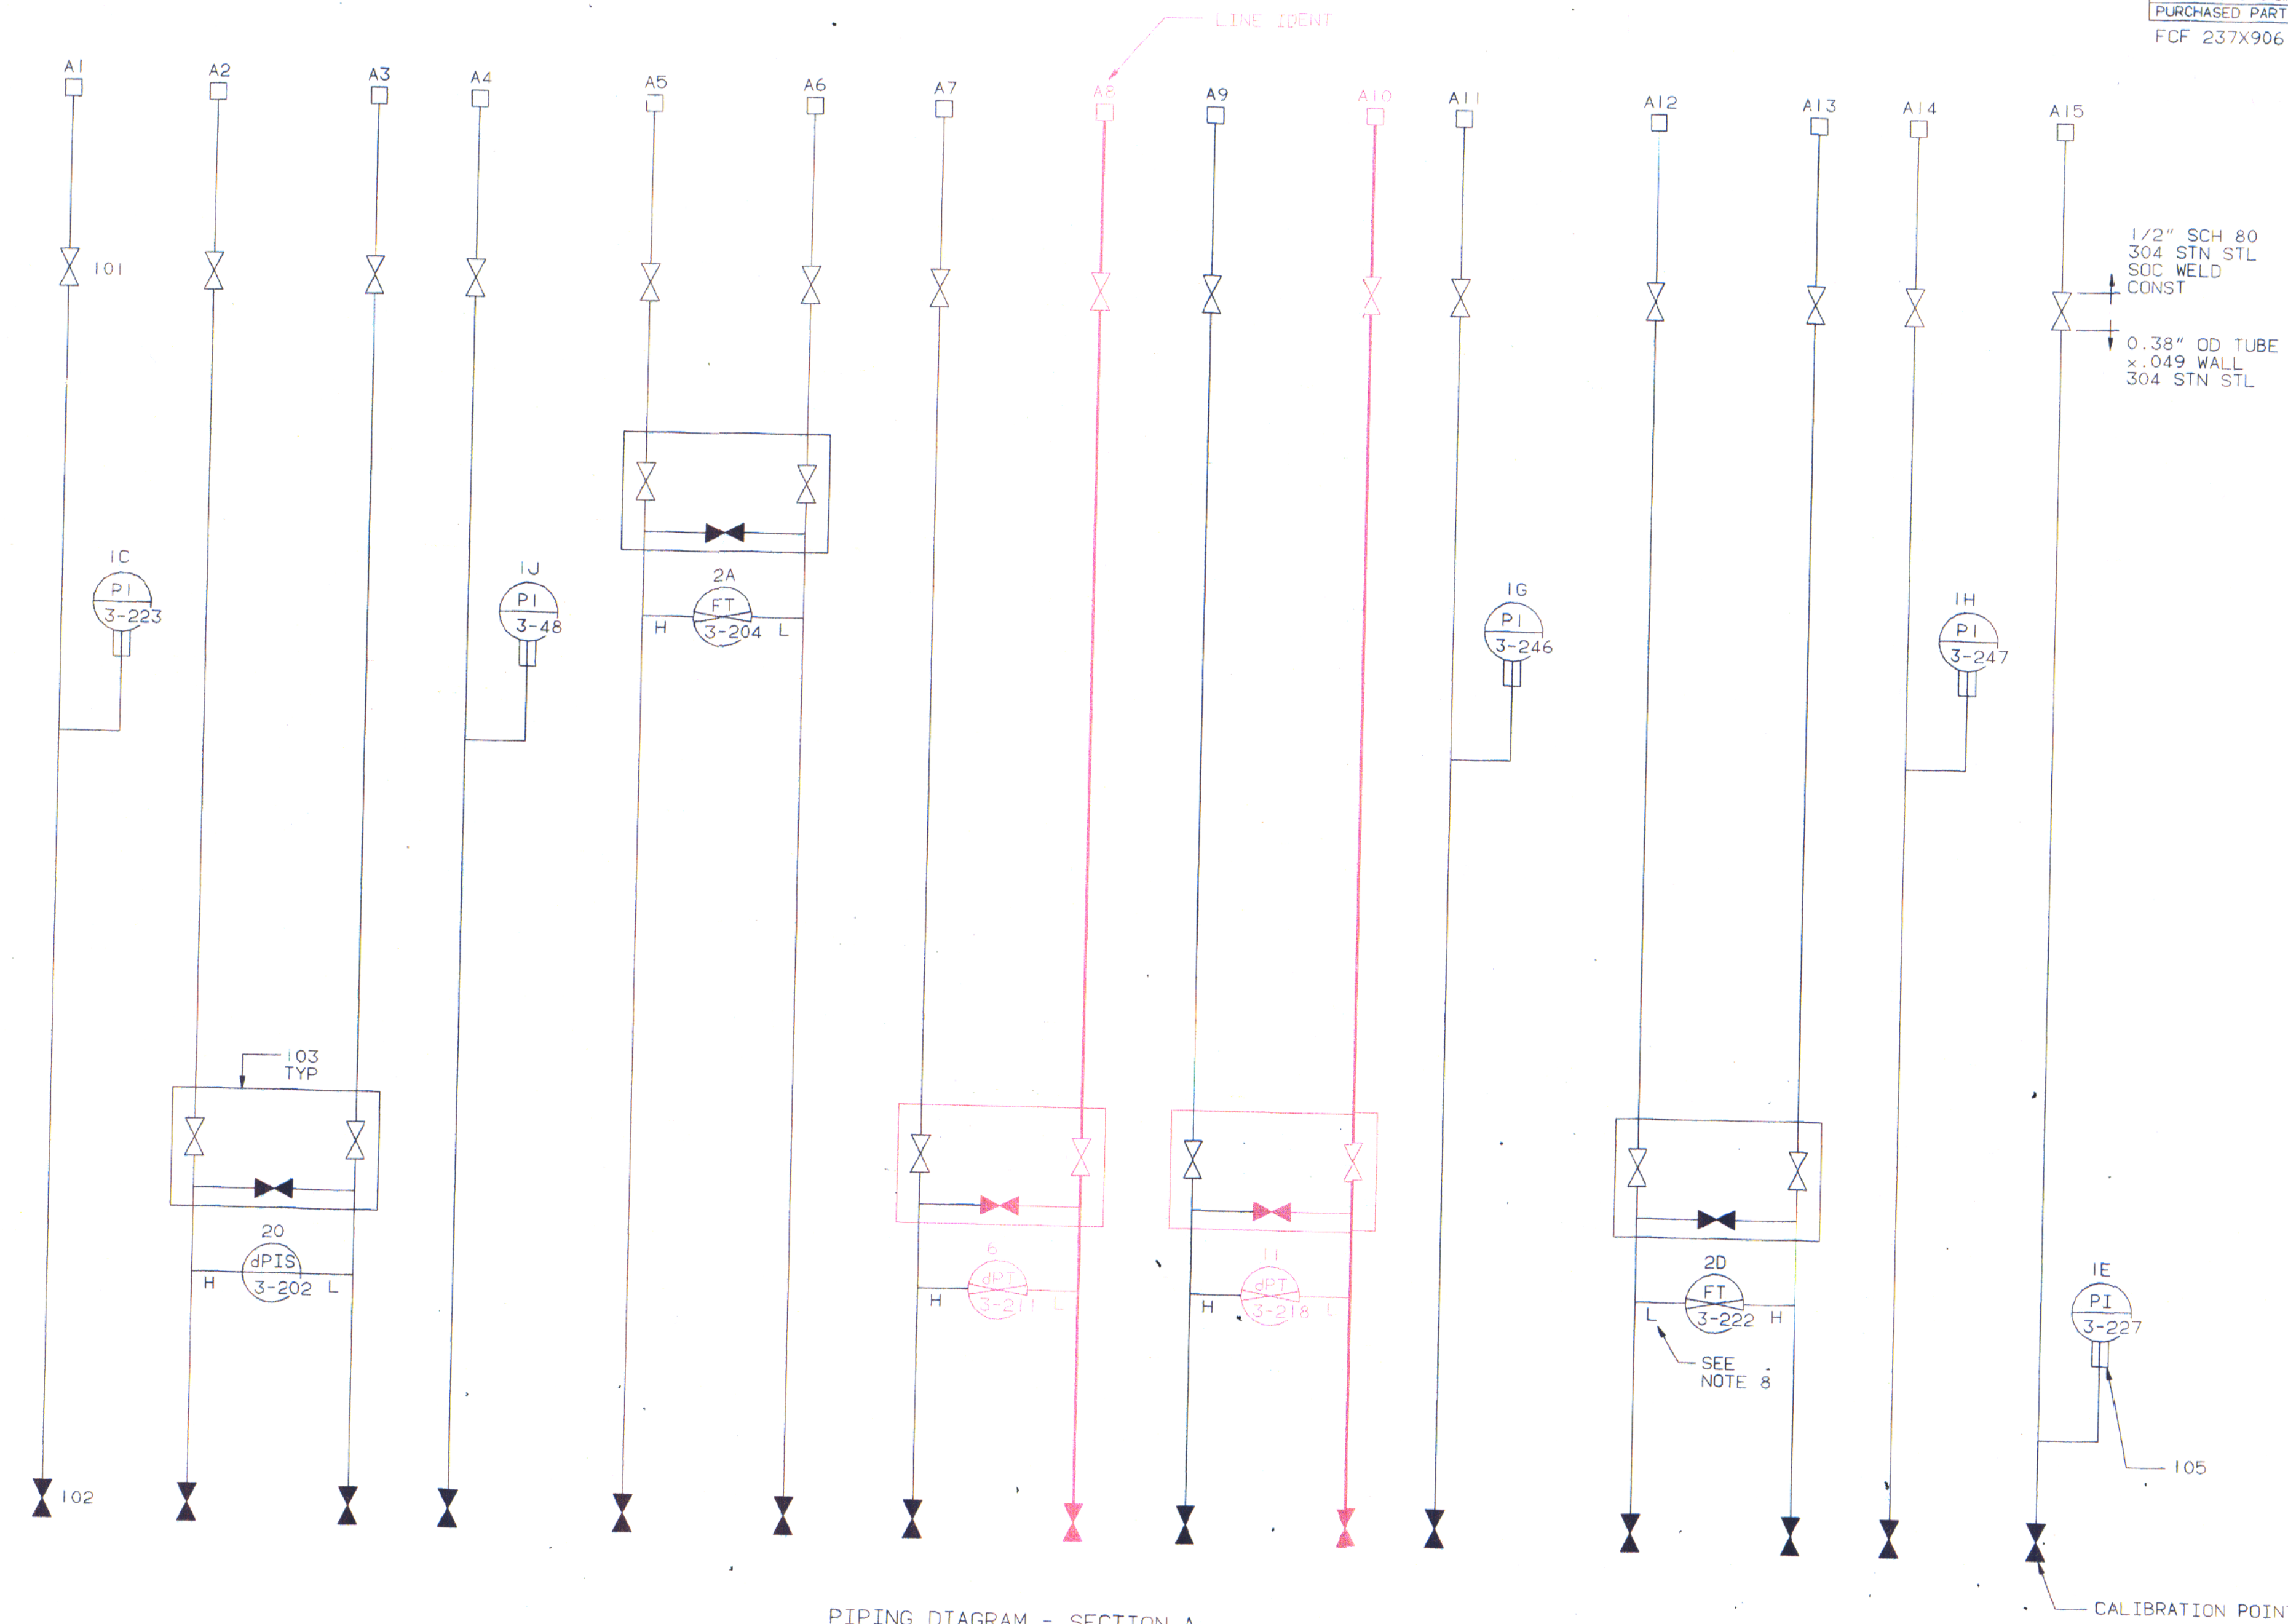

PIPING DIAGRAM - SECTION A

FOR ASME SECTION XI  
USE ONLY


■ -ASME CODE CLASS 2 EQUIVALENT  
■ -NON NUCLEAR CODE CLASS

1. ISI SUFFIX FROM REFERENCE CONTINUATION DWG HAS BEEN OMITTED, AS APPLICABLE.
2. THE ISI CODE CLASS DRAWING DOES NOT NECESSARILY REPRESENT THE ACTUAL PLANT CONFIGURATION.

ISI DRAWING WAS ISSUED FOR  
BASELINE DWG 0-117C2556-4  
REV 000

PROJECT BEND DISCIPLINE ELEC  
CONTRACT 91750 90744 UNIT 1, 2 & 3  
DESC RACK 25-18  
DWG/DOC NO 0-117C2556-4-ISI  
REV 000  
DATE 0-3-94 ECU/FCR FILE

SYG NO		* FOR ORIGINAL SIGNATURES AND PREVIOUS REVISIONS SEE MICROFILM COPY									
000	ISI	10	394	MPT	JK	N/A	STL	444	100	100	100
REV NO	CHANGE REF	DATE	DTFR	CHKR	DSGN	RVWR	APPD	APPD	APPD	ISSD	
MADE BY	APPROVALS	APRD	DEPT	REVISIONS BY TVA							
ISSUED				0-117C2556-4-ISI							
THIS DRAWING IS UNDER CONFIGURATION CONTROL											
CCD											

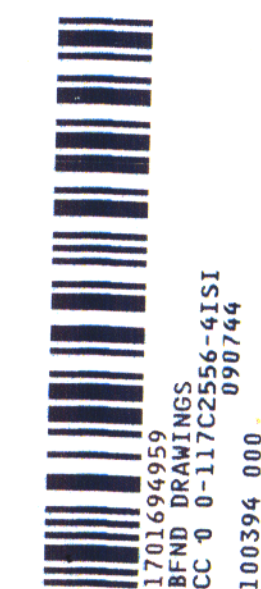

D-1