


TITLE:ARRGT
RACK 25-56B
FIRST MADE FOR BROWNS FERRY UNIT 2 (MAIN STM FLOW)
PURCHASED PART DRAWING

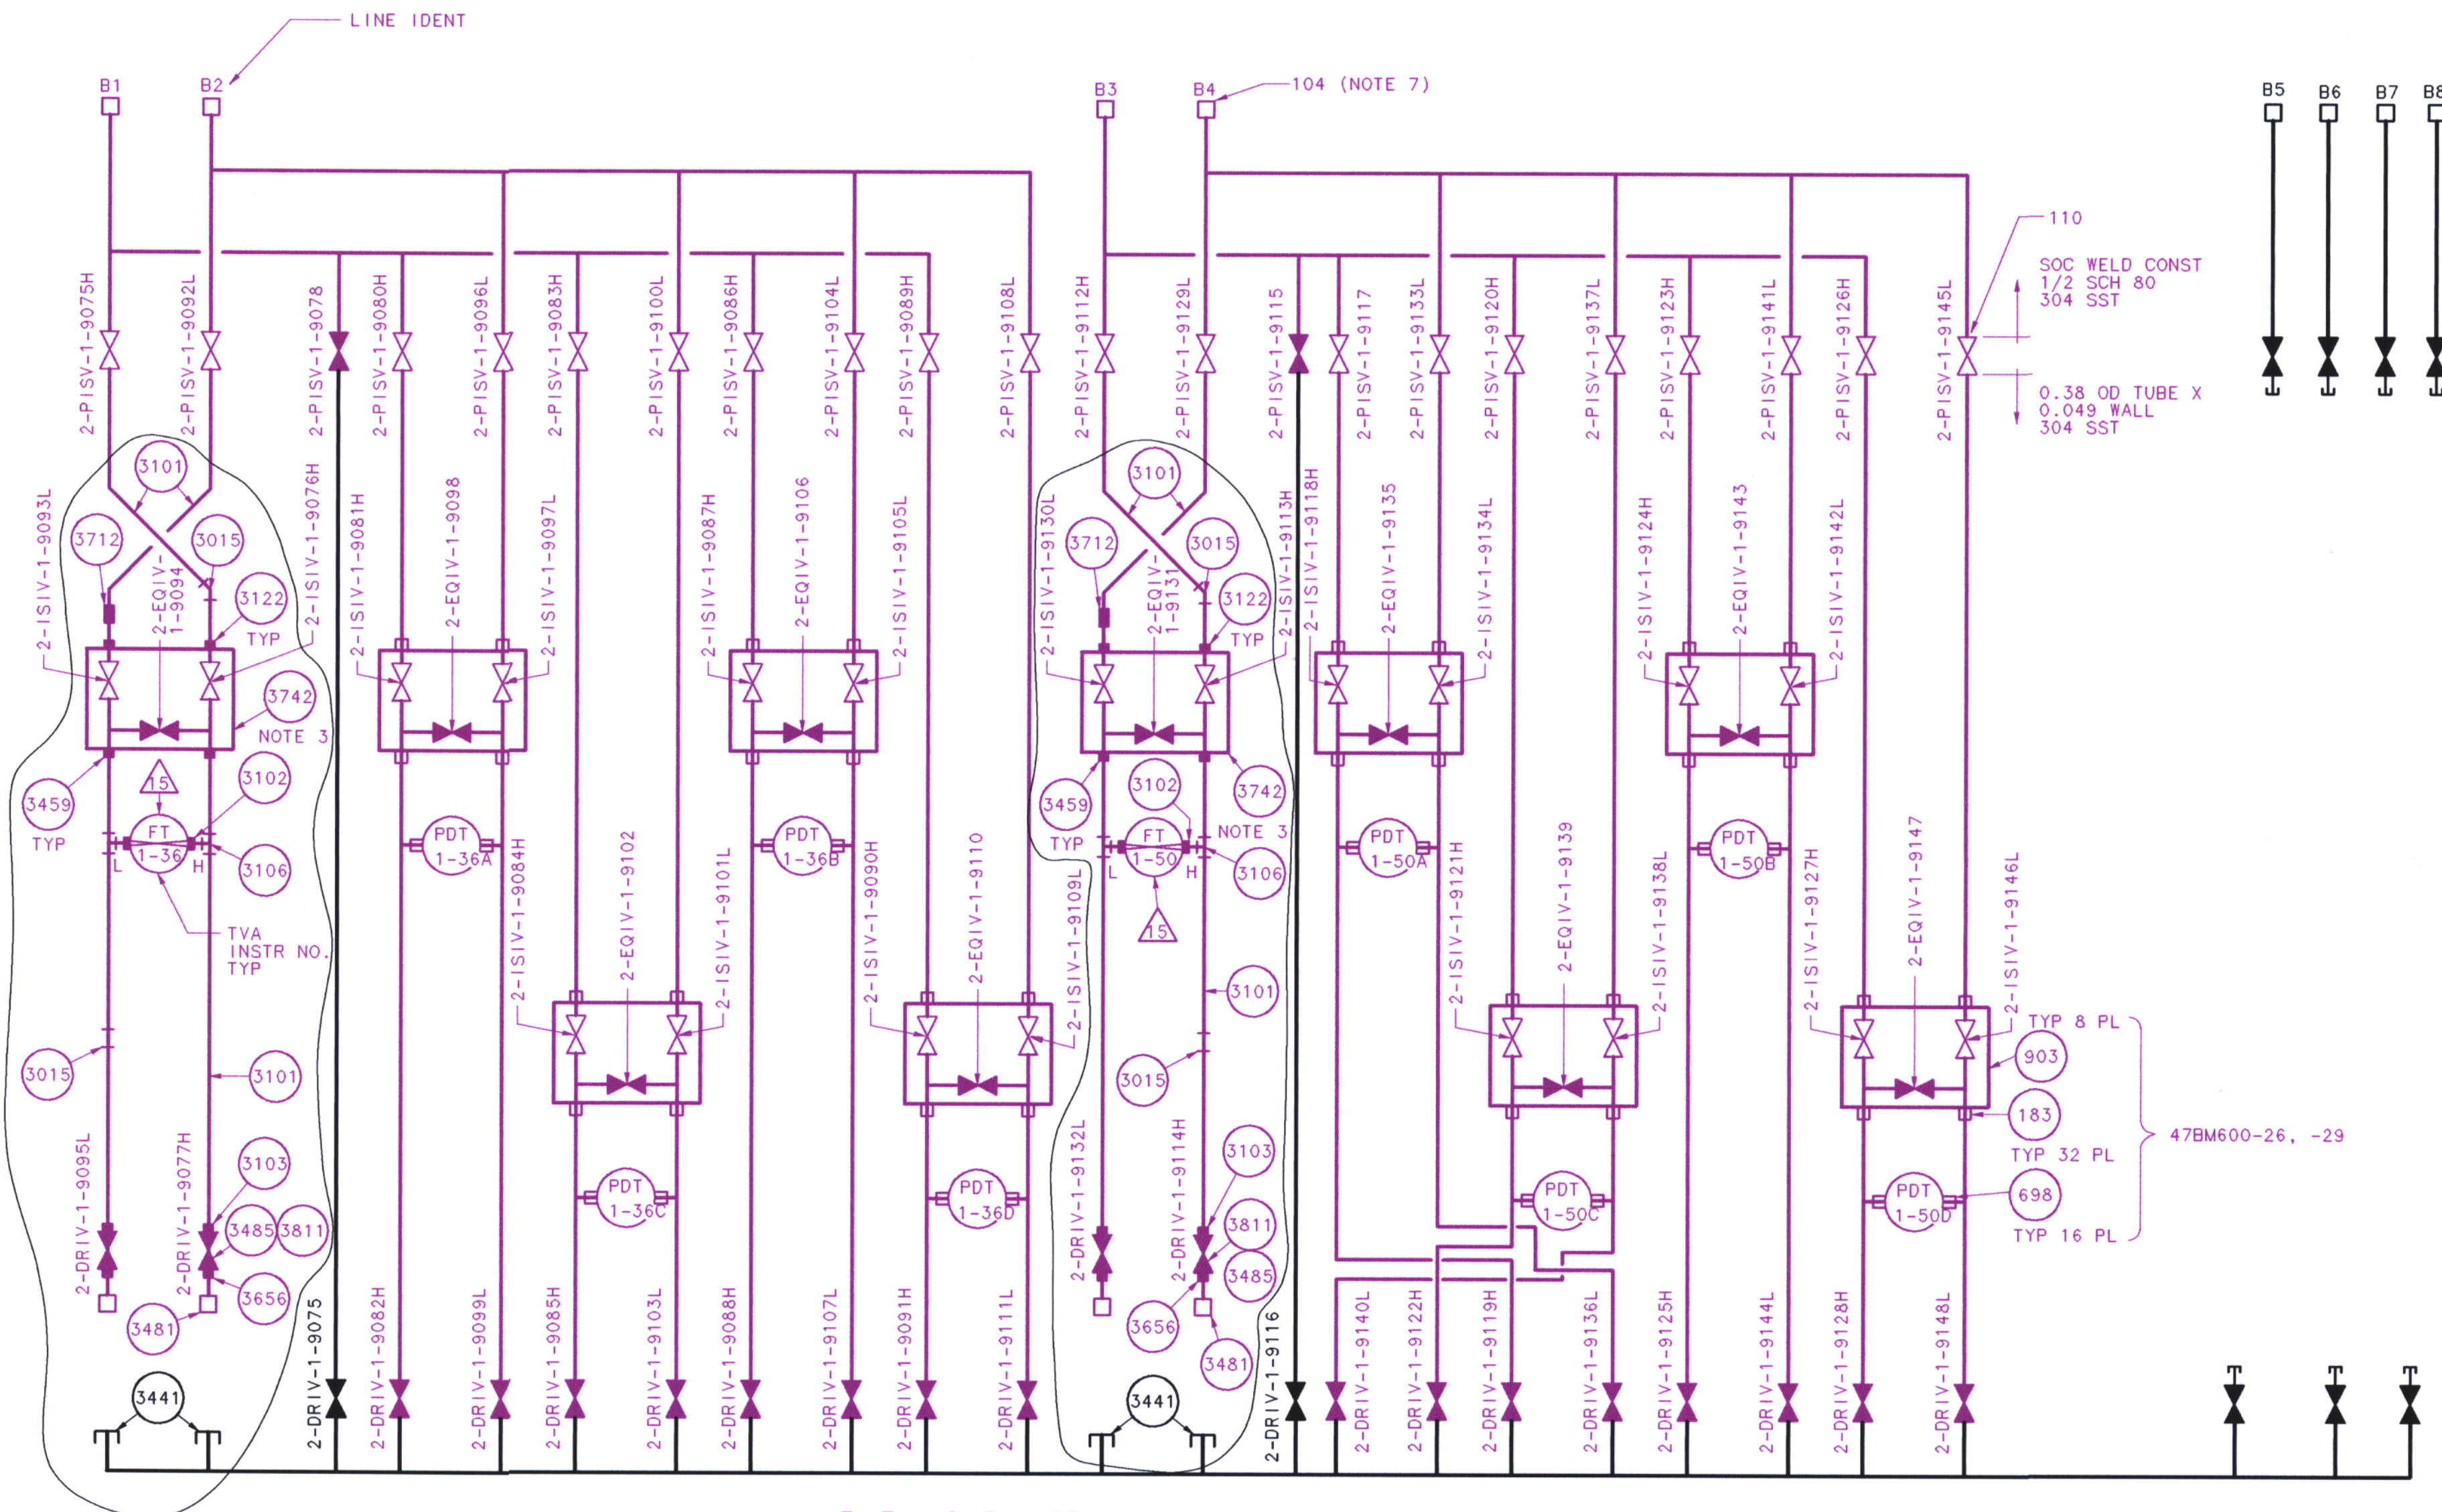

PIPING DIAGRAM-SECTION B

- NOTES:
1. ISI SUFFIX FROM REFERENCE CONTINUATION DRAWING HAS BEEN OMITTED, AS APPLICABLE.
 2. THE ISI CODE CLASS DRAWING DOES NOT NECESSARILY REPRESENT THE ACTUAL CONFIGURATION.
 3. THE VALVE MANIFOLD IS LOCATED ABOVE OR BELOW TRANSMITTER AS CLOSE AS POSSIBLE (NOT MORE THAN 8" FROM CENTERLINE OF VALVE TO BOTTOM OF TRANSMITTER).

FOR ASME SECTION XI
USE ONLY

■ -ASME CODE CLASS 1 EQUIVALENT
■ -NON NUCLEAR CODE CLASS

ISI DRAWING WAS ISSUED FOR
BASELINE DWG: 2-164C5984-5
REV: 001

PROJECT: BFNP DISCIPLINE: ELEC
CONTRACT: 90744 UNIT: 2
DESC: RACK 25-56B
DWG/DOC NO.: 2-164C5984-5-1SI
SHEET: 1 OF 1 REV: 001
DATE: ECN/FCR: FILE:

SYS NO.	001	DCN W25841		KED		N/A		N/A		N/A		N/A										
		REVISED LINES B1, B2, B3, B4 AND ADDED NOTE 3 PER DCN W25841 (REFERENCE DCA W25841-052-002); DOCUMENTED DCA W25841-053-000, DCN W25841																				
	000	ISI		10-30-94		MPT		JK		N/A		JTL		FWF		RDC		AEC		HLW/C		
		REVISED TO UPDATE ISI BOUNDARY TO MATCH CURRENT CONFIGURATION, SUPSERSEDES 164C5984-ISI R001																				
S	REV NO.	CHANGE REF		DATE		DFTR		CHKR		DSGN		RVWR		1APPD		2APPD		3APPD		ISSD		
	REVISIONS BY TVA																					
	MADE BY		JIM DAVALL		APPROVALS		NED		DIV OR DEPT		2-164C5984-5-ISI											
ISSUED		W. DOMINGO		W. HOOVER		SAN JOSE, CALIF.		LOCATION														
THIS DRAWING IS UNDER CONFIGURATION CONTROL														CCD								