

<u>INDEX OF EMERGENCY ACTION LEVEL CONDITIONS</u>		
<u>Tab</u>	<u>Condition</u>	<u>Page No(s)</u>
1.	<u>Primary System Events</u>	
	A. Failure of a primary relief valve	13
	B. Core fuel damage	14-16
	C. Loss of fission product barriers	17
	D. Abnormal CTMT atmosphere	18-21
2.	<u>Reactor Coolant System Leak Rate</u>	
	A. Abnormal RCS leak rate	22-24
3.	<u>Safety System Functions</u>	
	A. CRD, RPS	25
	B. SW, DH, CCW, MU, HPI, MFW, AFW	26-27
	C. Loss of CTRM alarms, Indication, or Communications	28
4.	<u>Electrical Failures</u>	
	A. AC	29-30
	B. DC	31
5.	<u>Secondary System Events</u>	
	A. Major steam leak	32-33
	B. Main steam safety valve failure	34
6.	<u>Radiation Release Event</u>	
	A. High radiation levels in plant	35
	B. Fuel handling accident	36
	C. Abnormal effluent release	37-38
	D. Abnormal radiation levels at site boundary	39-41

INDEX OF EMERGENCY ACTION LEVEL CONDITIONS

<u>Tab</u>	<u>Condition</u>	<u>Page No(s).</u>
7.	<u>Hazards to Station Operations</u>	
A.	Fire	42
B.	Aircraft crash	43
C.	Train derailment	44
D.	Explosion	45
E.	Toxic or flammable gas	46-47
F.	Turbine damage	48
G.	Missile impact	49
H.	Control room evacuation	50
I.	Security threat	51
8.	<u>Natural Events (Within Ottawa County)</u>	
A.	Earthquake	52
B.	Tornado	53
C.	Hurricane Force Winds	54
D.	Flooding, Low Water	55
9.	<u>Miscellaneous</u>	56-57
10.	<u>Downgrading Guidelines</u>	58
11.	<u>Termination Guidelines</u>	59

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS1. PRIMARY SYSTEM EVENTSA. FAILURE OF A PRIMARY RELIEF VALVE

Condition	Indication(s)	Emergency Classification
1. Failure of safety related safety valve, or relief valve, to close following a pressure reduction	1. Indication of flow through Pressurizer Reliefs (as indicated on Panel C5798, C5799 and C5705) <u>AND</u> 2. RCS Pressure drop to <1600 psig	Unusual Event RA-EP-01600 All Modes

See Also: Abnormal RCS Leak Rate (2-A-1 thru 4)

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS1. PRIMARY SYSTEM EVENTSB. CORE FUEL DAMAGE

Condition	Indication(s)	Emergency Classification
1. High reactor coolant activity sample requiring plant shutdown per T.S. 3.4.8	1. Confirmed primary coolant activity sample results indicate > T.S. 3.4.8 <u>AND</u> 2. Plant shutdown required and in progress	Unusual Event RA-EP-01600 Modes 1 & 2
2. Very high coolant activity	Confirmed primary coolant sample results indicate >300 μ Ci/gram DOSE EQUIVALENT I-131	Alert RA-EP-01700 All Modes

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS1. PRIMARY SYSTEM EVENTSB. CORE FUEL DAMAGE (Cont.)

Condition	Indication(s)	Emergency Classification
3. Core damage with inadequate core cooling determined	1. Confirmed primary coolant sample results indicate: A. DOSE EQUIVALENT I-131 >T.S. 3.4.8 OR B. >100/ \bar{E} μ Ci/gram specific activity, AND 2. The incore thermocouples indicate superheated conditions in the core	Site Area Emergency RA-EP-01800 All Modes
4. Core damage with other plant conditions making a release of large amounts of radioactivity possible	1. Confirmed primary coolant sample results indicate >300 μ Ci/gram DOSE EQUIVALENT I-131 AND 2. Incore thermocouple temperatures correspond to region 3 or 4 of DB-OP-02000 Figure 2 AND 3. A. Containment radiation level is > 10 ⁴ R/hr (RE 4596A/RE 4596B) OR B. SFAS level 4 trip (CTMT pressure 38.4 psia)	General Emergency RA-EP-01900 All Modes

See Also: Loss of Fission Product Barriers (1-C-1)
 Abnormal Containment Atmosphere (1-D-1 thru 3)

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS1. PRIMARY SYSTEM EVENTSB. CORE FUEL DAMAGE (Cont.)

Condition	Indication(s)	Emergency Classification
5. Core melt situations	1. Any sequence of events has occurred in which severe core damage (such as core melting) has taken place <u>AND</u> 2. A failure of containment is ready to take place (imminent)	General Emergency RA-EP-01900 All Modes

NOTE

Examples of some scenarios which could put the plant in this condition are:

1. Either a small or large LOCA occurs with a concurrent failure of the ECCS to perform, leading to severe core degradation or melting

OR

2. A transient is initiated by a loss of the main feedwater system followed by a failure of the auxiliary feedwater system for an extended period with core melting resulting

OR

3. A transient occurs requiring operation of shut-down systems with failure to trip which results in core damage, or additional failures of core cooling and makeup systems occur which lead to a core melt

OR

4. A failure of offsite and on-site power along with total loss of auxiliary feedwater makeup capability occurs for several hours which leads to a core melt

OR

5. A small LOCA occurs with initially successful ECCS, however a subsequent failure of RCS heat removal systems over a period of several hours leads to a core melt

See Also: Loss of Fission Product Barriers (1-C-1)
Abnormal Containment Atmosphere (1-D-1 thru 3)
Abnormal RCS Leak Rate (2-A-1 thru 4)

See Also: Loss of Fission
Product Barriers (1-C-1)

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS1. PRIMARY SYSTEM EVENTSC. LOSS OF FISSION PRODUCT BARRIERS

<u>Condition</u>	<u>Indication(s)</u>	<u>Emergency Classification</u>
1. Loss of 2 of 3 fission product barriers with a potential loss of the 3rd barrier	<u>Any TWO of the following conditions exist and the third is ready to take place (imminent):</u> 1. Fuel clad rupture as indicated by confirmed primary coolant sample results indicating >300 µCi/gm DOSE EQUIVALENT I-131 2. A rupture of the RCS has been confirmed with the leak rate >50 gpm. (Makeup tank level decreasing at a rate greater than 2 inches per minute) 3. Containment integrity has been breached and cannot be restored. Refer to T.S. 3.6.1.3 and T.S. 3.6.3.1.	General Emergency RA-EP-01900 All Modes

See Also: Abnormal RCS Leak Rate (2-A-1 thru 4)
Major Steam Leak (5-A-1 thru 3)

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS1. PRIMARY SYSTEM EVENTSD. ABNORMAL CONTAINMENT ATMOSPHERE

Condition	Indication(s)	Emergency Classification
1. Abnormal containment radiation and temperature	Both of the following: 1. Containment radiation level corresponds to an Alert as determined from the Containment Radiation EAL Plot on pages 20 or 21 <u>AND</u> 2. Containment average air temperature indicates >170°F (TI1356, 1357, 1358)	Alert RA-EP-01700 All Modes
2. High containment radiation, pressure and temperature	1. Containment radiation levels correspond to a Site Area Emergency as determined from the Containment Radiation EAL Plot on pages 20 or 21 <u>AND</u> 2. A. Containment average air temperature indicates >200°F (TI1356, 1357, 1358) <u>OR</u> B. Safety Features Actuation System (SFAS) level 2 has activated	Site Area Emergency RA-EP-01800 All Modes

See Also: Abnormal RCS Leak Rate (2-A-1 thru 4)
Loss of Fission Product Barriers (1-C-1)
Core Fuel Damage (1-B-1 thru 5)

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

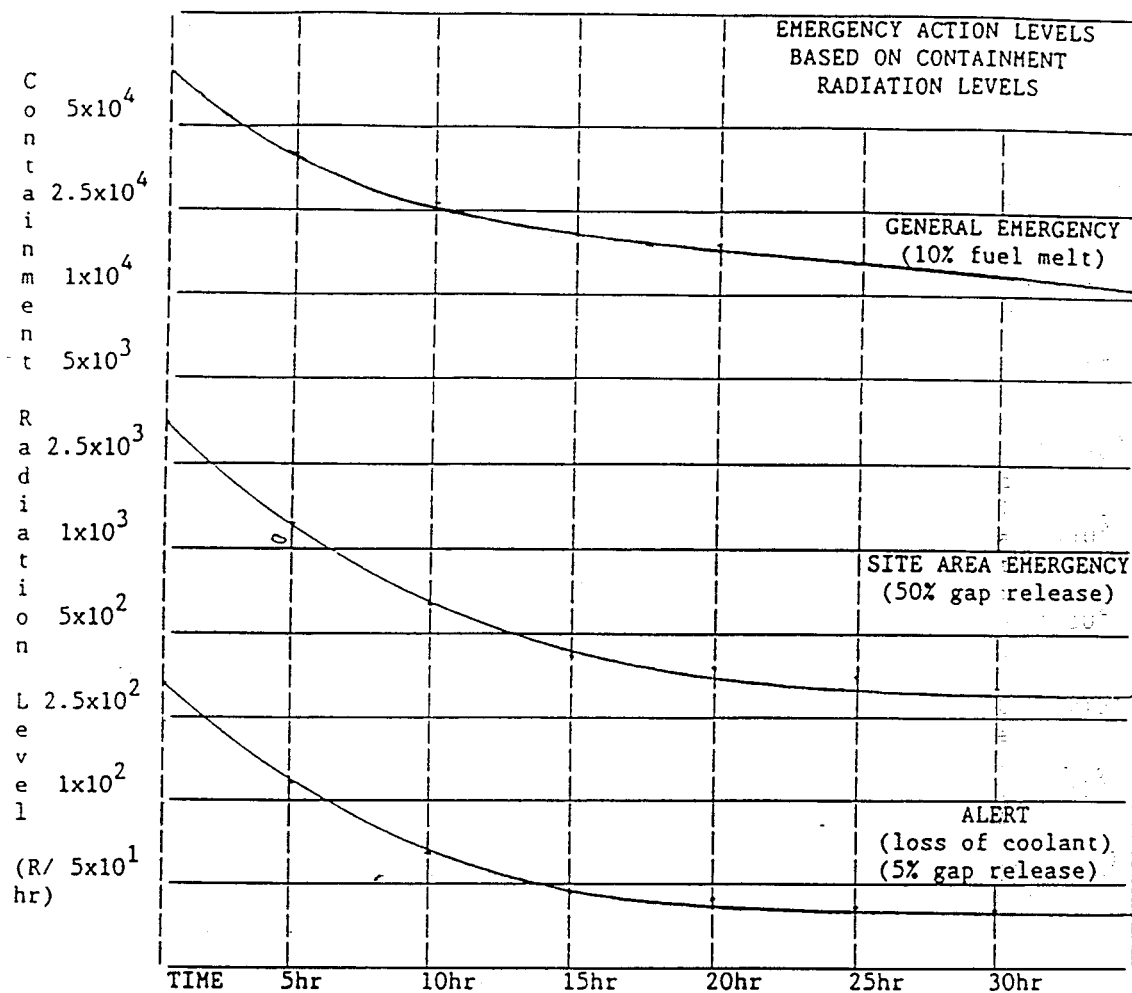
TABLE OF EMERGENCY ACTION LEVEL CONDITIONS1. PRIMARY SYSTEM EVENTSD. ABNORMAL CONTAINMENT ATMOSPHERE (Cont.)

<u>Condition</u>	<u>Indication(s)</u>	<u>Emergency Classification</u>
3. Very high containment radiation and pressure	1. Containment radiation level correlates to a General Emergency as determined from the Containment Radiation EAL Plot on pages 20 or 21 <u>AND</u> 2. SFAS level 4 actuation (Containment Pressure \geq 38.4 psia)	General Emergency RA-EP-01900 All Modes

See Also: Abnormal RCS Leak Rate (2-A-1 thru 4)
Loss of Fission Product Barrier (1-C-1)
Core Fuel Damage (1-B-1 thru 5)

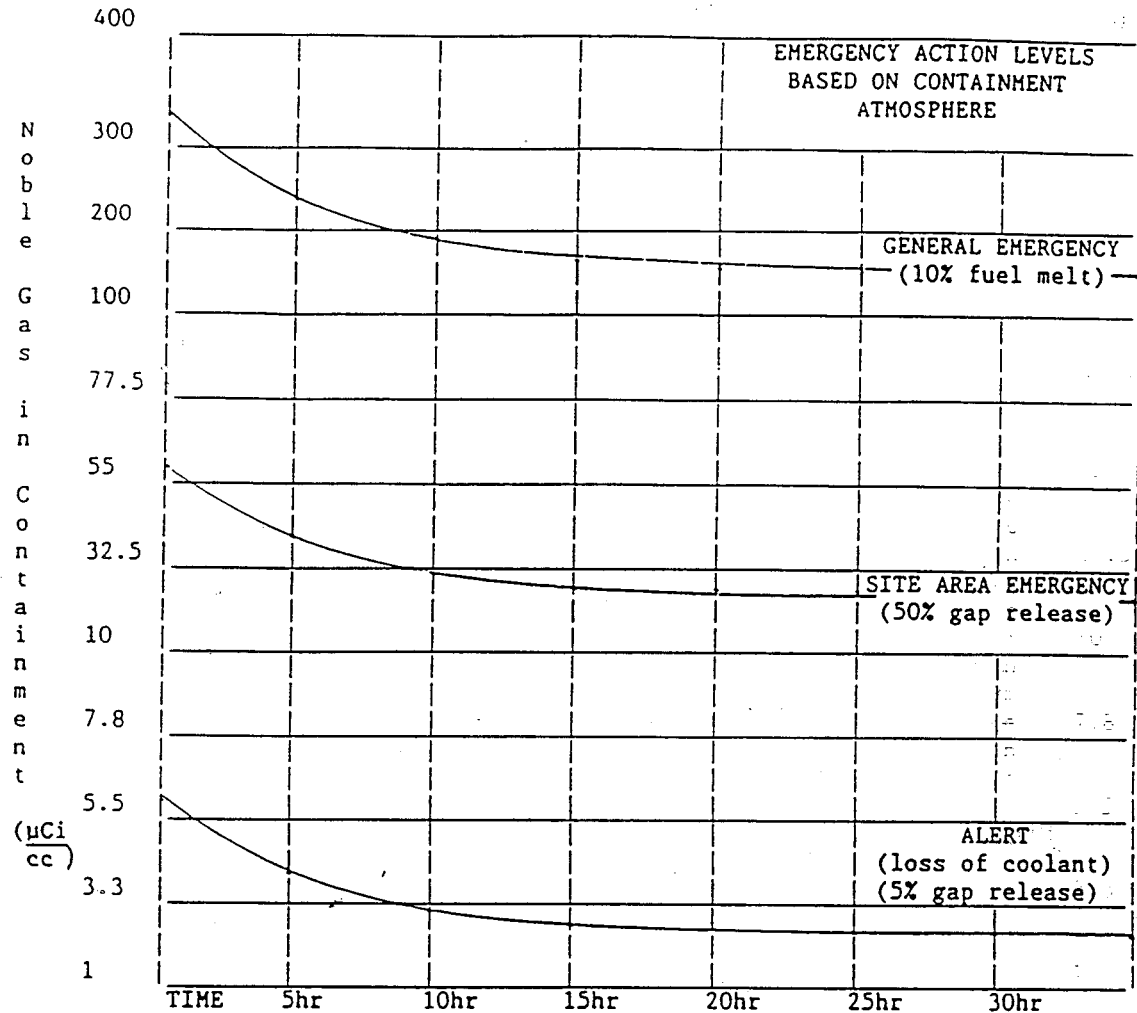
NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

CONTAINMENT RADIATION EAL PLOTCONTAINMENT RADIATION EAL PLOT INSTRUCTIONS

The curves represent readings for monitors RE 4596A or B, Containment High Range Radiation Detector. The procedure for their use is as follows:

1. Determine the time after reactor shutdown
2. Determine the RE 4596 Channel A or B radiation reading
3. Find the point on the figure where these two numbers intersect
4. Read the classification level of the line immediately below this point. This is the classification to use in correlation to the "Abnormal Containment Atmosphere" section of the Emergency Action Levels.

CONTAINMENT RADIATION EAL PLOTCONTAINMENT RADIATION EAL PLOT INSTRUCTIONS

The curves represent readings for monitors RE 4597AB or BB, Containment Atmosphere Radiation Detector. The procedure for their use is as follows:

1. Determine the time after reactor shutdown
2. Determine the RE 4597AB or BB Channel 1 or 2 radiation reading
3. Find the point on the figure where these two numbers intersect
4. Read the classification level of the line immediately below this point. This is the classification to use in correlation to the "Abnormal Containment Atmosphere" section of in the Emergency Action Levels.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS2. REACTOR COOLANT SYSTEM LEAK RATEA. ABNORMAL RCS LEAK RATE

Condition	Indication(s)	Emergency Classification
1. Reactor Coolant System leak requiring shutdown per T.S. 3.4.6.2 (includes primary leakage, and primary to secondary leakage)	1. A. Any leakage occurs from the pressure boundary <u>OR</u> B. RCS inventory balance indicates >1 GPM unidentified leakage <u>OR</u> C. Primary to Secondary leakage through the tubes of any one steam generator > 150 GPD <u>OR</u> D. RCS inventory balance indicates >10 GPM identified leakage <u>OR</u> E. Controlled leakage from Reactor Coolant Pump seals is > 10 GPM total <u>OR</u> F. Leakage from any RCS pressure isolation valve listed in T.S. Table 3.4-2 >5 GPM <u>AND</u> 2. Plant shutdown required and in progress	Unusual Event RA-EP-01600 Modes 1, 2, 3, & 4

See Also: Major Steam Leak (5-A-1 through 3)
 Loss of Fission Product Barriers (1-C-1)
 Abnormal Radiation Levels at Site Boundary (6-D-1 through 7)

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS2. REACTOR COOLANT SYSTEM LEAK RATEA. ABNORMAL RCS LEAK RATE

Condition	Indication(s)	Emergency Classification
2. Reactor Coolant System leak rate >50 gpm, but within High Pressure Injection capacity (includes primary leakage, and primary to secondary leakage)	1. Makeup tank level decreasing at a rate greater than 2 inches per minute, while RCS temperature remains steady OR 2. RCS inventory balance indicates >50 gpm total leakage	Alert RA-EP-01700 All Modes
3. Reactor Coolant System leak rate >50 gpm, but within High Pressure Injection Capacity (includes primary leakage, and primary to secondary leakage) AND loss of offsite power	1. A. Makeup tank level decreasing at a rate greater than 2 inches per minute, while RCS temperature remains steady OR B. RCS inventory balance indicates >50 gpm total leakage AND 2. The 13.8 KV busses are de-energized	Site Area Emergency RA-EP-01800 All Modes

See Also: Loss of Fission Product Barrier (1-C-1)
Electrical Failures (4-A-1 thru 5)
Safety/Relief Valve Failure (1-A-1)

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS2. REACTOR COOLANT SYSTEM LEAK RATEA. ABNORMAL RCS LEAK RATE (Cont.)

Condition	Indication(s)	Emergency Classification
4. Loss of Coolant Accident > High Pressure Injection system capacity	1. High Pressure Injection system running <u>AND</u> 2. A. RCS pressure/pressurizer level continue to decrease <u>OR</u> B. RCS temperature/ pressure reach saturation conditions	Site Area Emergency RA-EP-01800 All Modes

See Also: Loss of Fission Product Barrier (1-C-1)
Electrical Failures (4-A-1 thru 5)
Failure of a Primary Relief Valve (1-A-1)

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS3. SAFETY SYSTEM FUNCTIONSA. CRD, RPS

Condition	Indication(s)	Emergency Classification
1. An uncontrolled control rod withdrawal from a subcritical reactor	1. Outward control rod motion is indicated without a command for such motion <u>AND</u> 2. The reactor is initially subcritical	Unusual Event RA-EP-01600 Modes 2, 3, 4, 5
2. Failure of Reactor Protection System (RPS) to initiate and complete a trip which brings the reactor subcritical.	1. Any time plant parameters meet conditions requiring a trip <u>AND</u> 2. RPS fails to initiate and complete a trip (automatic or manual) which brings the reactor subcritical	Alert RA-EP-01700 Modes 1 & 2
3. Transient requiring operation of shutdown systems with failure to trip the reactor (continued power generation but no core damage immediately evident).	1. Any time plant parameters meet conditions requiring a trip <u>AND</u> 2. RPS fails to initiate and complete a trip (automatic or manual) which brings the reactor subcritical <u>AND</u> 3. Power interruption from the Control Room fails to bring the reactor subcritical. ✓	Site Area Emergency RA-EP-01800 Modes 1 & 2

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS3. SAFETY SYSTEM FUNCTIONSB. SW, DH, CCW, MU, HPI, MFW, AFW

Condition	Indication(s)	Emergency Classification
1. Complete loss of any functions needed for plant cold shut-down	Loss of the Low Pressure Injection/Decay Heat System (BOTH TRAINS)	Alert RA-EP-01700 Modes 1, 2, 3 & 4
2. Inability to maintain plant in cold shutdown	1. Loss of any cooling system function needed to maintain cold shutdown (Decay Heat, Component Cooling Water, Service Water) (BOTH TRAINS). <u>AND</u> 2. a. An operational mode change due to temperature increase. <u>OR</u> b. A 30°F rise in RCS temperature. <u>OR</u> c. Core cooling by feed and bleed has been initiated.	Alert RA-EP-01700 Modes 5 & 6

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS3. SAFETY SYSTEM FUNCTIONSB. SW, DH, CCW, MU, HPI, MFW, AFW (Continued)

Condition	Indication(s)	Emergency Classification
3. Complete loss of any function needed for plant hot shutdown	<u>Loss of any of the following systems:</u> 1. Service Water System (BOTH TRAINS) OR 2. Component Cooling Water (BOTH TRAINS) OR 3. A. Makeup System AND B. High Pressure Injection System (BOTH TRAINS) OR 4. A. Main Feedwater System AND B. Auxiliary Feedwater-System AND C. Motor Driven Feed Pump	Site Area Emergency RA-EP-01800 Modes 1,2,3 & 4
4. Loss of water level in the reactor vessel that has or will uncover fuel in the reactor vessel	1. Loss of any cooling system function needed to maintain cold shutdown (Decay Heat, Component Cooling Water, Service Water) (BOTH TRAINS). AND 2. Indication that the core is uncovered (e.g. incores indicate superheat, containment radiation levels increasing, source range detectors increasing, etc.).	Site Area Emergency RA-EP-01800 Modes 5 & 6

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS3. SAFETY SYSTEM FUNCTIONSC. LOSS OF CONTROL ROOM ALARMS, INDICATION, OR COMMUNICATIONS

Condition	Indication(s)	Emergency Classification
1. Communication capability lost to an extent requiring plant shutdown or other significant loss of assessment	Complete loss of the plant telephone system <u>AND</u> Gai-tronics system	Unusual Event RA-EP-01600 All Modes
2. Most or all alarms (annunciators) lost	Any simultaneous loss of all annunciator alarms <u>AND</u> the station computer	Alert RA-EP-01700 Modes 1 & 2
3. Most or all alarms (annunciators) lost and plant transient initiated or in progress	1. Complete loss of all annunciator alarms <u>AND</u> 2. Loss of the station computer <u>AND</u> 3. Plant transient in progress	Site Area Emergency RA-EP-01800 Modes 1 & 2

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS4. ELECTRICAL FAILURESA. AC

Condition	Indication(s)	Emergency Classification
1. Loss of offsite power or loss of onsite AC power capability	1. Loss of power to A and B busses from the following transformers: a. Startup 01 <u>AND</u> b. Startup 02 <u>AND</u> c. Aux 11 OR 2. a. Loss of power to C-1 <u>AND</u> D-1 busses from AC <u>AND</u> BD transformers. <u>AND</u> b. Onsite power capability has been degraded to either 4160 VAC vital bus C-1 or D-1 powered from a diesel generator. OR 3. Loss of all diesel generators.	Unusual Event RA-EP-01600 All Modes
2. AC power capability to vital busses reduced to a single power source for greater than 15 minutes such that any additional single failure would result in a station blackout.	1. Loss of power to C-1 <u>AND</u> D-1 busses from AC <u>AND</u> BD transformers for greater than 15 minutes. AND 2. Onsite power capability has been degraded to either 4160 VAC vital bus C-1 or D-1 powered from a diesel generator.	Alert RA-EP-01900 Modes 1,2,3 & 4

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS4. ELECTRICAL FAILURESA. AC (Continued)

Condition	Indication(s)	Emergency Classification
3. Loss of offsite power and loss of all onsite AC power	4160 VAC vital busses C-1 <u>AND</u> D-1 de-energized longer than momentarily during transfers (see below for extended loss)	Alert RA-EP-01700 All Modes
4. Loss of offsite power and loss of onsite AC power for more than 15 minutes	4160 VAC vital busses C-1 <u>AND</u> D-1 de-energized more than 15 minutes	Site Area Emergency RA-EP-01800 All Modes
5. Prolonged loss of all offsite power and prolonged loss of all onsite AC power.	1. Loss of power to A and B busses from the following transformers: A. Startup 01 <u>AND</u> B. Startup 02 <u>AND</u> C. Aux 11 <u>AND</u> 2. 4160 VAC vital busses C-1 <u>AND</u> D1 are de-energized for more than 15 minutes. <u>AND</u> 3. A. Restoration of at least one vital bus within 4 hours is <u>NOT</u> likely. <u>OR</u> B. Indication of continuing degradation of core cooling based on fission product barrier monitoring.	General Emergency RA-EP-01900 Modes 1,2,3 & 4

See Also: Abnormal RCS Leak Rate With a Loss of Offsite Power (2-A-3)

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS4. ELECTRICAL FAILURESB. DC

Condition	Indication(s)	Emergency Classification
1. Loss of all onsite DC power	All in plant DC busses de-energized (see below for extended loss)	Alert RA-EP-01700 All Modes
2. Loss of all vital onsite DC power for more than 15 minutes	All in plant DC busses de-energized for more than 15 minutes	Site Area Emergency RA-EP-01800 All Modes

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

Personal
judgment
actions

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS5. SECONDARY SYSTEM EVENTSA. MAJOR STEAM LEAK

Condition	Indication(s)	Emergency Classification
1. Rapid depressurization of secondary side	1. A. Increasing containment pressure (if leak is inside containment) <u>OR</u> B. Unusually loud noise <u>OR</u> C. Visual sighting outside containment <u>AND</u> 2. Valid Steam and Feedwater Rupture Control System (SFRCS) automatic initiation on low main steam line pressure	Unusual Event RA-EP-01600 Modes 1, 2, 3 & 4
2. Steam line break with >10 gpm primary to secondary leak rate	1. Indication of a major steam leak (see 5.A.1) <u>AND</u> 2. Main steam line radiation monitor(s) indicate increased activity (RE 600/609) <u>AND</u> 3. RCS leak rate >10 gpm as indicated by: A. Makeup tank decreasing >1/2 inch per minute <u>OR</u> B. RCS inventory balance indicates >10 gpm leak rate <u>OR</u> C. DB-CH-01814, Steam Generator Tube Leak Determination	Alert RA-EP-01700 Modes 1, 2, 3 & 4

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

Approved by:

actions are

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS5. SECONDARY SYSTEM EVENTSA. MAJOR STEAM LEAK (Cont.)

<u>Condition</u>	<u>Indication(s)</u>	<u>Emergency Classification</u>
3. Steam line break with >50 gpm primary to secondary leakage <u>AND</u> indication of fuel damage	1. Indication of a major steam leak (see 5.A.1) <u>AND</u> 2. Main steam line radiation Monitor(s) indicate increased activity (RE 600/ 609 <u>AND</u> 3. RCS leak rate >50 gpm as indicated by: A. Makeup tank decreasing >2 inches per minute <u>OR</u> B. RCS inventory balance indicates >50 gpm leak rate <u>AND</u> 4. Confirmed primary coolant sample results indicate activity above acceptable limits of T.S. 3.4.8	Site Area Emergency RA-EP-01800 Modes 1, 2, 3 & 4

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS5. SECONDARY SYSTEM EVENTSB. MAIN STEAM SAFETY VALVE FAILURE

Condition	Indication(s)	Emergency Classification
1. Failure of safety related safety valves, or relief valves, to close following a pressure reduction	1. Rapid and continuing decrease in steam generator pressure to <500 psig <u>AND</u> 2. Visual or audible observation of a safety valve being open	Unusual Event RA-EP-01600 Modes 1,2,3 & 4

See Also: Major Steam Leak (5-A-1 through 5-A-3)

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS6. RADIATION RELEASE EVENTSA. HIGH RADIATION LEVELS WITHINTHE PROTECTED AREA

Condition	Indication(s)	Emergency Classification
1. Radiation levels or air-borne contamination which indicates a severe degradation in the control of radioactive materials (such as an increase of a factor of 1000 in direct radiation readings)	1. A. An area radiation survey indicates radiation levels >1000 times normal OR B. Airborne radioactivity sample indicates activity levels >1000 times normal OR C. If an area of the plant is inaccessible, a radiation monitor reading indicating radiation levels >1000 times normal	Alert RA-EP-01700 All Modes

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS6. RADIATION RELEASE EVENTSB. FUEL HANDLING ACCIDENT

Condition	Indication(s)	Emergency Classification
1. Fuel handling accident which results in the release of radioactivity to containment or fuel handling area	Direct information from fuel handling personnel indicating that an irradiated fuel assembly has been damaged and radioactive gases are escaping	Alert RA-EP-01700 All Modes
2. Major damage to spent fuel in containment or fuel handling area (e.g., large object damages fuel or water loss below fuel level)	1. Indications of fuel handling accident which results in the release of radioactivity to containment or spent fuel pool area <u>AND</u> 2. A. SFAS incident Level 1 actuation on radiation in containment <u>OR</u> B. Isolation of ventilation in containment or spent fuel pool area based on radiation.	Site Area Emergency RA-EP-01800 All Modes

NOTE

The USAR analyzed fuel handling accident (Chapter 15) postulates the failure of 56 fuel pins from an assembly at maximum burnup, 72 hours after reactor shutdown.

Fuel repair activities involving the handling of an individual fuel pin are covered under the maintenance exception of Section 6.1.1.

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS6. RADIATION RELEASE EVENTSC. ABNORMAL EFFLUENT RELEASE

Condition	Indication(s)	Emergency Classification
1. Effluent release > limits allowed by the Offsite Dose Calculation Manual (ODCM): ODCM Section 2.3.1 ODCM Section 2.4.1 ODCM Section 3.3.1 ODCM Section 3.7.1 ODCM Section 3.8.1	<p><u>The following combination:</u></p> <p>1. Any confirmed effluent release exceeding the limits of the ODCM.</p> <p><u>OR</u></p> <p>2. A high alarm is received on any of the following Radiation Monitoring System monitors for greater than 15 minutes during a release (alarm setpoint established by the Chemistry Department)</p> <p>A. 1878A or B, Miscellaneous Waste Outlet</p> <p><u>OR</u></p> <p>B. 1770A or B, Clean Waste Outlet</p> <p><u>OR</u></p> <p>C. 1822A or B, Waste Gas Outlet</p> <p><u>AND</u></p> <p>3. The associated discharge valve fails to close (automatically <u>OR</u> manually)</p> <p><u>AND</u></p> <p>4. Chemistry Unit or Radiation Protection Section confirms that an ODCM limit has been exceeded.</p>	Unusual Event RA-EP-01600 All Modes

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS6. RADIATION RELEASE EVENTSC. ABNORMAL EFFLUENT RELEASE (Cont.)

Condition	Indication(s)	Emergency Classification
2. Effluent release >10 times limits allowed by the Offsite Dose Calculation Manual (ODCM): ODCM Section 2.3.1 ODCM Section 2.4.1 ODCM Section 3.3.1 ODCM Section 3.7.1 ODCM Section 3.8.1	<p>The following combination:</p> <p>1. Any confirmed effluent release exceeding the ODCM Limits by >10 times the limits</p> <p><u>OR</u></p> <p>2. A high alarm is received on any of the following Radiation Monitoring System monitors at 10 times setpoint (as established by the the Chemistry Department)</p> <p>A. 1878A or B, Miscellaneous Waste Outlet</p> <p><u>OR</u></p> <p>B. 1770A or B, Clean Waste Outlet</p> <p><u>OR</u></p> <p>C. 1822A or B, Waste Gas Outlet</p> <p><u>AND</u></p> <p>3. The associated discharge valve fails to close (automatically <u>OR</u> manually)</p> <p><u>AND</u></p> <p>4. Chemistry Unit or Radiation Protection Section confirms that an ODCM has been exceeded.</p>	<p>Alert</p> <p>RA-EP-01700</p> <p>All Modes</p>

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS6. RADIATION RELEASE EVENTSD. ABNORMAL RADIATION LEVELS AT SITE BOUNDARYNOTE 6.D.1

RE 4598 indication is based on average meteorological conditions: stability class D, wind speed 10 mph.

Condition	Indication(s)	Emergency Classification
1. Projected or actual site boundary radiation levels that indicate a potential dose of about 1 mrem at the site boundary if continued over 2 hours.	1. Station Vent RE 4598 Channel 1 reading $\geq 3.6E-3$ $\mu\text{Ci/cc}$ (Noble Gas) for 2 hours OR 2. 0.5 mrem/hr measured at the Site Boundary for 2 hours	Alert RA-EP-01700 All Modes

NOTE 6.D.2

RE 4598 indications are based on adverse meteorological conditions: stability class F, wind speed 2 mph.

Condition	Indication(s)	Emergency Classification
2. Projected or measured site boundary Total Effective Dose Equivalent (TEDE) rate ≥ 50 mrem/hr for $\frac{1}{2}$ hour.	1. Station Vent RE 4598 Channel 1 (Noble Gas) indicates $1.6E-2$ $\mu\text{Ci/cc}$ or greater for $\frac{1}{2}$ hour OR 2. 50 mrem/hr by direct measurement at the site boundary for $\frac{1}{2}$ hour	Site Area Emergency RA-EP-01800 All Modes

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS6. RADIATION RELEASE EVENTSD. ABNORMAL RADIATION LEVELS AT SITE BOUNDARY (Cont.)NOTES 6.D.3, 6.D.4 and 6.D.5

RE 4598 indications are based on adverse meteorological conditions: stability class F, wind speed 2 mph.

3. Projected or measured site boundary TEDE rate ≥ 500 mrem/hr for 2 minutes	1. Station Vent RE 4598 Channel 1 (Noble Gas) indicates $1.6E-1$ μ ci/cc or greater for 2 minutes	Site Area Emergency RA-EP-01800 All Modes
	OR 2. 500 mrem/hr by direct measurement at the site boundary for 2 minutes	
4. Projected or measured site boundary thyroid dose rate ≥ 250 mrem/hr for $\frac{1}{2}$ hour	1. Station Vent RE 4598 Channel 3 (Iodine) indicates $3.7E-6$ μ ci/cc or greater for $\frac{1}{2}$ hour	Site Area Emergency RA-EP-01800 All Modes
	OR 2. Radioiodine of $7.9E-8$ μ ci/cc by direct measurement at the Site Boundary for $\frac{1}{2}$ hour	
5. Projected or measured site boundary thyroid dose rate ≥ 2500 mrem/hr for 2 minutes	1. Station Vent RE 4598 Channel 3 (Iodine) indicates $3.7E-5$ μ ci/cc or greater for 2 minutes	Site Area Emergency RA-EP-01800 All Modes
	OR 2. Radioiodine of $7.8E-7$ μ ci/cc by direct measurement at the Site Boundary for 2 minutes	

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS6. RADIATION RELEASE EVENTSD. ABNORMAL RADIATION LEVELS AT SITE BOUNDARY (Cont.)NOTE 6.D.6 and 6.D.7


RE 4598 indications are based on adverse meteorological conditions: stability class D, wind speed 10 mph.

6. Projected or measured TEDE rate of 1 rem/hr or greater at the Site Boundary.	1. Station Vent RE 4598 Channel 1 (Noble Gas) indicates $6.9\text{E-}1$ $\mu\text{ci/cc}$ or greater.	General Emergency RA-EP-01900 All Modes
	OR 2. 1 rem/hr by direct measurement at the Site Boundary.	
7. Projected or measured thyroid dose rate of 5 rem/hr or greater at the Site Boundary	1. Station Vent RE 4598 Channel 3 (Iodine) indicates $1.8\text{E-}3$ $\mu\text{ci/cc}$ or greater.	General Emergency RA-EP-01900 All Modes
	OR 2. Radioiodine of $1.7\text{E-}6$ $\mu\text{ci/cc}$ by direct measurement at the Site Boundary.	

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS7. HAZARDS TO STATION OPERATIONSA. FIRE

Condition	Indication(s)	Emergency Classification
1. Fire within the plant lasting more than 10 minutes	1. Any fire within the protected area lasting more than 10 minutes from the initiation of fire suppression (manually or automatically), <u>NO</u> safety systems affected <u>OR</u> 2. Any fire which requires offsite assistance	Unusual Event RA-EP-01600 All Modes
2. Fire potentially affecting safety systems	Any fire at the station that has the potential to damage or degrade a safety system	Alert  RA-EP-01700 All Modes
3. Fire resulting in the loss of redundant trains of a safety system	Any fire that defeats the capability of both trains of a safety system	Site Area Emergency RA-EP-01800 All Modes

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS7. HAZARDS TO STATION OPERATIONSB. AIRCRAFT CRASH

Condition	Indication(s)	Emergency Classification
1. Aircraft crash onsite or unusual aircraft activity over facility	Control room informed by station personnel who have made a visual sighting	Unusual Event RA-EP-01600 All Modes
2. Aircraft crash affecting plant structures	Control room informed by station personnel who have made a visual sighting	Alert RA-EP-01700 All Modes
3. Aircraft crash damaging vital structures by impact or fire.	1. Control room informed by station personnel who have made a visual sighting <u>AND</u> 2. Instrumentation readings on vital systems indicate equipment problems	Site Area Emergency RA-EP-01800 Modes 1,2,3&4

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS7. HAZARDS TO STATION OPERATIONSC. TRAIN DERAILMENT

<u>Condition</u>	<u>Indication(s)</u>	<u>Emergency Classification</u>
1. Train derailment onsite	1. Control room informed by station personnel who have made a visual sighting <u>AND</u> 2. A. Station structures have been damaged <u>OR</u> B. Danger to station personnel exists	Unusual Event RA-EP-01600 All Modes

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS7. HAZARDS TO STATION OPERATIONSD. EXPLOSION

Condition	Indication(s)	Emergency Classification
1. Near or onsite explosion	Control room informed by station personnel who have made a visual sighting	Unusual Event RA-EP-01600 All Modes
2. Onsite explosion affecting plant operations	1. Control room informed by station personnel who have made a visual sighting <u>AND</u> 2. Instrumentation readings on plant systems indicate equipment problems	Alert RA-EP-01700 All Modes
3. Explosion causing severe damage to safe shutdown equipment	Explosion causing loss of: 1. Makeup system <u>AND</u> HPI system <u>OR</u> 2. Ability to supply feed water to the OTSG's	Site Area Emergency RA-EP-01800 Modes 1,2,3&4

NOTE

RA-EP-02840, Explosion, contains further detailed information.

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS7. HAZARDS TO STATION OPERATIONSE. TOXIC OR FLAMMABLE GAS

Condition	Indication(s)	Emergency Classification
1. Near or onsite toxic or flammable gas release	1. Report or detection of toxic or flammable gases that could enter within the Owner Controlled Area in amounts that can affect normal operation of the plant.	Unusual Event RA-EP-01600 All Modes
	<u>OR</u> 2. Report by local, county or State officials for potential evacuation of Owner Controlled Area personnel based on offsite events.	
2. Entry into facility environs of uncontrolled toxic or flammable gas	1. Report or detection of toxic or flammable gas within a Protected Area structure in concentrations that will be threatening to plant personnel.	Alert RA-EP-01700 All Modes
	<u>OR</u> 2. Report or detection of toxic or flammable gases within a Protected Area structure in concentrations that will affect the safe operation of the plant.	

NOTE

RA-EP-02850, Hazardous Chemical and Oil Spills, contains further detailed information.

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS7. HAZARDS TO STATION OPERATIONSE. TOXIC OR FLAMMABLE GAS (Continued)

Condition	Indication(s)	Emergency Classification
3. Entry of uncontrolled flammable gases into vital areas. Entry of uncontrolled toxic gases into vital areas where lack of access to the area constitutes a safety problem. (Plant not in cold shutdown.)	1. Report or detection of toxic or flammable gases within Vital Areas where lack of access to the area prevents operation of BOTH TRAINS of a safety system.	Site Area Emergency RA-EP-01800 Modes 1,2,3&4

NOTE

RA-EP-02850, Hazardous Chemical and Oil Spills, contains further detailed information.

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS7. HAZARDS TO STATION OPERATIONSF. TURBINE DAMAGE

Condition	Indication(s)	Emergency Classification
1. Turbine rotating component failure causing rapid plant shutdown	1. High turbine vibration trip <u>AND</u> 2. Reactor trip	Unusual Event RA-EP-01600 Modes 1 & 2
2. Turbine failure CAS-ing casing penetration	Control room informed by Station personnel who have made a visual inspection of turbine casing	Alert RA-EP-01700 Modes 1 & 2

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS7. HAZARDS TO STATION OPERATIONSG. MISSILE IMPACT

Condition	Indication(s)	Emergency Classification
1. Missile impact from whatever source on the facility	Control room informed by Station personnel of any missile	Alert RA-EP-01700 All Modes
2. Missile impact causing severe damage to safe shutdown equipment	1. Control room informed by Station personnel of any missile impact on safe shutdown equipment <u>AND</u> 2. Instrumentation readings on safe shutdown equipment indicate equipment problems	Site Area Emergency RA-EP-01800 Modes 1,2,3&4

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS7. HAZARDS TO STATION OPERATIONSH. CONTROL ROOM EVACUATION

Condition	Indication(s)	Emergency Classification
1. Evacuation of control room anticipated or required	Any evacuation of the control room anticipated or required with control of shutdown systems established from local stations within 15 minutes	Alert RA-EP-01700 All Modes
2. Evacuation of control room and control of shutdown systems <u>NOT</u> established from local stations in 15 minutes	Any evacuation of the control room with shutdown control <u>NOT</u> established locally within 15 minutes	Site Area Emergency RA-EP-01800 All Modes

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS7. HAZARDS TO STATION OPERATIONSI. SECURITY THREAT

Condition	Indication(s)	Emergency Classification
1. Security threat or attempted entry or attempted sabotage	Report by plant personnel of a security threat with a potential for industrial sabotage (i.e. attempted forcible entry into a vital area, armed entry into the protected area, discovery of suspected bombs or incendiary devices, etc.)	Unusual Event RA-EP-01600 All Modes
2. Ongoing security compromise	Report by a member of the security force that a security emergency is in progress	Alert RA-EP-01700 All Modes
3. Loss of physical control of the plant is ready to take place (imminent)	Physical attack on the plant involving imminent occupancy of the control room <u>OR</u> local shutdown stations that control vital equipment	Site Area Emergency RA-EP-01800 All Modes
4. Loss of physical control of the facility	1. Physical attack on the plant which has resulted in occupation of the control room <u>OR</u> 2. Unauthorized personnel in control of vital plant equipment	General Emergency RA-EP-01900 All Modes

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS8. NATURAL EVENTS (WITHIN OTTAWA COUNTY)A. EARTHQUAKE

Condition	Indication(s)	Emergency Classification
1. Any earthquake felt in-plant or detected on station seismic instrumentation	Any earthquake felt in-plant <u>OR</u> detected by station seismic instrumentation	Unusual Event RA-EP-01600 All Modes
2. Earthquake > Operating Basis Earthquake (OBE) levels	1. Ground motion felt <u>AND</u> 2. OBE alarm on seismic alarm panel C5764A	Alert RA-EP-01700 All Modes
3. Earthquake > Safe Shutdown Earthquake (SSE) levels	1. Ground motion felt <u>AND</u> 2. SSE alarm on seismic alarm panel C5764A	Site Area Emergency RA-EP-01800 Modes 1,2,3&4

NOTE

RA-EP-02820, Earthquake, contains further detailed information.

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS8. NATURAL EVENTS (WITHIN OTTAWA COUNTY)B. TORNADO

Condition	Indication(s)	Emergency Classification
1. Any tornado onsite	Control room informed by station personnel who have made a visual sighting of a tornado crossing the site boundary	Unusual Event RA-EP-01600 All Modes
2. Any tornado striking facility	Control room informed by station personnel who have made a visual sighting of a tornado striking the facility	Alert RA-EP-01700 All Modes

NOTE

RA-EP-02810, Tornado, contains further detailed information.

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS8. NATURAL EVENTS (WITHIN OTTAWA COUNTY)C. HURRICANE FORCE WINDS

Condition	Indication(s)	Emergency Classification
1. Hurricane force winds (greater than 74 mph)	Control room informed of hurricane force winds forecast for Ottawa County	Unusual Event RA-EP-01600 All Modes
2. Hurricane force winds near design basis levels (greater than 74 mph, but less than 90 mph)	1. Control Room informed of hurricane force winds occurring in Ottawa County <u>AND</u> 2. Two successive 15 minute averages from the station meteorological tower are of winds of 74 mph to 90 mph	Alert RA-EP-01700 All Modes
3. Hurricane force winds > design basis levels (greater than 90 mph)	1. Control room informed of hurricane force winds occurring in Ottawa County <u>AND</u> 2. Two successive 15 minute averages from the station meteorological tower are of winds above 90 mph	Site Area Emergency RA-EP-01800 Modes 1,2,3&4

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS8. NATURAL EVENTS (WITHIN OTTAWA COUNTY)D. FLOODING, LOW WATER

Condition	Indication(s)	Emergency Classification
1. 50 year flood or low water, surge or seiche	Forebay level observed to be: 1. High (>580 feet IGLD) OR 2. Low (<562 feet IGLD)	Unusual Event RA-EP-01600 All Modes
2. Flood, low water, surge or seiche near design levels	Forebay level observed to be: 1. High (584 feet IGLD) OR 2. Low (<560 feet IGLD)	Alert RA-EP-01700 All Modes
3. Flood, low water, surge or seiche > design levels with plant not in cold shutdown	Forebay level observed to be: 1. High (>584 feet IGLD) OR 2. Low (<558 feet IGLD)	Site Area Emergency RA-EP-01800 Modes 1,2,3,&4

NOTE

RA-EP-02830, Flooding, contains further detailed information on high water situations.

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS9. MISCELLANEOUS

Condition	Indication(s)	Emergency Classification
1. Inability to reach required shutdown within technical specification limits.	Plant is not brought to a required operating mode within a Technical Specification Limiting Condition for Operation (LCO) Action Statement Time.	Unusual Event RA-EP-01600 Modes 1,2,3,&4
2. Miscellaneous	Other plant conditions exist that warrant increased awareness on the part of the plant operations staff or State and/or local offsite authorities which are not covered under any other existing station procedures.	Unusual Event RA-EP-01600 All Modes
3. Miscellaneous	Other plant conditions exist that warrant precautionary activation of the Technical Support Center and Emergency Control Center and placing other key emergency personnel on standby.	Alert RA-EP-01700 All Modes
4. Miscellaneous	Other plant conditions exist that warrant activation of emergency centers and monitoring teams or a precautionary notification to the public near the site.	Site Area Emergency RA-EP-01800 All Modes

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS9. MISCELLANEOUS (Cont.)

Condition	Indication(s)	Emergency Classification
5. Miscellaneous	Other plant conditions exist, from whatever source, that make release of large amounts of radioactivity in a short time period possible, e.g., any core melt situation.	General Emergency RA-EP-01900 All Modes

NOTE

Personal judgment plays an important role in ensuring that during any specific event the appropriate actions are performed.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS10. DOWNGRADING GUIDELINES

- A. Existing conditions no longer meet the emergency criteria
AND
it appears unlikely that conditions will deteriorate further.
- B. Nonroutine releases of radioactive material to the environment are under control or terminated.
- C. Any fire, flood, earthquake, or similar emergency conditions are controlled or have ceased.
- D. All specified corrective actions have occurred
OR
the plant has been placed in the appropriate operational mode.
- E. All required notifications have been completed.
- F. Agreement between the Technical Support Center and the Emergency Control Center that downgrading is appropriate (if they were activated).
- G. After issuance of offsite protective actions has occurred, State and County officials must concur with the downgrading.

TABLE OF EMERGENCY ACTION LEVEL CONDITIONS11. TERMINATING GUIDELINES

- A. The conditions which caused the emergency have stabilized, are under control, and are unlikely to deteriorate further.
- B. No surveillance relative to offsite protective actions is needed, except for the control of foodstuffs, water, and offsite contamination, or environmental assessment activities.
- C. Radiation levels in affected plant areas are acceptable, and/or are stable or decreasing.
- D. Releases of radioactive material to the environment greater than Offsite Dose Calculation Manual are under control or have ceased.
- E. The potential for an uncontrolled release of radioactive material is at an acceptable, low level.
- F. Containment pressure is within Technical Specification requirements related to the existing mode of operation.
- G. The reactor is in a stable, safe shutdown condition and long-term core cooling is available, as required.
- H. Any fire, flood, earthquake, or similar emergency conditions no longer exist.
- I. All offsite notifications are complete.
- J. Offsite conditions will not limit access of personnel and resources.
- K. Discussions have been held with those federal, state and local organizations that have mobilized in support of the emergency, and that are in direct communication with DBNPS.
- L. The Technical Support Center (TSC) staff, if activated, has evaluated plant status with respect to Technical Specifications and concurs with termination of the emergency.

7.0 FINAL CONDITIONS

Abnormal plant conditions have been terminated and an Emergency Director is no longer required.

8.0 RECORDS

- 8.1 The following quality assurance records are completed by this procedure and shall be listed on the Nuclear Records List, captured, and submitted to Nuclear Records Management in accordance with NG-NA-00106:

8.1.1 None

- 8.2 The following non-quality assurance records are completed by this procedure and may be captured and submitted to Nuclear Records Management in accordance with NG-NA-00106:

8.2.1 None

ATTACHMENT 13: CONDITIONS AFFECTING EDG OPERABILITY

<u>PARAMETER</u>	<u>CONDITION</u>	<u>RESULT</u>
1. EDG Room Temperature	Greater than 120°F	Qualification issue. Contact Engineer in accordance with DB-OP-02037.
2. EDG Room TIC	Loss of power or not functioning (Removing any damper actuator from service causes a loss of control signal to all actuators)	EDG Inoperable. EDG Ventilation will not maintain EDG Room Temperature less than 120°F.
3. EDG Ventilation	Outside air temperature greater than 68°F with less than both Supply Air Fans OPERABLE.	EDG Inoperable
	Exception: With one Supply Air Fan inoperable, if outside air temperature is below 68°F and the inoperable fan is blanked off.	EDG OPERABLE
4. Lube Oil Temperature	Less than 85°F as indicated on TI 20173 (EDG 1) TI 20174 (EDG 2)	EDG Inoperable
5. Circulating (Soak Back) Oil Pump	Not operating when the EDG is in Standby	EDG Inoperable
6. Turbo Oil Pumps	Both AC and DC pumps not running	EDG Inoperable
7. Lube Oil Return Line from Camshaft Area	<ul style="list-style-type: none"> Oil Level not visible in lower sightglass Oil Level not visible in upper sightglass while running 	EDG OPERABLE but requires attention. EDG OPERABLE but requires attention.
8. Governor Oil Level	Low out of the sightglass	EDG Inoperable
9. Lube Oil Sump Level	Less than the LOW mark on the dipstick while in Standby Mode	EDG Inoperable
10. Immersion Heater	Breaker open or heater not functioning	EDG OPERABLE unless lube oil temperature drops below 85°F.
11. Cooling Water Expansion Tank Level	Less than the operating level bottom of sightglass	EDG Inoperable
12. Starting Air Receivers	Both less than 210 PSIG for an EDG	EDG Inoperable

ATTACHMENT 13: CONDITIONS AFFECTING EDG OPERABILITY (Continued)

<u>PARAMETER</u>	<u>CONDITION</u>	<u>RESULT</u>
13. Starting Air Regulator Outlet Pressure	Both less than 140 PSIG for an EDG as indicated on PI 2987 - DA 30 air start side PI 2988 - DA 44 air start side PI 2989 - DA 31 air start side PI 2994 - DA 45 air start side	EDG Inoperable
14. DC Control Power	Loss of power	EDG Inoperable
15. AC Control Power	Loss of power	EDG Inoperable. Power is lost to the EDG Room TIC.
16. EDG Fuel Oil Storage Tank Level	Less than 32,000 gallons	EDG Inoperable
17. EDG Fuel Oil Transfer Pump	Loss of power or not functioning	EDG Inoperable
18. EDG Fuel Oil Day Tank Level	Less than 4,000 gallons	EDG Inoperable
19. DC Motor Driven Fuel Oil Pump	Loss of power or not functioning	EDG Inoperable if not running. The diesel can be started but may not meet the fast start criteria (<10 sec). Operable if running.
20. Ambient Air Temperature (Computer Point M012 or equivalent)*	Use the flowchart on the next page.	

*Equivalent is defined as a direct reading at the 10 meter elevation at the Meteorological Tower or the Toledo temperature provided on www.weather.com. Computer Point M012 reads only to 100°F.

Curve	Title
1	Maximum RCS P/T for Cooldown
2	Minimum RCS P/T to Maintain RCS Subcooled
3	Minimum RCS P/T to provide NPSH with one RCP operating in a Loop
4	Minimum RCS P/T to provide NPSH with two RCP's operating in a Loop
5	Saturation Curve
6	Abnormal Transient Envelope
7	Maximum RCS P/T during simultaneous operation of DH Pumps and normal combination of RC Pumps

Note 1 - **Curves 1, 2, and 6**
RCS Pressure indicated on RCS Wide Range Pressure Indicator PI-RC2A4 (P732) or PI-RC2B4 (P724).

Curves 3 and 4
With RCS Pressure greater than 500 psig, use RCS Wide Range Pressure Indicators PI-RC2A4 (P732), or PRS-RC2A1, or PI RC2B4 (P724)

With RCS Pressure less than 500 psig, use RCS Hot Leg Low Range Pressure Indication from PI RC2A6

Note 2 - **Curves 1, 3, 4, and 7**
RCS Temperature indicated on RCS Cold Leg Temperature Indicator TI RC4A2 or TI RC4B2

Curves 2 and 6
RCS Temperature based on average of Core Exit Thermocouple readings

Note 3 - **Curves 1, 2, 3, 4, and 7** are corrected for instrument error to ensure limits are not exceeded.

Curve 5 is not instrument error corrected since it is a water saturation curve only.

Curve 6 is not instrument error corrected as it is guidance only, not a limit.

RCS PRESSURE/TEMPERATURE LIMITS

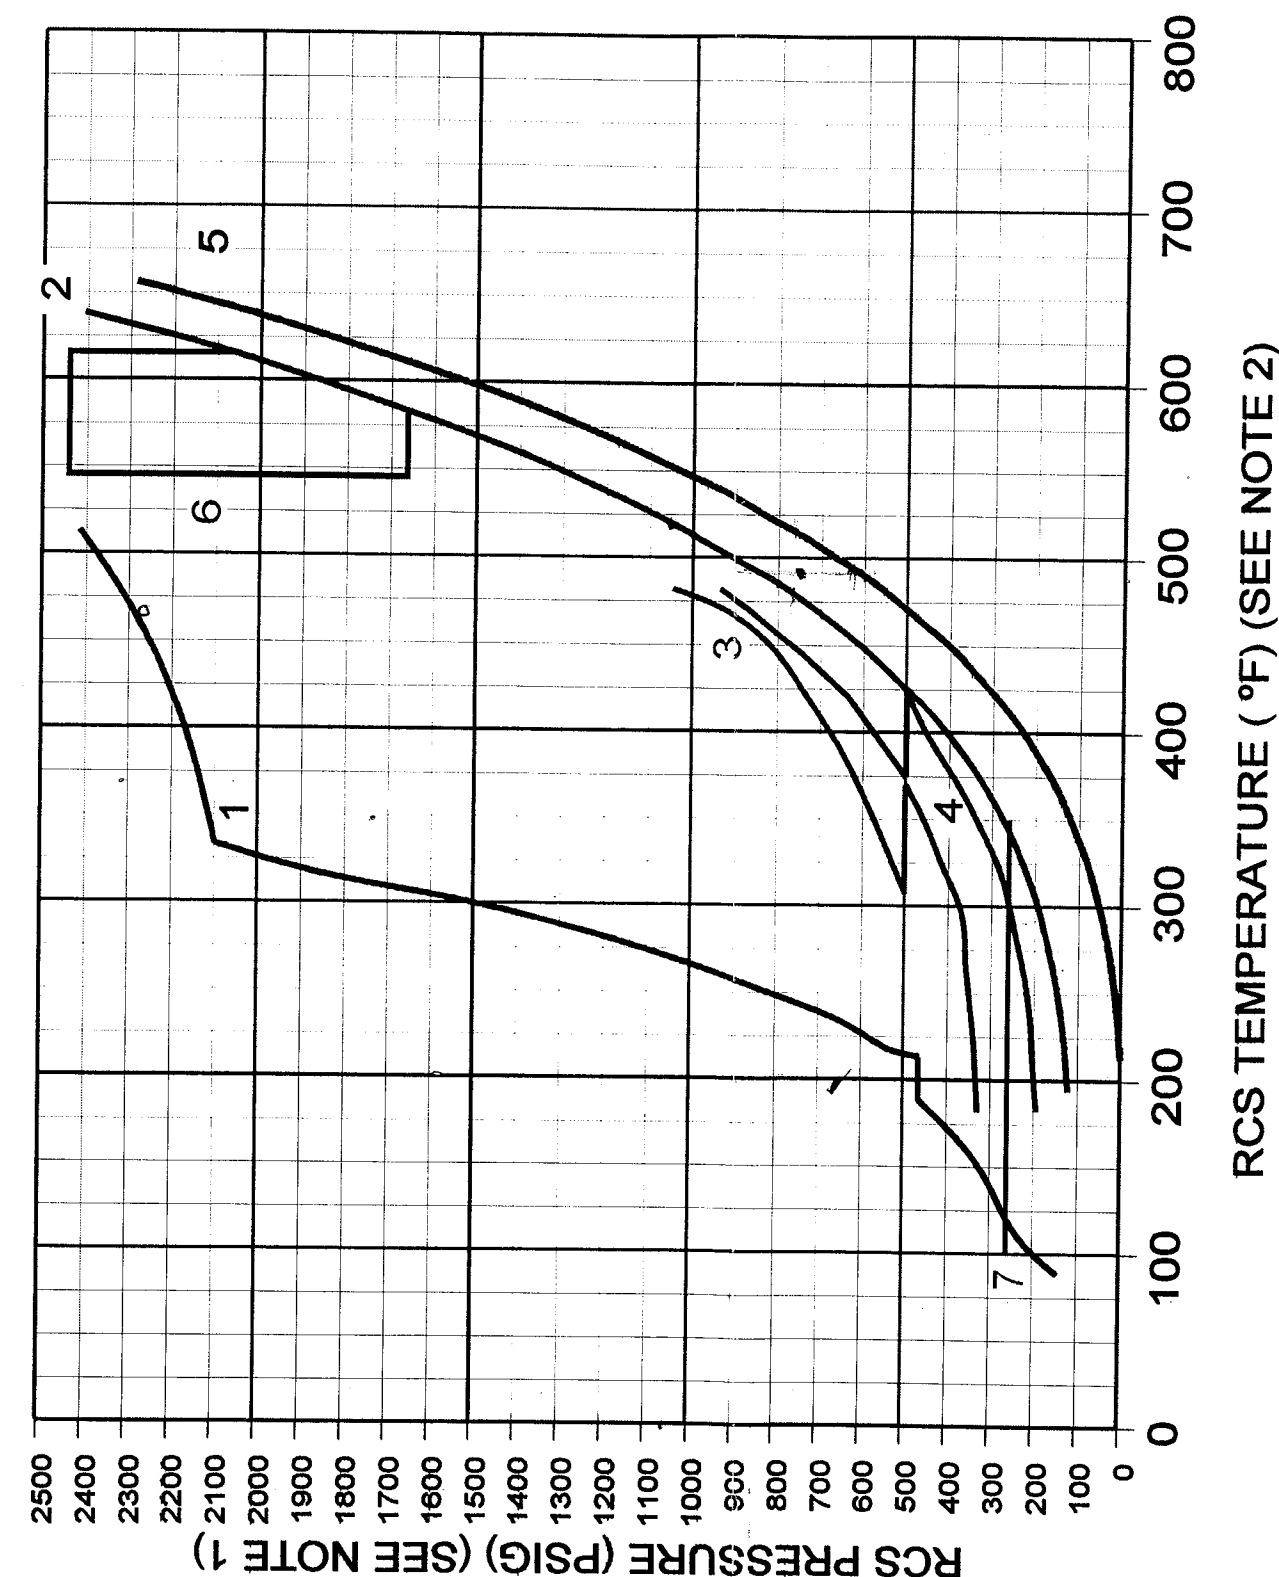


FIGURE 2
Incore, T/C
Temperature vs
RCS Pressure
for ICC

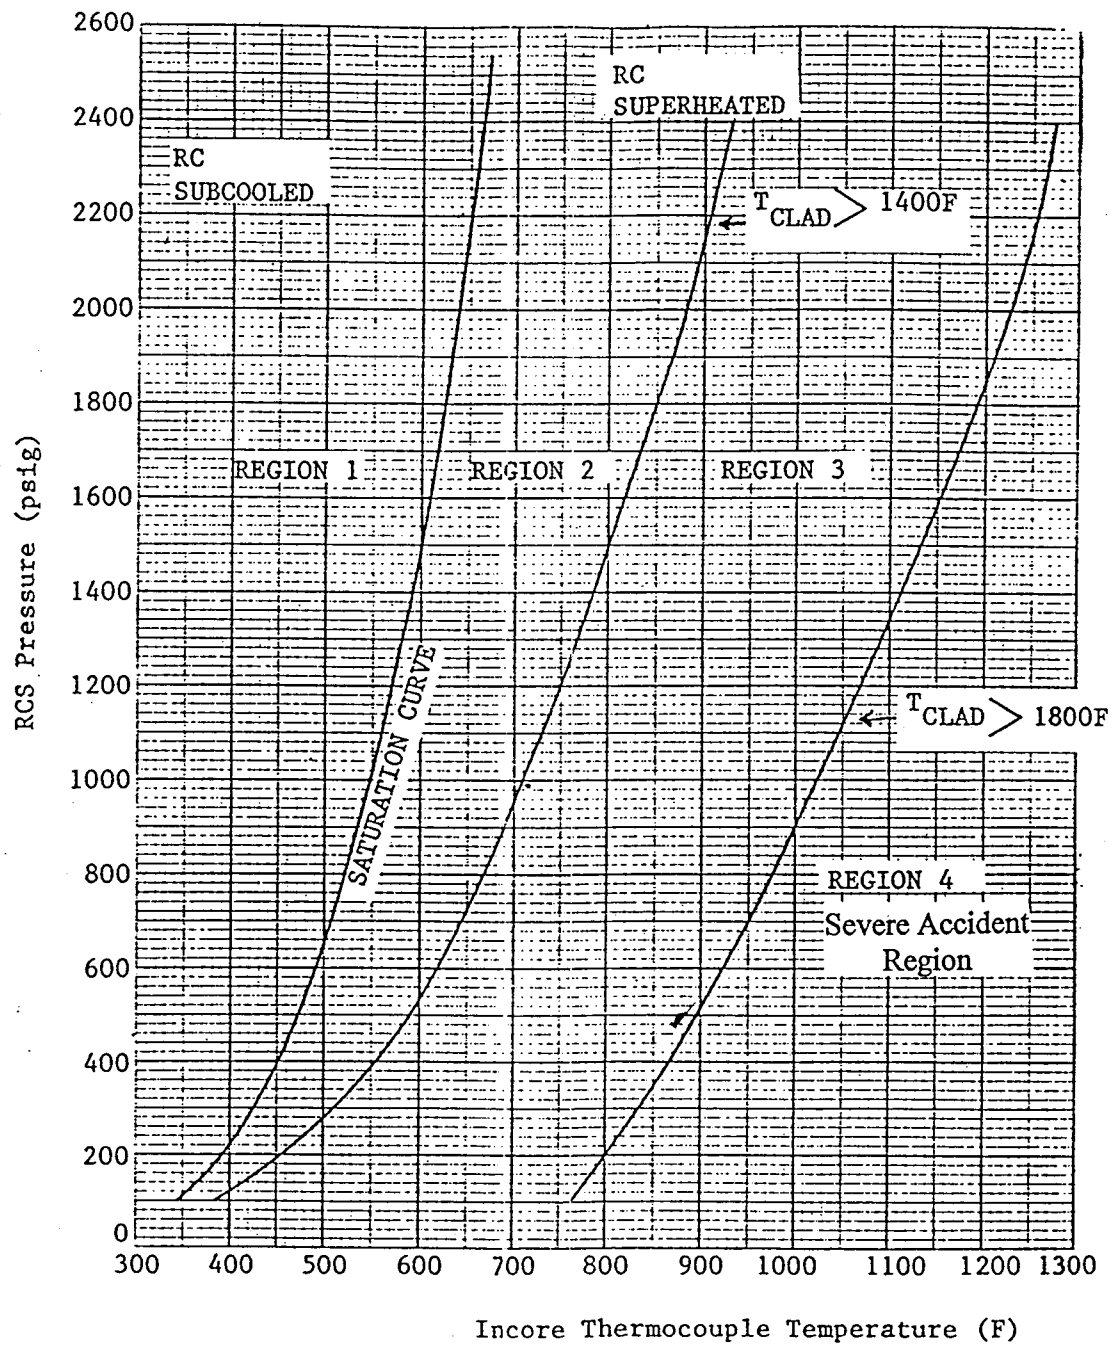


Figure 2
Sheet 1 of 1