

**RELOCATED TO USAR  
PAGE INTENTIONALLY LEFT BLANK**

---



## INSTRUMENTATION

### BASES

---

#### 3/4.3.7.9 RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION

The radioactive liquid effluent instrumentation is provided to monitor and control, as applicable, the releases of radioactive materials in liquid effluents during actual or potential releases of liquid effluents. The alarm/Trip Setpoints for these instruments shall be calculated and adjusted in accordance with the methodology and parameters in the ODCM to ensure that the alarm/trip will occur before exceeding the limits of 10 CFR 20. The OPERABILITY and use of this instrumentation is consistent with the requirements of GDC 60, 63, and 64 of Appendix A to 10 CFR 50. The purpose of tank level indicating devices is to assure the detection and control of leaks that if not controlled could potentially result in the transport of radioactive materials to UNRESTRICTED AREAS.

#### 3/4.3.7.10 RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION

The radioactive gaseous effluent instrumentation is provided to monitor and control, as applicable, the releases of radioactive materials in gaseous effluents during actual or potential releases of gaseous effluents. The alarm/Trip Setpoints for these instruments shall be calculated and adjusted in accordance with the methodology and parameters in the ODCM to ensure that the alarm/trip will occur before exceeding the limits of 10 CFR 20. The range of the noble gas channels of the main stack and radwaste/reactor building vent effluent monitors is sufficiently large to envelope both normal and accident levels of noble gas activity. The capabilities of these instruments are consistent with the recommendations of Regulatory Guide 1.97, "Instrumentation for Light Water Cooled Nuclear Power Plants to Assess Plant Conditions During and Following an Accident," December 1980 and NUREG-0737, "Clarification of the TMI Action Plan Requirements," November 1980. This instrumentation also includes provisions for monitoring and controlling the concentrations of potentially explosive gas mixtures in the offgas system. The OPERABILITY and use of this instrumentation is consistent with the requirements of GDC 60, 63, and 64 of Appendix A to 10 CFR 50.



### 3/4.11 RADIOACTIVE EFFLUENTS

#### BASES

---

#### 3/4.11.1 LIQUID EFFLUENTS

##### 3/4.11.1.1 CONCENTRATION

This CONTROL is provided to ensure that the concentration of radioactive materials released in liquid waste effluents to UNRESTRICTED AREAS will be less than the concentration levels specified in 10 CFR 20, Appendix B, Table II, Column 2. This limitation provides additional assurance that the levels of radioactive materials in bodies of water in UNRESTRICTED AREAS will result in exposures within: (1) the Section II.A design objectives of Appendix I to 10 CFR 50, to a MEMBER OF THE PUBLIC and (2) the limits of 10 CFR 20.106(e) to the population. The concentration limit for dissolved or entrained noble gases is based upon the assumption that Xe-135 is the controlling radioisotope and its MPC in air (submersion) was converted to an equivalent concentration in water using the methods described in International Commission on Radiological Protection (ICRP) Publication 2.

This CONTROL applies to the release of radioactive materials in liquid effluents from all units at the site.

The required detection capabilities for radioactive materials in liquid waste samples are tabulated in terms of the lower limits of detection (LLDs). Detailed discussion of the LLD, and other detection limits can be found in L. A. Currie, "Lower Limit of Detection: Definition and Elaboration of a Proposed Position for Radiological Effluent and Environmental Measurements," NUREG/CR-4007 (September 1984), and in the HASL Procedures Manual, HASL-300 (revised annually).

##### 3/4.11.1.2 DOSE

This CONTROL is provided to implement the requirements of Sections II.A, III.A, and IV.A of Appendix I to 10 CFR 50. The CONTROL implements the guides set forth in Section II.A of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A of Appendix I to assure that the releases of radioactive materials in liquid effluents to UNRESTRICTED AREAS will be kept as low as is reasonably achievable. Also, for fresh water sites with drinking water supplies that can be potentially affected by plant operations, there is reasonable assurance that the operation of the facility will not result in radionuclide concentrations in the potable drinking water that are in excess of the requirements of 40 CFR 141. The dose calculation methodology and parameters in the ODCM implement the requirements in Section III.A of Appendix I that conformance with the guides of Appendix I be shown by Calculational procedures based on models and data, so that the actual exposure of a MEMBER OF THE PUBLIC through appropriate pathways is unlikely to be substantially underestimated. The equations specified in the ODCM for calculating the doses that result from actual release rates of radioactive material in liquid effluents are consistent with the methodology provided in RG 1.109, "Calculation of Annual Doses To Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I,"



## RADIOACTIVE EFFLUENTS

### BASES

---

### LIQUID EFFLUENTS

#### DOSE

##### 3/4.11.1.2 (Continued)

Revision 1, October 1977 and R.G. 1.113, "Estimating Aquatic Dispersion of Effluents from Accidental and Routine Reactor Releases for the Purpose of Implementing Appendix I," April 1977. This CONTROL applies to the release of radioactive materials in liquid effluents from each unit at the site. For units with shared radwaste treatment systems, the liquid effluents from the shared system are to be proportioned among the units sharing that system.

##### 3/4.11.1.3 LIQUID RADWASTE TREATMENT SYSTEM

The OPERABILITY of the liquid radwaste treatment system ensures that this system will be available for use whenever liquid effluents require treatment before release to the environment.

The requirement that the appropriate portions of this system be used when specified provides assurance that the releases of radioactive materials in liquid effluents will be kept as low as is reasonably achievable. This CONTROL implements the requirements of 10 CFR 50.36a, GDC 60 of Appendix A to 10 CFR 50 and the design objective given in Section II.D of Appendix I to 10 CFR 50. The specified limits governing the use of appropriate portions of the liquid radwaste treatment system were specified as a suitable fraction of the dose design objectives set forth in Section II.A of Appendix I to 10 CFR 50 for liquid effluents. This CONTROL applies to the release of radioactive materials in liquid effluents from each unit at the site. For units with shared radwaste treatment systems, the liquid effluents from the shared system are to be proportioned among the units sharing that system.

##### 3/4.11.2 GASEOUS EFFLUENTS

###### 3/4.11.2.1 DOSE RATE

This CONTROL is provided to ensure that the dose rate at any time at and beyond the SITE BOUNDARY from gaseous effluents from all units on the site will be within the annual dose limits of 10 CFR 20 to UNRESTRICTED AREAS.



## RADIOACTIVE EFFLUENTS

### BASES

---

### GASEOUS EFFLUENTS

#### DOSE RATE

##### 3/4.11.2.1 (Continued)

The annual dose limits are the doses associated with the concentrations of 10 CFR 20, Appendix B, Table II, Column 1. These limits provide reasonable assurance that radioactive material discharged in gaseous effluents will not result in the exposure of a MEMBER OF THE PUBLIC in an UNRESTRICTED AREA, either within or outside the SITE BOUNDARY, to annual average concentrations exceeding the limits specified in Appendix B, Table II of 10 CFR 20.106(b). For MEMBERS OF THE PUBLIC who may at times be within the SITE BOUNDARY, the occupancy of that MEMBER OF THE PUBLIC will usually be sufficiently low to compensate for any increase in the atmospheric diffusion factor above that for the SITE BOUNDARY. Examples of calculations for such MEMBERS OF THE PUBLIC, with the appropriate occupancy factors, shall be given in the ODCM. The specified release rate limits restrict, at all times, the corresponding gamma and beta dose rates above background to a MEMBER OF THE PUBLIC at or beyond the SITE BOUNDARY to less than or equal to 500 mrem/year to the whole body or to less than or equal to 3000 mrem/year to the skin. These release rate limits also restrict, at all times, the corresponding thyroid dose rate above background to a child via the inhalation pathway to less than or equal to 1500 mrem/year. This CONTROL applies to the release of radioactive materials in gaseous effluents from all units at the site.

The required detection capabilities for radioactive materials in gaseous waste samples are tabulated in terms of the lower limits of detection (LLDs). Detailed discussion of the LLD, and other detection limits can be found in

L. A. Currie, "Lower Limit of Detection: Definition and Elaboration of a Proposed Position for Radiological Effluent and Environments Measurements," NUREG/CR-4007 (September 1984), and in the HASL Procedures Manual, HASL-300 (revised annually).

##### 3/4.11.2.2 DOSE - NOBLE GASES

This CONTROL is provided to implement the requirements of Section II.B, III.A, and IV.A of Appendix I to 10 CFR 50. The CONTROL implements the guides set forth in Section II.B of Appendix I. The ACTION statements provide the required operating flexibility and, at the same time, implement the guides set forth in Section IV.A of Appendix I to assure that the releases of radioactive material in gaseous effluents to UNRESTRICTED AREAS will be kept as low as is reasonably achievable. The Surveillance Requirements implement the requirements in Section III.A of Appendix I that conformance with the guidelines of Appendix I be shown by calculational procedures based on models and data so that the actual exposure of a MEMBER OF THE PUBLIC through appropriate pathways is unlikely to be substantially underestimated. The dose calculation methodology and parameters established in the ODCM for calculating the doses from the actual release rates of radioactive noble gases



## RADIOACTIVE EFFLUENTS

### BASES

---

### GASEOUS EFFLUENTS

#### DOSE - NOBLE GASES

##### 3/4.11.2.2 (Continued)

in gaseous effluents are consistent with the methodology provided in RG 1.109, "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I," Revision 1, October 1977, and RG 1.111, "Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light-Water Cooled Reactors," Revision 1," July 1977. The ODCM equations provided for determining the air doses at or beyond the SITE BOUNDARY are based upon real-time meteorological conditions or the historical average atmospheric conditions. This CONTROL applies to the release of radioactive material in gaseous effluents from each unit at the site.

##### 3/4.11.2.3 DOSE - IODINE-131, IODINE-133, TRITIUM, AND RADIOACTIVE MATERIAL IN PARTICULATE FORM

This CONTROL is provided to implement the requirements of Sections II.C, III.A, and IV.A of Appendix I to 10 CFR 50. The CONTROL implements the guides set forth in Section II.C of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A of Appendix I to assure that the releases of radioactive materials in gaseous effluents to UNRESTRICTED AREAS will be kept as low as is reasonably achievable. The ODCM calculational methods specified in the Surveillance Requirements implement the requirements in Section III.A of Appendix I that conformance with the guides of Appendix I be shown by calculational procedures based on models and data, so that the actual exposure of a MEMBER OF THE PUBLIC through appropriate pathways is unlikely to be substantially underestimated. The ODCM calculational methodology and parameters for calculating the doses from the actual release rates of the subject materials are consistent with the methodology provided in RG 1.109, "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I," Revision 1, October 1977, and RG 1.111, "Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light-Water-Cooled Reactors," Revision 1, July 1977. These equations also provide for determining the actual doses based upon the historical average atmospheric conditions. The release rate CONTROLS for iodine-131, iodine-133, tritium, and radioactive material in particulate form with half-lives greater than 8 days are dependent upon the existing radionuclide pathways to man, in the areas at or beyond the SITE BOUNDARY. The pathways that were examined in the development of these calculations were: (1) individual inhalation of airborne radioactive material, (2) deposition of radioactive material onto green leafy vegetation with subsequent consumption by man, (3) deposition onto grassy areas where milk-producing animals and meat-producing animals graze (human consumption of the milk and meat is assumed), and (4) deposition on the



## RADIOACTIVE EFFLUENTS

### BASES

---

### GASEOUS EFFLUENTS

#### DOSE - IODINE-131, IODINE-133, TRITIUM, AND RADIOACTIVE MATERIAL IN PARTICULATE FORM

##### 3/4.11.2.3 (Continued)

ground with subsequent exposure to man. This CONTROL applies to the release of radioactive materials in gaseous effluents from each unit at the site. For units with shared radwaste treatment systems, the gaseous effluents from the shared system are proportioned among the units sharing that system.

##### 3/4.11.2.4 & 3/4.11.2.5 GASEOUS RADWASTE TREATMENT SYSTEM AND VENTILATION EXHAUST TREATMENT SYSTEM

The OPERABILITY of the GASEOUS RADWASTE TREATMENT SYSTEM and the VENTILATION EXHAUST TREATMENT SYSTEM ensures that the systems will be available for use whenever gaseous effluents require treatment before release to the environment. The requirement that the appropriate portions of these systems be used, when specified, provides reasonable assurance that the releases of radioactive materials in gaseous effluents will be kept as low as is reasonably achievable. This CONTROL implements the requirements of 10 CFR 50.36a, GDC 60 of Appendix A to 10 CFR 50, and the design objectives given in Section II.D of Appendix I to 10 CFR 50. Limits governing the use of appropriate portions of the system were specified as a suitable fraction of the dose design objectives set forth in Sections II.B and II.C of Appendix I to 10 CFR 50, for gaseous effluents. This CONTROL applies to the release of radioactive materials in gaseous effluents from each unit at the site. For units with shared radwaste treatment systems, the gaseous effluents from the shared system are proportional among the units sharing that system.

##### 3/4.11.2.8 VENTING OR PURGING

This CONTROL provides reasonable assurance that releases from drywell and/or suppression chamber purging operations will not exceed the annual dose limits of 10 CFR 20 for unrestricted areas.



## RADIOACTIVE EFFLUENTS

### BASES

---

### GASEOUS EFFLUENTS

#### 3/4.11.4 TOTAL DOSE

This CONTROL is provided to meet the dose limitations of 40 CFR 190 that have been incorporated into 10 CFR 20 by 46 FR 18525. The CONTROL requires the preparation and submittal of a Special Report whenever the calculated doses from releases of radioactivity and from radiation from uranium fuel cycle sources exceed 25 mrem to the whole body or any organ, except the thyroid (which shall be limited to less than or equal to 75 mrem). For sites containing up to four reactors, it is highly unlikely that the resultant dose to a MEMBER OF THE PUBLIC will exceed the dose limits of 40 CFR 190 if the individual reactors remain within twice the dose design objectives of Appendix I, and if direct radiation doses from the units including outside storage tanks, etc., are kept small. The Special Report will describe a course of action that should result in the limitation of the annual dose to a MEMBER OF THE PUBLIC to within the 40 CFR 190 limits. For the purposes of the Special Report, it may be assumed that the dose commitment to the MEMBER OF THE PUBLIC from other uranium fuel cycle sources is negligible, with the exception that dose contributions from other nuclear fuel cycle facilities at the same site or within a radius of 5 miles must be considered. If the dose to any MEMBER OF THE PUBLIC is estimated to exceed the requirements of 40 CFR 190, the Special Report with a request for a variance (provided the release conditions resulting in violation of 40 CFR 190 have not already been corrected), in accordance with the provisions of 40 CFR 190.11 and 10 CFR 20.405c, is considered to be a timely request and fulfills the requirements of 40 CFR 190 until NRC staff action is completed. The variance only relates to the limits of 40 CFR 190, and does not apply in any way to the other requirements for dose limitation of 10 CFR 20, as addressed in CONTROLS 3.11.1.1 and 3.11.2.1. An individual is not considered a MEMBER OF THE PUBLIC during any period in which the individual is engaged in carrying out any operation that is part of the nuclear fuel cycle.



## 3/4.12 RADIOLOGICAL ENVIRONMENTAL MONITORING

### BASES

---

#### 3/4.12.1 MONITORING PROGRAM

The Radiological Environmental Monitoring Program required by this CONTROL provides representative measurements of radiation and of radioactive materials in those exposure pathways and for those radionuclides that lead to the highest potential radiation exposure of MEMBERS OF THE PUBLIC resulting from the plant operation. This monitoring program implements Section IV.B.2 of Appendix I to 10 CFR 50 and thereby supplements the Radiological Effluent Monitoring Program by verifying that the measurable concentrations of radioactive materials and levels of radiation are not higher than expected on the basis of the effluent measurements and the modeling of the environmental exposure pathways. Guidance for this monitoring program is provided by the Radiological Assessment Branch Technical Position on Environmental Monitoring, Revision 1, November 1979. The initially specified monitoring program will be effective for at least the first 3 years of commercial operation. After this period, program changes may be initiated based on operational experience.

The required detection capabilities for environmental sample analyses are tabulated in terms of the lower limits of detection (LLDs). The LLDs required by Table 4.12.1-1 are considered optimum for routine environmental measurements in industrial laboratories. It should be recognized that the LLD is defined as a before-the-fact limit representing the capability of a measurement system and not as an after-the-fact limit for a particular measurement.

Detailed discussion of the LLD, and other detection limits, can be found in L. A. Currie, "Lower Limit of Detection: Definition and Elaboration of a Proposed Position for Radiological Effluent and Environmental Measurements," NUREG/CR-4007 (September 1984), and in the HASL Procedures Manual, HASL-300 (revised annually).

#### 3/4.12.2 LAND USE CENSUS

This CONTROL is provided to ensure that changes in the use of areas at or beyond the SITE BOUNDARY are identified and that modifications to the Radiological Environmental Monitoring Program given in the ODCM are made if required by the results of this census. The best information, such as from a door-to-door survey, from an aerial survey, or from consulting with local agricultural authorities, shall be used. This census satisfies the requirements of Section IV.B.3 of Appendix I to 10 CFR 50. Restricting the census to gardens of greater than 500 square feet provides assurance that significant exposure pathways via leafy vegetables will be identified and monitored since a garden of this size is the minimum required to produce the quantity (26 kg/year) of leafy vegetables assumed in RG 1.109 for consumption by a child. To determine this minimum garden size, the following assumptions were made: (1) 20% of the garden was used for growing broad leaf vegetation (i.e., similar to lettuce and cabbage) and (2) the vegetation yield was 2 kg/m<sup>2</sup>.

A MILK SAMPLING LOCATION, as defined in Section 1.0, requires that at least 10 milking cows are present at a designated milk sample location. It has been



## RADIOLOGICAL ENVIRONMENTAL MONITORING

### BASES

---

#### LAND USE CENSUS

##### 3/4.12.2 (Continued)

found from past experience, and as a result of conferring with local farmers, that a minimum of 10 milking cows is necessary to guarantee an adequate supply of milk twice a month for analytical purposes. Locations with fewer than 10 milking cows are usually utilized for breeding purposes, eliminating a stable supply of milk for samples as a result of suckling calves and periods when the adult animals are dry.

##### 3/4.12.3 INTERLABORATORY COMPARISON PROGRAM

The requirement for participation in an approved Interlaboratory Comparison Program is provided to ensure that independent checks on the precision and accuracy of the measurements of radioactive materials in environmental sample matrices are performed as part of the quality assurance program for environmental monitoring in order to demonstrate that the results are valid for the purposes of Section IV.B.2 of Appendix I to 10 CFR 50.



**PART I - RADIOLOGICAL EFFLUENT CONTROLS**

**SECTION 5.0**

**DESIGN FEATURES**



## 5.0 DESIGN FEATURES

---

Sections 5.1.1, 5.1.2, 5.2, 5.3, 5.4, 5.6, and 5.7 are retained in the RETS.

**5.1.3 MAP DEFINING UNRESTRICTED AREAS AND SITE BOUNDARY FOR RADIOACTIVE GASEOUS AND LIQUID EFFLUENTS.** Information regarding radioactive gaseous and liquid effluents, which will allow identification of structures and release points as well as definition of UNRESTRICTED AREAS within the SITE BOUNDARY that are accessible to MEMBERS OF THE PUBLIC, shall be as shown in Figure 5.1.3-1.

## 5.5 METEOROLOGICAL TOWER LOCATION

---

The Meteorological Tower shall be located as shown on Figure 5.1.3-1.



**FIGURE 5.1.3-1  
SITE BOUNDARIES**



### **NOTES TO FIGURE 5.1.3-1**

- (a) NMP1 Stack (height is 350')
- (b) NMP2 Stack (height is 430')
- (c) JAFNPP Stack (height is 385')
- (d) NMP1 Radioactive Liquid Discharge (Lake Ontario, bottom)
- (e) NMP2 Radioactive Liquid Discharge (Lake Ontario, bottom)
- (f) JAFNPP Radioactive Liquid Discharge (Lake Ontario, bottom)
- (g) Site Boundary
- (h) Lake Ontario Shoreline
- (i) Meteorological Tower
- (j) Training Center
- (k) Energy Information Center

**Additional Information:**

- NMP2 Reactor Building Vent is located 187 feet above ground level
- JAFNPP Reactor and Turbine Building Vents are located 173 feet above ground level
- JAFNPP Radwaste Building Vent is 112 feet above ground level
- The Energy Information Center and adjoining picnic area are UNRESTRICTED AREAS within the SITE BOUNDARY that are accessible to MEMBERS OF THE PUBLIC
- Lake Road, a private road, is an UNRESTRICTED AREA within the SITE BOUNDARY accessible to MEMBERS OF THE PUBLIC



**PART I - RADIOLOGICAL EFFLUENT CONTROLS**

**SECTION 6.0**

**ADMINISTRATIVE CONTROLS**



## ADMINISTRATIVE CONTROLS

### ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT\*

6.9.1.7 Routine Annual Radiological Environmental Operating Reports covering the operation of the unit during the previous calendar year shall be submitted before May 1 of each year. The initial report shall be submitted before May 1 of the year after the plant achieves initial criticality.

The Annual Radiological Environmental Operating Report shall include summaries, interpretations, and an analysis of trends of the results of the radiological environmental surveillance activities for the report period, including a comparison, as appropriate, with preoperational studies, operational controls, previous environmental surveillance reports, and an assessment of the observed impacts of the plant operation on the environment. The reports shall also include the results of the land use census required by CONTROL 3.12.2.

The Annual Radiological Environmental Operating Reports shall include the results of analysis of all radiological environmental samples and of all environmental radiation measurements taken during the period pursuant to the locations specified in the table and figures in the OFFSITE DOSE CALCULATION MANUAL, as well as summarized and tabulated results of these analyses and measurements in the format of the table in the Radiological Assessment Branch Technical Position, Revision 1, November 1979. In the event that some individual results are not available for inclusion with the report, the report shall be submitted noting and explaining the reasons for the missing results. The missing data shall be submitted as soon as possible in a supplemental report.

The reports shall also include the following: a summary description of the Radiological Environmental Monitoring Program; at least two legible maps\*\* covering all sampling locations keyed to a table giving distances and directions from the centerline of one reactor; the results of licensee participation in the Interlaboratory Comparison Program, required by CONTROL 3.12.3; discussion of all deviations from the Sampling Schedule of Table 3.12.1-1; and discussion of all analyses in which the LLD required by Table 4.12.1-1 was not achievable.

---

\* *A single submittal may be made for a multiple unit site. The submittal should combine those sections that are common to all units at the site.*

\*\* *One map shall cover stations near the SITE BOUNDARY; a second shall include the more distant stations.*



## SEMIANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT\*

6.9.1.8 Routine Semiannual Radioactive Effluent Release Reports covering the operation of the unit during the previous 6 months of operation shall be submitted within 60 days after January 1 and July 1 of each year. The period of the first report shall begin with the date the plant achieves initial criticality.

The Semiannual Radioactive Effluent Release Reports shall also include a summary of the quantities of radioactive liquid and gaseous effluents and solid waste released from the unit as outlined in Regulatory Guide 1.21, "Measuring, Evaluating, and Reporting Radioactivity in Solid Wastes and Light-Water-Cooled Nuclear Power Plants," Revision 1, June 1974, with data summarized on a quarterly basis following the format of Appendix B thereof. For solid wastes, the format for Table 3 in Appendix B shall be supplemented with three additional categories; class of solid wastes (as defined by 10 CFR 61), type of container (e.g., LSA, Type A, Type B, Large Quantity), and SOLIDIFICATION agent or absorbent (e.g., cement, urea formaldehyde).

The Semiannual Radioactive Effluent Release Report to be submitted within 60 days after January 1 of each year shall include an annual summary of hourly meteorological data collected over the previous year. This annual summary may be either in the form of an hour-by-hour listing on magnetic tape of wind speed, wind direction, atmospheric stability and precipitation (if measured), or in the form of joint frequency distribution of wind speed, wind direction, and atmospheric stability.\*\* This same report shall also include an assessment of the radiation doses from the radioactive liquid and gaseous effluents released from the unit during the previous calendar year. The same report shall also include an assessment of the radiation doses from radioactive liquid and gaseous effluents to MEMBERS OF THE PUBLIC from their activities inside the SITE BOUNDARY (Figure 5.1.3-1) during the report period. All assumptions used in making these assessments, i.e., specific activity, exposure time, and location, shall be included in these reports. The assessment of radiation doses shall be performed in accordance with the methodology and parameters in the OFFSITE DOSE CALCULATION MANUAL (ODCM).

The Semiannual Radioactive Effluent Release Report to be submitted within 60 days after January 1 of each year shall also include an assessment of radiation doses to the likely most exposed MEMBER OF THE PUBLIC from reactor releases and other nearby uranium fuel cycle sources, including doses from primary effluent pathways and direct radiation, for the previous calendar year to show conformance with 40 CFR 190, "Environmental Radiation Protection Standards for Nuclear Power Operation." Acceptable methods for calculating the dose contribution from liquid and gaseous effluents are given in the ODCM.

The Semiannual Radioactive Effluent Release Reports shall include a list and description of unplanned releases from the site to UNRESTRICTED AREAS of radioactive materials in gaseous and liquid effluents made during the reporting period.

---

\* *A single submittal may be made for a multiple unit site. The submittal should combine those sections that are common to all units at the site; however, for units with separate radwaste systems, the submittal shall specify the releases of radioactive material from each unit.*

\*\* *In lieu of submission with the Semiannual Radioactive Effluent Release Report, the licensee has the option of retaining this summary of required meteorological data on site in a file that shall be provided to the NRC upon request.*



## ADMINISTRATIVE CONTROLS

### SEMIANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT

#### 6.9.1.8 (Continued)

The Semiannual Radioactive Effluent Release Reports shall include any changes made during the reporting period to the PROCESS CONTROL PROGRAM (PCP) and to the OFFSITE DOSE CALCULATION MANUAL (ODCM), pursuant to Technical Specification 6.13 and CONTROL 6.14, respectively, as well as any major change to liquid, gaseous, or solid radwaste treatment systems pursuant to CONTROL 6.15. It shall also include a listing of new locations for dose calculations and/or environmental monitoring identified by the land use census pursuant to CONTROL 3.12.2.

The Semiannual Radioactive Effluent Release Reports shall also include the following: an explanation of why the inoperability of liquid or gaseous effluent monitoring instrumentation was not corrected within the time specified in CONTROLS 3.3.7.9 or 3.3.7.10 respectively, and a description of the events leading to liquid holdup tanks exceeding the limits of Technical Specification 3.11.1.4.



#### 6.14 OFFSITE DOSE CALCULATION MANUAL

6.14.1 The OFFSITE DOSE CALCULATION MANUAL (ODCM) shall be approved by the Commission before implementation.

6.14.2 Licensee-initiated changes to the ODCM:

- a. Shall be submitted to the Commission in the Semiannual Radioactive Effluent Release Report for the period in which the change(s) was made effective. This submittal shall contain:
  1. Sufficiently detailed information to totally support the rationale for the change without benefit of additional or supplemental information. Information submitted should consist of a package of those pages of the ODCM to be changed; each page should be numbered, dated, and marked with the revision number; appropriate analyses or evaluations justifying the change(s) should be included;
  2. A determination that the change will not reduce the accuracy or reliability of dose calculations or setpoint determinations; and
  3. Documentation of the fact that the SORC has reviewed the change and found it acceptable.
- b. Shall become effective upon review and acceptance by the SORC.



## 6.15 MAJOR CHANGES TO LIQUID, GASEOUS, AND SOLID RADWASTE TREATMENT SYSTEMS\*

6.15.1 Licensee-initiated major changes to the radwaste treatment systems (liquid, gaseous, and solid):

- a. Shall be reported to the Commission in the Semiannual Radioactive Effluent Release Report for the period in which the evaluation was reviewed by the SORC. The discussion of each change shall contain:
  1. A summary of the evaluation that led to the determination that the change could be made in accordance with 10 CFR 50.59.
  2. Sufficient detailed information to totally support the reason for the change without benefit of additional or supplemental information;
  3. A detailed description of the equipment, components, and processes involved and the interfaces with other plant systems;
  4. An evaluation of the change, which shows the predicted releases of radioactive materials in liquid and gaseous effluents and/or quantity of solid waste that differ from those previously predicted in the license application and amendments thereto;
  5. An evaluation of the change, which shows the expected maximum exposures to a MEMBER OF THE PUBLIC in the UNRESTRICTED AREA and to the general population that differ from those previously estimated in the license application and amendments thereto;
  6. A comparison of the predicted releases of radioactive materials, in liquid and gaseous effluents and in solid waste, to the actual releases for the period that precedes the time when the change is to be made;
  7. An estimate of the exposure to plant operating personnel as a result of the change; and
  8. Documentation of the fact that the change was reviewed and found acceptable by the SORC.
- b. Shall become effective upon review and acceptance by the SORC.

---

\* Licensees may choose to submit the information called for in this CONTROL as part of the annual FSAR update.



## **PART II - CALCULATIONAL METHODOLOGIES**

---



Service Water A and B, Cooling Tower Blowdown and the Liquid Radioactive Waste Discharges comprise the Radioactive Liquid Effluents at Unit 2. Presently there are no temporary outdoor tanks containing radioactive water capable of affecting the nearest known or future water supply in an unrestricted area. NUREG 0133 and Regulatory Guide 1.109, Rev. 1 were followed in the development of this section.

## 1.1 Liquid Effluent Monitor Alarm Setpoints

### 1.1.1 Basis

The concentration of radioactive material released in liquid effluents to UNRESTRICTED AREAS (see Figure 5.1.3-1) shall be limited to the concentrations specified in 10 CFR 20, Appendix B, Table II, Column 2, for radionuclides other than dissolved or entrained noble gases. For dissolved or entrained noble gases, the concentration shall be limited to 2E-04 uCi/ml total activity.

### 1.1.2 Setpoint Determination Methodology

#### 1.1.2.1 Liquid Radwaste Effluent Radiation Alarm Setpoint

The Liquid Radioactive Waste System Tanks are pumped to the discharge tunnel which in turn flows directly to Lake Ontario. At the end of the discharge tunnel in Lake Ontario, a diffuser structure has been installed. Its purpose is to maintain surface water temperatures low enough to meet thermal pollution limits. However, it also assists in the near field dilution of any activity released. Service Water and the Cooling Tower Blowdown are also pumped to the discharge tunnel and will provide dilution. If the Service Water or the Cooling Tower Blowdown is found to be contaminated, then its activity will be accounted for when calculating the permissible radwaste effluent flow for a Liquid Radwaste discharge. The Liquid Radwaste System Monitor provides alarm and automatic termination of release if radiation levels above its alarm setpoint are detected.

The radiation detector is a sodium iodide crystal. It is a scintillation device. The crystal is sensitive to gamma and beta radiation. However, because of the metal walls of the sample chamber and the absorption characteristics of water, the monitor is not particularly sensitive to beta radiation. Actual detector response  $\sum_i (CG_i/CF_i)$ , cpm, has been evaluated by placing a sample of typical radioactive waste into the monitor and recording the gross count rate, cpm. A calibration ratio was developed by dividing the noted detector response,  $\sum_i (CG_i/CF_i)$  cpm, by total concentration of activity  $\sum_i (CG_i)$ , uCi/cc. The quantification of the gamma activity was completed with gamma spectrometry equipment whose calibration is traceable to NIST. This calibration ratio verified the manufacturer's prototype calibration, and any subsequent transfer calibrations performed. The current calibration factor (expressed as the reciprocal conversion factor, uCi/ml/cpm), will be used for subsequent setpoint calculations in the determination of detector response:

$$\sum_i (CG_i/CF_i) = \sum_i (CG_i/CF_i)$$

Where the factors are as defined above.



For the calculation of  $RDF = \sum \text{MPC fraction} = \sum_i (C_i / \text{MPC}_i)$  the contribution from non gamma emitting nuclides except tritium will be initially estimated based on the expected ratios to quantified nuclides as listed in the FSAR Table 11.2.5. Fe-55, Sr-89 and Sr-90 are 2.5, 0.25 and 0.02 times the concentration of Co-60. These values may be replaced by ratios calculated from analysis of composite samples.

Tritium concentration is assumed to equal the latest concentration detected in the monthly tritium analysis (performed offsite) of liquid radioactive waste tanks discharged.

Nominal flow rates of the Liquid Radioactive Waste System Tanks discharged is < 165 gpm while dilution flow from the Service Water Pumps, and Cooling Tower Blowdown cumulatively is typically over 10,200 gpm. Because of the large amount of dilution the alarm setpoint could be substantially greater than that which would correspond to the concentration actually in the tank. Potentially a discharge could continue even if the distribution of nuclides in the tank were substantially different from the grab sample obtained prior to discharge which was used to establish the detector alarm point. To avoid this possibility of "Non representative Sampling" resulting in erroneous assumptions about the discharge of a tank, the tank is recirculated for a minimum of 2.5 tank volumes prior to sampling.

This monitor's setpoint takes into account the dilution of Radwaste Effluents provided by the Service Water and Cooling Tower Blowdown flows. Detector response for the nuclides to be discharged (cpm) is multiplied by the Actual Dilution Factor (dilution flow/waste stream flow) and divided by the Required Dilution Factor (total fraction of MPC in the waste stream). A safety factor is used to ensure that the limit is never exceeded. Service Water and Cooling Tower Blowdown are normally non-radioactive. If they are found to be contaminated prior to a Liquid Radwaste discharge then an alternative equation is used to take into account the contamination. If they become contaminated during a Radwaste discharge, then the discharge will be immediately terminated and the situation fully assessed.

Normal Radwaste Effluent Alarm Setpoint Calculation:

$$\text{Alarm Setpoint} \leq 0.8 * \text{TDF} / \text{PEF} * \text{TGC} / \text{CF} * 1 / \text{RDF} + \text{Background}.$$

Where:

Alarm Setpoint	=	The Radiation Detector Alarm Setpoint, cpm
0.8	=	Safety Factor, unitless
TDF	=	Nonradioactive dilution flow rate, gpm. Service Water Flow ranges from 30,000 to 58,000 gpm. Blowdown flow is typically 10,200 gpm
$C_i$	=	Concentration of isotope i in Radwaste tank prior to dilution, uCi/ml (gamma + non-gamma emitters)
$\text{CF}_i$	=	Detector response for isotope i, net uCi/ml/cpm See Table 2-1 for a list of nominal values
PEF	=	The permissible Radwaste Effluent Flow rate, gpm, 165 gpm is the maximum value used in this equation
$\text{MPC}_i$	=	Concentration limit for isotope i from 10CFR20 Appendix B, Table II, Column 2, uCi/ml



Background	=	Detector response when sample chamber is filled with nonradioactive water, cpm
CF	=	Monitor Conversion Factor, uCi/ml/cpm, determined at each calibration of the effluent monitor
CG <sub>i</sub>	=	Concentration of gamma emitting nuclide in Radwaste tank prior to dilution, uCi/ml
TGC = $\sum CG_i$	=	Summation of all gamma emitting nuclides (which monitor will respond to)
$\sum (CG_i/CF_i)$	=	The total detector response when exposed to the concentration of nuclides in the Radwaste tank, cpm
RDF = $\sum_i (C_i/MPC_i)$	=	The total fraction of the 10CFR20, Appendix B, Table II, Column 2 limit that is in the Radwaste tank, unitless. This is also known as the Required Dilution Factor (RDF), and includes non-gamma emitters
TGC/CF	=	An approximation to $\sum_i (CG_i/CF_i)$ using CF determined at each calibration of the effluent monitor
TDF/PEF	=	An approximation to (TDF + PEF)/PEF, the Actual Dilution Factor in effect during a discharge.

Permissible effluent flow, PEF, shall be calculated to determine that MPC will not be exceeded in the discharge canal.

$$PEF = \frac{(\text{Dilution Flow}) (1 - \text{Fraction Tempering})}{(\text{RDF}) 1.5}$$

Fraction Tempering = A diversion of some fraction of discharge flow to the intake canal for the purpose of temperature control.

If Actual Dilution Factor is set equal to the Required Dilution Factor, then the alarm points required by the above equations correspond to a concentration of 80% of the Radwaste Tank concentration. No discharge could occur, since the monitor would be in alarm as soon as the discharge commenced. To avoid this situation, maximum allowable radwaste discharge flow is calculated using a multiple (usually 1.5 to 2) of the Required Dilution Factor, resulting in discharge canal concentration of 2/3 to 1/2 of MPC prior to alarm and termination of release. In performing the alarm calculation, the smaller of 165 gpm (the maximum possible flow) and PEF will be used.

To ensure the alarm setpoint is not exceeded, an alert alarm is provided. The alert alarm will be set in accordance with the equation above using a safety factor of 0.5 (or lower) instead of 0.8.

#### 1.1.2.2 Contaminated Dilution Water Radwaste Effluent Monitor Alarm Setpoint Calculation:

The allowable discharge flow rate for a Radwaste tank, when one of the normal dilution streams (Service Water A, Service Water B, or Cooling Tower Blowdown) is contaminated, will be calculated by an iterative process. Using Radwaste tank concentrations with a total liquid effluent flow rate the resulting fraction of MPC in the discharge canal will be calculated.

$$FMPC = \sum_s [F_s / \sum_s (F_s) \sum_i (C_{is} \div MPC_i)]$$



Then the permissible radwaste effluent flow rate is given by:

$$PEF = \frac{\text{Total Radwaste Effluent Flow}}{FMPC}$$

The corresponding Alarm Setpoint will then be calculated using the following equation, with PEF limited as above.

$$\text{Alarm Setpoint} \leq 0.8 \frac{TGC/CF}{FMPC} + \text{Background}$$

Where:

Alarm Setpoint	=	The Radiation Detector Alarm Setpoint, cpm
0.8	=	Safety Factor, Unitless
$F_s$	=	An Effluent flow rate for stream s, gpm
$C_i$	=	Concentration of isotope i in Radwaste tank prior to dilution, uCi/ml
$C_{is}$	=	Concentration of isotope i in Effluent stream s including the Radwaste Effluent tank undiluted, uCi/ml
CF	=	Average detector response for all isotopes in the waste stream, net uCi/ml/cpm
$MPC_i$	=	Concentration limit for isotope i from 10CFR20 Appendix B, Table II, Column 2, uCi/ml
PEF	=	The permissible Radwaste Effluent Flow rate, gpm
Background	=	Detector response when sample chamber is filled with nonradioactive water, cpm
$TGC/CF = \sum_i (CG_i/CF)$	=	The total detector response when exposed to the concentration of nuclides in the Radwaste tank, cpm
$\sum_s [F_s C_{is}]$	=	The total activity of nuclide i in all Effluent streams, uCi-gpm/ml
$\sum_s [F_s]$	=	The total Liquid Effluent Flow rate, gpm (Service Water & CT Blowdown & Radwaste)

#### 1.1.2.3 Service Water and Cooling Tower Blowdown Effluent Alarm Setpoint

These monitor setpoints do not take any credit for dilution of each respective effluent stream. Detector response for the distribution of nuclides potentially discharged is divided by the total MPC fraction of the radionuclides potentially in the respective stream. A safety factor is used to ensure that the limit is never exceeded.

Service Water and Cooling Tower Blowdown are normally non-radioactive. If they are found to be contaminated by statistically significant increase in detector response then grab samples will be obtained and analysis meeting the LLD requirements of Table 4.11.1-1 completed so that an estimate of offsite dose can be made and the situation fully assessed.

Service Water A and B and the Cooling Tower Blowdown are pumped to the discharge tunnel which in turn flows directly to Lake Ontario. Normal flow rates for each Service Water Pump is 10,000 gpm while that for the Cooling Tower Blowdown may be as much as 10,200 gpm. Credit is not taken for any dilution of these individual effluent streams.



The radiation detector is a sodium iodide crystal. It is a scintillation device. The crystal is sensitive to gamma and beta radiation. However, because of the metal walls in its sample chamber and the absorption characteristics of water, the monitor is not particularly sensitive to beta radiation.

Detector response  $\sum_i (C_i/CF_i)$  has been evaluated by placing a diluted sample of Reactor Coolant (after a two hour decay) in a representative monitor and noting its gross count rate. Reactor Coolant was chosen because it represents the most likely contaminant of Station Waters.

A two hour decay was chosen by judgement of the staff of Niagara Mohawk Power Corporation. Reactor Coolant with no decay contains a considerable amount of very energetic nuclides which would bias the detector response term high. However assuming a longer than 2 hour decay is not realistic as the most likely release mechanism is a leak through the Residual Heat Removal Heat Exchangers which would contain Reactor Coolant during shutdowns.

Service Water and Cooling Tower Blowdown Alarm Setpoint Equation:

$$\text{Alarm Setpoint} < 0.8 \frac{1}{CF} \sum_i C_i / [\sum_i (C_i/MPC_i)] + \text{Background}.$$

Where:

Alarm Setpoint	=	The Radiation Detector Alarm Setpoint, cpm
0.8	=	Safety Factor, unitless
$C_i$	=	Concentration of isotope i in potential contaminated stream, uCi/ml
$CF_i$	=	Detector response for isotope i, net uCi/ml/cpm See Table 2-1 for a list of nominal values
$MPC_i$	=	Concentration limit for isotope i from 10CFR20 Appendix B, Table II, Column 2, uCi/ml
Background	=	Detector response when sample chamber is filled with nonradioactive water, cpm
$\sum_i (C_i/CF_i)$	=	The total detector response when exposed to the concentration of nuclides in the potential contaminant, cpm
$\sum_i (C_i/MPC_i)$	=	The total fraction of the 10CFR20, Appendix B, Table II, Column 2 limit that is in the potential contaminated stream, unitless.
$(1/CF) \sum_i C_i$	=	An approximation to $\sum_i (C_i/CF_i)$ , determined at each calibration of the effluent monitor
CF	=	Monitor Conversion Factor, uCi/ml/cpm

## 1.2 Liquid Effluent Concentration Calculation

This calculation documents compliance with CONTROLS Section 3.11.1.1:

The concentration of radioactive material released in liquid effluents to UNRESTRICTED AREAS (see Figure 5.1.3-1) shall be limited to the concentrations specified in 10 CFR 20, Appendix B, Table II, Column 2, for radionuclides other than dissolved or entrained noble gases. For dissolved or entrained noble gases, the concentration shall be limited to 2E-04 microcurie/ml total activity.



The concentration of radioactivity from Liquid Radwaste, Service Water A and B and the Cooling Tower Blowdown are included in the calculation. The calculation is performed for a specific period of time. No credit is taken for averaging. The limiting concentration is calculated as follows:

$$\text{FMPC} = \frac{\sum_s [F_s / \sum_s (F_s) \sum_i (C_{is} / \text{MPC}_i)]}{1}$$

Where:

- FMPC = The fraction of MPC, the ratio at the point of discharge of the actual concentration to the limiting concentration of 10 CFR 20, Appendix B, Table II, Column 2, for radionuclides other than dissolved or entrained noble gases, unitless
- $C_{is}$  = The concentration of nuclide i in a particular effluent stream s, uCi/ml
- $F_s$  = The flow rate of a particular effluent stream s, gpm
- $\text{MPC}_i$  = The limiting concentration of a specific nuclide i from 10CFR20, Appendix b, Table II, Column 2 (for noble gases, the concentration shall be limited to 2E-4 microcurie/ml), uCi/ml
- $\sum_i (C_{is} / \text{MPC}_i)$  = The MPC fraction of stream s prior to dilution by other streams
- $\sum_s (F_s)$  = The total flow rate of all effluent streams s, gpm

A value of less than one for MPC fraction is required for compliance.

### 1.3 Liquid Effluent Dose Calculation Methodology

The dose or dose commitment to a MEMBER OF THE PUBLIC from radioactive materials in liquid effluents released, from each unit, to UNRESTRICTED AREAS (see Figure 5.1.3-1) shall be limited:

- a. During any calendar quarter to less than or equal to 1.5 mrem to the whole body and to less than or equal to 5 mrem to any organ, and
- b. During any calendar year to less than or equal to 3 mrem to the whole body and to less than or equal to 10 mrem to any organ.

Doses due to Liquid Effluents are calculated monthly for the fish and drinking water ingestion pathways and the external sediment exposure pathways from all detected nuclides in liquid effluents released to the unrestricted areas using the following expression from NUREG 0133, Section 4.3.

$$D_t = \sum_i [A_{it} \sum_L (\Delta T_L C_{iL} F_L)]$$

Where:

- $D_t$  = The cumulative dose commitment to the total body or any organ, t from the liquid effluents for the total time period  $\sum_L (\Delta T_L)$ , mrem
- $\Delta T_L$  = The length of the L th time period over which  $C_{iL}$  and  $F_L$  are averaged for all liquid releases, hours



$C_{iL}$	=	The average concentration of radionuclide, i, in undiluted liquid effluents during time period $\Delta T_L$ from any liquid release, uCi/ml
$A_{it}$	=	The site related ingestion dose commitment factor for the maximum individual to the total body or any organ t for each identified principal gamma or beta emitter, mrem/hr per uCi/ml. Table 2-2.
$F_L$	=	The near field average dilution factor for $C_{iL}$ during any liquid effluent release. Defined as the ratio of the maximum undiluted liquid waste flow during release to the product of the average flow from the site discharge structure to unrestricted receiving waters times 5.9. (5.9 is the site specific applicable factor for the mixing effect of the discharge structure.) See the Nine Mile Point Unit 2 Environmental Report - Operating License Stage, Table 5.4-2 footnote 1.

#### 1.4 Liquid Effluent Sampling Representativeness

There are four tanks in the radwaste system designed to be discharged to the discharge canal. These tanks are labeled 4A, 4B, 5A, and 5B.

Liquid Radwaste Tank 5A and 5B at Nine Mile Point Unit 2 contain a sparger spray ring which assists the mixing of the tank contents while it is being recirculated prior to sampling. This sparger effectively mixes the tank four times faster than simple recirculation.

Liquid Radwaste Tank 4A and 4B contain a mixing ring but no sparger. No credit is taken for the mixing effects of the ring. Normal recirculation flow is 150 gpm for tank 5A and 5B, 110 gpm for tank 4A and 4B while each tank contains up to 25,000 gallons although the entire contents are not discharged. To assure that the tanks are adequately mixed prior to sampling, it is a plant requirement that the tank be recirculated for the time required to pass 2.5 times the volume of the tank:

$$\text{Recirculation Time} = 2.5T/RM$$

Where:

Recirculation Time	=	Is the minimum time to recirculate the Tank, min
2.5	=	Is the plant requirement, unitless
T	=	Is the tank volume, gal
R	=	Is the recirculation flow rate, gpm.
M	=	Is the factor that takes into account the mixing of the sparger, unitless, four for tank 5A and B, one for tank 4A and B.

Additionally, the Alert Alarm setpoint of the Liquid Radwaste Effluent monitor is set at approximately 60% of the High alarm setpoint. This alarm will give indication of incomplete mixing with adequate margin to exceeding MPC.

Service Water A and B and the Cooling Tower Blowdown are sampled from the radiation monitor on each respective stream. These monitors continuously withdraw a sample and pump it back to the effluent stream. The length of tubing between the continuously flowing sample and the sample spigot contains less than 200 ml which is adequately purged by requiring a purge of at least 1 liter when grabbing a sample.



## 1.5 Liquid Radwaste System Operability

The Liquid Radwaste Treatment System shall be OPERABLE and used when projected doses due to liquid radwaste effluents would exceed 0.06 mrem to the whole body or 0.2 mrem to any organ in a 31-day period. Cumulative doses will be determined at least once per 31 days (as indicated in Section 1.3) and doses will also be projected if the radwaste treatment systems are not being fully utilized.

The system collection tanks are processed as follows:

- 1) Low Conductivity (Waste Collector): Radwaste Filter and Radwaste Demineralizer or the Thermex System.
- 2) High Conductivity (Floor Drains): Regenerant Evaporator or the Thermex System.
- 3) Regenerant Waste: If resin regeneration is used at NMP-2; the waste will be processed through the regenerant evaporator or Thermex System.

The dose projection indicated above will be performed in accordance with the methodology of Section 1.3.



## 2.0 GASEOUS EFFLUENTS

The gaseous effluent release points are the stack and the combined Radwaste/Reactor Building vent. The stack effluent point includes Turbine Building ventilation, main condenser offgas (after charcoal bed holdup), and Standby Gas Treatment System exhaust. NUREG 0133 and Regulatory Guide 1.109, Rev. 1 were followed in the development of this section.

### 2.1 Gaseous Effluent Monitor Alarm Setpoints

#### 2.1.1 Basis

The dose rate from radioactive materials released in gaseous effluents from the site to areas at or beyond the SITE BOUNDARY (see Figure 5.1.3-1) shall be limited to the following:

- a. For noble gases: Less than or equal to 500 mrem/yr to the whole body and less than or equal to 3000 mrem/yr to the skin, and
- b. For iodine-131, for iodine-133, for tritium, and for all radionuclides with half-lives greater than 8 days: Less than or equal to 1500 mrem/yr to any organ.

The radioactivity rate of noble gases measured downstream of the recombiner shall be limited to less than or equal to 350,000 microcuries/second during offgas system operation.

#### 2.1.2 Setpoint Determination Methodology Discussion

Nine Mile Point Unit 1 and the James A FitzPatrick nuclear plants occupy the same site as Nine Mile Point Unit 2. Because of the independence of these plants' safety systems, control rooms and operating staffs it is assumed that simultaneous accidents are not likely to occur at the different units. However, there are two release points at Unit 2. It is assumed that if an accident were to occur at Unit 2 that both release points could be involved.

The alarm setpoint for Gaseous Effluent Noble Gas Monitors are based on a dose rate limit of 500 mRem/yr to the Whole Body. Since there are two release points at Unit 2, the dose rate limit of 500 mRem/yr is divided equally for each release point, but may be apportioned otherwise, if required. These monitors are sensitive to only noble gases. Because of this it is considered impractical to base their alarm setpoints on organ dose rates due to iodines or particulates. Additionally skin dose rate is never significantly greater than the whole body dose rate. Thus the factor R which is the basis for the alarm setpoint calculation is nominally taken as equal to 250 mRem/yr. If there are significant releases from any gaseous release point on the site (> 25 mRem/yr) for an extended period of time then the setpoint will be recalculated with an appropriately smaller value for R.

The high alarm setpoint for the Offgas Noble Gas monitor is based on a limit of 350,000 uCi/sec. This is the release rate for which a FSAR accident analysis was completed. At this rate the Offgas System charcoal beds will not contain enough activity so that their failure and subsequent release of activity will present a significant offsite dose assuming accident meteorology.



Initially, in accordance with CONTROL 4.3.7.10, the Germanium multichannel analysis systems of the stack and vent will be calibrated with gas standards (traceable to NIST) in accordance with Table 4.3.7.10-1, note (a). Subsequent calibrations may be performed with gas standards, or with related solid sources. The quarterly Channel Functional Test will include operability of the 30cc chamber and the dilution stages to confirm monitor high range capability. (Appendix D, Gaseous Effluent Monitoring System).

#### 2.1.2.1 Stack Noble Gas Detector Alarm Setpoint Equation:

The stack at Nine Mile Point Unit 2 receives the Offgas after charcoal bed delay, Turbine Building Ventilation and the Standby Gas Treatment system exhaust. The Standby Gas Treatment System Exhausts the primary containment during normal shutdowns and maintains a negative pressure on the Reactor Building to maintain secondary containment integrity. The Standby Gas Treatment will isolate on high radiation detected (by the SGTS monitor) during primary containment purges.

The stack noble gas detector is made of germanium. It is sensitive to only gamma radiation. However, because it is a computer based multichannel analysis system it is able to accurately quantify the activity released in terms of uCi of specific nuclides. Only pure alpha and beta emitters are not detectable, of which there are no common noble gases. A distribution of Noble Gases corresponding to offgas is chosen for the nominal alarm setpoint calculation. Offgas is chosen because it represents the most significant contaminant of gaseous activity in the plant. The release rate  $Q_i$ , corresponds to offgas concentration expected with the plant design limit for fuel failure. The alarm setpoint may be recalculated if a significant release is encountered. In that case the actual distribution of noble gases will be used in the calculation.

The following calculation will be used for the initial Alarm Setpoint.

$$\text{Alarm Setpoint, uCi/sec} < \frac{0.8R \sum_i (Q_i)}{\sum_i (Q_i V_i)}$$

0.8	=	Safety Factor, unitless
R	=	Allocation Factor. Normally, 250 mrem/yr; the value must be 500 mrem/yr or less depending upon the dose rate from other release points within the site such that the total dose rate corresponds to < 500 mrem/yr
$Q_i$	=	The release rate of nuclide i, uCi/sec
$V_i$	=	The constant for each identified noble gas nuclide accounting for the whole body dose from the elevated finite plume listed on Table 3-2, mrem/yr per uCi/sec
$\sum_i (Q_i)$	=	The total release rate of noble gas nuclides in the stack effluent, uCi/sec
$\sum_i (Q_i V_i)$	=	The total of the product of each isotope release rate times its respective whole body plume constant, mrem/yr, uCi/sec



The alert alarm is normally set at less than 10% of the high alarm.

#### 2.1.2.2 Vent Noble Gas Detector Alarm Setpoint Equation:

The vent contains the Reactor Building ventilation above and below the refuel floor and the Radwaste Building ventilation effluents. The Reactor Building Ventilation will isolate when radiation monitors detect high levels of radiation (these are separate monitors, not otherwise discussed in the ODCM). Nominal flow rate for the vent is 2.37E5 CFM.

This detector is made of germanium. It is sensitive to only gamma radiation. However, because it is a computer based multichannel analysis system it is able to accurately quantify the activity released in terms of uCi of specific nuclides. Only pure alpha and beta emitters are not detectable, of which there are no common noble gases. A distribution of Noble Gases corresponding to that expected with the design limit for fuel failure offgas is chosen for the nominal alarm setpoint calculation. Offgas is chosen because it represents the most significant contaminant of gaseous activity in the plant. The alarm setpoint may be recalculated if a significant release is encountered. In that case the actual distribution of noble gases will be used in the calculation.

$$\text{Alarm Setpoint, uCi/sec} < \frac{0.8R \sum_i (Q_i)}{(X/Q)_v \sum_i (Q_i K_i)}$$

Where:

0.8	=	Safety Factor, unitless
R	=	Allocation Factor. Normally, 250 mrem/yr; the value must be 500 mrem/yr or less depending upon the dose rate from other release points within the site such that the total rate corresponds to < 500 mrem/yr
$Q_i$	=	The release rate of nuclide i, uCi/sec
$(X/Q)_v$	=	The highest annual average atmospheric dispersion coefficient at the site boundary as listed in the Final Environmental Statement, NUREG 1085, Table D-2, $2.0E-6 \text{ sec/m}^3$
$K_i$	=	The constant for each identified noble gas nuclide accounting for the whole body dose from the semi-infinite cloud, listed on Table 3-3, mrem/yr per uCi/m <sup>3</sup>
$\sum_i (Q_i)$	=	The total release rate of noble gas nuclides in the vent effluent, uCi/sec
$\sum_i (Q_i K_i)$	=	The total of the product of the each isotope release rate times its respective whole body immersion constant, mrem/yr per sec/m <sup>3</sup>



The alert alarm is normally set at less than 10% of the high alarm.

### 2.1.2.3 Offgas Pretreatment Noble Gas Detector Alarm Setpoint Equation:

The Offgas system has a radiation detector downstream of the recombiners and before the charcoal decay beds. The offgas, after decay, is exhausted to the main stack. The system will automatically isolate if its pretreatment radiation monitor detects levels of radiation above the high alarm setpoint.

The Radiation Detector contains a plastic scintillator disc. It is a beta scintillation detector. Detector response  $\sum_i (C_i/CF_i)$  has been evaluated from isotopic analysis of offgas analyzed on a multichannel analyzer, traceable to NIST. A distribution of offgas corresponding to that expected with the design limit for fuel failure was used to establish the initial setpoint. However, the alarm setpoint may be recalculated using an updated nuclide distribution based on actual plant process conditions. The monitor nominal response values will be confirmed during periodic calibration using a Transfer Standard source traceable to the primary calibration performed by the vendor.

Particulates and Iodines are not included in this calculation because this is a noble gas monitor.

To provide an alarm in the event of failure of the offgas system flow instrumentation, the low flow alarm setpoint will be set at or above 10 scfm, (well below normal system flow) and the high flow alarm setpoint will be set at or below 110 scfm, which is well above expected steady-state flow rates with a tight condenser.

To provide an alarm for changing conditions, the alert alarm will normally be set at 1.5 times nominal full power background to ensure that the Specific Activity Action required by Technical Specification 3.4.5, are implemented in a timely fashion.

$$\text{Alarm Setpoint, cpm} < 0.8 \frac{(3.50\text{E}+05) (2.12 \text{ E}-03) \sum_i (C_i/CF_i)}{F \sum_i (C_i)} + \text{Background}$$

Where:

Alarm Setpoint	=	The alarm setpoint for the offgas pretreatment Noble Gas Detector, cpm
0.8	=	Safety Factor, unitless
350,000	=	The Technical Specification Limit for Offgas Pretreatment, uCi/sec
2.12E-03	=	Unit conversion Factor, 60 sec/min / 28317 cc/CF
$C_i$	=	The concentration of nuclide, i, in the Offgas, uCi/cc
$CF_i$	=	The Detector response to nuclide i, uCi/cc/cpm; See Table 3-1 for a list of nominal values



F	=	The Offgas System Flow rate, CFM
Background	=	The detector response to non-fission gases and general area does rates, cpm
$\sum_i (C_i / CF_i)$	=	The summation of the nuclide concentration divided by the corresponding detector response, net cpm
$\sum_i (C_i)$	=	The summation of the concentration of nuclides in offgas, uCi/cc

## 2.2 Gaseous Effluents Dose Rate Calculation

Dose rates will be calculated monthly at a minimum to demonstrate that the release of noble gases, tritium, iodines, and particulates with half lives greater than 8 days are within the dose rate limits specified in 10CFR20. These limits are as follows:

The dose rate from radioactive materials released in gaseous effluents from the site to areas at or beyond the SITE BOUNDARY (see Figure 5.1.3-1) shall be limited per 10CFR20 to the following:

- a. For noble gases: Less than or equal to 500 mrem/yr to the whole body and less than or equal to 3000 mrem/yr to the skin, and
- b. For iodine-131, iodine-133, for tritium, and for all radionuclides in particulate form with half-lives greater than 8 days: Less than or equal to 1500 mrem/yr to any organ:

### 2.2.1 X/Q and $W_v$ - Dispersion Parameters for Dose Rate, Table 3-23

The dispersion parameters for the whole body and skin dose rate calculation correspond to the highest annual average dispersion parameters at or beyond the unrestricted area boundary. This is at the east site boundary. These values were obtained from the Nine Mile Point Unit 2 Final Environmental Statement, NUREG 1085 Table D-2 for the vent and stack. These were calculated using the methodology of Regulatory Guide 1.111, Rev. 1. The stack was modeled as an elevated release point because its height is more than 2.5 times any adjacent building height. The vent was modeled as a ground level release because even though it is higher than any adjacent building it is not more than 2.5 times the height.

The NRC Final Environmental Statement values for the site boundary X/Q and D/Q terms were selected for use in calculating Effluent Monitor Alarm Points and compliance with Site Boundary Dose Rate specifications because they are conservative when compared with the corresponding NMPC Environmental Report values. In addition, the stack "intermittent release" X/Q was selected in lieu of the "continuous" value, since it is slightly larger, and also would allow not making a distinction between long term and short term releases.

The dispersion parameters for the organ dose calculations were obtained from the Environmental Report, Figures 7B-4 (stack) and 7B-8 (vent) by locating values corresponding to currently existing (1985) pathways. It should be noted that the most conservative pathways do not all exist at the same location. It is conservative to assume that a single individual would actually be at each of the receptor locations.



## 2.2.2 Whole Body Dose Rate Due to Noble Gases

The ground level gamma radiation dose from a noble gas stack release (elevated), referred to as plume shine, is calculated using the dose factors from Appendix B of this document. The ground level gamma radiation dose from a noble gas vent release accounts for the exposure from immersion in the semi-infinite cloud. The dispersion of the cloud from the point of release to the receptor at the east site boundary is factored into the plume shine dose factors for stack releases and through the use of  $X/Q$  in the equation for the immersion ground level dose rates for vent releases. The release rate is averaged over the period of concern. The factors are discussed in Appendix B.

Whole body dose rate  $(DR)_\gamma$  due to noble gases:

$$(DR)_\gamma = 3.17E-08 \sum_i [V_i Q_{is} + K_i (X/Q)_v Q_{iv}]$$

Where:

- $DR_\gamma$  = Whole body dose rate (mrem/sec)
- $V_i$  = The constant accounting for the gamma whole body dose rate from the finite plume from the elevated stack releases for each identified noble gas nuclide,  $i$ . Listed on Table 3-2, mrem/yr per uCi/sec
- $K_i$  = The constant accounting for the gamma whole body dose rate from immersion in the semi-infinite cloud for each identified noble gas nuclide,  $i$ . Listed in Table 3-3, mrem/yr per uCi/m<sup>3</sup> (From Reg. Guide 1.109)
- $X/Q_s$   
 $X/Q_v$  = The relative plume concentration at or beyond the land sector site boundary. Average meteorological data is used. Elevated  $X/Q$  values are used for the stack releases ( $s$ =stack); ground  $X/Q$  values are used for the vent releases ( $v$ =vent). Listed on Table 3-23
- $Q_{is}, Q_{iv}$  = The release rate of each noble gas nuclide  $i$ , from the stack ( $s$ ) or vent ( $v$ ). Averaged over the time period of concern. (uCi/sec)
- $3.17E-08$  = Conversion Factor; the inverse of the number of seconds in one year. (yr/sec)

## 2.2.3 Skin Dose Rate Due to Noble Gases

There are two types of radiation from noble gas releases that contribute to the skin dose rate: beta and gamma.

For stack releases this calculation takes into account the dose from beta radiation in a semi infinite cloud by using an immersion dose factor. Additionally, the dispersion of the released activity from the stack to the receptor is taken into account by use of the factor  $(X/Q)$ . The gamma radiation dose from the elevated stack release is taken into account by the dose factors in Appendix B.

For vent releases the calculations also take into account the dose from the beta ( $\beta$ ) and gamma ( $\gamma$ ) radiation of the semi infinite cloud by using an immersion dose factor. Dispersion is taken into account by use of the factor  $(X/Q)$ .



The release rate is averaged over the period of concern.

Skin dose rate  $(DR)_{\gamma+\beta}$  due to noble gases:

$$(DR)_{\gamma+\beta} = 3.17E-8 \sum_i [ (L_i (X/Q)_s + 1.11 (B_i) Q_{is} + (L_i + 1.11 M_i) (X/Q)_v Q_{iv} ) ]$$

Where:

$(DR)_{\gamma+\beta}$	=	Skin dose rate (mrem/sec)
$L_i$	=	The constant to account for the gamma and beta skin dose rates for each noble gas nuclide, i, from immersion in the semi-infinite cloud, mrem/yr per uCi/m <sup>3</sup> , listed on Table 3-3 (from R.G. 1.109)
$M_i$	=	The constant to account for the air gamma dose rate for each noble gas nuclide, i, from immersion in the semi-infinite cloud, mrad/yr per uCi/m <sup>3</sup> , listed on Table 3-3 (from R.G. 1.109)
1.11	=	Unit conversion constant, mrem/mrad
.7	=	Structural shielding factor, unitless
$B_i$	=	The constant accounting for the air gamma dose rate from exposure to the overhead plume of elevated releases of each identified noble gas nuclide, i. Listed on Table 3-2, mrad/yr per uCi/sec.
$(X/Q)_s$ $(X/Q)_v$	=	The relative plume concentration at or beyond the land sector site boundary. Average meteorological data is used. Elevated X/Q values are used for the stack releases (s=stack); ground X/Q values are used for the vent releases (v=vent).
3.17E-8	=	Conversion Factor; the inverse of the number of seconds in a year; (yr/sec)
$Q_{iv}, Q_{is}$	=	The release rate of each noble gas nuclide i, from the stack(s) or vent (v) averaged over the time period of concern, uCi/sec.

#### 2.2.4 Organ Dose Rate Due to I-131, I-133, Tritium, and Particulates with Half-lives greater than 8 days.

The organ dose rate is calculated using the dose factors ( $R_i$ ) from Appendix C. The factor  $R_i$  takes into account the dose rate received from the ground plane, inhalation and ingestion pathways.  $W_s$  and  $W_v$  take into account the atmospheric dispersion from the release point to the location of the most conservative receptor for each of the respective pathways. The release rate is averaged over the period of concern.

Organ dose rates  $(DR)_{at}$  due to iodine-131, iodine-133, tritium and all radionuclides in particulate form with half-lives greater than 8 days:

$$(DR)_{at} = 3.17E-8 \sum_j [ \sum_i R_{ij} [ W_s Q_{is} + W_v Q_{iv} ] ]$$

Where:

$(DR)_{at}$	=	Organ dose rate (mrem/sec)
-------------	---	----------------------------



- $R_{ijat}$  = The factor that takes into account the dose from nuclide  $i$  through pathway  $j$  to an age group  $a$ , and individual organ  $t$ . Units for inhalation pathway, mrem/yr per uCi/m<sup>3</sup>. Units for ground and ingestion pathways, m<sup>2</sup>-mrem/yr per uCi/sec. See Tables 3-4 through 3-22).
- $W_s, W_v$  = Dispersion parameter either  $X/Q$  (sec/m<sup>3</sup>) or  $D/Q$  (1/m<sup>2</sup>) depending on pathway and receptor location. Average meteorological data is used (Table 3-23). Elevated  $W_s$  values are used for stack releases ( $s$ =stack); ground  $W_v$  values are used for vent releases ( $v$ =vent).
- $Q_{is}, Q_{iv}$  = The release rates for nuclide  $i$ , from the stack ( $s$ ) and vent ( $v$ ) respectively, uCi/sec.

When the release rate exceeds 0.75 uCi/sec from the stack or vent, the dose rate assessment shall, also, include JAF and NMP1 dose contributions. The use of the 0.75 uCi/sec release rate threshold is conservative because it is based on the dose conversion factor ( $R_i$ ) for the Sr-90 child bone which is significantly higher than the dose factors for the other isotopes present in the stack or vent release.

### 2.3 Gaseous Effluent Dose Calculation Methodology

Doses will be calculated monthly at a minimum to demonstrate that doses resulting from the release of noble gases, tritium, iodines, and particulates with half lives greater than 8 days are within the limits specified in 10CFR.50. These limits are as follows:

The air dose from noble gases released in gaseous effluents, from each unit, to areas at or beyond the SITE BOUNDARY (see Figure 5.1.3-1) shall be limited to the following.

- a. During any calendar quarter: Less than or equal to 5 mrad for gamma radiation and less than or equal to 10 mrad for beta radiation, and
- b. During any calendar year: Less than or equal to 10 mrad for gamma radiation and less than or equal to 20 mrad for beta radiation.

The dose to a MEMBER OF THE PUBLIC from iodine-131, iodine-133, tritium, and all radioactive material in particulate form with half-lives greater than 8 days in gaseous effluents released, from each unit, to areas at or beyond the SITE BOUNDARY (see Figure 5.1.3-1) shall be limited to the following:

- a. During any calendar quarter: Less than or equal to 7.5 mrem to any organ and,
- b. During any calendar year: Less than or equal to 15 mrem to any organ.

The VENTILATION EXHAUST TREATMENT SYSTEM shall be OPERABLE and appropriate portions of this system shall be used to reduce releases of radioactivity when the projected doses in 31 days from iodine and particulate releases, from each unit, to areas at or beyond the SITE BOUNDARY (see Figure 5.1.3-1) would exceed 0.3 mrem to any organ of a MEMBER OF THE PUBLIC.



### 2.3.1 $W_v$ and $W_s$ - Dispersion Parameters for Dose, Table 3-23

The dispersion parameters for dose calculations were obtained chiefly from the Nine Mile Point Unit 2 Environmental Report Appendix 7B. These were calculated using the methodology of Regulatory Guide 1.111 and NUREG 0324. The stack was modeled as an elevated release point because height is more than 2.5 times the height of any adjacent building. The vent was modeled as a combined elevated/ground level release because the vent's height is not more than 2.5 times the height of any adjacent building. Average meteorology over the appropriate time period was used. Dispersion parameters not available from the ER were obtained from C.T. Main Data report dated November, 1985, or the FES.

### 2.3.2 Gamma Air Dose Due to Noble Gases

Gamma air dose from the stack or vent noble gas releases is calculated monthly. The gamma air dose equation is similar to the gamma dose rate equation except the receptor is air instead of the whole body or skin of whole body. Therefore, the stack noble gas releases use the finite plume air dose factors, and the vent noble gas releases use semi-infinite cloud immersion dose factors. The factor  $X/Q$  takes into account the dispersion of vent releases to the most conservative location. The release activity is totaled over the period of concern. The finite plume factor is discussed in Appendix B.

Gamma air dose due to noble gases:

$$D_\gamma = 3.17E-8 \sum_i [M_i (X/Q)_v Q_{iv} + B_i Q_{is}] \times t$$

$$D_\gamma = \text{The gamma air dose for the period of concern, mrad}$$

$$t = \text{The duration of the dose period of concern, sec}$$

Where all other parameters have been previously defined.

### 2.3.3 Beta Air Dose Due to Noble Gases

The beta air dose from the stack or vent noble gas releases is calculated using the semi-infinite cloud immersion dose factor in beta radiation. The factor  $X/Q$  takes into account the dispersion of releases to the most conservative location.

Beta air dose due to noble gases:

$$D_\beta = 3.17E-8 \sum_i N_i [(X/Q)_v Q_{iv} + (X/Q)_s Q_{is}] \times t$$

$$D_\beta = \text{Beta air dose (mrad) for the period of concern}$$

$$N_i = \text{The constant accounting for the beta air dose from immersion in the semi-infinite cloud for each identified noble gas nuclide, i. Listed on Table 3-3, mrad/yr per uCi/m}^3. \text{ (From Reg. Guide 1.109).}$$

$$t = \text{The duration of the dose period of concern, sec}$$

Where all other parameters have been previously defined.

### 2.3.4 Organ Dose Due to I-131, I-133, Tritium and Particulates with half-lives greater than 8 days.



The organ dose is based on the same equation as the dose rate equation except the dose is compared to the 10CFR50 dose limits. The factor  $R_i$  takes into account the dose received from the ground plane, inhalation, food (cow milk, cow meat and vegetation) pathways.  $W_s$  and  $W_v$  take into account the atmospheric dispersion from the release point to the location of the most conservative receptor for each of the respective pathways. The release is totaled over the period of concern. The  $R_i$  factors are discussed in Appendix C.

Organ dose  $D_{at}$  due to iodine-131, iodine-133, tritium and radionuclides in particulate form with half-lives greater than 8 days.

$$D_{at} = 3.17E-8 \sum_j [ \sum_i R_{ij} a_t [W_s Q_{is} + W_v Q_{iv}] ] \times t$$

Where:

$D_{at}$  = Dose to the critical organ t, for age group a, mrem

t = The duration of the dose period of concern, sec

Where all other parameters have been previously defined in Section 2.2.4.

## 2.4 I-133 and I-135 Estimation

Stack and vent effluent iodine cartridges are analyzed to a sensitivity of at least  $1E-12$  uCi/cc. If detected in excess of the LLD, the I-131 and I-133 analysis results will be reported directly from each cartridge analyzed. Periodically, (usually quarterly but on a monthly frequency if effluent iodines are routinely detected) a short-duration (12 to 24 hour) effluent sample is collected and analyzed to establish an I-135/I-131 ratio and an I-133/I-131 ratio, if each activity exceeds LLD. The short-duration ratio is used to confirm the routinely measured I-133 values. The short-duration I-135/I-131 ratio (if determined) is used with the I-131 release to estimate the I-135 release. The short-duration I-133/I-131 ratio may be used with the I-131 release to estimate the I-133 release if the directly measured I-133 release appears non-conservative.

## 2.5 Isokinetic Sampling

Sampling systems for the stack and vent effluent releases are designed to maintain isokinetic sample flow at normal ventilation flow rates. During periods of reduced ventilation flow, sample flow may be maintained at a minimum flow rate (above the calculated isokinetic rate) in order to minimize sample line losses due to particulate deposition at low velocity.

## 2.6 Use of Concurrent Meteorological Data vs. Historical Data

It is the intent of NMPC to use dispersion parameters based on historical meteorological data to set alarm points and to determine or predict dose and dose rates in the environment due to gaseous effluents. If effluent levels approach limiting values, meteorological conditions concurrent with the time of release may be used to determine gaseous pathway doses.



## 2.7 Gaseous Radwaste Treatment System Operation

CONTROL 3.11.2.4 requires the Gaseous Radwaste Treatment System to be in operation whenever the main condenser air ejector system is in operation. The system may be operated for short periods with the charcoal beds bypassed to facilitate transients. The components of the system which normally should operate to treat offgas are the Preheater, Recombiner, Condenser, Dryer, Charcoal Adsorbers, HEPA Filter, and Vacuum Pump. (See Appendix D, Offgas System).

## 2.8 Ventilation Exhaust Treatment System Operation

CONTROL 3.11.2.5 requires the Ventilation Exhaust Treatment System to be OPERABLE when projected doses in 31 days due to iodine and particulate releases would exceed 0.3 mrem to any organ of a member of the public. The appropriate components, which affect iodine or particulate release, to be OPERABLE are:

- 1) HEPA Filter - Radwaste Decon Area
- 2) HEPA Filter - Radwaste Equipment Area
- 3) HEPA Filter - Radwaste General Area

Whenever one of these filters is not OPERABLE, iodine and particulate dose projections will be made for 31-day intervals starting with filter inoperability, and continuing as long as the filter remains inoperable, in accordance with Surveillance 4.11.2.5.1. Predicted release rates will be used, along with the methodology of Section 2.3.4. (See Appendix D, Gaseous Radiation Monitoring.)

## 3.0 URANIUM FUEL CYCLE

The "Uranium Fuel Cycle" is defined in 40 CFR Part 190.02 (b) as follows:

"Uranium fuel cycle means the operations of milling of uranium ore chemical conversion of uranium, isotopic enrichment of uranium, fabrication of uranium fuel, generation of electricity by a light-water-cooled nuclear power plant using uranium fuel, and reprocessing of spent uranium fuel, to the extent that these directly support the production of electrical power for public use utilizing nuclear energy, but excludes mining operations, operations at waste disposal sites, transportation of any radioactive material in support of these operations, and the reuse of recovered non-uranium special nuclear and by-product materials from the cycle."

Section 3/4.11.4 of the CONTROLS requires that when the calculated doses associated with the effluent releases exceed twice the applicable quarter or annual limits, the licensee shall evaluate the calendar year doses and, if required, submit a Special Report to the NRC and limit subsequent releases such that the dose commitment to a real individual from all uranium fuel cycle sources is limited to 25 mrem to the total body or any organ (except the thyroid, which is limited to 75 mrem). This report is to demonstrate that radiation exposures to all real individuals from all uranium fuel cycle sources (including all liquid and gaseous effluent pathways and direct radiation) are less than the limits in 40 CFR Part 190. If releases that result in doses exceeding the 40 CFR 190 limits have occurred, then a variance from the NRC to permit such releases will be requested and if possible, action will be taken to reduce subsequent releases.



The report to the NRC shall contain:

- 1) Identification of all uranium fuel cycle facilities or operations within 5 miles of the nuclear power reactor units at the site, that contribute to the annual dose of the maximum exposed member of the public.
- 2) Identification of the maximum exposed member of the public and a determination of the total annual dose to this person from all existing pathways and sources of radioactive effluents and direct radiation.

The total body and organ doses resulting from radioactive material in liquid effluents from Nine Mile Point Unit 2 will be summed with the doses resulting from the releases of noble gases, radioiodines, and particulates. The direct dose components will also be determined by either calculation or actual measurement. Actual measurements will utilize environmental TLD dosimetry. Calculated measurements will utilize engineering calculations to determine a projected direct dose component. In the event calculations are used, the methodology will be detailed as required in Section 6.9.1.8 of the CONTROLS. The doses from Nine Mile Point Unit 2 will be added to the doses to the maximum exposed individual that are contributed from other uranium fuel cycle operations within 5 miles of the site.

For the purpose of calculating doses, the results of the Environmental Monitoring Program may be included to provide more refined estimates of doses to a real maximum exposed individual. Estimated doses, as calculated from station effluents, may be replaced by doses calculated from actual environmental sample results.

### 3.1 Evaluation of Doses From Liquid Effluents

For the evaluation of doses to real members of the public from liquid effluents, the fish consumption and shoreline sediment ground dose will be considered. Since the doses from other aquatic pathways are insignificant, fish consumption and shoreline sediment are the only two pathways that will be considered. The dose associated with fish consumption may be calculated using effluent data and Regulatory Guide 1.109 methodology or by calculating a dose to man based on actual fish sample analysis data. Because of the nature of the receptor location and the extensive fishing in the area, the critical individual may be a teenager or an adult. The dose associated with shoreline sediment is based on the assumption that the shoreline would be utilized as a recreational area. This dose may be derived from liquid effluent data and Regulatory Guide 1.109 methodology or from actual shoreline sediment sample analysis data.

Equations used to evaluate fish and shoreline sediment samples are based on Regulatory Guide 1.109 methodology. Because of the sample medium type and the half-lives of the radionuclides historically observed, the decay corrected portions of the equations are deleted. This does not reduce the conservatism of the calculated doses but increases the simplicity from an evaluation point of view. Table 3-24 presents the parameters used for calculating doses from liquid effluents.



The dose from fish sample media is calculated as:

$$R_{apj} = \sum_i [C_{if} (U) (D_{aipj}) f] (1E+3)$$

Where:

- $R_{apj}$  = The total annual dose to organ j, of an individual of age group a, from nuclide i, via fish pathway p, in mrem per year; ex. if calculating to the adult whole body, then  $R_{apj} = R_{wb}$  and  $D_{aipj} = D_{iWB}$
- $C_{if}$  = The concentration of radionuclide i in fish samples in pCi/gram
- $U$  = The consumption rate of fish
- $1E+3$  = Grams per kilogram
- $(D_{aipj})$  = The ingestion dose factor for age group a, nuclide i, fish pathway p, and organ j, (Reg. Guide 1.109, Table E-11) (mrem/pCi). ex. when calculating to the adult whole body  $D_{aipj} = D_{iWB}$
- $f$  = The fractional portion of the year over which the dose is applicable

The dose from shoreline sediment sample media is calculated as:

$$R_{apj} = \sum_i [C_{is} (U) (4E+4) (0.3) (D_{aipj}) f]$$

Where:

- $R_{apj}$  = The total annual dose to organ j, of an individual of age group a, from nuclide i, via the sediment pathway p, in mrem per year; ex. if calculating to the adult whole body, then  $R_{apj} = R_{WB}$  and  $D_{aipj} = D_{iWB}$
- $C_{is}$  = The concentration of radionuclide i in shoreline sediment in pCi/gram
- $U$  = The usage factor, (hr/yr) (Reg. Guide 1.109)
- $4E+4$  = The product of the assumed density of shoreline sediment (40 kilogram per square meter to a depth of 2.5 cm) times the number of grams per kilogram
- $0.3$  = The shore width factor for a lake
- $D_{aipj}$  = The dose factor for age group a, nuclide i, sediment pathway s, and organ j. (Reg. Guide 1.109, Table E-6) (mrem/hr per pCi/m<sup>2</sup>); ex. when calculating to the adult whole body  $D_{aipj} = D_{iWB}$
- $f$  = The fractional portion of the year over which the dose is applicable

NOTE: Because of the nature of the receptor location and the extensive fishing in the area, the critical individual may be a teenager or an adult.



### 3.2 Evaluation of Doses From Gaseous Effluents

For the evaluation of doses to real members of the public from gaseous effluents, the pathways contained in section 2 of the calculational methodologies section in the ODCM will be considered and include ground deposition, inhalation, cows milk, goats milk, meat, and food products (vegetation). However, any updated field data may be utilized that concerns locations of real individuals, real time meteorological data, location of critical receptors, etc. Data from the most recent census and sample location surveys should be utilized. Doses may also be calculated from actual environmental sample media, as available. Environmental sample media data such as TLD, air sample, milk sample and vegetable (food crop) sample data may be utilized in lieu of effluent calculational data.

Doses to members of the public from the pathways considered in the ODCM section 2 as a result of gaseous effluents will be calculated using the methodology of Regulatory Guide 1.109 or the methodology of the ODCM, as applicable. Doses calculated from environmental sample media will be based on methodologies found in Regulatory Guide 1.109.

### 3.3 Evaluation of Doses From Direct Radiation

The dose contribution as a result of direct radiation shall be considered when evaluating whether the dose limitations of 40 CFR 190 have been exceeded. Direct radiation doses as a result of the reactor, turbine and radwaste buildings and outside radioactive storage tanks (as applicable) may be evaluated by engineering calculations or by evaluating environmental TLD results at critical receptor locations, site boundary or other special interest locations. For the evaluation of direct radiation doses utilizing environmental TLDs, the critical receptor in question, such as the critical residence, etc., will be compared to the control locations.

The comparison involves the difference in environmental TLD results between the receptor location and the average control location result.

### 3.4 Doses to Members of the Public Within the Site Boundary

The Semiannual Radioactive Effluent Release Report shall include an assessment of the radiation doses from radioactive liquid and gaseous effluents to members of the public due to their activities inside the site boundary as defined by Figure 5.1.3-1. A member of the public, would be represented by an individual who visits the sites' Energy Center for the purpose of observing the educational displays or for picnicking and associated activities.

Fishing is a major recreational activity in the area and on the Site as a result of the salmon and trout populations in Lake Ontario. Fishermen have been observed fishing at the shoreline near the Energy Center from April through December in all weather conditions. Thus, fishing is the major activity performed by members of the public within the site boundary. Based on the nature of the fishermen and undocumented observations, it is conservatively assumed that the maximum exposed individual spends an average of 8 hours per week fishing from the shoreline at a location between the Energy Center and the Unit 1 facility. This estimate is considered conservative but not necessarily excessive and accounts for occasions where individuals may fish more on weekends or on a few days in March of the year.



The pathways considered for the evaluation include the inhalation pathway with the resultant lung dose, the ground dose pathway with the resultant whole body and skin dose and the direct radiation dose pathway with the associated total body dose. The direct radiation dose pathway, in actuality, includes several pathways. These include: the direct radiation gamma dose to an individual from an overhead plume, a gamma submersion plume dose, possible direct radiation dose from the facility and a ground plane dose (deposition). Because the location is in close proximity to the site, any beta plume submersion dose is felt to be insignificant.

Other pathways, such as the ingestion pathway, are not applicable. In addition, pathways associated with water related recreational activities, other than fishing, are not applicable here. These include swimming, boating and wading which are prohibited at the facility.

The inhalation pathway is evaluated by identifying the applicable radionuclides (radioiodine, tritium and particulates) in the effluent for the appropriate time period. The radionuclide concentrations are then multiplied by the appropriate X/Q value, inhalation dose factor, air intake rate, and the fractional portion of the year in question.

Thus, the inhalation pathway is evaluated using the following equation adapted from Regulatory Guide 1.109. Table 3-24 presents the reference for the parameters used in the following equation.

**NOTE:** The following equation is adapted from equations C-3 and C-4 of Regulatory Guide 1.109. Since many of the factors are in units of pCi/m<sup>3</sup>, m<sup>3</sup>/sec., etc., and since the radionuclide decay expressions have been deleted because of the short distance to the receptor location, the equation presented here is not identical to the Regulatory Guide equations.

$$D_{ja} = \sum_i [(C_i) F (X/Q) (DFA)_{ija} (BR)_a t]$$

Where:

$D_{ja}$  = The maximum dose from all nuclides to the organ j and age group (a) in mrem/yr; ex. if calculating to the adult lung, then  $D_{ja} = D_L$  and  $DFA_{ija} = DFA_{iL}$

$C_i$  = The average concentration in the stack or vent release of nuclide i for the period in pCi/m<sup>3</sup>.

$F$  = Unit 2 average stack or vent flowrate in m<sup>3</sup>/sec.

$X/Q$  = The plume dispersion parameter for a location approximately 0.50 miles west of NMP-2 (The plume dispersion parameters are 9.6E-07 (stack) and 2.8E-06 (vent) and were obtained from the C.T. Main five year average annual X/Q tables. The vent X/Q (ground level) is ten times the listed 0.50 mile X/Q because the vent is approximately 0.3 miles from the receptor location. The stack (elevated) X/Q is conservative when based on 0.50 miles because of the close proximity of the stack and the receptor location.

$(DFA)_{ija}$  = the dose factor for nuclide i, organ j, and age group a in mrem per pCi (Reg. Guide 1.109, Table E-7); ex. if calculating to the adult lung the  $DFA_{ija} = DFA_{iL}$



$(BR)_a$  = annual air intake for individuals in age group  $a$  in  $M^3$  per year (obtained from Table E-5 of Regulatory Guide 1.109).

$t$  = fractional portion of the year for which radionuclide  $i$  was detected and for which a dose is to be calculated (in years).

The ground dose pathway (deposition) will be evaluated by obtaining at least one soil or shoreline sediment sample in the area where fishing occurs. The dose will then be calculated using the sample results, the time period in question, and the methodology based on Regulatory Guide 1.109 as presented in Section 3.1. The resultant dose may be adjusted for a background dose by subtracting the applicable off-site control soil or shoreline sediment sample radionuclide activities. In the event it is noted that fishing is not performed from the shoreline but is instead performed in the water (i.e., the use of waders), then the ground dose pathway (deposition) will not be evaluated.

The direct radiation gamma dose pathway includes any gamma doses from an overhead plume, submersion in the plume, possible radiation from the facility and ground plane dose (deposition). This general pathway will be evaluated by average environmental TLD readings. At least two environmental TLDs will be used at one location in the approximate area where fishing occurs. The TLDs will be placed in the field on approximately the beginning of each calendar quarter and removed approximately at the end of each calendar quarter (quarter 2, 3, and 4).

The average TLD readings will be adjusted by the average control TLD readings. This is accomplished by subtracting the average quarterly control TLD value from the average fishing location TLD value. The applicable quarterly control TLD values will be used after adjusting for the appropriate time period (as applicable). In the event of loss or theft of the TLDs, results from a TLD or TLDs in a nearby area may be utilized.



## 4.0 ENVIRONMENTAL MONITORING PROGRAM

### 4.1 Sampling Stations

The current sampling locations are specified in Table 5-1 and Figures 5.1-1, 5.1-2. The meteorological tower location is shown on Figure 5.1-1. The location is shown as TLD location #17. The Environmental Monitoring Program is a joint effort between the Niagara Mohawk Power Corporation and the New York Power Authority, the owners and operators of the Nine Mile Point Units 1 and 2 and the James A. FitzPatrick Nuclear Power Plants, respectively. Sampling locations are chosen on the basis of historical average dispersion or deposition parameters from both units. The environmental sampling location coordinates shown on Table 5-1 are based on the NMP-2 reactor centerline.

The average dispersion and deposition parameters for the three units have been calculated for a 5 year period, 1978 through 1982. The calculated dispersion or deposition parameters will be compared to the results of the annual land use census. If it is determined that a milk sampling location exists at a location that yields a significantly higher (e.g. 50%) calculated D/Q rate, the new milk sampling location will be added to the monitoring program within 30 days. If a new location is added, the old location that yields the lowest calculated D/Q may be dropped from the program after October 31 of that year.

### 4.2 Interlaboratory Comparison Program

Analyses shall be performed on samples containing known quantities of radioactive materials that are supplied as part of a Commission approved or sponsored Interlaboratory Comparison Program, such as the EPA Crosscheck Program. Participation shall be only for those media, e.g., air, milk, water, etc., that are included in the Nine Mile Point Environmental Monitoring Program and for which cross check samples are available. An attempt will be made to obtain a QC sample to program sample ratio of 5% or better. The Quality Control sample results shall be reported in the Annual Radiological Environmental Operating Report so that the Commission staff may evaluate the results.

Specific sample media for which EPA Cross Check Program samples are available include the following:

- gross beta in air particulate filters
- gamma emitters in air particulate filters
- gamma emitters in milk
- gamma emitters in water
- tritium in water
- I-131 in water

### 4.3 Capabilities for Thermoluminescent Dosimeters Used for Environmental Measurements

Required detection capabilities for thermoluminescent dosimeters used for environmental measurements required by the Technical Specifications are based on ANSI Standard N545, section 4.3. TLDs are defined as phosphors packaged for field use. In regard to the detection capabilities for thermoluminescent dosimeters, only one determination is required to evaluate the above capabilities per type of TLD. Furthermore, the above capabilities may be determined by the vendor who supplies the TLDs. Required detection capabilities are as follows.



- 4.3.1 Uniformity shall be determined by giving TLDs from the same batch an exposure equal to that resulting from an exposure rate of 10 uR/hr during the field cycle. The responses obtained shall have a relative standard deviation of less than 7.5%. A total of at least 5 TLDs shall be evaluated.
- 4.3.2 Reproducibility shall be determined by giving TLDs repeated exposures equal to that resulting from an exposure rate of 10 uR/hr during the field cycle. The average of the relative standard deviations of the responses shall be less than 3.0%. A total of at least 4 TLDs shall be evaluated.
- 4.3.3 Dependence of exposure interpretation on the length of a field cycle shall be examined by placing TLDs for a period equal to at least a field cycle and a period equal to half the same field cycle in an area where the exposure rate is known to be constant. This test shall be conducted under approximate average winter temperatures and approximate average summer temperatures. For these tests, the ratio of the response obtained in the field cycle to twice that obtained for half the field cycle shall not be less than 0.85. At least 6 TLDs shall be evaluated.
- 4.3.4 Energy dependence shall be evaluated by the response of TLDs to photons for several energies between approximately 30 keV and 3 MeV. The response shall not differ from that obtained with the calibration source by more than 25% for photons with energies greater than 80 keV and shall not be enhanced by more than a factor of two for photons with energies less than 80 keV. A total of at least 8 TLDs shall be evaluated.
- 4.3.5 The directional dependence of the TLD response shall be determined by comparing the response of the TLD exposed in the routine orientation with respect to the calibration source with the response obtained for different orientations. To accomplish this, the TLD shall be rotated through at least two perpendicular planes. The response averaged over all directions shall not differ from the response obtained in the standard calibration position by more than 10%. A total of at least 4 TLDs shall be evaluated.
- 4.3.6 Light dependence shall be determined by placing TLDs in the field for a period equal to the field cycle under the four conditions found in ANSI N545, section 4.3.6. The results obtained for the unwrapped TLDs shall not differ from those obtained for the TLDs wrapped in aluminum foil by more than 10%. A total of at least 4 TLDs shall be evaluated for each of the four conditions.
- 4.3.7 Moisture dependence shall be determined by placing TLDs (that is, the phosphors packaged for field use) for a period equal to the field cycle in an area where the exposure rate is known to be constant. The TLDs shall be exposed under two conditions: (1) packaged in a thin, sealed plastic bag, and (2) packaged in a thin, sealed plastic bag with sufficient water to yield observable moisture throughout the field cycle. The TLD or phosphor, as appropriate, shall be dried before readout. The response of the TLD exposed in the plastic bag containing water shall not differ from that exposed in the regular plastic bag by more than 10%. A total of at least 4 TLDs shall be evaluated for each condition.
- 4.3.8 Self irradiation shall be determined by placing TLDs for a period equal to the field cycle in an area where the exposure rate is less than 10 uR/hr and the exposure during the field cycle is known. If necessary, corrections shall be applied for the dependence of exposure interpretation on the length of the field cycle (ANSI N545, section 4.3.3). The average exposure inferred from the responses of the TLDs shall not differ from the known exposure by more than an exposure equal to that resulting from an exposure rate of 10 uR/hr during the field cycle. A total of at least 3 TLDs shall be evaluated.



TABLE 2-1

## LIQUID EFFLUENT DETECTORS RESPONSES\*

<u>NUCLIDE</u>	<u>(CPM/<math>\mu</math>Ci/ml X 10<sup>8</sup>)</u>
Sr 89	0.78E-04
Sr 91	1.22
Sr 92	0.817
Y 91	2.47
Y 92	0.205
Zr 95	0.835
Nb 95	0.85
Mo 99	0.232
Tc 99m	0.232
Te 132	1.12
Ba 140	0.499
Ce 144	0.103
Br 84	1.12
I 131	1.01
I 132	2.63
I 133	0.967
I 134	2.32
I 135	1.17
Cs 134	1.97
Cs 136	2.89
Cs 137	0.732
Cs 138	1.45
Mn 54	0.842
Mn 56	1.2
Fe 59	0.863
Co 58	1.14
Co 60	1.65

\* Values from SWEC purchase specification NMP2-P281F.



TABLE 2-2  
A<sub>int</sub> VALUES - LIQUID<sup>1</sup>  
ADULT  
 $\frac{\text{mrem} \cdot \text{ml}}{\text{hr} \cdot \text{uCi}}$

NUCLIDE	T BODY	GI-TRACT	BONE	LIVER	KIDNEY	THYROID	LUNG
H 3	3.67E-1	3.67E-1	--	3.67E-1	3.67E-1	3.67E-1	3.67E-1
Cr 51	1.26	3.13E2	1.18E-2	1.18E-2	2.86E-1	7.56E-1	1.66
Cu 64	1.28	2.33E2	--	2.73	6.89	--	--
Mn 54	8.38E2	1.34E4	3.98	4.38E3	1.31E3	3.98	3.98
Fe 55	1.07E2	2.62E2	6.62E2	4.57E2	--	--	2.55E2
Fe 59	9.28E2	8.06E3	1.03E3	2.42E3	7.53E-1	7.53E-1	6.76E2
Co 58	2.01E2	1.81E3	1.07	9.04E1	1.07	1.07	1.07
Co 60	6.36E2	4.93E3	6.47E1	3.24E2	6.47E1	6.47E1	6.47E1
Zn 65	3.32E4	4.63E4	2.31E4	7.35E4	4.92E4	2.21	2.21
Sr 89	6.38E2	3.57E3	2.22E4	6.18E-5	6.18E-5	6.18E-5	6.18E-5
Sr 90	1.36E5	1.60E4	5.55E5	--	--	--	--
Sr 92	1.44E-2	6.61	3.34E-1	--	--	--	--
Zr 95	7.59E-1	2.83E2	9.77E-1	7.88E-1	8.39E-1	6.99E-1	6.99E-1
Mn 56	3.07E-2	5.52	--	1.73E-1	2.20E-1	--	--
Mo 99	1.60E1	1.95E2	1.97E-3	8.42E1	1.91E2	1.97E-3	1.97E-3
Na 24	1.34E2	1.34E2	1.34E2	1.34E2	1.34E2	1.34E2	1.34E2
I 131	1.16E2	5.36E1	1.42E2	2.03E2	3.48E2	6.65E4	2.77E-2
I 132	4.34E-3	2.33E-3	4.64E-3	1.24E-2	1.98E-2	4.34E-1	--
I 133	1.22E1	3.59E1	2.30E1	3.99E1	6.97E1	5.87E3	--
Ni 65	1.14E-2	6.35E-1	1.93E-1	2.50E-2	--	--	--
Cs 134	5.79E5	1.24E4	2.98E5	7.08E5	2.29E5	2.04E1	7.61E4
Cs 136	8.42E4	1.33E4	2.96E4	1.17E5	6.51E4	3.28E-1	8.92E3
Cs 137	3.42E5	1.01E4	3.82E5	5.22E5	1.77E5	3.10E1	5.89E4
Ba 140	1.37E1	4.30E2	2.09E2	3.04E-1	1.31E-1	4.17E-2	1.92E-1
Ce 141	3.79E-2	8.81E1	6.93E-2	5.83E-2	4.60E-2	3.53E-2	3.53E-2
Nb 95	1.31E2	1.48E6	4.38E2	2.44E2	2.41E2	3.56E-1	3.56E-1
La 140	1.62E-2	3.72E3	1.03E-1	5.36E-2	2.83E-3	2.83E-3	2.83E-3
Ce 144	3.03E-1	6.15E2	2.02	9.66E-1	6.57E-1	2.06E-1	2.06E-1
Tc 99m	2.05E-2	9.54E-01	5.71E-4	1.61E-3	2.45E-2	--	7.90E-4
Np 239	1.8E-3	4.47E2	2.28E-2	2.78E-3	7.40E-3	5.95E-4	5.95E-4
Te 132	1.18E3	5.97E4	1.95E3	1.26E3	1.22E4	1.39E3	2.66E-3
Zr 97	5.08E-4	3.39E2	5.44E-3	1.10E-3	1.66E-3	7.11E-6	7.11E-6
W 187	4.31E1	4.04E4	1.48E2	1.23E2	4.43E-5	4.43E-5	4.43E-5
Ag 110m	1.09E1	3.94E2	1.14E1	1.13E1	1.22E1	1.04E1	1.04E1
Sb-124	4.72E1	3.36E2	1.07E3	4.33E1	4.31E1	4.31E1	5.12E1
Zn 69m	5.40E1	3.60E4	2.46E2	5.90E2	3.57E2	6.90E-2	6.90E-2
Au 199	3.95	7.33E2	1.26E-1	4.67	1.79E1	1.26E-1	1.26E-1

<sup>1</sup> Calculated in accordance with NUREG 0133, Section 4.3.1; and Regulatory Guide 1.109, Regulatory position C, Section 1.



TABLE 2-3  
A<sub>int</sub> VALUES - LIQUID<sup>1</sup>  
TEEN  
 $\frac{\text{mrem} - \text{ml}}{\text{hr} - \text{uCi}}$

NUCLIDE	T BODY	GI-TRACT	BONE	LIVER	KIDNEY	THYROID	LUNG
H 3	2.73E-1	2.73E-1	--	2.73E-1	2.73E-1	2.73E-1	2.73E-1
Cr 51	1.35	2.16E2	6.56E-2	6.56E-2	3.47E-1	7.79E-1	1.90
Cu 64	1.35	2.23E2	--	2.87	7.27	--	--
Mn 54	8.75E2	8.84E3	2.22E1	4.32E3	1.31E3	2.22E1	2.22E1
Fe 55	1.15E2	2.13E2	6.93E2	4.91E2	--	--	3.11E2
Fe 59	9.59E2	5.85E3	1.06E3	2.48E3	4.20	4.20	7.84E2
Co 58	2.10E2	1.23E3	5.98	9.47E1	5.98	5.98	5.98
Co 60	9.44E2	3.73E3	3.61E2	6.20E2	3.61E2	3.61E2	3.61E2
Zn 65	3.40E4	3.08E4	2.10E4	7.28E4	4.66E4	1.24E1	1.24E1
Sr 89	6.92E2	2.88E3	2.42E4	3.45E-4	3.45E-4	3.45E-4	
Sr 90	1.14E5	1.30E4	4.62E5	--	--	--	--
Sr 92	1.54E-2	9.19E1	3.61E-1	--	--	--	--
Zr 95	3.96	2.10E2	4.19	3.99	4.03	3.90	3.90
Mn 56	3.22E-2	1.19E1	--	1.81E-1	2.29E-1	--	--
Mo 99	1.71E1	1.60E2	1.10E-2	8.95E1	2.05E2	1.10E-2	1.10E-2
Na 24	1.38E2	1.38E2	1.38E2	1.38E2	1.38E2	1.38E2	1.38E2
I 131	1.14E2	4.21E1	1.52E2	2.12E2	3.66E2	6.19E4	1.55E-1
I 132	4.56E-3	5.54E-3	4.86E-3	1.27E-2	2.00E-2	4.29E-1	--
I 133	1.28E1	3.17E1	2.47E1	4.19E1	7.35E1	5.85E3	1.02E-4
Ni 65	1.21E-2	1.44	2.08E-1	2.66E-2	--	--	--
Cs 134	3.33E5	9.05E3	3.05E5	7.18E5	2.28E5	1.14E2	8.72E4
Cs 136	7.87E4	9.44E3	2.98E4	1.17E5	6.38E4	1.83	1.01E4
Cs 137	1.90E5	7.91E3	4.09E5	5.44E5	1.85E5	1.73E2	7.21E4
Ba 140	1.44E1	3.40E2	2.21E2	5.03E-1	3.25E-1	2.33E-1	4.15E-1
Ce 141	2.00E-1	6.85E1	2.33E-1	2.21E-1	2.08E-1	1.97E-1	1.97E-1
Nb 95	1.17E2	1.05E6	4.43E2	2.47E2	2.39E2	1.99	1.99
La 140	2.97E-2	3.01E3	1.22E-1	6.82E-2	1.58E-2	1.58E-2	1.58E-2
Ce 144	1.25	4.83E2	3.07	1.94	1.62	1.15	1.15
Tc 99m	2.11E-2	1.07	5.84E-4	1.63E-3	2.43E-2	--	9.04E-4
Np 239	4.63E-3	3.78E2	2.82E-2	5.67E-3	1.07E-2	3.32E-3	3.32E-3
Te 132	1.23E3	4.13E4	2.06E3	1.30E3	1.25E4	1.37E3	1.48E-2
Zr 97	5.68E-4	3.11E2	5.84E-3	1.19E-3	1.78E-3	3.97E-5	3.97E-5
W 187	4.55E1	3.52E4	1.59E2	1.30E2	2.47E-4	2.47E-4	2.47E-4
Ag 110m	5.85E1	3.17E2	5.89E1	5.88E1	5.97E1	5.79E1	5.79E1
Sb-124	2.45E2	4.53E2	2.51E2	2.41E2	2.41E2	2.41E2	2.50E2
Zn 69m	5.76E1	3.43E4	2.65E2	6.24E2	3.79E2	3.85E-1	3.85E-1
Au 199	4.85	5.78E2	7.04E-1	5.60	2.01E1	7.04E-1	7.04E-1

<sup>1</sup>Calculated in accordance with NUREG 0133, Section 4.3.1; and Regulatory Guide 1.109, Regulatory position C, Section 1.



TABLE 2-4  
A<sub>int</sub> VALUES - LIQUID<sup>1</sup>  
CHILD  
 $\frac{\text{mrem} \cdot \text{ml}}{\text{hr} \cdot \mu\text{Ci}}$

NUCLIDE	T BODY	GI-TRACT	BONE	LIVER	KIDNEY	THYROID	LUNG
H 3	3.34E-1	3.34E-1	--	3.34E-1	3.34E-1	3.34E-1	3.34E-1
Cr 51	1.39	7.29E1	1.37E-2	1.37E-2	2.22E-1	7.76E-1	1.41
Cu 64	1.60	1.25E2	--	2.65	6.41	--	--
Mn 54	9.02E2	2.83E3	4.65	3.37E3	9.49E2	4.65	4.65
Fe 55	1.50E2	8.99E1	9.15E2	4.85E2	--	--	2.74E2
Fe 59	1.04E3	2.18E3	1.29E3	2.09E3	8.78E-1	8.78E-1	6.08E2
Co 58	2.21E2	4.20E2	1.25	7.30E1	1.25	1.25	1.25
Co 60	7.03E2	1.25E3	7.55E1	2.88E2	7.55E1	7.55E1	7.55E1
Zn 65	3.56E4	1.01E4	2.15E4	5.73E4	3.61E4	2.58	2.58
Sr 89	9.13E2	1.24E3	3.20E4	--	--	--	--
Sr 90	1.06E5	5.62E3	4.17E5	--	--	--	--
Sr 92	1.85E-2	8.73	4.61E-1	--	--	--	--
Zr 95	8.95E-1	9.36E1	1.22	9.04E-1	9.43E-1	8.15E-1	8.15E-1
Mn 56	3.73E-2	2.39E1	--	1.65E-1	2.00E-1	--	--
Mo 99	2.22E1	7.42E1	2.30E-3	8.98E1	1.92E2	2.30E-3	2.30E-3
Na 24	1.51E2	1.51E2	1.51E2	1.51E2	1.51E2	1.51E2	1.51E2
I 131	1.14E2	1.80E1	2.00E2	2.01E2	3.31E2	6.66E4	3.23E-2
I 132	5.08E-3	1.30E-2	6.01E-3	1.10E-2	1.69E-2	5.13E-1	--
I 133	1.51E1	1.60E1	3.22E+1	3.98E1	6.64E1	7.40E3	--
Ni 65	1.46E-2	3.07	2.66E-1	2.51E-2	--	--	--
Cs 134	1.27E5	3.28E3	3.68E5	6.04E5	1.87E5	2.38E1	6.72E4
Cs 136	6.26E4	3.40E3	3.52E4	9.67E4	5.15E4	3.82E-1	7.68E3
Cs 137	7.28E4	3.12E3	5.15E5	4.93E5	1.61E5	3.62E1	5.78E4
Ba 140	1.87E1	1.62E2	3.19E2	3.28E-1	1.40E-1	4.87E-2	2.15E-1
Ce 141	4.61E-2	4.14E1	1.08E-1	7.43E-2	5.57E-2	4.12E-2	4.12E-2
Nb 95	1.45E2	3.75E5	5.21E2	2.03E2	1.91E2	4.16E-1	4.16E-1
La 140	1.93E-2	1.33E3	1.39E-1	5.09E-2	3.30E-3	3.30E-3	3.30E-3
Ce 144	4.31E-1	2.92E2	3.81	1.36	8.61E-1	2.40E-1	2.40E-1
Tc 99m	2.29E-2	7.87E-1	7.05E-4	1.38E-3	2.01E-2	--	7.02E-4
Np 239	2.40E-3	1.79E2	3.44E-2	3.12E-3	7.70E-3	6.94E-4	6.94E-4
Te 132	1.38E3	1.15E4	2.57E3	1.14E3	1.06E4	1.66E3	3.10E-3
Zr 97	6.99E-4	1.77E2	8.11E-3	1.18E-3	1.69E-3	8.29E-6	8.29E-6
W 187	5.37E1	1.68E4	2.02E2	1.20E2	5.16E-5	5.16E-5	5.16E-5
Ag 110m	1.29E1	1.24E2	1.35E1	1.30E1	1.39E1	1.21E1	1.21E1
Sb-124	5.69E1	1.68E2	6.92E1	5.06E1	5.03E1	5.04E1	6.08E1
Zn 69m	6.80E1	1.87E4	3.37E2	5.75E2	3.34E2	8.05E-2	8.05E-2
Au 199	5.58	2.75E2	1.47E-1	5.02	1.80E1	1.47E-1	1.47E-1

<sup>1</sup>Calculated in accordance with NUREG 0133, Section 4.3.1; and Regulatory Guide 1.109, Regulatory position C, Section 1.



**TABLE 2-5**  
**A<sub>int</sub> VALUES - LIQUID<sup>1</sup>**  
**INFANT**  
**mrem - ml**  
**hr - uCi**

NUCLIDE	T BODY	GI-TRACT	BONE	LIVER	KIDNEY	THYROID	LUNG
H 3	1.87E-1	1.87E-1	--	1.87E-1	1.87E-1	1.87E-1	1.87E-1
Cr 51	8.21E-3	2.39E-1	--	--	1.17E-3	5.36E-3	1.04E-2
Cu 64	1.96E-2	8.70E-1	--	4.24E-2	7.17E-2	--	--
Mn 54	2.73	4.42	--	1.20E1	2.67	--	--
Fe 55	1.45	6.91E-1	8.42	5.44	--	--	2.66
Fe 59	1.25E1	1.52E1	1.82E1	3.18E1	--	--	9.41
Co 58	5.36	5.36	--	2.15	--	--	--
Co 60	1.55E1	1.56E1	--	6.55	--	--	--
Zn 65	1.76E1	3.22E1	1.11E1	3.81E1	1.85E1	--	--
Sr 89	4.27E1	3.06E1	1.49E3	--	--	--	--
Sr 90	2.86E3	1.40E2	1.12E4	--	--	--	--
Sr 92	1.56E-5	4.54E-3	4.21E-4	--	--	--	--
Zr 95	2.12E-2	1.49E1	1.23E-1	2.99E-2	3.23E-2	--	--
Mn 56	1.81E-6	9.56E-4	--	1.05E-5	9.05E-6	--	--
Mo 99	2.65	4.48	--	1.36E1	2.03E1	--	--
Na 24	9.61E-1	9.61E-1	9.61E-1	9.61E-1	9.61E-1	9.61E-1	9.61E-1
I 131	9.78	7.94E-1	1.89E1	2.22E1	2.60E1	7.31E3	--
I 132	3.43E-6	7.80E-6	4.75E-6	9.63E-6	1.07E-5	4.52E-4	--
I 133	8.26E-1	4.77E-1	1.94	2.82	3.31	5.13E2	--
Ni 65	2.96E-6	4.96E-4	5.75E-5	6.51E-6	--	--	--
Cs 134	4.30E1	1.16	2.28E2	4.26E2	1.10E2	--	4.50E1
Cs 136	2.81E1	1.14	2.56E1	7.53E1	3.00E1	--	6.13
Cs 137	2.63E1	1.16	3.17E2	3.71E2	9.95E1	--	4.03E1
Ba 140	4.88	2.33E1	9.48E1	9.48E-2	2.25E-2	--	5.82E-2
Ce 141	3.31E-3	1.45E1	4.61E-2	2.81E-2	8.67E-3	--	--
Nb 95	5.87E-3	8.57	2.47E-2	1.02E-2	7.28E-3	--	--
La 140	6.52E-4	2.98E1	6.43E-3	2.53E-3	--	--	--
Ce 144	1.01E-1	1.03E2	1.80	7.37E-1	2.98E-1	--	--
Tc 99m	3.17E-4	7.14E-3	1.19E-5	2.46E-5	2.64E-4	--	1.28E-5
Np 239	2.08E-4	1.06E1	4.12E-3	3.68E-4	7.34E-4	--	--
Te 132	4.08	1.62E1	8.83	4.37	2.74E1	6.46	--
Zr 97	1.38E-4	1.92E1	1.76E-3	3.02E-4	3.04E-4	--	--
W 187	4.13E-2	7.02	1.72E-1	1.19E-1	--	--	--
Ag 110m	2.91E-1	2.28E1	6.02E-1	4.39E-1	6.28E-1	--	--
Sb-124	3.95	3.93E1	1.27E1	1.87E-1	--	3.38E-2	7.98
Zn 69m	2.30E-2	3.50	1.24E-1	2.52E-1	1.02E-1	--	--
Au 199	2.23E-1	5.38	--	2.48E-1	6.26E-1	--	--

<sup>1</sup>Calculated in accordance with NUREG 0133, Section 4.3.1; and Regulatory Guide 1.109, Regulatory position C, Section 1.



**TABLE 3-1**  
**OFFGAS PRETREATMENT\***  
**DETECTOR RESPONSE**

---

<u>NUCLIDE</u>	<u>NET CPM/<math>\mu</math>Ci/cc</u>
Kr 83m	--
Kr 85	4.28E+03
Kr 85m	3.85E+03
Kr 87	6.68E+03
Kr 88	3.97E+03
Kr 89	6.48E+03
Xe 131m	--
Xe 133	1.69E+03
Xe 133m	--
Xe 135	4.91E+03
Xe 135m	--
Xe 137	6.89E+03
Xe 138	5.51E+03

\* Values from calculation H21C-070



**TABLE 3-2**  
**PLUME SHINE PARAMETERS<sup>1</sup>**

<u>NUCLIDE</u>	<u>B<sub>i</sub> mrad/yr</u> <u>uCi/sec</u>	<u>V<sub>i</sub> mrem/yr</u> <u>uCi/sec</u>
Kr 83m	9.01E-7	-----
Kr 85	6.92E-7	-----
Kr 85m	5.09E-4	4.91E-4
Kr 87	2.72E-3	2.57E-3
Kr 88	7.23E-3	7.04E-3
Kr 89	1.15E-2	1.13E-2
Kr 90	6.57E-3	4.49E-3
Xe 131m	7.76E-6	-----
Xe 133	7.46E-5	6.42E-5
Xe 133m	4.79E-5	3.95E-5
Xe 135	7.82E-4	7.44E-4
Xe 135m	1.45E-3	1.37E-3
Xe 137	6.25E-4	5.98E-4
Xe 138	4.46E-3	4.26E-3
Xe-127	1.96E-3	1.31E-3
Ar 41	5.00E-3	4.79E-3

<sup>1</sup> B<sub>i</sub> and V<sub>i</sub> are calculated for critical site boundary location; 1.6km in the easterly direction. See Appendix B. Those values that show a dotted line were negligible because of high energy absorption coefficients.



**TABLE 3-3**  
**IMMERSION DOSE FACTORS<sup>1</sup>**

<u>Nuclide</u>	<u>K<sub>i</sub>(γ-Body)<sup>2</sup></u>	<u>L<sub>i</sub>(β-skin)<sup>2</sup></u>	<u>M<sub>i</sub>(γ-Air)<sup>3</sup></u>	<u>N<sub>i</sub>(β-Air)<sup>3</sup></u>
Kr 83m	7.56E-02	---	1.93E1	2.88E2
Kr 85m	1.17E3	1.46E3	1.23E3	1.97E3
Kr 85	1.61E1	1.34E3	1.72E1	1.95E3
Kr 87	5.92E3	9.73E3	6.17E3	1.03E4
Kr 88	1.47E4	2.37E3	1.52E4	2.93E3
Kr 89	1.66E4	1.01E4	1.73E4	1.06E4
Kr 90	1.56E4	7.29E3	1.63E4	7.83E3
Xe 131m	9.15E1	4.76E2	1.56E2	1.11E3
Xe 133m	2.51E2	9.94E2	3.27E2	1.48E3
Xe 133	2.94E2	3.06E2	3.53E2	1.05E3
Xe 135m	3.12E3	7.11E2	3.36E3	7.39E2
Xe 135	1.81E3	1.86E3	1.92E3	2.46E3
Xe 137	1.42E3	1.22E4	1.51E3	1.27E4
Xe 138	8.83E3	4.13E3	9.21E3	4.75E3
Ar 41	8.84E3	2.69E3	9.30E3	3.28E3

<sup>1</sup>From, Table B-1. Regulatory Guide 1.109 Rev. 1

<sup>2</sup>mrem/yr per uCi/m<sup>3</sup>.

<sup>3</sup>mrads/yr per uCi/m<sup>3</sup>.



TABLE 3-4  
DOSE AND DOSE RATE  
R<sub>i</sub> VALUES - INHALATION - INFANT<sup>1</sup>  
 $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

NUCLIDE	BONE	LIVER	T. BODY	THYROID	KIDNEY	LUNG	GI-LLI
H 3*	--	6.47E2	6.47E2	6.47E2	6.47E2	6.47E2	6.47E2
C 14*	2.65E4	5.31E3	5.31E3	5.31E3	5.31E3	5.31E3	5.31E3
Cr 51	--	--	8.95E1	5.75E1	1.32E1	1.28E4	3.57E2
Mn 54	--	2.53E4	4.98E3	--	4.98E3	1.00E6	7.06E3
Fe 55	1.97E4	1.17E4	3.33E3	--	--	8.69E4	1.09E3
Fe 59	1.36E4	2.35E4	9.48E3	--	--	1.02E6	2.48E4
Co 58	--	1.22E3	1.82E3	--	--	7.77E5	1.11E4
Co 60	--	8.02E3	1.18E4	--	--	4.51E6	3.19E4
Zn 65	1.93E4	6.26E4	3.11E4	--	3.25E4	6.47E5	5.14E4
Sr 89	3.98E5	--	1.14E4	--	--	2.03E6	6.40E4
Sr 90	4.09E7	--	2.59E6	--	--	1.12E7	1.31E5
Zr 95	1.15E5	2.79E4	2.03E4	--	3.11E4	1.75E6	2.17E4
Nb 95	1.57E4	6.43E3	3.78E3	--	4.72E3	4.79E5	1.27E4
Mo 99	--	1.65E2	3.23E1	--	2.65E2	1.35E5	4.87E4
I-131	3.79E4	4.44E4	1.96E4	1.48E7	5.18E4	--	1.06E3
I 133	1.32E4	1.92E4	5.60E3	3.56E6	2.24E4	--	2.16E3
Cs 134	3.96E5	7.03E5	7.45E4	--	1.90E5	7.97E4	1.33E3
Cs 137	5.49E5	6.12E5	4.55E4	--	1.72E5	7.13E4	1.33E3
Ba 140	5.60E4	5.60E1	2.90E3	--	1.34E1	1.60E6	3.84E4
La 140	5.05E2	2.00E2	5.15E1	--	--	1.68E5	8.48E4
Ce 141	2.77E4	1.67E4	1.99E3	--	5.25E3	5.17E5	2.16E4
Ce 144	3.19E6	1.21E6	1.76E5	--	5.38E5	9.84E6	1.48E5
Nd 147	7.94E3	8.13E3	5.00E2	--	3.15E3	3.22E5	3.12E4
Ag 110m	9.99E3	7.22E3	5.00E3	--	1.09E4	3.67E6	3.30E4

\* mrem/yr per  $\mu\text{Ci/m}^3$

<sup>1</sup>This and following R<sub>i</sub> Tables Calculated in accordance with NUREG 0133, Section 5.3.1, except C 14 values in accordance with Regulatory Guide 1.109 Equation C-8.



**TABLE 3-5**  
**DOSE AND DOSE RATE**  
**R<sub>i</sub> VALUES - INHALATION - CHILD**

	$\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$						
NUCLIDE	BONE	LIVER	T. BODY	THYROID	KIDNEY	LUNG	GI-LLI
H 3*	--	1.12E3	1.12E3	1.12E3	1.12E3	1.12E3	1.12E3
C 14*	3.59E4	6.73E3	6.73E3	6.73E3	6.73E3	6.73E3	6.73E3
Cr 51	--	--	1.54E2	8.55E1	2.43E1	1.70E4	1.08E3
Mn 54	--	4.29E4	9.51E3	--	1.00E4	1.58E6	2.29E4
Fe 55	4.74E4	2.52E4	7.77E3	--	--	1.11E5	2.87E3
Fe 59	2.07E4	3.34E4	1.67E4	--	--	1.27E6	7.07E4
Co 58	--	1.77E3	3.16E3	--	--	1.11E6	3.44E4
Co 60	--	1.31E4	2.26E4	--	--	7.07E6	9.62E4
Zn 65	4.26E4	1.13E5	7.03E4	--	7.14E4	9.95E5	1.63E4
Sr 89	5.99E5	--	1.72E4	--	--	2.16E6	1.67E5
Sr 90	1.01E8	--	6.44E6	--	--	1.48E7	3.43E5
Zr 95	1.90E5	4.18E4	3.70E4	--	5.96E4	2.23E6	6.11E4
Nb 95	2.35E4	9.18E3	6.55E3	--	8.62E3	6.14E5	3.70E4
Mo 99	--	1.72E2	4.26E1	--	3.92E2	1.35E5	1.27E5
I 131	4.81E4	4.81E4	2.73E4	1.62E7	7.88E4	--	2.84E3
I 133	1.66E4	2.03E4	7.70E3	3.85E6	3.38E4	--	5.48E3
Cs 134	6.51E5	1.01E6	2.25E5	--	3.30E5	1.21E5	3.85E3
Cs 137	9.07E5	8.25E5	1.28E5	--	2.82E5	1.04E5	3.62E3
Ba 140	7.40E4	6.48E1	4.33E3	--	2.11E1	1.74E6	1.02E5
La 140	6.44E2	2.25E2	7.55E1	--	--	1.83E5	2.26E5
Ce 141	3.92E4	1.95E4	2.90E3	--	8.55E3	5.44E5	5.66E4
Ce 144	6.77E6	2.12E6	3.61E5	--	1.17E6	1.20E7	3.89E5
Nd 147	1.08E4	8.73E3	6.81E2	--	4.81E3	3.28E5	8.21E4
Ag 110m	1.69E4	1.14E4	9.14E3	--	2.12E4	5.48E6	1.00E5

\* mrem/yr per  $\mu\text{Ci/m}^3$



**TABLE 3-6**  
**DOSE AND DOSE RATE**  
**R<sub>i</sub> VALUES - INHALATION - TEEN**

NUCLIDE	$\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$						
	BONE	LIVER	T. BODY	THYROID	KIDNEY	LUNG	GI-LLI
H 3*	--	1.27E3	1.27E3	1.27E3	1.27E3	1.27E3	1.27E3
C 14*	2.60E4	4.87E3	4.87E3	4.87E3	4.87E3	4.87E3	4.87E3
Cr 51	--	--	1.35E2	7.50E1	3.07E1	2.10E4	3.00E3
Mn 54	--	5.11E4	8.40E3	--	1.27E4	1.98E6	6.68E4
Fe 55	3.34E4	2.38E4	5.54E3	--	--	1.24E5	6.39E3
Fe 59	1.59E4	3.70E4	1.43E4	--	--	1.53E6	1.78E5
Co 58	--	2.07E3	2.78E3	--	--	1.34E6	9.52E4
Co 60	--	1.51E4	1.98E4	--	--	8.72E6	2.59E5
Zn 65	3.86E4	1.34E5	6.24E4	--	8.64E4	1.24E6	4.66E4
Sr 89	4.34E5	--	1.25E4	--	--	2.42E6	3.71E5
Sr 90	1.08E8	--	6.68E6	--	--	1.65E7	7.65E5
Zr 95	1.46E5	4.58E4	3.15E4	--	6.74E4	2.69E6	1.49E5
Nb 95	1.86E4	1.03E4	5.66E3	--	1.00E4	7.51E5	9.68E4
Mo 99	--	1.69E2	3.22E1	--	4.11E2	1.54E5	2.69E5
I 131	3.54E4	4.91E4	2.64E4	1.46E7	8.40E4	--	6.49E3
I 133	1.22E4	2.05E4	6.22E3	2.92E6	3.59E4	--	1.03E4
Cs 134	5.02E5	1.13E6	5.49E5	--	3.75E5	1.46E5	9.76E3
Cs 137	6.70E5	8.48E5	3.11E5	--	3.04E5	1.21E5	8.48E3
Ba 140	5.47E4	6.70E1	3.52E3	--	2.28E1	2.03E6	2.29E5
La 140	4.79E2	2.36E2	6.26E1	--	--	2.14E5	4.87E5
Ce 141	2.84E4	1.90E4	2.17E3	--	8.88E3	6.14E5	1.26E5
Ce 144	4.89E6	2.02E6	2.62E5	--	1.21E6	1.34E7	8.64E5
Nd 147	7.86E3	8.56E3	5.13E2	--	5.02E3	3.72E5	1.82E5
Ag 110m	1.38E4	1.31E4	7.99E3	--	2.50E4	6.75E6	2.73E5

\* mrem/yr per  $\mu\text{Ci/m}^3$



TABLE 3-7  
DOSE AND DOSE RATE  
R<sub>i</sub> VALUES - INHALATION - ADULT  
 $\frac{\text{mrem/yr}}{\mu\text{Ci/m}^3}$

NUCLIDE	BONE	LIVER	T. BODY	THYROID	KIDNEY	LUNG	GI-LLI
H 3*	--	1.26E3	1.26E3	1.26E3	1.26E3	1.26E3	1.26E3
C 14*	1.82E4	3.41E3	3.41E3	3.41E3	3.41E3	3.41E3	3.41E3
Cr 51	--	--	1.00E2	5.95E1	2.28E1	1.44E4	3.32E3
Mn 54	--	3.96E4	6.30E3	--	9.84E3	1.40E6	7.74E4
Fe 55	2.46E4	1.70E4	3.94E3	--	--	7.21E4	6.03E3
Fe 59	1.18E4	2.78E4	1.06E4	--	--	1.02E6	1.88E5
Co 58	--	1.58E3	2.07E3	--	--	9.28E5	1.06E5
Co 60	--	1.15E4	1.48E4	--	--	5.97E6	2.85E5
Zn 65	3.24E4	1.03E5	4.66E4	--	6.90E4	8.64E5	5.34E4
Sr 89	3.04E5	--	8.72E3	--	--	1.40E6	3.50E5
Sr 90	9.92E7	--	6.10E6	--	--	9.60E6	7.22E5
Zr 95	1.07E5	3.44E4	2.33E4	--	5.42E4	1.77E6	1.50E5
Nb 95	1.41E4	7.82E3	4.21E3	--	7.74E3	5.05E5	1.04E5
Mo 99	--	1.21E2	2.30E1	--	2.91E2	9.12E4	2.48E5
I 131	2.52E4	3.58E4	2.05E4	1.19E7	6.13E4	--	6.28E3
I 133	8.64E3	1.48E4	4.52E3	2.15E6	2.58E4	--	8.88E3
Cs 134	3.73E5	8.48E5	7.28E5	--	2.87E5	9.76E4	1.04E4
Cs 137	4.78E5	6.21E5	4.28E5	--	2.22E5	7.52E4	8.40E3
Ba 140	3.90E4	4.90E1	2.57E3	--	1.67E1	1.27E6	2.18E5
La 140	3.44E2	1.74E2	4.58E1	--	--	1.36E5	4.58E5
Ce 141	1.99E4	1.35E4	1.53E3	--	6.26E3	3.62E5	1.20E5
Ce 144	3.43E6	1.43E6	1.84E5	--	8.48E5	7.78E6	8.16E5
Nd 147	5.27E3	6.10E3	3.65E2	--	3.56E3	2.21E5	1.73E5
Ag 110m	1.08E4	1.00E4	5.94E3	--	1.97E4	4.63E6	3.02E5

\* mrem/yr per  $\mu\text{Ci/m}^3$



TABLE 3-8  
DOSE AND DOSE RATE  
R<sub>i</sub> VALUES - GROUND PLANE  
ALL AGE GROUPS  
 $\frac{\text{m}^2\text{-mrem/yr}}{\text{uCi/sec}}$

<u>NUCLIDE</u>	<u>TOTAL BODY</u>	<u>SKIN</u>
H 3	--	--
C 14	--	--
Cr 51	4.65E6	5.50E6
Mn 54	1.40E9	1.64E9
Fe 55	--	--
Fe 59	2.73E8	3.20E8
Co 58	3.80E8	4.45E8
Co 60	2.15E10	2.53E10
Zn 65	7.46E8	8.57E8
Sr 89	2.16E4	2.51E4
Sr 90	--	--
Zr 95	2.45E8	2.85E8
Nb 95	1.36E8	1.61E8
Mo 99	3.99E6	4.63E6
I 131	1.72E7	2.09E7
I 133	2.39E6	2.91E6
Cs 134	6.83E9	7.97E9
Cs 137	1.03E10	1.20E10
Ba 140	2.05E7	2.35E7
La 140	1.92E7	2.18E7
Ce 141	1.37E7	1.54E7
Ce 144	6.96E7	8.07E7
Nd 147	8.46E6	1.01E7
Ag 110m	3.44E9	4.01E9



TABLE 3-9  
DOSE AND DOSE RATE  
R<sub>i</sub> VALUES - COW MILK - INFANT  
 $\frac{\text{m}^2\text{-mrem/yr}}{\text{uCi/sec}}$

NUCLIDE	BONE	LIVER	T. BODY	THYROID	KIDNEY	LUNG	GI-LLI
H 3*	--	2.38E3	2.38E3	2.38E3	2.38E3	2.38E3	2.38E3
C 14*	3.23E6	6.89E5	6.89E5	6.89E5	6.89E5	6.89E5	6.89E5
Cr 51	--	--	8.35E4	5.45E4	1.19E4	1.06E5	2.43E6
Mn 54	--	2.51E7	5.68E6	--	5.56E6	--	9.21E6
Fe 55	8.43E7	5.44E7	1.45E7	--	--	2.66E7	6.91E6
Fe 59	1.22E8	2.13E8	8.38E7	--	--	6.29E7	1.02E8
Co 58	--	1.39E7	3.46E7	--	--	--	3.46E7
Co 60	--	5.90E7	1.39E8	--	--	--	1.40E8
Zn 65	3.53E9	1.21E10	5.58E9	--	5.87E9	--	1.02E10
Sr 89	6.93E9	--	1.99E8	--	--	--	1.42E8
Sr 90	8.19E10	--	2.09E10	--	--	--	1.02E9
Zr 95	3.85E3	9.39E2	6.66E2	--	1.01E3	--	4.68E5
Nb 95	4.21E5	1.64E5	1.17E5	--	1.54E5	--	3.03E8
Mo 99	--	1.04E8	2.03E7	--	1.55E8	--	3.43E7
I 131	6.81E8	8.02E8	3.53E8	2.64E11	9.37E8	--	2.86E7
I 133	8.52E6	1.24E7	3.63E6	2.26E9	1.46E7	--	2.10E6
Cs 134	2.41E10	4.49E10	4.54E9	--	1.16E10	4.74E9	1.22E8
Cs 137	3.47E10	4.06E10	2.88E9	--	1.09E10	4.41E9	1.27E8
Ba 140	1.21E8	1.21E5	6.22E6	--	2.87E4	7.42E4	2.97E7
La 140	2.03E1	7.99	2.06	--	--	--	9.39E4
Ce 141	2.28E4	1.39E4	1.64E3	--	4.28E3	--	7.18E6
Ce 144	1.49E6	6.10E5	8.34E4	--	2.46E5	--	8.54E7
Nd 147	4.43E2	4.55E2	2.79E1	--	1.76E2	--	2.89E5
Ag 110m	2.46E8	1.79E8	1.19E8	--	2.56E8	--	9.29E9

\*mrem/yr per  $\mu\text{Ci/m}^3$ .



TABLE 3-10  
DOSE AND DOSE RATE  
R<sub>i</sub> VALUES - COW MILK - CHILD  
 $\frac{\text{m}^2 \cdot \text{mrem/yr}}{\text{uCi/sec}}$

NUCLIDE	BONE	LIVER	T. BODY	THYROID	KIDNEY	LUNG	GI-LLI
H 3*	--	1.57E3	1.57E3	1.57E3	1.57E3	1.57E3	1.57E3
C 14*	1.65E6	3.29E5	3.29E5	3.29E5	3.29E5	3.29E5	3.29E5
Cr 51	--	--	5.27E4	2.93E4	7.99E3	5.34E4	2.80E6
Mn 54	--	1.35E7	3.59E6	--	3.78E6	--	1.13E7
Fe 55	6.97E7	3.07E7	1.15E7	--	--	2.09E7	6.85E6
Fe 59	6.52E7	1.06E8	5.26E7	--	--	3.06E7	1.10E8
Co 58	--	6.94E6	2.13E7	--	--	--	4.05E7
Co 60	--	2.89E7	8.52E7	--	--	--	1.60E8
Zn 65	2.63E9	7.00E9	4.35E9	--	4.41E9	--	1.23E9
Sr 89	3.64E9	--	1.04E8	--	--	--	1.41E8
Sr 90	7.53E10	--	1.91E10	--	--	--	1.01E9
Zr 95	2.17E3	4.77E2	4.25E2	--	6.83E2	--	4.98E5
Nb 95	1.86E5	1.03E4	5.69E4	--	1.00E5	--	4.42E8
Mo 99	--	4.07E7	1.01E7	--	8.69E7	--	3.37E7
I 131	3.26E8	3.28E8	1.86E8	1.08E11	5.39E8	--	2.92E7
I 133	4.04E6	4.99E6	1.89E6	9.27E8	8.32E6	--	2.01E6
Cs 134	1.50E10	2.45E10	5.18E9	--	7.61E9	2.73E9	1.32E8
Cs 137	2.17E10	2.08E10	3.07E9	--	6.78E9	2.44E9	1.30E8
Ba 140	5.87E7	5.14E4	3.43E6	--	1.67E4	3.07E4	2.97E7
La 140	9.70	3.39	1.14	--	--	--	9.45E4
Ce 141	1.15E4	5.73E3	8.51E2	--	2.51E3	--	7.15E6
Ce 144	1.04E6	3.26E5	5.55E4	--	1.80E5	--	8.49E7
Nd 147	2.24E2	1.81E2	1.40E1	--	9.94E1	--	2.87E5
Ag 110m	1.33E8	8.97E7	7.17E7	--	1.67E8	--	1.07E10

\*mrem/yr per  $\mu\text{Ci/m}^3$ .



TABLE 3-11  
DOSE AND DOSE RATE  
R<sub>i</sub> VALUES - COW MILK - TEEN  
 $\frac{\text{m}^2\text{-mrem/yr}}{\text{uCi/sec}}$

NUCLIDE	BONE	LIVER	T. BODY	THYROID	KIDNEY	LUNG	GI-LLI
H 3*	--	9.94E2	9.94E2	9.94E2	9.94E2	9.94E2	9.94E2
C 14*	6.70E5	1.34E5	1.34E5	1.34E5	1.34E5	1.35E5	1.34E5
Cr 51	--	--	2.58E4	1.44E4	5.66E3	3.69E4	4.34E6
Mn 54	--	9.01E6	1.79E6	--	2.69E6	--	1.85E7
Fe 55	2.78E7	1.97E7	4.59E6	--	--	1.25E7	8.52E6
Fe 59	2.81E7	6.57E7	2.54E7	--	--	2.07E7	1.55E8
Co 58	--	4.55E6	1.05E7	--	--	--	6.27E7
Co 60	--	1.86E7	4.19E7	--	--	--	2.42E8
Zn 65	1.34E9	4.65E9	2.17E9	--	2.97E9	--	1.97E9
Sr 89	1.47E9	--	4.21E7	--	--	--	1.75E8
Sr 90	4.45E10	--	1.10E10	--	--	--	1.25E9
Zr 95	9.34E2	2.95E2	2.03E2	--	4.33E2	--	6.80E5
Nb 95	1.86E5	1.03E5	5.69E4	--	1.00E5	--	4.42E8
Mo 99	--	2.24E7	4.27E6	--	5.12E7	--	4.01E7
I 131	1.34E8	1.88E8	1.01E8	5.49E10	3.24E8	--	3.72E7
I 133	1.66E6	2.82E6	8.59E5	3.93E8	4.94E6	--	2.13E6
Cs 134	6.49E9	1.53E10	7.08E9	--	4.85E9	1.85E9	1.90E8
Cs 137	9.02E9	1.20E10	4.18E9	--	4.08E9	1.59E9	1.71E8
Ba 140	2.43E7	2.98E4	1.57E6	--	1.01E4	2.00E4	3.75E7
La 140	4.05	1.99	5.30E-1	--	--	--	1.14E5
Ce 141	4.67E3	3.12E3	3.58E2	--	1.47E3	--	8.91E6
Ce 144	4.22E5	1.74E5	2.27E4	--	1.04E5	--	1.06E8
Nd 147	9.12E1	9.91E1	5.94E0	--	5.82E1	--	3.58E5
Ag 110m	6.13E7	5.80E7	3.53E7	--	1.11E8	--	1.63E10

\*mrem/yr per  $\mu\text{Ci/m}^3$ .



TABLE 3-12  
DOSE AND DOSE RATE  
R<sub>i</sub> VALUES - COW MILK - ADULT  
 $\frac{\text{m}^2\text{-mrem/yr}}{\text{uCi/sec}}$

NUCLIDE	BONE	LIVER	T. BODY	THYROID	KIDNEY	LUNG	GI-LLI
H 3*	--	7.63E2	7.63E2	7.63E2	7.63E2	7.63E2	7.63E2
*C 14	3.63E5	7.26E4	7.26E4	7.26E4	7.26E4	7.26E4	7.26E4
Cr 51	--	--	1.48E4	8.85E3	3.26E3	1.96E4	3.72E6
Mn 54	--	5.41E6	1.03E6	--	1.61E6	--	1.66E7
Fe 55	1.57E7	1.08E7	2.52E6	--	--	6.04E6	6.21E6
Fe 59	1.61E7	3.79E7	1.45E7	--	--	1.06E7	1.26E8
Co 58	--	2.70E6	6.05E6	--	--	--	5.47E7
Co 60	--	1.10E7	2.42E7	--	--	--	2.06E8
Zn 65	8.71E8	2.77E9	1.25E9	--	1.85E9	--	1.75E9
Sr 89	7.99E8	--	2.29E7	--	--	--	1.28E8
Sr 90	3.15E10	--	7.74E9	--	--	--	9.11E8
Zr 95	5.34E2	1.71E2	1.16E2	--	2.69E2	--	5.43E5
Nb 95	1.09E5	6.07E4	3.27E4	--	6.00E4	--	3.69E8
Mo 99	--	1.24E7	2.36E6	--	2.81E7	--	2.87E7
I 131	7.41E7	1.06E8	6.08E7	3.47E10	1.82E8	--	2.80E7
I 133	9.09E5	1.58E6	4.82E5	2.32E8	2.76E6	--	1.42E6
Cs 134	3.74E9	8.89E9	7.27E9	--	2.88E9	9.55E8	1.56E8
Cs 137	4.97E9	6.80E9	4.46E9	--	2.31E9	7.68E8	1.32E8
Ba 140	1.35E7	1.69E4	8.83E5	--	5.75E3	9.69E3	2.77E7
La 140	2.26	1.14	3.01E-1	--	--	--	8.35E4
Ce 141	2.54E3	1.72E3	1.95E2	--	7.99E2	--	6.58E6
Ce 144	2.29E5	9.58E4	1.23E4	--	5.68E4	--	7.74E7
Nd 147	4.74E1	5.48E1	3.28E0	--	3.20E1	--	2.63E5
Ag 110m	3.71E7	3.43E7	2.04E7	--	6.74E7	--	1.40E10

\*mrem/yr per  $\mu\text{Ci/m}^3$ .



TABLE 3-13  
DOSE AND DOSE RATE  
R<sub>i</sub> VALUES - GOAT MILK - INFANT  
 $\frac{\text{m}^2\text{-mrem/yr}}{\text{uCi/sec}}$

NUCLIDE	BONE	LIVER	T. BODY	THYROID	KIDNEY	LUNG	GI-LLI
H 3*	--	6.33E3	6.33E3	6.33E3	6.33E3	6.33E3	6.33E3
C 14*	3.23E6	6.89E5	6.89E5	6.89E5	6.89E5	6.89E5	6.89E5
Cr 51	--	--	1.00E4	6.56E3	1.43E3	1.28E4	2.93E5
Mn 54	--	3.01E6	6.82E5	--	6.67E5	--	1.11E6
Fe 55	1.10E6	7.08E5	1.89E5	--	--	3.46E5	8.98E4
Fe 59	1.59E6	2.78E6	1.09E6	--	--	8.21E5	1.33E6
Co 58	--	1.67E6	4.16E6	--	--	--	4.16E6
Co 60	--	7.08E6	1.67E7	--	--	--	1.68E7
Zn 65	4.24E8	1.45E9	6.70E8	--	7.04E8	--	1.23E9
Sr 89	1.48E10	--	4.24E8	--	--	--	3.04E8
Sr 90	1.72E11	--	4.38E10	--	--	--	2.15E9
Zr 95	4.66E2	1.13E2	8.04E1	--	1.22E2	--	5.65E4
Nb 95	9.42E4	3.88E4	2.24E4	--	2.78E4	--	3.27E7
Mo 99	--	1.27E7	2.47E6	--	1.89E7	--	4.17E6
I 131	8.17E8	9.63E8	4.23E8	3.16E11	1.12E9	--	3.44E7
I 133	1.02E7	1.49E7	4.36E6	2.71E9	1.75E7	--	2.52E6
Cs 134	7.23E10	1.35E11	1.36E10	--	3.47E10	1.42E10	3.66E8
Cs 137	1.04E11	1.22E11	8.63E9	--	3.27E10	1.32E10	3.81E8
Ba 140	1.45E7	1.45E4	7.48E5	--	3.44E3	8.91E3	3.56E6
La 140	2.430	9.59E-1	2.47E-1	--	--	--	1.13E4
Ce 141	2.74E3	1.67E3	1.96E2	--	5.14E2	--	8.62E5
Ce 144	1.79E5	7.32E4	1.00E4	--	2.96E4	--	1.03E7
Nd 147	5.32E1	5.47E1	3.35E0	--	2.11E1	--	3.46E4
Ag 110m	2.95E7	2.15E7	1.43E7	--	3.07E7	--	1.11E9

\*mrem/yr per  $\mu\text{Ci/m}^3$ .



TABLE 3-14  
DOSE AND DOSE RATE  
R<sub>i</sub> VALUES - GOAT MILK - CHILD  
 $\frac{\text{m}^2 \cdot \text{mrem}}{\text{yr}}$   
 $\frac{\text{uCi}}{\text{sec}}$

NUCLIDE	BONE	LIVER	T. BODY	THYROID	KIDNEY	LUNG	GI-LLI
H 3*	--	4.17E3	4.17E3	4.17E3	4.17E3	4.17E3	4.17E3
C 14*	1.65E6	3.29E5	3.29E5	3.29E5	3.29E5	3.29E5	3.29E5
Cr 51	--	--	6.34E3	3.52E3	9.62E2	6.43E3	3.36E5
Mn 54	--	1.62E6	4.31E5	--	4.54E5	--	1.36E6
Fe 55	9.06E5	4.81E5	1.49E5	--	--	2.72E5	8.91E4
Fe 59	8.52E5	1.38E6	6.86E5	--	--	3.99E5	1.43E6
Co 58	--	8.35E5	2.56E6	--	--	--	4.87E6
Co 60	--	3.47E6	1.02E7	--	--	--	1.92E7
Zn 65	3.15E8	8.40E8	5.23E8	--	5.29E8	--	1.48E8
Sr 89	7.77E9	--	2.22E8	--	--	--	3.01E8
Sr 90	1.58E11	--	4.01E10	--	--	--	2.13E9
Zr 95	2.62E2	5.76E1	5.13E1	--	8.25E1	--	6.01E4
Nb 95	5.05E4	1.96E4	1.40E4	--	1.85E4	--	3.63E7
Mo 99	--	4.95E6	1.22E6	--	1.06E7	--	4.09E6
I 131	3.91E8	3.94E8	2.24E8	1.30E11	6.46E8	--	3.50E7
I 133	4.84E6	5.99E6	2.27E6	1.11E9	9.98E6	--	2.41E6
Cs 134	4.49E10	7.37E10	1.55E10	--	2.28E10	8.19E9	3.97E8
Cs 137	6.52E10	6.24E10	9.21E9	--	2.03E10	7.32E9	3.91E8
Ba 140	7.05E6	6.18E3	4.12E5	--	2.01E3	3.68E3	3.57E6
La 140	1.16	4.07E-1	1.37E-1	--	--	--	1.13E4
Ce 141	1.38E3	6.88E2	1.02E2	--	3.02E2	--	8.59E5
Ce 144	1.25E5	3.91E4	6.66E3	--	2.16E4	--	1.02E7
Nd 147	2.68E1	2.17E1	1.68E0	--	1.19E1	--	3.44E4
Ag 110m	1.60E7	1.08E7	8.60E6	--	2.00E7	--	1.28E9

\*mrem/yr per  $\mu\text{Ci}/\text{m}^3$ .



**TABLE 3-15**  
**DOSE AND DOSE RATE**  
**R<sub>i</sub> VALUES - GOAT MILK - TEEN**  
 $\frac{\text{m}^2 \cdot \text{mrem}}{\text{yr}}$   
 $\frac{\text{uCi}}{\text{sec}}$

NUCLIDE	BONE	LIVER	T. BODY	THYROID	KIDNEY	LUNG	GI-LLI
H 3*	--	2.64E3	2.64E3	2.64E3	2.64E3	2.64E3	2.64E3
C 14*	6.70E5	1.34E5	1.34E5	1.34E5	1.34E5	1.35E5	1.34E5
Cr 51	--	--	3.11E3	1.73E3	6.82E2	4.44E3	5.23E5
Mn 54	--	1.08E6	2.15E5	--	3.23E5	--	2.22E6
Fe 55	3.61E5	2.56E5	5.97E4	--	--	1.62E5	1.11E5
Fe 59	3.67E5	8.57E5	3.31E5	--	--	2.70E5	2.03E6
Co 58	--	5.46E5	1.26E6	--	--	--	7.53E6
Co 60	--	2.23E6	5.03E6	--	--	--	2.91E7
Zn 65	1.61E8	5.58E8	2.60E8	--	3.57E8	--	2.36E8
Sr 89	3.14E9	--	8.99E7	--	--	--	3.74E8
Sr 90	9.36E10	--	2.31E10	--	--	--	2.63E9
Zr 95	1.13E2	3.56E1	2.45E1	--	5.23E1	--	8.22E4
Nb 95	2.23E4	1.24E4	6.82E3	--	1.20E4	--	5.30E7
Mo 99	--	2.72E6	5.19E5	--	6.23E6	--	4.87E6
I 131	1.61E8	2.26E8	1.21E8	6.59E10	3.89E8	--	4.47E7
I 133	1.99E6	3.38E6	1.03E6	4.72E8	5.93E6	--	2.56E6
Cs 134	1.95E10	4.58E10	2.13E10	--	1.46E10	5.56E9	5.70E8
Cs 137	2.71E10	3.60E10	1.25E10	--	1.23E10	4.76E9	5.12E8
Ba 140	2.92E6	3.58E3	1.88E5	--	1.21E3	2.41E3	4.50E6
La 140	4.86E-1	2.39E-1	6.36E-2	--	--	--	1.37E4
Ce 141	5.60E2	3.74E2	4.30E1	--	1.76E2	--	1.07E6
Ce 144	5.06E4	2.09E4	2.72E3	--	1.25E4	--	1.27E7
Nd 147	1.09E1	1.19E1	7.13E-1	--	6.99E0	--	4.29E4
Ag 110m	7.36E6	6.96E6	4.24E6	--	1.33E7	--	1.96E9

\*mrem/yr per  $\mu\text{Ci}/\text{m}^3$ .



**TABLE 3-16**  
**DOSE AND DOSE RATE**  
**R<sub>i</sub> VALUES - GOAT MILK - ADULT**  
 $\frac{\text{m}^2\text{-mrem/yr}}{\text{uCi/sec}}$

NUCLIDE	BONE	LIVER	T. BODY	THYROID	KIDNEY	LUNG	GI-LLI
H 3*	--	2.03E3	2.03E3	2.03E3	2.03E3	2.03E3	2.03E3
C 14*	3.63E5	7.26E4	7.26E4	7.26E4	7.26E4	7.26E4	7.26E4
Cr 51	--	--	1.78E3	1.06E3	3.92E2	2.36E3	4.48E5
Mn 54	--	6.50E5	1.24E5	--	1.93E5	--	1.99E6
Fe 55	2.04E5	1.41E5	3.28E4	--	--	7.85E4	8.07E4
Fe 59	2.10E5	4.95E5	1.90E5	--	--	1.38E5	1.65E6
Co 58	--	3.25E5	7.27E5	--	--	--	6.58E6
Co 60	--	1.32E6	2.91E6	--	--	--	2.48E7
Zn 65	1.05E8	3.33E8	1.51E8	--	2.23E8	--	2.10E8
Sr 89	1.70E9	--	4.89E7	--	--	--	2.73E8
Sr 90	6.62E10	--	1.63E10	--	--	--	1.91E9
Zr 95	6.45E1	2.07E1	1.40E1	--	3.25E1	--	6.56E4
Nb 95	1.31E4	7.29E3	3.92E3	--	7.21E3	--	4.42E7
Mo 99	--	1.51E6	2.87E5	--	3.41E6	--	3.49E6
I 131	8.89E7	1.27E8	7.29E7	4.17E10	2.18E8	--	3.36E7
I 133	1.09E6	1.90E6	5.79E5	2.79E8	3.31E6	--	1.71E6
Cs 134	1.12E10	2.67E10	2.18E10	--	8.63E9	2.86E9	4.67E8
Cs 137	1.49E10	2.04E10	1.34E10	--	6.93E9	2.30E9	3.95E8
Ba 140	1.62E6	2.03E3	1.06E5	--	6.91E2	1.16E3	3.33E6
La 140	2.71E-1	1.36E-1	3.61E-2	--	--	--	1.00E4
Ce 141	3.06E2	2.07E2	2.34E1	--	9.60E1	--	7.90E5
Ce 144	2.75E4	1.15E4	1.48E3	--	6.82E3	--	9.30E6
Nd 147	5.69E0	6.57E0	3.93E-1	--	3.84E0	--	3.15E4
Ag 110m	4.45E6	4.12E6	2.45E6	--	8.09E6	--	1.68E9

\*mrem/yr per  $\mu\text{Ci/m}^3$ .



TABLE 3-17  
DOSE AND DOSE RATE  
R<sub>i</sub> VALUES - COW MEAT - CHILD  
 $\frac{\text{m}^2 \cdot \text{mrem}}{\text{yr}}$   
uCi/sec

NUCLIDE	BONE	LIVER	T. BODY	THYROID	KIDNEY	LUNG	GI-LLI
H 3*	--	2.34E2	2.34E2	2.34E2	2.34E2	2.34E2	2.34E2
C 14*	5.29E5	1.06E5	1.06E5	1.06E5	1.06E5	1.06E5	1.06E5
Cr 51	--	--	4.55E3	2.52E3	6.90E2	4.61E3	2.41E5
Mn 54	--	5.15E6	1.37E6	--	1.44E6	--	4.32E6
Fe 55	2.89E8	1.53E8	4.74E7	--	--	8.66E7	2.84E7
Fe 59	2.04E8	3.30E8	1.65E8	--	--	9.58E7	3.44E8
Co 58	--	9.41E6	2.88E7	--	--	--	5.49E7
Co 60	--	4.64E7	1.37E8	--	--	--	2.57E8
Zn 65	2.38E8	6.35E8	3.95E8	--	4.00E8	--	1.12E8
Sr 89	2.65E8	--	7.57E6	--	--	--	1.03E7
Sr 90	7.01E9	--	1.78E9	--	--	--	9.44E7
Zr 95	1.51E6	3.32E5	2.95E5	--	4.75E5	--	3.46E8
Nb 95	4.10E6	1.59E6	1.14E6	--	1.50E6	--	2.95E9
Mo 99	--	5.42E4	1.34E4	--	1.16E5	--	4.48E4
I 131	4.15E6	4.18E6	2.37E6	1.38E9	6.86E6	--	3.72E5
I 133	9.38E-2	1.16E-1	4.39E-2	2.15E1	1.93E-1	--	4.67E-2
Cs 134	6.09E8	1.00E9	2.11E8	--	3.10E8	1.11E8	5.39E6
Cs 137	8.99E8	8.60E8	1.27E8	--	2.80E8	1.01E8	5.39E6
Ba 140	2.20E7	1.93E4	1.28E6	--	6.27E3	1.15E4	1.11E7
La 140	2.80E-2	9.78E-3	3.30E-3	--	--	--	2.73E2
Ce 141	1.17E4	5.82E3	8.64E2	--	2.55E3	--	7.26E6
Ce 144	1.48E6	4.65E5	7.91E4	--	2.57E5	--	1.21E8
Nd 147	5.93E3	4.80E3	3.72E2	--	2.64E3	--	7.61E6
Ag 110m	5.62E6	3.79E6	3.03E6	--	7.05E6	--	4.52E8

\*mrem/yr per  $\mu\text{Ci}/\text{m}^3$ .



TABLE 3-18  
DOSE AND DOSE RATE  
R<sub>i</sub> VALUES - COW MEAT - TEEN  
 $\frac{\text{m}^2 \cdot \text{mrem}}{\text{yr}}$   
uCi/sec

NUCLIDE	BONE	LIVER	T. BODY	THYROID	KIDNEY	LUNG	GI-LLI
H 3*	--	1.94E2	1.94E2	1.94E2	1.94E2	1.94E2	1.94E2
C 14*	2.81E5	5.62E4	5.62E4	5.62E4	5.62E4	5.62E4	5.62E4
Cr 51	--	--	2.93E3	1.62E3	6.39E2	4.16E3	4.90E5
Mn 54	--	4.50E6	8.93E5	--	1.34E6	--	9.24E6
Fe 55	1.50E8	1.07E8	2.49E7	--	--	6.77E7	4.62E7
Fe 59	1.15E8	2.69E8	1.04E8	--	--	8.47E7	6.36E8
Co 58	--	8.05E6	1.86E7	--	--	--	1.11E8
Co 60	--	3.90E7	8.80E7	--	--	--	5.09E8
Zn 65	1.59E8	5.52E8	2.57E8	--	3.53E8	--	2.34E8
Sr 89	1.40E8	--	4.01E6	--	--	--	1.67E7
Sr 90	5.42E9	--	1.34E9	--	--	--	1.52E8
Zr 95	8.50E5	2.68E5	1.84E5	--	3.94E5	--	6.19E8
Nb 95	2.37E6	1.32E6	7.24E5	--	1.28E6	--	5.63E9
Mo 99	--	3.90E4	7.43E3	--	8.92E4	--	6.98E4
I 131	2.24E6	3.13E6	1.68E6	9.15E8	5.40E6	--	6.20E5
I 133	5.05E-2	8.57E-2	2.61E-2	1.20E1	1.50E-1	--	6.48E-2
Cs 134	3.46E8	8.13E8	3.77E8	--	2.58E8	9.87E7	1.01E7
Cs 137	4.88E8	6.49E8	2.26E8	--	2.21E8	8.58E7	9.24E6
Ba 140	1.19E7	1.46E4	7.68E5	--	4.95E3	9.81E3	1.84E7
La 140	1.53E-2	7.51E-3	2.00E-3	--	--	--	4.31E2
Ce 141	6.19E3	4.14E3	4.75E2	--	1.95E3	--	1.18E7
Ce 144	7.87E5	3.26E5	4.23E4	--	1.94E5	--	1.98E8
Nd 147	3.16E3	3.44E3	2.06E2	--	2.02E3	--	1.24E7
Ag 110m	3.39E6	3.20E6	1.95E7	--	6.13E6	--	9.01E8

\*mrem/yr per  $\mu\text{Ci}/\text{m}^3$ .



TABLE 3-19  
DOSE AND DOSE RATE  
R<sub>i</sub> VALUES - COW MEAT - ADULT  
 $\frac{\text{m}^2 \cdot \text{mrem/yr}}{\text{uCi/sec}}$

NUCLIDE	BONE	LIVER	T. BODY	THYROID	KIDNEY	LUNG	GI-LLI
H 3*	--	3.25E2	3.25E2	3.25E2	3.25E2	3.25E2	3.25E2
C 14*	3.33E5	6.66E4	6.66E4	6.66E4	6.66E4	6.66E4	6.66E4
Cr 51	--	--	3.65E3	2.18E3	8.03E2	4.84E3	9.17E5
Mn 54	--	5.90E6	1.13E6	--	1.76E6	--	1.81E7
Fe 55	1.85E8	1.28E8	2.98E7	--	--	7.14E7	7.34E7
Fe 59	1.44E8	3.39E8	1.30E8	--	--	9.46E7	1.13E9
Co 58	--	1.04E7	2.34E7	--	--	--	2.12E8
Co 60	--	5.03E7	1.11E8	--	--	--	9.45E8
Zn 65	2.26E8	7.19E8	3.25E8	--	4.81E8	--	4.53E8
Sr 89	1.66E8	--	4.76E6	--	--	--	2.66E7
Sr 90	8.38E9	--	2.06E9	--	--	--	2.42E8
Zr 95	1.06E6	3.40E5	2.30E5	--	5.34E5	--	1.08E9
Nb 95	3.04E6	1.69E6	9.08E5	--	1.67E6	--	1.03E10
Mo 99	--	4.71E4	8.97E3	--	1.07E5	--	1.09E5
I 131	2.69E6	3.85E6	2.21E6	1.26E9	6.61E6	--	1.02E6
I 133	6.04E-2	1.05E-1	3.20E-2	1.54E1	1.83E-1	--	9.44E-2
Cs 134	4.35E8	1.03E9	8.45E8	--	3.35E8	1.11E8	1.81E7
Cs 137	5.88E8	8.04E8	5.26E8	--	2.73E8	9.07E7	1.56E7
Ba 140	1.44E7	1.81E4	9.44E5	--	6.15E3	1.04E4	2.97E7
La 140	1.86E-2	9.37E-3	2.48E-3	--	--	--	6.88E2
Ce 141	7.38E3	4.99E3	5.66E2	--	2.32E3	--	1.91E7
Ce 144	9.33E5	3.90E5	5.01E4	--	2.31E5	--	3.16E8
Nd 147	3.59E3	4.15E3	2.48E2	--	2.42E3	--	1.99E7
Ag 110m	4.48E6	4.14E6	2.46E6	--	8.13E6	--	1.69E9

\*mrem/yr per  $\mu\text{Ci/m}^3$ .



**TABLE 3-20**  
**DOSE AND DOSE RATE**  
**R<sub>i</sub> VALUES - VEGETATION - CHILD**  
 $\frac{\text{m}^2 \cdot \text{mrem}}{\text{yr}}$   
 $\frac{\text{uCi}}{\text{sec}}$

NUCLIDE	BONE	LIVER	T. BODY	THYROID	KIDNEY	LUNG	GI-LLI
H 3*	--	4.01E3	4.01E3	4.01E3	4.01E3	4.01E3	4.01E3
C 14*	3.50E6	7.01E5	7.01E5	7.01E5	7.01E5	7.01E5	7.01E5
Cr 51	--	--	1.17E5	6.49E4	1.77E4	1.18E5	6.20E6
Mn 54	--	6.65E8	1.77E8	--	1.86E8	--	5.58E8
Fe 55	7.63E8	4.05E8	1.25E8	--	--	2.29E8	7.50E7
Fe 59	3.97E8	6.42E8	3.20E8	--	--	1.86E8	6.69E8
Co 58	--	6.45E7	1.97E8	--	--	--	3.76E8
Co 60	--	3.78E8	1.12E9	--	--	--	2.10E9
Zn 65	8.12E8	2.16E9	1.35E9	--	1.36E9	--	3.80E8
Sr 89	3.59E10	--	1.03E9	--	--	--	1.39E9
Sr 90	1.24E12	--	3.15E11	--	--	--	1.67E10
Zr 95	3.86E6	8.50E5	7.56E5	--	1.22E6	--	8.86E8
Nb 95	1.02E6	3.99E5	2.85E5	--	3.75E5	--	7.37E8
Mo 99	--	7.70E6	1.91E6	--	1.65E7	--	6.37E6
I 131	7.16E7	7.20E7	4.09E7	2.38E10	1.18E8	--	6.41E6
I 133	1.69E6	2.09E6	7.92E5	3.89E8	3.49E6	--	8.44E5
Cs 134	1.60E10	2.63E10	5.55E9	--	8.15E9	2.93E9	1.42E8
Cs 137	2.39E10	2.29E10	3.38E9	--	7.46E9	2.68E9	1.43E8
Ba 140	2.77E8	2.43E5	1.62E7	--	7.90E4	1.45E5	1.40E8
La 140	3.25E3	1.13E3	3.83E2	--	--	--	3.16E7
Ce 141	6.56E5	3.27E5	4.85E4	--	1.43E5	--	4.08E8
Ce 144	1.27E8	3.98E7	6.78E6	--	2.21E7	--	1.04E10
Nd 147	7.23E4	5.86E4	4.54E3	--	3.22E4	--	9.28E7
Ag 110m	3.21E7	2.17E7	1.73E7	--	4.04E7	--	2.58E9

\*mrem/yr per  $\mu\text{Ci}/\text{m}^3$ .



TABLE 3-21  
DOSE AND DOSE RATE  
R<sub>i</sub> VALUES - VEGETATION - TEEN  
 $\frac{\text{m}^2 \cdot \text{mrem}}{\text{yr}}$   
uCi/sec

NUCLIDE	BONE	LIVER	T. BODY	THYROID	KIDNEY	LUNG	GI-LLI
H 3*	--	2.59E3	2.59E3	2.59E3	2.59E3	2.59E3	2.59E3
C 14*	1.45E6	2.91E5	2.91E5	2.91E5	2.91E5	2.91E5	2.91E5
Cr 51	--	--	6.16E4	3.42E4	1.35E4	8.79E4	1.03E7
Mn 54	--	4.54E8	9.01E7	--	1.36E8	--	9.32E8
Fe 55	3.10E8	2.20E8	5.13E7	--	--	1.40E8	9.53E7
Fe 59	1.79E8	4.18E8	1.61E8	--	--	1.32E8	9.89E8
Co 58	--	4.37E7	1.01E8	--	--	--	6.02E8
Co 60	--	2.49E8	5.60E8	--	--	--	3.24E9
Zn 65	4.24E8	1.47E9	6.86E8	--	9.41E8	--	6.23E8
Sr 89	1.51E10	--	4.33E8	--	--	--	1.80E9
Sr 90	7.51E11	--	1.85E11	--	--	--	2.11E10
Zr 95	1.72E6	5.44E5	3.74E5	--	7.99E5	--	1.26E9
Nb 95	4.80E5	2.66E5	1.46E5	--	2.58E5	--	1.14E9
Mo 99	--	5.64E6	1.08E6	--	1.29E7	--	1.01E7
I 131	3.85E7	5.39E7	2.89E7	1.57E10	9.28E7	--	1.07E7
I 133	9.29E5	1.58E6	4.80E5	2.20E8	2.76E6	--	1.19E6
Cs 134	7.10E9	1.67E10	7.75E9	--	5.31E9	2.03E9	2.08E8
Cs 137	1.01E10	1.35E10	4.69E9	--	4.59E9	1.78E9	1.92E8
Ba 140	1.38E8	1.69E5	8.91E6	--	5.74E4	1.14E5	2.13E8
La 140	1.81E3	8.88E2	2.36E2	--	--	--	5.10E7
Ce 141	2.83E5	1.89E5	2.17E4	--	8.89E4	--	5.40E8
Ce 144	5.27E7	2.18E7	2.83E6	--	1.30E7	--	1.33E10
Nd 147	3.66E4	3.98E4	2.38E3	--	2.34E4	--	1.44E8
Ag 110m	1.51E7	1.43E7	8.72E6	--	2.74E7	--	4.03E9

\*mrem/yr per  $\mu\text{Ci}/\text{m}^3$



**TABLE 3-22**  
**DOSE AND DOSE RATE**  
**R<sub>i</sub> VALUES - VEGETATION - ADULT**  
 $\frac{\text{m}^2\text{-mrem/yr}}{\text{uCi/sec}}$

NUCLIDE	BONE	LIVER	T. BODY	THYROID	KIDNEY	LUNG	GI-LLI
H 3*	--	2.26E3	2.26E3	2.26E3	2.26E3	2.26E3	2.26E3
C 14*	8.97E5	1.79E5	1.79E5	1.79E5	1.79E5	1.79E5	1.79E5
Cr 51	--	--	4.64E4	2.77E4	1.02E4	6.15E4	1.17E7
Mn 54	--	3.13E8	5.97E7	--	9.31E7	--	9.58E8
Fe 55	2.00E8	1.38E8	3.22E7	--	--	7.69E7	7.91E7
Fe 59	1.26E8	2.96E8	1.13E8	--	--	8.27E7	1.02E9
Co 58	--	3.08E7	6.90E7	--	--	--	6.24E8
Co 60	--	1.67E8	3.69E8	--	--	--	3.14E9
Zn 65	3.17E8	1.01E9	4.56E8	--	6.75E8	--	6.36E8
Sr 89	9.96E9	--	2.86E8	--	--	--	1.60E9
Sr 90	6.05E11	--	1.48E11	--	--	--	1.75E10
Zr 95	1.18E6	3.77E5	2.55E5	--	5.92E5	--	1.20E9
Nb 95	3.55E5	1.98E5	1.06E5	--	1.95E5	--	1.20E9
Mo 99	--	6.14E6	1.17E6	--	1.39E7	--	1.42E7
I 131	4.04E7	5.78E7	3.31E7	1.90E10	9.91E7	--	1.53E7
I 133	1.00E6	1.74E6	5.30E5	2.56E8	3.03E6	--	1.56E6
Cs 134	4.67E9	1.11E10	9.08E9	--	3.59E9	1.19E9	1.94E8
Cs 137	6.36E9	8.70E9	5.70E9	--	2.95E9	9.81E8	1.68E8
Ba 140	1.29E8	1.61E5	8.42E6	--	5.49E4	9.25E4	2.65E8
La 140	1.98E3	9.97E2	2.63E2	--	--	--	7.32E7
Ce 141	1.97E5	1.33E5	1.51E4	--	6.19E4	--	5.09E8
Ce 144	3.29E7	1.38E7	1.77E6	--	8.16E6	--	1.11E10
Nd 147	3.36E4	3.88E4	2.32E3	--	2.27E4	--	1.86E8
Ag 110m	1.05E7	9.75E6	5.79E6	--	1.92E7	--	3.98E9

\*mrem/yr per  $\mu\text{Ci/m}^3$



**TABLE 3-23**  
**DISPERSION PARAMETERS AT CONTROLLING LOCATIONS<sup>1</sup>**  
**X/Q, W<sub>v</sub> and W<sub>g</sub> VALUES**

<u>VENT</u>	<u>DIRECTION</u>	<u>DISTANCE (m)</u>	<u>X/Q (sec/m<sup>3</sup>)</u>	<u>D/Q (m<sup>-2</sup>)</u>
Site Boundary <sup>2</sup>	E	1,600	2.00 E-6	2.10E-9
Inhalation and Ground Plane	E (104°)	1,800	1.42E-7	2.90E-9
Cow Milk	ESE (130°)	4,300	4.11E-8	4.73E-10
Goat Milk <sup>3</sup>	SE (140°)	4,800	3.56E-08	5.32E-10
Meat Animal	E (114°)	2,600	1.17E-7	1.86E-9
Vegetation	E (96°)	2,900	1.04E-7	1.50E-9
<u>STACK</u>				
Site Boundary <sup>2</sup>	E	1,600	4.50E-8	6.00E-9
Inhalation and Ground Plane	E (109°)	1,700	8.48E-9	1.34E-9
Cow Milk	ESE (135°)	4,200	1.05E-8	3.64E-10
Goat Milk <sup>3</sup>	SE (140°)	4,800	2.90E-08	5.71E-10
Meat Animal	E (114°)	2,500	1.13E-8	1.15E-9
Vegetation	E (96°)	2,800	1.38E-8	9.42E-10

NOTE: Inhalation and Ground Plane are annual average values. Others are grazing season only.

<sup>1</sup> X/Q and D/Q values from NMP-2 ER-OLS.

<sup>2</sup> X/Q and D/Q from NMP-2 FES, NUREG-1085, May 1985, Table D-2.

<sup>3</sup> X/Q and D/Q from C.T. Main Data Report dated November 1985.



**TABLE 3-24**  
**PARAMETERS FOR THE EVALUATION OF DOSES TO REAL MEMBERS**  
**OF THE PUBLIC FROM GASEOUS AND LIQUID EFFLUENTS**

<u>Pathway</u>	<u>Parameter</u>	<u>Value</u>	<u>Reference</u>
Fish	U (kg/yr) - adult	21	Reg. Guide 1.109 Table E-5
Fish	D <sub>aipj</sub> (mrem/pCi)	Each Radionuclide	Reg. Guide 1.109 Table E-11
Shoreline	U (hr/yr)		
	- adult	67	Reg. Guide 1.109
	- teen	67	Assumed to be Same as Adult
Shoreline	D <sub>aipj</sub> (mrem/hr per pCi/m <sup>2</sup> )	Each Radionuclide	Reg. Guide 1.109 Table E-6
Inhalation	DFA <sub>ija</sub>	Each Radionuclide	Reg. Guide 1.109 Table E-7



**TABLE 5.1**  
**NINE MILE POINT NUCLEAR STATION**  
**RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM**  
**SAMPLING LOCATIONS**

<u>Type of Sample</u>	<u>* Map Location</u>	<u>Collection Site (Env. Program No.)</u>	<u>Location</u>
Radioiodine and Particulates (air)	1	Nine Mile Point Road North (R-1)	1.8 mi @ 88° E
Radioiodine and Particulates (air)	2	County Route 29 & Lake Road (R-2)	1.1 mi @ 104° ESE
Radioiodine and Particulates (air)	3	County Route 29 (R-3)	1.5 mi @ 132° SE
Radioiodine and Particulates (air)	4	Village of Lycoming, NY (R-4)	1.8 mi @ 143° SE
Radioiodine and Particulates (air)	5	Montario Point Road (R-5)	16.4 mi @ 42° NE
Direct Radiation (TLD)	6	North Shoreline Area (75)	0.1 mi @ 5° N
Direct Radiation (TLD)	7	North Shoreline Area (76)	0.1 mi @ 25° NNE
Direct Radiation (TLD)	8	North Shoreline Area (77)	0.2 mi @ 45° NE
Direct Radiation (TLD)	9	North Shoreline Area (23)	0.8 mi @ 70° ENE
Direct Radiation (TLD)	10	JAF East Boundary (78)	1.0 mi @ 90° E
Direct Radiation (TLD)	11	Route 29 (79)	1.1 mi @ 115° SE
Direct Radiation (TLD)	12	Route 29 (80)	1.4 mi @ 133° SE
Direct Radiation (TLD)	13	Miner Road (81)	1.6 mi @ 159° SSE
Direct Radiation (TLD)	14	Miner Road (82)	1.6 mi @ 181° S
Direct Radiation (TLD)	15	Lakeview Road (83)	1.2 mi @ 200° SSW
Direct Radiation (TLD)	16	Lakeview Road (84)	1.1 mi @ 225° SW
Direct Radiation (TLD)	17	Site Meteorological Tower (7)	0.7 mi @ 250° WSW
Direct Radiation (TLD)	18	Energy Information Center (18)	0.4 mi @ 265° W
Direct Radiation (TLD)	19	North Shoreline (85)	0.2 mi @ 294° WNW

\* Map = See Figures 5.1-1 and 5.1-2.



**TABLE 5.1 (Cont'd)**  
**NINE MILE POINT NUCLEAR STATION**  
**RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM**  
**SAMPLING LOCATIONS**

<u>Type of Sample</u>	<u>* Map Location</u>	<u>Collection Site (Env. Program No.)</u>	<u>Location</u>
Direct Radiation (TLD)	20	North Shoreline (86)	0.1 mi @ 315° NW
Direct Radiation (TLD)	21	North Shoreline (87)	0.1 mi @ 341° NNW
Direct Radiation (TLD)	22	Hickory Grove (88)	4.5 mi @ 97° E
Direct Radiation (TLD)	23	Leavitt Road (89)	4.1 mi @ 111° ESE
Direct Radiation (TLD)	24	Route 104 (90)	4.2 mi @ 135° SE
Direct Radiation (TLD)	25	Route 51A (91)	4.8 mi @ 156° SSE
Direct Radiation (TLD)	26	Maiden Lane Road (92)	4.4 mi @ 183° S
Direct Radiation (TLD)	27	County Route 53 (93)	4.4 mi @ 205° SSW
Direct Radiation (TLD)	28	County Route 1 (94)	4.7 mi @ 223° SW
Direct Radiation (TLD)	29	Lake Shoreline (95)	4.1 mi @ 237° WSW
Direct Radiation (TLD)	30	Phoenix, NY Control (49)	19.8 mi @ 163° S
Direct Radiation (TLD)	31	S. W. Oswego, Control (14)	12.6 mi @ 226° SW
Direct Radiation (TLD)	32	Scriba, NY (96)	3.6 mi @ 199° SSW
Direct Radiation (TLD)	33	Alcan Aluminum, Route 1A (58)	3.1 mi @ 220° SW
Direct Radiation (TLD)	34	Lycoming, NY (97)	1.8 mi @ 143° SE
Direct Radiation (TLD)	35	New Haven, NY (56)	5.3 mi @ 123° ESE
Direct Radiation (TLD)	36	W. Boundary, Bible Camp (15)	0.9 mi @ 237° WSW
Direct Radiation (TLD)	37	Lake Road (98)	1.2 mi @ 101° E

\* Map = See Figures 5.1-1 and 5.1-2.



**TABLE 5.1 (Cont'd)**  
**NINE MILE POINT NUCLEAR STATION**  
**RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM**  
**SAMPLING LOCATIONS**

<u>Type of Sample</u>	<u>* Map Location</u>	<u>Collection Site (Env. Program No.)</u>	<u>Location</u>
Surface Water	38	OSS Inlet Canal (NA)	7.6 mi @ 235° SW
Surface Water	39	JAFNPP Inlet Canal (NA)	0.5 mi @ 70° ENE
Shoreline Sediment	40	Sunset Bay Shoreline (NA)	1.5 mi @ 80° E
Fish	41	NMP Site Discharge Area (NA)	0.3 mi @ 315° NW (and/or)
Fish	42	NMP Site Discharge Area (NA)	0.6 mi @ 55° NE
Fish	43	Oswego Harbor Area (NA)	6.2 mi @ 235° SW
Milk	44	Milk Location #50	8.2 mi @ 93° E
Milk	45	Milk Location #7	5.5 mi @ 107° ESE
Milk	★ 47	Milk Location #65	17.0 mi @ 220° SW
Milk	64	Milk Location #55	9.0 mi @ 95° E
Milk	65	Milk Location #60	9.5 mi @ 90° E
Milk	66	Milk Location #4	7.8 mi @ 113° ESE
Milk (CR)	73	Milk Location (Woodworth)	13.9 mi @ 234° SW
Food Product	48	Produce Location #6** (Bergenstock) (NA)	1.9 mi @ 141° SE
Food Product	49	Produce Location #1** (Culeton) (NA)	1.7 mi @ 96° E
Food Product	50	Produce Location #2** (Vitullo) (NA)	1.9 mi @ 101° E
Food Product	51	Produce Location #5** (C.S. Parkhurst) (NA)	1.5 mi @ 114° ESE
Food Product	52	Produce Location #3** (C. Narewski) (NA)	1.6 mi @ 84° E

★ = The Jones milk location has been deleted due to the herd being sold.  
 (Map location #46.)

\* Map = See Figures 5.1-1 and 5.1-2.

\*\* = Food Product Samples need not necessarily be collected from all listed locations. Collected samples will be of the highest calculated site average D/Q.

(NA) = Not applicable.

CR = Control Result (location).



**TABLE 5.1 (Cont'd)**  
**NINE MILE POINT NUCLEAR STATION**  
**RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM**  
**SAMPLING LOCATIONS**

<u>Type of Sample</u>	<u>* Map Location</u>	<u>Collection Site (Env. Program No.)</u>	<u>Location</u>
Food Product	53	Produce Location #4** (P. Parkhurst) (NA)	2.1 mi @ 110° ESE
Food Product (CR)	54	Produce Location #7** (Mc Millen) (NA)	15.0 mi @ 223° SW
Food Product (CR)	55	Produce Location #8** (Denman) (NA)	12.6 mi @ 225° SW
Food Product	56	Produce Location #9** (O'Connor) (NA)	1.6 mi @ 171° S
Food Product	57	Produce Location #10** (C. Lawton) (NA)	2.2 mi @ 123° ESE
Food Product	58	Produce Location #11** (C. R. Parkhurst) (NA)	2.0 mi @ 112° ESE
Food Product	59	Produce Location #12** (Barton) (NA)	1.9 mi @ 115° ESE
Food Product (CR)	60	Produce Location #13** (Flack) (NA)	15.6 mi @ 225° W
Food Product	61	Produce Location #14** (Koenke) (NA)	1.9 mi @ 95° E
Food Product	62	Produce Location #15** (Whaley) (NA)	1.7 mi @ 136° SE
Food Product	63	Produce Location #16** (Murray) (NA)	1.2 mi @ 207° SSW
Food Product	67	Produce Location #17** (Battles) (NA)	1.76 mi @ 97° E

\* Map = See Figures 5.1-1 and 5.1-2.

\*\* = Food Product Samples need not necessarily be collected from all listed locations. Collected samples will be of the highest calculated site average D/Q.

(NA) = Not applicable.

CR = Control Result (location).



## **APPENDIX A**

### **LIQUID DOSE FACTOR DERIVATION**

---



## Appendix A

### Liquid Effluent Dose Factor Derivation, $A_{iat}$

$A_{iat}$  (mrem/hr per uCi/ml) which embodies the dose conversion factors, pathway transfer factors (e.g., bioaccumulation factors), pathway usage factors, and dilution factors for the points of pathway origin takes into account the dose from ingestion of fish and drinking water and the sediment. The total body and organ dose conversion factors for each radionuclide will be used from Table E-11 of Regulatory Guide 1.109. To expedite time, the dose is calculated for a maximum individual instead of each age group. The maximum individual dose factor is a composite of the highest dose factor  $A_{iat}$  of each nuclide  $i$  age group  $a$ , and organ  $t$ , hence  $A_{iat}$ . It should be noted that the fish ingestion pathway is the most significant pathway for dose from liquid effluents. The water consumption pathway is included for consistency with NUREG 0133.

The equation for calculating dose contributions given in section 1.3 requires the use of the composite dose factor  $A_{it}$  for each nuclide,  $i$ . The dose factor equation for a fresh water site is:

$$A_{iat} = K_o \left[ \frac{U_w (e^{-\lambda_i t_{pw}})}{D_w} + U_f (BF)_i (e^{-\lambda_i t_{pf}}) (DFL)_{iat} + \dots \right. \\ \left. \dots + \frac{69.3 U_s W}{(D_s) (\lambda_i)} e^{-\lambda_i t_{ps}} (1 - e^{-\lambda_i t_b}) (DFS)_i \right]$$

Where:

- $A_{iat}$  = Is the dose factor for nuclide  $i$ , age group  $a$ , total body or organ  $t$ , for all appropriate pathways, (mrem/hr per uCi/ml)
- $K_o$  = Is the unit conversion factor,  $1.14E5 = 1E6 \text{ pCi/uCi} \times 1E3 \text{ ml/kg} \therefore 8760 \text{ hr/yr}$
- $U_w$  = Water consumption (l/yr); from Table E-5 of Reg. Guide 1.109
- $U_f$  = Fish consumption (Kg/yr); from Table E-5 of Reg. Guide 1.109
- $U_s$  = Sediment Shoreline Usage (hr/yr); from Table E-5 of Reg. Guide 1.109
- $(BF)_i$  = Bioaccumulation factor for nuclide,  $i$ , in fish, (pCi/kg per pCi/l), from Table A-1 of Reg. Guide 1.109
- $(DFL)_{iat}$  = Dose conversion factor for age, nuclide,  $i$ , group  $a$ , total body or organ  $t$ , (mrem/pCi); from Table E-11 of Reg. Guide 1.109
- $(DFS)_i$  = Dose conversion factor for nuclide  $i$  and total body, from standing on contaminated ground (mem/hr per pCi/m<sup>2</sup>); from Table E-6 of Reg. Guide 1.109
- $D_w$  = Dilution factor from the near field area within one-quarter mile of the release point to the potable water intake for the adult water consumption. This is the Metropolitan Water Board, Onondaga County intake structure located west of the City of Oswego. (Unitless)
- $D_s$  = Dilution factor from the near field area within one quarter mile of the release point to the shoreline deposit (taken at the same point where we take environmental samples 1.5 miles; unitless)



## Appendix A (Cont'd)

- 69.3 = conversion factor  $.693 \times 100, 100 = K_c (L/kg\text{-hr}) \times 40 \times 24 \text{ hr/day} / .693$  in  $L/m^2\text{-d}$ , and  $K_c$  = transfer coefficient from water to sediment in  $L/kg$  per hour.
- $t_{pw}, t_{pf}, t_{ps}$  = Average transit time required for each nuclide to reach the point of exposure for internal dose, it is the total time elapsed from release of the nuclides to either ingestion for water (w) and fish (f) or shoreline deposit (s), (hr)
- $t_b$  = Length of time the sediment is exposed to the contaminated water, nominally 15 yrs (approximate midpoint of facility operating life), (hrs).
- $\lambda_i$  = decay constant for nuclide i ( $hr^{-1}$ )
- W = Shore width factor (unitless) from Table A-2 of Reg. Guide 1.109

### Example Calculation

For I-131 Thyroid Dose Factor for an Adult from a Radwaste liquid effluents release:

$(DFS)_i$	=	2.80E-9 mrem/hr per pCi/m <sup>2</sup>	$t_{pw}$	=	40 hrs. (w = water)
$(DFL)_{iat}$	=	1.95E-3 mrem/pCi	$t_{pf}$	=	24 hrs. (f = fish)
$BF_i$	=	15 pCi/Kg per pCi/L	$t_b$	=	1.314E5 hr (5.48E3 days)
$U_f$	=	21 Kg/yr	$U_w$	=	730 L/yr
$D_w$	=	62 unitless	$K_o$	=	1.14E5 $\frac{(pCi/uCi)(ml/kg)}{(hr/yr)}$
$D_s$	=	17.8 unitless	$\lambda_i$	=	3.61E-3 $hr^{-1}$
$U_s$	=	12 hr/yr			
W	=	0.3			
$t_{ps}$	=	7.3 hrs (s=Shoreline Sediment)			

These values will yield an  $A_{iat}$  Factor of 6.65E4 mrem-ml per uCi-hr as listed in Table 2-2. It should be noted that only a limited number of nuclides are listed on Tables 2-2 to 2-5. These are the most common nuclides encountered in effluents. If a nuclide is detected for which a factor is not listed, then it will be calculated and included in a revision to the ODCM.

In addition, not all dose factors are used for the dose calculations. A maximum individual is used, which is a composite of the maximum dose factor of each age group for each organ as reflected in the applicable chemistry procedures.



## **APPENDIX B**

### **PLUME SHINE DOSE FACTOR DERIVATION**

---



## Appendix B

For elevated releases the plume shine dose factors for gamma air ( $B_i$ ) and whole body ( $V_i$ ), are calculated using the finite plume model with an elevation above ground equal to the stack height. To calculate the plume shine factor for gamma whole body doses, the gamma air dose factor is adjusted for the attenuation of tissue, and the ratio of mass absorption coefficients between tissue and air. The equations are as follows:

### Gamma Air

$$\frac{B_i}{s} = \sum_s \frac{K^1 \mu_a E I_s}{R \Theta V_s}$$

- Where:
- $K^1$  = conversion factor (see below for actual value).
  - $\mu_a$  = mass absorption coefficient ( $\text{cm}^2/\text{g}$ ; air for  $B_i$ , tissue for  $V_i$ )
  - $E$  = Energy of gamma ray per disintegration (Mev)
  - $V_s$  = average wind speed for each stability class ( $\text{s}$ ),  $\text{m/s}$
  - $R$  = downwind distance (site boundary, m)
  - $\Theta$  = sector width (radians)
  - $s$  = subscript for stability class
  - $I_s$  = I function =  $I_1 + kI_2$  for each stability class. (unitless, see Regulatory Guide 1.109)
  - $k^2$  = Fraction of the attenuated energy that is actually absorbed in air (see Regulatory Guide 1.109, see below for equation)

### Whole Body

$$V_i = 1.11 S_F B_i e^{-\mu_a t_d}$$

- Where:
- $t_d$  = tissue depth ( $\text{g}/\text{cm}^2$ )
  - $S_F$  = shielding factor from structures (unitless)
  - 1.11 = Ratio of mass absorption coefficients between tissue and air.

Where all other parameters are defined above.

$$^1K = \text{conversion factor} = \frac{3.7 \text{ E10 } \frac{\text{dis}}{\text{Ci-sec}}}{1293 \frac{\text{g}}{\text{m}^3}} \cdot \frac{1.6 \text{ E-6 } \frac{\text{erg}}{\text{Mev}}}{100 \frac{\text{erg}}{\text{g-rad}}} = .46$$

$$^2k = \frac{\mu - \mu_a}{\mu_a}$$

- Where:
- $\mu$  = mass attenuation coefficient ( $\text{cm}^2/\text{g}$ ; air for  $B_i$ , tissue for  $V_i$ )
  - $\mu_a$  = defined above



## Appendix B (Cont'd)

There are seven stability classes, A thru F. The percentage of the year that each stability class is taken from the U-2 FSAR. From this data, a plume shine dose factor is calculated for each stability class and each nuclide, multiplied by its respective fraction and then summed.

The wind speeds corresponding to each stability class are, also, taken from the U-2 FSAR. To confirm the accuracy of these values, an average of the 12 month wind speeds for 1985, 1986, 1987 and 1988 was compared to the average of the FSAR values. The average wind speed of the actual data is equal to 6.78 m/s, which compared favorably to the FSAR average wind speed equal to 6.77 m/s.

The average gamma energies were calculated using a weighted average of all gamma energies emitted from the nuclide. These energies were taken from the handbook "Radioactive Decay Data Tables", David C. Kocher.

The mass absorption ( $\mu_a$ ) and attenuation ( $\mu$ ) coefficients were calculated by multiplying the mass absorption ( $\mu_a/\rho$ ) and mass attenuation ( $\mu/\rho$ ) coefficients given in the Radiation Health Handbook by the air density equal to 1.293 E-3 g/cc or the tissue density of 1 g/cc where applicable. The tissue depth is 5g/cm<sup>2</sup> for the whole body.

The downwind distance is the site boundary.



## Appendix B (Cont'd)

### SAMPLE CALCULATION

Ex. Kr-89      F STABILITY CLASS ONLY - Gamma Air

#### -DATA

$$\begin{aligned}
 E &= 2.22 \text{ MeV} & k &= \mu - \mu_a = .871 & K &= .46 \\
 \mu_a &= 2.943 \text{ E-}3 \text{ m}^{-1} & & & & V_F = 5.55 \text{ m/sec} \\
 \mu &= 5.5064 \text{ E-}3 \text{ m}^{-1} & R &= 1600 \text{ m} & & \\
 \Theta &= .39 & & & & \\
 \sigma_z &= 19 \text{ m} & \text{vertical plume spread taken from "Introduction to Nuclear Engineering", John R. LaMarsh} & & &
 \end{aligned}$$

#### -I Function

$$\begin{aligned}
 U_{\sigma_z} &= .11 \\
 I_1 &= .3 \\
 I_2 &= .4 \\
 I &= I_1 + kI_2 = .3 + (.871)(.4) = .65
 \end{aligned}$$

$$\begin{aligned}
 B_i &= \frac{0.46 \left[ \frac{\text{dis.}}{\text{Ci-sec}} \frac{(\text{Mev/ergs})}{(\text{g-m}^3)} \right] \frac{(2.943 \text{ E-}3 \text{ m}^{-1}) (2.22 \text{ Mev}) (.65)}{(5.55 \text{ m/s}) (.39) (1600 \text{ m})}}{(\pi^{1/2}) \frac{(\text{ergs})}{(\text{g-rad})}} \\
 &= 3.18(-7) \frac{\text{rad/s} (3600 \text{ s/hr}) (24 \text{ h/d}) (365 \text{ d/y}) (1 \text{ E}3 \text{ mrad/rad})}{\text{Ci/s} \frac{(1 \text{ E}6 \text{ uCi})}{\text{Ci}}} \\
 &= 1.00(-2) \frac{\text{mrad/yr}}{\text{uCi/sec}} \\
 V_i &= 1.11 (.7) (1 \text{ E-}2) \frac{\text{mrad/yr}}{\mu\text{Ci/sec}} \left[ e^{-(.0253 \text{ cm}^2/\text{g}) (5 \text{ g/cm}^2)} \right] \\
 &= 6.85(-3) \frac{\text{mrad/yr}}{\mu\text{Ci/sec}}
 \end{aligned}$$

Note: The above calculation is for the F stability class only. For Table 3-2 and procedure values, a weighted fraction of each stability class was used to determine the  $B_i$  and  $V_i$  values.



**APPENDIX C**

**DOSE PARAMETERS FOR IODINE 131 and 133,**

**PARTICULATES AND TRITIUM**

---



## Appendix C

### DOSE PARAMETERS FOR IODINE - 131 AND - 133, PARTICULATES AND TRITIUM

This appendix contains the methodology which was used to calculate the organ dose factors for I-131, I-133, particulates, and tritium. The dose factor,  $R_i$ , was calculated using the methodology outlined in NUREG-0133. The radioiodine and particulate Radiological Controls (Section 3.11.2) is applicable to the location in the unrestricted area where the combination of existing pathways and receptor age groups indicates the maximum potential exposure occurs, i.e., the critical receptor. Washout was calculated and determined to be negligible.  $R_i$  values have been calculated for the adult, teen, child and infant age groups for all pathways. However, for dose compliance calculations, a maximum individual is assumed that is a composite of highest dose factor of each age group for each organ and pathway. The methodology used to calculate these values follows:

#### C.1 Inhalation Pathway

$$R_i(I) = K'(BR)_a(DFA)_{ija}$$

where:

$R_i(I)$  = dose factor for each identified radionuclide  $i$  of the organ of interest (units = mrem/yr per uCi/m<sup>3</sup>);

$K'$  = a constant of unit conversion, 1E6 pCi/uCi

$(BR)_a$  = Breathing rate of the receptor of age group  $a$ , (units = m<sup>3</sup>/yr);

$(DFA)_{ija}$  = The inhalation dose factor for nuclide  $i$ , organ  $j$  and age group  $a$ , and organ  $t$  (units = mrem/pCi).

The breathing rates  $(BR)_a$  for the various age groups, as given in Table E-5 of Regulatory Guide 1.109 Revision 1, are tabulated below.

<u>Age Group (a)</u>	<u>Breathing Rate (m<sup>3</sup>/yr)</u>
Infant	1400
Child	3700
Teen	8000
Adult	8000

Inhalation dose factors  $(DFA)_{ija}$  for the various age groups are given in Tables E-7 through E-10 of Regulatory Guide 1.109 Revision 1.



## Appendix C (Cont'd)

### C.2 Ground Plane Pathway

$$R_i(G) = \frac{K' K'' (SF) (DFG)_i (1 - e^{-\lambda_i t})}{\lambda_i}$$

Where:

$R_i(G)$	=	Dose factor for the ground plane pathway for each identified radionuclide i for the organ of interest (units = m <sup>2</sup> -mrem/yr per uCi/sec)
$K'$	=	A constant of unit conversion, 1E6 pCi/uCi
$K''$	=	A constant of unit conversion, 8760 hr/year
$\lambda_i$	=	The radiological decay constant for radionuclide i, (units = sec <sup>-1</sup> )
$t$	=	The exposure time, sec, 4.73E8 sec (15 years)
$(DFG)_i$	=	The ground plane dose conversion factor for radionuclide i; (units = mrem/hr per pCi/m <sup>2</sup> )
SF	=	The shielding factor (dimensionless)

A shielding factor of 0.7 is discussed in Table E-15 of Regulatory Guide 1.109 Revision 1. A tabulation of  $DFG_i$  values is presented in Table E-6 of Regulatory Guide 1.109 Revision 1.



## Appendix C (Cont'd)

### C.3 Grass-(Cow or Goat)-Milk Pathway

$$R_i(C) = \frac{K' Q_f (U_{ap}) F_m(r) (DFL)_{iat}}{(\lambda_i + \lambda_w)} \left[ \frac{f_p f_s}{Y_p} + \frac{(1 - f_p f_s)}{Y_s} (e^{-\lambda_i t_h}) e^{-\lambda_i t_f} \right]$$

Where:

- $R_i(C)$  = Dose factor for the cow milk or goat milk pathway, for each identified radionuclide i for the organ of interest, (units = m2-mrem/yr per uCi/sec)
- $K'$  = A constant of unit conversion, 1E6 pCi/uCi
- $Q_f$  = The cow's or goat's feed consumption rate, (units = Kg/day-wet weight)
- $U_{ap}$  = The receptor's milk consumption rate for age group a, (units = liters/yr)
- $Y_p$  = The agricultural productivity by unit area of pasture feed grass, (units = kg/m2)
- $Y_s$  = The agricultural productivity by unit area of stored feed, (units = kg/m2)
- $F_m$  = The stable element transfer coefficients, (units = pCi/liter per pCi/day)
- $r$  = Fraction of deposited activity retained on cow's feed grass
- $(DFL)_{iat}$  = The ingestion dose factor for nuclide i, age group a, and total body or organ t (units = mrem/pCi)
- $\lambda_i$  = The radiological decay constant for radionuclide i, (units = sec<sup>-1</sup>)
- $\lambda_w$  = The decay constant for removal of activity on leaf and plant surfaces by weathering equal to 5.73E-7 sec<sup>-1</sup> (corresponding to a 14 day half-life)
- $t_f$  = The transport time from pasture to cow or goat, to milk, to receptor, (units = sec)
- $t_h$  = The transport time from pasture, to harvest, to cow or goat, to milk, to receptor (units = sec)



## Appendix C (Cont'd)

- $f_p$  = Fraction of the year that the cow or goat is on pasture (dimensionless)
- $f_s$  = Fraction of the cow feed that is pasture grass while the cow is on pasture (dimensionless)

Milk cattle and goats are considered to be fed from two potential sources, pasture grass and stored feeds. Following the development in Regulatory Guide 1.109 Revision 1, the value of  $f_s$  is considered unity in lieu of site specific information. The value of  $f_p$  is 0.5 based on 6 month grazing period. This value for  $f_p$  was obtained from the environmental group.

Table C-1 contains the appropriate values and their source in Regulatory Guide 1.109 Revision 1.

The concentration of tritium in milk is based on the airborne concentration rather than the deposition. Therefore, the  $R_T(C)$  is based on  $X/Q$ :

$$R_T(C) = K'K''' F_m Q_f U_{ap} (DFL)_{iat} 0.75(0.5/H)$$

Where:

- $R_T(C)$  = Dose factor for the cow or goat milk pathway for tritium for the organ of interest, (units = mrem/yr per uCi/m<sup>3</sup>)
- $K'''$  = A constant of unit conversion, 1E3 g/kg
- $H$  = Absolute humidity of the atmosphere, (units = g/m<sup>3</sup>)
- 0.75 = The fraction of total feed that is water
- 0.5 = The ratio of the specific activity of the feed grass water to the atmospheric water

Other values are given previously. A site specific value of  $H$  equal to 6.14 g/m<sup>3</sup> is used. This value was obtained from the environmental group using actual site data.



## Appendix C (Cont'd)

### C.4 Grass-Cow-Meat Pathway

$$R_i(C) = \frac{K' Q_f (U_{ap}) F_f(r) (DFL)_{iat}}{(\lambda_i + \lambda_w)} \left[ \frac{f_p f_s}{Y_p} + \frac{(1 - f_p f_s)}{Y_s} (e^{-\lambda_i t_h}) e^{-\lambda_i t_f} \right]$$

$R_i(M)$  = Dose factor for the meat ingestion pathway for radionuclide i for any organ of interest, (units = m<sup>2</sup>-mrem/yr per uCi/sec)

$F_f$  = The stable element transfer coefficients, (units = pCi/kg per pCi/day)

$U_{ap}$  = The receptor's meat consumption rate for age group a, (units = kg/year)

$t_h$  = The transport time from harvest, to cow, to receptor, (units = sec)

$t_f$  = The transport time from pasture, to cow, to receptor, (units = sec)

All other terms remain the same as defined for the milk pathway. Table C-2 contains the values which were used in calculating  $R_i(M)$ .

The concentration of tritium in meat is based on airborne concentration rather than deposition. Therefore, the  $R_T(M)$  is based on  $X/Q$ .

$$R_T(M) = K' K'' F_f Q_f U_{ap} (DFL)_{iat} [0.75(0.5/H)]$$

Where:

$R_T(M)$  = Dose factor for the meat ingestion pathway for tritium for any organ of interest, (units = mrem/yr per uCi/m<sup>3</sup>)

All other terms are defined above.

### C.5 Vegetation Pathway

The integrated concentration in vegetation consumed by man follows the expression developed for milk. Man is considered to consume two types of vegetation (fresh and stored) that differ only in the time period between harvest and consumption, therefore:

$$R_i(V) = K' \frac{r}{Y_v (\lambda_i + \lambda_w)} (DFL)_{iat} \left[ U_a^L F_L e^{-\lambda_i t_L} + U_a^S F_S e^{-\lambda_i t_h} \right]$$



## Appendix C (Cont'd)

Where:

- $R_i(V)$  = Dose factor for vegetable pathway for radionuclide  $i$  for the organ of interest, (units =  $m^2$ -mrem/yr per uCi/sec)
- $K'$  = A constant of unit conversion,  $1E6$  pCi/uCi
- $U_a^L$  = The consumption rate of fresh leafy vegetation by the receptor in age group  $a$ , (units = kg/yr)
- $U_a^S$  = The consumption rate of stored vegetation by the receptor in age group  $a$  (units = kg/yr)
- $F_L$  = The fraction of the annual intake of fresh leafy vegetation grown locally
- $F_g$  = The fraction of the annual intake of stored vegetation grown locally
- $t_L$  = The average time between harvest of leafy vegetation and its consumption, (units = sec)
- $t_h$  = The average time between harvest of stored vegetation and its consumption, (units = sec)
- $Y_v$  = The vegetation areal P density, (units = kg/ $m^2$ )

All other factors have been defined previously.

Table C-3 presents the appropriate parameter values and their source in Regulatory Guide 1.109 Revision 1.

In lieu of site-specific data, values for  $F_L$  and  $F_g$  of, 1.0 and 0.76, respectively, were used in the calculation. These values were obtained from Table E-15 of Regulatory Guide 1.109 Revision 1.

The concentration of tritium in vegetation is based on the airborne concentration rather than the deposition. Therefore, the  $R_T(V)$  is based on  $X/Q$ :

$$R_T(V) = K'K''' [U_a^L f_L + U_a^S f_g](DFL)_{iat} 0.75(0.5/H)$$

Where:

- $R_T(V)$  = dose factor for the vegetable pathway for tritium for any organ of interest, (units = mrem/yr per uCi/ $m^3$ ).

All other terms are defined in preceeding sections.



**TABLE C-1****Parameters for Grass - (Cow or Goat) - Milk Pathways**

<u>Parameter</u>	<u>Value</u>	<u>Reference</u> (Reg. Guide 1.109 Rev. 1)
$Q_f$ (kg/day)	50 (cow)	Table E-3
	6 (goat)	Table E-3
$r$	1.0 (radioiodines)	Table E-15
	0.2 (particulates)	Table E-15
$(DFL)_{ija}$ (mrem/pCi)	Each radionuclide	Tables E-11 to E-14
$F_m$ (pCi/liter per pCi/day)	Each stable element	Table E-1 (cow) Table E-2 (goat)
$Y_s$ (kg/m <sup>2</sup> )	2.0	Table E-15
$Y_p$ (kg/m <sup>2</sup> )	0.7	Table E-15
$t_h$ (seconds)	$7.78 \times 10^6$ (90 days)	Table E-15
$t_r$ (seconds)	$1.73 \times 10^5$ (2 days)	Table E-15
$U_{ap}$ (liters/yr)	330 infant	Table E-5
	330 child	Table E-5
	400 teen	Table E-5
	310 adult	Table E-5



**TABLE C-2****Parameters for the Grass-Cow-Meat Pathway**

<u>Parameter</u>	<u>Value</u>	<u>Reference</u> (Reg. Guide 1.109 Rev. 1)
r	1.0 (radioiodines)	Table E-15
	0.2 (particulates)	Table E-15
$F_f$ (pCi/Kg per pCi/day)	Each stable element	Table E-1
$U_{ap}$ (Kg/yr)	0 infant	Table E-5
	41 child	Table E-5
	65 teen	Table E-5
	110 adult	Table E-5
$(DFL)_{ija}$ (mrem/pCi)	Each radionuclide	Tables E-11 to E-14
$Y_p$ (kg/m <sup>2</sup> )	0.7	Table E-15
$Y_s$ (kg/m <sup>2</sup> )	2.0	Table E-15
$t_h$ (seconds)	7.78E6 (90 days)	Table E-15
$t_f$ (seconds)	1.73E6 (20 days)	Table E-15
$Q_f$ (kg/day)	50	Table E-3



## TABLE C-3

### Parameters for the Vegetable Pathway

<u>Parameter</u>	<u>Value</u>	<u>Reference</u> (Reg. Guide 1.109 Rev. 1)
r (dimensionless)	1.0 (radioiodines) 0.2 (particulates)	Table E-1 Table E-1
(DFL) <sub>ija</sub> (mrem/pCi)	Each radionuclide	Tables E-11 to E-14
U <sup>L</sup> <sub>a</sub> (kg/yr) - infant	0	Table E-5
- child	26	Table E-5
- teen	42	Table E-5
- adult	64	Table E-5
U <sup>S</sup> <sub>a</sub> (kg/yr) - infant	0	Table E-5
- child	520	Table E-5
- teen	630	Table E-5
- adult	520	Table E-5
t <sub>L</sub> (seconds)	8.6E4 (1 day)	Table E-15
t <sub>h</sub> (seconds)	5.18E6 (60 days)	Table E-15
Y <sub>v</sub> (kg/m <sup>2</sup> )	2.0	Table E-15



**APPENDIX D**

**DIAGRAMS OF LIQUID AND GASEOUS TREATMENT SYSTEMS  
AND  
MONITORING SYSTEMS**


---




## **Liquid Radwaste Treatment System Diagrams**

---




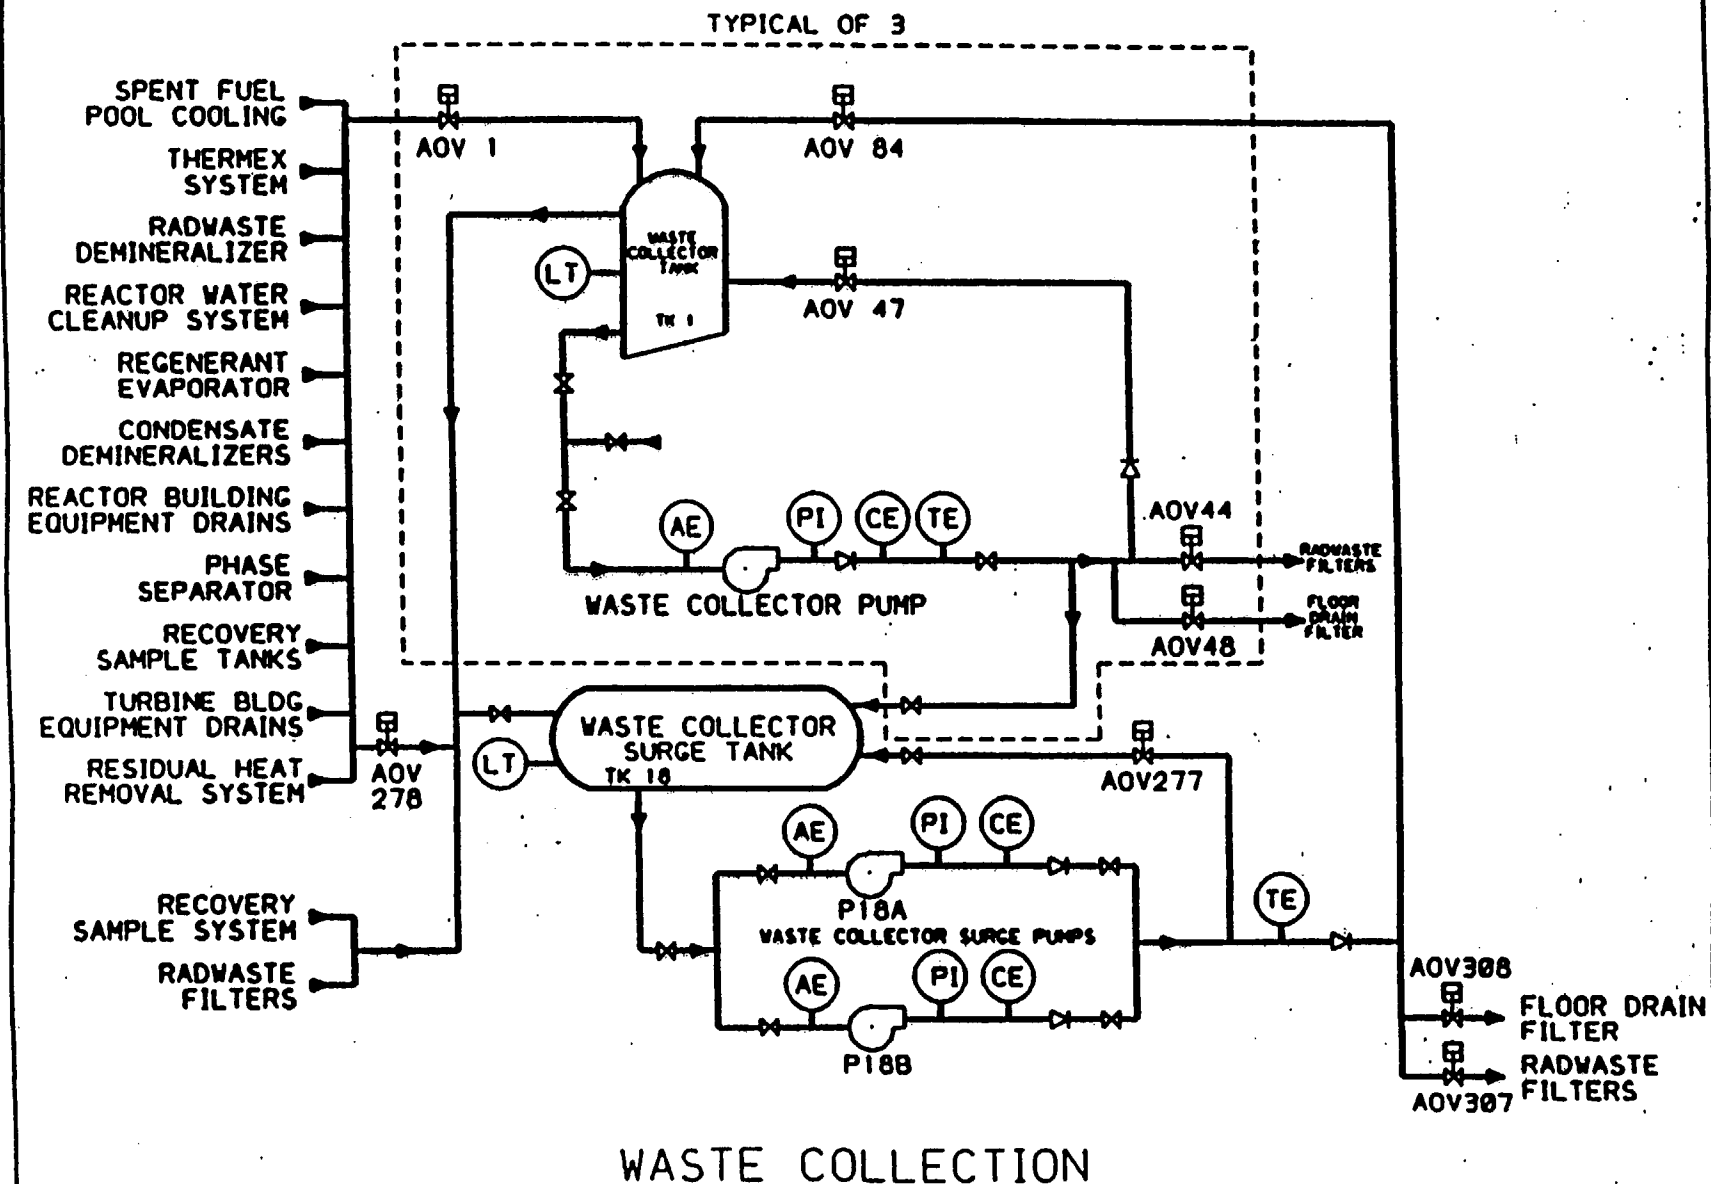



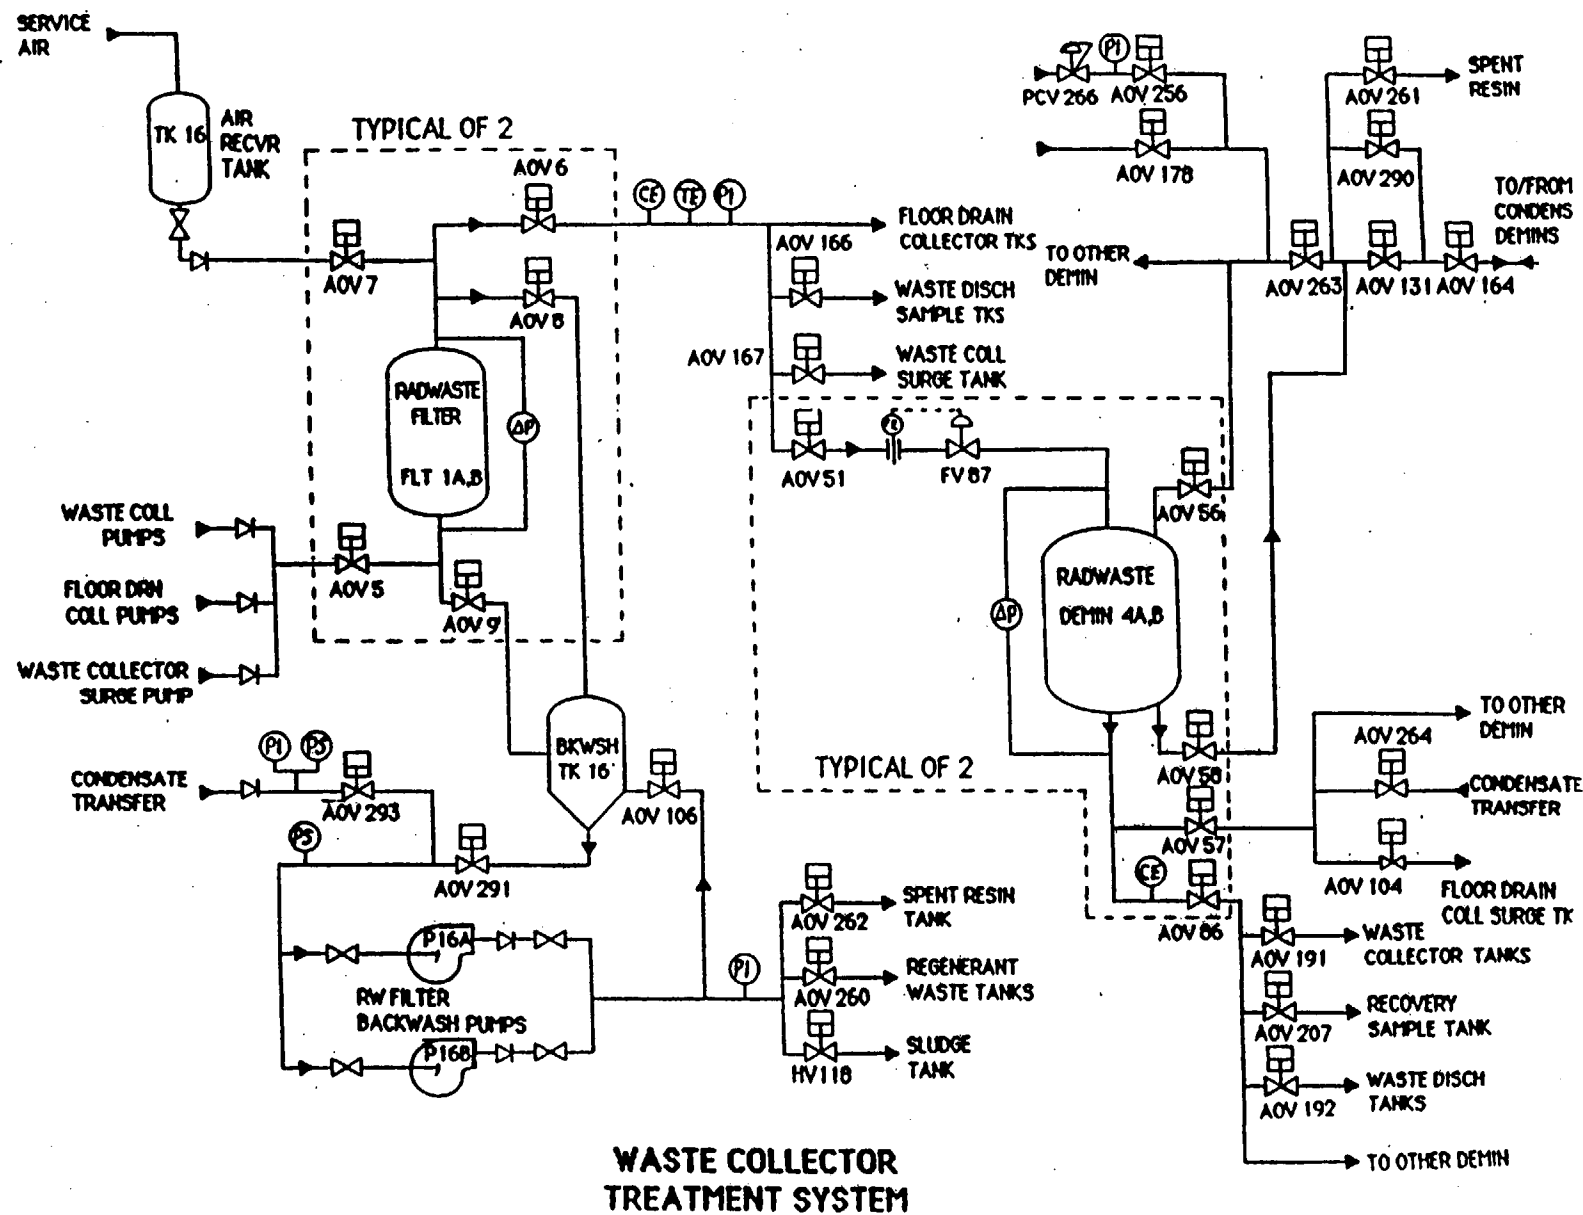




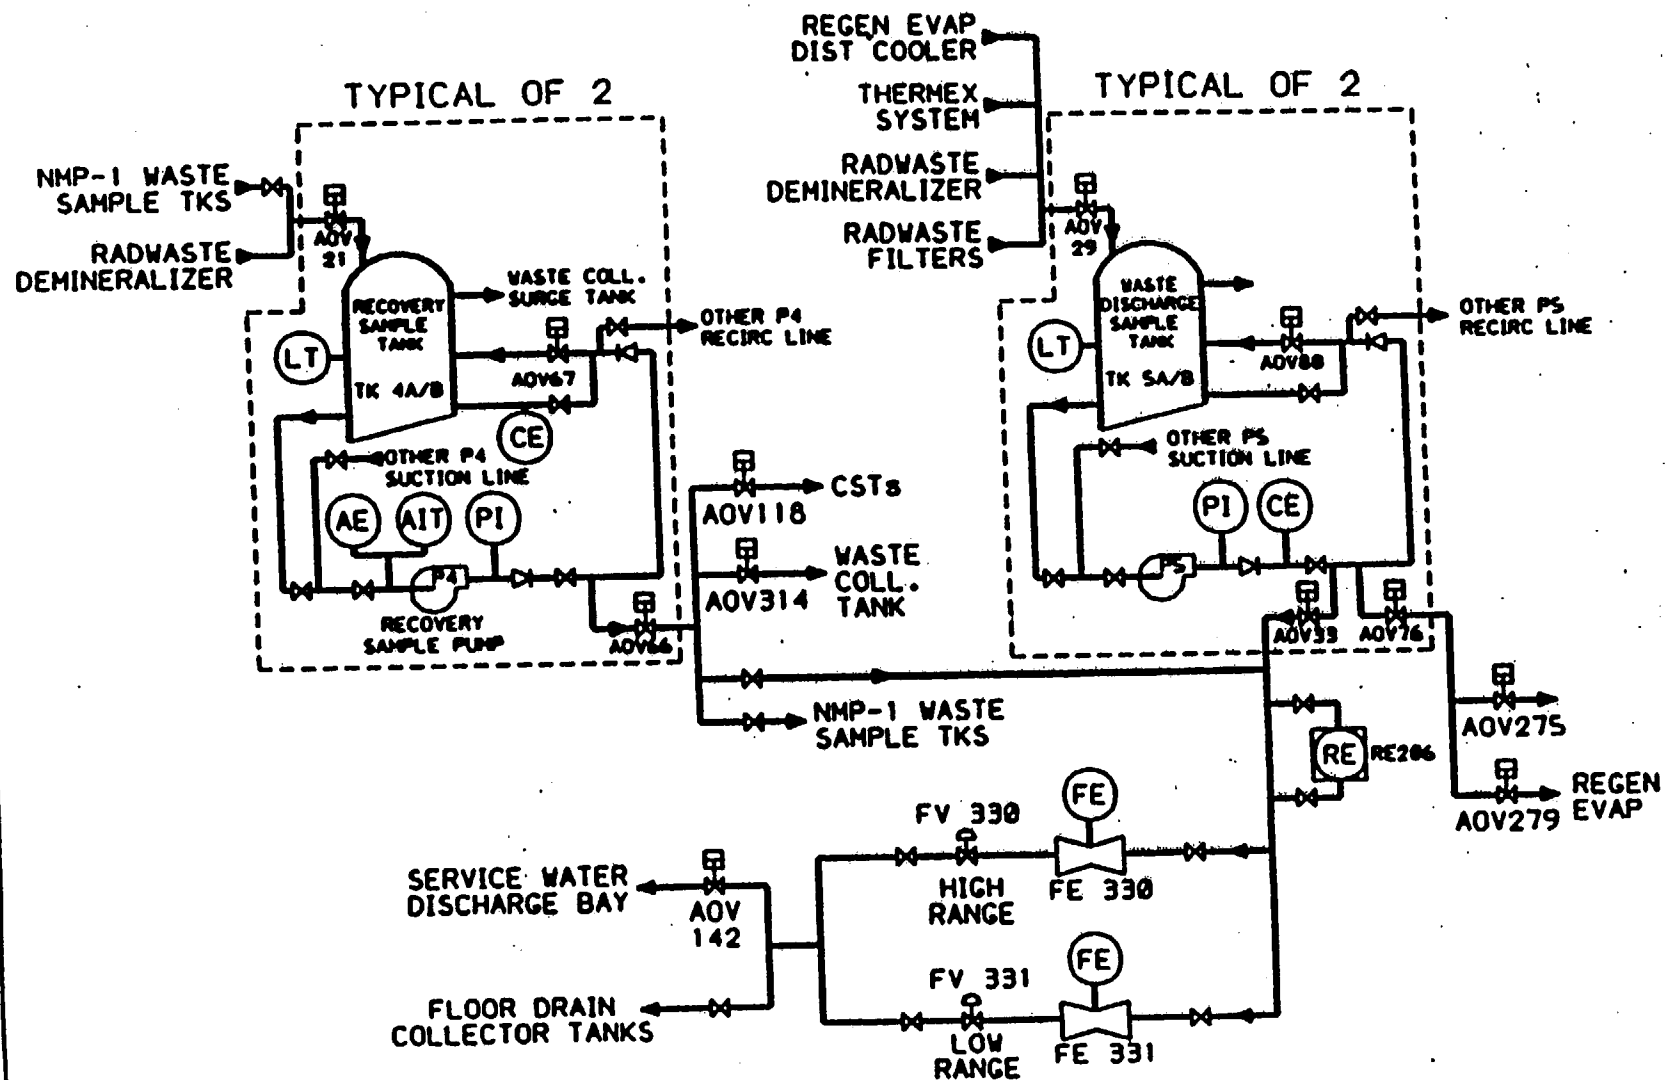


RECOVERY SAMPLE SYSTEM and  
WASTE DISCHARGE SAMPLE SYSTEM



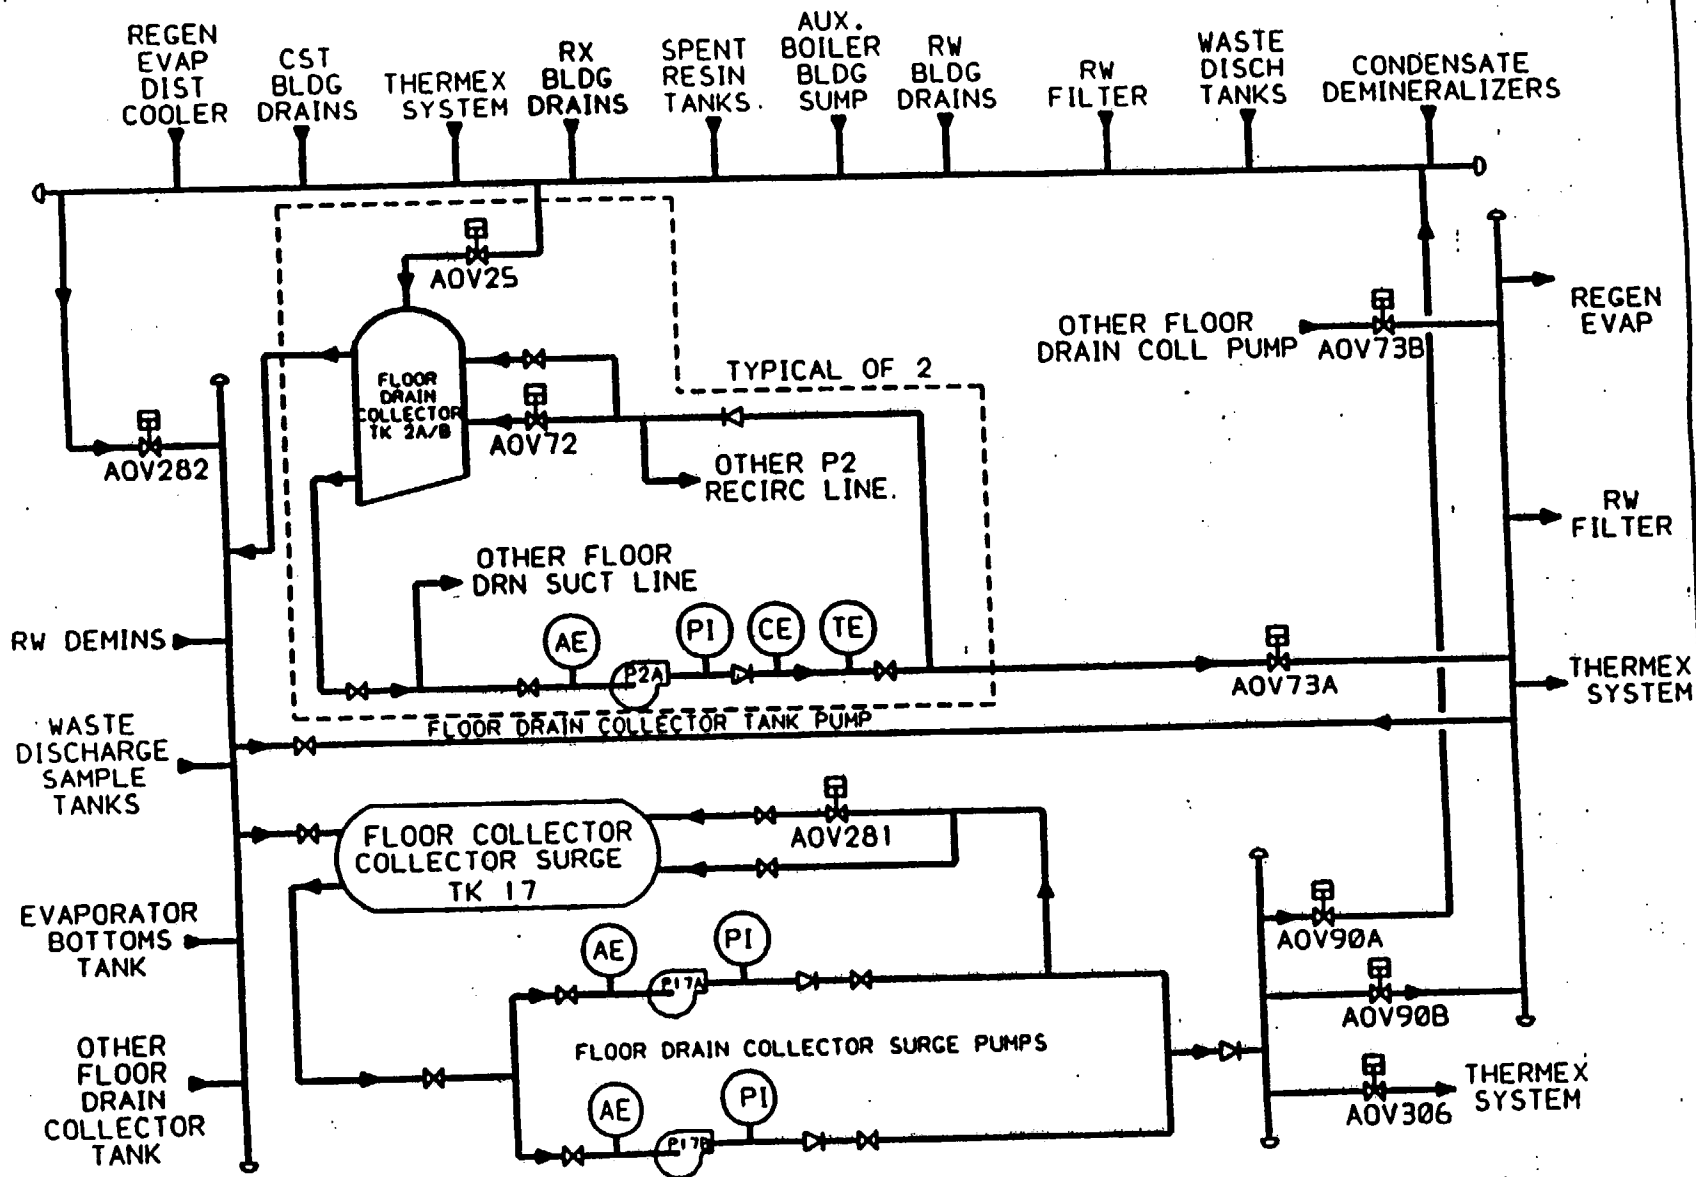


FLOOR DRAIN COLLECTION SYSTEM



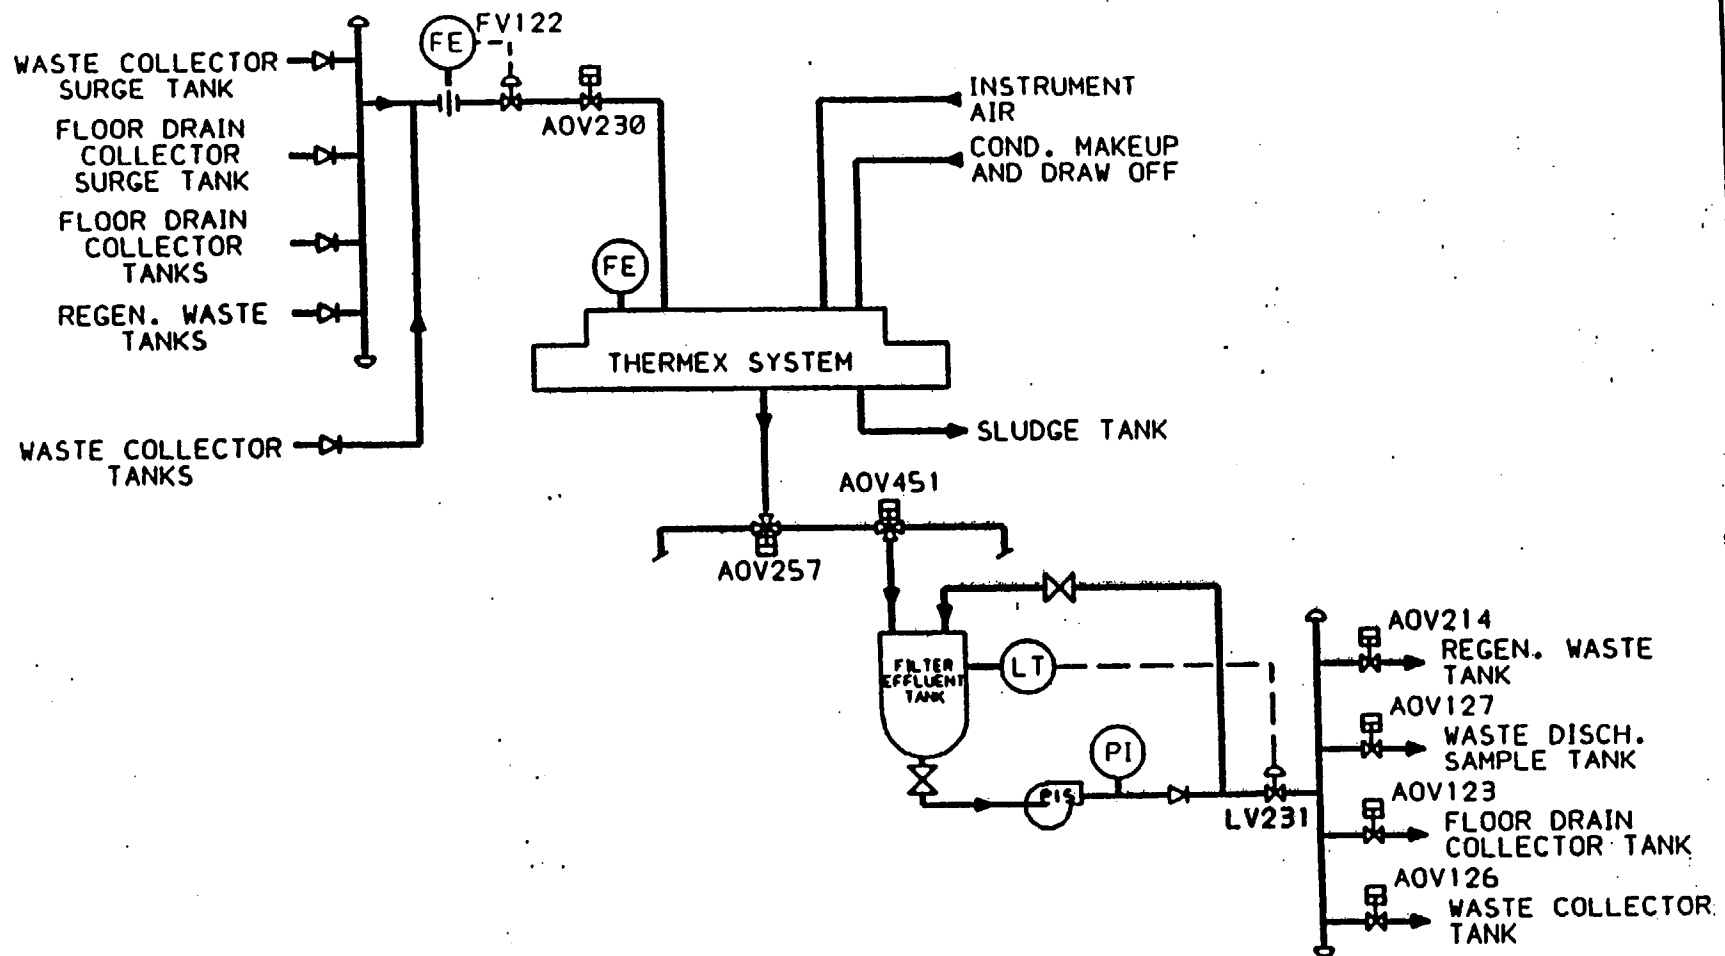


FLOOR DRAIN FILTER SYSTEM



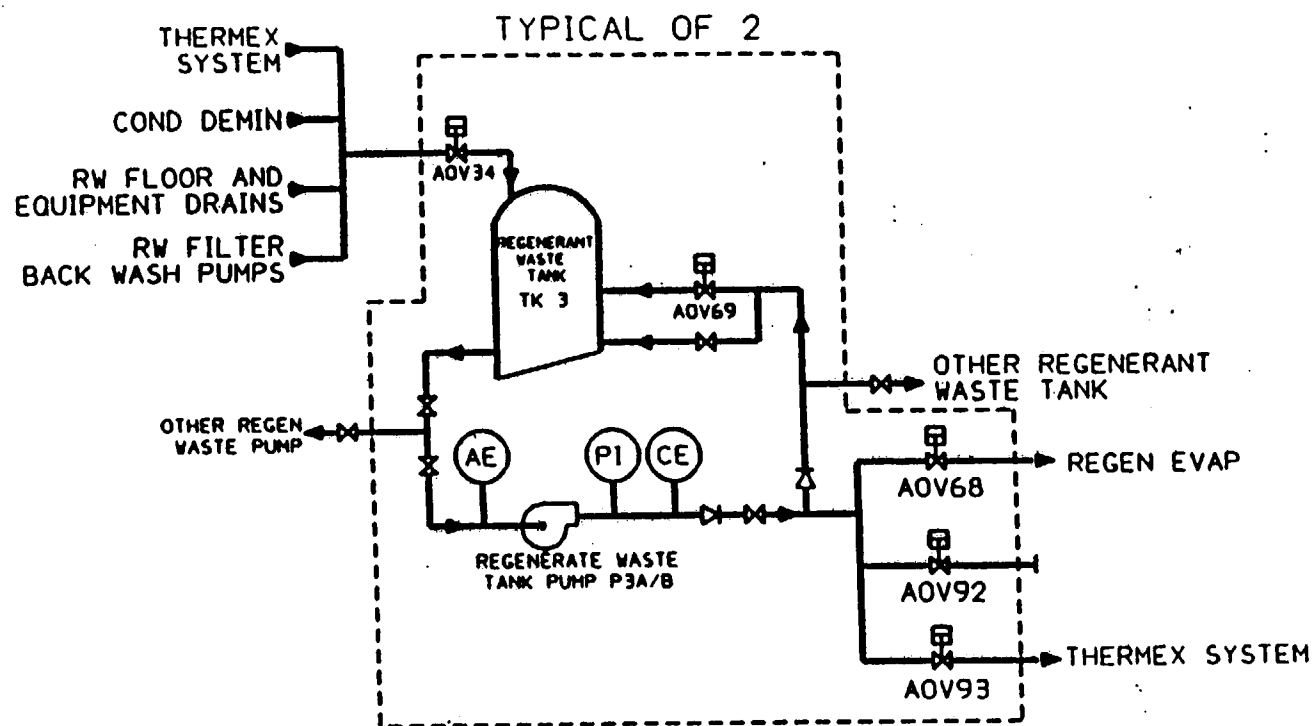

## REGENERANT WASTE SYSTEM



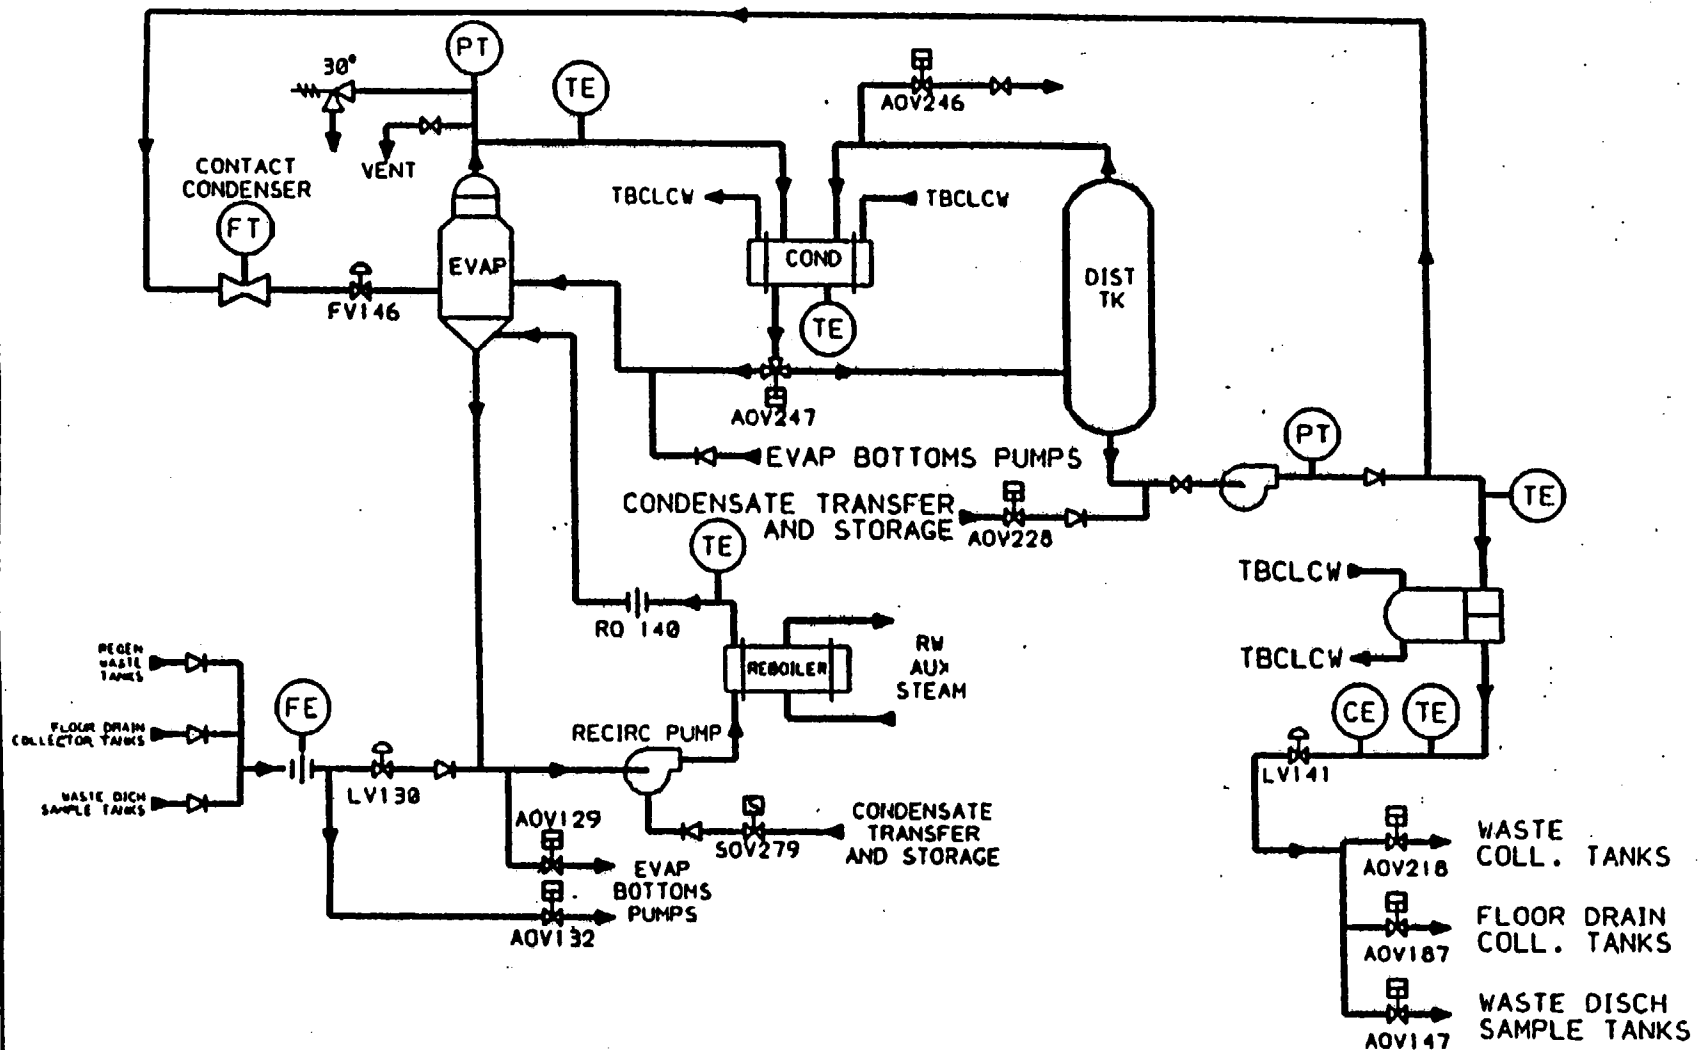


REGENERANT  
EVAPORATOR SYSTEM



## **Gaseous Treatment System Diagrams**

---



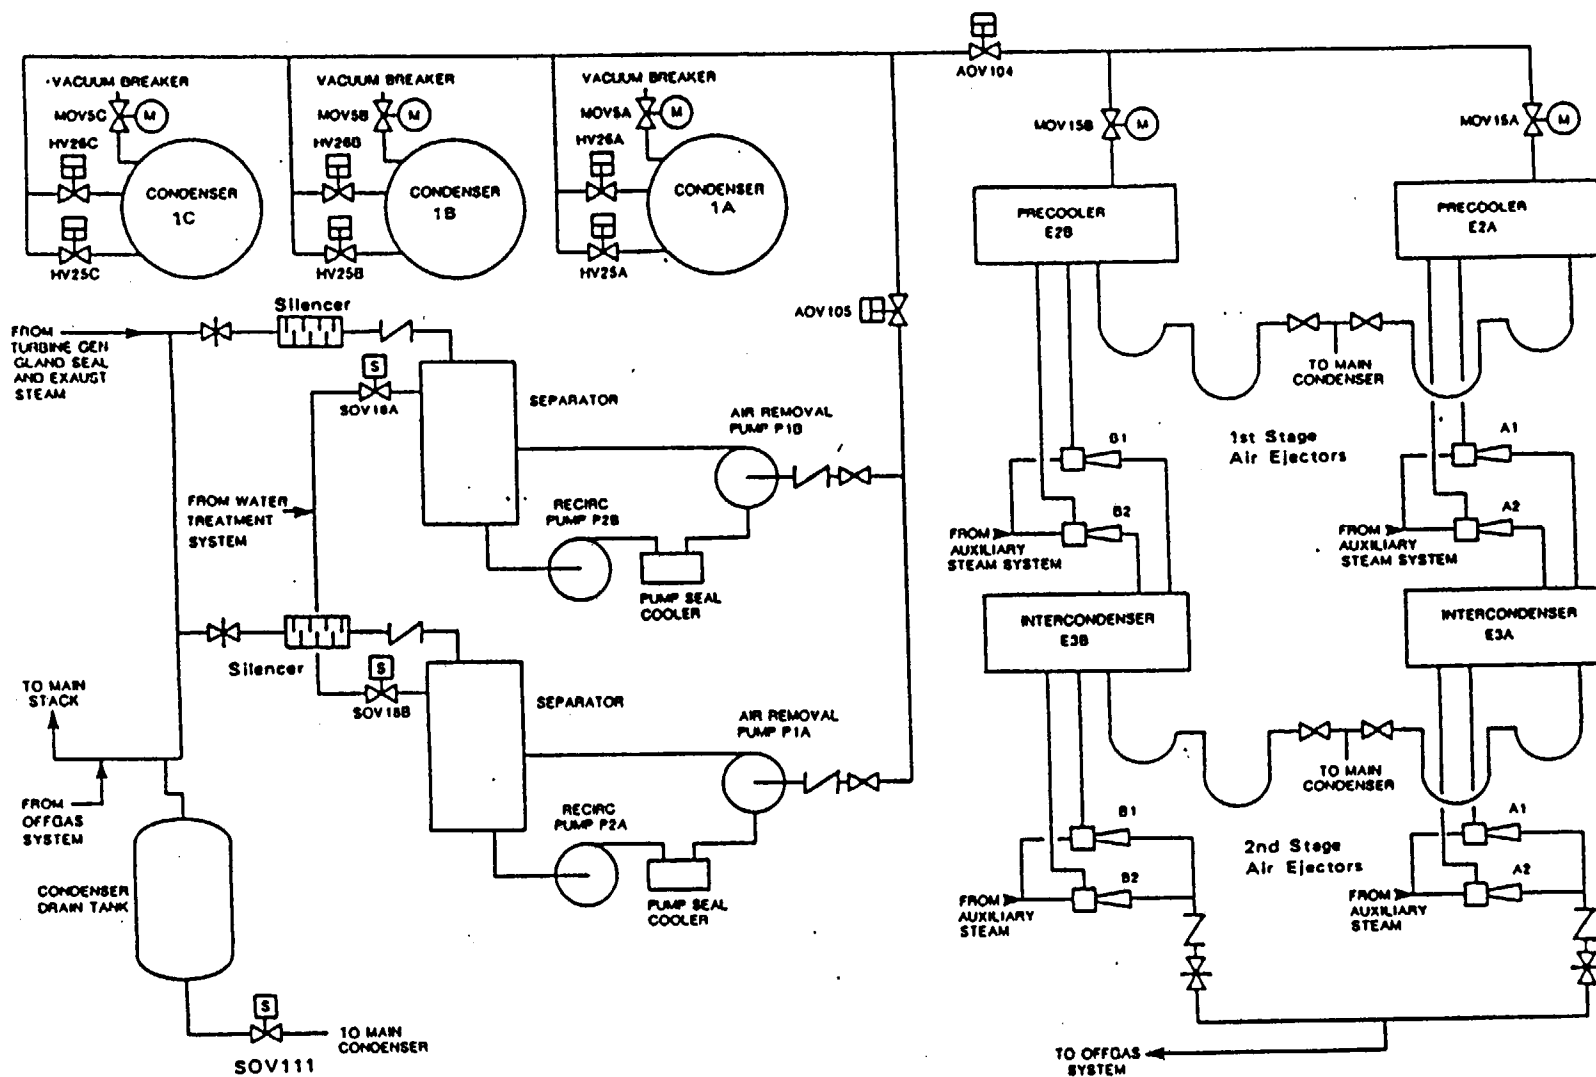


Title: CONDENSER AIR REMOVAL SYSTEM



# OFFGAS RECOMBINERS

Title:


II 89

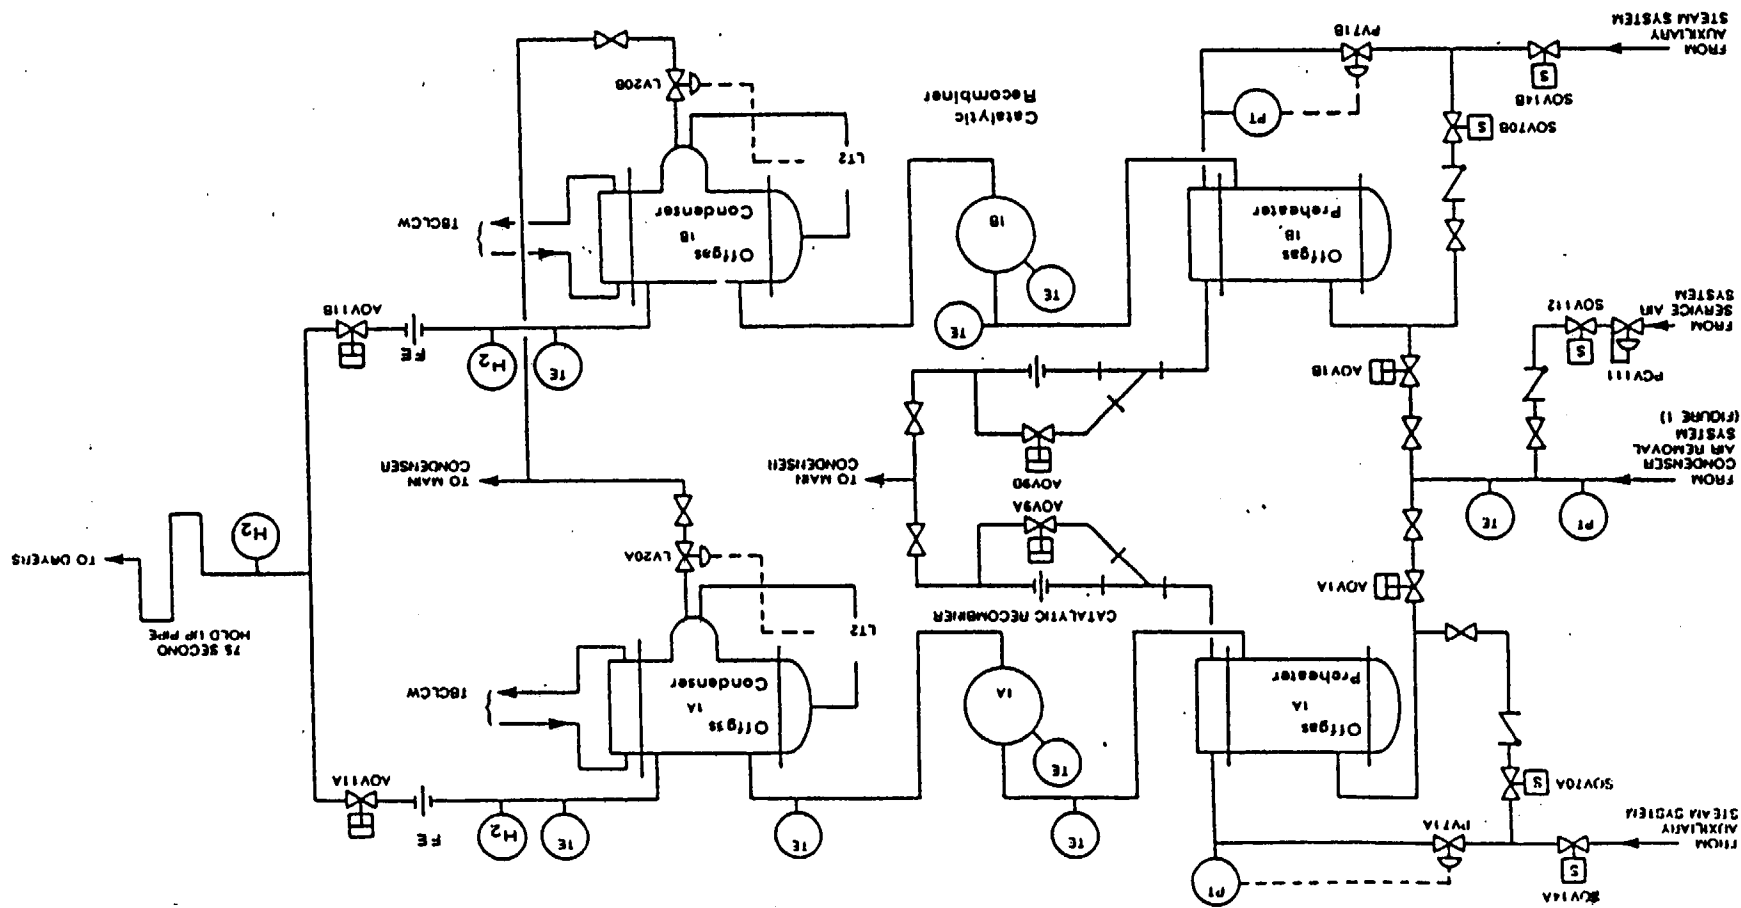








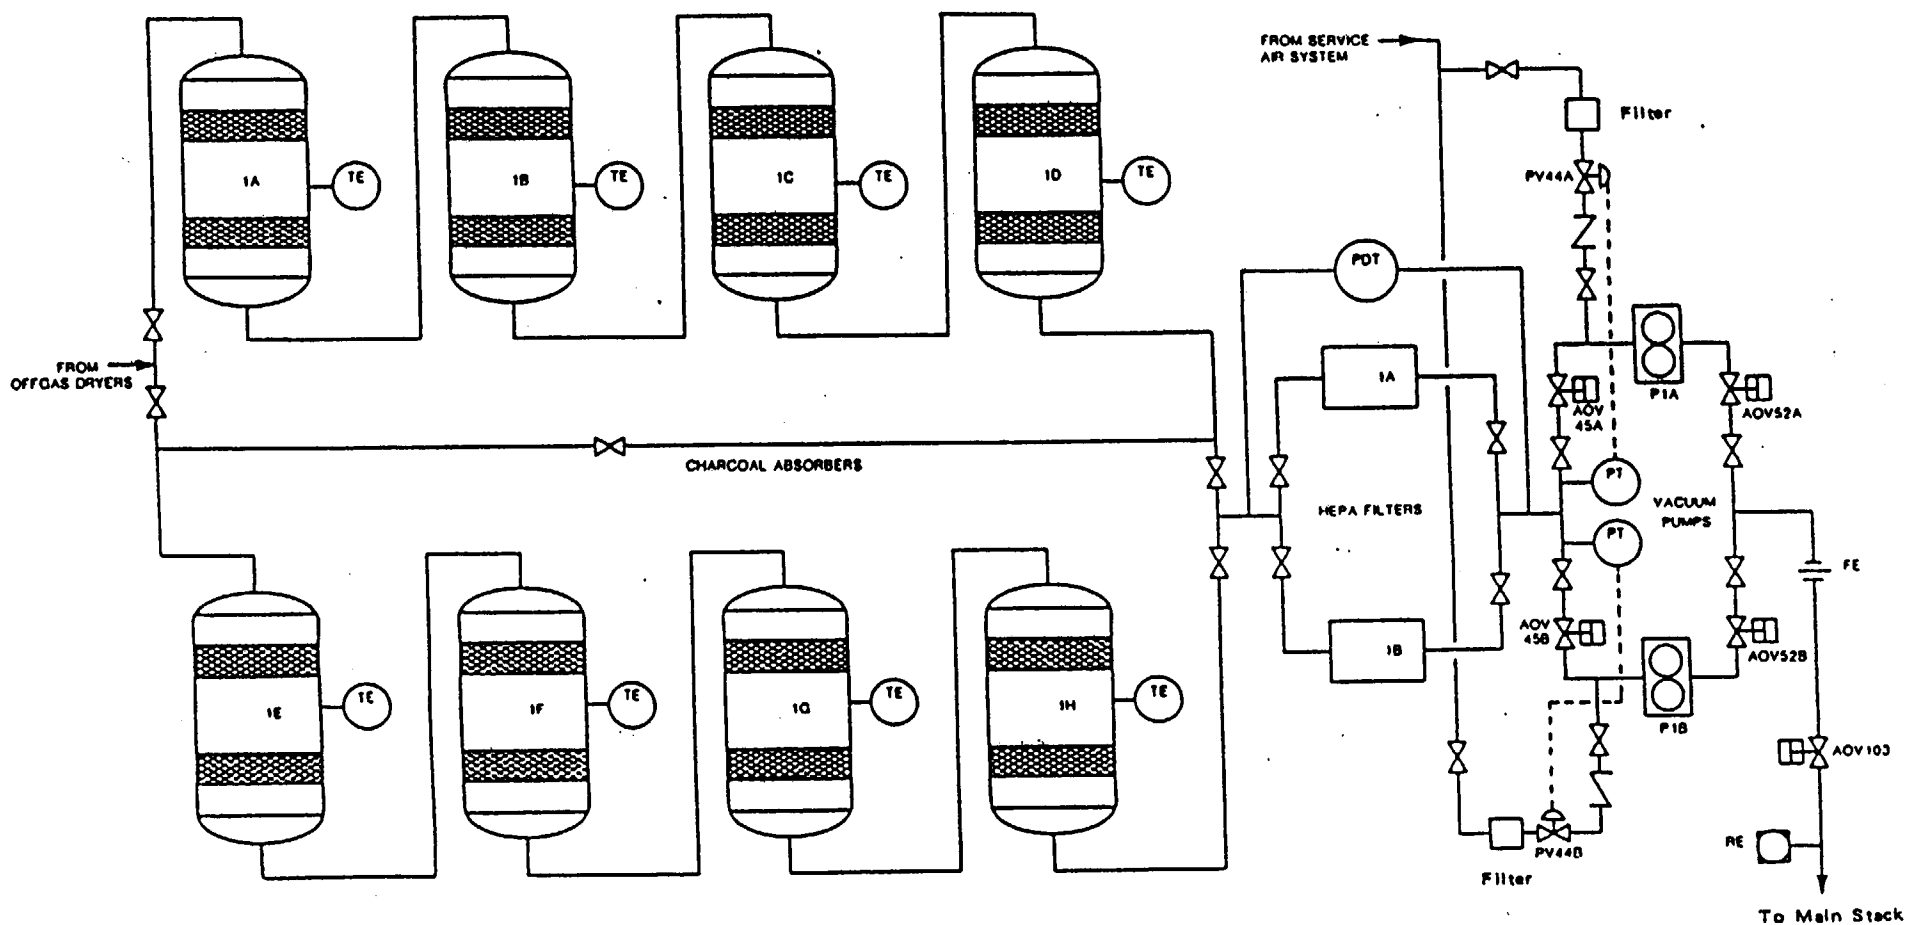

Title: OFFGAS SYSTEM  
CHARCOAL ABSORBERS



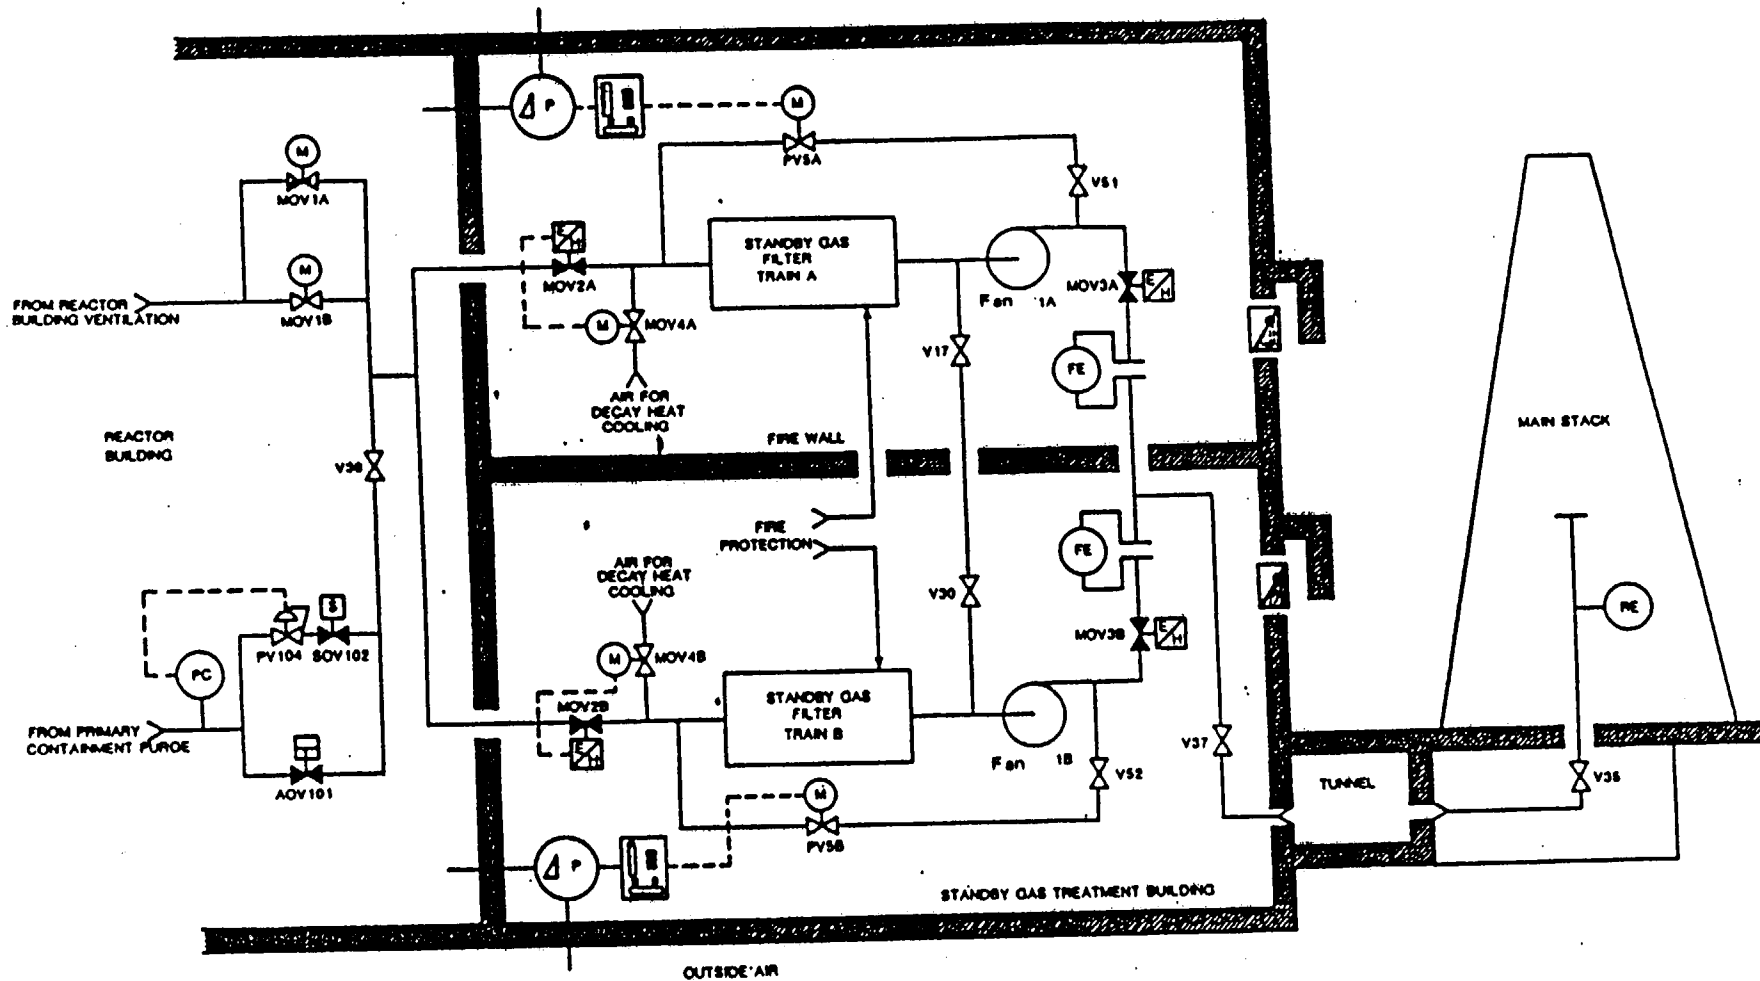


Title: **STANDBY GAS TREATMENT SYSTEM**



## **Liquid Radiation Monitoring Diagrams**

---




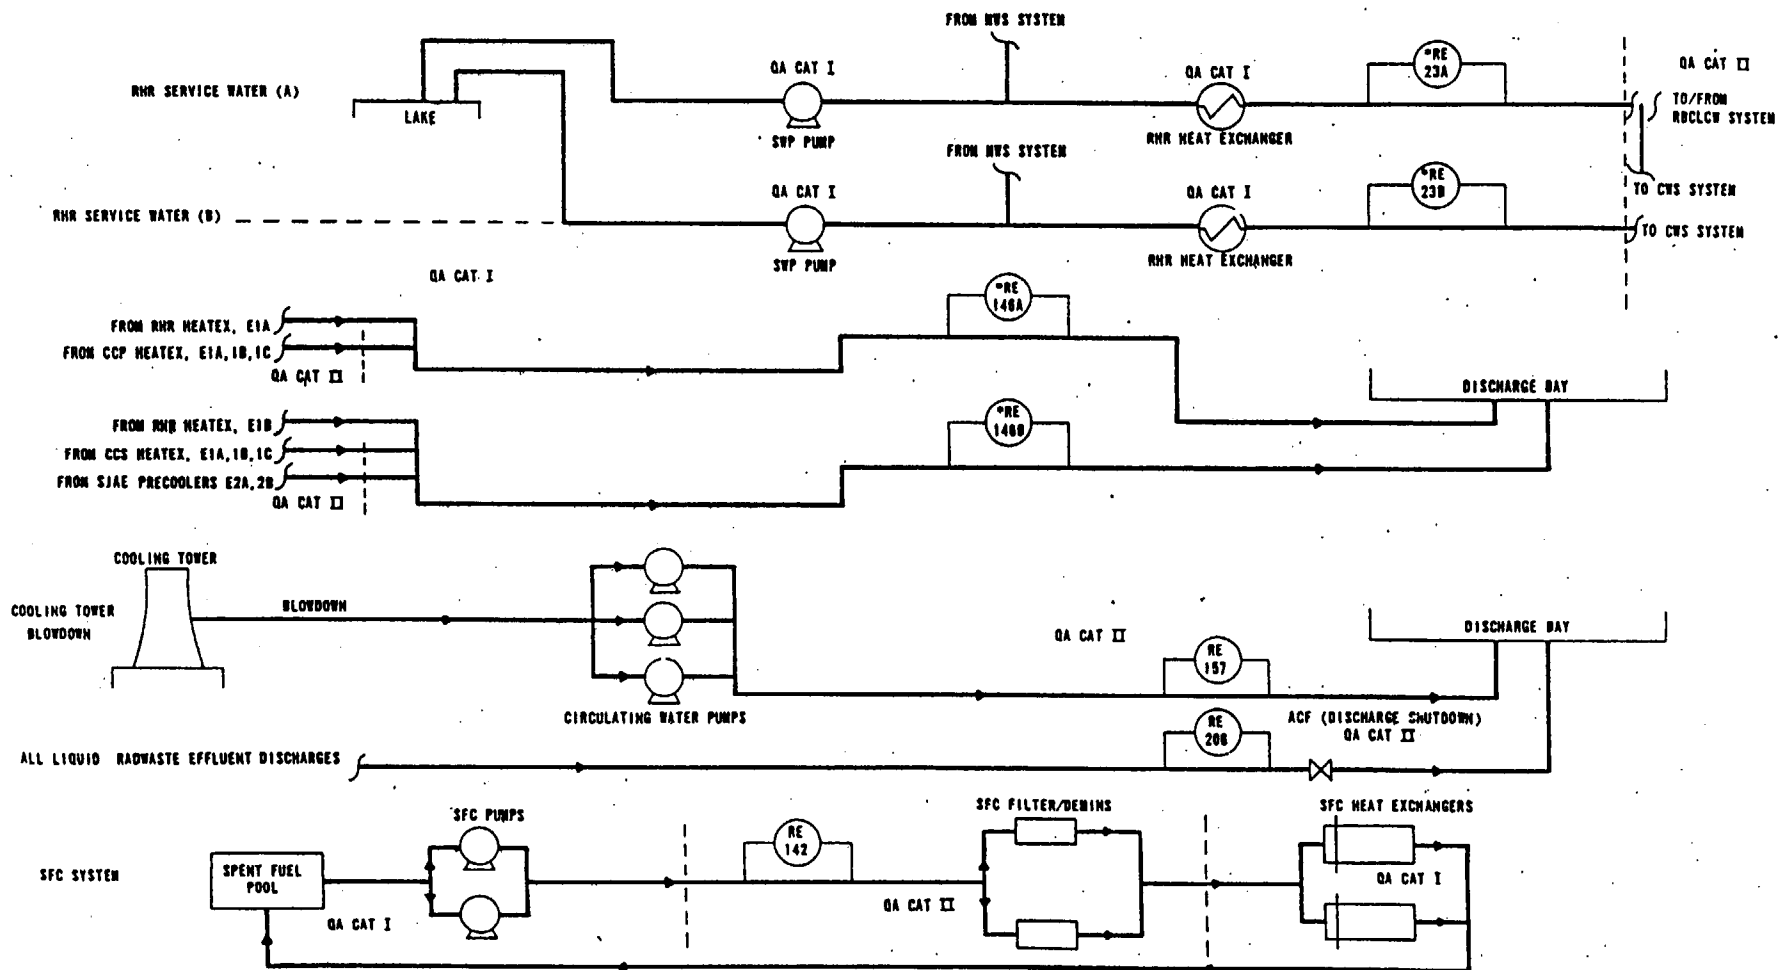






LIQUID RADIATION MONITORING  
SHEET 2 OF 2

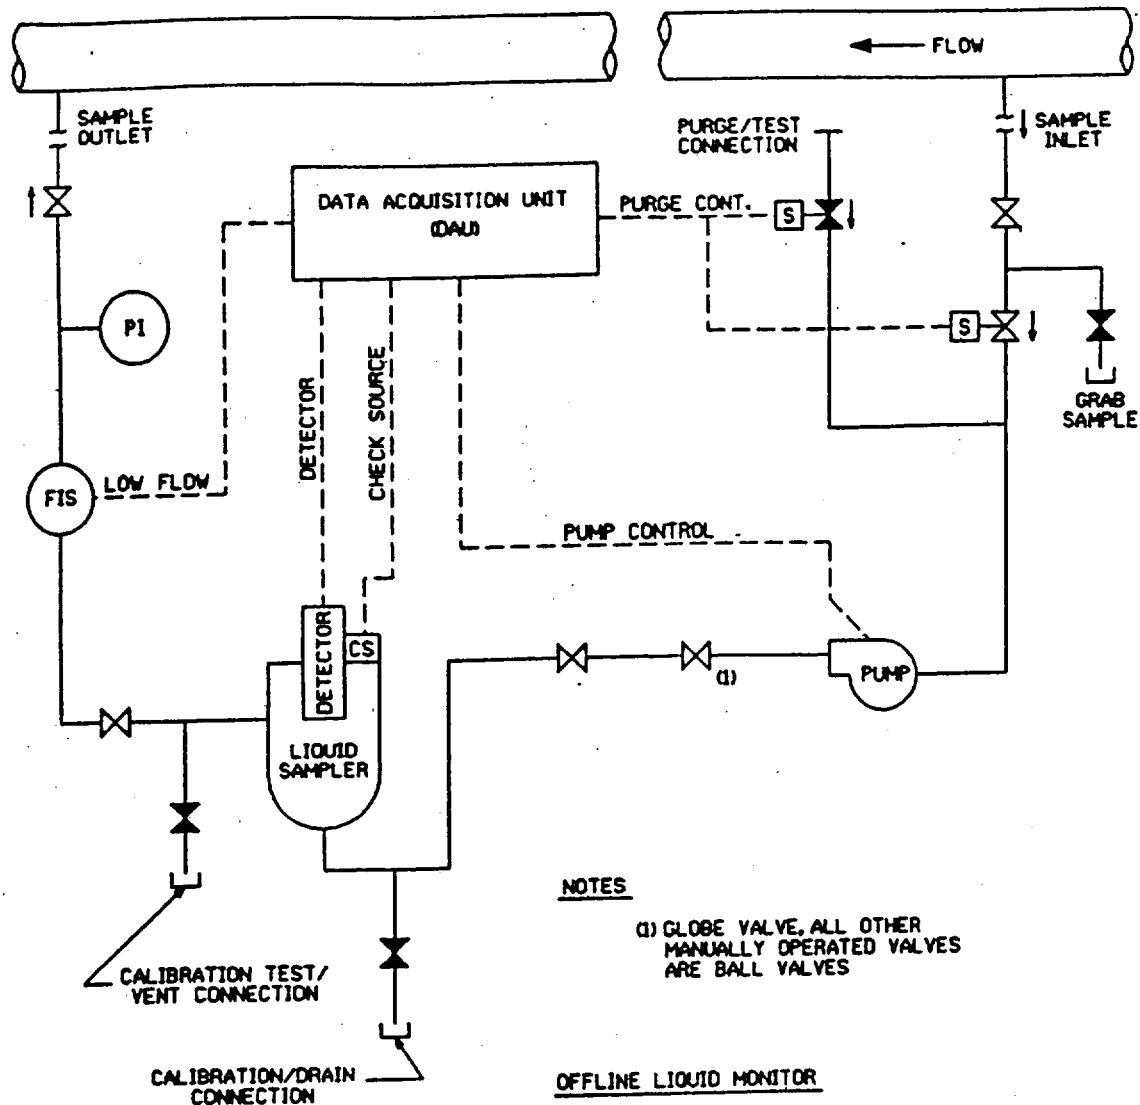NIAGARA MOHAWK POWER CORPORATION  
NINE MILE POINT-UNIT 2  
FINAL SAFETY ANALYSIS REPORT





#### LEGEND

-  PRESSURE INDICATOR
-  FLOW INDICATING SW.
-  SOLENOID OPERATED SW.
-  NORMALLY CLOSED VALVE
-  NORMALLY OPEN VALVE

#### OFF-LINE LIQUID MONITOR

NIAGARA MOHAWK POWER CORPORATION  
NINE MILE POINT-UNIT 2  
UPDATED SAFETY ANALYSIS REPORT












## **Gaseous Effluent Monitoring System Diagrams**

---



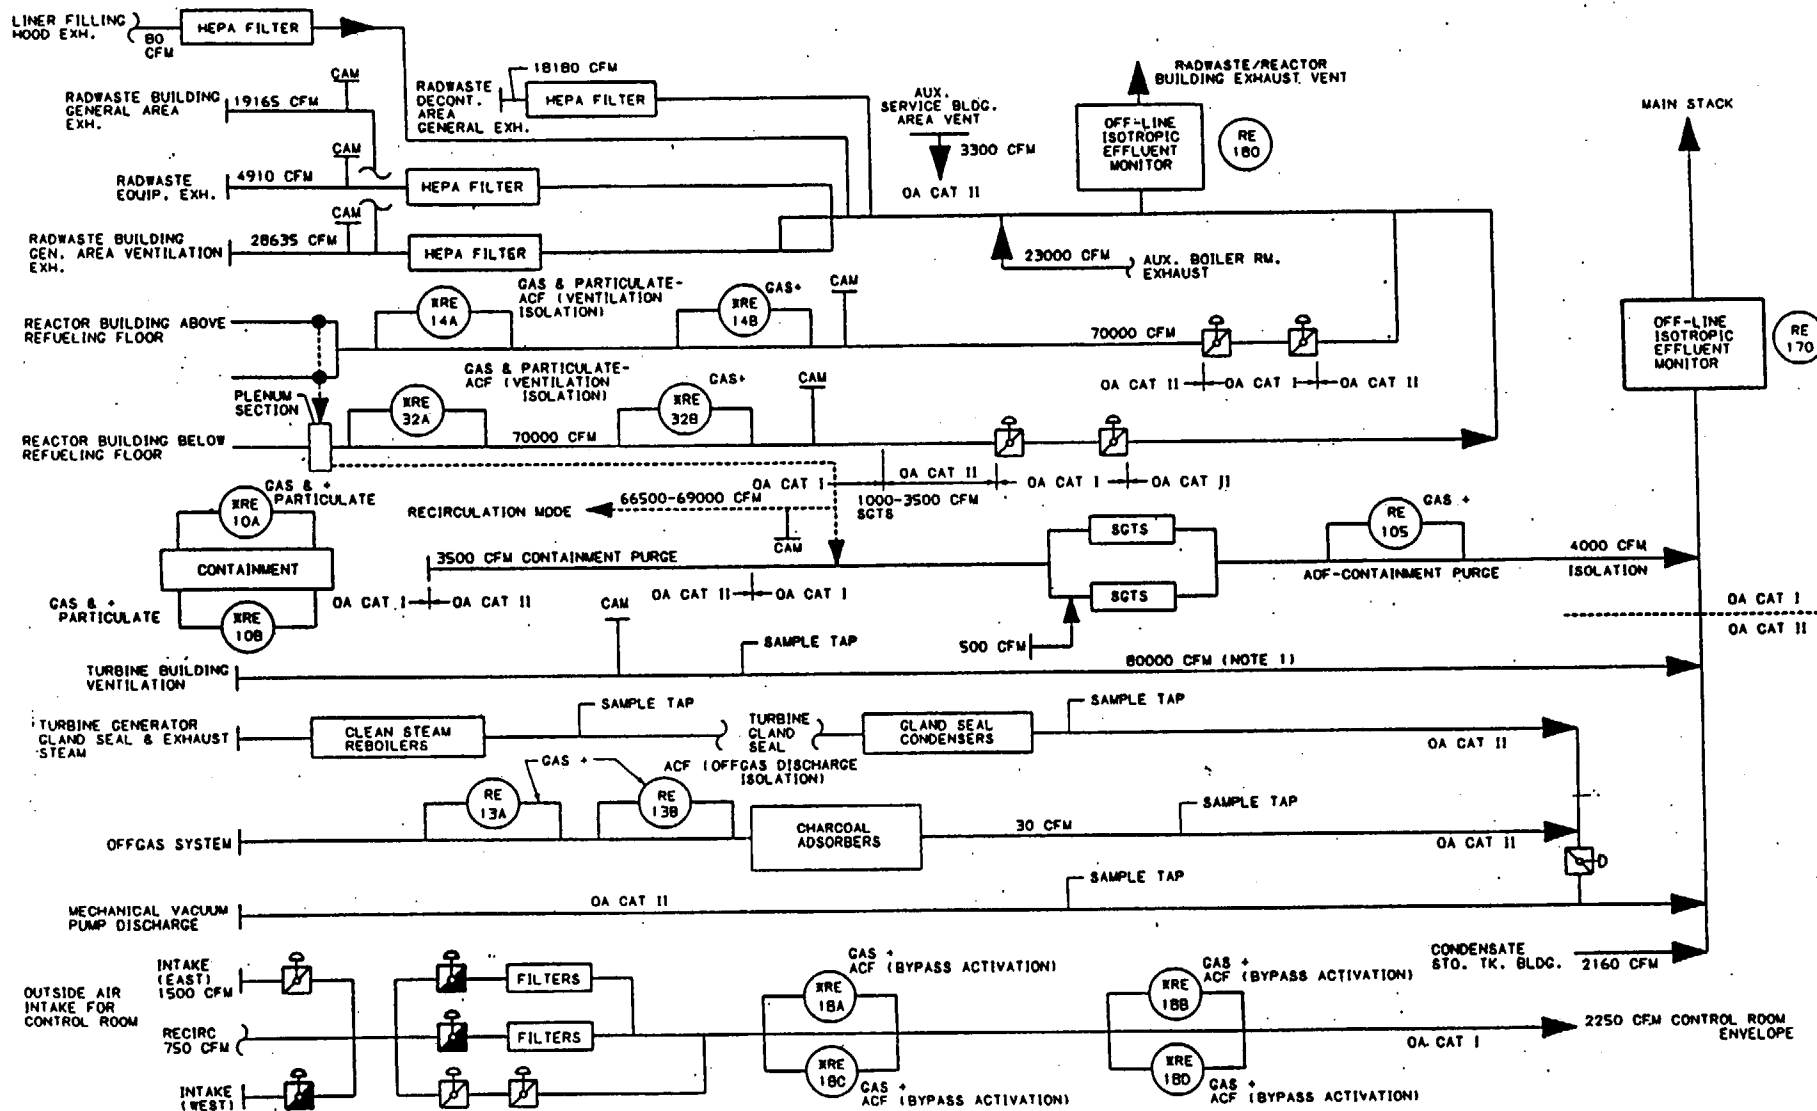

ACF: AUTOMATIC CONTROL FUNCTION  
 PAM: POST ACCIDENT MONITOR  
 + : PARTICULATE & IODINE SAMPLING CAPABILITY  
 CAM: CONTINUOUS AIRBORNE MONITOR  
 X : SAFETY-RELATED MONITOR


#### NOTES.

- MODIFICATION 95-011 HAS BEEN INSTALLED TO ALLOW CONCURRENT OPERATION OF ALL 3 EXHAUST FANS. WHEN ALL 3 FANS ARE RUNNING THERE WILL BE AN ADDITIONAL EXHAUST OF  $\approx 17,500$  CFM.

GASEOUS RADIATION  
 MONITORING

NIAGARA MOHAWK POWER CORPORATION  
 NINE MILE POINT-UNIT 2  
 UPDATED SAFETY ANALYSIS REPORT



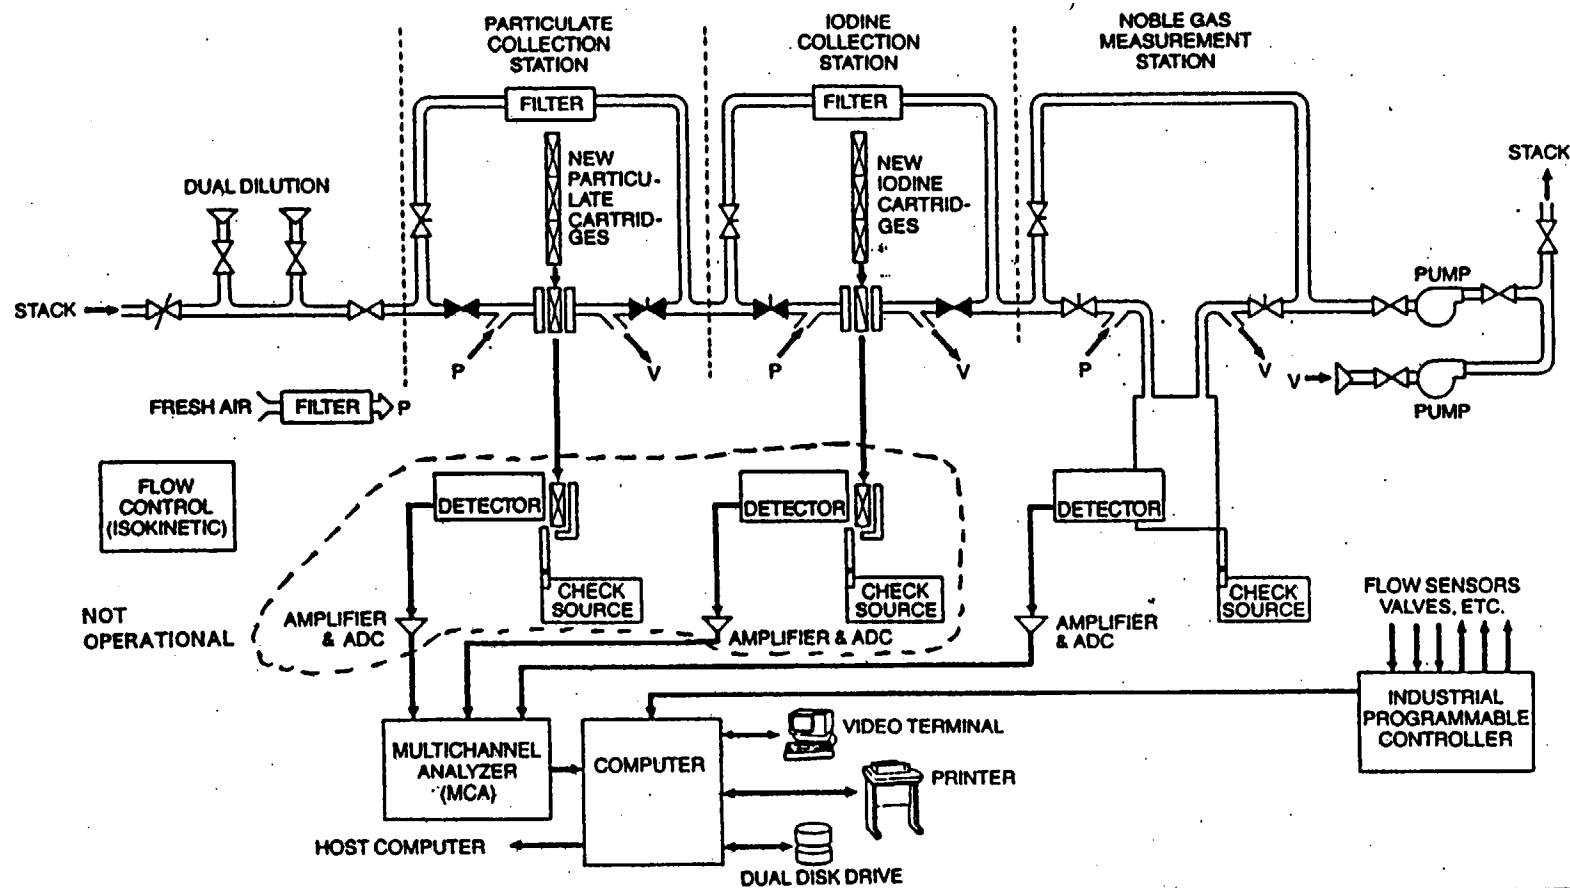

BLOCK DIAGRAM  
TYPICAL GASEOUS EFFLUENT  
MONITORING SYSTEM


NIAGARA MOHAWK POWER CORPORATION  
**NINE MILE POINT-UNIT 2**  
UPDATED SAFETY ANALYSIS REPORT



**APPENDIX E**  
**NINE MILE POINT ON-SITE AND OFF-SITE MAPS**

---



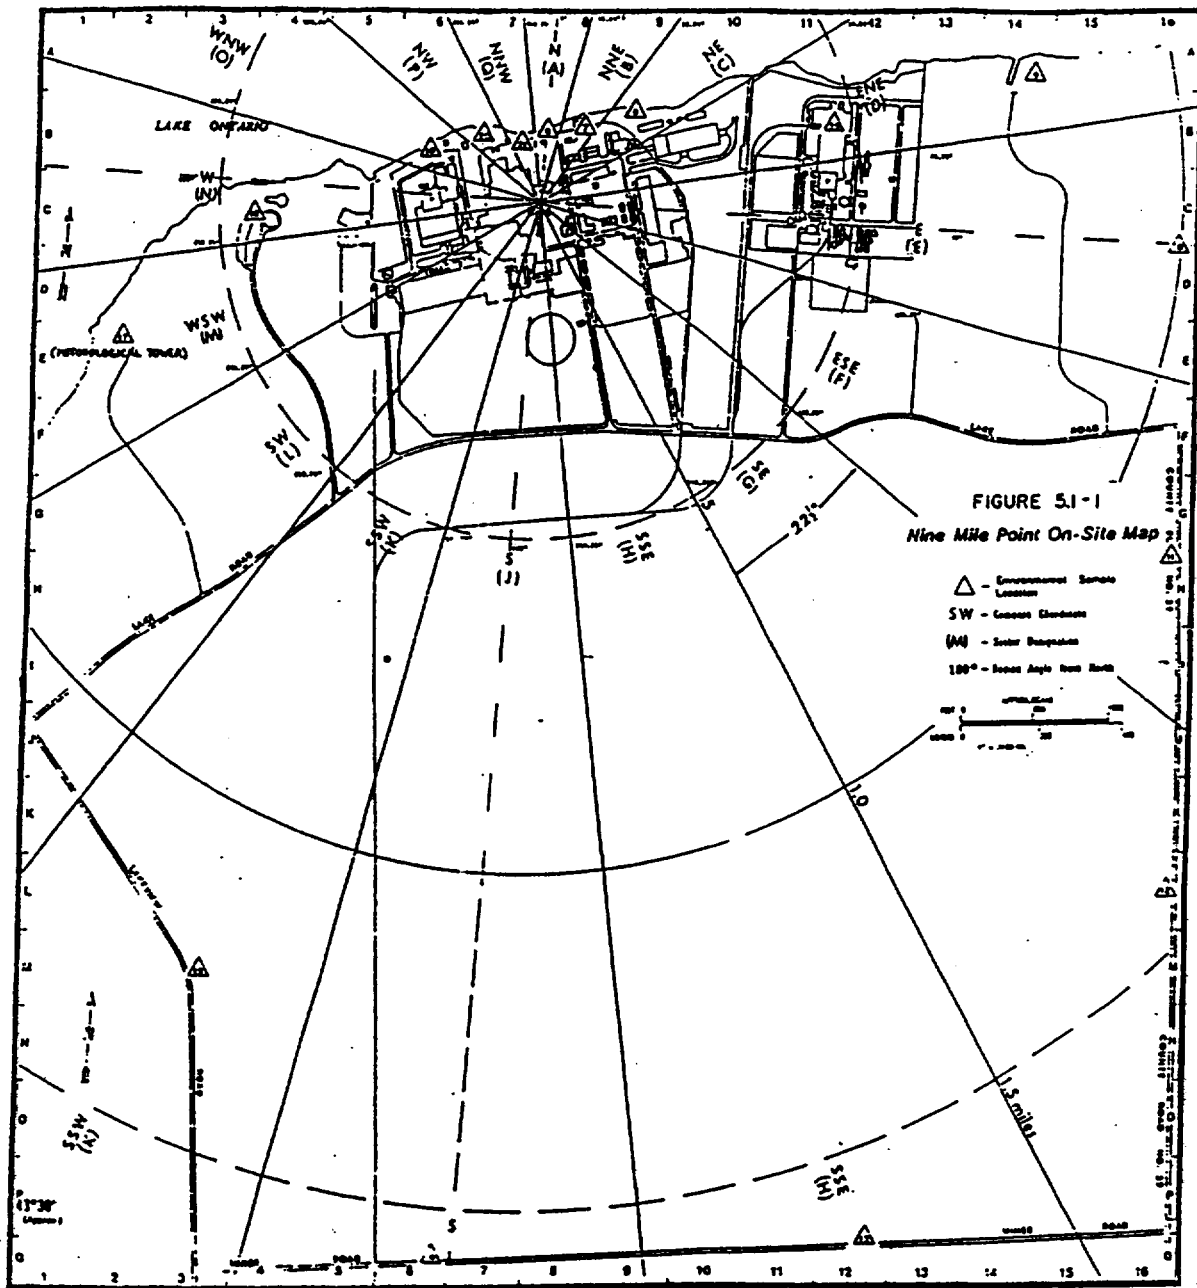















## LEGEND


Interstate.....	
U.S. & State Highways.....	
County Roads.....	
Town Roads.....	
County Lines.....	
Town Lines.....	
City & Village Lines.....	
Railroads.....	
ENVIRONMENTAL SAMPLE.....	
LOCATION.....	

Latitude 43°28'N.  
Longitude 76°20'W.  
at Orange County Bldg., Orange, N.Y.  
Lead Area 200 Square miles



L A K E  
O N T A R I O

FIGURE 5.1-2  
NINE MILE POINT  
OFF-SITE MAP  
(12/95)

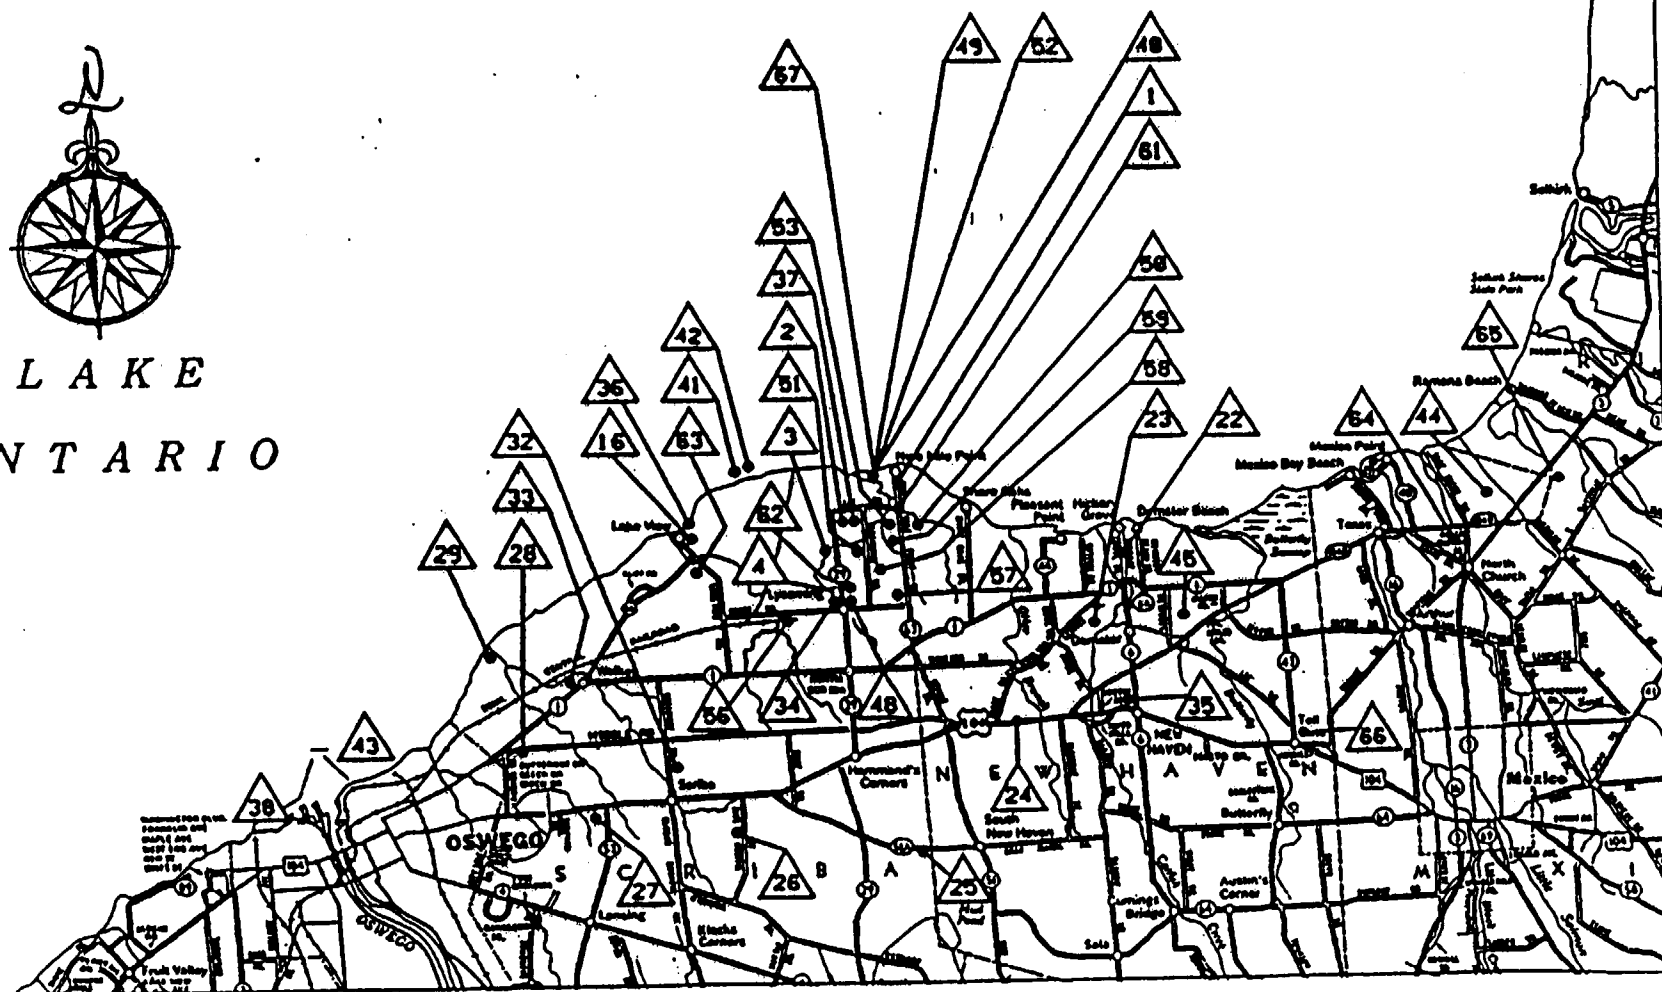





II 103a



Document Number	N2-ODCM
Revision	19

The subject document was never issued controlled from QS Document Control, it should be retained for reference purposes only.

QS Document Control  
JCJosh 1/19/2001



**ORIGINAL**

NINE MILE POINT NUCLEAR STATION

NINE MILE POINT UNIT 2

OFF-SITE DOSE CALCULATION MANUAL (ODCM)

THIS IS A FULL REVISION


DATE

APPROVALS

SIGNATURES


REVISION 19

Prepared by:

  
G. R. Stinson  
Health Physicist


7/21/00

Reviewed by:

  
T. G. Kulczycky  
Supervisor, Analysis Services

7/21/00

Reviewed by:

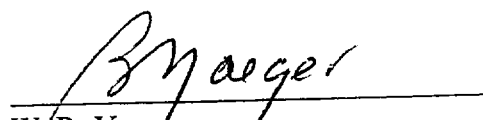  
W. R. Yaeger  
Manager, Engineering Services

7/21/00

R. B. Abbott

  
V. P. Nuclear Engineering

7/21/00

M. F. Peckham

  
Plant Manager Unit 2

7/25/00

NIAGARA MOHAWK POWER CORPORATION



## DISCUSSION OF CHANGES

### Introduction

#### ADMINISTRATIVE

In the relocation and conversion of the Nine Mile Point Unit 2 current Technical Specifications (CTS) to the proposed Offsite Dose Calculation Manual (ODCM) used in support of the Improved Technical Specifications (ITS), certain wording preferences or conventions are adopted that do not result in technical changes (either actual or interpretational). Revision 7 to the ODCM incorporated the Radiological Effluent Technical Specifications (RETS) per Generic Letter 89-01 and NUREG-1302, with minor editorial changes. The specifications incorporated into Revision 7 were for reference only, in order to facilitate the change from the CTS to implementation of ITS. In this revision, 19, reformatting, the elimination of redundant wording, and revised numbering are adopted to make the ODCM consistent with ITS. The majority of the changes had been marked up on a copy of Revision 14 of the ODCM. Subsequent to that mark-up, Revisions 15, 16 and 17 have been issued. Rather than transfer all of the mark-ups to a copy of Revision 17, only those pages that were changed between Revision 14 and 17 have been marked up on a Revision 17 copy.

In the specific case of the Introduction, the numbering has been updated for Technical Specification references.



*SUMMARY OF REVISIONS*

*Revision 19 (Effective 8/4/00 )*

*PAGE*

FULL REVISION

*DATE*

August 2000



# TABLE OF CONTENTS

	<u>PAGE</u>
List of Tables	vii
List of Figures	ix
Introduction	x
PART I – RADIOLOGICAL EFFLUENT CONTROLS	I
SECTION 1.0      DEFINITIONS	I 1.0-0
SECTION 2.0      Not Used	
SECTION 3.0      APPLICABILITY	
D 3.1      Radioactive Liquid Effluents	I 3.0-0
D 3.1.1      Liquid Effluents Concentration	I 3.1-1
D 3.1.2      Liquid Effluents Dose	I 3.1-1
D 3.1.3      Liquid Radwaste Treatment System	I 3.1-4 I 3.1-7
D 3.2      Radioactive Gaseous Effluents	I 3.2-1
D 3.2.1      Gaseous Effluents Dose Rate	I 3.2-1
D 3.2.2      Gaseous Effluents Noble Gas Dose	I 3.2-4
D 3.2.3      Gaseous Effluents Dose – Iodine-131, Iodine-133, Tritium, and Radioactive Material in Particulate Form	I 3.2-7
D 3.2.4      Gaseous Radwaste Treatment System	I 3.2-10
D 3.2.5      Ventilation Exhaust Treatment System	I 3.2-12
D 3.2.6      Venting or Purging	I 3.2-14
D 3.3      Instrumentation	I 3.3-1
D 3.3.1      Radioactive Liquid Effluent Monitoring Instrumentation	I 3.3-1
D 3.3.2      Radioactive Gaseous Effluent Monitoring Instrumentation	I 3.3-7
D 3.4      Radioactive Effluents Total Dose	I 3.4-1
D 3.5      Radiological Environmental Monitoring	I 3.5-1
D 3.5.1      Monitoring Program	I 3.5-1
D 3.5.2      Land Use Census	I 3.5-13
D 3.5.3      Interlaboratory Comparison Program	I 3.5-16
BASES	
B 3.1      Radioactive Liquid Effluents	I B 3.1-0
B 3.1.1      Liquid Effluents Concentration	I B 3.1-1
B 3.1.2      Liquid Effluents Dose	I B 3.1-1
B 3.1.3      Liquid Radwaste Treatment System	I B 3.1-2 I B 3.1-3



## TABLE OF CONTENTS (Cont)

		<u>PAGE</u>
B 3.2	Radioactive Gaseous Effluents	
B 3.2.1	Gaseous Effluents Dose Rate	I B 3.2-1
B 3.2.2	Gaseous Effluents Noble Gas Dose	I B 3.2-1
B 3.2.3	Gaseous Effluents Dose – Iodine-131, Iodine-133, Tritium, and Radioactive Material in Particulate Form	I B 3.2-2
B 3.2.4	Gaseous Radwaste Treatment System	I B 3.2-3
B 3.2.5	Ventilation Exhaust Treatment System	I B 3.2-5
B 3.2.6	Venting or Purging	I B 3.2-6
		I B 3.2-7
B 3.3	Instrumentation	
B 3.3.1	Radioactive Liquid Effluent Monitoring Instrumentation	I B 3.3-1
B 3.3.2	Radioactive Gaseous Effluent Monitoring Instrumentation	I B 3.3-1
		I B 3.3-2
B 3.4	Radioactive Effluents Total Dose	
		I B 3.4-1
B 3.5	Radiological Environmental Monitoring	
B 3.5.1	Monitoring Program	I B 3.5-1
B 3.5.2	Land Use Census	I B 3.5-1
B 3.5.3	Interlaboratory Comparison Program	I B 3.5-2
		I B 3.5-3
SECTION 4.0	ADMINISTRATIVE CONTROLS	
		I 4.0-1
D 4.1	Reporting Requirements	
D 4.1.1	Special Reports	I 4.1-1
		I 4.1-1
D 4.2	Major Changes to Liquid, Gaseous and Solid Radwaste Treatment Systems	
		I 4.2-1



# TABLE OF CONTENTS (Cont)

<u>SECTION</u>	<u>SUBJECT</u>	<u>REF SECTION</u>	<u>PAGE</u>
PART II – CALCULATIONAL METHODOLOGIES			II 1
1.0	LIQUID EFFLUENTS		II 2
1.1	Liquid Effluent Monitor Alarm Setpoints		II 2
1.1.1	Basis		II 2
1.1.2	Setpoint Determination Methodology	3.1.1	II 2
1.1.2.1	Liquid Radwaste Effluent Radiation Alarm Setpoint	3.3.1	II 2
1.1.2.2	Contaminated Dilution Water Radwaste Effluent Monitor Alarm Setpoint Calculations		II 2
1.1.2.3	Service Water and Cooling Tower Blowdown Effluent Radiation Alarm Setpoint		II 5
1.2	Liquid Effluent Concentration Calculation	3.1.1	II 7
1.3	Liquid Effluent Dose Calculation Methodology	DSR 3.1.1.2	II 8
1.4	Liquid Effluent Sampling Representativeness	3.1.2	II 8
1.5	Liquid Radwaste System Operability	DSR 3.1.2.1	II 9
		Table D 3.1.1-1	II 9
		note b	
		3.1.3	II 10
		DSR 3.1.3.1	
2.0	GASEOUS EFFLUENTS	B 3.1.3	II 11
2.1	Gaseous Effluent Monitor Alarm Setpoints		II 11
2.1.1	Basis		II 11
2.1.2	Setpoint Determination Methodology Discussion	3.2.1	II 11
2.1.2.1	Stack Noble Gas Detector Alarm Setpoint Equation	3.3.2	II 12
2.1.2.2	Vent Noble Gas Detector Alarm Setpoint Equation		II 13
2.1.2.3	Offgas Pretreatment Noble Gas Detector Alarm Setpoint Equation		II 14
2.2	Gaseous Effluent Dose Rate Calculation Methodology	3.2.1	II 15
2.2.1	X/Q and W <sub>v</sub> - Dispersion Parameters for Dose Rate, Table D 3-23		II 15
2.2.2	Whole Body Dose Rate Due to Noble Gases	DLCO 3.2.1.a	II 16
2.2.3	Skin Dose Rate Due to Noble Gases	DSR 3.2.1.1	II 17
		DLCO 3.2.1.a	
		DSR 3.2.1.1	



## TABLE OF CONTENTS (Cont)

<u>SECTION</u>	<u>SUBJECT</u>	<u>REF SECTION</u>	<u>PAGE</u>
2.2.4	Organ Dose Rate Due to I-131, I-133, Tritium and Particulates with half-lives greater than 8 days	DLCO 3.2.1.b DSR 3.2.1.2	II 18
2.3	Gaseous Effluent Dose Calculation Methodology	3.2.2 3.2.3 3.2.5	II 19
2.3.1	W <sub>s</sub> and W <sub>v</sub> - Dispersion Parameters For Dose, Table D 3-23		II 19
2.3.2	Gamma Air Dose Due to Noble Gases	3.2.2 DSR 3.2.2.1	II 20
2.3.3	Beta Air Dose Due to Noble Gases	3.3.2	II 20
2.3.4	Organ Dose Due to I-131, I-133, Tritium and Particulates with half-lives	3.2.3 3.2.5 DSR 3.2.3.1 DSR 3.2.5.1	II 20
2.4	I-133 and I-135 Estimation		II 21
2.5	Isokinetic Sampling		II 21
2.6	Use of Concurrent Meteorological Data vs. Historical Data		II 21
2.7	Gaseous Radwaste Treatment System Operation	3.2.4	II 21
2.8	Ventilation Exhaust Treatment System Operation	3.2.5	II 22
3.0	URANIUM FUEL CYCLE	3.4	II 23
3.1	Evaluation of Doses From Liquid Effluents	DSR 3.1.2.1	II 24
3.2	Evaluation of Doses From Gaseous Effluents	DSR 3.2.2.1	II 26
3.3	Evaluation of Doses From Direct Radiation	DSR 3.2.3.1	II 26
3.4	Doses to Members of the Public Within the Site Boundary	4.1	II 26
4.0	ENVIRONMENTAL MONITORING PROGRAM	3.5	II 29
4.1	Sampling Stations	3.5.1 DSR 3.5.1.1	II 29
4.2	Interlaboratory Comparison Program	DSR 3.5.3.2	II 29
4.3	Capabilities for Thermoluminescent Dosimeters Used for Environmental Measurements		II 30



**TABLE OF CONTENTS** (Cont)

<u><b>SECTION</b></u>	<u><b>SUBJECT</b></u>	<u><b>REF SECTION</b></u>	<u><b>PAGE</b></u>
Appendix A	Liquid Dose Factor Derivation		II 65
Appendix B	Plume Shine Dose Factor Derivation		II 68
Appendix C	Dose Parameters for Iodine 131 and 133, Particulates and Tritium		II 72
Appendix D	Diagrams of Liquid and Gaseous Radwaste Treatment Systems and Monitoring Systems		II 82
Appendix E	Nine Mile Point On-Site and Off-Site Maps		II 105



## LIST OF TABLES

### *PART I - RADIOLOGICAL EFFLUENT CONTROLS*

<u>TABLE NO</u>	<u>TITLE</u>	<u>PAGE</u>
D 3.1.1-1	Radioactive Liquid Waste Sampling and Analysis	I 3.1-2
D 3.2.1-1	Radioactive Gaseous Waste Sampling and Analysis	I 3.2-2
D 3.3.1-1	Radioactive Liquid Effluent Monitoring Instrumentation	I 3.3-6
D 3.3.2-1	Radioactive Gaseous Effluent Monitoring Instrumentation	I 3.3-13
D 3.5.1-1	Radiological Environmental Monitoring Program	I 3.5-6
D 3.5.1-2	Reporting Levels for Radioactivity Concentrations in Environmental Samples	I 3.5-10
D 3.5.1-3	Detection Capabilities for Environmental Sample Analyses	I 3.5-11



LIST OF TABLES (Cont)

**PART II – CALCULATIONAL METHODOLOGIES**

<b>TABLE NO</b>	<b>TITLE</b>	<b>PAGE</b>
D 2-1	Liquid Effluent Detector Response	II 32
D 2-2 thru D 2-5	$A_{iat}$ Values - Liquid Effluent Dose Factor	II 33
D 3-1	Offgas Pretreatment Detector Response	II 37
D 3-2	Finite Plume - Ground Level Dose Factors from an Elevated Release	II 38
D 3-3	Immersion Dose Factors	II 39
D 3-4 thru D 3-22	Dose And Dose Rate Factors, $R_i$	II 40
D 3-23	Dispersion Parameters at Controlling Locations, $X/Q$ , $W_v$ and $W_s$ Values	II 59
D 3-24	Parameters For the Evaluation of Doses to Real Members of the Public From Gaseous And Liquid Effluents	II 60
D 5.1	Radiological Environmental Monitoring Program Sampling Locations	II 61



**LIST OF FIGURES**

<u><b>FIGURE NO</b></u>	<u><b>TITLE</b></u>	<u><b>PAGE</b></u>
D 1.0-1	Site Area and Land Portion of Exclusion Area Boundaries	I 1.0-4
D 5.1-1	Nine Mile Point On-Site Map	II 106
D 5.1-2	Nine Mile Point Off-Site Map	II 107



# INTRODUCTION

---

The OFFSITE DOSE CALCULATION MANUAL (ODCM) is a supporting document of the Technical Specifications Section 5.5.1. The previous Limiting Conditions for Operation that were contained in the Radiological Effluent Technical Specifications are now transferred to the ODCM as Radiological Effluent Controls. The ODCM contains two parts: Radiological Effluent Controls, Part I; and Calculational Methodologies, Part II. Radiological Effluent Controls, Part I, includes the following: (1) The Radioactive Effluent Controls and Radiological Environmental Monitoring Programs required by Technical Specification 5.5.1 and (2) descriptions of the information that should be included in the Annual Radiological Environmental Operating and Radioactive Effluent Release Reports required by Technical Specifications 5.6.2 and 5.6.3. Calculational Methodologies, Part II, describes the methodology and parameters to be used in the calculation of liquid and gaseous effluent monitoring instrumentation alarm/trip setpoints and the calculation of offsite doses due to radioactive liquid and gaseous effluents. The ODCM also contains a list and graphical description of the specific sample locations for the radiological environmental monitoring program, and liquid and gaseous radwaste treatment system configurations.

The ODCM follows the methodology and models suggested by NUREG-0133 and Regulatory Guide 1.109, Revision 1. Simplifying assumptions have been applied in this manual where applicable to provide a more workable document for implementing the Radiological Effluent Control requirements; this simplified approach will result in a more conservative dose evaluation for determining compliance with regulatory requirements.

The ODCM will be maintained for use as a reference and training document of accepted methodologies and calculations. Changes to the calculation methods or parameters will be incorporated into the ODCM to assure that the ODCM represents the present methodology in all applicable areas. Any changes to the ODCM will be implemented in accordance with Section 5.5.1 of the Technical Specifications.

---



## SUMMARY OF REVISIONS

### Revision 17.(Effective 3/1/00)

#### PAGE

#### DATE

iii, 12-14, 18, 28-31, 34,  
37, 53, 55-58, 60-82, 87-89, 92

May 1986

15

May 1987

54

May 1987 (TCN-1)

19

June 1987  
(TCN-2)

90-91, 93-103

February 1988

20-27, 83-86

April 1988

i-ii

November 1988

1-11, 16, 32-33, 35-36, 59

February 1990

100-102, 106

June 1992

i-viii

December 1992

Part I - added section

Part II - 2-19, 21-25, 28-31, 33, 35-53, 55

Part II - added Appendices pp. 60-104

Part II - added pages 77, 78, 88, 94, 99, 102

Part I - 3/4 12-10

February 1993

Part II - 28, 29, 31, 55, 58, II 104a-c

Part I-i, ii, iii, iv, I 1-1, 3/4 3-75

December 1993

3/4 3-76, 3/4 3-96, 3/4 3-102, 3/4 12-12,

3/4 12-14, B 3/4 3-5, I 5-6, I 6-20, I 6-21,

I 6-22

Part II - II 25, II 59, II 63, II 105

Part I - xii

December 1995

Part II - II 36, II 54, II 60, II 105

Unit 2

Revision 17  
March 2000



SUMMARY OF REVISIONS (Cont)

PAGE

DATE

Part II - II 9, II 80, II 82, II 83 (Delete  
Duplicate of II 82), II 84, II 85, II 86  
(Delete, Equipment Removed), II 87

June 1996

Part II - II 19, II 90, II 99

December 1996

Part II - II 84, II 99

June 1997

Part I - xii

June 1998

Part II - II 11, II 13, II 14, II 33

June 1998 Rev. 14

Part I - i, iii, ix, xii, I 3/4 3-74, I 3/4 3-75,  
I 3/4 3-76, I B 3/4 3-5

June 1999 Rev. 15

Part II - II 9

December 1999 Rev. 16

Part II - II 29, II 30, II 31, II 32

March 2000 Rev. 17



# TABLE OF CONTENTS

	<u>PAGE</u>
List of Tables	(ix) vii
List of Figures	(xi) ix
Introduction	xii
PART I - RADIOLOGICAL EFFLUENT CONTROLS	I
SECTION 1.0 DEFINITIONS	I 1-0
SECTION 2.0 <sup>Not Used</sup> (Retained in Technical Specifications)	
SECTION 3.0 AND 4.0 CONTROLS AND SURVEILLANCE REQUIREMENTS	I 3/4 0-0
3/4.0 Applicability	I 3/4 0-1
3/4.1 (Retained in the Technical Specifications)	
3/4.2	
3/4.3 → (Relocated to USAR)	I 3/4 3-74
3/4.3.1 → (Retained in the Technical Specifications)	
3/4.3.6	
3/4.3.7 → (Relocated to USAR)	I 3/4 3-74
3/4.3.7.1 (Retained in the Technical Specifications)	
3/4.3.7.2	
3/4.3.7.3 → (Relocated to USAR)	I 3/4 3-74
3/4.3.7.4 → (Retained in the Technical Specifications)	
3/4.3.7.8	
<sup>Instrumentation</sup> 3/4.3.7.9 Radioactive Liquid Effluent Monitoring Instrumentation	I 3/4 3-92
<sup>Instrumentation</sup> 3/4.3.7.10 Radioactive Gaseous Effluent Monitoring Instrumentation	I 3/4 3-97

WISSET  
(A)



# TABLE OF CONTENTS (Cont)

## PAGE

3/4.3.8 (Retained in the Technical Specifications)  
3/4.3.9

3/4.4 → (Retained in the Technical Specifications)  
3/4.9

~~3/4.11~~ Liquid  
~~3/4.11~~ Radioactive Effluents I ~~3/4.11-1~~

~~3/4.11.1~~ Liquid Effluents I ~~3/4.11-1~~

D ~~3/4.11.1.1~~ Liquid Effluents & Concentration I ~~3/4.11-1~~

D ~~3/4.11.1.2~~ Liquid Effluents & Dose I ~~3/4.11-1~~

D ~~3/4.11.1.3~~ ~~Liquid Effluents~~ Liquid Radwaste  
Treatment System I ~~3/4.11-1~~

~~3/4.11.1.4~~ (Retained in the Technical Specifications)

D ~~3/4.11.2~~ ~~Radioactive~~  
Gaseous Effluents I ~~3/4.11-8~~

D ~~3/4.11.2.1~~ Gaseous Effluents Dose Rate I ~~3/4.11-8~~

D ~~3/4.11.2.2~~ Gaseous Effluents ~~Dose~~ Noble Gases Dose I ~~3/4.11-12~~

D ~~3/4.11.2.3~~ Gaseous Effluents Dose - Iodine-131,  
Iodine-133, Tritium, and Radioactive  
Material in Particulate Form I ~~3/4.11-13~~

D ~~3/4.11.2.4~~ ~~Gaseous Effluents~~ Gaseous Radwaste  
Treatment System I ~~3/4.11-14~~

D ~~3/4.11.2.5~~ ~~Gaseous Effluents~~ Ventilation Exhaust  
Treatment System I ~~3/4.11-15~~

~~3/4.11.2.6,~~ (Retained in the Technical Specifications)  
~~3/4.11.2.7~~

D ~~3/4.11.2.8~~ Venting or Purging I ~~3/4.11-18~~

~~3/4.11.3~~ (Retained in the Technical Specifications)

D ~~3/4.11.4~~ Radioactive Effluents Total Dose I ~~3/4.11-21~~



# TABLE OF CONTENTS (Cont)

## PAGE

D 3/4.1 <sup>.5</sup>	Radiological Environmental Monitoring	I 3/4.1 <sup>.5</sup> -1
D 3/4.1 <sup>.5</sup> .1	Monitoring Program	I 3/4.1 <sup>.5</sup> -1
D 3/4.1 <sup>.5</sup> .2	Land Use Census	I 3/4.1 <sup>.5-13</sup> -14
D 3/4.1 <sup>.5</sup> .3	Interlaboratory Comparison Program	I 3/4.1 <sup>.5</sup> -16

BASES (Sections 3/4.1 and 3/4.2 are Retained in the Technical Specifications)

2 3.1-0

3/4.3 →	(Relocated to USAR)	I B 3/4 3-5
3/4.3.1 →	(Retained in the Technical Specifications)	
3/4.3.6		
3/4.3.7 →	(Relocated to USAR)	I B 3/4 3-5
3/4.3.7.1	(Retained in the Technical Specifications)	
3/4.3.7.2		
3/4.3.7.3 →	(Relocated to USAR)	I B 3/4 3-5
3/4.3.7.5 →	(Retained in the Technical Specifications)	
3/4.3.7.8		

B 3/4.3 <sup>.3</sup>	Instrumentation	I B 3.3-1
B 3/4.3.7.9 <sup>.3.1</sup>	Radioactive Liquid Effluent Monitoring Instrumentation	I B 3/4.3-7 <sup>.3-1</sup>

B 3/4.3.7.10 <sup>.3.2</sup>	Radioactive Gaseous Effluent Monitoring Instrumentation	I B 3/4.3-7 <sup>.3-2</sup>
------------------------------	---	-----------------------------

3/4.3.8	(Retained in the Technical Specifications)
3/4.3.9	
3/4.4 →	(Retained in the Technical Specifications)
3/4.10	

3/4.11	Radioactive Effluents	I B 3/4 11-1
--------	-----------------------	--------------

B 3/4.1 <sup>.1</sup>	Radioactive Liquid Effluents	I B 3/4.1 <sup>.1-1</sup>
B 3/4.1 <sup>.1.1</sup>	Liquid Effluents Concentration	I B 3/4.1 <sup>.1</sup> -1
B 3/4.1 <sup>.1.2</sup>	Liquid Effluents Dose	I B 3/4.1 <sup>.1-2</sup> -1



## TABLE OF CONTENTS (Cont)

### PAGE

B	<u>3/4.11.1.3</u>	Liquid Radwaste Treatment System	I B <u>3/4 11-2</u> <sup>.1-3</sup>
	<u>3/4.11.1.4</u>	(Retained in the Technical Specifications) <sup>2</sup>	
B	<u>3/4.11.2</u>	<sup>Radioactive</sup> Gaseous Effluents	I B <u>3/4 11-2</u> <sup>.2-1</sup>
B	<u>3/4.11.2.1</u>	<sup>Gaseous Effluents</sup> Dose Rate	I B <u>3/4 11-2</u> <sup>.2-1</sup>
B	<u>3/4.11.2.2</u>	<sup>Gaseous Effluents</sup> Dose of Noble Gases	I B <u>3/4 11-3</u> <sup>.2-2</sup>
B	<u>3/4.11.2.3</u>	<sup>Gaseous Effluents</sup> Dose - Iodine-131, Iodine-133, Tritium, and Radioactive Material in Particulate Form	I B <u>3/4 11-4</u> <sup>.2-3</sup>
B	<u>3/4.11.2.4</u>	Gaseous Radwaste Treatment System	I B <u>3/4 11-5</u> <sup>.2-4</sup>
B	<u>3/4.11.2.5</u>	Ventilation Exhaust Treatment System	I B <u>3/4 11-5</u> <sup>.2</sup>
	<u>3/4.11.2.6</u>	(Retained in the Technical Specifications) <sup>2</sup>	
	<u>3/4.11.2.7</u>		
B	<u>3/4.11.2.8</u>	<sup>.2.6</sup> Venting or Purging	I B <u>3/4 11-5</u> <sup>.2-6</sup>
	<u>3/4.11.3</u>	(Retained in the Technical Specifications) <sup>2</sup>	
B	<u>3/4.11.4</u>	<sup>Radioactive Effluents</sup> Total Dose	I B <u>3/4 11-6</u> <sup>.4-1</sup>
B	<u>3/4.12.1</u>	<sup>3.5</sup> Radiological Environmental Monitoring Monitoring Program	I B <u>3/4 12-1</u> <sup>3.5-1</sup>
B	<u>3/4.12.2</u>	<sup>5</sup> Land Use Census	I B <u>3/4 12-1</u> <sup>.5-2</sup>
B	<u>3/4.12.3</u>	<sup>5</sup> Interlaboratory Comparison Program	I B <u>3/4 12-2</u> <sup>.5-3</sup>
SECTION 5.0 DESIGN FEATURES (5.1.1 thru 5.1.2, 5.2 thru 5.4, 5.6 and 5.7 are retained in the Technical Specifications)			I 5-0 <sup>2</sup>
5.1.3	Maps Defining Unrestricted Areas and Site Boundary For Radioactive Gaseous and Liquid Effluents		I 5-1
5.5	Meteorological Tower Location		I 5-1

Insert  
from  
B



# TABLE OF CONTENTS (Cont)

	<u>PAGE</u>
SECTION <sup>4</sup> 6.0 ADMINISTRATIVE CONTROLS (6.1 thru 6.8 and 6.10 thru 6.13 are Retained in the Technical Specifications)	I <sup>4.0-1</sup> 6-0
D 4.1 6.9 Reporting Requirements	I <sup>4.1-1</sup> 6-19
D 4.1 6.9.1 <sup>Special</sup> Routine Reports (6.9.1.1 thru 6.9.1.6 and 6.9.1.9 are Retained in the Technical Specifications)	I <sup>4.1-1</sup> 6-19
6.9.1.7 Annual Radiological Environmental Operating Report	I 6-19
6.9.1.8 Semiannual Radioactive Effluent Release Report	I 6-20
6.9.2 (Retained in the Technical Specifications)	
6.10 → (Retained in the Technical Specifications)	
6.13	
6.14 Offsite Dose Calculation Manual	I 6-26
D 4.2 6.15 Major Changes to Liquid, Gaseous and Solid Radwaste Treatment Systems	I <sup>4.2-1</sup> 6-27



# TABLE OF CONTENTS (Cont)

SECTION	SUBJECT	REC	SECTION	PAGE
Part II -	<u>Calculational Methodologies</u> All CAPS			II 1
1.0	LIQUID EFFLUENTS			II 2
1.1	Liquid Effluent Monitor Alarm Setpoints			II 2
1.1.1	Basis	3.11	1.1	II 2
1.1.2	Setpoint Determination Methodology	3.3	7.91	II 2
1.1.2.1	Liquid Radwaste Effluent Radiation Alarm Setpoint			II 2
1.1.2.2	Contaminated Dilution Water Radwaste Effluent Monitor Alarm Setpoint Calculations			II 5
1.1.2.3	Service Water and Cooling Tower Blowdown Effluent Radiation Alarm Setpoint			II 5
1.2	Liquid Effluent Concentration Calculation	3.11	1.1	II 6
1.3	Liquid Effluent Dose Calculation Methodology	DSR 3.1.1.2	4.11.1.2	II 8
1.4	Liquid Effluent Sampling Representativeness	Table 4.1	1-1	II 9
1.5	Liquid Radwaste System Operability	3.11	1.3	II 9
		DSR 3.1.2.1	4.11.1.3.1	
		B 3.1.3	4.11.1.3.2	
2.0	GASEOUS EFFLUENTS			II 10
2.1	Gaseous Effluent Monitor Alarm Setpoints			II 10
2.1.1	Basis	3.11	2.1	II 10
2.1.2	Setpoint Determination Methodology Discussion	3.3	7.10	II 11
2.1.2.1	Stack Noble Gas Detector Alarm Setpoint Equation			II 11
2.1.2.2	Vent Noble Gas Detector Alarm Setpoint Equation			II 12
2.1.2.3	Offgas Pretreatment Noble Gas Detector Alarm Setpoint Equation			II 13
2.2	Gaseous Effluent Dose Rate Calculation Methodology	3.11	2.1	II 14
2.2.1	X/Q and W <sub>v</sub> - Dispersion Parameters for Dose Rate, Table 3-23			II 14
2.2.2	Whole Body Dose Rate Due to Noble Gases	DLCO 3.11	2.1.a	II 15
		DSR 3.4.1	2.1.1	
2.2.3	Skin Dose Rate Due to Noble Gases	DLCO 3.11	2.1.a	II 15
		DSR 3.4.1	2.1.1	
2.2.4	Organ Dose Rate Due to I-131, I-133, Tritium and Particulates with half-lives greater than 8 days	DLCO 3.11	2.1.b	II 16
		DSR 3.4.1	2.1.2	



# TABLE OF CONTENTS (Cont)

SECTION	SUBJECT	REC SECTION	PAGE
2.3	Gaseous Effluent Dose Calculation Methodology	3.112.2 3.112.3 3.112.5	II 17
2.3.1	W <sub>g</sub> and W <sub>v</sub> - Dispersion Parameters For Dose, Table 3-23		II 18
2.3.2	Gamma Air Dose Due to Noble Gases	3.112.2 a/b	II 18
2.3.3	Beta Air Dose Due to Noble Gases	DSR 3.4.1.2.2.1 3.112.2 a/b	II 18
2.3.4	Organ Dose Due to I-131, I-133, Tritium and Particulates with half-lives greater than 8 days.	3.112.3 3.112.5 DSR 3.4.1.2.3.1 DSR 3.4.1.2.5.1	II 18
2.4	I-133 and I-135 Estimation		II 19
2.5	Isokinetic Sampling		II 19
2.6	Use of Concurrent Meteorological Data vs. Historical Data		II 19
2.7	Gaseous Radwaste Treatment System Operation	3.112.4	II 20
2.8	Ventilation Exhaust Treatment System Operation	3.112.5	II 20
3.0	URANIUM FUEL CYCLE	3.114	II 20
3.1	Evaluation of Doses From Liquid Effluents	DSR 3.1.2.4.11.4.1	II 21
3.2	Evaluation of Doses From Gaseous Effluents	DSR 3.1.2.4.11.4.1	II 23
3.3	Evaluation of Doses From Direct Radiation	DSR 3.2.3.4.11.4.2	II 23
3.4	Doses to Members of the Public Within the Site Boundary	4.1 (6.9.1.8)	II 23
4.0	ENVIRONMENTAL MONITORING PROGRAM	3.125 4.12	II 26
4.1	Sampling Stations	3.12.1 DSR 3.3.1.4.12.1	II 26
4.2	Interlaboratory Comparison Program	DSR 3.3.3.4.12.2	II 26
4.3	Capabilities for Thermoluminescent Dosimeters Used for Environmental Measurements		II 26



TABLE OF CONTENTS    (Cont)

<u>SECTION</u>	<u>SUBJECT</u>	<u>REC SECTION</u>	<u>PAGE</u>
Appendix A	Liquid Dose Factor Derivation	II	61
Appendix B	Plume Shine Dose Factor Derivation	II	64
Appendix C	Dose Parameters for Iodine 131 and 133, Particulates and Tritium	II	68
Appendix D	Diagrams of Liquid and Gaseous Radwaste Treatment Systems and Monitoring Systems	II	78
Appendix E	Nine Mile Point On-Site and Off-Site Maps	II	101



# LIST OF TABLES

## PART I - RADIOLOGICAL EFFLUENT CONTROLS

<u>TABLE NO</u>	<u>TITLE</u>	<u>PAGE</u>
1.1	Surveillance Frequency Notations	I 1-5
1.2	Operational Conditions	I 1-6
3.3.7.3-1	Deleted - Page Intentionally Left Blank	I 3/4 3-75
4.3.7.3-1	Deleted - Page Intentionally Left Blank	I 3/4 3-76
D 3.3. <sup>1</sup> 7.9-1	Radioactive Liquid Effluent Monitoring Instrumentation	I 3/4 <sup>3-6</sup> 3-93
4.3.7.9-1	Radioactive Liquid Effluent Monitoring Instrumentation Surveillance Requirements	I 3/4 3-95
D 3.3. <sup>2</sup> 7.10-1	Radioactive Gaseous Effluent Monitoring Instrumentation	I 3/4 <sup>3-13</sup> 3-98
4.3.7.10-1	Radioactive Gaseous Effluent Monitoring Instrumentation Surveillance Requirements	I 3/4 3-100
D 3.3. <sup>1</sup> 4.1.1-1	Radioactive Liquid Waste Sampling and Analysis Program	I 3/4 <sup>1-2</sup> 1-2
D 3.3. <sup>1</sup> 4.1.2-1	Radioactive Gaseous Waste Sampling and Analysis Program	I 3/4 <sup>2-2</sup> 1-9
D 3. <sup>5</sup> 12.1-1	Radiological Environmental Monitoring Program	I 3/4 <sup>5-6</sup> 12-3
D 3. <sup>5</sup> 12.1-2	Reporting Levels for Radioactivity Concentrations in Environmental Samples	I 3/4 <sup>5-11</sup> 12-10
D 3.5.1-3 4.12.1-1	Detection Capabilities for Environmental Sample Analyses	I 3/4 <sup>5-12</sup> 12-11



**LIST OF TABLES** (Cont)

**PART II - CALCULATIONAL METHODOLOGIES**

<u><b>TABLE NO</b></u>	<u><b>TITLE</b></u>	<u><b>PAGE</b></u>
D 2-1	Liquid Effluent Detector Response	II 28
D 2-2 thru <sup>D</sup> <sub>A</sub> 2-5	A <sub>lat</sub> Values - Liquid Effluent Dose Factor	II 29
D 3-1	Offgas Pretreatment Detector Response	II 33
D 3-2	Finite Plume - Ground Level Dose Factors from an Elevated Release	II 34
D 3-3	Immersion Dose Factors	II 35
D 3-4 thru <sup>D</sup> <sub>A</sub> 3-22	Dose And Dose Rate Factors, R <sub>i</sub>	II 36
D 3-23	Dispersion Parameters at Controlling Locations, X/Q, W <sub>v</sub> and W <sub>s</sub> Values	II 55
D 3-24	Parameters For the Evaluation of Doses to Real Members of the Public From Gaseous And Liquid Effluents	II 56
D 5.1	Radiological Environmental Monitoring Program Sampling Locations	II 57



LIST OF FIGURES

<u>FIGURE NO</u>	<u>TITLE</u>	<u>PAGE</u>
D 5.1-1	Site Boundaries and Land Portion of Exclusion Area Boundaries	I 10 <sup>1.0</sup> 3-5
D 5.1-1	Nine Mile Point On-Site Map	II 100 <sup>1</sup>
D 5.1-2	Nine Mile Point Off-Site Map	II 103 <sup>2</sup> /103a



section 5.5.1

The ODCM will be maintained for use as a reference and training document of accepted methodologies and calculations. Changes to the calculation methods or parameters will be incorporated into the ODCM to assure that the ODCM represents the present methodology in all applicable areas. Any changes to the ODCM will be implemented in accordance with Section 6.14 of the Technical Specifications.

Until the Unit 2 Technical Specifications are revised to delete the Radiological Effluent Technical Specifications, the ODCM Part I will be used as a reference only, and the Technical Specifications with LCO's and Surveillance requirements will remain the primary controlling document.



## DISCUSSION OF CHANGES

### Definitions

#### ADMINISTRATIVE

In the relocation and conversion of the Nine Mile Point Unit 2 current Technical Specifications (CTS) to the proposed Offsite Dose Calculation Manual (ODCM) used in support of the Improved Technical Specifications (ITS), certain wording preferences or conventions are adopted that do not result in technical changes (either actual or interpretational). Editorial changes, the elimination of redundant wording, reformatting and revised numbering are adopted to make the ODCM consistent with ITS.

In the specific case of the Definitions, the numbering has been updated for Technical Specification references and ITS wording and formatting has been applied. Table 1.1, "Surveillance Frequency Notations", has been deleted since the notation is no longer used. With the exception of environmental sampling, the frequency notations have been replaced with times in hours, days, months, etc., and the usage as described in the ITS Section 1.4. The frequencies for environmental sampling, Section D 3.5.1, Table D 3.5.1-1 have not been changed from those given in the Current Technical Specifications (CTS). The usage for the frequencies used in environmental sampling are in accordance with the Radiological Environmental Monitoring Program (REMP), which is a joint program between Nine Mile Point and James A. Fitzpatrick. Table 1.2, "Operation Conditions", has been deleted as it is redundant to ITS Table 1.1-1, "Modes". Figure D 1.0-1 "Site Area and Land Portion of Exclusion Area Boundary" has been moved from Section 5.0, "Design Features." The figure has been updated to correspond to the ITS Figure 4.1-1.



# **PART I - RADIOLOGICAL EFFLUENT CONTROLS**



## **PART I - RADIOLOGICAL EFFLUENT CONTROLS**

### **SECTION 1.0 DEFINITIONS**



## 1.0 DEFINITIONS

---

-----NOTE-----

Technical Specifications defined terms and the following additional defined terms appear in capitalized type and are applicable throughout these specifications and bases.

-----

<u>TERM</u>	<u>DEFINITION</u>
GASEOUS RADWASTE TREATMENT SYSTEM	A GASEOUS RADWASTE TREATMENT SYSTEM shall be any system designed and installed to reduce radioactive gaseous effluents by collecting offgases from the main condenser evacuation system and providing for delay or holdup for the purpose of reducing the total radioactivity prior to release to the environment.
MEMBER(S) OF THE PUBLIC	MEMBER(S) OF THE PUBLIC shall include all persons who are not occupationally associated with the Nine Mile Point Nuclear Station and James A. FitzPatrick Nuclear Power Plant. This category does not include employees of Niagara Mohawk Power Corporation, the Nine Mile Point Unit 2 co-tenants, the New York State Power Authority, their contractors or vendors. Also excluded from this category are persons who enter the site to service equipment or to make deliveries. This category does include persons who use portions of the site for recreational, occupational, or other purposes not associated with Nine Mile Point Nuclear Station and James A. FitzPatrick Nuclear Power Plant.
MILK SAMPLING LOCATION	A MILK SAMPLING LOCATION is a location where 10 or more head of milk animals are available for collection of milk samples.
OFFSITE DOSE CALCULATION MANUAL	The OFFSITE DOSE CALCULATION MANUAL (ODCM) shall contain the current methodology and parameters used in the calculation of offsite doses that result from radioactive gaseous and liquid effluents, in the calculation of gaseous and liquid effluent monitoring Alarm/Trip Setpoints, and in the conduct of the environmental radiological monitoring program. The ODCM shall also contain: (1) the Radioactive Effluent Controls and Radiological Environmental Monitoring Program required by Specification 5.5.1 of Technical Specifications and, (2) descriptions of the information that should be included in the Annual Radiological Environmental Operating and Radioactive Effluent Release Reports required by Technical Specifications 5.6.2 and 5.6.3.

---

(continued)



## 1.0 DEFINITIONS (continued)

---

<u>TERM</u>	<u>DEFINITION</u>
PURGE – PURGING	PURGE and PURGING shall be the controlled process of discharging air or gas from a confinement to maintain temperature, pressure, concentration, or other operating condition, in such a manner that replacement air or gas is required to purify the confinement.
REPORTABLE EVENT	A REPORTABLE EVENT shall be any of those conditions specified in 10 CFR 50.73.
SITE BOUNDARY	The SITE BOUNDARY shall be that line around the Nine Mile Point Nuclear Station beyond which the land is not owned, leased or otherwise controlled by the Niagara Mohawk Power Corporation or the New York State Power Authority. See Figure D 1.0-1.
SOURCE CHECK	A SOURCE CHECK shall be the qualitative assessment of channel response when the channel sensor is exposed to a source of increased radioactivity.
UNRESTRICTED AREA	An UNRESTRICTED AREA shall be any area at or beyond the SITE BOUNDARY, access to which is not controlled by the Niagara Mohawk Power Corporation or the New York State Power Authority for purposes of protection of individuals from exposure to radiation and radioactive materials, or any area within the SITE BOUNDARY used for residential quarters or for industrial, commercial, institutional, and/or recreational purposes.
VENTILATION EXHAUST TREATMENT SYSTEM	A VENTILATION EXHAUST TREATMENT SYSTEM shall be any system designed and installed to reduce gaseous radioiodine or radioactive material in particulate form in effluents by passing ventilation or vent exhaust gases through charcoal adsorbers and/or HEPA filters for the purpose of removing iodines or particulates from the gaseous exhaust stream prior to the release to the environment (such a system is not considered to have any effect on noble gas effluents). Engineered safety features (ESF) atmospheric cleanup systems are not considered to be VENTILATION EXHAUST TREATMENT SYSTEM components.

---

(continued)



## **1.0 DEFINITIONS (continued)**

---

<u>TERM</u>	<u>DEFINITION</u>
VENTING	VENTING shall be the controlled process of discharging air or gas from a confinement to maintain temperature, pressure, concentration, or other operating condition, in such a manner that replacement air or gas is not provided or required during VENTING. Vent, used in system names, does not imply a VENTING process.

---



0 N 1 A R 1 0



# SCALE-MILES

**Figure D 1.0-1 (Page 1 of 1)**



## **PART I - RADIOLOGICAL EFFLUENT CONTROLS**



## **PART I - RADIOLOGICAL EFFLUENT CONTROLS**

### **SECTION 1.0 DEFINITIONS**



## 1.0 DEFINITIONS

*Technical Specifications defined terms and the following additional*

### NOTE

The defined terms appear in capitalized type and are applicable throughout these specifications and bases.

### TERM

### DEFINITION

#### ACTION

Action shall be that part of a DLCO which prescribes remedial measures required under designated conditions.

#### CHANNEL CALIBRATION

*move up*  
A CHANNEL CALIBRATION shall be the adjustment, as necessary, of the channel output so that it responds within the necessary range and accuracy to known values of the parameter which the channel monitors. The CHANNEL CALIBRATION shall encompass the entire channel including the sensor and alarm and/or trip functions, and shall include the CHANNEL FUNCTIONAL TEST. The CHANNEL CALIBRATION may be performed by any series of sequential, overlapping or total channel steps such that the entire channel is calibrated.

#### CHANNEL CHECK

A CHANNEL CHECK shall be the qualitative assessment of channel behavior during operation by observation. This determination shall include, where possible, comparison of the channel indication and/or status with other indications and/or status derived from independent instrument channels measuring the same parameter.

#### CHANNEL FUNCTIONAL TEST

A CHANNEL FUNCTIONAL TEST shall be:

- a. Analog channels - the injection of a simulated signal into the channel as close to the sensor as practicable to verify OPERABILITY including alarm and/or trip functions and channel failure trips.
- b. Bistable channels - the injection of a simulated signal into the sensor to verify OPERABILITY including alarm and/or trip functions.

The CHANNEL FUNCTIONAL TEST may be performed by any series of sequential overlapping or total channel steps so that the entire channel is tested.



**1.0 DEFINITIONS****TERM****DEFINITION**

DOSE  
EQUIVALENT  
I-131

DOSE EQUIVALENT I-131 shall be that concentration of I-131, expressed in microcuries per gram, which alone would produce the same thyroid dose as the quantity and isotopic mixture of I-131, I-132, I-133, I-134, and I-135 actually present. The thyroid dose conversion factors used for this calculation shall be those listed in Table III of TID-14844, AEC, 1962, "Calculation of Distance Factors for Power and Test Reactor Sites; Table E-7 of Regulatory Guide 1.109, Rev. 1, NRC, 1977, or ICRP30, Supplement to Part 1, Page 192-212, Table titled, "Committed Dose Equivalent in Target Organs or Tissues per Intake of Unit Activity "

GASEOUS  
RADWASTE  
TREATMENT  
SYSTEM

A GASEOUS RADWASTE TREATMENT SYSTEM shall be any system designed and installed to reduce radioactive gaseous effluents by collecting offgases from the main condenser evacuation system and providing for delay or holdup for the purpose of reducing the total radioactivity prior to release to the environment.

MEMBER(S)  
OF THE PUBLIC

MEMBER(S) OF THE PUBLIC shall include all persons who are not occupationally associated with the Nine Mile Point Nuclear Station and James A. FitzPatrick Nuclear Power Plant. This category does not include employees of Niagara Mohawk Power Corporation, the Nine Mile Point Unit 2 co-tenants, the New York State Power Authority, their contractors or vendors. Also excluded from this category are persons who enter the site to service equipment or to make deliveries. This category does include persons who use portions of the site for recreational, occupational, or other purposes not associated with Nine Mile Point Nuclear Station and James A. FitzPatrick Nuclear Power Plant.

MILK SAMPLING  
LOCATION

A MILK SAMPLING LOCATION is a location where 10 or more head of milk animals are available for collection of milk samples.



## 1.0 DEFINITIONS

TERM	DEFINITION
✓ OFFSITE DOSE CALCULATION MANUAL	↗ The OFFSITE DOSE CALCULATION MANUAL (ODCM) shall contain the current methodology and parameters used in the calculation of offsite doses that result from radioactive gaseous and liquid effluents, in the calculation of gaseous and liquid effluent monitoring Alarm/Trip Setpoints, and in the conduct of the environmental radiological monitoring program. The ODCM shall also contain: (1) the Radioactive Effluent Controls and Radiological Environmental Monitoring Program required by Section 5.5.1 of Technical Specifications and, (2) descriptions of the information that should be included in the Annual Radiological Environmental Operating and Radioactive Effluent Release Reports required by Technical Specifications 5.6.2 and 5.6.3.
↗ OPERABLE - OPERABILITY	↗ A system, subsystem, division, component, or device shall be OPERABLE or have OPERABILITY when it is capable of performing its specified safety function(s) and when all necessary attendant instrumentation, controls, normal or emergency electrical power, cooling and seal water, lubrication, and other auxiliary equipment that are required for the system, subsystem, division, component, or device to perform its specified safety function(s) are also capable of performing their related support function(s).
↗ MODE	↗ A MODE shall correspond to any one inclusive combination of mode switch position, average reactor coolant temperature, and reactor vessel head closure bolt tensing as specified in Table D 1.0-1 with fuel in the reactor vessel.
✓ PURGE - PURGING	↗ PURGE and PURGING shall be the controlled process of discharging air or gas from a confinement to maintain temperature, pressure, concentration, or other operating condition, in such a manner that replacement air or gas is required to purify the confinement.
↗ RATED THERMAL POWER (RTP)	↗ RTP shall be a total reactor core heat transfer rate to the reactor coolant of 3467 MWt.
✓ REPORTABLE EVENT	↗ A REPORTABLE EVENT shall be any of those conditions specified in 10 CFR 50.73.



## 1.0 DEFINITIONS

### TERM

### DEFINITION

✓ **SITE BOUNDARY** THE SITE BOUNDARY shall be that line around the Nine Mile Point Nuclear Station beyond which the land is not owned, leased or otherwise controlled by the Niagara Mohawk Power Corporation or the New York State Power Authority. See Figure D 1.0-1.

✓ **SOURCE CHECK** A SOURCE CHECK shall be the qualitative assessment of channel response when the channel sensor is exposed to a source of increased radioactivity.

✓ **THERMAL POWER**

THERMAL POWER shall be the total reactor core heat transfer rate to the reactor coolant.

✓ **UNRESTRICTED AREA**

An UNRESTRICTED AREA shall be any area at or beyond the SITE BOUNDARY, access to which is not controlled by the Niagara Mohawk Power Corporation or the New York State Power Authority for purposes of protection of individuals from exposure to radiation and radioactive materials, or any area within the SITE BOUNDARY used for residential quarters or for industrial, commercial, institutional, and/or recreational purposes.

✓ **VENTILATION EXHAUST TREATMENT SYSTEM**

A VENTILATION EXHAUST TREATMENT SYSTEM shall be any system designed and installed to reduce gaseous radioiodine or radioactive material in particulate form in effluents by passing ventilation or vent exhaust gases through charcoal adsorbers and/or HEPA filters for the purpose of removing iodines or particulates from the gaseous exhaust stream prior to the release to the environment (such a system is not considered to have any effect on noble gas effluents). Engineered safety features (ESF) atmospheric cleanup systems are not considered to be VENTILATION EXHAUST TREATMENT SYSTEM components.

✓ **VENTING**

VENTING shall be the controlled process of discharging air or gas from a confinement to maintain temperature, pressure, concentration, or other operating condition, in such a manner that replacement air or gas is not provided or required during VENTING. Vent, used in system names, does not imply a VENTING process.



Definitions

1.0

**Figure D 1.0-1 (Page 1 of 1)**  
**Site Area and Land Portion of Exclusion Area Boundaries**



**TABLE D 1.0-1**

**MODES**

MODE	REACTOR MODE SWITCH POSITION	AVERAGE REACTOR COOLANT TEMPERATURE °F
1. Power Operation	Run	Any temperature
2. Startup	Refuel <sup>(a)</sup> or Startup/Hot Standby	Any temperature
3. Hot Shutdown <sup>(a)</sup>	Shutdown	> 200°F
4. Cold Shutdown <sup>(a)</sup>	Shutdown	≤ 200°F
5. Refueling <sup>(b)</sup>	Shutdown or Refuel	NA

<sup>(a)</sup> All reactor vessel head closure bolts fully tensioned.

<sup>(b)</sup> One or more reactor vessel head closure bolts less than fully tensioned.

*delete  
this is in Tech Specs*



## DISCUSSION OF CHANGES

### 3.0 Applicability

#### ADMINISTRATIVE

The ODCM Specifications are approved for relocation in the conversion the improved Technical Specifications (ITS). In that verbatim relocation is approved, the specifications are relocated with the current Technical Specifications (CTS) applicability discussions as detailed in 3/4.0 Applicability. ITS LCOs 3.0.6 and 3.0.7 are not appropriate for inclusion in the ODCM and are, therefore, so stated as excluded.

The definitions and rules of usage associated with the Improved Technical Specifications (ITS) are applied to the ODCM Specifications, with the exception of the frequencies used in Specification 3.5.1 for environmental sampling. The frequencies for environmental sampling are in accordance with the Radiological Effluent Monitoring Program (REMP). While some of the revised or added specifications and definitions are specifically more restrictive, and some are specifically less restrictive than the CTS requirements, the No Significant Hazards Evaluation prepared for the ITS Amendment, and the NRC review and acceptance of these changes for the Technical Specifications also support their application to the relocated Specifications. With the Technical Specifications definitions and rules for usage and application also applied to the ODCM Specifications, consistency in implementation and compliance is benefited. Definitions and allowances acceptable for Technical Specification use and application can be administratively applied to non-Technical Specification requirements with no safety impact. Given the relative safety significance of the Technical Specifications (for which the NRC has approved these rules of usage) versus that of the ODCM, there is no unreviewed safety question in adopting the same NRC approved use and application rules for the ODCM Specifications.

#### TECHNICAL

Several Applicability section changes approved in the NRC Safety Evaluation for the Improved Technical Specifications Amendment are appropriate for application to the ODCM, both for their technical merit and for consistency. Cumulatively the changes are classified as less restrictive. The specific changes and a discussion of each follow.

1. The CTS 3.0.4 phrase "unless the conditions for the Limiting Condition for Operation are met without reliance on provisions contained in the ACTION requirements" was changed to "except when the associated ACTIONS to be entered permit continued operation in the MODE or other specified condition in the Applicability for an unlimited period of time." This statement is consistent



with the Generic Letter 87-09 guidance regarding changing of MODES while relying upon the ACTION requirements when they permit continued operation for an unlimited period of time.

2. ITS LCO 3.0.5 is added to provide an exception to ITS LCO 3.0.2 for instances where restoration of inoperable equipment to an OPERABLE status could not be performed while continuing to comply with Required Actions. Some Specifications ACTIONS require an inoperable component to be removed from service. To allow the performance of Surveillance Requirements to demonstrate OPERABILITY of the equipment being returned to service or to demonstrate the OPERABILITY of other equipment, which otherwise could not be performed without returning the equipment to service, an exception to these Required Actions is necessary. LCO 3.0.5 is necessary to establish an allowance that, although informally utilized in restoration of inoperable equipment, is not formally recognized in the CTS.

3. The statement, "For frequencies specified as "once," the above interval extension does not apply," was added to CTS 4.0.2 (ITS SR 3.0.2) to clarify that the 1.25 times the interval specified in the Frequency does not apply to certain Surveillances.

4. The statement, "If a Completion Time requires periodic performance on a "once per ..." basis, the above Frequency extension applies to each performance after the initial performance," was added to CTS 4.0.2 (proposed ITS SR 3.0.2) to allow the 1.25 times the interval specified in the Frequency concept to apply to periodic Required Actions. This provides the consistency in scheduling flexibility for all performances of periodic requirements, whether they are Surveillances or Required Actions. The intent remains to perform the activity, on the average, once during each specified interval.

5. ITS SR 3.0.3 allows that, at the time it is discovered that the Surveillance has not been performed, the requirement to declare the equipment inoperable (DLCO not met) may be delayed for up to 24 hours regardless as to whether the Completion Times of the Actions are 24 hours or less, as is currently allowed in CTS 4.0.3. This is based on NRC Generic Letter 87-09, which states, "It is overly conservative to assume that systems or components are inoperable when a surveillance has not been performed. The opposite is in fact the case, the vast majority of surveillances demonstrate that systems or components in fact are operable. When a Surveillance is missed, it is primarily a question of operability that has not been verified by the performance of the required surveillance."

Based on consideration of plant conditions, adequate planning, availability of personnel, the time required to perform the Surveillance and the safety significance of the delay in completing the Surveillance, the NRC concluded in the Generic Letter that 24 hours is an acceptable time limit for completing a missed Surveillance when the allowable outage times of the ACTIONS are less than the 24 hour limit or a shutdown is required to comply with ACTIONS.



However, since 24 hours has been determined to be an acceptable time limit for completing the Surveillance, it is reasonable to apply this 24 hour deferral to all systems or components, regardless of whether or not their ACTIONS Completion Time is 24 hours or less. This is primarily because shorter Completion Times are generally provided for more safety significant Required Actions; therefore, there should be less of a safety impact when a 24 hour delay is applied to a Required Action with a long Completion Time. In addition, the limit of 24 hours is not applicable if the specified Frequency of the missed Surveillance is less than 24 hours; instead, the specified Frequency would dictate the delay period. Therefore, the proposed SR 3.0.3 has eliminated the restriction that the extension only apply to outage times less than 24 hours, as is currently allowed in CTS 4.0.3.

The second and third paragraphs of proposed SR 3.0.3 are added to clearly state the actions to take if the Surveillance is not performed within the delay period or the Surveillance fails when performed. This clarification will help avoid confusion as to when the Completion Time(s) of the Required Action(s) begin in various situations.



# **PART I - RADIOLOGICAL EFFLUENT CONTROLS**

## **SECTION 3.0 APPLICABILITY**



### **3.0 APPLICABILITY**

---

The Offsite Dose Calculation Manual (ODCM) Specifications are contained in Section 3.0 of Part I. They contain operational requirements, Surveillance Requirements, and reporting requirements. Additionally, the Required Actions and associated Completion Times for degraded Conditions are specified. The format is consistent with the Technical Specifications (Appendix A to the NMP2 Operating License).

The rules of usage for the ODCM Specification are the same as those for the Technical Specifications. These rules are found in Technical Specifications Sections 1.2, "Logical Connectors," 1.3, "Completion Times," and 1.4, "Frequency."


The ODCM Specifications are subject to Technical Specifications Section 3.0, "Limiting Condition for Operation (LCO) Applicability and Surveillance Requirement (SR) Applicability," with the following exceptions:

1. LCO 3.06, regarding support/supported system ACTIONS is not applicable to ODCM Specifications.
  2. LCO 3.0.7, regarding allowances to change specified Technical Specifications is not applicable to ODCM Specifications.
  3. Section 3.0 requirements are not required when so stated in notes within individual specifications.
-



**PART I - RADIOLOGICAL EFFLUENT CONTROLS**

**SECTIONS 3.0 AND 4.0**

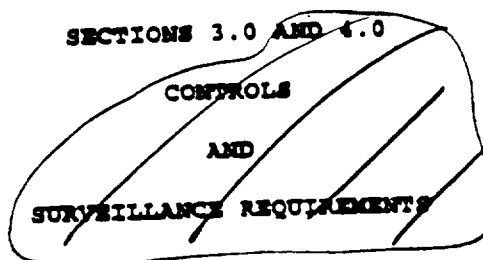

**APPLICABILITY**



Insert :

### 3.0 APPLICABILITY

The Offline Data Calculation Manual (ODCM) Specifications are contained in Section 3.0 of Part I. They contain operational requirements, Surveillance Requirements, and reporting requirements. Additionally, the Required Actions and associated Completion Times for degraded Conditions are specified. The format is consistent with the Technical Specifications (Appendix A to the NMP's Operating License).

The rules of usage for the ODCM Specifications are the same as those for the Technical Specifications. These rules are found in Technical Specifications Section 1.2, "Logical Connectors;" 1.3, "Completion Times;" and 1.4, "Frequency."

The ODCM Specifications are subject to Technical Specifications Section 3.0, "Limiting Condition for Operation (LCO) Applicability and Surveillance Requirement (SR) Applicability," with the following exceptions:

1. LCO 3.0.6, regarding support/supported system ACTIONS is not applicable to ODCM Specifications.
2. LCO 3.0.7, regarding allowances to change specified Technical Specifications is not applicable to ODCM Specifications.
3. Section 3.0 requirements are not applicable when so stated in notes within individual Specifications.



### 3/4 CONTROLS AND SURVEILLANCE REQUIREMENTS

#### 3/4.0 APPLICABILITY

##### CONTROLS

DLCOs

in the Applicability,

MODES

DLCO - 3.0.1 ~~Compliance with the~~ <sup>shall be met</sup> ~~CONTROLS~~ <sup>during the</sup> ~~OPERATIONAL~~ <sup>CONDITIONS</sup> or other conditions specified ~~except that upon failure to~~ <sup>as provided</sup> ~~meet the CONTROL, the associated ACTION requirements shall be met~~ <sup>in</sup> 3.0.2a  
3.0.7a

3.0.2 Noncompliance with a CONTROL shall exist when the requirements of the CONTROL and associated ACTION requirements are not met within the specified time intervals. If the CONTROL is restored prior to expiration of the specified time intervals, completion of the ACTION requirements is not required.

Insert (2)

3.0.3 When a CONTROL is not met, except as provided in the associated ACTION requirements, within 1 hour action shall be initiated to place the unit in an OPERATIONAL CONDITION in which the CONTROL does not apply by placing it, as applicable, in:

1. At least STARTUP within the next 8 hours,
2. At least HOT SHUTDOWN within the following 6 hours, and
3. At least COLD SHUTDOWN within the subsequent 24 hours.

Where corrective measures are completed that permit operation under the ACTION requirements, the ACTION may be taken in accordance with the specified time limits as measured from the time of failure to meet the CONTROL. Exceptions to these requirements are stated in the individual CONTROLS.

This CONTROL is not applicable to OPERATIONAL CONDITIONS 4 or 5.

3.0.4 Entry into an OPERATIONAL CONDITION or other specified condition shall not be made unless the conditions for the CONTROL are met without reliance on provisions contained in the ACTION requirements. This provision shall not prevent passage through or to OPERATIONAL CONDITIONS as required to comply with ACTION requirements. Exceptions to these requirements are stated in the individual CONTROLS.

INSERT (3)  
INSERT (4), (5) and (6)

Upon discovery of a failure to meet a CONTROL, the Required Actions of the associated CONTROL shall be met, except as provided in LCO 3.0.5 and LCO 3.0.6.

If the CONTROL is met or is no longer applicable prior to expiration of the specified Completion Time(s), completion of the Required Action(s) is not required, unless otherwise stated.



~~APPENDIX~~

## SURVEILLANCE REQUIREMENTS (SR) APPLICABILITY

~~SRs~~

~~(in the Applicability)~~

~~OPERATIONAL MODES~~

DSR 3.0.1

~~SURVEILLANCE REQUIREMENTS shall be met during the~~  
~~OPERATIONAL MODES or other conditions specified for individual Controls unless~~  
~~otherwise stated in an~~  
~~SR.~~

DSR 3.0.2

~~Each SURVEILLANCE REQUIREMENT shall be performed within the specified~~  
~~time interval with a maximum allowable extension not to exceed 25% of the~~  
~~surveillance interval.~~

DSR 3.0.3

~~Failure to perform a SURVEILLANCE REQUIREMENT within the allowed~~  
~~surveillance interval, defined by Specification 4.0.2, shall constitute~~  
~~noncompliance with the OPERABILITY requirements for a CONTROL. The time~~  
~~limits of the ACTION requirements are applicable at the time it is identified~~  
~~that a SURVEILLANCE REQUIREMENT has not been performed. The ACTION~~  
~~requirements may be delayed for up to 24 hours to permit the completion of the~~  
~~surveillance when the allowable outage time limits of the ACTION requirements~~  
~~are less than 24 hours. SURVEILLANCE REQUIREMENTS do not have to be performed~~  
~~on inoperable equipment.~~

Move to  
SR 3.0.1

Move to  
SR 3.

DSR 3.0.4

~~Entry into an OPERATIONAL CONDITION or other specified applicable~~  
~~condition shall not be made unless the Surveillance Requirement(s) associated~~  
~~with the CONTROL have been performed within the applicable surveillance~~  
~~interval or as otherwise specified. This provision shall not prevent passage~~  
~~through or to OPERATIONAL CONDITIONS as required to comply with ACTION~~  
~~requirements.~~

Insert  
10

### INSERT 7

Failure to meet a Surveillance, whether such failure is experienced during the performance

### INSERT 8

The specified Frequency for each SR is met if the surveillance is performed within 1.25 times the interval specified in the Frequency, as measured from the previous performance or as measured from the time a specified condition of the Frequency is met.

For Frequencies specified as "once," the above interval extension does not apply.

If a Completion Time requires periodic performance on a "once per..." basis, the above Frequency extension applies to each performance after the initial performance.

Exceptions to this Specification are stated in the individual Specifications.

Unit 2  
Revision 14  
June 1998



DISCUSSION OF CHANGES  
D 3.1.1 Liquid Effluents Concentration

ADMINISTRATIVE

In the relocation and conversion of the Nine Mile Point Unit 2 current Technical Specifications (CTS) to the proposed Offsite Dose Calculation Manual (ODCM) used in support of the Improved Technical Specifications (ITS), certain wording preferences or conventions are adopted that do not result in technical changes (either actual or interpretational). Editorial changes, such as the elimination of redundant wording, reformatting and revised numbering are adopted to make the ODCM consistent with ITS.

In the specific case of the Liquid Effluent Concentration, the new Specification number is D 3.1.1.

TECHNICAL

In the specific case of the Part II – Calculational Methodologies, wording has been changed to incorporate the revised 10 CFR Part 20. Nine Mile Point's position is to use ten times the concentration limits specified in 10 CFR 20 Appendix B, Table 2, Column 2.

NEI (formerly NUMARC) requested clarification from the NRC with regard to implementation of Appendix B to 10 CFR 20. The NRC acknowledged in accordance with the provision of 10 CFR 20.1008 (c), that appendix B to 10 CFR 20.1 – 20.602 remains a valid reference for gaseous and liquid effluent Technical Specifications. Therefore, licensees could choose to maintain their existing level of effluent control as adequate implementation of the ALARA requirement.

The old 10 CFR 20 Appendix B, Table II, Column 2 values are equivalent to the concentrations which, if inhaled or ingested would produce an annual whole body dose of 500 mRem. The revised 10 CFR 20 Appendix B, Table 2, Column 2 values are equivalent to the radionuclide concentrations which, if inhaled or ingested continuously over the course of a year, would produce a total effective dose equivalent of 50 mRem. Therefore, ten times the revised 10 CFR 20 Appendix B, Table 2, Column 2 concentration values would produce the equivalent requirement of the current values in 10 CFR 20 Appendix B, Table II, Column 2. This will allow Nine Mile Point to maintain the level of effluent control and operational flexibility that existed with the current Technical Specifications under the old 10 CFR 20.

In addition, Nine Mile Point will be retaining these concentration values (i.e., ten times the revised 10 CFR 20 values) as instantaneous release rate limits which is



more conservative than demonstrating compliance by averaging the release rate over the course of a year (revised 10 CFR 20).

Furthermore, 40 CFR 190 and 10 CFR 50 Appendix I set limits or design objectives for releases of radioactive material to the general environment that are generally more restrictive than the dose limits in the revised 10 CFR 20. Consequently, since these more restrictive standards remained essentially unchanged by the 10 CFR 20 amendments, the level of public protection and the associated environmental impact are not changed appreciably from those associated with existing practice under 10 CFR 20 and the aforementioned regulations.

In conclusion, instantaneous release rate limits of ten times the concentration limits is more restrictive than the concentration limits averaged over one year specified in 10 CFR 20 Appendix B, Table 2, Column 2.

**Basis:**

1. NEI (formerly NUMARC) White Paper on Radiological Effluent Technical Specifications and Revised 10 CFR Part 20 Implementation to the NRC in April 1993.
2. Draft Generic Letter, "Guidance for Modification of Technical Specifications to Reflect (A) Revisions to 10 CFR part 20, "Standards for Protection Against Radiation" and 10 CFR 50.36a, "Technical specifications on effluents from nuclear power reactors," (B) Related Current Industry Initiatives, and (C) Miscellaneous Related Editorial Clarifications. Federal Register, Vol. 58, No. 245, 12/23/1993.



## D 3.1 RADIOACTIVE LIQUID EFFLUENTS

### D 3.1.1 Liquid Effluents Concentration

DLCO 3.1.1 The concentration of radioactive material released in liquid effluents to UNRESTRICTED AREAS (Figure D 1.0-1) shall be limited to:

- a. Ten times the concentration specified in 10 CFR Part 20, Appendix B, Table 2, Column 2 for radionuclides other than dissolved or entrained noble gases; and
- b.  $2 \times 10^{-4}$   $\mu\text{Ci/ml}$  total activity concentration for dissolved or entrained noble gases.

APPLICABILITY: At all times.

### ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. Concentration of radioactive material released in liquid effluents to UNRESTRICTED AREAS exceeds limits.	A.1 Initiate action to restore concentration to within limits.	Immediately

### SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
DSR 3.1.1.1 Perform radioactive liquid waste sampling and activity analysis.	In accordance with Table D 3.1.1-1
DSR 3.1.1.2 Verify the results of the DSR 3.1.1.1 analyses to assure that the concentrations at the point of release are maintained within the limits of DLCO 3.1.1.	In accordance with Table D 3.1.1-1