

J. Bernie Beasley, Jr., P.E.
Vice President
Vogtle Project

**Southern Nuclear
Operating Company, Inc.**
40 Inverness Center Parkway
P.O. Box 1295
Birmingham, Alabama 35201

Tel 205.992.7110
Fax 205.992.0403



March 22, 2001

Docket Nos: 50-424
50-425

U. S. Nuclear Regulatory Commission
ATTN: Document Control Desk
Washington, D. C. 20555

Ladies and Gentlemen:

**VOGTLE ELECTRIC GENERATING PLANT
REVISION OF UNIT 1 AND UNIT 2
PRESSURE AND TEMPERATURE LIMITS REPORT**

Pursuant to the reporting requirements of Vogtle Electric Generating Plant (VEGP) Technical Specification 5.6.6, Southern Nuclear Operating Company (SNC) is submitting Revision 1 of the Unit 1 PRESSURE AND TEMPERATURE LIMITS REPORT (PTLR) and Revision 1 of the Unit 2 PTLR. This update incorporates the replacement of the positive displacement pump by the normal charging pump. This change does not impact the pressure and temperature limits, nor the methodology used to establish those limits.

Sincerely,

A handwritten signature in black ink, appearing to read "J. B. Beasley, Jr.", is written over the printed name.

JBB/JPC

Attachment

cc: Southern Nuclear Operating Company
Mr. J. T. Gasser
Mr. M. Sheibani
SNC Document Management

U. S. Nuclear Regulatory Commission
Mr. L. A. Reyes, Regional Administrator
Mr. Ramin R. Assa, Vogtle Project Manager, NRR
Mr. J. Zeiler, Senior Resident Inspector, Vogtle

1001

VOGTLE ELECTRIC GENERATING PLANT - UNIT 1
PRESSURE AND TEMPERATURE LIMITS REPORT
REVISION 1

Prepared by: Jimmy Paul Cash 3-19-01

Reviewed by: J. G. Bailey 03-20-01

**VOGTLE ELECTRIC GENERATING PLANT (VEGP) – UNIT 1
PRESSURE AND TEMPERATURE LIMITS REPORT**

Table of Contents

Section		Page
1.0	Reactor Coolant System (RCS) Pressure and Temperature Limits Report (PTLR) - Unit 1	1
2.0	Operating Limits	1
	2.1 RCS Pressure and Temperature (P/T) Limits	1
	2.2 Cold Overpressure Protection System (COPS) Setpoints	2
3.0	Supplemental Data Tables	9
4.0	Reactor Vessel Material Surveillance Program	19
5.0	Reactor Vessel Surveillance Data Credibility	19
6.0	References	25

**VOGTLE ELECTRIC GENERATING PLANT (VEGP) – UNIT 1
PRESSURE AND TEMPERATURE LIMITS REPORT**

List of Figures

Figure		Page
2.1-1	Unit 1 Reactor Coolant System Heatup Limitations (Heatup rates up to 100 °F/hr). Applicable for the First 16 EFPY (With Margins of 10 °F and 60 psig for Instrumentation Errors and Margin of 74 psig for Pressure Difference Between Pressure Instrumentation and Reactor Vessel Beltline Region).	3
2.1-2	Unit 1 Reactor Coolant System Cooldown Limitations (Cooldown rates up to 100 °F/hr). Applicable for the First 16 EFPY (With Margins of 10 °F and 60 psig for Instrumentation Errors and Margin of 74 psig for Pressure Difference Between Pressure Instrumentation and Reactor Vessel Beltline Region).	5
2.2-1	Unit 1 Maximum Allowable Nominal PORV Setpoint for the Cold Overpressure Protection System	7

**VOGTLE ELECTRIC GENERATING PLANT (VEGP) – UNIT 1
PRESSURE AND TEMPERATURE LIMITS REPORT**

List of Tables

Table		Page
2.1-1	Data Points for Unit 1 Reactor Coolant System Heatup Limitations	4
2.1-2	Data Points for Unit 1 Reactor Coolant System Cooldown Limitations	6
2.2-1	Data Points for Unit 1 PORV Setpoints	8
3.0-1	Comparison of the Vogtle Unit 1 Surveillance Material 30 ft-lb Transition Temperature Shifts and Upper Shelf Energy Decrease with Regulatory Guide 1.99, Revision 2, Predictions	10
3.0-2	Vogtle Unit 1 Calculation of Chemistry Factors Using Surveillance Capsule Data	11
3.0-3	Vogtle Unit 1 Reactor Vessel Toughness Table (Unirradiated)	12
3.0-4	Vogtle Unit 1 Reactor Vessel Surface Fluence Values at 16 EFPY (Fluence Based on $E > 1.0$ MeV)	12
3.0-5	Summary of Adjusted Reference Temperatures (ARTs) for the Vogtle Unit 1 Reactor Vessel Beltline Materials at the 1/4-T and 3/4-T Locations for 16 EFPY	13
3.0-6	Calculation of Adjusted Reference Temperature at 16 EFPY for the Limiting Vogtle Unit 1 Reactor Vessel Material (Intermediate Shell Plate B8805-2)	14
3.0-7	Neutron Exposure Projections at Key Locations on the Vogtle Unit 1 Pressure Vessel Clad/Base Metal Interface	15
3.0-8	RT _{PTS} Values for Vogtle Unit 1 for 4.64 EFPY	16
3.0-9	RT _{PTS} Values for Vogtle Unit 1 for 32 EFPY	17
3.0-10	RT _{PTS} Values for Vogtle Unit 1 for 48 EFPY	18
5.0-1	Calculation of Best Line Drawn as Described in Regulatory Position 2.1 of Regulatory Guide 1.99, Revision 2	22

VOGTLE ELECTRIC GENERATING PLANT (VEGP) - UNIT 1 PRESSURE AND TEMPERATURE LIMITS REPORT

1.0 Reactor Coolant System (RCS) Pressure and Temperature Limits Report (PTLR) - Unit 1

This PTLR for VEGP Unit 1 has been prepared in accordance with the requirements of Technical Specification (TS) 5.6.6. The TS addressed in this report are listed below:

LCO 3.4.3 RCS Pressure and Temperature (P/T) Limits

LCO 3.4.12 Cold Overpressure Protection Systems (COPS)

2.0 Operating Limits

The parameter limits for the specifications listed in section 1.0 are presented in the following subsections. The current limits were developed using a methodology that is in accordance with the NRC-approved methodology specified in Specification 5.6.6 (Ref. 1) with two exceptions. The two exceptions are the fluence methodology used to calculate the heatup and cooldown limits and the incorporation of random pressure uncertainty in the cold overpressure protection system setpoints. Future changes to these limits will be made in full compliance with the NRC-approved methodology, and the first revision to the limits after initial implementation of this PTLR will be submitted to the NRC for prior approval. Subsequent revisions will be made in accordance with the NRC-approved methodology without prior approval. It should be noted that the heatup and cooldown limit curves and the cold overpressure protection system setpoints were approved by the NRC staff by Amendment 87 dated June 8, 1995.

2.1 RCS Pressure and Temperature (P/T) Limits (LCO 3.4.3)

2.1.1 The RCS temperature rate-of-change limits are (Ref. 2):

- a. A maximum heatup of 100 °F in any 1-hour period.
- b. A maximum cooldown of 100 °F in any 1-hour period.
- c. A maximum temperature change of less than or equal to 10 °F in any 1-hour period during inservice hydrostatic and leak testing operations above the heatup and cooldown limit curves.

2.1.2 The RCS P/T limits for heatup and cooldown are specified by Figures 2.1-1 and 2.1-2, respectively.

**VOGTLE ELECTRIC GENERATING PLANT (VEGP) - UNIT 1
PRESSURE AND TEMPERATURE LIMITS REPORT**

2.2 Cold Overpressure Protection System (COPS) Setpoints (LCO 3.4.12)

The power-operated relief valves (PORVs) shall each have lift settings in accordance with Figure 2.2-1.

The setpoints in combination with the relief capacity of the PORVs will protect the RCS from the limiting mass injection transient of two centrifugal charging pumps plus the normal charging pump injecting into the RCS and the limiting heat input transient of starting a RCP with the RCS 50 °F colder than the secondary coolant.

**VOGTLE ELECTRIC GENERATING PLANT (VEGP) - UNIT 1
PRESSURE AND TEMPERATURE LIMITS REPORT**

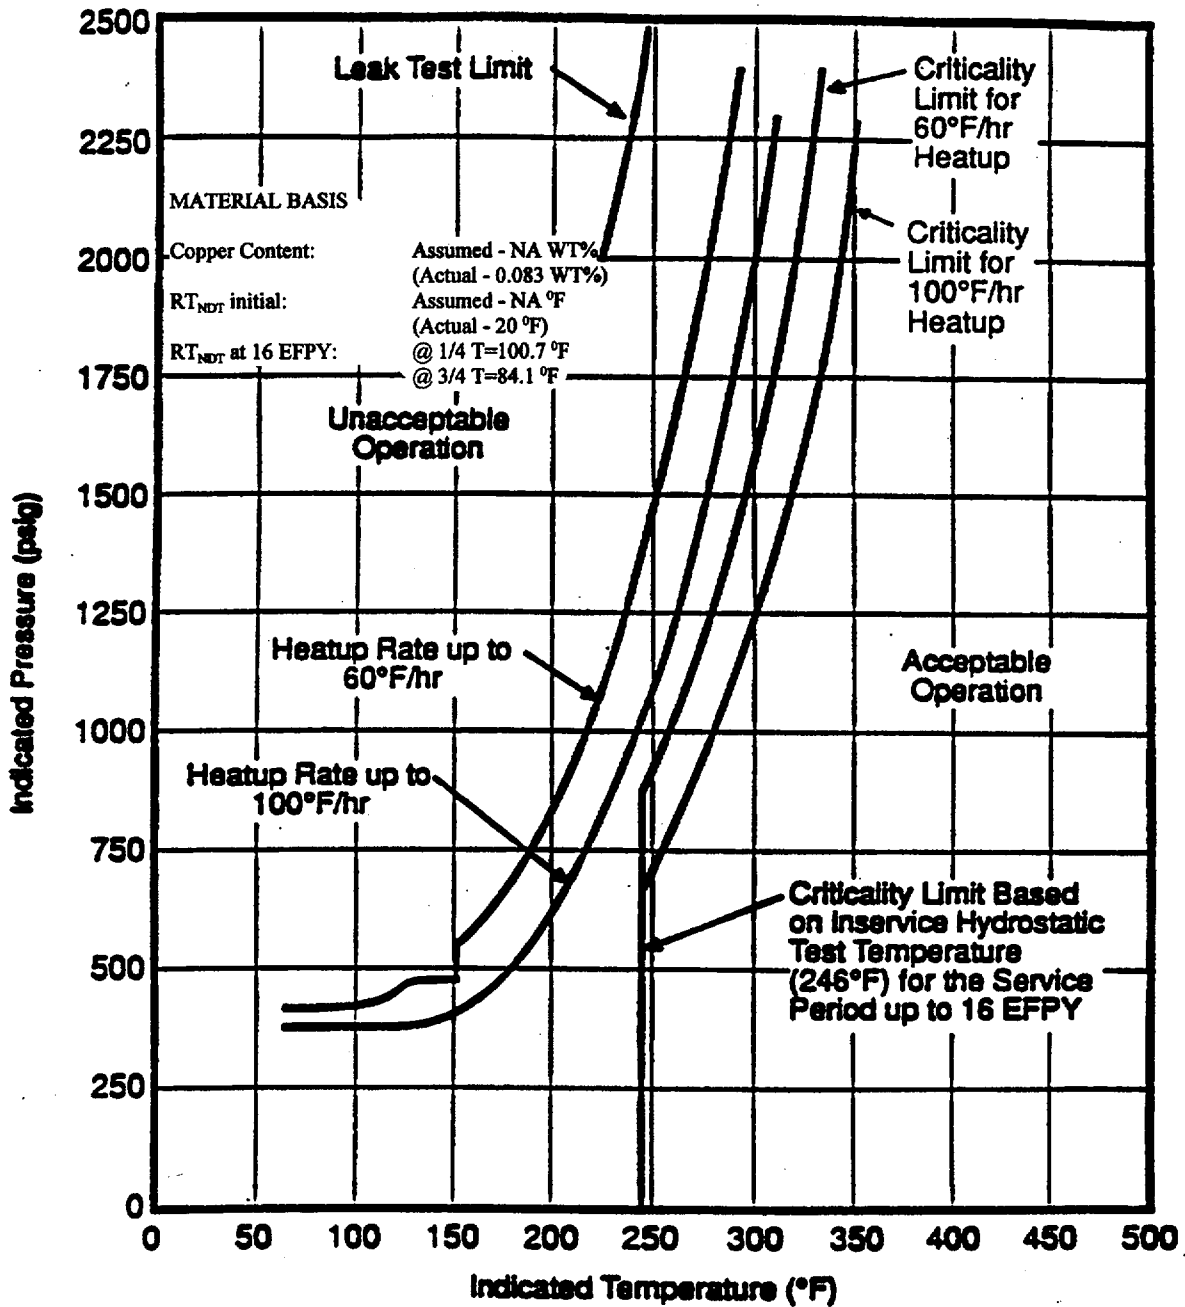


Figure 2.1-1

Unit 1 Reactor Coolant System Heatup Limitations (Heatup Rates up to 100 °F/hr)
Applicable for the First 16 EFPY
(With Margins of 10 °F and 60 psig for Instrumentation Errors and Margin of 74 psig for
Pressure Difference Between Pressure Instrumentation and Reactor Vessel Beltline Region)

VOGTLE ELECTRIC GENERATING PLANT (VEGP) - UNIT 1 **PRESSURE AND TEMPERATURE LIMITS REPORT**

Table 2.1-1
Data Points for Unit 1 Reactor Coolant System Heatup Limitations

60 HU		Criticality Limit		100 HU		Criticality Limit		Hydrostatic Leak Test	
T	P	T	P	T	P	T	P	T	P
70	411.59	246	0.00	70	379.59	246	0.00	225	2000
75	411.59	246	411.59	75	379.59	246	379.59	246	2485
80	411.59	246	411.59	80	379.59	246	379.59		
85	411.59	246	411.59	85	379.59	246	379.59		
90	411.59	246	411.59	90	379.59	246	379.59		
95	411.59	246	411.59	95	379.59	246	379.59		
100	413.02	246	413.02	100	379.59	246	379.59		
105	416.63	246	416.63	105	379.59	246	379.59		
110	422.40	246	422.40	110	379.59	246	379.59		
115	429.94	246	429.94	115	379.59	246	379.59		
120	439.34	246	439.34	120	381.23	246	381.23		
125	450.36	246	450.36	125	384.46	246	384.46		
130	462.96	246	462.96	130	389.32	246	389.32		
135	477.28	246	477.28	135	395.71	246	395.71		
140	487.00	246	487.00	140	403.67	246	403.67		
145	487.00	246	487.00	145	413.05	246	413.05		
150	487.00	246	487.00	150	424.12	246	424.12		
155	530.18	246	530.18	155	436.75	246	436.75		
155	551.31	246	551.31	160	451.02	246	451.02		
160	574.18	246	574.18	165	466.81	246	466.81		
165	599.11	246	599.11	170	484.47	246	484.47		
170	625.99	246	625.99	175	503.91	246	503.91		
175	654.97	246	654.97	180	525.12	246	525.12		
180	686.48	246	686.48	185	548.41	246	548.41		
185	720.23	246	720.23	190	573.65	246	573.65		
190	756.57	246	756.57	195	601.20	246	601.20		
195	795.85	246	795.85	200	630.96	246	630.96		
200	837.97	246	837.97	205	663.11	246	663.11		
205	883.21	246	883.21	210	698.05	250	698.05		
210	931.85	250	931.85	215	735.63	255	735.63		
215	984.06	255	984.06	220	776.14	260	776.14		
220	1039.90	260	1039.90	225	819.75	265	819.75		
225	1100.16	265	1100.16	230	866.71	270	866.71		
230	1164.70	270	1164.70	235	917.23	275	917.23		
235	1233.69	275	1233.69	240	971.48	280	971.48		
240	1308.02	280	1308.02	245	1029.79	285	1029.79		
245	1387.43	285	1387.43	250	1092.22	290	1092.22		
250	1472.31	290	1472.31	255	1159.47	295	1159.47		
255	1563.28	295	1563.28	260	1231.28	300	1231.28		
260	1660.77	300	1660.77	265	1308.60	305	1308.60		
265	1765.08	305	1765.08	270	1391.31	310	1391.31		
270	1876.53	310	1876.53	275	1479.80	315	1479.80		
275	1995.33	315	1995.33	280	1574.52	320	1574.52		
280	2122.41	320	2122.41	285	1675.74	325	1675.74		
285	2257.67	325	2257.67	290	1783.98	330	1783.98		
290	2401.70	330	2401.70	295	1899.51	335	1899.51		
				300	2023.06	340	2023.06		
				305	2154.59	345	2154.59		
				310	2294.65	350	2294.65		

**VOGTLE ELECTRIC GENERATING PLANT (VEGP) - UNIT 1
PRESSURE AND TEMPERATURE LIMITS REPORT**

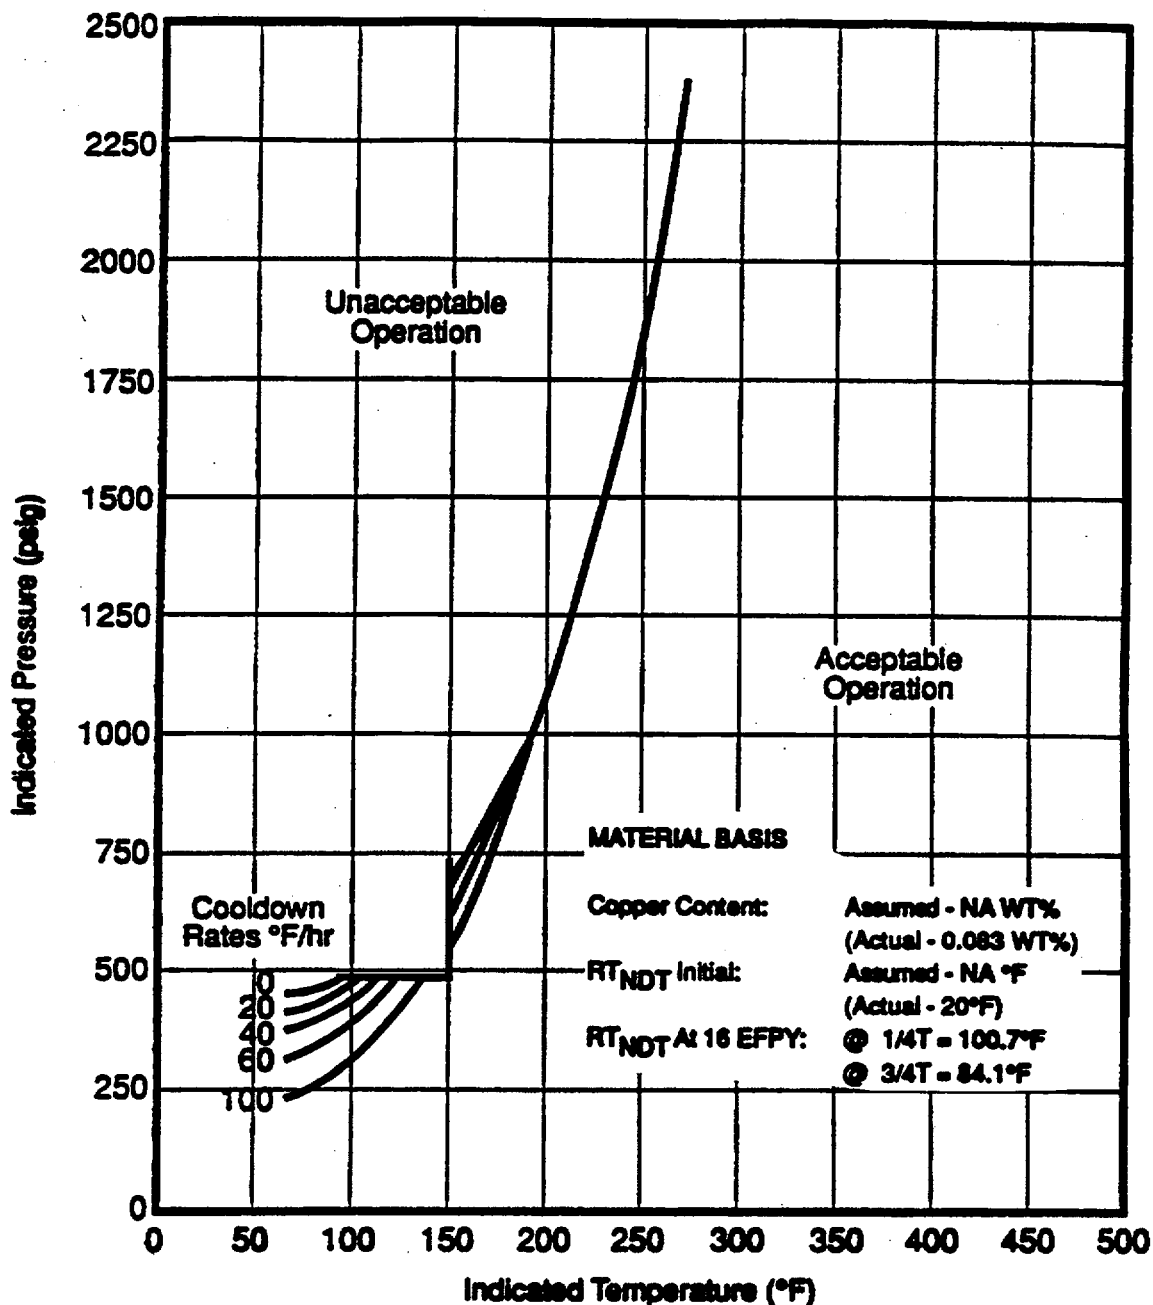


Figure 2.1-2

Unit 1 Reactor Coolant System Cooldown Limitations (Cooldown Rates up to 100 °F/hr)
Applicable for the First 16 EFY
(With Margins of 10 °F and 60 psig for Instrumentation Errors and Margin of 74 psig for
Pressure Difference Between Pressure Instrumentation and Reactor Vessel Beltline Region)

VOGTLE ELECTRIC GENERATING PLANT (VEGP) - UNIT 1 PRESSURE AND TEMPERATURE LIMITS REPORT

Table 2.1-2
Data Points for Unit 1 Reactor Coolant System Cooldown Limitations

Steady State		20 CD		40 CD		60 CD		100 CD	
T	P	T	P	T	P	T	P	T	P
70	441.06	70	401.75	70	361.89	70	321.34	70	238.56
75	449.91	75	410.96	75	371.60	75	331.70	75	250.28
80	459.29	80	420.95	80	382.15	80	342.88	80	262.93
85	469.52	85	431.74	85	393.56	85	354.98	85	276.69
90	480.51	90	443.33	90	405.83	90	367.93	90	291.47
95	487.00	95	455.84	95	418.98	95	382.03	95	307.58
100	487.00	100	469.15	100	433.25	100	397.22	100	324.90
105	487.00	105	483.64	105	448.66	105	413.54	105	343.74
110	487.00	110	487.00	110	465.11	110	431.24	110	364.07
115	487.00	115	487.00	115	483.00	115	450.35	115	385.99
120	487.00	120	487.00	120	487.00	120	470.81	120	409.73
125	487.00	125	487.00	125	487.00	125	487.00	125	435.30
130	487.00	130	487.00	130	487.00	130	487.00	130	462.87
135	487.00	135	487.00	135	487.00	135	487.00	135	487.00
140	487.00	140	487.00	140	487.00	140	487.00	140	487.00
145	487.00	145	487.00	145	487.00	145	487.00	145	487.00
150	487.00	150	487.00	150	487.00	150	487.00	150	487.00
150	697.52	150	674.44	150	652.71	150	632.35	150	597.16
155	725.51	155	704.35	155	684.91	155	666.93	155	637.55
160	755.50	160	736.74	160	719.47	160	704.15	160	681.03
165	787.98	165	771.39	165	756.69	165	744.45	165	727.95
170	822.71	170	808.59	170	796.90	170	787.66	170	778.47
175	859.97	175	848.62	175	840.01	175	834.17	175	832.90
180	900.00	180	891.83	180	886.37	180	884.17	180	891.46
185	943.02	185	938.13	185	936.26	185	937.98		
190	989.43	190	987.88						
195	1038.93								
200	1092.31								
205	1149.67								
210	1211.10								
215	1276.80								
220	1347.74								
225	1423.41								
230	1504.91								
235	1591.99								
240	1685.30								
245	1785.26								
250	1892.15								
255	2006.55								
260	2128.76								
265	2259.41								
270	2398.54								

VOGTLE ELECTRIC GENERATING PLANT (VEGP) - UNIT 1
PRESSURE AND TEMPERATURE LIMITS REPORT

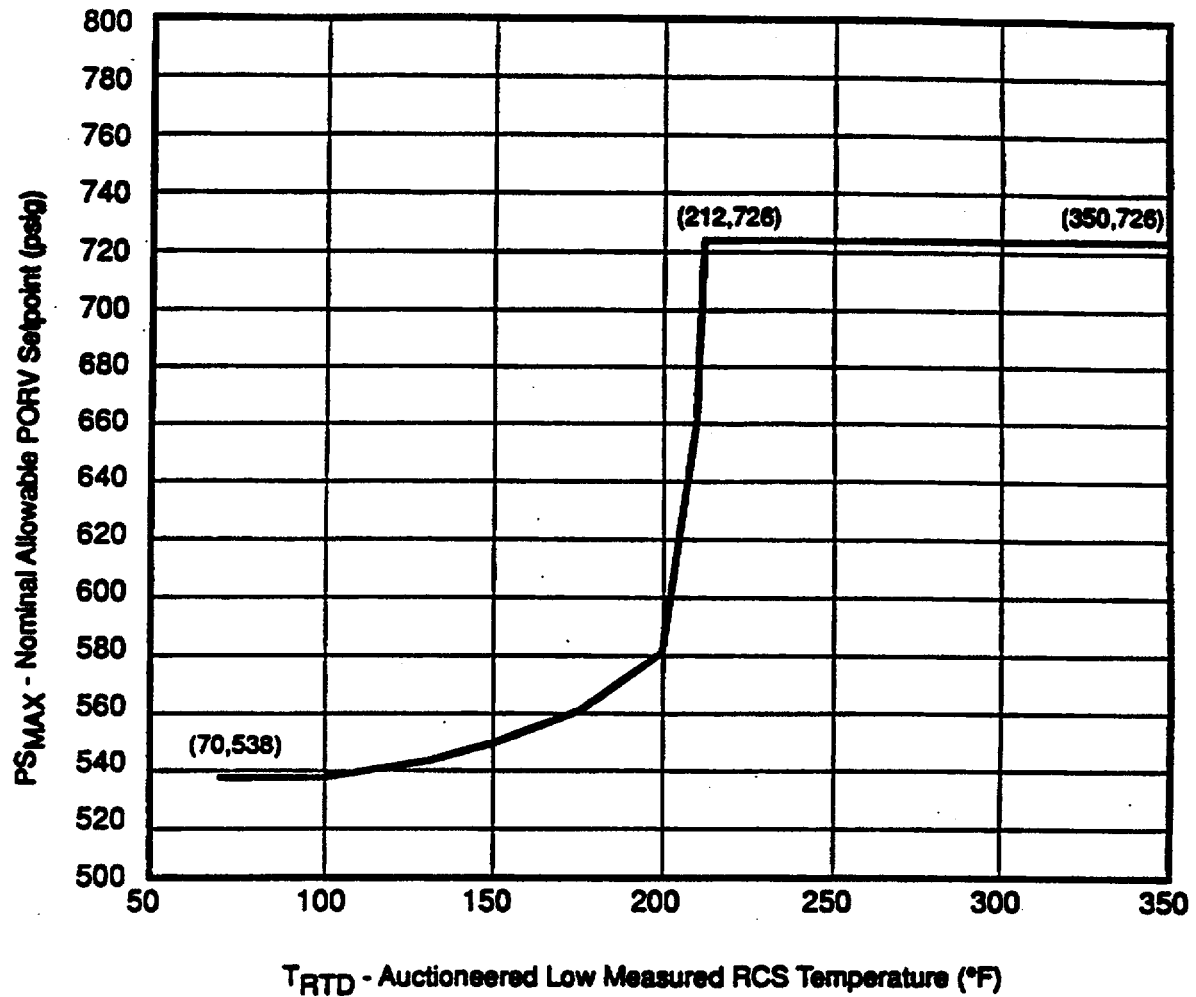


Figure 2.2-1

Unit 1 Maximum Allowable Nominal PORV Setpoint
for the Cold Overpressure Protection System

**VOGTLE ELECTRIC GENERATING PLANT (VEGP) - UNIT 1
PRESSURE AND TEMPERATURE LIMITS REPORT**

Table 2.2-1
Data Points for Unit 1 PORV Setpoints

Temperature (° F)	Pressure (psig)
70	538
100	538
130	540
160	550
180	560
200	576
210	660
212	726
350	726

VOGTLE ELECTRIC GENERATING PLANT (VEGP) - UNIT 1 PRESSURE AND TEMPERATURE LIMITS REPORT

3.0 Supplemental Data Tables

Table 3.0-1 is a comparison of the measured surveillance material 30 ft-lb transition temperature shifts and upper shelf energy decreases with Regulatory Guide 1.99, Revision 2 predictions.

Table 3.0-2 shows the calculation of the surveillance material chemistry factors using surveillance capsule data.

Table 3.0-3 provides the unirradiated Vogtle Unit 1 reactor vessel toughness data. The bolt-up temperature is also included in this table.

Table 3.0-4 provides a summary of the fluences used in the generation of the heatup and cooldown curves.

Table 3.0-5 provides a summary of the adjusted reference temperatures (ARTs) of the Vogtle Unit 1 reactor vessel beltline materials at the 1/4-T and 3/4-T locations for 16 EFPY.

Table 3.0-6 shows the calculation of the ART at 16 EFPY for the limiting Vogtle Unit 1 reactor vessel material (intermediate shell plate B8805-2).

Table 3.0-7 provides a summary of the fluences used in the PTS evaluation.

Table 3.0-8 provides RT_{PTS} values for Vogtle Unit 1 for 4.64 EFPY.

Table 3.0-9 provides RT_{PTS} values for Vogtle Unit 1 for 32 EFPY.

Table 3.0-10 provides RT_{PTS} values for Vogtle Unit 1 for 48 EFPY.

**VOGTLE ELECTRIC GENERATING PLANT (VEGP) - UNIT 1
PRESSURE AND TEMPERATURE LIMITS REPORT**

Table 3.0-1						
Comparison of the Vogtle Unit 1 Surveillance Material 30 ft-lb Transition Temperature Shifts and Upper Shelf Energy Decrease with Regulatory Guide 1.99 Revision 2 Predictions						
Material	Capsule	Fluence ($\times 10^{19}$ n/cm ² , E > 1.0 MeV)	30 ft-lb Transition Temperature Shift		Upper Shelf Energy Decrease	
			Predicted ^(a) (°F)	Measured (°F)	Predicted ^(a) (%)	Measured ^(a) (%)
Intermediate Shell Plate B8805-3 (Longitudinal)	U	0.344	27	15	15	0
	Y	1.24	41	40	20	0
Intermediate Shell Plate B8805-3 (Transverse)	U	0.344	27	0	15	0
	Y	1.24	41	20	20	0
Weld Metal	U	0.344	23	15	15	0
	Y	1.24	35	0	20	1
HAZ Metal	U	0.344	-	0	-	6
	Y	1.24	-	25	-	9

(a) Based on Regulatory Guide 1.99, Revision 2, methodology using mean wt. % values of Cu and Ni.

**VOGTLE ELECTRIC GENERATING PLANT (VEGP) - UNIT 1
PRESSURE AND TEMPERATURE LIMITS REPORT**

Table 3.0-2						
Vogtle Unit 1 Calculation of Chemistry Factors Using Surveillance Capsule Data						
Material	Capsule	Fluence (f) (n/cm ² , E > 1.0 MeV)	FF ^(a)	ΔRT_{NDT} (°F)	FF* ΔRT_{NDT} (°F)	FF ²
Intermediate Shell Plate B8805-3 (Longitudinal)	U	3.437 x 10 ¹⁸	0.706	15	10.585	0.498
	Y	1.242 x 10 ¹⁹	1.060	40	42.4	1.124
Intermediate Shell Plate B8805-3 (Transverse)	U	3.437 x 10 ¹⁸	0.706	0	0	0.498
	Y	1.242 x 10 ¹⁹	1.060	20	21.2	1.124
	Sum:				74.185	3.244
	Chemistry Factor = 74.185 ÷ 3.244 = 22.9					
Weld Metal	U	3.437 x 10 ¹⁸	0.706	15	10.585	0.498
	Y	1.242 x 10 ¹⁹	1.060	0	0	1.124
	Sum:				10.585	1.622
	Chemistry Factor = 10.585 ÷ 1.622 = 6.5					

(a) Fluence Factor (FF) per Regulatory Guide 1.99, Revision 2, is defined as $FF = f^{(0.28 - 0.10 \log f)}$

**VOGTLE ELECTRIC GENERATING PLANT (VEGP) - UNIT 1
PRESSURE AND TEMPERATURE LIMITS REPORT**

Table 3.0-3			
Vogtle Unit 1 Reactor Vessel Toughness Table (Unirradiated)			
Material Description	Cu (%) ^(a)	Ni (%) ^(a)	Initial RT _{NDT} (° F) ^(b)
Closure Head Flange	--	0.70	20 ^(c)
Vessel Flange	--	0.71	0 ^(c)
Intermediate Shell Plate B8805-1	0.083	0.597	0
Intermediate Shell Plate B8805-2	0.083	0.610	20
Intermediate Shell Plate B8805-3	0.062	0.598	30
Lower Shell Plate B8606-1	0.053	0.593	20
Lower Shell Plate B8606-2	0.057	0.600	20
Lower Shell Plate B8606-3	0.067	0.623	10
Intermediate & Lower Shell Vertical Weld Seams and Girth Seam Weld	0.039	0.102	-80

(a) The average values of copper and nickel content.

(b) Initial RT_{NDT} values are measured values.

(c) These values are used for considering flange requirements for the heatup/cooldown curves. Per the methodology given in WCAP-14040, Revision 1, the minimum boltup temperature is 60° F.

**VOGTLE ELECTRIC GENERATING PLANT (VEGP) - UNIT 1
PRESSURE AND TEMPERATURE LIMITS REPORT**

Table 3.0-4						
Vogtle Unit 1 Reactor Vessel Surface Fluence Values at 16 EFPY (Fluence Based on E > 1.0 MeV)						
Azimuthal	0°	15°	25°	30°	35°	45°
Surface	6.216E+18	9.236E+18	1.088E+19	6.897E+18	9.043E+18	1.015E+19

Table 3.0-5		
Summary of Adjusted Reference Temperatures (ARTs) for the Vogtle Unit 1 Reactor Vessel Beltline Materials at the 1/4-T and 3/4-T Locations for 16 EFPY		
Component	16 EFPY ART ^(a)	
	1/4-T (°F)	3/4-T (°F)
Intermediate Shell Plate B8805-1	80.7	64.1
Intermediate Shell Plate B8805-2	100.7 ^(b)	84.1 ^(b)
Intermediate Shell Plate B8805-3	97.5	76.4
Intermediate Shell Plate B8805-3 Using S/C Data	67.1	57.6
Lower Shell Plate B8606-1	77.6	59.6
Lower Shell Plate B8606-2	81.9	62.5
Lower Shell Plate B8606-3	80.8	60.6
Circ. Weld 101-171	-21.7	-39.9
Circ. Weld 101-171 Using S/C Data	-68.6	-72.2
Long. Weld 101-124A	-31.8 ^(c)	-48.5 ^(c)
Long. Weld 101-124B	-30.0 ^(d)	-47.0 ^(d)
Long. Weld 101-124C	-30.0 ^(d)	-47.0 ^(d)
Long. Weld 101-142A	-30.0 ^(d)	-47.0 ^(d)
Long. Weld 101-142B	-31.8 ^(c)	-48.5 ^(c)
Long. Weld 101-142C	-30.0 ^(d)	-47.0 ^(d)

(a) The ARTs presented here are based on the peak reactor vessel surface fluence of 1.088×10^{19} n/cm² (E > 1.0 MeV) unless noted.

(b) These ART values are used to generate the heatup and cooldown curves.

(c) These ARTs were calculated using the peak vessel fluence of 6.216×10^{18} n/cm² (E > 1.0 MeV) at 0°.

(d) These ARTs were calculated using the peak vessel fluence of 6.897×10^{18} n/cm² (E > 1.0 MeV) at 30°.

**VOGTLE ELECTRIC GENERATING PLANT (VEGP) - UNIT 1
PRESSURE AND TEMPERATURE LIMITS REPORT**

Table 3.0-6		
Calculation of Adjusted Reference Temperature at 16 EFPY for the Limiting Vogtle Unit 1 Reactor Vessel Material (Intermediate Shell Plate B8805-2)		
Parameter	ART Value	
Operating Time	16 EFPY	
Material	B8805-2	B8805-2
Location	1/4-T	3/4-T
Chemistry Factor, CF (°F)	53.1	53.1
Fluence $\div 10^{19}$ n/cm ² (E > 1.0 MeV), $f^{(a)}$	0.6485	0.2303
Fluence Factor, FF ^(b)	0.879	0.604
$\Delta RT_{NDT} = CF \times FF$, (°F)	46.653	32.056
Initial RT_{NDT} , I (°F)	20	20
Margin, M (°F) ^(c)	34	32.056
$ART = I + (CF \times FF) + M$ (°F) per Regulatory Guide 1.99, Revision 2	100.7	84.1

(a) Fluence, f , is based upon f_{surf} (10^{19} n/cm², E > 1.0 MeV) = 1.088 at 16 EFPY. The Vogtle Unit 1 reactor vessel wall thickness is 8.625 inches at the beltline region.

(b) Fluence Factor (FF) per Regulatory Guide 1.99, Revision 2, is defined as $FF = f^{(0.28 - 0.10 \log f)}$.

(c) Margin is calculated as $M = 2(\sigma_i^2 + \sigma_\Delta^2)^{0.5}$. The standard deviation for the initial RT_{NDT} margin term, σ_i , is 0 °F since the initial RT_{NDT} is a measured value. The Standard deviation for ΔRT_{NDT} term σ_Δ , is 17 °F for the plate, except that σ_Δ need not exceed 0.5 times the mean value of ΔRT_{NDT} .

**VOGTLE ELECTRIC GENERATING PLANT (VEGP) - UNIT 1
PRESSURE AND TEMPERATURE LIMITS REPORT**

Table 3.0-7						
Neutron Exposure Projections ⁽¹⁾ at Key Locations on the Vogtle Unit 1 Pressure Vessel Clad/Base Metal Interface						
EFPY	0°	15°	25°	30°	35°	45°
4.64	0.1802	0.2678	0.3155	0.2000	0.2622	0.2942
32	1.243	1.847	2.176	1.379	1.809	2.029
48	1.863	2.769	3.262	2.068	2.711	3.041

(1) Fluence in 10^{19} n/cm² (E > 1.0 MeV).

**VOGTLE ELECTRIC GENERATING PLANT (VEGP) - UNIT 1
PRESSURE AND TEMPERATURE LIMITS REPORT**

Table 3.0-8							
RT _{PTS} Values for Vogtle Unit 1 for 4.64 EFPY							
Material	CF (°F)	Surface Fluence (n/cm ² , E > 1.0 MeV)	FF	ΔRT _{NDT} (CF x FF) (°F)	I (°F)	M (°F)	RT _{PTS} (°F)
Inter. Shell Plate B8805-1	53.1	3.155 x 10 ¹⁸	0.6833	36.3	0	34	70.3
Inter. Shell Plate B8805-2	53.1	3.155 x 10 ¹⁸	0.6833	36.3	20	34	90.3
Inter. Shell Plate B8805-3	38.4	3.155 x 10 ¹⁸	0.6833	26.2	30	34	90.2
Inter. Shell Plate B8805-3 Using S/C Data ⁽¹⁾	22.9	3.155 x 10 ¹⁸	0.6833	15.6	30	34	79.6
Lower Shell Plate B8606-1	32.8	3.155 x 10 ¹⁸	0.6833	22.4	20	34	76.4
Lower Shell Plate B8606-2	35.2	3.155 x 10 ¹⁸	0.6833	24.1	20	34	78.1
Lower Shell Plate B8606-3	41.9	3.155 x 10 ¹⁸	0.6833	28.6	10	34	72.6
Circ. Weld 101-171	33.2	3.155 x 10 ¹⁸	0.6833	22.7	-80	56	-1.3
Weld Metal Using S/C Data ⁽¹⁾	6.5	3.155 x 10 ¹⁸	0.6833 ⁽²⁾	4.4	-80	56	-19.6
Long. Weld 101-124A	33.2	1.802 x 10 ¹⁸	0.5448	18.1	-80	56	-5.9
Long. Weld 101-124B	33.2	2.0 x 10 ¹⁸	0.5694	18.9	-80	56	-5.1
Long. Weld 101-124C	33.2	2.0 x 10 ¹⁸	0.5694	18.9	-80	56	-5.1
Long. Weld 101-142A	33.2	2.0 x 10 ¹⁸	0.5694	18.9	-80	56	-5.1
Long. Weld 101-142B	33.2	1.802 x 10 ¹⁸	0.5448	18.1	-80	56	-5.9
Long. Weld 101-142C	33.2	2.0 x 10 ¹⁸	0.5694	18.9	-80	56	-5.1

(1) Numbers were calculated using a chemistry factor (CF) based on surveillance capsule data.

(2) Peak fluence factor which represents most limiting case for weld metal.

**VOGTLE ELECTRIC GENERATING PLANT (VEGP) - UNIT 1
PRESSURE AND TEMPERATURE LIMITS REPORT**

Table 3.0-9							
RT _{PTS} Values for Vogtle Unit 1 for 32 EFPY							
Material	CF (°F)	Surface Fluence (n/cm ² , E > 1.0 MeV)	FF	ΔRT _{NDT} (CF x FF) (°F)	I (°F)	M (°F)	RT _{PTS} (°F)
Inter. Shell Plate B8805-1	53.1	2.176 x 10 ¹⁹	1.2110	64.3	0	34	98.3
Inter. Shell Plate B8805-2	53.1	2.176 x 10 ¹⁹	1.2110	64.3	20	34	118.3
Inter. Shell Plate B8805-3	38.4	2.176 x 10 ¹⁹	1.2110	46.5	30	34	110.5
Inter. Shell Plate B8805-3 Using S/C Data ⁽¹⁾	22.9	2.176 x 10 ¹⁹	1.2110	27.7	30	34	91.7
Lower Shell Plate B8606-1	32.8	2.176 x 10 ¹⁹	1.2110	39.7	20	34	93.7
Lower Shell Plate B8606-2	35.2	2.176 x 10 ¹⁹	1.2110	42.6	20	34	96.6
Lower Shell Plate B8606-3	41.9	2.176 x 10 ¹⁹	1.2110	50.7	10	34	94.7
Circ. Weld 101-171	33.2	2.176 x 10 ¹⁹	1.2110	40.2	-80	56	16.2
Weld Metal Using S/C Data ⁽¹⁾	6.5	2.176 x 10 ¹⁹	1.2110 ⁽²⁾	7.9	-80	56	-16.1
Long. Weld 101-124A	33.2	1.243 x 10 ¹⁹	1.0606	35.2	-80	56	11.2
Long. Weld 101-124B	33.2	1.379 x 10 ¹⁹	1.0893	36.2	-80	56	12.2
Long. Weld 101-124C	33.2	1.379 x 10 ¹⁹	1.0893	36.2	-80	56	12.2
Long. Weld 101-142A	33.2	1.379 x 10 ¹⁹	1.0893	36.2	-80	56	12.2
Long. Weld 101-142B	33.2	1.243 x 10 ¹⁹	1.0606	35.2	-80	56	11.2
Long. Weld 101-142C	33.2	1.379 x 10 ¹⁹	1.0893	36.2	-80	56	12.2

(1) Numbers were calculated using a chemistry factor (CF) based on surveillance capsule data.

(3) Peak fluence factor which represents most limiting case for weld metal.

**VOGTLE ELECTRIC GENERATING PLANT (VEGP) - UNIT 1
PRESSURE AND TEMPERATURE LIMITS REPORT**

Table 3.0-10							
RT _{PTS} Values for Vogtle Unit 1 for 48 EFPY							
Material	CF (°F)	Surface Fluence (n/cm ² , E > 1.0 MeV)	FF	ΔRT _{NDT} (CF x FF) (°F)	I (°F)	M (°F)	RT _{PTS} (°F)
Inter. Shell Plate B8805-1	53.1	3.262 x 10 ¹⁹	1.3104	69.6	0	34	103.6
Inter. Shell Plate B8805-2	53.1	3.262 x 10 ¹⁹	1.3104	69.6	20	34	123.6
Inter. Shell Plate B8805-3	38.4	3.262 x 10 ¹⁹	1.3104	50.3	30	34	114.3
Inter. Shell Plate B8805-3 Using S/C Data ⁽¹⁾	22.9	3.262 x 10 ¹⁹	1.3104	30.0	30	34	94.0
Lower Shell Plate B8606-1	32.8	3.262 x 10 ¹⁹	1.3104	43.0	20	34	97.0
Lower Shell Plate B8606-2	35.2	3.262 x 10 ¹⁹	1.3104	46.1	20	34	100.1
Lower Shell Plate B8606-3	41.9	3.262 x 10 ¹⁹	1.3104	54.9	10	34	98.9
Circ. Weld 101-171	33.2	3.262 x 10 ¹⁹	1.3104	43.5	-80	56	19.5
Weld Metal Using S/C Data ⁽¹⁾	6.5	3.262 x 10 ¹⁹	1.3104 ⁽²⁾	8.5	-80	56	-15.5
Long. Weld 101-124A	33.2	1.863 x 10 ¹⁹	1.1705	38.9	-80	56	14.9
Long. Weld 101-124B	33.2	2.068 x 10 ¹⁹	1.1978	39.8	-80	56	15.8
Long. Weld 101-124C	33.2	2.068 x 10 ¹⁹	1.1978	39.8	-80	56	15.8
Long. Weld 101-142A	33.2	2.068 x 10 ¹⁹	1.1978	39.8	-80	56	15.8
Long. Weld 101-142B	33.2	1.863 x 10 ¹⁹	1.1705	38.9	-80	56	14.9
Long. Weld 101-142C	33.2	2.068 x 10 ¹⁹	1.1978	39.8	-80	56	15.8

(1) Numbers were calculated using a chemistry factor (CF) based on surveillance capsule data.

(2) Peak fluence factor which represents most limiting case for weld metal.

VOGTLE ELECTRIC GENERATING PLANT (VEGP) - UNIT 1 PRESSURE AND TEMPERATURE LIMITS REPORT

4.0 Reactor Vessel Material Surveillance Program

The reactor vessel material surveillance program is in compliance with 10 CFR 50, Appendix H, and is described in section 16.3 of the VEGP FSAR. The withdrawal schedule is presented in FSAR table 16.3-3. The Unit 1 surveillance capsule reports are as follows:

1. WCAP-12256, May 1989, "Analysis of Capsule U From the Georgia Power Company Vogtle Unit 1 Reactor Vessel Radiation Surveillance Program."
2. WCAP-13931, February 1994, "Analysis of Capsule Y From the Georgia Power Company Vogtle Unit 1 Reactor Vessel Radiation Surveillance Program."

5.0 Reactor Vessel Surveillance Data Credibility

Regulatory Guide 1.99, Revision 2, describes general procedures acceptable to the NRC staff for calculating the effects of neutron radiation embrittlement of the low-alloy steels currently used for light-water-cooled reactor vessels. Position C.2 of Regulatory Guide 1.99, Revision 2, describes the method for calculating the adjusted reference temperature and Charpy upper-shelf energy of reactor vessel beltline materials using surveillance capsule data. The methods of Position C.2 can only be applied when two or more credible surveillance data sets become available from the reactor in question.

To date, there have been two surveillance capsules removed from the Vogtle Unit 1 reactor vessel. To use these surveillance data sets, they must be shown to be credible. In accordance with the discussion of Regulatory Guide 1.99, Revision 2, there are five criteria that must be met for the surveillance data to be judged credible.

The purpose of this evaluation is to apply the credibility criteria of Regulatory Guide 1.99, Revision 2, to the Vogtle Unit 1 reactor vessel surveillance data and determine if the Vogtle Unit 1 surveillance data is credible.

Criterion 1: Materials in the capsules should be those judged most likely to be controlling with regard to radiation embrittlement.

The beltline region of the reactor vessel is defined in Appendix G to 10 CFR Part 50, "Fracture Toughness Requirements," May 27, 1983 to be:

"the reactor vessel (shell material including welds, heat affected zones, and plates or forgings) that directly surrounds the effective height of the active core and adjacent regions of the reactor vessel that are predicted to experience sufficient neutron radiation damage to be considered in the selection of the most limiting material with regard to radiation damage."

VOGTLE ELECTRIC GENERATING PLANT (VEGP) - UNIT 1 PRESSURE AND TEMPERATURE LIMITS REPORT

The Vogtle Unit 1 reactor vessel consists of the following beltline region materials:

- a) Intermediate shell longitudinal weld seams 101-124A, B, and C, lower shell longitudinal seams 101-142A, B, and C, and intermediate to lower shell circumferential weld seam 101-171 (all beltline weld seams were fabricated with 3/16 inch Mil B-4 weld filler wire, heat number 83653 and Linde flux, lot number 3536),
- b) Intermediate shell plates B8805-1, heat number C0613-1, B8805-2, heat number C0613-2, and B8805-3, heat number C0623-1, and
- c) Lower shell plates B8606-1, heat number C2146-1, B8606-2, heat number C2146-2, and B8606-3, heat number C2085-2.

At the time the surveillance capsule was developed, Regulatory Guide 1.99, Revision 1 was in effect. Per the Regulatory Guide 1.99, Revision 1, calculational methodology, intermediate shell plate B8805-3 was projected to have the highest end of life (EOL) RT_{NDT} of all beltline plate materials. Hence, intermediate shell plate B8805-3 was judged to be most limiting and was used in the surveillance program. Since the surveillance weld metal and all of the Vogtle Unit 1 reactor vessel beltline welds were made of the same heat, flux, and flux lot, the surveillance weld represents the most limiting weld metal in the beltline region.

The materials selected for use in the Vogtle Unit 1 surveillance program were those judged to be most likely controlling with regard to radiation embrittlement according to the accepted methodology at the time the surveillance program was developed. Therefore, the Vogtle Unit 1 surveillance program meets this criteria.

Criterion 2: Scatter in the plots of Charpy energy versus temperature for the irradiated and unirradiated conditions should be small enough to permit the determination of the 30 ft-lb temperature and upper shelf energy unambiguously.

Plots of Charpy energy versus temperature for the unirradiated condition are presented in WCAP-11011, "Georgia Power Company Alvin W. Vogtle Unit No. 1 Reactor Vessel Radiation Surveillance Program," dated February 1986.

Plots of Charpy energy versus temperature for the irradiated condition are presented in WCAP-12256, "Analysis of Capsule U from the Georgia Power Company Vogtle Unit 1 Reactor Vessel Radiation Surveillance Program," dated May 1989 and WCAP-13931, Revision 1, "Analysis of Capsule Y from the Georgia Power Company Vogtle Unit 1 Reactor Vessel Radiation Surveillance Program," dated August 1995.

VOGTLE ELECTRIC GENERATING PLANT (VEGP) - UNIT 1 PRESSURE AND TEMPERATURE LIMITS REPORT

Based on engineering judgement, the scatter in the data presented in these plots is small enough to permit the determination of the 30-ft lb temperature and the upper shelf energy of the Vogtle Unit 1 surveillance materials unambiguously. Therefore, the Vogtle Unit 1 surveillance program meets this criteria.

Criterion 3: When there are two or more sets of surveillance data from one reactor, the scatter of ΔRT_{NDT} values about a best-fit line drawn as described in Regulatory Position 2.1 normally should be less than 28° F for welds and 17° F for base metal. Even if the fluence range is large (two or more orders of magnitude), the scatter should not exceed twice those values. Even if the data fail this criterion for use in shift calculations, they may be credible for determining decrease in upper shelf energy if the upper shelf can be clearly determined, following the definition given ASTM E185-82.

The least squares method as described in Regulatory Position 2.1 will be utilized to determine a best-fit line for this data and to determine if the scatter of these ΔRT_{NDT} values about this line is less than 28° F for welds and 17° F for the plate.

VOGTLE ELECTRIC GENERATING PLANT (VEGP) - UNIT 1
PRESSURE AND TEMPERATURE LIMITS REPORT

Table 5.0-1						
Vogtle Unit 1 Surveillance Capsule Data Calculation of Best Line Drawn as Described in Regulatory Position 2.1 of Regulatory Guide 1.99, Revision 2						
Material	Capsule	F ⁽¹⁾	FF ⁽²⁾ (x)	$\Delta RT_{NDT}^{(3)}$ (y)	FF* ΔRT_{NDT} (xy)	FF ² (x ²)
Intermediate Shell Plate B8805-3 (Longitudinal)	U	0.3437	0.706	15	10.585	0.498
	Y	1.242	1.060	40	42.4	1.124
Intermediate Shell Plate B8805-3 (Transverse)	U	0.3437	0.706	0	0	0.498
	Y	1.242	1.060	20	21.2	1.124
	$\sum_{i=1}^n 1$		3.532	75	74.185	3.244
Weld Metal	U	0.3437	0.706	15	10.585	0.498
	Y	1.242	1.060	0	0	1.124
	$\sum_{i=1}^n 2$		1.766	15	10.585	1.622

- (1) F = Fluence (10^{19} n/cm², E>1.0 MeV)
(2) FF = Fluence Factor = $F^{(0.28-0.1 \log F)}$
(3) ΔRT_{NDT} values do not include the adjustment ratio procedure of Regulatory Guide 1.99, Revision 2, Position 2.1, since the surveillance materials are identical to the actual beltline material.

Per the 27th Edition of the CRC Standard Mathematical Tables (page 497), for a straight line fit by the method of least squares, the values b_0 and b_1 are obtained by solving the normal equations

$$nb_0 + b_1 \sum x_i = \sum y_i \quad \text{and}$$

$$b_0 \sum x_i + b_1 \sum x_i^2 = \sum x_i y_i$$

These equations can be rewritten as follows:

$$\begin{aligned} \sum_{i=1}^n y_i &= a n + b \sum_{i=1}^n x_i & \text{and} \\ \sum_{i=1}^n x_i y_i &= a \sum_{i=1}^n x_i + b \sum_{i=1}^n x_i^2 \end{aligned}$$

VOGTLE ELECTRIC GENERATING PLANT (VEGP) - UNIT 1 PRESSURE AND TEMPERATURE LIMITS REPORT

Intermediate Shell Plate B8805-3:

Based on the data provided in Table 5.0-1, these equations become:

$$75 = 4a + 3.532b \quad \text{and}$$

$$74.185 = 3.532a + 3.244b$$

Thus, $b = 63.556$ and $a = -37.37$, and the equation of the straight line which provides the best fit in the sense of least squares is:

$$Y' = 63.556 (X) - 37.37$$

The error in predicting a value Y corresponding to a given X value is :

$$e = Y - Y'$$

Intermediate Shell Plate B8805-3 "Orientation"	FF	ΔRT_{NDT} (30 ft-lb) (°F)	Best Fit ΔRT_{NDT} (°F)	Scatter of ΔRT_{NDT} (°F)
Longitudinal	0.706	15	7.50	7.50
	1.060	40	30.0	10.0
Transverse	0.706	0	7.50	-7.50
	1.060	20	30.0	-10.0

The scatter of ΔRT_{NDT} values about a best-fit line drawn as described in Regulatory Position 2.1 is less than 17°F as shown above. Therefore, this criteria is met for the surveillance plate material.

Weld Metal:

Based on the data provided in Table 5.0-1, the equations become:

$$15 = 2a + 1.766b \quad \text{and}$$

$$10.585 = 1.766a + 1.622b$$

VOGTLE ELECTRIC GENERATING PLANT (VEGP) - UNIT 1 PRESSURE AND TEMPERATURE LIMITS REPORT

Thus $a = 45.007$ and $b = -42.477$, and the equation of the straight line which provides the best fit in the sense of least squares is:

$$Y' = -42.477 (X) + 45.007$$

The error in predicting a value Y corresponding to a given X value is:

$$e = Y - Y'$$

FF	ΔRT_{NDT} (30 ft-lb) (°F)	Best Fit ΔRT_{NDT} (°F)	Scatter of ΔRT_{NDT} (°F)
0.706	15	15.0182	-0.0182
1.060	0	-0.0186	-0.0186

The scatter of ΔRT_{NDT} values about a best-fit line drawn as described in Regulatory Position 2.1 is less than 28°F as shown above. Therefore, this criteria is met for the surveillance weld material.

Criterion 4: The irradiation temperature of the Charpy specimens in the capsule should match the vessel wall temperature at the cladding/base metal interface within +/- 35°F.

The capsule specimens are located in the reactor between the core barrel and the vessel wall and are positioned opposite the center of the core. The test capsules are in baskets attached to the neutron pads. The location of the specimens with respect to the reactor vessel beltline provides assurance that the reactor vessel wall and the specimens experience equivalent operating conditions and will not differ by more than 25°F.

Criterion 5: The surveillance data for the correlation monitor material in the capsule should fall within the scatter band of the data base for that material.

The Vogtle Unit 1 surveillance program does not include correlation monitor material. Therefore, this criterion is not applicable to Vogtle Unit 1.

VOGTLE ELECTRIC GENERATING PLANT (VEGP) - UNIT 1 PRESSURE AND TEMPERATURE LIMITS REPORT

6.0 References

1. WCAP-14040, Revision 1, December 1994, "Methodology Used to Develop Cold Overpressure Mitigating System Setpoints and RCS Heatup and Cooldown Limit Curves," as approved by the NRC by letter dated October 16, 1995 (TAC M91749).
2. Louis L. Wheeler to C. K. McCoy, dated June 8, 1995, "Issuance of Amendments - Vogtle Electric Generating Plant, Units 1 and 2 (TAC Nos. M90966 and M90967)."

VOGTLE ELECTRIC GENERATING PLANT - UNIT 2
PRESSURE AND TEMPERATURE LIMITS REPORT
REVISION 1

Prepared by: Jimmy Paul Cash 3-19-01

Reviewed by: J. L. Bailey 03-20-01

**VOGTLE ELECTRIC GENERATING PLANT - UNIT 2
PRESSURE AND TEMPERATURE LIMITS REPORT**

Table of Contents

Section		Page
1.0	Reactor Coolant System (RCS) Pressure and Temperature Limits Report - Unit 2	1
2.0	Operating Limits	1
	2.1 RCS Pressure and Temperature (P/T) Limits	1
	2.2 Cold Overpressure Protection System (COPS) Setpoints	2
3.0	Supplemental Data Tables	9
4.0	Reactor Vessel Material Surveillance Program	18
5.0	Reactor Vessel Surveillance Data Credibility	18
6.0	References	18

**VOGTLE ELECTRIC GENERATING PLANT - UNIT 2
PRESSURE AND TEMPERATURE LIMITS REPORT**

List of Figures

Figure		Page
2.1-1	Unit 2 Reactor Coolant System Heatup Limitations (Heatup rates up to 100 °F/hr). Applicable for the First 16 EFPY (With Margins of 10 °F and 60 psig for Instrumentation Errors and Margin of 74 psig for Pressure Difference Between Pressure Instrumentation and Reactor Vessel Beltline Region).	3
2.1-2	Unit 2 Reactor Coolant System Cooldown Limitations (Cooldown rates up to 100 °F/hr). Applicable for the First 16 EFPY (With Margins of 10 °F and 60 psig for Instrumentation Errors and Margin of 74 psig for Pressure Difference Between Pressure Instrumentation and Reactor Vessel Beltline Region).	5
2.2-1	Unit 2 Maximum Allowable Nominal PORV Setpoint for the Cold Overpressure Protection System	7

VOGTLE ELECTRIC GENERATING PLANT - UNIT 2 PRESSURE AND TEMPERATURE LIMITS REPORT

List of Tables

Table		Page
2.1-1	Data Points for Unit 2 Reactor Coolant System Heatup Limitations	4
2.1-2	Data Points for Unit 2 Reactor Coolant System Cooldown Limitations	6
2.2-1	Data Points for Unit 2 PORV Setpoints	8
3.0-1	Comparison of the Vogtle Unit 2 Surveillance Material 30 ft-lb Transition Temperature Shifts and Upper Shelf Energy Decrease with Regulatory Guide 1.99, Revision 2, Predictions	10
3.0-2	Vogtle Unit 2 Calculation of Chemistry Factors Using Surveillance Capsule Data	11
3.0-3	Vogtle Unit 2 Reactor Vessel Toughness Table (Unirradiated)	12
3.0-4	Vogtle Unit 2 Reactor Vessel Surface Fluence Values at 16 EFPY (Fluence Based on $E > 1.0$ MeV)	12
3.0-5	Summary of Adjusted Reference Temperatures (ARTs) for the Vogtle Unit 2 Reactor Vessel Beltline Materials at the 1/4-T and 3/4-T Locations for 16 EFPY	13
3.0-6	Calculation of Adjusted Reference Temperature at 16 EFPY for the Limiting Vogtle Unit 2 Reactor Vessel Material (Lower Shell Plate B8628-1)	14
3.0-7	Neutron Exposure Projections at Key Locations on the Vogtle Unit 2 Pressure Vessel Clad/Base Metal Interface	15
3.0-8	RT _{PTS} Values for Vogtle Unit 2 for 32 EFPY	16
3.0-9	RT _{PTS} Values for Vogtle Unit 2 for 48 EFPY	17

VOGTLE ELECTRIC GENERATING PLANT - UNIT 2 PRESSURE AND TEMPERATURE LIMITS REPORT

1.0 Reactor Coolant System (RCS) Pressure and Temperature Limits Report (PTLR) - Unit 2

This PTLR for VEGP Unit 2 has been prepared in accordance with the requirements of Technical Specification (TS) 5.6.6. The TS addressed in this report are listed below:

LCO 3.4.3 RCS Pressure and Temperature (P/T) Limits

LCO 3.4.12 Cold Overpressure Protection Systems (COPS)

2.0 Operating Limits

The parameter limits for the specifications listed in section 1.0 are presented in the following subsections. The current limits were developed using a methodology that is in accordance with the NRC-approved methodology specified in Specification 5.6.6 (Ref. 1) with two exceptions. The two exceptions are the fluence methodology used to calculate the heatup and cooldown limits and the incorporation of random pressure uncertainty in the cold overpressure protection system setpoints. Future changes to these limits will be made in full compliance with the NRC-approved methodology, and the first revision to the limits after initial implementation of this PTLR will be submitted to the NRC for prior approval. Subsequent revisions will be made in accordance with the NRC-approved methodology without prior approval. It should be noted that the heatup and cooldown limit curves and the cold overpressure protection system setpoints were approved by the NRC staff by Amendment 65 dated June 8, 1995.

2.1 RCS Pressure and Temperature (P/T) Limits (LCO 3.4.3)

2.1.1 The RCS temperature rate-of-change limits are (Ref. 2):

- a. A maximum heatup of 100°F in any 1-hour period.
- b. A maximum cooldown of 100°F in any 1-hour period.
- c. A maximum temperature change of less than or equal to 10°F in any 1-hour period during inservice hydrostatic and leak testing operations above the heatup and cooldown limit curves.

2.1.2 The RCS P/T limits for heatup and cooldown are specified by Figures 2.1-1 and 2.1-2, respectively.


VOGTLE ELECTRIC GENERATING PLANT - UNIT 2 PRESSURE AND TEMPERATURE LIMITS REPORT

2.2 Cold Overpressure Protection System (COPS) Setpoints (LCO 3.4.12)

The power-operated relief valves (PORVs) shall each have lift settings in accordance with Figure 2.2-1.

The setpoints in combination with the relief capacity of the PORVs will protect the RCS from the limiting mass injection transient of two centrifugal charging pumps plus the normal charging pump injecting into the RCS and the limiting heat input transient of starting a RCP with the RCS 50°F colder than the secondary coolant.

VOGTLE ELECTRIC GENERATING PLANT - UNIT 2 PRESSURE AND TEMPERATURE LIMITS REPORT

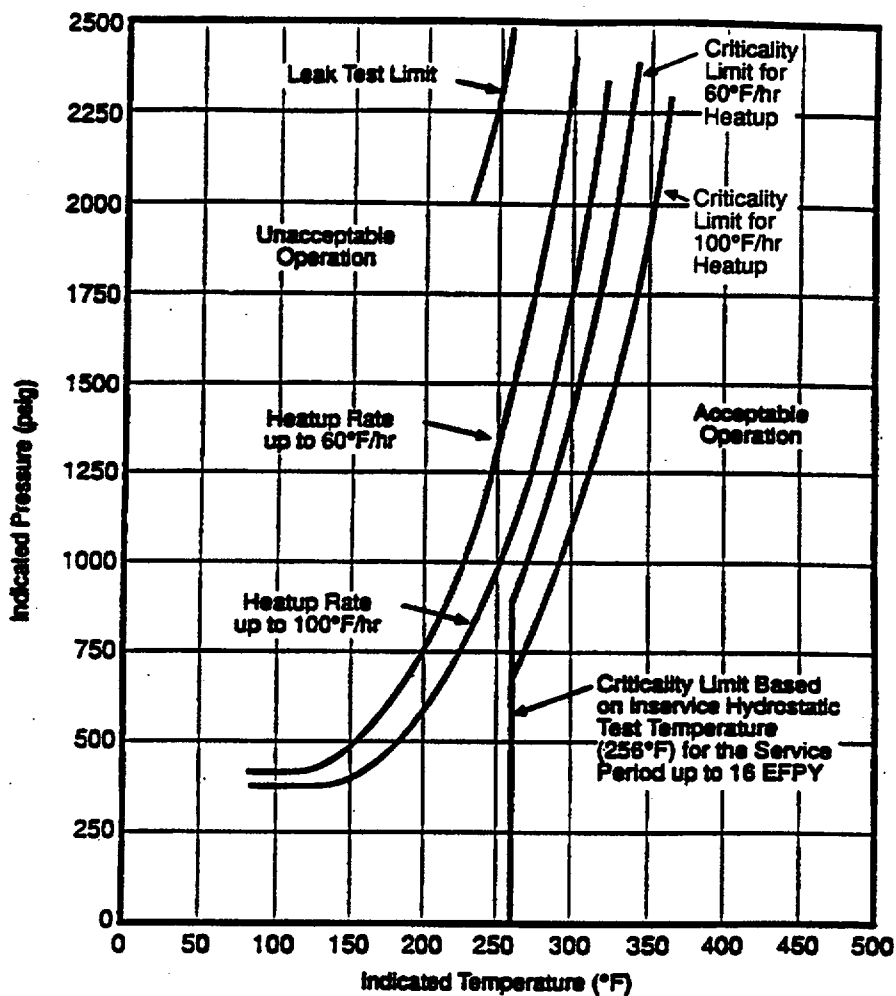

MATERIAL BASIS

Copper Content:	Assumed - NA WT% (Actual - 0.05 WT%)
RT _{NOT} Initial:	Assumed - NA °F (Actual - 60°F)
RT _{NOT} At 16 EFPY:	⊙ 1/4T = 112°F ⊙ 3/4T = 94°F

Figure 2.1-1

Unit 2 Reactor Coolant System Heatup Limitations (Heatup Rates up to 100 °F/hr)
Applicable for the First 16 EFPY
(With Margins of 10 °F and 60 psig for Instrumentation Errors and Margin of 74 psig for
Pressure Difference Between Pressure Instrumentation and Reactor Vessel Beltline Region)

VOGTLE ELECTRIC GENERATING PLANT - UNIT 2 PRESSURE AND TEMPERATURE LIMITS REPORT

Table 2.1-1

Data Points for Unit 2 Reactor Coolant System Heatup Limitations

60 HU		Criticality Limit		100 HU		Criticality Limit		Hydrostatic Leak Test	
T	P	T	P	T	P	T	P	T	P
85	424.16	256	0.00	85	392.65	256	0.00	236	2000
90	424.16	256	424.16	90	392.65	256	392.65	256	2485
95	424.16	256	424.16	95	392.65	256	392.65		
100	424.16	256	424.16	100	392.65	256	392.65		
105	424.16	256	424.16	105	392.65	256	392.65		
110	424.16	256	424.16	110	392.65	256	392.65		
115	426.05	256	426.05	115	392.65	256	392.65		
120	430.17	256	430.17	120	392.65	256	392.65		
125	436.54	256	436.54	125	392.65	256	392.65		
130	444.80	256	444.80	130	392.91	256	392.91		
135	455.01	256	455.01	135	395.01	256	395.01		
140	466.83	256	466.83	140	398.78	256	398.78		
145	480.60	256	480.60	145	404.26	256	404.26		
150	496.06	256	496.06	150	411.25	256	411.25		
155	513.18	256	513.18	155	420.00	256	420.00		
160	532.19	256	532.19	160	430.37	256	430.37		
165	553.06	256	553.06	165	442.41	256	442.41		
170	575.69	256	575.69	170	456.11	256	456.11		
175	600.46	256	600.46	175	471.42	256	471.42		
180	627.17	256	627.17	180	488.61	256	488.61		
185	656.06	256	656.06	185	507.64	256	507.64		
190	687.47	256	687.47	190	528.48	256	528.48		
195	721.18	256	721.18	195	551.45	256	551.45		
200	757.46	256	757.46	200	576.37	256	576.37		
205	796.74	256	796.74	205	603.64	256	603.64		
210	838.85	256	838.85	210	633.15	256	633.15		
215	884.12	256	884.12	215	665.08	256	665.08		
220	932.78	260	932.78	220	699.80	260	699.80		
225	985.00	265	985.00	225	737.19	265	737.19		
230	1040.94	270	1040.94	230	777.51	270	777.51		
235	1101.29	275	1101.29	235	820.97	275	820.97		
240	1165.91	280	1165.91	240	867.77	280	867.77		
245	1235.02	285	1235.02	245	918.16	285	918.16		
250	1309.37	290	1309.37	250	972.28	290	972.28		
255	1388.91	295	1388.91	255	1030.47	295	1030.47		
260	1474.02	300	1474.02	260	1092.78	300	1092.78		
265	1565.15	305	1565.15	265	1159.94	305	1159.94		
270	1662.80	310	1662.80	270	1231.65	310	1231.65		
275	1767.31	315	1767.31	275	1308.88	315	1308.88		
280	1878.79	320	1878.79	280	1391.50	320	1391.50		
285	1997.96	325	1997.96	285	1479.91	325	1479.91		
290	2125.07	330	2125.07	290	1574.56	330	1574.56		
295	2260.56	335	2260.56	295	1675.71	335	1675.71		
300	2405.07	340	2405.07	300	1783.88	340	1783.88		
				305	1899.34	345	1899.34		
				310	2022.83	350	2022.83		
				315	2154.30	355	2154.30		
				320	2294.29	360	2294.29		

VOGTLE ELECTRIC GENERATING PLANT - UNIT 2 PRESSURE AND TEMPERATURE LIMITS REPORT

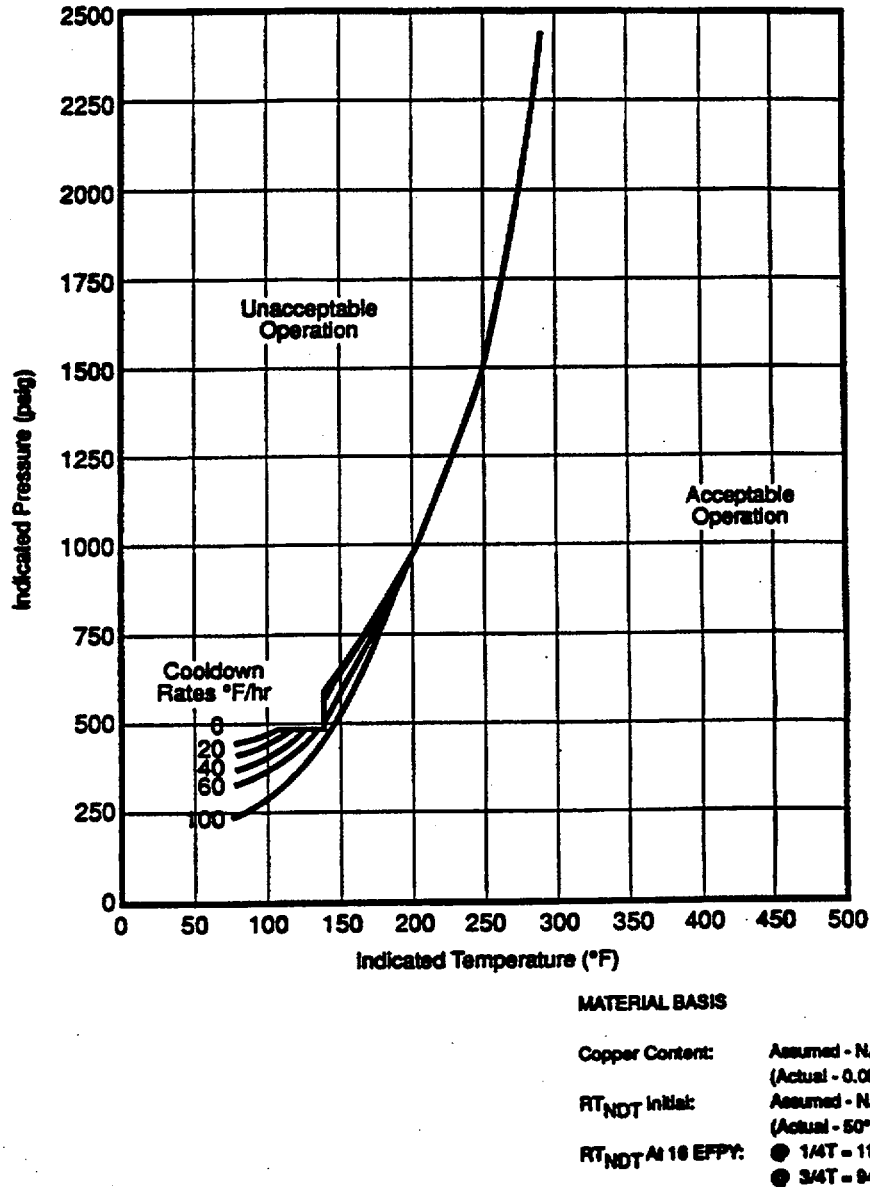


Figure 2.1-2

Unit 2 Reactor Coolant System Cooldown Limitations (Cooldown Rates up to 100 °F/hr)
Applicable for the First 16 EFPPY
(With Margins of 10 °F and 60 psig for Instrumentation Errors and Margin of 74 psig for
Pressure Difference Between Pressure Instrumentation and Reactor Vessel Beltline Region)

VOGTLE ELECTRIC GENERATING PLANT - UNIT 2 PRESSURE AND TEMPERATURE LIMITS REPORT

Table 2.1-2

Data Points for Unit 2 Reactor Coolant System Cooldown Limitations

Steady State		20 CD		40 CD		60 CD		100 CD	
T	P	T	P	T	P	T	P	T	P
80	439.56	80	399.79	80	359.43	80	318.38	80	234.54
85	448.29	85	408.97	85	369.02	85	328.62	85	246.12
90	457.67	90	418.74	90	379.44	90	339.65	90	258.63
95	467.65	95	429.39	95	390.70	95	351.61	95	272.23
100	478.50	100	440.83	100	402.83	100	364.49	100	286.85
105	487.00	105	453.18	105	415.82	105	378.33	105	302.77
110	487.00	110	466.33	110	429.91	110	393.34	110	319.90
115	487.00	115	480.63	115	445.13	115	409.57	115	338.53
120	487.00	120	487.00	120	461.38	120	426.95	120	358.64
125	487.00	125	487.00	125	479.04	125	445.84	125	380.31
130	487.00	130	487.00	130	487.00	130	466.05	130	403.80
135	487.00	135	487.00	135	487.00	135	487.00	135	429.09
140	487.00	140	487.00	140	487.00	140	487.00	140	456.47
140	600.06	140	569.93	140	540.48	140	511.52	145	485.97
145	620.72	145	592.17	145	564.10	145	537.04	150	517.75
150	643.08	150	615.87	150	589.70	150	564.35	155	552.20
155	666.94	155	641.59	155	617.09	155	593.97	160	589.23
160	692.76	160	669.05	160	646.72	160	625.70	165	629.17
165	720.36	165	698.77	165	678.52	165	659.89	170	672.20
170	750.14	170	730.61	170	712.66	170	696.86	175	718.62
175	782.07	175	764.80	175	749.61	175	736.57	180	768.61
180	816.32	180	801.53	180	789.20	180	779.25	185	822.54
185	853.09	185	841.28	185	831.83	185	825.27	190	880.52
190	892.81	190	883.81	190	877.63	190	874.70		
195	935.33	195	929.55	195	926.94	195	927.94		
200	980.99	200	978.69	200	979.87				
205	1030.06								
210	1082.72								
215	1139.08								
220	1199.92								
225	1265.01								
230	1334.76								
235	1409.74								
240	1490.05								
245	1576.15								
250	1668.31								
255	1767.04								
260	1872.77								
265	1985.79								
270	2106.52								
275	2235.61								
280	2373.08								

VOGTLE ELECTRIC GENERATING PLANT - UNIT 2
PRESSURE AND TEMPERATURE LIMITS REPORT

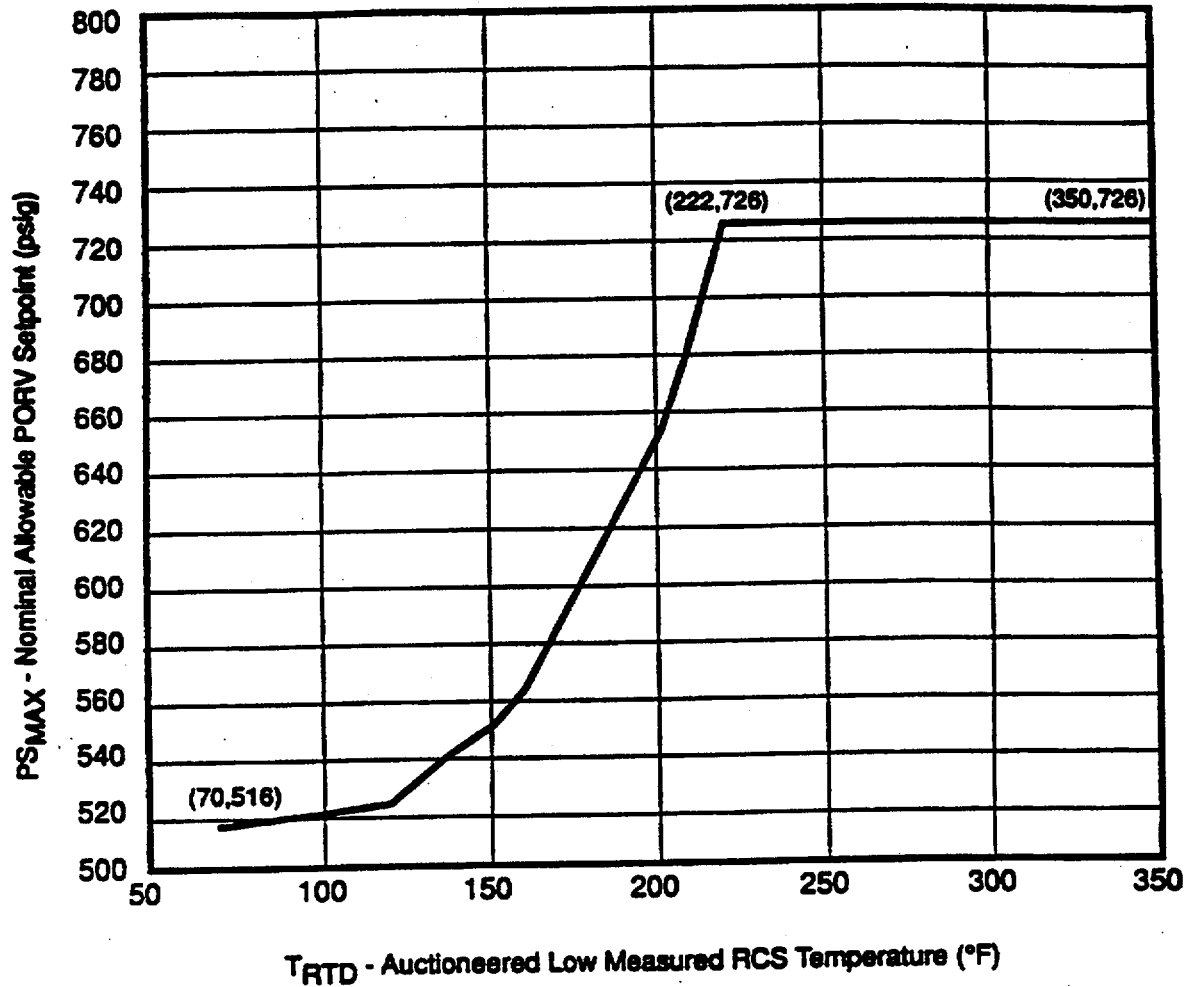


Figure 2.2-1

Unit 2 Maximum Allowable Nominal PORV Setpoint
for the Cold Overpressure Protection System.

**VOGTLE ELECTRIC GENERATING PLANT - UNIT 2
PRESSURE AND TEMPERATURE LIMITS REPORT**

Table 2.2-1
Data Points for Unit 2 PORV Setpoints

Temperature (°F)	Pressure (psig)
70	516
100	518
120	522
150	547
160	560
200	642
210	675
222	726
350	726

VOGTLE ELECTRIC GENERATING PLANT - UNIT 2 PRESSURE AND TEMPERATURE LIMITS REPORT

3.0 Supplemental Data Tables

Table 3.0-1 is a comparison of the measured surveillance material 30 ft-lb transition temperature shifts and upper shelf energy decreases with Regulatory Guide 1.99, Revision 2 predictions.

Table 3.0-2 shows the calculation of the surveillance material chemistry factors using surveillance capsule data. However, since there has been only one surveillance capsule removed from the Vogtle Unit 2 reactor vessel, this table has been intentionally left blank.

Table 3.0-3 provides the unirradiated Vogtle Unit 2 reactor vessel toughness data. The bolt-up temperature is also included in this table.

Table 3.0-4 provides a summary of the fluences used in the generation of the heatup and cooldown curves.

Table 3.0-5 provides a summary of the adjusted reference temperatures (ARTs) of the Vogtle Unit 2 reactor vessel beltline materials at the 1/4-T and 3/4-T locations for 16 EFPY.

Table 3.0-6 shows the calculation of the ART at 16 EFPY for the limiting Vogtle Unit 2 reactor vessel material lower shell plate B8628-1).

Table 3.0-7 provides a summary of the fluences used in the PTS evaluation.

Table 3.0-8 provides RT_{PTS} values for Vogtle Unit 2 for 32 EFPY.

Table 3.0-9 provides RT_{PTS} values for Vogtle Unit 2 for 48 EFPY.

**VOGTLE ELECTRIC GENERATING PLANT - UNIT 2
PRESSURE AND TEMPERATURE LIMITS REPORT**

Table 3.0-1						
Comparison of the Vogtle Unit 2 Surveillance Material 30 ft-lb Transition Temperature Shifts and Upper Shelf Energy Decrease with Regulatory Guide 1.99 Revision 2 Predictions						
Material	Capsule	Fluence ($\times 10^{19}$ n/cm ² , E > 1.0 MeV)	30 ft-lb Transition Temperature Shift		Upper Shelf Energy Decrease	
			Predicted ^(a) (°F)	Measured (°F)	Predicted ^(a) (%)	Measured (%)
Lower Shell Plate B8628-1 (Longitudinal)	U	0.444	24	0	16	0
Lower Shell Plate B8628-1 (Transverse)	U	0.444	24	0	16	0
Weld Metal	U	0.444	28	0	16	0
HAZ Metal	U	0.444	-	0	-	0

(a) Based on Regulatory Guide 1.99, Revision 2, methodology using mean wt. % values of Cu and Ni.

**VOGTLE ELECTRIC GENERATING PLANT - UNIT 2
PRESSURE AND TEMPERATURE LIMITS REPORT**

Table 3.0-2 ^(*)						
Vogtle Unit 2 Calculation of Chemistry Factors Using Surveillance Capsule Data						
Material	Capsule	Fluence (f) (n/cm ² , E > 1.0 MeV)	FF ^(a)	ΔRT_{NDT} (°F)	FF* ΔRT_{NDT} (°F)	FF ²
	Sum:					
	Chemistry Factor =					
Weld Metal						
	Sum:					
	Chemistry Factor =					

(a) Fluence Factor (FF) per Regulatory Guide 1.99, Revision 2, is defined as $FF = f^{(0.28 - 0.10 \log f)}$

(*) This table was intentionally left blank pending completion of the evaluation of the second surveillance capsule.

**VOGTLE ELECTRIC GENERATING PLANT - UNIT 2
PRESSURE AND TEMPERATURE LIMITS REPORT**

Table 3.0-3			
Vogtle Unit 2 Reactor Vessel Toughness Table (Unirradiated)			
Material Description	Cu (%) ^(a)	Ni (%) ^(a)	Initial RT _{NDT} (° F) ^(b)
Closure Head Flange	--	--	10 ^(c)
Vessel Flange	--	--	-60 ^(c)
Intermediate Shell Plate R4-1	0.06	0.64	10
Intermediate Shell Plate R4-2	0.05	0.62	10
Intermediate Shell Plate R4-3	0.05	0.59	30
Lower Shell Plate B8825-1	0.05	0.59	40
Lower Shell Plate R8-1	0.06	0.62	40
Lower Shell Plate B8628-1	0.05	0.59	50
Longitudinal Welds	0.07	0.13	-10
Circumferential Weld	0.06	0.12	-30

(a) The average values of copper and nickel content.

(b) Initial RT_{NDT} values are measured values.

(c) These values are used for considering flange requirements for the heatup/cooldown curves. Per the methodology given in WCAP-14040, Revision 1, the minimum boltup temperature is 60° F.

Table 3.0-4					
Vogtle Unit 2 Reactor Vessel Surface Fluence Values at 16 EFPY (Fluence Based on E > 1.0 MeV)					
Azimuthal	0°	15°	25°	35°	45°
Surface	8.99E+18	1.34E+19	1.52E+19	1.24E+19	1.42E+19

**VOGTLE ELECTRIC GENERATING PLANT - UNIT 2
PRESSURE AND TEMPERATURE LIMITS REPORT**

Table 3.0-5		
Summary of Adjusted Reference Temperatures (ARTs) for the Vogtle Unit 2 Reactor Vessel Beltline Materials at the 1/4-T and 3/4-T Locations for 16 EFPY		
Component	16 EFPY ART ^(a)	
	1/4-T (° F)	3/4-T (° F)
Intermediate Shell Plate R4-1	80	61
Intermediate Shell Plate R4-2	70	53
Intermediate Shell Plate R4-3	90	73
Lower Shell Plate B8825-1	100	83
Lower Shell Plate R8-1	110 ^(b)	91
Lower Shell Plate B8628-1	110 ^(b)	93 ^(b)
Longitudinal Welds	81	55
Circumferential Weld	54	29

(a) The ARTs presented here are based on the peak reactor vessel surface fluence of $1.52 \times 10^{19} \text{ n/cm}^2$ ($E > 1.0 \text{ MeV}$) at 16 EFPY, which is conservative for the longitudinal weld seams.

(b) These ART values are used to generate the heatup and cooldown curves.

**VOGTLE ELECTRIC GENERATING PLANT - UNIT 2
PRESSURE AND TEMPERATURE LIMITS REPORT**

Table 3.0-6		
Calculation of Adjusted Reference Temperature at 16 EFPY for the Limiting Vogtle Unit 2 Reactor Vessel Material (Lower Shell Plate B8628-1)		
Parameter	ART Value	
Operating Time	16 EFPY	
Material	B8628-1	B8628-1
Location	1/4-T	3/4-T
Chemistry Factor, CF (°F)	31	31
Fluence $\div 10^{19}$ n/cm ² (E > 1.0 MeV), $f^{(a)}$	0.9057	0.3215
Fluence Factor, FF ^(b)	0.972	0.688
$\Delta RT_{NDT} = CF \times FF$, (°F)	30	21.5
Initial RT_{NDT} , I (°F)	50	50
Margin, M (°F) ^(c)	30	21.5
$ART = I + (CF \times FF) + M$ (°F) per Regulatory Guide 1.99, Revision 2	110	93

- (a) Fluence, f , is based upon f_{surf} (10^{19} n/cm², E > 1.0 MeV) = 1.52 at 16 EFPY. The Vogtle Unit 2 reactor vessel wall thickness is 8.625 inches at the beltline region.
- (b) Fluence Factor (FF) per Regulatory Guide 1.99, Revision 2, is defined as $FF = f^{(0.28 - 0.10 \log f)}$.
- (c) Margin is calculated as $M = 2(\sigma_1^2 + \sigma_\Delta^2)^{0.5}$. The standard deviation for the initial RT_{NDT} margin term, σ_i , is 0°F since the initial RT_{NDT} is a measured value. The Standard deviation for ΔRT_{NDT} term σ_Δ , is 17°F for the plate, except that σ_Δ need not exceed 0.5 times the mean value of ΔRT_{NDT} .

**VOGTLE ELECTRIC GENERATING PLANT - UNIT 2
PRESSURE AND TEMPERATURE LIMITS REPORT**

Table 3.0-7					
Neutron Exposure Projections ⁽¹⁾ at Key Locations on the Vogtle Unit 2 Pressure Vessel Clad/Base Metal Interface					
EFPY	0°	15°	25°	35°	45°
32	1.80	2.69	3.04	2.47	2.84
48	2.70	4.05	4.56	3.69	4.26

(1) Fluence in 10^{19} n/cm² (E > 1.0 MeV).

**VOGTLE ELECTRIC GENERATING PLANT - UNIT 2
PRESSURE AND TEMPERATURE LIMITS REPORT**

Table 3.0-8							
RT _{PTS} Values for Vogtle Unit 2 for 32 EFPY							
Material	CF (°F)	Surface Fluence (n/cm ² , E > 1.0 MeV)	FF	ΔRT _{NDT} (CF x FF) (°F)	I (°F)	M (°F)	RT _{PTS} (°F)
Inter. Shell Plate R4-1	37	3.04 x 10 ¹⁹	1.29	47.7	10	34	92
Inter. Shell Plate R4-2	31	3.04 x 10 ¹⁹	1.29	40.0	10	34	84
Inter. Shell Plate R4-3	31	3.04 x 10 ¹⁹	1.29	40.0	30	34	104
Lower Shell Plate B8825-1	31	3.04 x 10 ¹⁹	1.29	40.0	40	34	114
Lower Shell Plate R8-1	37	3.04 x 10 ¹⁹	1.29	47.7	40	34	122
Lower Shell Plate B8628-1	31	3.04 x 10 ¹⁹	1.29	40.0	50	34	124
Longitudinal Weld	47	3.04 x 10 ¹⁹	1.29	60.6	-10	56	107
Circumferential Weld	43	3.04 x 10 ¹⁹	1.29	55.5	-30	56	82

(1) RT_{PTS} values were calculated using the peak 32 EFPY vessel clad/base metal interface fluence of 3.04 x 10¹⁹ n/cm² (E > 1.0 MeV), which is conservative for the longitudinal weld seams. (See Table 3.0-7.)

**VOGTLE ELECTRIC GENERATING PLANT - UNIT 2
PRESSURE AND TEMPERATURE LIMITS REPORT**

Table 3.0-9							
RT _{PTS} Values for Vogtle Unit 2 for 48 EFPY							
Material	CF (°F)	Surface Fluence (n/cm ² , E > 1.0 MeV)	FF	ΔRT _{NDT} (CF x FF) (°F)	I (°F)	M (°F)	RT _{PTS} (°F)
Inter. Shell Plate R4-1	37	4.56 x 10 ¹⁹	1.384	51.2	10	34	95
Inter. Shell Plate R4-2	31	4.56 x 10 ¹⁹	1.384	42.9	10	34	87
Inter. Shell Plate R4-3	31	4.56 x 10 ¹⁹	1.384	42.9	30	34	107
Lower Shell Plate B8825-1	31	4.56 x 10 ¹⁹	1.384	42.9	40	34	117
Lower Shell Plate R8-1	37	4.56 x 10 ¹⁹	1.384	51.2	40	34	125
Lower Shell Plate B8628-1	31	4.56 x 10 ¹⁹	1.384	42.9	50	34	127
Longitudinal Weld	47	4.56 x 10 ¹⁹	1.384	65.0	-10	56	111
Circumferential Weld	43	4.56 x 10 ¹⁹	1.384	59.5	-30	56	86

(1) RT_{PTS} values were calculated using the peak 48 EFPY vessel clad/base metal interface fluence of 4.56 x 10¹⁹ n/cm² (E > 1.0 MeV), which is conservative for the longitudinal weld seams. (See Table 3.0-7.)

VOGTLE ELECTRIC GENERATING PLANT - UNIT 2 PRESSURE AND TEMPERATURE LIMITS REPORT

4.0 Reactor Vessel Material Surveillance Program

The reactor vessel material surveillance program is in compliance with 10 CFR 50, Appendix H, and is described in section 16.3 of the VEGP FSAR. The withdrawal schedule is presented in FSAR table 16.3-3. The Unit 2 surveillance capsule reports are as follows:

1. WCAP-13007, August 1991, "Analysis of Capsule U From the Georgia Power Company Vogtle Electric Generating Plant Unit 2 Reactor Vessel Radiation Surveillance Program."

5.0 Reactor Vessel Surveillance Data Credibility

This discussion is not currently applicable to Unit 2 since the analysis of the second surveillance capsule is not complete at this time.

6.0 References

1. WCAP-14040, Revision 1, December 1994, "Methodology Used to Develop Cold Overpressure Mitigating System Setpoints and RCS Heatup and Cooldown Limit Curves," as approved by the NRC by letter dated October 16, 1995 (TAC M91749).
2. Louis L. Wheeler to C. K. McCoy, dated June 8, 1995, "Issuance of Amendments - Vogtle Electric Generating Plant, Units 1 and 2 (TAC Nos. M90966 and M90967)."