

1.0 USE AND APPLICATION

1.1 Definitions

NOTE

The defined terms of this section appear in capitalized type and are applicable throughout these Technical Specifications and Bases.

<u>Term</u>	<u>Definition</u>
ACTIONS	ACTIONS shall be that part of a Specification that prescribes Required Actions to be taken under designated Conditions within specified Completion Times.
ALLOWABLE THERMAL POWER	ALLOWABLE THERMAL POWER shall be the maximum steady state reactor core heat transfer rate to the reactor coolant permitted by consideration of the number and configuration of reactor coolant pumps (RCPs) in operation.
AXIAL POWER IMBALANCE	AXIAL POWER IMBALANCE shall be the power in the top half of the core, expressed as a percentage of RATED THERMAL POWER (RTP), minus the power in the bottom half of the core, expressed as a percentage of RTP.
AXIAL POWER SHAPING RODS (APSRs)	APSRs shall be the control components with part length absorbers used to control the axial power distribution of the reactor core. The APSRs are positioned manually by the operator and are not trippable.
CHANNEL CALIBRATION	A CHANNEL CALIBRATION shall be the adjustment, as necessary, of the channel output such that it responds within the necessary range and accuracy to known values of the parameter that the channel monitors. The CHANNEL CALIBRATION shall encompass all devices in the channel required for channel OPERABILITY and the CHANNEL FUNCTIONAL TEST. Calibration of instrument channels with resistance temperature detector (RTD) or thermocouple sensors may consist of an inplace qualitative assessment of sensor behavior and normal calibration of the remaining adjustable devices in the channel.

1.1 Definition

CHANNEL CALIBRATION (continued)	The CHANNEL CALIBRATION may be performed by means of any series of sequential, overlapping, or total channel steps.
CHANNEL CHECK	A CHANNEL CHECK shall be the qualitative assessment, by observation, of channel behavior during operation. This determination shall include, where possible, comparison of the channel indication and status to other indications or status derived from independent instrument channels measuring the same parameter.
CHANNEL FUNCTIONAL TEST	A CHANNEL FUNCTIONAL TEST shall be the injection of a simulated or actual signal into the channel as close to the sensor as practicable to verify OPERABILITY of all devices in the channel required for channel OPERABILITY. The CHANNEL FUNCTIONAL TEST may be performed by means of any series of sequential, overlapping, or total steps.
CONTROL RODS	CONTROL RODS shall be all full length safety and regulating rods that are used to shutdown the reactor and control power level during maneuvering operations.
CORE ALTERATION	CORE ALTERATION shall be the movement of any fuel, sources, or reactivity control components, within the reactor vessel with the vessel head removed and fuel in the vessel. Suspension of CORE ALTERATIONS shall not preclude completion of movement of a component to a safe position.
CORE OPERATING LIMITS REPORT (COLR)	The COLR is the ANO-1 specific document that provides cycle specific parameter limits for the current reload cycle. These cycle specific parameter limits shall be determined for each reload cycle in accordance with Specification 5.6.5. Plant operation within these limits is addressed in individual Specifications.
DOSE EQUIVALENT I-131	DOSE EQUIVALENT I-131 shall be that concentration of I-131 (microcuries/gram) that alone would produce the same thyroid dose as the quantity and isotopic mixture of I-131, I-132, I-133, I-134, and I-135 actually present. The thyroid dose conversion factors used for this calculation shall be those listed in Table III of TID-14844, AEC, 1962, "Calculation of Distance Factors for Power and Test Reactor Sites."

1.1 Definition (continued)

**\bar{E} -AVERAGE
DISINTEGRATION ENERGY**

\bar{E} shall be the average (weighted in proportion to the concentration of each radionuclide in the reactor coolant at the time of sampling) of the sum of the average beta and gamma energies per disintegration (in MeV) for isotopes, other than iodines, with half lives > 15 minutes, making up at least 95% of the total noniodine activity in the coolant.

LEAKAGE

LEAKAGE shall be:

a. Identified LEAKAGE

1. LEAKAGE, such as that from pump seals or valve packing (except RCP seal water injection or leakoff), that is captured and conducted to collection systems or a sump or collecting tank;
2. LEAKAGE into the containment atmosphere from sources that are both specifically located and known either not to interfere with the operation of leakage detection systems or not to be pressure boundary LEAKAGE; or
3. Reactor Coolant System (RCS) LEAKAGE through a steam generator (SG) to the Secondary System;

b. Unidentified LEAKAGE

All LEAKAGE (except RCP seal water injection and leakoff) that is not identified LEAKAGE;

c. Pressure Boundary LEAKAGE

LEAKAGE (except SG LEAKAGE) through a nonisolable fault in an RCS component body, pipe wall, or vessel wall.

MODE

A MODE shall correspond to any one inclusive combination of core reactivity condition, power level, average reactor coolant temperature, and reactor vessel head closure bolt tensioning specified in Table 1.1-1 with fuel in the reactor vessel.

1.1 Definition (continued)

OPERABLE-OPERABILITY

A system, subsystem, train, component, or device shall be OPERABLE or have OPERABILITY when it is capable of performing its specified safety function(s) and when all necessary attendant instrumentation, controls, normal or emergency electrical power, cooling and seal water, lubrication, and other auxiliary equipment that are required for the system, subsystem, train, component, or device to perform its specified safety function(s) are also capable of performing their related support function(s).

PHYSICS TESTS

PHYSICS TESTS shall be those tests performed to measure the fundamental nuclear characteristics of the reactor core and related instrumentation.

These tests are:

- a. Described in the SAR;
- b. Authorized under the provisions of 10 CFR 50.59; or
- c. Otherwise approved by the Nuclear Regulatory Commission.

QUADRANT POWER TILT
(QPT)

QPT shall be defined by the following equation and is expressed as a percentage.

$$QPT = 100 \left(\frac{\text{Power in any Core Quadrant}}{\text{Average Power in all Quadrants}} - 1 \right)$$

RATED THERMAL POWER
(RTP)

RTP shall be a total steady state reactor core heat transfer rate to the reactor coolant of 2568 MWt.

1.1 Definition (continued)

SHUTDOWN MARGIN (SDM)

SDM shall be the instantaneous amount of reactivity by which the reactor is subcritical or would be subcritical from its present condition assuming:

- a. All full length CONTROL RODS (safety and regulating) are fully inserted except for the single CONTROL ROD of highest reactivity worth, which is assumed to be fully withdrawn. With any CONTROL ROD not capable of being fully inserted, the reactivity worth of these CONTROL RODS must be accounted for in the determination of SDM;
- b. In MODES 1 and 2, the fuel and moderator temperatures are changed to the nominal zero power design level; and
- c. There is no change in APSR position.

STAGGERED TEST BASIS

A STAGGERED TEST BASIS shall consist of the testing of one of the systems, subsystems, channels, or other designated components during the interval specified by the Surveillance Frequency, so that all systems, subsystems, channels, or other designated components are tested during n Surveillance Frequency intervals, where n is the total number of systems, subsystems, channels, or other designated components in the associated function.

THERMAL POWER

THERMAL POWER shall be the total reactor core heat transfer rate to the reactor coolant.

Table 1.1-1

MODES

MODE	TITLE	REACTIVITY CONDITION (k_{eff})	% RATED THERMAL POWER ^(a)	AVERAGE REACTOR COOLANT TEMPERATURE (°F)
1	Power Operation	≥ 0.99	> 5	NA
2	Startup	≥ 0.99	≤ 5	NA
3	Hot Standby	< 0.99	NA	≥ 280
4	Hot Shutdown ^(b)	< 0.99	NA	$280 > T_{avg} > 200$
5	Cold Shutdown ^(b)	< 0.99	NA	≤ 200
6	Refueling ^(c)	NA	NA	NA

(a) Excluding decay heat.

(b) All reactor vessel head closure bolts fully tensioned.

(c) One or more reactor vessel head closure bolts less than fully tensioned.

1.0 USE AND APPLICATION

1.2 Logical Connectors

PURPOSE	<p>The purpose of this section is to explain the meaning of logical connectors.</p> <p>Logical connectors are used in Technical Specifications (TS) to discriminate between, and yet connect, discrete Conditions, Required Actions, Completion Times, Surveillances, and Frequencies. The only logical connectors that appear in TS are <u>AND</u> and <u>OR</u>. The physical arrangement of these connectors constitutes logical conventions with specific meanings.</p>
BACKGROUND	<p>Several levels of logic may be used to state Required Actions. These levels are identified by the placement (or nesting) of the logical connectors and by the number assigned to each Required Action. The first level of logic is identified by the first digit of the number assigned to a Required Action and the placement of the logical connector in the first level of nesting (i.e., left justified with the number of the Required Action). The successive levels of logic are identified by additional digits of the Required Action number and by successive indentations of the logical connectors.</p> <p>When logical connectors are used to state a Condition, Completion Time, Surveillance, or Frequency, only the first level of logic is used, and the logical connector is left justified with the statement of the Condition, Completion Time, Surveillance, or Frequency.</p>
EXAMPLES	<p>The following examples illustrate the use of logical connectors.</p>

1.2 Logical Connectors

EXAMPLES (continued)

EXAMPLE 1.2-1

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. LCO not met.	A.1 Verify . . . <u>AND</u> A.2 Restore . . .	

In this example the logical connector AND is used to indicate that when in Condition A, both Required Actions A.1 and A.2 must be completed.

1.2 Logical Connectors

EXAMPLES (continued)

EXAMPLE 1.2-2

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. LCO not met.	A.1 Trip . . . <u>OR</u> A.2.1 Verify . . . <u>AND</u> A.2.2.1 Reduce . . . <u>OR</u> A.2.2.2 Perform . . . <u>OR</u> A.3 Align . . .	

This example represents a more complicated use of logical connectors. Required Actions A.1, A.2, and A.3 are alternative choices, only one of which must be performed as indicated by the use of the logical connector OR and the left justified placement. Any one of these three Actions may be chosen. If A.2 is chosen, then both A.2.1 and A.2.2 must be performed as indicated by the logical connector AND. Required Action A.2.2 is met by performing A.2.2.1 or A.2.2.2. The indented position of the logical connector OR indicates that A.2.2.1 and A.2.2.2 are alternative choices, only one of which must be performed.

1.0 USE AND APPLICATION

1.3 Completion Times

PURPOSE	The purpose of this section is to establish the Completion Time convention and to provide guidance for its use.
---------	---

BACKGROUND	Limiting Conditions for Operation (LCOs) specify minimum requirements for ensuring safe operation of the unit. The ACTIONS associated with an LCO state Conditions that typically describe the ways in which the requirements of the LCO can fail to be met. Specified with each stated Condition are Required Action(s) and Completion Time(s).
------------	--

DESCRIPTION	<p>The Completion Time is the amount of time allowed for completing a Required Action. It is referenced to the time of discovery of a situation (e.g., inoperable equipment or variable not within limits) that requires entering an ACTIONS Condition unless otherwise specified, providing the unit is in a MODE or specified condition stated in the Applicability of the LCO. Required Actions must be completed prior to the expiration of the specified Completion Time. An ACTIONS Condition remains in effect and the Required Actions apply until the Condition no longer exists or the unit is not within the LCO Applicability.</p> <p>If situations are discovered that require entry into more than one Condition at a time within a single LCO (multiple Conditions), the Required Actions for each Condition must be performed within the associated Completion Time. When in multiple Conditions, separate Completion Times are tracked for each Condition starting from the time of discovery of the situation that required entry into the Condition.</p> <p>Once a Condition has been entered, subsequent trains, subsystems, components, or variables expressed in the Condition, discovered to be inoperable or not within limits, will <u>not</u> result in separate entry into the Condition, unless specifically stated. The Required Actions of the Condition continue to apply to each additional failure, with Completion Times based on initial entry into the Condition.</p>
-------------	---

1.3 Completion Times

DESCRIPTION (continued)

However, when a subsequent train, subsystem, component, or variable, expressed in the Condition, is discovered to be inoperable or not within limits, the Completion Time(s) may be extended. To apply this Completion Time extension, two criteria must first be met. The subsequent inoperability:

- a. Must exist concurrent with the first inoperability; and
- b. Must remain inoperable or not within limits after the first inoperability is resolved.

The total Completion Time allowed for completing a Required Action to address the subsequent inoperability shall be limited to the more restrictive of either:

- a. The stated Completion Time, as measured from the initial entry into the Condition, plus an additional 24 hours; or
- b. The stated Completion Time as measured from discovery of the subsequent inoperability.

The above Completion Time extensions do not apply to those Specifications that have exceptions that allow completely separate re-entry into the Condition (for each train, subsystem, component, or variable expressed in the Condition) and separate tracking of Completion Times based on this re-entry. These exceptions are stated in individual Specifications.

The above Completion Time extension does not apply to a Completion Time with a modified "time zero." This modified "time zero" may be expressed as a repetitive time (i.e., "once per 8 hours," where the Completion Time is referenced from a previous completion of the Required Action versus the time of Condition entry) or as a time modified by the phrase "from discovery . . ." Example 1.3-3 illustrates one use of this type of Completion Time. The 10 day Completion Time specified for Conditions A and B in Example 1.3-3 may not be extended.

EXAMPLES

The following examples illustrate the use of Completion Times with different types of Conditions and changing Conditions.

1.3 Completion Times (continued)

EXAMPLES (continued)

EXAMPLE 1.3-1

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
B. Required Action and associated Completion Time not met.	B.1 Be in MODE 3.	6 hours
	<u>AND</u> B.2 Be in MODE 5.	36 hours

Condition B has two Required Actions. Each Required Action has its own separate Completion Time. Each Completion Time is referenced to the time that Condition B is entered.

The Required Actions of Condition B are to be in MODE 3 within 6 hours AND in MODE 5 within 36 hours. A total of 6 hours is allowed for reaching MODE 3 and a total of 36 hours (not 42 hours) is allowed for reaching MODE 5 from the time that Condition B was entered. If MODE 3 is reached within 3 hours, the time allowed for reaching MODE 5 is the next 33 hours because the total time allowed for reaching MODE 5 is 36 hours.

If Condition B is entered while in MODE 3, the time allowed for reaching MODE 5 is the next 36 hours.

1.3 Completion Times

EXAMPLES (continued)

EXAMPLE 1.3-2

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One pump inoperable.	A.1 Restore pump to OPERABLE status.	7 days
B. Required Action and associated Completion Time not met.	B.1 Be in MODE 3.	6 hours
	<u>AND</u> B.2 Be in MODE 5.	36 hours

When a pump is declared inoperable, Condition A is entered. If the pump is not restored to OPERABLE status within 7 days, Condition B is also entered and the Completion Time clocks for Required Actions B.1 and B.2 start. If the inoperable pump is restored to OPERABLE status after Condition B is entered, Condition A and B are exited, and therefore, the Required Actions of Condition B may be terminated.

When a second pump is declared inoperable while the first pump is still inoperable, Condition A is not re-entered for the second pump. LCO 3.0.3 is entered, since the ACTIONS do not include a Condition for more than one inoperable pump. The Completion Time clock for Condition A does not stop after LCO 3.0.3 is entered, but continues to be tracked from the time Condition A was initially entered.

While in LCO 3.0.3, if one of the inoperable pumps is restored to OPERABLE status and the Completion Time for Condition A has not expired, LCO 3.0.3 may be exited and operation continued in accordance with Condition A.

While in LCO 3.0.3, if one of the inoperable pumps is restored to OPERABLE status and the Completion Time for Condition A has expired, LCO 3.0.3 may be exited and operation continued in accordance with Condition B. The Completion Time for Condition B is tracked from the time the Condition A Completion Time expired.

1.3 Completion Times

EXAMPLES (continued)

On restoring one of the pumps to OPERABLE status, the Condition A Completion Time is not reset, but continues from the time the first pump was declared inoperable. This Completion Time may be extended if the pump restored to OPERABLE status was the first inoperable pump. A 24 hour extension to the stated 7 days is allowed, provided this does not result in the second pump being inoperable for > 7 days.

1.3 Completion Times

EXAMPLES (continued)

EXAMPLE 1.3-3

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One Function X train inoperable.	A.1 Restore Function X train to OPERABLE status.	7 days <u>AND</u> 10 days from discovery of failure to meet the LCO
B. One Function Y train inoperable.	B.1 Restore Function Y train to OPERABLE status.	72 hours <u>AND</u> 10 days from discovery of failure to meet the LCO
C. One Function X train inoperable. <u>AND</u> One Function Y train inoperable.	C.1 Restore Function X train to OPERABLE status. <u>OR</u> C.2 Restore Function Y train to OPERABLE status.	72 hours 72 hours

1.3 Completion Times

EXAMPLES (continued)

When one Function X train and one Function Y train are inoperable, Condition A and Condition B are concurrently applicable. The Completion Times for Condition A and Condition B are tracked separately for each train starting from the time each train was declared inoperable and the Condition was entered. A separate Completion Time is established for Condition C and tracked from the time the second train was declared inoperable (i.e., the time the situation described in Condition C was discovered).

If Required Action C.2 is completed within the specified Completion Time, Conditions B and C are exited. If the Completion Time for Required Action A.1 has not expired, operation may continue in accordance with Condition A. The remaining Completion Time in Condition A is measured from the time the affected train was declared inoperable (i.e., initial entry into Condition A).

The Completion Times of Conditions A and B are modified by a logical connector, with a separate 10 day Completion Time measured from the time it was discovered the LCO was not met. In this example, without the separate Completion Time, it would be possible to alternate between Conditions A, B, and C in such a manner that operation could continue indefinitely without ever restoring systems to meet the LCO. The separate Completion Time modified by the phrase "from discovery of failure to meet the LCO" is designed to prevent indefinite continued operation while not meeting the LCO. This Completion Time allows for an exception to the normal "time zero" for beginning the Completion Time "clock." In this instance, the Completion Time "time zero" is specified as commencing at the time the LCO was initially not met, instead of at the time the associated Condition was entered.

1.3 Completion Times

EXAMPLES (continued)

EXAMPLE 1.3-4

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more valves inoperable.	A.1 Restore valve(s) to OPERABLE status.	4 hours
B. Required Action and associated Completion Time not met.	B.1 Be in MODE 3. <u>AND</u>	6 hours
	B.2 Be in MODE 4.	12 hours

A single Completion Time is used for any number of valves inoperable at the same time. The Completion Time associated with Condition A is based on the initial entry into Condition A and is not tracked on a per valve basis. Declaring subsequent valves inoperable, while Condition A is still in effect, does not trigger the tracking of separate Completion Times.

Once one of the valves has been restored to OPERABLE status, the Condition A Completion Time is not reset, but continues from the time the first valve was declared inoperable. The Completion Time may be extended if the valve restored to OPERABLE status was the first inoperable valve. The Condition A Completion Time may be extended for up to 4 hours provided this does not result in any subsequent valve being inoperable for > 4 hours.

If the Completion Time of 4 hours (plus the extension) expires while one or more valves are still inoperable, Condition B is entered.

1.3 Completion Times

EXAMPLES (continued)

EXAMPLE 1.3-5

ACTIONS

NOTE

Separate Condition entry is allowed for each inoperable valve.

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more valves inoperable.	A.1 Restore valve to OPERABLE status.	4 hours
B. Required Action and associated Completion Time not met.	B.1 Be in MODE 3.	6 hours
	<u>AND</u> - B.2 Be in MODE 4.	12 hours

The Note above the ACTIONS Table is a method of modifying how the Completion Time is tracked. If this method of modifying how the Completion Time is tracked was applicable only to a specific Condition, the Note would appear in that Condition rather than at the top of the ACTIONS Table.

The Note allows Condition A to be entered separately for each inoperable valve, and Completion Times tracked on a per valve basis. When a valve is declared inoperable, Condition A is entered and its Completion Time starts. If subsequent valves are declared inoperable, Condition A is entered for each valve and separate Completion Times start and are tracked for each valve.

1.3 Completion Times

EXAMPLES (continued)

If the Completion Time associated with a valve in Condition A expires, Condition B is entered for that valve. If the Completion Times associated with subsequent valves in Condition A expire, Condition B is entered separately for each valve and separate Completion Times start and are tracked for each valve. If a valve that caused entry into Condition B is restored to OPERABLE status, Condition B is exited for that valve.

Since the Note in this example allows multiple Condition entry and tracking of separate Completion Times, Completion Time extensions do not apply.

EXAMPLE 1.3-6

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One channel inoperable.	A.1 Perform SR 3.x.x.x.	Once per 8 hours
	<u>OR</u> A.2 Reduce THERMAL POWER to $\leq 50\%$ RTP.	8 hours
B. Required Action and associated Completion Time not met.	B.1 Be in MODE 3.	6 hours

1.3 Completion Times

EXAMPLES (continued)

Entry into Condition A offers a choice between Required Action A.1 or A.2. Required Action A.1 has a "once per" Completion Time, which qualifies for the 25% extension, per SR 3.0.2, to each performance after the initial performance. The initial 8 hour interval of Required Action A.1 begins when Condition A is entered and the initial performance of Required Action A.1 must be complete within the first 8 hour interval. If Required Action A.1 is followed and the Required Action is not met within the Completion Time (plus the extension allowed by SR 3.0.2), Condition B is entered. If Required Action A.2 is followed and the Completion Time of 8 hours is not met, Condition B is entered.

If after entry into Condition B, Required Action A.1 or A.2 is met, Condition B is exited and operation may then continue in Condition A.

1.3 Completion Times

EXAMPLES (continued)

ACTIONS		
CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One subsystem inoperable.	A.1 Verify affected subsystem isolated.	1 hour <u>AND</u> Once per 8 hours thereafter
	<u>AND</u> A.2 Restore subsystem to OPERABLE status.	72 hours
B. Required Action and associated Completion Time not met.	B.1 Be in MODE 3.	6 hours
	<u>AND</u> B.2 Be in MODE 5.	36 hours

Required Action A.1 has two Completion Times. The 1 hour Completion Time begins at the time the Condition is entered and each "Once per 8 hours thereafter" interval begins upon performance of Required Action A.1.

If after Condition A is entered, Required Action A.1 is not met within either the initial 1 hour or any subsequent 8 hour interval from the previous performance (plus the extension allowed by SR 3.0.2), Condition B is entered. The Completion Time clock for Condition A does not stop after Condition B is entered, but continues from the time Condition A was initially entered. If Required Action A.1 is met after Condition B is entered, Condition B is exited and operation may continue in accordance with Condition A, provided the Completion Time for Required Action A.2 has not expired.

1.3 Completion Times

IMMEDIATE COMPLETION TIME	When "Immediately" is used as a Completion Time, the Required Action should be pursued without delay and in a controlled manner.
------------------------------	---

1.0 USE AND APPLICATION

1.4 Frequency

PURPOSE	The purpose of this section is to define the proper use and application of Frequency requirements.
DESCRIPTION	<p>Each Surveillance Requirement (SR) has a specified Frequency in which the Surveillance must be met in order to meet the associated LCO. An understanding of the correct application of the specified Frequency is necessary for compliance with the SR.</p> <p>The "specified Frequency" is referred to throughout this section and each of the Specifications of Section 3.0, Surveillance Requirement (SR) Applicability. The "specified Frequency" consists of the requirements of the Frequency column of each SR, as well as certain Notes in the Surveillance column that modify performance requirements.</p> <p>Sometimes special situations dictate when the requirements of a Surveillance are to be met. They are "otherwise stated" conditions allowed by SR 3.0.1. They may be stated as clarifying Notes in the Surveillance, as part of the Surveillances, or both.</p> <p>Situations where a Surveillance could be required (i.e., its Frequency could expire), but where it is not possible or not desired that it be preformed until sometime after the associated LCO is within its Applicability, represent potential SR 3.0.4 conflicts. To avoid these conflicts, the SR (i.e., the Surveillance or the Frequency) is stated such that it is only "required" when it can be and should be performed. With an SR satisfied, SR 3.0.4 imposes no restriction.</p> <p>The use of "met" or "performed" in these instances conveys specific meanings. A Surveillance is "met" only when the acceptance criteria are satisfied. Known failure of the requirements of a Surveillance, even without a Surveillance specifically being "performed," constitutes a Surveillance not "met." "Performance" refers only to the requirement to specifically determine the ability to meet the acceptance criteria.</p> <p>Some Surveillances contain notes that modify the Frequency of performance or the conditions during which the acceptance criteria must be satisfied. For these Surveillances, the MODE-entry restrictions of SR 3.0.4 may not apply. Such a Surveillance is not required to be performed prior to entering a MODE or other specified condition in the Applicability of the associated LCO if any of the following three conditions are satisfied:</p>

1.4 Frequency

DESCRIPTION (continued)

- a. The Surveillance is not required to be met in the MODE or other specified condition to be entered: or
- b. The Surveillance is required to be met in the MODE or other specified condition to be entered, but has been performed within the specified Frequency (i.e., it is current) and is known not to be failed; or
- c. The Surveillance is required to be met, but not performed, in the MODE or other specified condition to be entered, and is known no to be failed.

Examples 1.4-3, 1.4-4, 1.4-5, and 1.4-6 discuss these special situations.

EXAMPLES

The following examples illustrate the various ways that Frequencies are specified. In these examples, the Applicability of the LCO (LCO not shown) is MODES 1, 2, and 3.

1.4 Frequency

EXAMPLES (continued)

EXAMPLE 1.4-1SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
Perform CHANNEL CHECK.	12 hours

Example 1.4-1 contains the type of SR most often encountered in the Technical Specifications (TS). The Frequency specifies an interval (12 hours) during which the associated Surveillance must be performed at least one time. Performance of the Surveillance initiates the subsequent interval. Although the Frequency is stated as 12 hours, an extension of the time interval to 1.25 times the stated Frequency is allowed by SR 3.0.2 for operational flexibility. The measurement of this interval continues at all times, even when the SR is not required to be met per SR 3.0.1 (such as when the equipment is inoperable, a variable is outside specified limits, or the unit is outside the Applicability of the LCO). If the interval specified by SR 3.0.2 is exceeded while the unit is in a MODE or other specified condition in the Applicability of the LCO, and the performance of the Surveillance is not otherwise modified (refer to Example 1.4-3), then SR 3.0.3 becomes applicable.

If the interval as specified by SR 3.0.2 is exceeded while the unit is not in a MODE or other specified condition in the Applicability of the LCO for which performance of the SR is required, the Surveillance must be performed within the Frequency requirements of SR 3.0.2 prior to entry into the MODE or other specified condition. Failure to do so would result in a violation of SR 3.0.4.

1.4 Frequency

EXAMPLES (continued)

EXAMPLE 1.4-2SURVEILLANCE REQUIREMENTS

<u>SURVEILLANCE</u>	<u>FREQUENCY</u>
Verify flow is within limits.	Once within 12 hours after $\geq 25\%$ RTP <u>AND</u> 24 hours thereafter

Example 1.4-2 has two Frequencies. The first is a one time performance Frequency, and the second is of the type shown in Example 1.4-1. The logical connector "AND" indicates that both Frequency requirements must be met. Each time reactor power is increased from a power level $< 25\%$ RTP to $\geq 25\%$ RTP, the Surveillance must be performed within 12 hours.

The use of "once" indicates a single performance will satisfy the specified Frequency (assuming no other Frequencies are connected by "AND"). This type of Frequency does not qualify for the extension allowed by SR 3.0.2. "Thereafter" indicates future performances must be established per SR 3.0.2, but only after a specified condition is first met (i.e., the "once" performance in this example). If reactor power decreases to $< 25\%$ RTP, the measurement of both intervals stops. New intervals start upon reactor power reaching 25% RTP.

1.4 Frequency

EXAMPLES (continued)

EXAMPLE 1.4-3SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
-----NOTE----- Not required to be performed until 12 hours after ≥ 25% RTP. -----	
Perform channel adjustment.	7 days

The interval continues whether or not the unit operation is < 25% RTP between performances.

As the Note modifies the required performance of the Surveillance, it is construed to be part of the "specified Frequency." Should the 7 day interval be exceeded while operation is < 25% RTP, this Note allows 12 hours after power reaches ≥ 25% RTP to perform the Surveillance. The Surveillance is still considered to be performed within the "specified Frequency." Therefore, if the Surveillance were not performed within the 7 day (plus the extension allowed by SR 3.0.2) interval, but operation was < 25% RTP, it would not constitute a failure of the SR or failure to meet the LCO. Also, no violation of SR 3.0.4 occurs when changing MODES, even with the 7 day Frequency not met, provided operation does not exceed 12 hours with power ≥ 25% RTP.

Once the unit reaches 25% RTP, 12 hours would be allowed for completing the Surveillance. If the Surveillance were not performed within this 12 hour interval, there would then be a failure to perform a Surveillance within the specified Frequency, and the provisions of SR 3.0.3 would apply.

1.4 Frequency

EXAMPLES (continued)

EXAMPLE 1.4-4SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
-----NOTE----- Only required to be met in MODE 1. -----	24 hours
Verify leakage rates are within limits.	

Example 1.4-4 specifies that the requirements of this Surveillance do not have to be met until the unit is in MODE 1. The interval measurement for the Frequency of this Surveillance continues at all times, as described in Example 1.4-1. However, the Note constitutes an "otherwise stated" exception to the Applicability of this Surveillance. Therefore, if the Surveillance were not performed within the 24 hour interval (plus the extension allowed by SR 3.0.2), but the unit was not in MODE 1, there would be no failure of the SR nor failure to meet the LCO. Therefore, no violation of SR 3.0.4 occurs when changing MODES, even with the 24 hour Frequency exceeded, provided the MODE change was not made into MODE 1. Prior to entering MODE 1 (assuming again that the 24 hour Frequency were not met), SR 3.0.4 would require satisfying the SR.

1.4 Frequency

EXAMPLES (continued)

EXAMPLE 1.4-5SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
-----NOTE----- Only required to be performed in MODE 1. -----	
Perform complete cycle of the valve.	7 days

The interval continues, whether or not the unit operation is in MODE 1,2 or 3 (the assumed Applicability of the associated LCO) between performances.

As the Note modifies the required performance of the Surveillance, the Note is construed to be part of the "specified Frequency." Should the 7 day interval be exceeded while operation is not in MODE 1, this Note allows entry into and operation in MODES 2 and 3 to perform the Surveillance. The Surveillance is still considered to be performed within the "specified Frequency" if completed prior to entering MODE 1. Therefore, if the Surveillance were not performed within the 7 day (plus the extension allowed by SR 3.0.2) interval, but operation was not in MODE 1, it would not constitute a failure of the SR or failure to meet the LCO. Also, no violation of SR 3.0.4 occurs when changing MODES, even with the 7 day Frequency not met, provided operation does not result in entry into MODE 1.

Once the unit reaches MODE 1, the requirement for the Surveillance to be performed within its specified Frequency applies and would require that the Surveillance had been performed. If the Surveillance were not performed prior to entering MODE 1, there would then be a failure to perform a Surveillance within the specified Frequency, and the provisions of SR 3.0.3 would apply.

1.4 Frequency

EXAMPLES (continued)

EXAMPLE 1.4-6

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
<p>-----NOTE----- Not required to be met in MODE 3. -----</p> <p>Verify parameter is within limits.</p>	24 hours

Example 1.4-6 specifies that the requirements of this Surveillance do not have to be met while the unit is in MODE 3 (the assumed Applicability of the associated LCO is MODES 1,2, and 3). The interval measurement for the Frequency of this Surveillance continues at all times, as described in Example 1.4-1. However, the Note constitutes an "otherwise stated" exception to the Applicability of this Surveillance. Therefore, if the Surveillance were not performed within the 24 hour interval (plus the extension allowed by SR 3.0.2), and the unit was in MODE 3, there would be no failure of the SR nor failure to meet the LCO. Therefore, no violation of SR 3.0.4 occurs when changing MODES to enter MODE 3, even with the 24 hour Frequency exceeded, provided the MODE change does not result in entry into MODE 2. Prior to entering MODE 2 (assuming again that the 24 hour Frequency were not met), SR 3.0.4 would require satisfying the SR.

2.0 SAFETY LIMITS (SLs)

2.1 SLs

2.1.1 Reactor Core SLs

- 2.1.1.1 In MODES 1 and 2, the maximum local fuel pin centerline temperature shall be $\leq 5080 - (6.5 \times 10^{-3} \times (\text{Burnup, MWD/MTU})^\circ\text{F})$ for TACO2 applications and $\leq 4642 - (5.8 \times 10^{-3} \times (\text{Burnup, MWD/MTU})^\circ\text{F})$ for TACO 3 applications.
- 2.1.1.2 In MODES 1 and 2, the departure from nucleate boiling ratio shall be maintained greater than the limits of 1.3 for the BAW-2 correlation and 1.18 for the BWC correlation.
- 2.1.1.3 In MODES 1 and 2, Reactor Coolant System (RCS) core outlet temperature and pressure shall be maintained above and to the left of the Variable Low RCS Pressure-Temperature Protective Limits as specified in the Core Operating Limits Report, so that the safety limits are met.

2.1.2 RCS Pressure SL

In MODES 1, 2, 3, 4, and 5, the RCS pressure shall be maintained ≤ 2750 psig.

2.2 SL Violations

With any SL violation, the following actions shall be completed:

- 2.2.1 In MODE 1 or 2, if SL 2.1.1.1 or SL 2.1.1.2 is violated, be in MODE 3 within 1 hour.
 - 2.2.2 In MODE 1 or 2, if SL 2.1.1.3 is violated, restore RCS pressure and temperature within limits AND be in MODE 3 within 1 hour.
 - 2.2.3 In MODE 1 or 2, if SL 2.1.2 is violated, restore compliance within limits AND be in MODE 3 within 1 hour.
 - 2.2.4 In MODES 3, 4, and 5, if SL 2.1.2 is violated, restore RCS pressure to ≤ 2750 psig within 5 minutes.
 - 2.2.5 Within 1 hour, notify the NRC Operations Center, in accordance with 10 CFR 50.72.
-

3.0 LIMITING CONDITION FOR OPERATION (LCO) APPLICABILITY

LCO 3.0.1 LCOs shall be met during the MODES or other specified conditions in the Applicability, except as provided in LCO 3.0.2 and LCO 3.0.7.

LCO 3.0.2 Upon discovery of a failure to meet an LCO, the Required Actions of the associated Conditions shall be met, except as provided in LCO 3.0.5 and LCO 3.0.6.

If the LCO is met or is no longer applicable prior to expiration of the specified Completion Time(s), completion of the Required Action(s) is not required, unless otherwise stated.

LCO 3.0.3 When an LCO is not met and the associated ACTIONS are not met, an associated ACTION is not provided, or if directed by the associated ACTIONS, the unit shall be placed in a MODE or other specified condition in which the LCO is not applicable. Action shall be initiated within 1 hour to place the unit, as applicable, in:

- a. MODE 3 within 7 hours;
- b. MODE 4 within 13 hours; and
- c. MODE 5 within 37 hours.

Exceptions to this Specification are stated in the individual Specifications.

Where corrective measures are completed that permit operation in accordance with the LCO or ACTIONS, completion of the actions required by LCO 3.0.3 is not required.

LCO 3.0.3 is only applicable in MODES 1, 2, 3, and 4.

LCO 3.0.4 When an LCO is not met, entry into a MODE or other specified condition in the Applicability shall not be made except when the associated ACTIONS to be entered permit continued operation in the MODE or other specified condition in the Applicability for an unlimited period of time. This Specification shall not prevent changes in MODES or other specified conditions in the Applicability that are required to comply with ACTIONS or that are part of a shutdown of the unit.

3.0 LCO APPLICABILITY

LCO 3.0.4
(continued)

Exceptions to this Specification are stated in the individual Specifications.

LCO 3.0.4 is only applicable for entry into a MODE or other specified condition in the Applicability in MODES 1, 2, 3 and 4.

LCO 3.0.5

Equipment removed from service or declared inoperable to comply with ACTIONS may be returned to service under administrative control solely to perform testing required to demonstrate its OPERABILITY or the OPERABILITY of other equipment. This is an exception to LCO 3.0.2 for the system returned to service under administrative control to perform the testing required to demonstrate OPERABILITY.

LCO 3.0.6

When a supported system LCO is not met solely due to a support system LCO not being met, the Conditions and Required Actions associated with this supported system are not required to be entered. Only the support system LCO ACTIONS are required to be entered. This is an exception to LCO 3.0.2 for the supported system. In this event, an evaluation shall be performed in accordance with Specification 5.5.15, "Safety Function Determination Program (SFDP)." If a loss of safety function is determined to exist by this program, the appropriate Conditions and Required Actions of the LCO in which the loss of safety function exists are required to be entered.

When a support system's Required Action directs a supported system to be declared inoperable or directs entry into Conditions and Required Actions for a supported system, the applicable Conditions and Required Actions shall be entered in accordance with LCO 3.0.2.

LCO 3.0.7

Test Exception LCOs 3.1.8 and 3.1.9 allow specified Technical Specification (TS) requirements to be changed to permit performance of special tests and operations. Unless otherwise specified, all other TS requirements remain unchanged. Compliance with Test Exception LCOs is optional. When a Test Exception LCO is desired to be met but is not met, the ACTIONS of the Test Exception LCO shall be met. When a Test Exception LCO is not desired to be met, entry into a MODE or other specified condition in the Applicability shall be made in accordance with the other applicable Specifications.

3.0 SURVEILLANCE REQUIREMENT (SR) APPLICABILITY

SR 3.0.1 SRs shall be met during the MODES or other specified conditions in the Applicability for individual LCOs, unless otherwise stated in the SR. Failure to meet a Surveillance, whether such failure is experienced during the performance of the Surveillance or between performances of the Surveillance, shall be failure to meet the LCO. Failure to perform a Surveillance within the specified Frequency shall be failure to meet the LCO except as provided in SR 3.0.3. Surveillances do not have to be performed on inoperable equipment or variables outside specified limits.

SR 3.0.2 The specified Frequency for each SR is met if the Surveillance is performed within 1.25 times the interval specified in the Frequency, as measured from the previous performance or as measured from the time a specified condition of the Frequency is met.

For Frequencies specified as "once," the above interval extension does not apply.

If a Completion Time requires periodic performance on a "once per . . ." basis, the above Frequency extension applies to each performance after the initial performance.

Exceptions to this Specification are stated in the individual Specifications.

SR 3.0.3 If it is discovered that a Surveillance was not performed within its specified Frequency, then compliance with the requirement to declare the LCO not met may be delayed, from the time of discovery, up to 24 hours or up to the limit of the specified Frequency, whichever is less. This delay period is permitted to allow performance of the Surveillance.

If the Surveillance is not performed within the delay period, the LCO must immediately be declared not met, and the applicable Condition(s) must be entered.

When the Surveillance is performed within the delay period and the Surveillance is not met, the LCO must immediately be declared not met, and the applicable Condition(s) must be entered.

3.0 SR APPLICABILITY

SR 3.0.4 Entry into a MODE or other specified condition in the Applicability of an LCO shall not be made unless the LCO's Surveillances have been met within their specified Frequency. This provision shall not prevent entry into MODES or other specified conditions in the Applicability that are required to comply with ACTIONS or that are part of a shutdown of the unit.

SR 3.0.4 is only applicable for entry into a MODE or other specified condition in the Applicability in MODES 1, 2, 3, and 4.

3.1 REACTIVITY CONTROL SYSTEMS

3.1.1 SHUTDOWN MARGIN (SDM)

LCO 3.1.1 The SDM shall be within the limit specified in the COLR.

APPLICABILITY: MODES 3, 4, and 5.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. SDM not within limit.	A.1 Initiate boration to restore SDM to within limit.	15 minutes

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.1.1.1	Verify SDM greater than or equal to the limit specified in the COLR.	24 hours

3.1 REACTIVITY CONTROL SYSTEMS

3.1.2 Reactivity Balance

LCO 3.1.2 The measured core reactivity balance shall be within $\pm 1\% \Delta k/k$ of predicted values.

APPLICABILITY: MODES 1 and 2.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. Measured core reactivity balance not within limit.	A.1 Re-evaluate core design and safety analysis and determine that the reactor core is acceptable for continued operation.	7 days
	<u>AND</u> A.2 Establish appropriate operating restrictions and SRs.	7 days
B. Required Action and associated Completion Time not met.	B.1 Be in MODE 3.	6 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
<p>SR 3.1.2.1</p> <p>-----NOTES-----</p> <ol style="list-style-type: none"> 1. The predicted reactivity values may be adjusted (normalized) to correspond to the measured core reactivity prior to exceeding a fuel burnup of 60 effective full power days (EFPD) after each fuel loading. 2. This Surveillance is not required to be performed prior to entry into MODE 2. <p>-----</p> <p>Verify measured core reactivity balance is within $\pm 1\% \Delta k/k$ of predicted values.</p>	<p>Once prior to entering MODE 1 after each fuel loading</p> <p><u>AND</u></p> <p>-----NOTE----- Only required after 60 EFPD -----</p> <p>31 EFPD thereafter</p>

3.1 REACTIVITY CONTROL SYSTEMS

3.1.3 Moderator Temperature Coefficient (MTC)

LCO 3.1.3 The MTC shall be non-positive whenever THERMAL POWER is $\geq 95\%$ RTP and shall be less positive than $0.9 \times 10^{-4} \Delta k/k/^{\circ}F$ whenever THERMAL POWER is $< 95\%$ RTP.

APPLICABILITY: MODES 1 and 2.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. MTC not within limits.	A.1 Be in MODE 3.	6 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.1.3.1 Verify MTC is within the limits.	Once prior to entering MODE 1 after each fuel loading

3.1 REACTIVITY CONTROL SYSTEMS

3.1.4 CONTROL ROD Group Alignment Limits

LCO 3.1.4 Each CONTROL ROD shall be OPERABLE and aligned to within 6.5% of its group average height.

APPLICABILITY: MODES 1 and 2.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One CONTROL ROD inoperable, or not aligned to within 6.5% of its group average height, or both.	A.1.1 Verify SDM to be within the limit provided in the COLR.	1 hour
	<u>AND</u>	
		Once per 12 hours thereafter
	<u>OR</u>	
	A.1.2 Initiate boration to restore SDM to within limit.	1 hour
	<u>AND</u>	
	A.2.1 Restore CONTROL ROD alignment.	2 hours
	<u>OR</u>	
	A.2.2.1 Reduce THERMAL POWER to $\leq 60\%$ of the ALLOWABLE THERMAL POWER.	2 hours
	<u>AND</u>	
	A.2.2.2 Verify the potential ejected rod worth is within the assumptions of the rod ejection analysis.	72 hours
	<u>AND</u>	

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. (continued)	<p>A.2.2.3 -----NOTE----- Only required when THERMAL POWER is > 20% RTP. -----</p> <p>Perform SR 3.2.5.1.</p>	72 hours
B. Required Action and associated Completion Time for Condition A not met.	B.1 Be in MODE 3.	6 hours
C. More than one CONTROL ROD inoperable, or not aligned within 6.5% of its group average height, or both.	<p>C.1.1 Verify SDM to be within the limit provided in the COLR.</p> <p style="text-align: center;"><u>OR</u></p> <p>C.1.2 Initiate boration to restore SDM to within limit.</p> <p style="text-align: center;"><u>AND</u></p> <p>C.2 Be in MODE 3.</p>	<p>1 hour</p> <p>1 hour</p> <p>6 hours</p>

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.1.4.1	Verify individual CONTROL ROD positions are within 6.5% of their group average height.	12 hours
SR 3.1.4.2	Verify CONTROL ROD freedom of movement for each individual CONTROL ROD that is not fully inserted.	92 days

SURVEILLANCE	FREQUENCY
<p>SR 3.1.4.3</p> <p>-----NOTE-----</p> <p>With rod drop times determined with at least one but less than four reactor coolant pumps operating, operation may proceed provided operation is restricted to the pump combination operating during the rod drop time determination or pump combinations providing less total reactor coolant flow.</p> <p>-----</p> <p>Verify the rod drop time for each CONTROL ROD, from the fully withdrawn position, is ≤ 1.66 seconds from power interruption at the CONTROL ROD drive breakers to $\frac{3}{4}$ insertion (25% withdrawn position) with $T_{avg} \geq 525^{\circ}\text{F}$.</p>	<p>Once prior to reactor criticality after each removal of the reactor vessel head</p>

3.1 REACTIVITY CONTROL SYSTEMS

3.1.5 Safety Rod Insertion Limits

LCO 3.1.5 Each safety rod shall be fully withdrawn.

-----NOTE-----
Not required for any safety rod inserted to perform SR 3.1.4.2.

APPLICABILITY: MODES 1 and 2.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One safety rod not fully withdrawn.	A.1.1 Verify SDM to be within the limit provided in the COLR.	1 hour
	<u>OR</u>	
	A.1.2 Initiate boration to restore SDM to within limit.	1 hour
	<u>AND</u>	
	A.2 Declare the rod inoperable.	1 hour
B. More than one safety rod not fully withdrawn.	B.1.1 Verify SDM to be within the limit provided in the COLR.	1 hour
	<u>OR</u>	
	B.1.2 Initiate boration to restore SDM to within limit.	1 hour
	<u>AND</u>	
	B.2 Be in MODE 3.	6 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.1.5.1	Verify each safety rod is fully withdrawn.	12 hours

3.1 REACTIVITY CONTROL SYSTEMS

3.1.6 AXIAL POWER SHAPING ROD (APSR) Alignment Limits

LCO 3.1.6 Each APSR shall be OPERABLE and aligned to within 6.5% of its group average height.

APPLICABILITY: MODES 1 and 2.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One APSR inoperable, or not aligned to within 6.5% of its group average height, or both.	A.1 Perform SR 3.2.5.1.	2 hours <u>AND</u> 2 hours after each APSR movement
B. Required Action and associated Completion Time not met.	B.1 Be in MODE 3	6 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.1.6.1 Verify position of each APSR is within 6.5% of the group average height.	12 hours

3.1 REACTIVITY CONTROL SYSTEMS

3.1.7 Position Indicator Channels

LCO 3.1.7 One position indicator channel for each CONTROL ROD and APSR shall be OPERABLE.

APPLICABILITY: MODES 1 and 2.

ACTIONS

NOTES

Separate Condition entry is allowed for each CONTROL ROD and APSR.

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. The required position indicator channel inoperable for one or more rods.	A.1 Declare the rod(s) inoperable.	Immediately

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.1.7.1 Perform CHANNEL CHECK of required position indicator channel.	12 hours
SR 3.1.7.2 Perform CHANNEL CALIBRATION of required position indicator channel.	18 months

3.1 REACTIVITY CONTROL SYSTEMS

3.1.8 PHYSICS TESTS Exceptions - MODE 1

LCO 3.1.8 During the performance of PHYSICS TESTS, the requirements of

LCO 3.1.4, "CONTROL ROD Group Alignment Limits";
 LCO 3.1.5, "Safety Rod Insertion Limits";
 LCO 3.1.6, "AXIAL POWER SHAPING ROD (APSR) Alignment Limits";
 LCO 3.2.1, "Regulating Rod Insertion Limits," for the restricted operation region only;
 LCO 3.2.2, "AXIAL POWER SHAPING ROD (APSR) Insertion Limits";
 LCO 3.2.3, "AXIAL POWER IMBALANCE Operating Limits"; and
 LCO 3.2.4, "QUADRANT POWER TILT (QPT)"

may be suspended, provided:

- a. THERMAL POWER is maintained \leq 85% RTP;
- b. Nuclear overpower trip setpoint is \leq 10% RTP higher than the THERMAL POWER at which the test is performed, with a maximum setting of 90% RTP;

c. -----NOTE-----
 Only required when THERMAL POWER is $>$ 20% RTP.

Linear Heat Rate (LHR) is maintained within the limits specified in the COLR; and

- d. SDM is within the limits provided in the COLR.

APPLICABILITY: MODE 1 during PHYSICS TESTS.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. SDM not within limit.	A.1 Initiate boration to restore SDM to within limit.	15 minutes
	<u>AND</u> A.2 Suspend PHYSICS TESTS exceptions.	1 hour

CONDITION	REQUIRED ACTION	COMPLETION TIME
<p>B. THERMAL POWER > 85% RTP.</p> <p><u>OR</u></p> <p>Nuclear overpower trip setpoint > 10% higher than PHYSICS TESTS power level.</p> <p><u>OR</u></p> <p>Nuclear overpower trip setpoint > 90% RTP.</p> <p><u>OR</u></p> <p>-----NOTE----- Only required when THERMAL POWER is > 20% RTP. -----</p> <p>LHR not within limits.</p>	B.1 Suspend PHYSICS TESTS exceptions.	1 hour

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.1.8.1	Verify THERMAL POWER is \leq 85% RTP.	1 hour
SR 3.1.8.2	<p>-----NOTE----- Only required when THERMAL POWER is > 20% RTP. -----</p> <p>Perform SR 3.2.5.1.</p>	2 hours
SR 3.1.8.3	Verify nuclear overpower trip setpoint is \leq 10% RTP higher than the THERMAL POWER at which the test is performed, with a maximum setting of 90% RTP.	Within 8 hours prior to performance of PHYSICS TESTS at each test plateau

SURVEILLANCE		FREQUENCY
SR 3.1.8.4	Verify SDM to be within the limits provided in the COLR.	24 hours

3.1 REACTIVITY CONTROL SYSTEMS

3.1.9 PHYSICS TESTS Exceptions - MODE 2

- LCO 3.1.9 During performance of PHYSICS TESTS, the requirements of
- LCO 3.1.3, "Moderator Temperature Coefficient (MTC)";
 - LCO 3.1.4, "CONTROL ROD Group Alignment Limits";
 - LCO 3.1.5, "Safety Rod Insertion Limits";
 - LCO 3.1.6, "AXIAL POWER SHAPING ROD (APSR) Alignment Limits";
 - LCO 3.2.1, "Regulating Rod Insertion Limits";
 - LCO 3.2.2, "AXIAL POWER SHAPING ROD (APSR) Insertion Limits";
 - and
 - LCO 3.4.2, "RCS Minimum Temperature for Criticality"
- may be suspended, provided:
- a. THERMAL POWER is $\leq 5\%$ RTP;
 - b. Nuclear overpower trip setpoint is set to $\leq 5\%$ RTP;
 - c. Nuclear instrumentation high startup rate CONTROL ROD withdrawal inhibit is OPERABLE; and
 - d. SDM is within the limits provided in the COLR.

APPLICABILITY: During PHYSICS TESTS initiated in MODE 2.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. THERMAL POWER not within limit.	A.1 Open control rod drive trip breakers.	Immediately
B. SDM not within limit.	B.1 Initiate boration to restore SDM to within limit.	15 minutes
	<u>AND</u> B.2 Suspend PHYSICS TESTS exceptions.	1 hour

CONDITION	REQUIRED ACTION	COMPLETION TIME
<p>C. Nuclear overpower trip setpoint is not within limit.</p> <p><u>OR</u></p> <p>Nuclear instrumentation high startup rate CONTROL ROD withdrawal inhibit inoperable.</p>	<p>C.1 Suspend PHYSICS TESTS exceptions.</p>	<p>1 hour</p>

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.1.9.1	Verify THERMAL POWER is \leq 5% RTP.	1 hour
SR 3.1.9.2	Verify nuclear overpower trip setpoint is \leq 5% RTP.	Within 8 hours prior to performance of PHYSICS TESTS
SR 3.1.9.3	Verify SDM to be within the limit provided in the COLR.	24 hours

3.2 POWER DISTRIBUTION LIMITS

3.2.1 Regulating Rod Insertion Limits

LCO 3.2.1 Regulating rod groups shall be within the physical insertion, sequence, and overlap limits specified in the COLR.

-----NOTE-----
Not required for any regulating rod repositioned to perform SR 3.1.4.2:

APPLICABILITY: MODES 1 and 2.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. Regulating rod groups inserted in restricted operation region.	A.1 -----NOTE----- Only required when THERMAL POWER is > 20% RTP. Perform SR 3.2.5.1.	Once per 2 hours
	<u>AND</u> A.2 Restore regulating rod groups to within acceptable region.	24 hours from discovery of failure to meet the LCO
B. Required Action and associated Completion Time of Condition A not met.	B.1 Reduce THERMAL POWER to less than or equal to THERMAL POWER allowed by regulating rod group insertion limits.	2 hours
C. Regulating rod groups sequence or overlap requirements not met.	C.1 Restore regulating rod groups to within limits.	4 hours

CONDITION	REQUIRED ACTION	COMPLETION TIME
D. Regulating rod groups inserted in unacceptable operation region.	D.1 Initiate boration to restore SDM to within the limit provided in the COLR.	15 minutes
	<u>AND</u>	
	D.2.1 Restore regulating rod groups to within restricted operation region.	2 hours
	<u>OR</u>	
	D.2.2 Reduce THERMAL POWER to less than or equal to the THERMAL POWER allowed by the regulating rod group insertion limits.	2 hours
E. Required Actions and associated Completion Times of Conditions C or D not met.	E.1 Be in MODE 3.	6 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.2.1.1	Verify regulating rod groups are within the sequence and overlap limits as specified in the COLR.	12 hours
SR 3.2.1.2	Verify regulating rod groups meet the insertion limits as specified in the COLR.	12 hours
SR 3.2.1.3	Verify $SDM \geq 1\% \Delta k/k$.	Within 4 hours prior to achieving criticality

3.2 POWER DISTRIBUTION LIMITS

3.2.2 AXIAL POWER SHAPING ROD (APSR) Insertion Limits

LCO 3.2.2 APSRs shall be positioned within the limits specified in the COLR.

APPLICABILITY: MODES 1 and 2.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. APSRs not within limits.	A.1 <u>-----NOTE-----</u> Only required when THERMAL POWER is > 20% RTP. ----- Perform SR 3.2.5.1.	Once per 2 hours
	AND A.2 Restore APSRs to within limits.	24 hours
B. Required Action and associated Completion Time not met.	B.1 Be in MODE 3.	6 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.2.2.1 Verify APSRs are within acceptable limits specified in the COLR.	12 hours

3.2 POWER DISTRIBUTION LIMITS

3.2.3 AXIAL POWER IMBALANCE Operating Limits

LCO 3.2.3 AXIAL POWER IMBALANCE shall be maintained within the limits specified in the COLR.

APPLICABILITY: MODE 1 with THERMAL POWER > 40% RTP.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. AXIAL POWER IMBALANCE not within limits.	A.1 Perform SR 3.2.5.1. <u>AND</u>	Once per 2 hours
	A.2 Reduce AXIAL POWER IMBALANCE to within limits.	24 hours
B. Required Action and associated Completion Time not met.	B.1 Reduce THERMAL POWER to \leq 40% RTP.	4 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.2.3.1 Verify AXIAL POWER IMBALANCE is within limits as specified in the COLR.	12 hours

3.2 POWER DISTRIBUTION LIMITS

3.2.4 QUADRANT POWER TILT (QPT)

LCO 3.2.4 QPT shall be maintained less than or equal to the steady state limits specified in the COLR.

APPLICABILITY: MODE 1 with THERMAL POWER > 20% RTP.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. QPT greater than the steady state limits specified in the COLR.	A.1.1 Perform SR 3.2.5.1. <u>OR</u>	Once per 2 hours
	A.1.2.1 Reduce THERMAL POWER \geq 2% RTP from the ALLOWABLE THERMAL POWER for each 1% of QPT greater than the steady state limit. <u>OR</u>	2 hours <u>OR</u> 2 hours after last performance of SR 3.2.5.1
	<u>AND</u>	
	A.1.2.2 Reduce nuclear overpower based on Reactor Coolant System flow and AXIAL POWER IMBALANCE trip setpoint \geq 2% RTP from the ALLOWABLE THERMAL POWER for each 1% of QPT greater than the steady state limit. <u>AND</u>	10 hours <u>OR</u> 10 hours after last performance of SR 3.2.5.1

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. (continued)	A.1.2.3 Reduce the regulating group insertion limits given in the COLR \geq 2% RTP from the ALLOWABLE THERMAL POWER for each 1% of QPT greater than the steady state limit. <u>AND</u>	10 hours <u>OR</u> 10 hours after last performance of SR 3.2.5.1
	A.1.2.4 Reduce the Operational Power Imbalance Setpoints given in the COLR \geq 2% RTP from the ALLOWABLE THERMAL POWER for each 1% of QPT greater than the steady state limit. <u>AND</u>	10 hours <u>OR</u> 10 hours after last performance of SR 3.2.5.1
	A.2 Restore QPT to less than or equal to the steady state limit.	24 hours from discovery of failure to meet the LCO
B. Required Action and associated Completion Time of Condition A not met.	B.1 Reduce THERMAL POWER to < 60% of the ALLOWABLE THERMAL POWER. <u>AND</u>	2 hours
	B.2 Reduce nuclear overpower trip setpoint to \leq 65.5% of the ALLOWABLE THERMAL POWER.	10 hours
C. Required Action and associated Completion Time for Condition B not met.	C.1 Reduce THERMAL POWER to \leq 20% RTP.	4 hours
D. QPT greater than the maximum limit specified in the COLR.	D.1 Reduce THERMAL POWER to \leq 20% RTP.	4 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.2.4.1	Verify QPT is within limits as specified in the COLR.	7 days <u>AND</u> When QPT has been restored to less than or equal to the steady state limit, 1 hour for 12 consecutive hours, or until verified acceptable at $\geq 95\%$ RTP

3.2 POWER DISTRIBUTION LIMITS

3.2.5 Power Peaking

LCO 3.2.5 Linear Heat Rate (LHR) shall be within the limits specified in the COLR.

APPLICABILITY: MODE 1 with THERMAL POWER > 20% RTP.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. LHR not within limits.	A.1 Reduce THERMAL POWER to restore LHR to within limits.	2 hours
B. Required Action and associated Completion Time not met.	B.1 Reduce THERMAL POWER to $\leq 20\%$ RTP.	4 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
<p>SR 3.2.5.1</p> <p style="text-align: center;">-----NOTE-----</p> <p>Only required to be performed when specified in LCO 3.1.8, "PHYSICS TESTS Exceptions – MODE 1," or when complying with Required Actions of LCO 3.1.4, "CONTROL ROD Group Alignment Limits"; LCO 3.1.6, "AXIAL POWER SHAPING ROD (APSR) Alignment Limits"; LCO 3.2.1, "Regulating Rod Insertion Limits"; LCO 3.2.2, "AXIAL POWER SHAPING ROD (APSR) Insertion Limits"; LCO 3.2.3, "AXIAL POWER IMBALANCE Operating Limits"; LCO 3.2.4, "QUADRANT POWER TILT (QPT)."</p> <p>Verify LHR is within limits by using the Incore Detector System to obtain a power distribution map.</p>	As specified by the applicable LCO(s)

3.3 INSTRUMENTATION

3.3.1 Reactor Protection System (RPS) Instrumentation

LCO 3.3.1 Four channels of RPS instrumentation for each Function in Table 3.3.1-1 shall be OPERABLE.

APPLICABILITY: According to Table 3.3.1-1.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One channel inoperable.	A.1 Place channel in bypass or trip.	1 hour
	<u>OR</u> A.2 Prevent bypass of remaining channels.	1 hour
B. Two channels inoperable.	B.1 Place one channel in trip.	1 hour
	<u>AND</u> B.2.1 Place second channel in bypass.	1 hour
	<u>OR</u> B.2.2 Prevent bypass of remaining channels.	1 hour
C. Three or more channels inoperable. <u>OR</u> Required Action and associated Completion Time of Condition A or B not met.	C.1 Enter the Condition referenced in Table 3.3.1-1 for the Function.	Immediately

CONDITION	REQUIRED ACTION	COMPLETION TIME
D. As required by Required Action C.1 and referenced in Table 3.3.1-1.	D.1 Be in MODE 3.	6 hours
	<u>AND</u> D.2 Open all control rod drive (CRD) trip breakers.	6 hours
E. As required by Required Action C.1 and referenced in Table 3.3.1-1.	E.1 Open all CRD trip breakers.	6 hours
F. As required by Required Action C.1 and referenced in Table 3.3.1-1.	F.1 Reduce THERMAL POWER < 45% RTP.	6 hours
G. As required by Required Action C.1 and referenced in Table 3.3.1-1.	G.1 Reduce THERMAL POWER < 10% RTP.	6 hours

SURVEILLANCE REQUIREMENTS

NOTE

Refer to Table 3.3.1-1 to determine which SRs apply to each RPS Function.

SURVEILLANCE	FREQUENCY
SR 3.3.1.1 Perform CHANNEL CHECK.	12 hours

SURVEILLANCE		FREQUENCY
SR 3.3.1.2	<p>-----NOTES-----</p> <ol style="list-style-type: none"> 1. Adjust power range channel output if the absolute difference is $> 2\%$ RTP. 2. Not required to be performed until 24 hours after THERMAL POWER is $\geq 20\%$ RTP. <p>-----</p> <p>Compare results of calorimetric heat balance calculation to power range channel output.</p>	<p>96 hours</p> <p><u>AND</u></p> <p>Once within 24 hours after a THERMAL POWER change of $\geq 10\%$ RTP</p>
SR 3.3.1.3	<p>-----NOTES-----</p> <ol style="list-style-type: none"> 1. Adjust the power range channel imbalance output if the absolute value of the imbalance error is $\geq 2\%$ RTP. 2. Not required to be performed until 24 hours after THERMAL POWER is $\geq 20\%$ RTP. <p>-----</p> <p>Compare results of out of core measured AXIAL POWER IMBALANCE to incore measured AXIAL POWER IMBALANCE.</p>	<p>31 days</p>
SR 3.3.1.4	Perform CHANNEL FUNCTIONAL TEST.	31 days
SR 3.3.1.5	<p>-----NOTE-----</p> <p>Neutron detectors are excluded from CHANNEL CALIBRATION.</p> <p>-----</p> <p>Perform CHANNEL CALIBRATION.</p>	<p>18 months</p>

Table 3.3.1-1
Reactor Protection System Instrumentation

FUNCTION	APPLICABLE MODES OR OTHER SPECIFIED CONDITIONS	CONDITIONS REFERENCED FROM REQUIRED ACTION C.1	SURVEILLANCE REQUIREMENTS	ALLOWABLE VALUE
1. Nuclear Overpower - a. High Setpoint	1,2 ^(a) ,3 ^(d)	D	SR 3.3.1.1 SR 3.3.1.2 SR 3.3.1.4 SR 3.3.1.5	≤ 104.9% RTP
b. Low Setpoint	2 ^(b) ,3 ^(b) 4 ^(b) ,5 ^(b)	E	SR 3.3.1.1 SR 3.3.1.4 SR 3.3.1.5	≤ 5% RTP
2. RCS High Outlet Temperature	1,2	D	SR 3.3.1.1 SR 3.3.1.4 SR 3.3.1.5	≤ 618°F
3. RCS High Pressure	1,2 ^(a) ,3 ^(d)	D	SR 3.3.1.1 SR 3.3.1.4 SR 3.3.1.5	≤ 2355 psig
4. RCS Low Pressure	1,2 ^(a)	D	SR 3.3.1.1 SR 3.3.1.4 SR 3.3.1.5	≥ 1800 psig
5. RCS Variable Low Pressure	1,2 ^(a)	D	SR 3.3.1.1 SR 3.3.1.4 SR 3.3.1.5	As specified in the COLR
6. Reactor Building High Pressure	1,2,3 ^(c)	D	SR 3.3.1.1 SR 3.3.1.4 SR 3.3.1.5	≤ 18.7 psia
7. Reactor Coolant Pump to Power	1,2 ^(a)	D	SR 3.3.1.1 SR 3.3.1.4 SR 3.3.1.5	≤ 55% RTP with one pump operating in each loop.
8. Nuclear Overpower RCS Flow and Measured AXIAL POWER IMBALANCE	1,2 ^(a)	D	SR 3.3.1.1 SR 3.3.1.3 SR 3.3.1.4 SR 3.3.1.5	As specified in the COLR
9. Main Turbine Trip (Oil Pressure)	≥ 45% RTP	F	SR 3.3.1.1 SR 3.3.1.4 SR 3.3.1.5	≥ 40.5 psig
10. Loss of Main Feedwater Pumps (Control Oil Pressure)	≥ 10% RTP	G	SR 3.3.1.1 SR 3.3.1.4 SR 3.3.1.5	≥ 55.5 psig
11. Shutdown Bypass RCS High Pressure	2 ^(b) ,3 ^(b) 4 ^(b) ,5 ^(b)	E	SR 3.3.1.1 SR 3.3.1.4 SR 3.3.1.5	≤ 1720 psig

(a) When not in shutdown bypass operation.

(b) During shutdown bypass operation with any CRD trip breaker in the closed position and the CRD System capable of rod withdrawal.

(c) With any CRD trip breaker in the closed position and the CRD System capable of rod withdrawal.

(d) With any CRD trip breaker in the closed position, the CRD system capable of rod withdrawal, and not in shutdown bypass operation.

3.3 INSTRUMENTATION

3.3.2 Reactor Protection System (RPS) Manual Reactor Trip

LCO 3.3.2 The RPS Manual Reactor Trip Function shall be OPERABLE.

APPLICABILITY: MODES 1 and 2,
 MODES 3, 4, and 5 with any control rod drive (CRD) trip breaker in the
 closed position and the CRD System capable of rod withdrawal.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. Manual Reactor Trip Function inoperable.	A.1 Restore Function to OPERABLE status.	1 hour
B. Required Action and associated Completion Time not met in MODE 1, 2, or 3.	B.1 Be in MODE 3.	6 hours
	<u>AND</u> B.2 Open all CRD trip breakers.	6 hours
C. Required Action and associated Completion Time not met in MODE 4 or 5.	C.1 Open all CRD trip breakers.	6 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.3.2.1 Perform CHANNEL FUNCTIONAL TEST.	Once prior to each reactor startup if not performed within the previous 7 days

3.3 INSTRUMENTATION

3.3.3 Reactor Protection System (RPS) - Reactor Trip Module (RTM)

LCO 3.3.3 Four RTMs shall be OPERABLE.

APPLICABILITY: MODES 1 and 2,
MODES 3, 4, and 5 with any control rod drive (CRD) trip breaker in the closed position and the CRD System capable of rod withdrawal.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One RTM inoperable.	A.1.1 Open the associated CRD trip breaker.	1 hour
	<u>OR</u>	
	A.1.2 Remove power from the associated CRD trip breaker.	1 hour
	<u>AND</u>	
	A.2 Physically remove the inoperable RTM.	1 hour
B. Two or more RTMs inoperable in MODE 1, 2, or 3.	B.1 Be in MODE 3.	6 hours
	<u>AND</u>	
	B.2.1 Open all CRD trip breakers.	6 hours
	<u>OR</u>	
Required Action and associated Completion Time not met in MODE 1, 2, or 3.	B.2.2 Remove power from all CRD trip breakers.	6 hours

CONDITION	REQUIRED ACTION	COMPLETION TIME
C. Two or more RTMs inoperable in MODE 4 or 5. <u>OR</u> Required Action and associated Completion Time not met in MODE 4 or 5.	C.1 Open all CRD trip breakers.	6 hours
	<u>OR</u> C.2 Remove power from all CRD trip breakers.	6 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.3.3.1 Perform CHANNEL FUNCTIONAL TEST.	92 days

3.3 INSTRUMENTATION

3.3.4 Control Rod Drive (CRD) Trip Devices

LCO 3.3.4 The following CRD trip devices shall be OPERABLE:

- a. Two AC CRD trip breakers;
- b. Two DC CRD trip breaker pairs; and
- c. Eight electronic trip assembly (ETA) relays.

APPLICABILITY: MODES 1 and 2,
MODES 3, 4, and 5 with any CRD trip breaker in the closed position and
the CRD System capable of rod withdrawal.

ACTIONS

-----NOTE-----
Separate Condition entry is allowed for each CRD trip device.

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more CRD trip breaker(s) or breaker pair undervoltage or shunt trip Functions inoperable.	A.1 Open the CRD trip breaker.	48 hours
	<u>OR</u> A.2 Remove power from the CRD trip breaker.	48 hours
B. One or more CRD trip breaker(s) or breaker pair inoperable for reasons other than those in Condition A.	B.1 Open the CRD trip breaker.	1 hour
	<u>OR</u> B.2 Remove power from the CRD trip breaker.	1 hour

CONDITION	REQUIRED ACTION	COMPLETION TIME
C. One or more required ETA relays inoperable.	C.1 Transfer affected CONTROL ROD group to power supply with OPERABLE or open ETA relays.	1 hour
	<u>OR</u>	
	C.2 Transfer affected CONTROL ROD group to a DC hold power supply.	1 hour
	<u>OR</u>	
	C.3 Place the SCRs associated with the inoperable ETA relay in trip.	1 hour
	<u>OR</u>	
	C.4 Open corresponding AC CRD trip breaker.	1 hour
D. Required Action and associated Completion Time not met in MODE 1, 2, or 3.	D.1 Be in MODE 3.	6 hours
	<u>AND</u>	
	D.2.1 Open all CRD trip breakers.	6 hours
	<u>OR</u>	
	D.2.2 Remove power from all CRD trip breakers.	6 hours
E. Required Action and associated Completion Time not met in MODE 4 or 5.	E.1 Open all CRD trip breakers.	6 hours
	<u>OR</u>	
	E.2 Remove power from all CRD trip breakers.	6 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.3.4.1	Perform CHANNEL FUNCTIONAL TEST.	92 days

3.3 INSTRUMENTATION

3.3.5 Engineered Safeguards Actuation System (ESAS) Instrumentation

LCO 3.3.5 Three ESAS analog instrument channels for each Parameter in Table 3.3.5-1 shall be OPERABLE.

APPLICABILITY: According to Table 3.3.5-1.

ACTIONS

-----NOTE-----
Separate Condition entry is allowed for each Parameter.

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more Parameters with one analog instrument channel inoperable.	A.1 Place analog instrument channel in trip.	1 hour
B. One or more Parameters with more than one analog instrument channel inoperable. <u>OR</u> Required Action and associated Completion Time not met.	B.1 Be in MODE 3.	6 hours
	<u>AND</u>	
	B.2 -----NOTE----- Only required for RCS Pressure - Low setpoint.	
	Reduce RCS pressure < 1750 psig.	36 hours
	<u>AND</u>	
	B.3 -----NOTE----- Only required for Reactor Building Pressure High setpoint and High High setpoint.	
	Be in MODE 5.	36 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.3.5.1	Perform CHANNEL CHECK.	12 hours
SR 3.3.5.2	Perform CHANNEL FUNCTIONAL TEST.	31 days
SR 3.3.5.3	Perform CHANNEL CALIBRATION.	18 months

Table 3.3.5-1
Engineered Safeguards Actuation System Instrumentation

PARAMETER	APPLICABLE MODES OR OTHER SPECIFIED CONDITIONS	ALLOWABLE VALUE
1. Reactor Coolant System Pressure - Low Setpoint	≥ 1750 psig	≥ 1585 psig
2. Reactor Building (RB) Pressure - High Setpoint	1,2,3,4	≤ 18.7 psia
3. RB Pressure - High High Setpoint	1,2,3,4	≤ 44.7 psia

3.3 INSTRUMENTATION

3.3.6 Engineered Safeguards Actuation System (ESAS) Manual Initiation

LCO 3.3.6 Two manual initiation channels of each one of the ESAS Functions below shall be OPERABLE:

- a. High Pressure Injection (channels 1 and 2);
- b. Low Pressure Injection (channels 3 and 4);
- c. Reactor Building (RB) Cooling (channels 5 and 6);
- d. RB Spray (channels 7 and 8); and
- e. Spray Additive (channels 9 and 10).

APPLICABILITY: MODES 1 and 2,
MODES 3 and 4 when associated engineered safeguards equipment is required to be OPERABLE.

ACTIONS

-----NOTE-----
Separate Condition entry is allowed for each Function.

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more ESAS Functions with one channel inoperable.	A.1 Restore channel to OPERABLE status.	72 hours
B. Required Action and associated Completion Time not met.	B.1 Be in MODE 3.	6 hours
	<u>AND</u> B.2 Be in MODE 5.	36 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.3.6.1	Perform CHANNEL FUNCTIONAL TEST.	18 months

3.3 INSTRUMENTATION

3.3.7 Engineered Safeguards Actuation System (ESAS) Actuation Logic

LCO 3.3.7 The ESAS digital actuation logic channels shall be OPERABLE.

APPLICABILITY: MODES 1 and 2,
 MODES 3 and 4 when associated engineered safeguards equipment is
 required to be OPERABLE.

ACTIONS

-----NOTE-----
Separate Condition entry is allowed for each digital actuation logic channel.

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more digital actuation logic channels inoperable.	A.1 Place associated component(s) in engineered safeguards configuration.	1 hour
	<u>OR</u> A.2 Declare the associated component(s) inoperable.	1 hour

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.3.7.1 Perform digital actuation logic CHANNEL FUNCTIONAL TEST.	31 days

3.3 INSTRUMENTATION

3.3.8 Diesel Generator (DG) Loss of Power Start (LOPS)

LCO 3.3.8 Two loss of voltage Function relays and two degraded voltage Function relays DG LOPS instrumentation per DG shall be OPERABLE.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTIONS

-----NOTE-----
Separate Condition entry is allowed for each Function.

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more Functions with one or more relays for one or more DGs inoperable.	A.1 Restore relay(s) to OPERABLE status.	1 hour
B. Required Action and associated Completion Time not met.	B.1 Declare affected DG(s) inoperable.	Immediately

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.3.8.1 Perform CHANNEL CHECK.	7 days

SURVEILLANCE	FREQUENCY
<p>SR 3.3.8.2</p> <p>-----NOTE-----</p> <p>When DG LOPS instrumentation is placed in an inoperable status solely for performance of this Surveillance, entry into associated Conditions and Required Actions may be delayed up to 4 hours for the loss of voltage Function, provided the one remaining relay monitoring the Function for the bus is OPERABLE.</p> <hr/> <p>Perform CHANNEL CALIBRATION with setpoint Allowable Value as follows:</p> <ul style="list-style-type: none"> a. Degraded voltage ≥ 423.2 V and ≤ 436.0 V with a time delay of 8 seconds ± 1 second; and b. Loss of voltage ≥ 1600 V and ≤ 3000 V with a time delay of ≥ 0.30 seconds and ≤ 0.98 seconds. 	<p>18 months</p>

3.3 INSTRUMENTATION

3.3.9 Source Range Neutron Flux

LCO 3.3.9 One source range neutron flux channel shall be OPERABLE.

APPLICABILITY: MODES 2, 3, 4, and 5.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. Required source range neutron flux channel inoperable with $\leq 1E-10$ amp on the intermediate range neutron flux channel.	<p>-----NOTE----- Plant temperature changes are allowed provided the temperature change is accounted for in the SDM calculations.</p>	
	A.1 Suspend operations involving positive reactivity changes.	Immediately
	<u>AND</u>	
	A.2 Initiate action to insert all CONTROL RODS.	Immediately
	<u>AND</u>	
	A.3 Open control rod drive trip breakers.	1 hour
	<u>AND</u>	
	A.4 Verify SDM to be within the limit provided in the COLR.	1 hour
		<u>AND</u> Once per 12 hours thereafter
B. Required source range neutron flux channel inoperable with $> 1E-10$ amp on the intermediate range neutron flux channel.	B.1 Initiate action to restore required channel to OPERABLE status.	1 hour

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.3.9.1	Perform CHANNEL CHECK.	12 hours
SR 3.3.9.2	<p>-----NOTE----- Neutron detectors are excluded from CHANNEL CALIBRATION. -----</p> <p>Perform CHANNEL CALIBRATION.</p>	18 months

3.3 INSTRUMENTATION

3.3.10 Intermediate Range Neutron Flux

LCO 3.3.10 One intermediate range neutron flux channel shall be OPERABLE.

APPLICABILITY: MODE 2,
MODES 3, 4, and 5 with any control rod drive (CRD) trip breaker in the
closed position and the CRD System capable of rod withdrawal.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. Required channel inoperable.	<p>-----NOTE----- Plant temperature changes are allowed provided the temperature change is accounted for in the SDM calculations.</p>	Immediately
	A.1 Suspend operations involving positive reactivity changes.	
	<p><u>AND</u></p> <p>A.2 Open CRD trip breakers.</p>	
		1 hour

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.3.10.1 Perform CHANNEL CHECK.	12 hours
SR 3.3.10.2 Perform CHANNEL FUNCTIONAL TEST.	31 days

SURVEILLANCE		FREQUENCY
SR 3.3.10.3	-----NOTE----- Neutron detectors are excluded from CHANNEL CALIBRATION. -----	18 months
	Perform CHANNEL CALIBRATION.	

3.3 INSTRUMENTATION

3.3.11 Emergency Feedwater Initiation and Control (EFIC) System Instrumentation

LCO 3.3.11 The EFIC System instrumentation channels for each Function in Table 3.3.11-1 shall be OPERABLE.

APPLICABILITY: According to Table 3.3.11-1.

ACTIONS

-----NOTE-----
Separate Condition entry is allowed for each Function.

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more Emergency Feedwater (EFW) Initiation or Main Steam Line Isolation Functions listed in Table 3.3.11-1 with one channel inoperable.	A.1 Place channel(s) in bypass or trip.	1 hour
B. One or more EFW Initiation or Main Steam Line Isolation Functions listed in Table 3.3.11-1 with two channels inoperable.	B.1 Place one channel in bypass.	1 hour
	<u>AND</u> B.2 Place second channel in trip.	1 hour
C. One EFW Vector Valve Control channel inoperable.	C.1 Restore channel to OPERABLE status.	72 hours
D. Required Action and associated Completion Time not met for Function 1.b.	D.1 Be in MODE 3.	6 hours
	<u>AND</u> D.2 Be in MODE 4.	12 hours

CONDITION	REQUIRED ACTION	COMPLETION TIME
E. Required Action and associated Completion Time not met for Functions 1.a or 1.d.	E.1 Reduce THERMAL POWER to \leq 10% RTP.	6 hours
F. Required Action and associated Completion Time not met for Functions 1.c, 2, or 3.	F.1 Be in MODE 3.	6 hours
	<u>AND</u> F.2 Reduce steam generator pressure to < 750 psig.	12 hours

SURVEILLANCE REQUIREMENTS

-----NOTE-----

Refer to Table 3.3.11-1 to determine which SRs shall be performed for each EFIC Function.

SURVEILLANCE	FREQUENCY
SR 3.3.11.1 Perform CHANNEL CHECK.	12 hours
SR 3.3.11.2 Perform CHANNEL FUNCTIONAL TEST.	31 days
SR 3.3.11.3 Perform CHANNEL CALIBRATION.	18 months

Table 3.3.11-1
Emergency Feedwater Initiation and Control System Instrumentation

FUNCTION	APPLICABLE MODES OR OTHER SPECIFIED CONDITIONS	REQUIRED CHANNELS	SURVEILLANCE REQUIREMENTS	ALLOWABLE VALUES
1. EFW Initiation				
a. Loss of MFW Pumps (Control Oil Pressure)	$\geq 10\%$ RTP	4	SR 3.3.11.1 SR 3.3.11.2 SR 3.3.11.3	≥ 55.5 psig
b. SG Level - Low	1,2,3	4 per SG	SR 3.3.11.1 SR 3.3.11.2 SR 3.3.11.3	≥ 11.1 inches
c. SG Pressure - Low	1,2,3 ^(a)	4 per SG	SR 3.3.11.1 SR 3.3.11.2 SR 3.3.11.3	≥ 584.2 psig
d. RCP Status	$\geq 10\%$ RTP	4	SR 3.3.11.1 SR 3.3.11.2	NA
2. EFW Vector Valve Control				
a. SG Pressure - Low	1,2,3 ^(a)	4 per SG	SR 3.3.11.1 SR 3.3.11.2 SR 3.3.11.3	≥ 584.2 psig
b. SG Differential Pressure - High	1,2,3 ^(a)	4	SR 3.3.11.1 SR 3.3.11.2 SR 3.3.11.3	≤ 150 psid
3. Main Steam Line Isolation				
a. SG Pressure - Low	1,2,3 ^{(a)(b)}	4 per SG	SR 3.3.11.1 SR 3.3.11.2 SR 3.3.11.3	≥ 584.2 psig

(a) When SG pressure ≥ 750 psig.

(b) Except when all associated valves are closed and deactivated.

3.3 INSTRUMENTATION

3.3.12 Emergency Feedwater Initiation and Control (EFIC) Manual Initiation

LCO 3.3.12 Two manual initiation switches per actuation train for each of the following EFIC Functions shall be OPERABLE:

- a. Steam generator (SG) A Main Steam Line Isolation;
- b. SG B Main Steam Line Isolation; and
- c. Emergency Feedwater (EFW) Initiation.

APPLICABILITY: When associated EFIC Function is required to be OPERABLE.

ACTIONS

-----NOTE-----
Separate Condition entry is allowed for each Function.

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more EFIC Function(s) with one required manual initiation switch inoperable in one actuation train.	A.1 Place affected trip bus in the affected train for the associated EFIC Function(s) in trip.	72 hours
B. One or more EFIC Function(s) with both required manual initiation switches inoperable in a single actuation train.	B.1 Restore one manual initiation switch for each of the affected EFIC Function(s) to OPERABLE status.	72 hours
C. One or more EFIC Function(s) with one or both required manual initiation switches inoperable in both actuation trains.	C.1 Restore one actuation train for the associated EFIC Function(s) to OPERABLE status.	1 hour

CONDITION	REQUIRED ACTION	COMPLETION TIME
D. Required Action and associated Completion Time not met for EFW Initiation Function.	D.1 Be in MODE 3.	6 hours
	<u>AND</u> D.2 Be in MODE 4.	12 hours
E. Required Action and associated Completion Time not met for Main Steam Line Isolation Function.	E.1 Be in MODE 3.	6 hours
	<u>AND</u> E.2.1 Reduce steam generator pressure to < 750 psig.	12 hours
	<u>OR</u> E.2.2 Close and deactivate all associated valves.	12 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.3.12.1 Perform CHANNEL FUNCTIONAL TEST.	31 days

3.3 INSTRUMENTATION

3.3.13 Emergency Feedwater Initiation and Control (EFIC) Logic

LCO 3.3.13 Trains A and B of each Logic Function shown below shall be OPERABLE:

- a. Main Steam Line Isolation; and
- b. Emergency Feedwater (EFW) Initiation.

APPLICABILITY: When associated EFIC Function is required to be OPERABLE.

ACTIONS

-----NOTE-----
Separate Condition entry is allowed for each Function.

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more train A Functions inoperable with all train B Functions OPERABLE; or one or more train B Functions inoperable with all train A Functions OPERABLE.	A.1 Restore affected train to OPERABLE status.	72 hours
B. Required Action and associated Completion Time not met for EFW Initiation Function.	B.1 Be in MODE 3.	6 hours
	<u>AND</u> B.2 Be in MODE 4.	12 hours
C. Required Action and associated Completion Time not met for Main Steam Line Isolation Function.	C.1 Be in MODE 3.	6 hours
	<u>AND</u> C.2.1 Reduce steam generator pressure to < 750 psig.	12 hours
	<u>OR</u> C.2.2 Close and deactivate all associated valves.	12 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.3.13.1	Perform CHANNEL FUNCTIONAL TEST.	31 days

3.3 INSTRUMENTATION

3.3.14 Emergency Feedwater Initiation and Control (EFIC) Vector Logic

LCO 3.3.14 Four channels of the EFIC vector logic shall be OPERABLE.

APPLICABILITY: MODES 1 and 2,
MODE 3 when steam generator pressure is ≥ 750 psig.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One vector logic channel inoperable.	A.1 Restore channel to OPERABLE status.	72 hours
B. Required Action and associated Completion Time not met.	B.1 Be in MODE 3. <u>AND</u>	6 hours
	B.2 Reduce steam generator pressure to < 750 psig.	12 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.3.14.1 Perform a CHANNEL FUNCTIONAL TEST.	31 days

3.3 INSTRUMENTATION

3.3.15 Post Accident Monitoring (PAM) Instrumentation

LCO 3.3.15 The PAM instrumentation for each Function in Table 3.3.15-1 shall be OPERABLE.

APPLICABILITY: MODES 1, 2, and 3.

ACTIONS

NOTES

1. LCO 3.0.4 is not applicable.
2. Separate Condition entry is allowed for each Function.

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more Functions with one required channel inoperable.	A.1 Restore required channel to OPERABLE status.	30 days
B. Required Action and associated Completion Time of Condition A not met.	B.1 Initiate action to prepare and submit a Special Report.	Immediately
C. -----NOTE----- Not applicable to hydrogen monitor channels. ----- One or more Functions with two required channels inoperable.	C.1 Restore one channel to OPERABLE status.	7 days
D. Two required hydrogen monitor channels inoperable.	D.1 Restore one required hydrogen monitor channel to OPERABLE status.	72 hours

CONDITION	REQUIRED ACTION	COMPLETION TIME
E. Required Action and associated Completion Time of Condition C or D not met.	E.1 Enter the Condition referenced in Table 3.3.15-1 for the channel.	Immediately
F. As required by Required Action E.1 and referenced in Table 3.3.15-1.	F.1 Be in MODE 3. <u>AND</u>	6 hours
	F.2 Be in MODE 4.	12 hours
G. As required by Required Action E.1 and referenced in Table 3.3.15-1.	G.1 Initiate action to prepare and submit a Special Report.	Immediately

SURVEILLANCE REQUIREMENTS

-----NOTE-----
These SRs apply to each PAM instrumentation Function in Table 3.3.15-1.

SURVEILLANCE		FREQUENCY
SR 3.3.15.1	Perform CHANNEL CHECK for each required instrumentation channel that is normally energized.	31 days
SR 3.3.15.2	-----NOTE----- Neutron detectors are excluded from CHANNEL CALIBRATION. ----- Perform CHANNEL CALIBRATION.	18 months

Table 3.3.15-1
Post Accident Monitoring Instrumentation

FUNCTION	REQUIRED CHANNELS	CONDITIONS REFERENCED FROM REQUIRED ACTION E.1
1. Wide Range Neutron Flux	2	F
2. RCS Hot Leg Temperature	2	F
3. RCS Hot Leg Level	2	G
4. RCS Pressure (Wide Range)	2	F
5. Reactor Vessel Water Level	2	G
6. Reactor Building Water Level (Wide Range)	2	F
7. Reactor Building Pressure (Wide Range)	2	F
8. Penetration Flow Path Automatic Reactor Building Isolation Valve Position	2 per penetration flow path ^{(a)(b)}	F
9. Reactor Building Area Radiation (High Range)	2	G
10. Reactor Building Hydrogen Concentration	2	F
11. Pressurizer Level	2	F
12. a. SG "A" Water Level - Low Range	2	F
b. SG "B" Water Level - Low Range	2	F
c. SG "A" Water Level - High Range	2	F
d. SG "B" Water Level - High Range	2	F
13. a. SG "A" Pressure	2	F
b. SG "B" Pressure	2	F
14. Condensate Storage Tank Level	2	F
15. Borated Water Storage Tank Level	2	F
16. Core Exit Temperature (CETs per quadrant)	2	F
17. a. Emergency Feedwater Flow to SG "A"	2	F
b. Emergency Feedwater Flow to SG "B"	2	F
18. High Pressure Injection Flow	2	F
19. Low Pressure Injection Flow	2	F
20. Reactor Building Spray Flow	2	F

(a) Not required for isolation valves whose associated penetration is isolated by at least one closed and deactivated automatic valve, closed manual valve, blind flange, or check valve with flow through the valve secured.

(b) Only one position indication channel is required for penetration flow paths with only one installed control room indication channel.

3.3 INSTRUMENTATION

3.3.16 Control Room Isolation - High Radiation

LCO 3.3.16 Two channels of Control Room Isolation - High Radiation shall be OPERABLE.

APPLICABILITY: MODES 1, 2, 3, and 4,
During movement of irradiated fuel assemblies.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One channel inoperable in MODE 1, 2, 3, or 4.	A.1 Place one OPERABLE Control Room Emergency Ventilation System (CREVS) train in the emergency recirculation mode.	7 days
B. Two channels inoperable in MODE 1, 2, 3, or 4.	B.1 Place one OPERABLE CREVS train in the emergency recirculation mode.	1 hour
C. Required Action and associated Completion Time of Condition A or B not met.	C.1 Be in MODE 3.	6 hours
	<u>AND</u> C.2 Be in MODE 5.	36 hours
D. One or two channels inoperable during movement of irradiated fuel.	D.1 Place one OPERABLE CREVS train in emergency recirculation mode.	Immediately
	<u>OR</u> D.2 Suspend movement of irradiated fuel assemblies.	Immediately

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.3.16.1	Perform CHANNEL CHECK.	12 hours
SR 3.3.16.2	<p>-----NOTE----- When the Control Room Isolation - High Radiation instrumentation is placed in an inoperable status solely for performance of this Surveillance, entry into associated Conditions and Required Actions may be delayed for up to 3 hours. -----</p> <p>Perform CHANNEL FUNCTIONAL TEST.</p>	31 days
SR 3.3.16.3	Perform CHANNEL CALIBRATION.	18 months

3.4 REACTOR COOLANT SYSTEM (RCS)

3.4.1 RCS Pressure, Temperature, and Flow Departure from Nucleate Boiling (DNB) Limits

LCO 3.4.1 RCS DNB parameters (loop pressure, hot leg temperature, and RCS total flow rate) shall be within the limits specified in the COLR.

APPLICABILITY: MODE 1.

-----NOTE-----
RCS loop pressure limit does not apply during pressure transients due to a THERMAL POWER change > 5% RTP per minute.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more RCS DNB parameters not within limits.	A.1 Restore RCS DNB parameter(s) to within limit.	2 hours
B. Required Action and associated Completion Time not met.	B.1 Be in MODE 2.	6 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.4.1.1 -----NOTE----- With three RCPs operating, the limits are applied to the loop with two RCPs in operation. ----- Verify RCS loop pressure is within the limit specified in the COLR.	12 hours

SURVEILLANCE		FREQUENCY
SR 3.4.1.2	-----NOTE----- With three RCPs operating, the limits are applied to the loop with two RCPs in operation.	12 hours
	Verify RCS hot leg temperature is within the limit specified in the COLR.	
SR 3.4.1.3	Verify RCS total flow is within the limit specified in the COLR.	12 hours
SR 3.4.1.4	-----NOTE----- Only required to be performed when stable thermal conditions are established at $\geq 90\%$ RTP.	18 months
	Verify RCS total flow rate is within the limit specified in the COLR by measurement.	

3.4 REACTOR COOLANT SYSTEM (RCS)

3.4.2 RCS Minimum Temperature for Criticality

LCO 3.4.2 The RCS average temperature (T_{avg}) shall be $\geq 525^{\circ}\text{F}$.

APPLICABILITY: MODE 1 and 2.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. T_{avg} not within limit.	A.1 Be in MODE 3.	30 minutes

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.4.2.1 Verify RCS $T_{avg} \geq 525^{\circ}\text{F}$.	12 hours

3.4 REACTOR COOLANT SYSTEM (RCS)

3.4.3 RCS Pressure and Temperature (P/T) Limits

LCO 3.4.3 RCS pressure, RCS temperature, and RCS heatup and cooldown rates shall be maintained within limits specified in Figures 3.4.3-1, 3.4.3-2, and 3.4.3-3.

-----NOTE-----
Not applicable to the pressurizer.

APPLICABILITY: At all times.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. RCS Pressure and Temperature not within criticality limit of Figure 3.4.3-1 during PHYSICS TESTS with RCS temperature $\leq 525^{\circ}\text{F}$.	A.1 Be in MODE 3.	30 minutes
B. -----NOTE----- Required Action B.2 shall be completed whenever this Condition is entered. ----- Requirements of LCO not met in MODE 1, 2, 3, or 4.	B.1 Restore parameter(s) to within limits. <u>AND</u> B.2 Determine RCS is acceptable for continued operation.	30 minutes 72 hours
C. Required Action and associated Completion Time of Condition B not met.	C.1 Be in MODE 3. <u>AND</u> C.2 Be in MODE 5.	6 hours 36 hours


CONDITION	REQUIRED ACTION	COMPLETION TIME
D. -----NOTE----- Required Action D.2 shall be completed whenever this Condition is entered. Requirements of LCO not met in other than MODE 1, 2, 3, or 4.	D.1 Initiate action to restore parameter(s) to within limit. <u>AND</u> D.2 Determine RCS is acceptable for continued operation.	Immediately Prior to entering MODE 4

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.4.3.1	-----NOTE----- Only required to be performed during RCS heatup operations with fuel in the reactor vessel. Verify RCS pressure, RCS temperature, and RCS heatup rates are within the limits specified in Figure 3.4.3-1.	30 minutes
SR 3.4.3.2	-----NOTE----- Only required to be performed during RCS cooldown operations with fuel in the reactor vessel. Verify RCS pressure, RCS temperature, and RCS cooldown rates are within the limits specified in Figure 3.4.3-2.	30 minutes
SR 3.4.3.3	-----NOTE----- Only required to be performed during RCS heatup and cooldown operations with no fuel in the reactor vessel. Verify RCS pressure, RCS temperature, and RCS cooldown rates are within the limits specified in Figure 3.4.3-3.	30 minutes

SURVEILLANCE	FREQUENCY
<p>SR 3.4.3.4</p> <p>-----NOTE----- Only required to be performed during PHYSICS TESTS with RCS temperature $\leq 525^{\circ}\text{F}$.</p> <p>Verify RCS pressure and RCS temperature are within the criticality limits specified in Figure 3.4.3-1.</p>	<p>30 minutes</p>

FIGURE 3.4.3-1
RCS Heatup Limitations to 31 EFPY

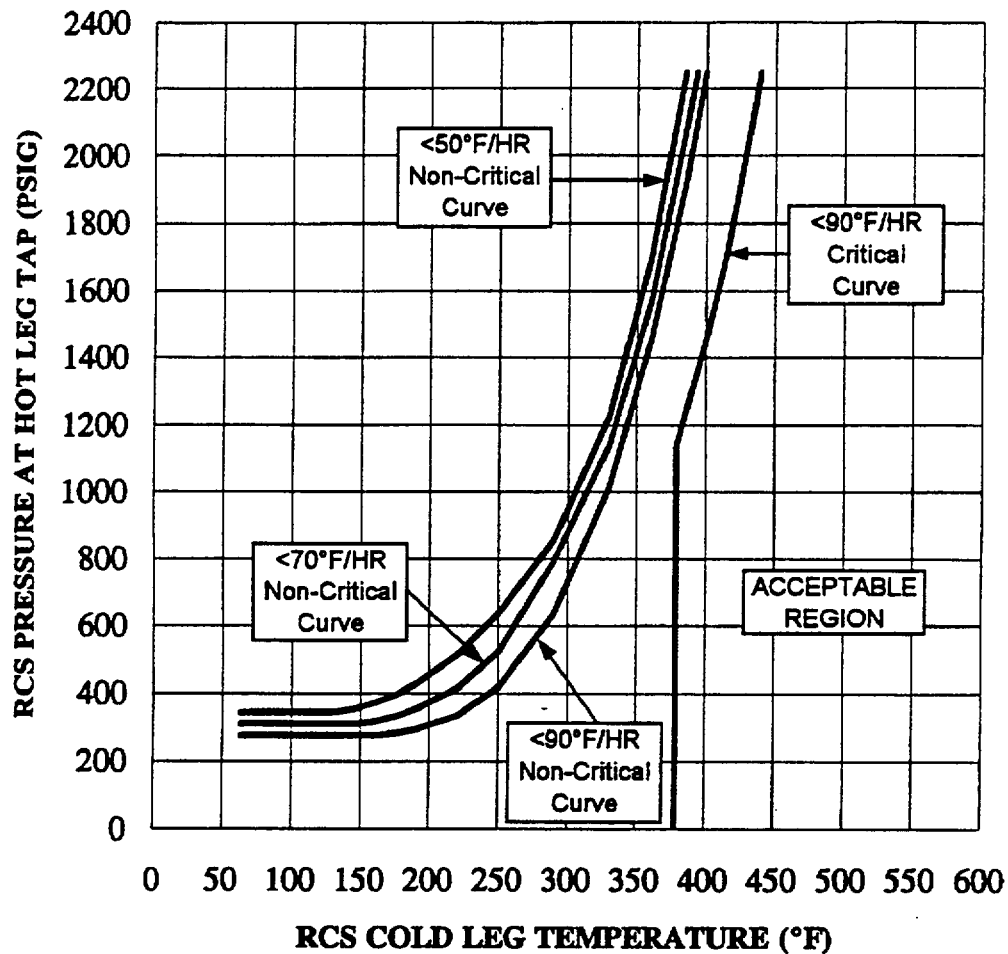

Notes:


1. These curves are not adjusted for instrument error and shall not be used for operation.
2. When DHR is in operation with no RCPs operating, the DHR system return temperature shall be used.
3. RCP Operating Restrictions:

<u>RCS TEMP</u>	<u>RCP RESTRICTIONS</u>
$T > 300^{\circ}\text{F}$	None
$300^{\circ}\text{F} \geq T \geq 225^{\circ}\text{F}$	≤ 3
$225^{\circ}\text{F} > T \geq 84^{\circ}\text{F}$	≤ 2
$T < 84^{\circ}\text{F}$	No RCPs operating

4. Allowable Heatup Rates:

<u>RCS TEMP</u>	<u>H/U RATE</u>
$60^{\circ}\text{F} < T \leq 84^{\circ}\text{F}$	$\leq 15^{\circ}\text{F/HR}$
$T > 84^{\circ}\text{F}$	As allowed by applicable curve

FIGURE 3.4.3-2
RCS Cooldown Limits to 31 EFPY

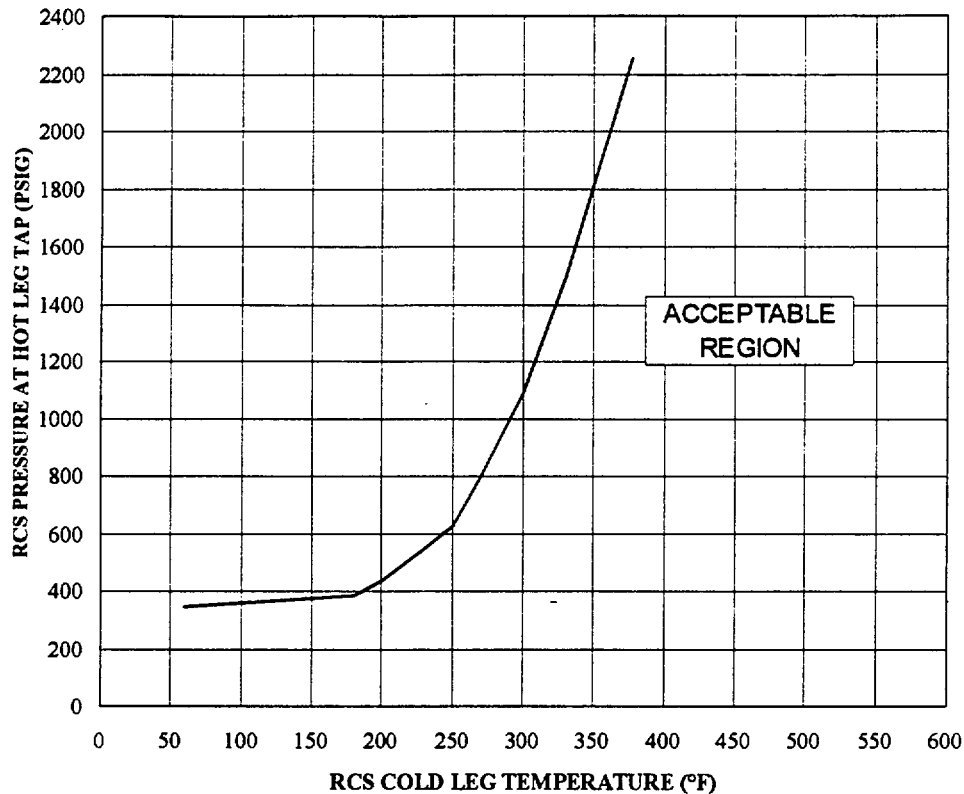

Notes:

1. This curve is not adjusted for instrument error and shall not be used for operation.
2. A maximum step temperature change of 25°F is allowable when securing all RCPs with the DHR system in operation. This change is defined as the RCS temperature prior to securing all the RCPs minus the DHR return temperature after the RCPs are secured. When DHR is in operation with no RCPs operating, the DHR system return temperature shall be used.

3. RCP Operating Restrictions:

RCS TEMP

$T > 255^{\circ}\text{F}$
 $150^{\circ}\text{F} \leq T \leq 255^{\circ}\text{F}$
 $T < 150^{\circ}\text{F}$

RCP RESTRICTIONS

None
 ≤ 2 (See Note 5)
 No RCPs operating

4. Allowable Cooldown Rates:

RCS TEMP

$T \geq 280^{\circ}\text{F}$
 $280^{\circ}\text{F} > T \geq 150^{\circ}\text{F}$
 $T < 150^{\circ}\text{F}$

C/D RATE


100°F/HR
 50°F/HR (Note 5)
 25°F/HR

STEP CHANGE

$\leq 50^{\circ}\text{F}$ in any 1/2 HR
 $\leq 25^{\circ}\text{F}$ in any 1/2 HR
 $\leq 25^{\circ}\text{F}$ in any 1 HR

5. If RCPs are operated $< 200^{\circ}\text{F}$, then the RCS cooldown rate from $150^{\circ}\text{F} \leq T \leq 180^{\circ}\text{F}$ is reduced to 30°F in 15 hours.

FIGURE 3.4.3-3
RCS Inservice Hydrostatic Test H/U & C/D Limits to 31 EFPY

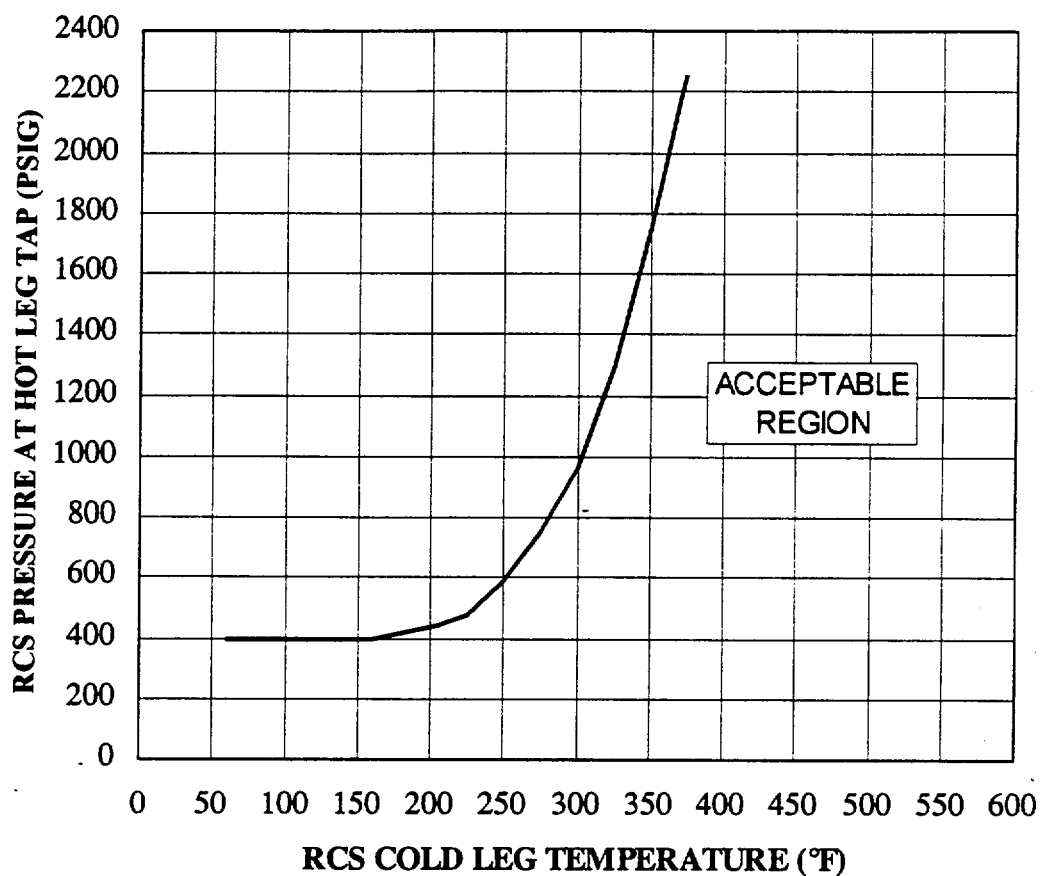

Notes:

1. This curve is not adjusted for instrument error and shall not be used for operation.
2. All Notes on Figure 3.4.3-1 are applicable for heatups. This curve is based on a heatup rate of $< 90^{\circ}\text{F}/\text{HR}$.
3. All Notes on Figure 3.4.3-2 are applicable for cooldowns.

3.4 REACTOR COOLANT SYSTEM (RCS)

3.4.4 RCS Loops - MODES 1 and 2

LCO 3.4.4 Two RCS Loops shall be in operation, with:

- a. Four reactor coolant pumps (RCPs) operating; or
- b. Three RCPs operating and THERMAL POWER restricted as specified in the COLR.

APPLICABILITY: MODES 1 and 2.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One RCP not in operation in each loop.	A.1 Restore one non-operating RCP to operation.	18 hours
B. Required Action and associated Completion Time of Condition A not met. <u>OR</u> LCO not met for reasons other than Condition A.	B.1 Be in MODE 3.	6 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.4.4.1 Verify required RCS loops are in operation.	12 hours

3.4 REACTOR COOLANT SYSTEM (RCS)

3.4.5 RCS Loops - MODE 3

LCO 3.4.5 Two RCS loops shall be OPERABLE and one OPERABLE RCS loop shall be in operation.

NOTES

All reactor coolant pumps (RCPs) may be removed from operation for ≤ 8 hours per 24 hour period for the transition to or from the Decay Heat Removal System, and all RCPs may be removed from operation for ≤ 1 hour per 8 hour period for any other reason, provided:

- a. No operations are permitted that would cause introduction into the RCS, coolant with boron concentration less than required to meet the SDM of LCO 3.1.1; and
- b. Core outlet temperature is maintained at least 10°F below saturation temperature.

APPLICABILITY: MODE 3.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One RCS loop inoperable.	A.1 Restore RCS loop to OPERABLE status.	72 hours
B. Required Action and associated Completion Time of Condition A not met.	B.1 Be in MODE 4.	12 hours

CONDITION	REQUIRED ACTION	COMPLETION TIME
C. Two RCS loops inoperable. <u>OR</u> Required RCS loop not in operation.	C.1 Suspend operations that would cause introduction into the RCS, coolant with boron concentration less than required to meet SDM of LCO 3.1.1.	Immediately
	<u>AND</u> C.2 Initiate action to restore one RCS loop to OPERABLE status and operation.	Immediately

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.4.5.1	Verify required RCS loop is in operation.	12 hours
SR 3.4.5.2	<p style="text-align: center;"><u>NOTE</u></p> <p>Not required to be performed until 24 hours after a required pump is not in operation.</p> <hr/> <p>Verify correct breaker alignment and indicated power available to each required pump.</p>	7 days

3.4 REACTOR COOLANT SYSTEM (RCS)

3.4.6 RCS Loops - MODE 4

LCO 3.4.6 Two loops consisting of any combination of RCS loops and decay heat removal (DHR) loops shall be OPERABLE and one OPERABLE loop shall be in operation.

-----NOTE-----
All reactor coolant pumps (RCPs) and DHR pumps may be removed from operation for ≤ 1 hour provided:

- a. No operations are permitted that would cause introduction into the RCS, coolant with boron concentration less than required to meet the SDM of LCO 3.1.1; and
 - b. Core outlet temperature is maintained at less than or equal to a temperature which is 10°F below saturation temperature.
-

APPLICABILITY: MODE 4.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One required loop inoperable.	A.1 Initiate action to restore a second loop to OPERABLE status.	Immediately
	<p><u>AND</u></p> <p>A.2 -----NOTE----- Only required if DHR loop is OPERABLE.</p> <p>-----</p> <p>Be in MODE 5.</p>	24 hours

CONDITION	REQUIRED ACTION	COMPLETION TIME
B. Two required loops inoperable. <u>OR</u> Required loop not in operation.	B.1 Suspend operations that would cause introduction into the RCS, coolant with boron concentration less than required to meet SDM of LCO 3.1.1.	Immediately
	<u>AND</u> B.2 Initiate action to restore one loop to OPERABLE status and operation.	Immediately

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.4.6.1	Verify required DHR or RCS loop is in operation.	12 hours
SR 3.4.6.2	<p>-----NOTE----- Not required to be performed until 24 hours after a required pump is not in operation. -----</p> <p>Verify correct breaker alignment and indicated power available to each required pump.</p>	7 days

3.4 REACTOR COOLANT SYSTEM (RCS)

3.4.7 RCS Loops - MODE 5, Loops Filled

LCO 3.4.7 One decay heat removal (DHR) loop shall be OPERABLE and in operation, and either:

- a. One additional DHR loop shall be OPERABLE; or
- b. The secondary side of each steam generator (SG) shall be ≥ 20 inches.

NOTES

1. The DHR pump of the loop in operation may be removed from operation for ≤ 1 hour provided:
 - a. No operations are permitted that would cause introduction into the RCS, coolant with boron concentration less than required to meet the SDM of LCO 3.1.1; and
 - b. Core outlet temperature is maintained at less than or equal to a temperature which is 10°F below saturation temperature.
 2. One required DHR loop may be inoperable for ≤ 2 hours for surveillance testing provided that the other DHR loop is OPERABLE and in operation.
 3. All DHR loops may be removed from operation during planned heatup to MODE 4 when at least one RCS loop is in operation.
-

APPLICABILITY: MODE 5 with RCS loops filled.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One required DHR loop inoperable. <u>AND</u> One DHR loop OPERABLE.	A.1 Initiate action to restore a second DHR loop to OPERABLE status.	Immediately
	<u>OR</u> A.2 Initiate action to restore required SGs secondary side water level to within limit.	Immediately
B. One or more required SGs with secondary side water level not within limit <u>AND</u> One DHR loop OPERABLE.	B.1 Initiate action to restore a second DHR loop to OPERABLE status.	Immediately
	<u>OR</u> B.2 Initiate action to restore required SGs secondary side water level to within limit.	Immediately
C. No required DHR loop OPERABLE. <u>OR</u> Required DHR loop not in operation.	C.1 Suspend operations that would cause introduction into the RCS, coolant with boron concentration less than required to meet SDM of LCO 3.1.1.	Immediately
	<u>AND</u> C.2 Initiate action to restore one DHR loop to OPERABLE status and operation.	Immediately

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.4.7.1	Verify required DHR loop is in operation.	12 hours
SR 3.4.7.2	Verify required SG secondary side water levels are ≥ 20 inches.	12 hours
SR 3.4.7.3	<p>-----NOTE----- Not required to be performed until 24 hours after a required pump is not in operation. -----</p> <p>Verify correct breaker alignment and indicated power available to each required DHR pump.</p>	7 days

3.4 REACTOR COOLANT SYSTEM (RCS)

3.4.8 RCS Loops - MODE 5, Loops Not Filled

LCO 3.4.8 Two decay heat removal (DHR) loops shall be OPERABLE and one OPERABLE DHR loop shall be in operation.

NOTES

1. All DHR pumps may be removed from operation for ≤ 1 hour provided:
 - a. No operations are permitted that would cause introduction into the RCS, coolant with boron concentration less than required to meet the SDM of LCO 3.1.1; and
 - b. No draining operations to further reduce the RCS water volume are permitted.
2. One DHR loop may be inoperable for ≤ 2 hours for surveillance testing provided that the other DHR loop is OPERABLE and in operation.

APPLICABILITY: MODE 5 with RCS loops not filled.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One DHR loop inoperable.	A.1 Initiate action to restore DHR loop to OPERABLE status.	Immediately

CONDITION	REQUIRED ACTION	COMPLETION TIME
B. No required DHR loop OPERABLE. <u>OR</u> Required DHR loop not in operation.	B.1 Suspend operations that would cause introduction into the RCS, coolant with boron concentration less than required to meet SDM of LCO 3.1.1.	Immediately
	<u>AND</u>	
	B.2 Suspend all operations involving reduction in RCS water volume.	Immediately
	<u>AND</u> B.3 Initiate action to restore one DHR loop to OPERABLE status and operation.	Immediately

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.4.8.1	Verify required DHR loop is in operation.	12 hours
SR 3.4.8.2	-----NOTE----- Not required to be performed until 24 hours after a required pump is not in operation. -----	7 days
	Verify correct breaker alignment and indicated power available to each required DHR pump.	

3.4 REACTOR COOLANT SYSTEM (RCS)

3.4.9 Pressurizer

LCO 3.4.9 The pressurizer shall be OPERABLE with:

- a. Pressurizer water level ≥ 45 inches and ≤ 320 inches; and
- b. A minimum of 126 kW of Engineered Safeguards (ES) bus powered pressurizer heaters OPERABLE.

-----NOTE-----
OPERABILITY requirements on pressurizer heaters do not apply in
MODE 4.

APPLICABILITY: MODES 1, 2, and 3,
MODE 4 with RCS temperature $> 262^{\circ}\text{F}$.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. Pressurizer water level not within limits.	A.1 Restore level to within limits.	1 hour
B. Required Action and associated Completion Time of Condition A not met.	B.1 Be in MODE 3.	6 hours
	<u>AND</u> B.2 Be in MODE 4 with RCS temperature $\leq 262^{\circ}\text{F}$.	24 hours
C. Capacity of ES bus powered pressurizer heaters less than limit.	C.1 Restore pressurizer heater capacity.	72 hours
D. Required Action and associated Completion Time of Condition C not met.	D.1 Be in MODE 3.	6 hours
	<u>AND</u> D.2 Be in MODE 4.	12 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.4.9.1	Verify pressurizer water level ≥ 45 inches and ≤ 320 inches.	12 hours
SR 3.4.9.2	Verify capacity of ES bus powered pressurizer heaters ≥ 126 kW.	18 months

3.4 REACTOR COOLANT SYSTEM (RCS)

3.4.10 Pressurizer Safety Valves

LCO 3.4.10 Two pressurizer safety valves shall be OPERABLE.

-----NOTES-----

1. Only one pressurizer safety valve is required to be OPERABLE in MODE 3, and in MODE 4 with RCS temperature > 262°F.
 2. The lift settings are not required to be within limits for entry into MODE 3 or the applicable portions of MODE 4 for the purpose of setting the pressurizer safety valves under ambient (hot) conditions. This exception is allowed for 36 hours following entry into MODE 3 provided a preliminary cold setting was made prior to heatup.
 3. Not applicable in MODE 3, and in MODE 4 with RCS temperature > 262°F during hydrostatic tests in accordance with ASME Boiler and Pressure Vessel Code, Section III.
 4. The provisions of LCO 3.0.3 are not applicable in MODE 3, and in MODE 4 with RCS temperature > 262°F.
-

APPLICABILITY: MODES 1, 2, and 3,
MODE 4 with RCS temperature > 262°F.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One pressurizer safety valve inoperable in MODES 1 or 2.	A.1 Restore valve to OPERABLE status.	15 minutes
B. Required Action and associated Completion Time of Condition A not met. <u>OR</u> Two pressurizer safety valves inoperable in MODES 1 or 2.	B.1 Be in MODE 3.	6 hours

CONDITION	REQUIRED ACTION	COMPLETION TIME
C. Required pressurizer safety valve inoperable in MODE 3 or MODE 4 with RCS temperature > 262°F.	C.1 Be in MODE 4 with RCS temperature ≤ 262°F.	18 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.4.10.1 Verify each required pressurizer safety valve is OPERABLE in accordance with the Inservice Testing Program. Following testing, as-left lift settings shall be within ± 1%.	In accordance with the Inservice Testing Program

3.4 REACTOR COOLANT SYSTEM (RCS)

3.4.11 Low Temperature Overpressure Protection (LTOP) System

LCO 3.4.11 An LTOP System shall be OPERABLE with high pressure injection (HPI) deactivated and the core flood tanks (CFTs) isolated and:

NOTES

1. HPI deactivation and CFT isolation not applicable during ASME Section XI testing.
2. HPI deactivation not applicable during fill and vent of the RCS.
3. HPI deactivation not applicable during emergency RCS makeup.
4. HPI deactivation not applicable during valve maintenance.
5. CFT isolation is only required when CFT pressure is greater than or equal to the maximum RCS pressure for the existing RCS temperature allowed by the pressure and temperature curves provided in LCO 3.4.3, "RCS Pressure and Temperature (P/T) Limits."

- a. Pressurizer level such that the unit is not in a water solid condition and an OPERABLE electromatic relief valve (ERV) with a setpoint of ≤ 460 psig; or

NOTES

1. Pressurizer level not applicable as allowed by Emergency Operating Procedures.
2. Pressurizer level not applicable during system hydrotest.

- b. The RCS depressurized and the RCS open.

APPLICABILITY: MODE 4 with RCS temperature $\leq 262^{\circ}\text{F}$,
MODE 5,
MODE 6 when the reactor vessel head is on.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. Pressurizer level not within required limits.	A.1 Restore pressurizer level to within required limits.	1 hour

CONDITION	REQUIRED ACTION	COMPLETION TIME
B. Required Action and associated Completion Time of Condition A not met.	B.1 Close and maintain closed the makeup control valve and its associated isolation valve.	12 hours
	<u>AND</u> B.2 Stop RCS heatup.	12 hours
C. Required Electromatic Relief Valve (ERV) inoperable.	C.1 Restore required ERV to OPERABLE status.	1 hour
D. Required Action and associated Completion Time of Condition C not met.	D.1 Reduce makeup tank level to ≤ 73 inches.	12 hours
E. LCO requirements not met for any reason other than Condition A through Condition D.	E.1 Initiate action to restore compliance with LCO requirements.	Immediately

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.4.11.1	Verify pressurizer level does not represent a water solid condition.	30 minutes during RCS heatup and cooldown <u>AND</u> 12 hours
SR 3.4.11.2	Verify HPI is deactivated.	12 hours
SR 3.4.11.3	Verify each pressurized CFT is isolated.	12 hours
SR 3.4.11.4	<p>-----NOTE-----</p> <p>Verification of locked, sealed, or otherwise secured open vent path(s) only required to be performed every 31 days.</p> <p>-----</p> <p>Verify OPERABLE pressure relief capability.</p>	12 hours
SR 3.4.11.5	Perform CHANNEL CALIBRATION of ERV opening circuitry.	18 months

3.4 REACTOR COOLANT SYSTEM (RCS)

3.4.12 RCS Specific Activity

LCO 3.4.12 The specific activity of the reactor coolant shall be:

- a. $\leq 3.5 \mu\text{Ci/gm}$ DOSE EQUIVALENT I-131; and
- b. $\leq 72/\bar{E} \mu\text{Ci/gm}$ total.

APPLICABILITY: MODES 1 and 2,
MODE 3 with RCS average temperature (T_{avg}) $\geq 500^\circ\text{F}$.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. Specific activity not within limits.	A.1 Restore specific activity to within limit(s).	24 hours
B. Required Action and associated Completion Time not met.	B.1 Be in MODE 3 with $T_{\text{avg}} < 500^\circ\text{F}$.	6 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.4.12.1 Verify reactor coolant gross specific activity $\leq 72/\bar{E} \mu\text{Ci/gm}$.	7 days
SR 3.4.12.2 <div style="border: 1px solid black; padding: 5px; margin: 5px 0;"> <p style="text-align: center;">-----NOTE-----</p> <p>Only required to be performed in MODE 1.</p> </div> Verify reactor coolant DOSE EQUIVALENT I-131 specific activity $\leq 3.5 \mu\text{Ci/gm}$.	14 days

SURVEILLANCE	FREQUENCY
<p>SR 3.4.12.3</p> <p>-----NOTE-----</p> <p>Not required to be performed until 31 days after a minimum of 2 EFPD and 20 days of MODE 1 operation have elapsed since the reactor was last subcritical for ≥ 48 hours.</p> <p>-----</p> <p>Determine \bar{E}.</p>	<p>184 days</p>

3.4 REACTOR COOLANT SYSTEM (RCS)

3.4.13 RCS Operational LEAKAGE

LCO 3.4.13 RCS operational LEAKAGE shall be limited to:

- a. No pressure boundary LEAKAGE;
- b. 1 gpm unidentified LEAKAGE;
- c. 10 gpm identified LEAKAGE; and
- d. 150 gallons per day primary to secondary LEAKAGE through any one SG.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. RCS primary to secondary LEAKAGE not within limits.	A.1 Reduce LEAKAGE to within limits.	4 hours
B. RCS unidentified or identified LEAKAGE not within limits.	B.1 Reduce LEAKAGE to within limits.	18 hours
C. Required Action and associated Completion Time of Condition A or B not met. <u>OR</u> Pressure boundary LEAKAGE exists.	C.1 Be in MODE 3. <u>AND</u> C.2 Be in MODE 5.	6 hours 36 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.4.13.1	<p align="center">-----NOTE-----</p> <p>Not required to be performed until 12 hours after establishment of steady state operation at or near operating pressure.</p> <p>-----</p> <p>Verify RCS operational LEAKAGE is within limits by performance of an RCS water inventory balance.</p>	72 hours
	SR 3.4.13.2 Verify steam generator tube integrity is in accordance with the Steam Generator Tube Surveillance Program.	
		In accordance with the Steam Generator Tube Surveillance Program

3.4 REACTOR COOLANT SYSTEM (RCS)

3.4.14 RCS Pressure Isolation Valve (PIV) Leakage

LCO 3.4.14 Leakage from each PIV shall be within limits.

APPLICABILITY: MODES 1, 2, and 3.
MODE 4, except valves in the decay heat removal (DHR) flow path when in, or during the transition to or from, the DHR mode of operation.

ACTIONS

NOTES

1. Separate Condition entry is allowed for each flow path.
2. Enter applicable Conditions and Required Actions for systems made inoperable by an inoperable pressure isolation function.

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more flow paths with leakage from one or more RCS pressure isolation check valves not within limit.	A.1 Isolate the high pressure portion of the affected system from the low pressure portion by use of one closed deactivated automatic valve and one OPERABLE check valve.	4 hours
B. Required Decay Heat Removal (DHR) System autoclosure interlock function inoperable.	B.1 Isolate the affected penetration by use of one closed manual or deactivated automatic valve.	4 hours
C. Required Action and associated Completion Time not met.	C.1 Be in MODE 3.	6 hours
	<u>AND</u> C.2 Be in MODE 5.	36 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY										
SR 3.4.14.1	<div>-----NOTE----- Not required to be performed in MODES 3 and 4.</div> <div>Verify leakage from each RCS pressure isolation check valve, or pair of check valves, as applicable, is less than or equal to an equivalent of the Allowable Leakage Limit identified below at a differential test pressure ≥ 150 psid.</div> <table><thead><tr><th><u>Pressure Isolation Check Valves(s)</u></th><th><u>Allowable Leakage Limit</u></th></tr></thead><tbody><tr><td>DH-14A</td><td>≤ 5 gpm</td></tr><tr><td>DH-13A and DH-17</td><td>≤ 5 gpm total</td></tr><tr><td>DH-14B</td><td>≤ 5 gpm</td></tr><tr><td>DH-13B and DH-18</td><td>≤ 5 gpm total</td></tr></tbody></table>	<u>Pressure Isolation Check Valves(s)</u>	<u>Allowable Leakage Limit</u>	DH-14A	≤ 5 gpm	DH-13A and DH-17	≤ 5 gpm total	DH-14B	≤ 5 gpm	DH-13B and DH-18	≤ 5 gpm total	<div>In accordance with the Inservice Testing Program</div> <div>AND</div> <div>Once prior to entering MODE 2 whenever the unit has been in MODE 5 for 7 days or more, if leakage testing has not been performed in the previous 9 months</div>
<u>Pressure Isolation Check Valves(s)</u>	<u>Allowable Leakage Limit</u>											
DH-14A	≤ 5 gpm											
DH-13A and DH-17	≤ 5 gpm total											
DH-14B	≤ 5 gpm											
DH-13B and DH-18	≤ 5 gpm total											
SR 3.4.14.2	Verify DHR System autoclosure interlock prevents the valves from being opened with a simulated or actual high RCS pressure signal.	18 months										
SR 3.4.14.3	Verify DHR System autoclosure interlock causes the valves to close automatically with a simulated or actual high RCS pressure signal: a. ≤ 340 psig for one valve; and b. ≤ 400 psig for the other valve.	18 months										
SR 3.4.14.4	Verify DHR System autoclosure interlock prevents the valves from being opened with a simulated or actual Core Flood Tank isolation valve "not closed" signal.	18 months										
SR 3.4.14.5	Verify DHR System autoclosure interlock causes the valves to close automatically with a simulated or actual Core Flood Tank isolation valve "not closed" signal.	18 months										

3.4 REACTOR COOLANT SYSTEM (RCS)

3.4.15 RCS Leakage Detection Instrumentation

LCO 3.4.15 The following RCS leakage detection instrumentation shall be OPERABLE:

- a. One reactor building sump monitor; and
- b. One reactor building atmosphere radioactivity monitor (gaseous or particulate).

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTIONS

-----NOTE-----

LCO 3.0.4 is not applicable.

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. Required reactor building sump monitor inoperable.	A.1 -----NOTE----- Not required until 12 hours after establishment of steady state operation at or near operating pressure.	Once per 24 hours
	Perform SR 3.4.13.1.	
	AND A.2 Restore required reactor building sump monitor to OPERABLE status.	30 days

CONDITION	REQUIRED ACTION	COMPLETION TIME
B. Required reactor building atmosphere radioactivity monitor inoperable.	B.1.1 Analyze grab samples of the reactor building atmosphere.	Once per 24 hours
	<u>OR</u>	
	B.1.2 <u>-----NOTE-----</u> Not required until 12 hours after establishment of steady state operation at or near operating pressure. <u>-----</u> Perform SR 3.4.13.1.	Once per 24 hours
	<u>AND</u> B.2 Restore required reactor building atmosphere radioactivity monitor to OPERABLE status.	30 days
C. Required Action and associated Completion Time not met.	C.1 Be in MODE 3.	6 hours
	<u>AND</u> C.2 Be in MODE 5.	36 hours
D. Both required monitors inoperable.	D.1 Enter LCO 3.0.3.	Immediately

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.4.15.1	Perform CHANNEL CHECK of required reactor building atmosphere radioactivity monitor.	12 hours
SR 3.4.15.2	Perform CHANNEL FUNCTIONAL TEST of required reactor building atmosphere radioactivity monitor.	92 days
SR 3.4.15.3	Perform CHANNEL CALIBRATION of required reactor building atmosphere radioactivity monitor.	18 months
SR 3.4.15.4	Perform CHANNEL CALIBRATION of required reactor building sump monitor.	18 months

3.5 EMERGENCY CORE COOLING SYSTEMS (ECCS)

3.5.1 Core Flood Tanks (CFTs)

LCO 3.5.1 Two CFTs shall be OPERABLE.

APPLICABILITY: MODES 1 and 2,
MODE 3 with Reactor Coolant System (RCS) pressure > 800 psig.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One CFT inoperable due to boron concentration not within limits.	A.1 Restore boron concentration to within limits.	72 hours
B. One CFT inoperable for reasons other than Condition A.	B.1 Restore CFT to OPERABLE status.	1 hour
C. Required Action and associated Completion Time of Condition A or B not met. <u>OR</u> Two CFTs inoperable.	C.1 Be in MODE 3. <u>AND</u> C.2 Reduce RCS pressure to ≤ 800 psig.	6 hours 12 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.5.1.1 Verify each CFT isolation valve is fully open.	12 hours
SR 3.5.1.2 Verify borated water volume in each CFT is $\geq 970 \text{ ft}^3$ and $\leq 1110 \text{ ft}^3$.	12 hours
SR 3.5.1.3 Verify nitrogen cover pressure in each CFT is ≥ 560 psig and ≤ 640 psig.	12 hours

SURVEILLANCE		FREQUENCY
SR 3.5.1.4	Verify boron concentration in each CFT is ≥ 2270 ppm.	<p>31 days</p> <p><u>AND</u></p> <p>-----NOTE----- Only required to be performed for affected CFT</p> <p>-----</p> <p>Once within 12 hours after each solution level increase of ≥ 0.2 feet that is not the result of addition from a borated water source of known concentration ≥ 2270 ppm</p>
SR 3.5.1.5	Verify power is removed from each CFT isolation valve operator.	31 days

3.5 EMERGENCY CORE COOLING SYSTEMS (ECCS)

3.5.2 ECCS - Operating

LCO 3.5.2 Two ECCS trains shall be OPERABLE.

APPLICABILITY: MODES 1 and 2,
MODE 3 with Reactor Coolant System (RCS) temperature > 350°F.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more trains inoperable.	A.1 Restore train(s) to OPERABLE status.	72 hours
B. Required Action and associated Completion Time not met.	B.1 Be in MODE 3.	6 hours
	<u>AND</u> B.2 Reduce RCS temperature to $\leq 350^{\circ}\text{F}$.	12 hours
C. Less than 100% of the ECCS flow equivalent to a single OPERABLE train available.	C.1 Enter LCO 3.0.3.	Immediately

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.5.2.1	Verify each ECCS manual, power operated, and automatic valve in the flow path, that is not locked, sealed, or otherwise secured in position, is in the correct position.	31 days
SR 3.5.2.2	Verify each ECCS pump's developed head at the test flow point is greater than or equal to the required developed head.	In accordance with the Inservice Testing Program

SURVEILLANCE		FREQUENCY
SR 3.5.2.3	Verify each ECCS automatic valve in the flow path that is not locked, sealed, or otherwise secured in position, actuates to the correct position on an actual or simulated actuation signal.	18 months
SR 3.5.2.4	Verify each ECCS pump starts automatically on an actual or simulated actuation signal.	18 months
SR 3.5.2.5	Verify, by visual inspection, each ECCS train reactor building sump suction inlet is not restricted by debris and screens show no evidence of structural distress or abnormal corrosion.	18 months

3.5 EMERGENCY CORE COOLING SYSTEMS (ECCS)

3.5.3 ECCS – Shutdown

LCO 3.5.3 Two LPI trains shall be OPERABLE.

-----NOTE-----
An LPI train may be considered OPERABLE during alignment and when aligned for decay heat removal, if capable of being manually realigned to the LPI mode of operation.

APPLICABILITY: MODE 3 with Reactor Coolant System (RCS) temperature $\leq 350^{\circ}\text{F}$,
MODE 4.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One LPI train inoperable.	A.1 Restore LPI train to OPERABLE status.	48 hours
B. Required Action and associated Completion Time of Condition A not met.	B.1 -----NOTE----- Only required if one DHR train is OPERABLE. ----- Be in MODE 5.	24 hours
C. Two LPI trains inoperable.	C.1 Initiate action to restore one LPI train to OPERABLE status. <u>AND</u> C.2 -----NOTE----- Only required if one DHR train is OPERABLE. ----- Be in MODE 5.	Immediately 24 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
<p>SR 3.5.3.1</p> <p style="text-align: center;">-----NOTE-----</p> <p>An LPI train may be considered OPERABLE during alignment and operation for DHR, if capable of being manually realigned to the LPI mode of operation.</p> <p>-----</p> <p>For all equipment required to be OPERABLE, the following SRs are applicable:</p> <p>SR 3.5.2.1, SR 3.5.2.4, SR 3.5.2.2, SR 3.5.2.5. SR 3.5.2.3,</p>	<p>In accordance with applicable SRs</p>

3.5 EMERGENCY CORE COOLING SYSTEMS (ECCS)

3.5.4 Borated Water Storage Tank (BWST)

LCO 3.5.4 The BWST shall be OPERABLE.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. BWST boron concentration not within limits. <u>OR</u> BWST water temperature not within limits.	A.1 Restore BWST to OPERABLE status.	8 hours
B. BWST inoperable for reasons other than Condition A.	B.1 Restore BWST to OPERABLE status.	1 hour
C. Required Action and associated Completion Time not met.	C.1 Be in MODE 3.	6 hours
	<u>AND</u> C.2 Be in MODE 5.	36 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.5.4.1 <u>NOTE</u> Only required to be performed when ambient air temperature is < 40°F or > 110°F. Verify BWST borated water temperature is ≥ 40°F and ≤ 110°F.	24 hours

SURVEILLANCE		FREQUENCY
SR 3.5.4.2	Verify BWST borated water level is ≥ 38.4 feet and ≤ 42 feet.	7 days
SR 3.5.4.3	Verify BWST boron concentration is ≥ 2270 ppm and ≤ 2670 ppm.	7 days

3.6 REACTOR BUILDING SYSTEMS

3.6.1 Reactor Building

LCO 3.6.1 The reactor building shall be OPERABLE.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. Reactor building inoperable.	A.1 Restore reactor building to OPERABLE status.	1 hour
B. Required Action and associated Completion Time not met.	B.1 Be in MODE 3.	6 hours
	<u>AND</u> B.2 Be in MODE 5.	36 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.6.1.1 Perform required visual examinations and leakage rate testing except for reactor building air lock testing, in accordance with the Reactor Building Leakage Rate Testing Program.	In accordance with the Reactor Building Leakage Rate Testing Program

3.6 REACTOR BUILDING SYSTEMS

3.6.2 Reactor Building Air Locks

LCO 3.6.2 Two reactor building air locks shall be OPERABLE.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTIONS

NOTES

1. Entry and exit is permissible to perform repairs on the affected air lock components.
2. Separate Condition entry is allowed for each air lock.
3. Enter applicable Conditions and Required Actions of LCO 3.6.1, "Reactor Building," when air lock leakage results in exceeding the overall reactor building leakage rate acceptance criteria.

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more reactor building air locks with one reactor building air lock door inoperable.	<h4>NOTES</h4> <ol style="list-style-type: none"> 1. Required Actions A.1, A.2, and A.3 are not applicable if both doors in the same air lock are inoperable and Condition C is entered. 2. Entry and exit is permissible for 7 days under administrative controls if both air locks are inoperable. 	1 hour
	A.1 Verify the OPERABLE door is closed in the affected air lock.	
	<u>AND</u>	

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. (continued)	A.2 Lock the OPERABLE door closed in the affected air lock.	24 hours
	<p><u>AND</u></p> <p>A.3 <u>NOTE</u></p> <p>Air lock doors in high radiation areas may be verified locked closed by administrative means.</p> <p>Verify the OPERABLE door is locked closed in the affected air lock.</p>	Once per 31 days
B. One or more reactor building air locks with reactor building air lock interlock mechanism inoperable.	<p><u>NOTES</u></p> <p>1. Required Actions B.1, B.2, and B.3 are not applicable if both doors in the same air lock are inoperable and Condition C is entered.</p> <p>2. Entry and exit of the reactor building is permissible under the control of a dedicated individual.</p>	
	<p>B.1 Verify an OPERABLE door is closed in the affected air lock.</p> <p><u>AND</u></p>	1 hour

CONDITION	REQUIRED ACTION	COMPLETION TIME
B. (continued)	B.2 Lock an OPERABLE door closed in the affected air lock.	24 hours
	<p><u>AND</u></p> <p>B.3 <u>NOTE</u></p> <p>Air lock doors in high radiation areas may be verified locked closed by administrative means.</p> <p>Verify an OPERABLE door is locked closed in the affected air lock.</p>	Once per 31 days
C. One or more reactor building air locks inoperable for reasons other than Condition A or B.	C.1 Initiate action to evaluate overall reactor building leakage rate per LCO 3.6.1.	Immediately
	<p><u>AND</u></p> <p>C.2 Verify a door is closed in the affected air lock.</p>	1 hour
	<p><u>AND</u></p> <p>C.3 Restore air lock to OPERABLE status.</p>	24 hours
D. Required Action and associated Completion Time not met.	D.1 Be in MODE 3.	6 hours
	<p><u>AND</u></p> <p>D.2 Be in MODE 5.</p>	36 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.6.2.1	<p>-----NOTE-----</p> <ol style="list-style-type: none"> 1. An inoperable air lock door does not invalidate the previous successful performance of the overall air lock leakage test. 2. Results shall be evaluated against acceptance criteria applicable to SR 3.6.1.1. <p>-----</p> <p>Perform required air lock leakage rate testing in accordance with the Reactor Building Leakage Rate Testing Program.</p>	In accordance with the Reactor Building Leakage Rate Testing Program
SR 3.6.2.2	Verify only one door in the air lock can be opened at a time.	18 months

3.6 REACTOR BUILDING SYSTEMS

3.6.3 Reactor Building Isolation Valves

LCO 3.6.3 Each reactor building isolation valve shall be OPERABLE.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTIONS

NOTES

1. Penetration flow paths, except for purge valve penetration flow paths, may be unisolated intermittently under administrative controls.
2. Separate Condition entry is allowed for each penetration flow path.
3. Enter applicable Conditions and Required Actions for system(s) made inoperable by reactor building isolation valves.
4. Enter applicable Conditions and Required Actions of LCO 3.6.1, "Reactor Building," when isolation valve leakage results in exceeding the overall reactor building leakage rate acceptance criteria.

CONDITION	REQUIRED ACTION	COMPLETION TIME
<p>A. -----NOTE-----</p> <p>Only applicable to penetration flow paths with two reactor building isolation valves.</p> <p>-----</p> <p>One or more penetration flow paths with one reactor building isolation valve inoperable.</p>	<p>A.1 Isolate the affected penetration flow path by use of at least one closed and de-activated automatic valve, closed manual valve, blind flange, or check valve with flow through the valve secured.</p> <p><u>AND</u></p>	48 hours

CONDITION	REQUIRED ACTION	COMPLETION TIME
<p>A. (continued)</p>	<p>A.2</p> <p>-----NOTES-----</p> <ol style="list-style-type: none"> 1. Isolation devices in high radiation areas may be verified by use of administrative means. 2. Isolation devices that are locked, sealed, or otherwise secured may be verified by use of administrative means. <p>-----</p> <p>Verify the affected penetration flow path is isolated.</p>	<p>Once per 31 days for isolation devices outside the reactor building</p> <p><u>AND</u></p> <p>Prior to entering MODE 4 from MODE 5 if not performed within the previous 92 days for isolation devices inside the reactor building</p>
<p>B. -----NOTE-----</p> <p>Only applicable to penetration flow paths with two reactor building isolation valves.</p> <p>-----</p> <p>One or more penetration flow paths with two reactor building isolation valves inoperable.</p>	<p>B.1</p> <p>Isolate the affected penetration flow path by use of at least one closed and de-activated automatic valve, closed manual valve, or blind flange.</p>	<p>1 hour</p>

CONDITION	REQUIRED ACTION	COMPLETION TIME
<p>C. -----NOTE----- Only applicable to penetration flow paths with only one reactor building isolation valve and a closed system.</p> <p>----- One or more penetration flow paths with one reactor building isolation valve inoperable.</p>	<p>C.1 Isolate the affected penetration flow path by use of at least one closed and de-activated automatic valve, closed manual valve, or blind flange.</p>	72 hours
	<p><u>AND</u></p> <p>C.2 -----NOTES----- 1. Isolation devices in high radiation areas may be verified by use of administrative means. 2. Isolation devices that are locked, sealed, or otherwise secured may be verified by use of administrative means.</p> <p>----- Verify the affected penetration flow path is isolated.</p>	Once per 31 days
<p>D. Required Action and associated Completion Time not met.</p>	<p>D.1 Be in MODE 3.</p>	6 hours
	<p><u>AND</u></p> <p>D.2 Be in MODE 5.</p>	36 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.6.3.1 Verify each reactor building purge isolation valve is closed.	31 days

SURVEILLANCE	FREQUENCY
<p>SR 3.6.3.2 -----NOTE-----</p> <p>Valves and blind flanges in high radiation areas may be verified by use of administrative means.</p> <p>-----</p> <p>Verify each reactor building isolation manual valve and blind flange that is located outside the reactor building and not locked, sealed, or otherwise secured, and is required to be closed during accident conditions is closed, except for reactor building isolation valves that are open under administrative controls.</p>	<p>31 days</p>
<p>SR 3.6.3.3 -----NOTE-----</p> <p>Valves and blind flanges in high radiation areas may be verified by use of administrative means.</p> <p>-----</p> <p>Verify each reactor building isolation manual valve and blind flange that is located inside the reactor building and not locked, sealed, or otherwise secured, and required to be closed during accident conditions is closed, except for reactor building isolation valves that are open under administrative controls.</p>	<p>Prior to entering MODE 4 from MODE 5 if not performed within the previous 92 days</p>
<p>SR 3.6.3.4 Verify the isolation time of each automatic power operated reactor building isolation valve is within limits.</p>	<p>In accordance with the Inservice Testing Program</p>
<p>SR 3.6.3.5 Verify each automatic reactor building isolation valve that is not locked, sealed, or otherwise secured in position, actuates to the isolation position on an actual or simulated actuation signal.</p>	<p>18 months</p>

3.6 REACTOR BUILDING SYSTEMS

3.6.4 Reactor Building Pressure

LCO 3.6.4 Reactor building pressure shall be ≥ -1.0 psig and $\leq +3.0$ psig.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. Reactor building pressure not within limits.	A.1 Restore reactor building pressure to within limits.	1 hour
B. Required Action and associated Completion Time not met.	B.1 Be in MODE 3.	6 hours
	<u>AND</u> B.2 Be in MODE 5.	36 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.6.4.1 Verify reactor building pressure is ≥ -1.0 psig and $\leq +3.0$ psig.	12 hours

3.6 REACTOR BUILDING SYSTEMS

3.6.5 Reactor Building Spray and Cooling Systems

LCO 3.6.5 Two reactor building spray trains and two reactor building cooling trains shall be OPERABLE.

-----NOTE-----

Only one train of reactor building spray and one train of reactor building cooling are required to be OPERABLE during MODES 3 and 4.

APPLICABILITY: MODES 1, 2, 3, and 4

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One reactor building spray train inoperable in MODE 1 or 2.	A.1 Restore reactor building spray train to OPERABLE status.	72 hours AND 10 days from discovery of failure to meet the LCO
B. One reactor building cooling train inoperable in MODE 1 or 2.	B.1 Restore reactor building cooling train to OPERABLE status.	7 days AND 10 days from discovery of failure to meet the LCO
C. Two reactor building cooling trains inoperable in MODE 1 or 2.	C.1 Restore one reactor building cooling train to OPERABLE status.	72 hours

D. Required Action and associated Completion Time of Condition A, B, or C not met.	D.1 Be in MODE 3.	6 hours
E. One required reactor building spray train inoperable in MODE 3 or 4. <u>OR</u> One required reactor building cooling train inoperable in MODE 3 or 4.	E.1 Restore required inoperable train to OPERABLE status.	36 hours
F. Required Action and associated Completion Time of Condition E not met.	F.1 Be in MODE 5.	36 hours
G. Two reactor building spray trains inoperable in MODE 1 or 2. <u>OR</u> Any combination of three or more trains inoperable in MODE 1 or 2. <u>OR</u> One required reactor building spray train and one required reactor building cooling train inoperable in MODE 3 or 4.	G.1 Enter LCO 3.0.3.	Immediately

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.6.5.1	Verify each reactor building spray manual, power operated, and automatic valve in each required flow path that is not locked, sealed, or otherwise secured in position is in the correct position.	31 days
SR 3.6.5.2	Operate each required reactor building cooling train fan unit for ≥ 15 minutes.	31 days
SR 3.6.5.3	Verify each required reactor building cooling train cooling water flow rate is ≥ 1200 gpm.	31 days
SR 3.6.5.4	Verify each required reactor building spray pump's developed head at the flow test point is greater than or equal to the required developed head.	In accordance with the Inservice Testing Program
SR 3.6.5.5	Verify each automatic reactor building spray valve in each required flow path that is not locked, sealed, or otherwise secured in position, actuates to the correct position on an actual or simulated actuation signal.	18 months
SR 3.6.5.6	Verify each required reactor building spray pump starts automatically on an actual or simulated actuation signal.	18 months
SR 3.6.5.7	Verify each required reactor building cooling train starts automatically on an actual or simulated actuation signal.	18 months
SR 3.6.5.8	Verify each required train spray nozzle is unobstructed.	10 years

3.6 REACTOR BUILDING SYSTEMS

3.6.6 Spray Additive System

LCO 3.6.6 The Spray Additive System shall be OPERABLE.

APPLICABILITY: MODES 1 and 2.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. Spray Additive System inoperable.	A.1 Restore Spray Additive System to OPERABLE status.	72 hours
B. Required Action and associated Completion Time not met.	B.1 Be in MODE 3.	6 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.6.6.1	Verify each Spray Additive System manual, power operated, and automatic valve in the flow path that is not locked, sealed, or otherwise secured in position is in the correct position.	31 days
SR 3.6.6.2	Verify sodium hydroxide tank solution volume is ≥ 9000 gallons.	184 days
SR 3.6.6.3	Verify sodium hydroxide tank solution concentration is > 5.0 wt% and < 16.5 wt.% NaOH.	184 days

SURVEILLANCE		FREQUENCY
SR 3.6.6.4	Verify each Spray Additive System automatic valve in the flow path actuates to the correct position on an actual or simulated actuation signal.	18 months

3.6 REACTOR BUILDING SYSTEMS

3.6.7 Hydrogen Recombiners

LCO 3.6.7 Two hydrogen recombiners shall be OPERABLE.

APPLICABILITY: MODES 1 and 2.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One hydrogen recombinder inoperable.	A.1 -----NOTE----- LCO 3.0.4 is not applicable. ----- Restore hydrogen recombinder to OPERABLE status.	30 days
B. Required Action and associated Completion Time not met.	B.1 Be in MODE 3.	6 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.6.7.1	Perform a system functional test for each hydrogen recombinder.	18 months
SR 3.6.7.2	Visually examine each hydrogen recombinder enclosure and verify there is no evidence of abnormal conditions.	18 months

SURVEILLANCE		FREQUENCY
SR 3.6.7.3	Perform a resistance to ground test for each heater phase.	18 months

3.7 PLANT SYSTEMS

3.7.1 Main Steam Safety Valves (MSSVs)

LCO 3.7.1 Seven MSSVs shall be OPERABLE on each main steam line.

-----NOTE-----

During main steam system hydrotesting in MODE 3, one MSSV is required to be OPERABLE on each main steam line with lift setpoints adjusted to allow testing.

APPLICABILITY: MODES 1, 2, and 3.

ACTIONS

-----NOTE-----

Separate Condition entry is allowed for each MSSV.

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more required MSSVs inoperable.	A.1 Reduce power in accordance with Table 3.7.1-1.	4 hours
	<u>AND</u> A.2 Reduce the nuclear overpower trip setpoint in accordance with Table 3.7.1-1.	36 hours
B. Required Action and associated Completion Time not met. <u>OR</u> One or more steam generators with less than two MSSVs OPERABLE.	B.1 Be in MODE 3.	6 hours
	<u>AND</u> B.2 Be in MODE 4.	12 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.7.1.1	<p>-----NOTE----- Only required to be performed in MODES 1 and 2.</p> <p>Verify each required MSSV lift setpoint in accordance with the Inservice Testing Program. Following testing, as-left lift settings shall be within $\pm 1\%$.</p>	In accordance with the Inservice Testing Program

Table 3.7.1-1
Allowable Power Level and RPS Nuclear Overpower Trip
Allowable Value versus OPERABLE Main Steam Safety Valves

MINIMUM NUMBER OF MSSVS OPERABLE (PER SG)	MAXIMUM ALLOWABLE POWER LEVEL (% RTP)	RPS NUCLEAR OVERPOWER TRIP ALLOWABLE VALUE (% RTP)
6	85.7	89.9
5	71.4	74.9
4	57.1	59.9
3	42.8	44.9
2	28.5	29.9

3.7 PLANT SYSTEMS

3.7.2 Main Steam Isolation Valves (MSIVs)

LCO 3.7.2 Two MSIVs shall be OPERABLE.

APPLICABILITY: MODE 1, 2, and 3.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more MSIV(s) inoperable in MODE 1 or 2.	A.1 Restore MSIV(s) to OPERABLE status.	24 hours
B. Required Action and associated Completion Time of Condition A not met.	B.1 Be in MODE 3.	12 hours
C. <u>NOTE</u> Separate Condition entry is allowed for each MSIV. One or more MSIV(s) inoperable in MODE 3.	C.1 Close MSIV. <u>AND</u> C.2 Verify MSIV is closed.	48 hours Once per 7 days
D. Required Action and associated Completion Time of Condition C not met.	D.1 Be in MODE 4.	24 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.7.2.1	<p>-----NOTE-----</p> <p>Only required to be performed in MODES 1 and 2.</p> <p>-----</p> <p>Verify isolation time of each MSIV is within the limits specified in the Inservice Testing Program.</p>	In accordance with the Inservice Testing Program
SR 3.7.2.2	<p>-----NOTE-----</p> <ol style="list-style-type: none"> Only required to be performed in MODES 1 and 2. Not required to be met when SG pressure is < 750 psig. <p>-----</p> <p>Verify each MSIV actuates to the isolation position on an actual or simulated actuation signal.</p>	18 months

3.7 PLANT SYSTEMS

3.7.3 Main Feedwater Isolation Valves (MFIVs), Main Feedwater Block Valves, Low Load Feedwater Control Valves and Startup Feedwater Control Valves

LCO 3.7.3 All MFIVs, Main Feedwater Block Valves, Low Load Feedwater Control Valves and Startup Feedwater Control Valves shall be OPERABLE.

APPLICABILITY: MODES 1, 2, and 3.

ACTIONS

-----NOTE-----
Separate Condition entry is allowed for each valve.

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One MFIV in one or more flow paths inoperable	A.1 Close or isolate MFIV.	72 hours
	<u>AND</u> A.2 Verify MFIV is closed or isolated.	Once per 7 day
B. One Main Feedwater Block Valve in one or more flow paths inoperable	B.1 Close or isolate Main Feedwater Block Valve.	72 hours
	<u>AND</u> B.2 Verify Main Feedwater Block Valve is closed or isolated.	Once per 7 days
C. One Low Load Feedwater Control Valve in one or more flow paths inoperable.	C.1 Close or isolate Low Load Feedwater Control Valve.	72 hours
	<u>AND</u> C.2 Verify Low Load Feedwater Control Valve is closed or isolated.	Once per 7 days

MFIVs, Main Feedwater Block Valves,
Low Load Feedwater Control Valves and
Startup Feedwater Control Valves
3.7.3

CONDITION	REQUIRED ACTION	COMPLETION TIME
D. One Startup Feedwater Control Valve in one or more flow paths inoperable.	D.1 Close or isolate Startup Feedwater Control Valve.	72 hours
	<u>AND</u> D.2 Verify Startup Feedwater Control Valve is closed or isolated.	Once per 7 days
E. Two valves in the same flow path inoperable for one or more flow paths.	E.1 Isolate affected flow path.	8 hours
F. Required Action and associated Completion Time not met.	F.1 Be in MODE 3.	6 hours
	<u>AND</u> F.2 Be in MODE 4.	12 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
<p>SR 3.7.3.1</p> <p style="text-align: center;"><u>NOTE</u></p> <p style="text-align: center;">Only required to be performed in MODES 1 and 2.</p> <p>Verify the isolation time of each MFIV, Main Feedwater Block Valve, Low Load Feedwater Control Valve and Startup Feedwater Control Valve is within the limits provided in the Inservice Testing Program.</p>	In accordance with the Inservice Testing Program

MFIVs, Main Feedwater Block Valves,
Low Load Feedwater Control Valves and
Startup Feedwater Control Valves
3.7.3

SURVEILLANCE		FREQUENCY
SR 3.7.3.2	<p style="text-align: center;">-----NOTES-----</p> <ol style="list-style-type: none"> 1. Only required to be performed in MODES 1 and 2. 2. Not required to be met when SG pressure is < 750 psig. <p>-----</p> <p>Verify that each MFIV, Main Feedwater Block Valve, Low Load Feedwater Control Valve and Startup Feedwater Control Valve actuates to the isolation position on an actual or simulated actuation signal.</p>	18 months

3.7 PLANT SYSTEMS

3.7.4 Secondary Specific Activity

LCO 3.7.4 The specific activity of the secondary coolant shall be $\leq 0.17 \mu\text{Ci/gm}$
DOSE EQUIVALENT I-131.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. Specific activity not within limit.	A.1 Be in MODE 3.	6 hours
	<u>AND</u> A.2 Be in MODE 5.	36 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.7.4.1 Verify the specific activity of the secondary coolant is $\leq 0.17 \mu\text{Ci/gm}$ DOSE EQUIVALENT I-131.	31 days

3.7 PLANT SYSTEMS

3.7.5 Emergency Feedwater (EFW) System

LCO 3.7.5 Two EFW trains shall be OPERABLE.

~~-----NOTE-----~~
Only one EFW train, which includes a motor driven pump, is required to be OPERABLE in MODE 4.
~~-----~~

APPLICABILITY: MODES 1, 2, and 3,
MODE 4 when steam generator is relied upon for heat removal.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
<p>A. One steam supply to turbine driven EFW pump inoperable.</p> <p><u>OR</u></p> <p>-----NOTE----- Only applicable if MODE 2 has not been entered following refueling. -----</p> <p>Turbine driven EFW pump inoperable in MODE 3 following refueling.</p>	<p>A.1 Restore affected equipment to OPERABLE status.</p>	<p>7 days</p> <p><u>AND</u></p> <p>10 days from discovery of failure to meet the LCO</p>
<p>B. One EFW train inoperable for reasons other than Condition A in MODE 1, 2, or 3.</p>	<p>B.1 Restore EFW train to OPERABLE status.</p>	<p>72 hours</p> <p><u>AND</u></p> <p>10 days from discovery of failure to meet the LCO</p>

CONDITION	REQUIRED ACTION	COMPLETION TIME
C. Required Action and associated Completion Time of Condition A or B not met.	C.1 Be in MODE 3.	6 hours
	<u>AND</u> C.2 Be in MODE 4.	18 hours
D. Two EFW trains inoperable in MODE 1, 2, or 3.	D.1 <u>NOTE</u> LCO 3.0.3 and all other LCO Required Actions requiring MODE changes are suspended until one EFW train is restored to OPERABLE status. Initiate action to restore one EFW train to OPERABLE status.	Immediately
E. Required EFW train inoperable in MODE 4.	E.1 Initiate action to restore EFW train to OPERABLE status.	Immediately

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.7.5.1	Verify each EFW manual, power operated, and automatic valve in each water flow path and in both steam supply flow paths to the steam turbine driven pump, that is not locked, sealed, or otherwise secured in position, is in the correct position.	31 days
SR 3.7.5.2	<u>NOTE</u> Not required to be performed for the turbine driven EFW pump, until 24 hours after reaching ≥ 750 psig in the steam generators. Verify the developed head of each EFW pump at the flow test point is greater than or equal to the required developed head.	In accordance with the Inservice Testing Program

SURVEILLANCE		FREQUENCY
SR 3.7.5.3	<p>-----NOTE----- Not required to be met in MODE 4 when steam generator is relied upon for heat removal.</p> <p>Verify each EFW automatic valve that is not locked, sealed, or otherwise secured in position, actuates to the correct position on an actual or simulated actuation signal.</p>	18 months
SR 3.7.5.4	<p>-----NOTE----- Not required to be met in MODE 4 when steam generator is relied upon for heat removal.</p> <p>Verify each EFW pump starts automatically on an actual or simulated actuation signal.</p>	18 months
SR 3.7.5.5	Verify proper alignment of the required EFW flow paths by verifying manual valve alignment from the "Q" condensate storage tank to each steam generator.	Prior to entering MODE 2 whenever the unit has been in MODE 5, MODE 6, or defueled for a cumulative period of > 30 days
SR 3.7.5.6	Verify that feedwater is delivered to each steam generator using the motor-driven EFW pump.	18 months

3.7 PLANT SYSTEMS

3.7.6 Q Condensate Storage Tank (QCST)

LCO 3.7.6 The QCST shall be OPERABLE.

APPLICABILITY: MODES 1, 2, and 3,
 MODE 4 when steam generator is relied upon for heat removal.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. The QCST inoperable.	A.1 Verify by administrative means OPERABILITY of backup water supply.	4 hours <u>AND</u> Once per 12 hours thereafter
	<u>AND</u> A.2 Restore QCST to OPERABLE status.	7 days
B. Required Action and associated Completion Time not met.	B.1 Be in MODE 3.	6 hours
	<u>AND</u> B.2 Be in MODE 4 without reliance on steam generator for heat removal.	24 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.7.6.1 Verify QCST volume is $\geq 267,000$ gallons when required for both units and $\geq 107,000$ gallons when only required for Unit 1.	12 hours

3.7 PLANT SYSTEMS

3.7.7 Service Water System (SWS)

LCO 3.7.7 Two SWS loops shall be OPERABLE.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One SWS loop inoperable.	<p>A.1</p> <p>-----NOTES-----</p> <p>1. Enter applicable Conditions and Required Actions of LCO 3.8.1, "AC Sources - Operating," for diesel generator made inoperable by SWS.</p> <p>2. Enter Applicable Conditions and Required Actions of LCO 3.4.6, "RCS Loops - MODE 4," for decay heat removal made inoperable by SWS.</p> <p>-----</p> <p>Restore SWS loop to OPERABLE status.</p>	72 hours
B. Required Action and associated Completion Time not met.	<p>B.1 Be in MODE 3.</p> <p><u>AND</u></p> <p>B.2 Be in MODE 5.</p>	<p>6 hours</p> <p>36 hours</p>

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.7.7.1	<p>-----NOTE----- Isolation of SWS flow to individual components does not render the SWS inoperable.</p> <p>Verify each SWS manual, power operated, and automatic valve in the flow path servicing safety related equipment, that is not locked, sealed, or otherwise secured in position, is in the correct position.</p>	31 days
SR 3.7.7.2	Verify each SWS automatic valve in the flow path that is not locked, sealed, or otherwise secured in position, actuates to the correct position on an actual or simulated actuation signal.	18 months
SR 3.7.7.3	Verify each required SWS pump starts automatically on an actual or simulated signal.	18 months

3.7 PLANT SYSTEMS

3.7.8 Emergency Cooling Pond (ECP)

LCO 3.7.8 The ECP shall be OPERABLE.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. ECP inoperable.	A.1 Be in MODE 3.	6 hours
	<u>AND</u> A.2 Be in MODE 5.	36 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.7.8.1	Verify water level of ECP is ≥ 5 ft.	24 hours
SR 3.7.8.2	<div>-----NOTE----- Only required to be performed from June 1 through September 30. -----</div> Verify average water temperature is $\leq 100^{\circ}\text{F}$.	24 hours
SR 3.7.8.3	Verify contained water volume of ECP ≥ 70 acre-ft at water level of 5 ft.	12 months

SURVEILLANCE		FREQUENCY
SR 3.7.8.4	<p>Verify earth portions of stone covered embankments and spillway of ECP:</p> <ul style="list-style-type: none"> a. Have not been eroded or undercut by wave action, and b. Do not show apparent changes in visual appearance or other abnormal degradation from as-built condition. 	12 months

3.7 PLANT SYSTEMS

3.7.9 Control Room Emergency Ventilation System (CREVS)

LCO 3.7.9 Two CREVS trains shall be OPERABLE.

NOTES

1. The control room boundary may be opened intermittently under administrative controls.
2. One CREVS train shall be capable of automatic actuation.

APPLICABILITY: MODES 1, 2, 3, and 4,
During movement of irradiated fuel assemblies.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One CREVS train inoperable.	A.1 Restore CREVS train to OPERABLE status.	7 days
B. Two CREVS trains inoperable due to inoperable control room boundary in MODES 1, 2, 3, and 4.	B.1 Restore control room boundary to OPERABLE status.	24 hours
C. Required Action and associated Completion Time of Condition A or B not met in MODE 1, 2, 3, or 4.	C.1 Be in MODE 3.	6 hours
	<u>AND</u> C.2 Be in MODE 5.	36 hours
D. Required Action and associated Completion Time of Condition A not met during movement of irradiated fuel assemblies.	D.1 Place OPERABLE CREVS train in emergency recirculation mode.	Immediately
	<u>OR</u> D.2. Suspend movement of irradiated fuel assemblies.	Immediately

CONDITION	REQUIRED ACTION	COMPLETION TIME
E. Two CREVS trains inoperable during movement of irradiated fuel assemblies.	E.1 Suspend movement of irradiated fuel assemblies.	Immediately
F. Two CREVS trains inoperable during MODE 1, 2, 3, or 4 for reasons other than Condition B.	F.1 Enter LCO 3.0.3.	Immediately

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.7.9.1	Operate each CREVS train for ≥ 15 minutes.	31 days
SR 3.7.9.2	Perform required CREVS filter testing in accordance with the Ventilation Filter Testing Program (VFTP).	In accordance with the VFTP
SR 3.7.9.3	Verify the CREVS automatically isolates the Control Room and switches into a recirculation mode of operation on an actual or simulated actuation signal.	18 months
SR 3.7.9.4	Verify the system makeup flow rate is ≥ 300 and ≤ 366 cfm when supplying the control room with outside air.	18 months

3.7 PLANT SYSTEMS

3.7.10 Control Room Emergency Air Conditioning System (CREACS)

LCO 3.7.10 Two CREACS trains shall be OPERABLE.

APPLICABILITY: MODES 1, 2, 3, and 4,
During movement of irradiated fuel assemblies.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One CREACS train inoperable.	A.1 Restore CREACS train to OPERABLE status.	30 days
B. Required Action and associated Completion Time of Condition A not met in MODE 1, 2, 3, or 4.	B.1 Be in MODE 3.	6 hours
	<u>AND</u> B.2 Be in MODE 5.	36 hours
C. Required Action and associated Completion Time of Condition A not met during movement of irradiated fuel assemblies.	C.1 Place OPERABLE CREACS train in operation.	Immediately
	<u>OR</u> C.2 Suspend movement of irradiated fuel assemblies.	Immediately
D. Two CREACS trains inoperable during movement of irradiated fuel assemblies.	D.1 Suspend movement of irradiated fuel assemblies.	Immediately
E. Two CREACS trains inoperable during MODE 1, 2, 3, or 4.	E.1 Enter LCO 3.0.3.	Immediately

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.7.10.1	Verify each CREACS train starts, operates for at least 1 hour, and maintains control room air temperature $\leq 84^{\circ}\text{F D. B.}$	31 days
SR 3.7.10.2	Verify system flow rate of 9900 cfm $\pm 10\%$.	18 months

3.7 PLANT SYSTEMS

3.7.11 Penetration Room Ventilation System (PRVS)

LCO 3.7.11 Two PRVS trains shall be OPERABLE.

-----NOTE-----

The penetration room negative pressure boundary may be opened intermittently under administrative controls.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One PRVS train inoperable.	A.1 Restore PRVS train to OPERABLE status.	7 days
B. Two PRVS trains inoperable due to inoperable penetration room negative pressure boundary.	B.1 Restore penetration room negative pressure boundary to OPERABLE status.	24 hours
C. Required Action and associated Completion Time not met. <u>OR</u> Both PRVS trains inoperable for reasons other than Condition B.	C.1 Be in MODE 3. <u>AND</u> C.2 Be in MODE 5.	6 hours 36 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.7.11.1 Operate each PRVS train for ≥ 15 minutes.	31 days
SR 3.7.11.2 Perform required PRVS filter testing in accordance with the Ventilation Filter Testing Program (VFTP).	In accordance with the VFTP

SURVEILLANCE		FREQUENCY
SR 3.7.11.3	Verify each PRVS train actuates on an actual or simulated actuation signal.	18 months

3.7 PLANT SYSTEMS

3.7.12 Fuel Handling Area Ventilation System (FHAVS)

LCO 3.7.12 The FHAVS shall be OPERABLE and in operation.

APPLICABILITY: During movement of irradiated fuel assemblies in the fuel handling area.

ACTIONS

-----NOTE-----

LCO 3.0.3 is not applicable.

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. FHAVS inoperable or not in operation.	A.1 Suspend movement of irradiated fuel assemblies in the fuel handling area.	Immediately

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.7.12.1 Verify FHAVS in operation.	12 hours
SR 3.7.12.2 Perform required FHAVS filter testing in accordance with the Ventilation Filter Testing Program (VFPT).	In accordance with the VFPT

3.7 PLANT SYSTEMS

3.7.13 Spent Fuel Pool Water Level

LCO 3.7.13 The spent fuel pool water level shall be ≥ 23 ft over the top of irradiated fuel assemblies seated in the storage racks.

APPLICABILITY: During movement of irradiated fuel assemblies in the spent fuel pool.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. Spent fuel pool water level not within limit.	<p>A.1</p> <p>-----NOTE----- LCO 3.0.3 is not applicable.</p> <p>Suspend movement of irradiated fuel assemblies in the spent fuel pool.</p>	Immediately

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.7.13.1 Verify the spent fuel pool water level is ≥ 23 ft above the top of irradiated fuel assemblies seated in the storage racks.	7 days

3.7 PLANT SYSTEMS

3.7.14 Spent Fuel Pool Boron Concentration

LCO 3.7.14 The spent fuel pool boron concentration shall be ≥ 1600 ppm.

APPLICABILITY: When fuel assemblies are stored in the spent fuel pool and a spent fuel pool verification has not been performed since the last movement of fuel assemblies in the spent fuel pool.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. Spent fuel pool boron concentration not within limit.	-----NOTE----- LCO 3.0.3 is not applicable. -----	
	A.1 Suspend movement of fuel assemblies in the spent fuel pool.	Immediately
	<u>AND</u>	
	A.2.1 Initiate action to restore spent fuel pool boron concentration to within limit.	Immediately
	<u>OR</u>	
	A.2.2 Initiate action to perform a spent fuel pool verification.	Immediately

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.7.14.1 Verify the spent fuel pool boron concentration is ≥ 1600 ppm.	7 days

3.7 PLANT SYSTEMS

3.7.15 Spent Fuel Pool Storage

LCO 3.7.15 The combination of initial enrichment and burnup of each spent fuel assembly stored in Region 2 shall be within the acceptable range of Figure 3.7.15-1 or in accordance with Specification 4.3.1.1.

APPLICABILITY: Whenever any fuel assembly is stored in Region 2 of the spent fuel pool.


ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. Requirements of the LCO not met.	<p>A.1 <u>-----NOTE-----</u> LCO 3.0.3 is not applicable.</p> <p>Initiate action to move the noncomplying fuel assembly from Region 2.</p>	Immediately

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.7.15.1 Verify by administrative means the initial enrichment and burnup of the fuel assembly is in accordance with Figure 3.7.15-1 or Specification 4.3.1.1.	Prior to storing the fuel assembly in Region 2

Figure 3.7.15-1
Burnup versus Enrichment Curve for
Spent Fuel Storage Racks

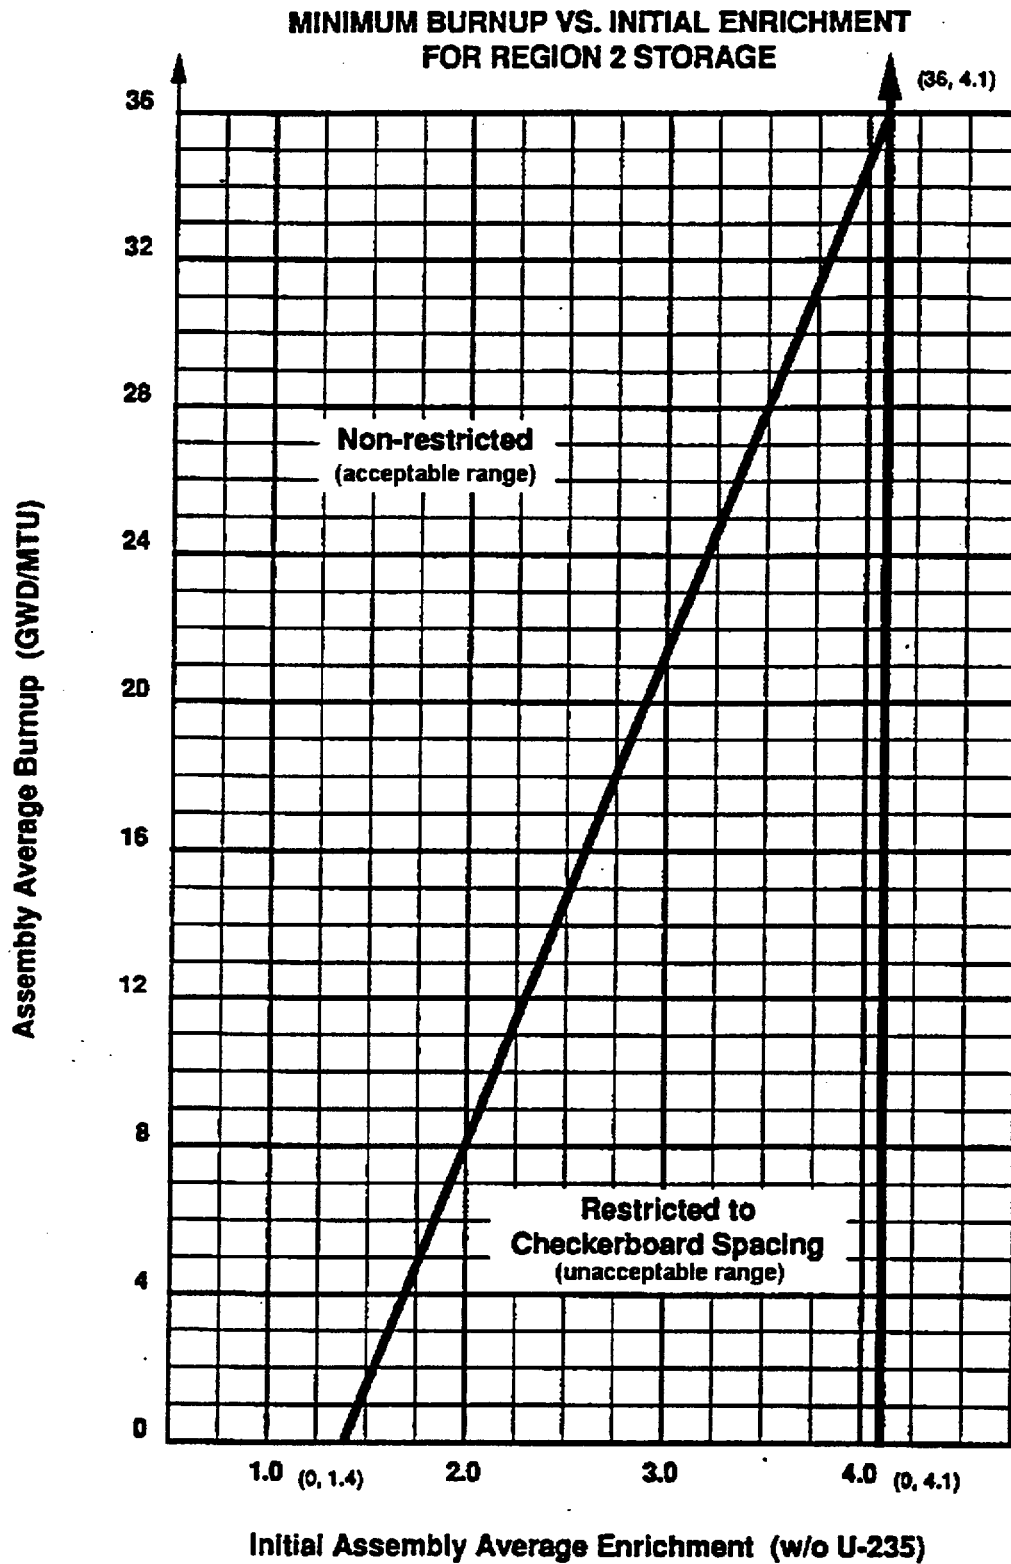

3.8 ELECTRICAL POWER SYSTEMS

3.8.1 AC Sources - Operating

LCO 3.8.1 The following AC electrical power sources shall be OPERABLE:

- a. Two qualified circuits between the offsite transmission network and the onsite Class 1E AC Electrical Power Distribution System; and
- b. Two diesel generators (DGs) each capable of supplying one train of the onsite Class 1E AC Electrical Power Distribution System.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One required offsite circuit inoperable.	A.1 Perform SR 3.8.1.1 for OPERABLE required offsite circuit.	1 hour
	<u>AND</u>	<u>AND</u>
	A.2 Declare required feature(s) with no offsite power available inoperable when its redundant required feature(s) is inoperable.	Once per 12 hours thereafter
	<u>AND</u>	24 hours from discovery of no offsite power to one train concurrent with inoperability of redundant required feature(s)

CONDITION	REQUIRED ACTION	COMPLETION TIME
A (continued)	<p>A.3 <u>NOTE</u> Startup Transformer No. 2 may be removed from service for up to 30 days for preplanned preventative maintenance. This 30 day Completion Time may be applied not more than once in any 10 year period. The provisions of LCO 3.0.4 are not applicable to Startup Transformer No. 2 during this 30 day preventative maintenance period.</p> <hr/> <p>Restore required offsite circuit to OPERABLE status.</p>	<p>72 hours</p> <p><u>AND</u></p> <p>10 days from discovery of failure to meet LCO</p>
B. One DG inoperable.	<p>B.1 Perform SR 3.8.1.1 for OPERABLE required offsite circuit(s).</p> <p><u>AND</u></p> <p>B.2 Declare required feature(s) supported by the inoperable DG inoperable when its redundant required feature(s) is inoperable.</p> <p><u>AND</u></p> <p>B.3.1 Determine OPERABLE DG is not inoperable due to common cause failure.</p> <p><u>OR</u></p>	<p>1 hour</p> <p><u>AND</u></p> <p>Once per 12 hours thereafter</p> <p>4 hours from discovery of Condition B concurrent with inoperability of redundant required feature(s)</p> <p>24 hours</p>

CONDITION	REQUIRED ACTION	COMPLETION TIME
B. (continued)	B.3.2 Perform SR 3.8.1.2 for OPERABLE DG.	24 hours
	<u>AND</u> B.4 Restore DG to OPERABLE status.	7 days <u>AND</u> 10 days from discovery of failure to meet LCO
C. Two required offsite circuits inoperable.	C.1 Declare required feature(s) inoperable when its redundant required feature(s) is inoperable.	12 hours from discovery of Condition C concurrent with inoperability of redundant required feature(s)
	<u>AND</u> C.2 Restore one required offsite circuit to OPERABLE status.	24 hours
D. One required offsite circuit inoperable. <u>AND</u> One DG inoperable.	-----NOTE----- Enter applicable Conditions and Required Actions of LCO 3.8.6, "Distribution Systems - Operating," when Condition D is entered with no AC power source to any train. -----	
	D.1 Restore required offsite circuit to OPERABLE status.	12 hours
	<u>OR</u> D.2 Restore DG to OPERABLE status.	12 hours
E. Two DGs inoperable.	E.1 Restore one DG to OPERABLE status.	2 hours

CONDITION	REQUIRED ACTION	COMPLETION TIME
F. Required Action and Associated Completion Time of Condition A, B, C, D, or E not met.	F.1 Be in MODE 3.	12 hours
	<u>AND</u> F.2 Be in MODE 5.	36 hours
G. Three or more required AC sources inoperable.	G.1 Enter LCO 3.0.3.	Immediately

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.8.1.1	Verify correct breaker alignment and indicated power availability for each required offsite circuit.	7 days
SR 3.8.1.2	<p>-----NOTE-----</p> <p>All DG starts may be preceded by an engine prelube period and followed by a warmup period prior to loading.</p> <p>-----</p> <p>Verify each DG starts from standby conditions and, in ≤ 15 seconds achieves "ready-to-load" conditions.</p>	31 days
SR 3.8.1.3	<p>-----NOTES-----</p> <ol style="list-style-type: none"> DG loadings may include gradual loading as recommended by the manufacturer. Momentary transients outside the load range do not invalidate this test. This Surveillance shall be conducted on only one DG at a time. This SR shall be preceded by and follow, without shutdown, a successful performance of SR 3.8.1.2. <p>-----</p> <p>Verify each DG is synchronized and loaded and operates for ≥ 60 minutes at a load ≥ 2475 kW and ≤ 2750 kW.</p>	31 days

SURVEILLANCE		FREQUENCY
SR 3.8.1.4	Verify each day tank contains ≥ 160 gallons of fuel oil.	31 days
SR 3.8.1.5	Check for and remove accumulated water from each day tank.	31 days
SR 3.8.1.6	Verify the fuel oil transfer system operates to transfer fuel oil from storage tanks to the day tank.	31 days
SR 3.8.1.7	<p>-----NOTE----- This Surveillance shall not normally be performed in MODE 1 or 2. However, portions of the Surveillance may be performed to reestablish OPERABILITY provided an assessment determines the safety of the plant is maintained or enhanced.</p> <p>Verify automatic transfer of AC power sources to the selected offsite circuit and manual transfer to the alternate required offsite circuit.</p>	18 months
SR 3.8.1.8	<p>-----NOTE----- All DG starts may be preceded by an engine prelube period.</p> <p>Verify on an actual or simulated loss of offsite power signal:</p> <ol style="list-style-type: none"> De-energization of emergency buses; Load shedding from emergency buses; and DG auto-starts from standby condition and: <ol style="list-style-type: none"> achieves "ready-to-load" conditions in ≤ 15 seconds, energizes permanently connected loads, energizes auto-connected shutdown load through automatic load sequencing timers, and supplies connected loads for ≥ 5 minutes. 	18 months

SURVEILLANCE	FREQUENCY
<p>SR 3.8.1.9</p> <hr/> <p style="text-align: center;">NOTE</p> <hr/> <p>All DG starts may be preceded by an engine prelube period.</p> <hr/> <p>Verify on an actual or simulated loss of offsite power signal in conjunction with an actual or simulated ESF actuation signal:</p> <ul style="list-style-type: none"> a. De-energization of emergency buses; b. Load shedding from emergency buses; and c. DG auto-starts from standby condition and: <ul style="list-style-type: none"> 1. achieves "ready-to-load" conditions in ≤ 15 seconds, 2. energizes permanently connected loads, 3. energizes auto-connected emergency loads through load sequencing timers, and 4. supplies connected loads for ≥ 5 minutes. 	<p>18 months</p>

3.8 ELECTRICAL POWER SYSTEMS

3.8.2 AC Sources - Shutdown

LCO 3.8.2 The following AC electrical power sources shall be OPERABLE:

- a. One qualified circuit between the offsite transmission network and the onsite Class 1E AC electrical power distribution subsystem(s) required by LCO 3.8.10, "Distribution Systems - Shutdown"; and
- b. One diesel generator (DG) capable of supplying one train of the onsite Class 1E AC electrical power distribution subsystem(s) required by LCO 3.8.10.

APPLICABILITY: MODES 5 and 6,
During movement of irradiated fuel assemblies.

ACTIONS

-----NOTE-----
LCO 3.0.3 is not applicable.

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One required offsite circuit inoperable.	-----NOTE----- Enter applicable Conditions and Required Actions of LCO 3.8.10, with one required train de-energized as a result of Condition A.	
	A.1 Declare affected required feature(s) with no offsite power available inoperable.	Immediately
	<u>OR</u>	
	A.2.1 Suspend CORE ALTERATIONS.	Immediately
	<u>AND</u>	

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. (continued)	A.2.2 Suspend movement of irradiated fuel assemblies.	Immediately
	<u>AND</u>	
	A.2.3 Suspend operations involving positive reactivity additions that could result in loss of required SDM or boron concentration.	Immediately
	<u>AND</u>	
	A.2.4 Initiate action to restore required offsite power circuit to OPERABLE status.	Immediately
B. One required DG inoperable.	B.1 Suspend CORE ALTERATIONS.	Immediately
	<u>AND</u>	
	B.2 Suspend movement of irradiated fuel assemblies.	Immediately
	<u>AND</u>	
	B.3 Suspend operations involving positive reactivity additions that could result in loss of required SDM or boron concentration.	Immediately
	<u>AND</u>	
	B.4 Initiate action to restore required DG to OPERABLE status.	Immediately

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
<p>SR 3.8.2.1</p> <hr/> <p style="text-align: center;">NOTES</p> <hr/> <ol style="list-style-type: none"> 1. SR 3.8.1.3 is not required to be performed. 2. The 15 second acceptance criteria of SR 3.8.1.2 is not applicable. <hr/> <p>For AC Sources required to be OPERABLE, the SRs of Specification 3.8.1, "AC Sources – Operating," except SR 3.8.1.4, SR 3.8.1.7, SR 3.8.1.8, and SR 3.8.1.9, are applicable.</p>	<p>31 days</p>

3.8 ELECTRICAL POWER SYSTEMS

3.8.3 Diesel Fuel Oil and Starting Air

LCO 3.8.3 The stored diesel fuel oil and starting air subsystem shall be within limits for each required diesel generator (DG).

APPLICABILITY: When associated DG is required to be OPERABLE.

ACTIONS

-----NOTE-----
Separate Condition entry is allowed for each DG.

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more DG fuel oil storage tank(s) with fuel volume < 20,000 gallons and > 17,140 gallons.	A.1 Restore fuel oil volume to within limits.	48 hours
B. One or more DGs with stored fuel oil total particulates not within limit.	B.1 Restore fuel oil total particulates to within limits.	7 days
C. One or more DGs with new fuel oil properties not within limits.	C.1 Restore stored fuel oil properties to within limits.	30 days
D. One or more DGs with required starting air receiver pressure < 175 psig and \geq 158 psig.	D.1 Restore required starting air receiver pressure to within limits.	48 hours

CONDITION	REQUIRED ACTION	COMPLETION TIME
<p>E. Required Action and associated Completion Time not met.</p> <p><u>OR</u></p> <p>One or more DGs with diesel fuel oil or required starting air subsystem not within limits for reasons other than Condition A, B, C, or D.</p>	E.1 Declare associated DG inoperable.	Immediately

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.8.3.1	Verify each fuel oil storage tank contains $\geq 20,000$ gallons of fuel.	31 days
SR 3.8.3.2	Verify fuel oil properties of new and stored fuel oil are tested in accordance with, and maintained within the limits of, the Diesel Fuel Oil Testing Program.	In accordance with the Diesel Fuel Oil Testing Program
SR 3.8.3.3	Verify each DG required air start receiver pressure is ≥ 175 psig.	31 days
SR 3.8.3.4	Check for and remove accumulated water from each fuel oil storage tank.	31 days

3.8 ELECTRICAL POWER SYSTEMS

3.8.4 DC Sources - Operating

LCO 3.8.4 Both DC electrical power subsystems shall be OPERABLE.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One DC electrical power subsystem inoperable.	A.1 Restore DC electrical power subsystem to OPERABLE status.	8 hours
B. Required Action and Associated Completion Time not met.	B.1 Be in MODE 3.	12 hours
	<u>AND</u> B.2 Be in MODE 5.	36 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.8.4.1	Verify battery terminal voltage is ≥ 124.7 V on float charge.	7 days
SR 3.8.4.2	Verify battery capacity is adequate to supply, and maintain in OPERABLE status, the required emergency loads for the design duty cycle when subjected to a battery service test or a modified performance discharge test.	18 months

SURVEILLANCE	FREQUENCY
<p>SR 3.8.4.3 Verify battery capacity is $\geq 80\%$ of the manufacturer's rating when subjected to a performance discharge test or a modified performance discharge test.</p>	<p>60 months</p> <p><u>AND</u></p> <p>12 months when battery shows degradation, or has reached 85% of the expected life with capacity $< 100\%$ of manufacturer's rating</p> <p><u>AND</u></p> <p>24 months when battery has reached 85% of the expected life with capacity $\geq 100\%$ of manufacturer's rating</p>

3.8 ELECTRICAL POWER SYSTEMS

3.8.5 DC Sources - Shutdown

LCO 3.8.5 The DC electrical power subsystem shall be OPERABLE to support the DC electrical power distribution subsystem(s) required by LCO 3.8.10, "Distribution Systems – Shutdown."

APPLICABILITY: MODES 5 and 6,
During movement of irradiated fuel assemblies.

ACTIONS

-----NOTE-----
LCO 3.0.3 is not applicable.

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more required DC electrical power subsystems inoperable.	A.1.1 Suspend CORE ALTERATIONS.	Immediately
	<u>AND</u>	
	A.1.2 Suspend movement of irradiated fuel assemblies.	Immediately
	<u>AND</u>	
	A.1.3 Suspend operations involving positive reactivity additions that could result in loss of required SDM or boron concentration.	Immediately
	<u>AND</u>	
	A.1.4 Initiate action to restore required DC electrical power subsystems to OPERABLE status.	Immediately
	<u>AND</u>	

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. (continued)	A.1.5 Enter applicable Conditions and Required Actions of LCO 3.4.11, "Low Temperature Overpressure Protection (LTOP) System," for LTOP features made inoperable by Condition A.	Immediately

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
<p>SR 3.8.5.1</p> <p>-----NOTE-----</p> <p>The following SRs are not required to be performed: SR 3.8.4.2 and SR 3.8.4.3.</p> <p>-----</p> <p>For DC sources required to be OPERABLE, the following SRs are applicable:</p> <p>SR 3.8.4.1, SR 3.8.4.2, and SR 3.8.4.3.</p>	In accordance with applicable SRs

3.8 ELECTRICAL POWER SYSTEMS

3.8.6 Battery Cell Parameters

LCO 3.8.6 Battery cell parameters shall be within limits.

APPLICABILITY: When associated DC electrical power subsystems are required to be OPERABLE.

ACTIONS

-----NOTE-----
Separate Condition entry is allowed for each battery.

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more batteries with one or more battery cell parameters not within Table 3.8.6-1 Category A or B limits.	A.1 Verify pilot cell electrolyte level and float voltage meet Table 3.8.6-1 Category C limits.	1 hour
	<u>AND</u>	
	A.2 Verify battery cell parameters meet Table 3.8.6-1 Category C limits.	24 hours
	<u>AND</u>	Once per 7 days thereafter
	A.3 Restore battery cell parameters to Table 3.8.6-1 Category A and B limits.	31 days

CONDITION	REQUIRED ACTION	COMPLETION TIME
<p>B. Required Action and associated Completion Time of Condition A not met.</p> <p><u>OR</u></p> <p>One or more batteries with pilot cell or average electrolyte temperature of the representative cells < 60°F.</p> <p><u>OR</u></p> <p>One or more batteries with one or more battery cell parameters not within Table 3.8.6-1 Category C values.</p>	<p>B.1 Declare associated battery inoperable.</p>	<p>Immediately</p>

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.8.6.1	Verify battery cell parameters meet Table 3.8.6-1 Category A limits.	7 days
SR 3.8.6.2	Verify electrolyte temperature of the pilot cell is $\geq 60^{\circ}\text{F}$.	31 days

SURVEILLANCE		FREQUENCY
SR 3.8.6.3	Verify battery cell parameters meet Table 3.8.6-1 Category B limits.	<p>92 days</p> <p><u>AND</u></p> <p>Once within 24 hours after a battery discharge < 110 V</p> <p><u>AND</u></p> <p>Once within 24 hours after a battery overcharge > 145 V</p>
SR 3.8.6.4	Verify average electrolyte temperature of representative cells is $\geq 60^{\circ}\text{F}$.	92 days

Table 3.8.6-1
Battery Cell Surveillance Requirements

PARAMETER	CATEGORY A: LIMITS FOR EACH DESIGNATED PILOT CELL	CATEGORY B: LIMITS FOR EACH CONNECTED CELL	CATEGORY C: ALLOWABLE LIMITS FOR EACH CONNECTED CELL
Electrolyte Level	> Minimum level indication mark, and ≤ 1/4 inch above maximum level indication mark ^(a)	> Minimum level indication mark, and ≤ 1/4 inch above maximum level indication mark ^(a)	Above top of plates, and not overflowing
Float Voltage	≥ 2.13 V	≥ 2.13 V	> 2.07 V
Specific Gravity ^{(b)(c)}	≥ 1.195	≥ 1.190 <u>AND</u> Average of all connected cells > 1.195	Not more than 0.020 below average connected cells <u>AND</u> Average of all connected cells ≥ 1.190

- (a) It is acceptable for the electrolyte level to temporarily increase above the specified maximum during equalizing charges provided it is not overflowing.
- (b) Corrected for electrolyte temperature.
- (c) A battery charging current of < 2 amps when on float charge is acceptable for meeting specific gravity limits following a battery recharge, for a maximum of 7 days. When charging current is used to satisfy specific gravity requirements, specific gravity of each connected cell shall be measured prior to expiration of the 7 day allowance.

3.8 ELECTRICAL POWER SYSTEMS

3.8.7 Inverters - Operating

LCO 3.8.7 The following inverters shall be OPERABLE.

- a. Two Red Train inverters (Y11 and Y13, Y11 and Y15, or Y13 and Y15),
- b. Two Green Train inverters (Y22 and Y24, Y22 and Y25, or Y24 and Y25),
and
- c. Inverter Y28

NOTE

One of the four inverters required by LCO 3.8.7.a and LCO 3.8.7.b may be disconnected from its associated DC bus for ≤ 2 hours to perform load transfer to or from the swing inverter, provided:

- a. The associated 120 VAC bus is energized from its alternate AC source;
and
- b. The other three 120 VAC buses are energized from their associated
OPERABLE inverters.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One of the four inverters required by LCO 3.8.7.a and LCO 3.8.7.b inoperable.	<p>A.1 <u>NOTE</u> Enter applicable Conditions and Required Actions of LCO 3.8.9, "Distribution Systems - Operating" with any of the 120 VAC buses RS1, RS2, RS3, or RS4 de-energized.</p> <hr/> <p>Restore inverter to OPERABLE status.</p>	<p>24 hours</p> <p><u>AND</u></p> <p>96 hours from discovery of failure to meet LCO</p>

CONDITION	REQUIRED ACTION	COMPLETION TIME
B. Inverter Y28 inoperable.	<p>B.1 <u>NOTE</u> Enter applicable Conditions and Required Actions of LCO 3.8.9, "Distribution Systems - Operating" with 120 VAC bus C540 de-energized.</p> <p>Restore inverter to OPERABLE status.</p>	<p>72 hours</p> <p><u>AND</u></p> <p>96 hours from discovery of failure to meet LCO</p>
<p>C. Inverter Y28 inoperable.</p> <p><u>AND</u></p> <p>One of the two Red Train inverters required by LCO 3.8.7.a inoperable.</p>	C.1 Restore one inverter to OPERABLE status.	2 hours
<p>D. Required Action and associated Completion Time not met.</p> <p><u>OR</u></p> <p>Two or more of the four inverters required by LCO 3.8.7.a and LCO 3.8.7.b inoperable.</p>	<p>D.1 Be in MODE 3.</p> <p><u>AND</u></p> <p>D.2 Be in MODE 5.</p>	<p>12 hours</p> <p>36 hours</p>

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
<p>SR 3.8.7.1 Verify correct inverter voltage, frequency, and alignment to associated 120 VAC buses RS1, RS2, RS3, RS4, and C540.</p>	7 days

3.8 ELECTRICAL POWER SYSTEMS

3.8.8 Inverters - Shutdown

LCO 3.8.8 Inverters shall be OPERABLE to support the onsite Class 1E AC vital bus electrical power distribution subsystem(s) required by LCO 3.8.10, "Distribution Systems – Shutdown."

APPLICABILITY: MODES 5 and 6,
During movement of irradiated fuel assemblies.

ACTIONS

-----NOTE-----
LCO 3.0.3 is not applicable.

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more required inverters inoperable.	A.2.1 Suspend CORE ALTERATIONS.	Immediately
	<u>AND</u>	
	A.2.2 Suspend movement of irradiated fuel assemblies.	Immediately
	<u>AND</u>	
	A.2.3 Suspend operations involving positive reactivity additions that could result in loss of required SDM or boron concentration.	Immediately
	<u>AND</u>	
	A.2.4 Initiate action to restore required inverters to OPERABLE status.	Immediately
	<u>AND</u>	

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. (continued)	A.2.5 Enter applicable Conditions and Required Actions of LCO 3.4.11, "Low Temperature Overpressure Protection (LTOP) System," for LTOP features made inoperable by AC vital bus inverter(s).	Immediately

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.8.8.1 Verify correct inverter voltage and alignments to required 120 VAC vital buses.	7 days

3.8 ELECTRICAL POWER SYSTEMS

3.8.9 Distribution Systems - Operating

LCO 3.8.9 Two AC, DC, and 120 VAC electrical power distribution subsystems shall be OPERABLE.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more AC electrical power distribution subsystem(s) inoperable.	A.1 Restore AC electrical power distribution subsystem(s) to OPERABLE status.	8 hours <u>AND</u> 16 hours from discovery of failure to meet LCO
B. One or more 120 VAC electrical power distribution subsystem(s) (RS1, RS2, RS3, RS4) inoperable.	B.1 Restore 120 VAC electrical power distribution subsystem(s) to OPERABLE status.	8 hours <u>AND</u> 16 hours from discovery of failure to meet LCO
C. 120 VAC electrical power distribution subsystem C540 inoperable.	C.1 Enter applicable Conditions and Required Actions of LCO 3.3.11, "Emergency Feedwater Initiation and Control (EFIC) System Instrumentation," LCO 3.3.15, "Post Accident Monitoring (PAM) Instrumentation," and LCO 3.4.14, "RCS Pressure Isolation Valve (PIV) Leakage."	Immediately

ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
D. One or more DC electrical power distribution subsystem(s) inoperable.	D.1 Restore DC electrical power distribution subsystem(s) to OPERABLE status.	8 hours <u>AND</u> 16 hours from discovery of failure to meet LCO
E. Required Action and associated Completion Time not met.	E.1 Be in MODE 3. <u>AND</u> E.2 Be in MODE 5.	12 hours 36 hours
F. Two or more electrical power distribution subsystems inoperable that result in a loss of function.	F.1 Enter LCO 3.0.3.	Immediately

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.8.9.1 Verify correct breaker alignments to required AC, DC, and 120 VAC bus electrical power distribution subsystems.	7 days

3.8 ELECTRICAL POWER SYSTEMS

3.8.10 Distribution Systems - Shutdown

LCO 3.8.10 The necessary portion of AC, DC, and 120 VAC vital bus electrical power distribution subsystems shall be OPERABLE to support equipment required to be OPERABLE by the following specifications:

- LCO 3.3.9, "Source Range Neutron Flux,"
- LCO 3.4.3, "RCS Pressure and Temperature (P/T) Limits,"
- LCO 3.4.7, "RCS Loops - MODE 5, Loops Filled,"
- LCO 3.4.8, "RCS Loops - MODE 5, Loops Not Filled,"
- LCO 3.4.11, "Low Temperature Overpressure Protection (LTOP) System,"
- LCO 3.7.9, "Control Room Emergency Ventilation System (CREVS),"
- LCO 3.7.10, "Control Room Emergency Air Conditioning System (CREACS),"
- LCO 3.7.12, "Fuel Handling Area Ventilation System (FHAVS),"
- LCO 3.9.2, "Nuclear Instrumentation," for one monitor,
- LCO 3.9.4, "Decay Heat Removal (DHR) and Coolant Circulation - High Water Level," and
- LCO 3.9.5, "Decay Heat Removal (DHR) and Coolant Circulation - Low Water Level."

APPLICABILITY: MODES 5 and 6,
During movement of irradiated fuel assemblies.

ACTIONS

-----NOTE-----
LCO 3.0.3 is not applicable.

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more required AC, DC, or 120 VAC vital bus electrical power distribution subsystems inoperable.	A.1 Declare associated supported required feature(s) inoperable.	Immediately
	<u>OR</u>	
	A.2.1 Suspend CORE ALTERATIONS.	Immediately
	<u>AND</u>	

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. (continued)	A.2.2 Suspend movement of irradiated fuel assemblies.	Immediately
	<u>AND</u>	
	A.2.3 Suspend operations involving positive reactivity additions that could result in loss of required SDM or boron concentration.	Immediately
	<u>AND</u>	
	A.2.4 Initiate actions to restore required AC, DC, and 120 VAC vital bus electrical power distribution subsystems to OPERABLE status.	Immediately
	<u>AND</u>	
	A.2.5 Declare associated required decay heat removal subsystem(s) inoperable.	Immediately
	<u>AND</u>	
	A.2.6 Enter applicable Conditions and Required Actions of LCO 3.4.11, "Low Temperature Overpressure Protection (LTOP) System," for LTOP features made inoperable by Electrical Power Distribution System.	Immediately

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.8.10.1 Verify correct breaker alignments to required AC, DC, and 120 VAC vital bus electrical power distribution subsystems.	7 days

3.9 REFUELING OPERATIONS

3.9.1 Boron Concentration

LCO 3.9.1 Boron concentrations of the Reactor Coolant System and the refueling canal shall be maintained within the limit specified in the COLR.

APPLICABILITY: MODE 6.

-----NOTE-----
Only applicable to the refueling canal when connected to the RCS.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. Boron concentration not within limit.	A.1 Suspend CORE ALTERATIONS.	Immediately
	<u>AND</u>	
	A.2 Suspend positive reactivity additions.	Immediately
	<u>AND</u>	
	A.3 Initiate action to restore boron concentration to within limit.	Immediately

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.9.1.1 Verify boron concentration is within the limit specified in the COLR.	72 hours

3.9 REFUELING OPERATIONS

3.9.2 Nuclear Instrumentation

- LCO 3.9.2 a. One source range neutron flux monitor shall be OPERABLE, and
- b. One additional source range neutron flux monitor shall be
 OPERABLE during CORE ALTERATIONS.

APPLICABILITY: MODE 6.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One required source range neutron flux monitor inoperable during CORE ALTERATIONS.	A.1 Suspend CORE ALTERATIONS.	Immediately
	<u>AND</u> A.2 Suspend operations that would cause introduction into the RCS, coolant with boron concentration less than required to meet the boron concentration of LCO 3.9.1.	Immediately
B. No OPERABLE source range neutron flux monitor.	B.1 Initiate action to restore one source range neutron flux monitor to OPERABLE status.	Immediately
	<u>AND</u> B.2 Perform SR 3.9.1.1.	Once per 12 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.9.2.1	Perform CHANNEL CHECK.	12 hours
SR 3.9.2.2	<p>—————NOTE—————</p> <p>Neutron detectors are excluded from CHANNEL CALIBRATION.</p> <p>—————</p> <p>Perform CHANNEL CALIBRATION.</p>	18 months

3.9 REFUELING OPERATIONS

3.9.3 Reactor Building Penetrations

- LCO 3.9.3** The reactor building penetrations shall be in the following status:
- a. The equipment hatch is capable of being closed;
 - b. One door in each air lock is capable of being closed; and
 - c. Each penetration providing direct access from the reactor building atmosphere to the outside atmosphere either:
 1. closed by a manual or automatic isolation valve, blind flange, or equivalent, or
 2. capable of being closed by an OPERABLE reactor building isolation valve, except reactor building purge isolation valves, or
 3. capable of being closed by an OPERABLE reactor building purge isolation valve with the purge exhaust radiation monitoring channel OPERABLE.

APPLICABILITY: During movement of irradiated fuel assemblies within the reactor building.

ACTIONS

CONDITION		REQUIRED ACTION	COMPLETION TIME
A.	One or more reactor building penetrations not in required status.	A.1 Suspend movement of irradiated fuel assemblies within the reactor building.	Immediately

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.9.3.1	Verify each required reactor building penetration is in the required status.	7 days
SR 3.9.3.2	<p style="text-align: center;">NOTE</p> <p>Not required to be met for reactor building isolation valves and reactor building purge isolation valves in penetrations closed to comply with LCO c.1.</p> <p>Verify each required reactor building isolation valve and each reactor building purge isolation valve actuates to the isolation position.</p>	18 months
SR 3.9.3.3	Perform CHANNEL CALIBRATION of reactor building purge exhaust radiation monitor.	18 months

3.9 REFUELING OPERATIONS

3.9.4 Decay Heat Removal (DHR) and Coolant Circulation - High Water Level

LCO 3.9.4 One DHR loop shall be OPERABLE and in operation.

NOTE

The required DHR loop may be removed from operation for ≤ 1 hour per 8 hour period, provided no operations are permitted that would cause introduction into the Reactor Coolant System, coolant with boron concentration less than that required to meet the minimum required boron concentration of LCO 3.9.1.

APPLICABILITY: MODE 6 with the water level ≥ 23 ft above the top of the irradiated fuel seated in the reactor pressure vessel.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. DHR loop requirements not met.	A.1 Suspend operations that would cause introduction into the RCS, coolant with boron concentration less than required to meet the boron concentration of LCO 3.9.1.	Immediately
	<u>AND</u>	
	A.2 Suspend loading irradiated fuel assemblies in the core.	Immediately
	<u>AND</u>	
	A.3 Initiate action to satisfy DHR loop requirements.	Immediately
	<u>AND</u>	
	A.4 Close all reactor building penetrations providing direct access from the reactor building atmosphere to outside atmosphere.	4 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.9.4.1	Verify one DHR loop is in operation.	12 hours

3.9 REFUELING OPERATIONS

3.9.5 Decay Heat Removal (DHR) and Coolant Circulation - Low Water Level

LCO 3.9.5 Two DHR loops shall be OPERABLE, and one DHR loop shall be in operation.

NOTE

1. All DHR pumps may be de-energized for ≤ 15 minutes when switching from one train to another provided:
 - a. The core outlet temperature is maintained > 10 degrees F below saturation temperature;
 - b. No operations are permitted that would cause a reduction of the Reactor Coolant System boron concentration; and
 - c. No draining operations to further reduce RCS water volume are permitted.
2. One required DHR loop may be inoperable for up to 2 hours for surveillance testing, provided that the other DHR loop is OPERABLE and in operation.

APPLICABILITY: MODE 6 with the water level < 23 feet above the top of the irradiated fuel seated in the reactor pressure vessel.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. Less than required number of DHR loops OPERABLE.	A.1 Initiate action to restore DHR loop to OPERABLE status.	Immediately
	<u>OR</u> A.2 Initiate action to establish ≥ 23 feet of water above the top of the irradiated fuel seated in the reactor pressure vessel.	Immediately

CONDITION	REQUIRED ACTION	COMPLETION TIME
B. No DHR loop OPERABLE or in operation.	B.1 Suspend operations that would cause introduction into the RCS, coolant with boron concentration less than required to meet the boron concentration of LCO 3.9.1.	Immediately
	<u>AND</u>	
	B.2 Initiate action to restore one DHR loop to OPERABLE status and to operation.	Immediately
	<u>AND</u>	
	B.3 Close all reactor building penetrations providing direct access from the reactor building atmosphere to outside atmosphere.	4 hours

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.9.5.1	Verify one DHR loop is in operation.	12 hours
SR 3.9.5.2	Verify correct breaker alignment and indicated power available to each required DHR pump.	7 days

3.9 REFUELING OPERATIONS

3.9.6 Refueling Canal Water Level

LCO 3.9.6 Refueling canal water level shall be maintained ≥ 23 feet above the top of the irradiated fuel assemblies seated within the reactor pressure vessel.

APPLICABILITY: During movement of irradiated fuel assemblies within the reactor building.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. Refueling cavity water level not within limit.	A.1 Suspend movement of irradiated fuel assemblies within the reactor building.	Immediately

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.9.6.1 Verify refueling canal water level is ≥ 23 feet above the top of irradiated fuel assemblies seated within the reactor pressure vessel.	24 hours

4.0 DESIGN FEATURES

4.1 Site Location

The site for Arkansas Nuclear One is located in Pope County, Arkansas on the north bank of the Dardanelle Reservoir (Arkansas River), approximately 6 miles west-northwest of Russellville, AR. The exclusion area boundary shall have a radius of 0.65 statute miles from the Unit 1 reactor building.

4.0 DESIGN FEATURES

4.2 Reactor Core

4.2.1 Fuel Assemblies

The reactor shall contain 177 fuel assemblies. Each assembly shall consist of a matrix of Zircaloy clad fuel rods with an initial composition of natural or slightly enriched uranium dioxide (UO_2) as fuel material. Limited substitutions of stainless steel filler rods for fuel rods, in accordance with approved applications of fuel rod configurations, may be used. Fuel assemblies shall be limited to those fuel designs that have been analyzed with applicable NRC staff approved codes and methods, and shown by tests or analyses to comply with all fuel safety design bases. A limited number of lead test assemblies that have not completed representative testing may be placed in nonlimiting core regions.

4.2.2 Control Assemblies

The reactor core shall contain 60 safety and regulating CONTROL ROD assemblies and 8 APSR assemblies. The CONTROL ROD assembly control material shall be a silver-indium-cadmium alloy and the APSR assembly control material shall be an Inconel alloy, as approved by the NRC.

DESIGN FEATURES

4.3 Fuel Storage

4.3.1 Criticality

- 4.3.1.1 The spent fuel storage racks are designed and shall be maintained with:
- Fuel assemblies having a maximum U-235 enrichment of 4.1 weight percent;
 - $k_{\text{eff}} \leq 0.95$ if fully flooded with unborated water, which includes an allowance for uncertainties as described in Section 9.6.2.4.3 of the SAR;
 - A nominal 10.65 inch center to center distance between fuel assemblies placed in the storage racks;
 - New or partially spent fuel assemblies with a discharge burnup in the "acceptable range" of Figure 3.7.15-1 allowed unrestricted storage in either fuel storage rack Region 1 or Region 2; and
 - New or partially spent fuel assemblies with a discharge burnup in the "unacceptable range" of Figure 3.7.15-1 stored in Region 1, or in checkerboard configuration in Region 2.
- 4.3.1.2 The new fuel storage racks are designed and shall be maintained with:
- Fuel assemblies having a maximum U-235 enrichment of 4.1 weight percent;
 - $k_{\text{eff}} \leq 0.95$ under normal conditions, which includes an allowance for uncertainties as described in Section 9.6.2.4.3 of the SAR;
 - $k_{\text{eff}} \leq 0.98$ with optimum moderation, which includes an allowance for uncertainties as described in Section 9.6.2.4.3 of the SAR;
 - A nominal 21 inch center to center distance between fuel assemblies placed in the storage racks; and
 - Ten interior storage cells, as shown in Figure 4.3.1.2-1, precluded from use during fuel storage.

DESIGN FEATURES

4.3 Fuel Storage

4.3.2 Drainage

The spent fuel storage pool is designed and shall be maintained to prevent inadvertent draining of the pool below elevation 397 ft.

4.3.3 Capacity

The spent fuel storage pool is designed and shall be maintained with a storage capacity limited to no more than 968 fuel assemblies.

Figure 4.3.1.2-1
Fresh Fuel Storage Rack
Loading Pattern

<----NORTH

		NO			NO		
			NO	NO			
			NO	NO			
			NO	NO			
		NO			NO		

"NO" Indicates a location in which fuel loading is prohibited.

5.0 ADMINISTRATIVE CONTROLS

5.1 Responsibility

- 5.1.1 The ANO-1 plant manager shall be responsible for overall unit operation and shall delegate in writing the succession to this responsibility during his absence.
- 5.1.2 An individual with an active Senior Reactor Operator (SRO) license shall be designated as responsible for the control room command function while the unit is in MODE 1, 2, 3, or 4. With the unit not in MODES 1, 2, 3, or 4, an individual with an active SRO or Reactor Operator license shall be designated as responsible for the control room command function.
-

5.0 ADMINISTRATIVE CONTROLS

5.2 Organization

5.2.1 Onsite and Offsite Organizations

Onsite and offsite organizations shall be established for unit operation and corporate management, respectively. The onsite and offsite organizations shall include the positions for activities affecting safety of the nuclear power unit.

- a. Lines of authority, responsibility, and communication shall be defined and established throughout highest management levels, intermediate levels, and all operating organization positions. These relationships shall be documented and updated, as appropriate, in organization charts, functional descriptions of departmental responsibilities and relationships, and job descriptions for key personnel positions, or in equivalent forms of documentation. These requirements, including the unit specific titles of those personnel fulfilling the responsibilities of the positions delineated in these Technical Specifications, shall be documented in the Safety Analysis Report (SAR);
- b. The ANO-1 plant manager shall be responsible for overall safe operation of the unit and shall have control over those onsite activities necessary for safe operation and maintenance of the unit;
- c. A specified corporate executive shall have corporate responsibility for overall unit nuclear safety and shall take any measures needed to ensure acceptable performance of the staff in operating, maintaining, and providing technical support to the unit to ensure nuclear safety. The specified corporate executive shall be identified in the SAR; and
- d. The individuals who train the operating staff, carry out health physics, or perform quality assurance functions may report to the appropriate onsite manager; however, these individuals shall have sufficient organizational freedom to ensure their independence from operating pressures.

5.2.2 Unit Staff

- a. A non-licensed operator shall be on site when fuel is in the reactor and an additional non-licensed operator shall be on site when the reactor is in MODES 1, 2, 3, or 4.
- b. The minimum shift crew composition for licensed operators shall meet the minimum staffing requirements of 10 CFR 50.54(m)(2)(i) for one unit, one control room.

5.0 ADMINISTRATIVE CONTROLS

5.2 Organization

- c. Shift crew composition may be less than the minimum requirement of 10 CFR 50.54(m)(2)(i) for one unit, one control room, and 5.2.2.a and 5.2.2.g for a period of time not to exceed 2 hours in order to accommodate unexpected absence of on-duty shift crew members provided immediate action is taken to restore the shift crew composition to within the minimum requirements.
 - d. An individual qualified in radiation protection procedures shall be on site when fuel is in the reactor. The position may be vacant for not more than 2 hours, in order to provide for unexpected absence, provided immediate action is taken to fill the required position.
 - e. The amount of overtime worked by unit staff members performing safety related functions shall be limited and controlled in accordance with the NRC Policy Statement on working hours (Generic Letter 82-12).
 - f. The operations manager or assistant operations manager shall hold an SRO license.
 - g. In MODES 1, 2, 3, or 4, an individual shall provide advisory technical support for the operations shift crew in the areas of thermal hydraulics, reactor engineering, and plant analysis with regard to the safe operation of the unit. This individual shall meet the qualifications specified by the Commission Policy Statement on Engineering Expertise on Shift.
-

5.0 ADMINISTRATIVE CONTROLS

5.3 Unit Staff Qualifications

- 5.3.1 Each member of the unit staff shall meet or exceed the minimum qualifications of ANSI ANS 3.1 - 1978 for comparable positions, except for the designated radiation protection manager, who shall meet or exceed the minimum qualifications of Regulatory Guide 1.8, September 1975.
-

5.0 ADMINISTRATIVE CONTROLS

5.4 Procedures

- 5.4.1 Written procedures shall be established, implemented, and maintained covering the following activities:
- a. The applicable procedures recommended in Regulatory Guide 1.33, Revision 2, Appendix A, February 1978;
 - b. The emergency operating procedures required to implement the requirements of NUREG-0737 and NUREG-0737, Supplement 1, as stated in Section 7.1 of Generic Letter 82-33;
 - c. Fire Protection Program implementation; and
 - d. All programs specified in Specification 5.5.
-

5.0 ADMINISTRATIVE CONTROLS

5.5 Programs and Manuals

The following programs shall be established, implemented, and maintained.

5.5.1 Offsite Dose Calculation Manual (ODCM)

The ODCM shall contain the methodology and parameters used in the calculation of offsite doses resulting from radioactive gaseous and liquid effluents, in the calculation of gaseous and liquid effluent monitoring alarm and trip setpoints, and in the conduct of the radiological environmental monitoring program; and

The ODCM shall also contain the radioactive effluent controls and radiological environmental monitoring activities, and descriptions of the information that should be included in the Annual Radiological Environmental Operating and Radioactive Effluent Release Reports.

Licensee initiated changes to the ODCM:

- a. Shall be documented and records of reviews performed shall be retained. This documentation shall contain:
 1. sufficient information to support the change(s) together with the appropriate analyses or evaluations justifying the change(s), and
 2. a determination that the change(s) maintain the levels of radioactive effluent control required by 10 CFR 20.1302, 40 CFR 190, 10 CFR 50.36a, and 10 CFR 50, Appendix I, and not adversely impact the accuracy or reliability of effluent, dose, or setpoint calculations;
- b. Shall become effective after the approval of the ANO general manager, and
- c. Shall be submitted to the NRC in the form of a complete, legible copy of the entire ODCM as a part of or concurrent with the Radioactive Effluent Release Report for the period of the report in which any change in the ODCM was made effective. Each change shall be identified by markings in the margin of the affected pages, clearly indicating the area of the page that was changed, and shall indicate the date (i.e., month and year) the change was implemented.

5.0 ADMINISTRATIVE CONTROLS

5.5 Programs and Manuals

5.5.2 Primary Coolant Sources Outside Containment

This program provides controls to minimize leakage from those portions of systems outside containment that could contain highly radioactive fluids during a serious transient or accident to levels as low as practicable. The program shall include the following:

- a. Preventive maintenance and periodic visual inspection requirements; and
- b. Integrated leak test requirements for each system at least once per 18 months. The provisions of SR 3.0.2 are applicable.

5.5.3 Post Accident Sampling

This program provides controls that ensure the capability to obtain and analyze reactor coolant, radioactive iodine, and particulates in plant gaseous effluents and containment atmosphere samples under accident conditions. The program shall include the following:

- a. Training of personnel;
- b. Procedures for sampling and analysis; and
- c. Provisions for maintenance of sampling and analysis equipment.

5.5.4 Radioactive Effluent Controls Program

This program conforms to 10 CFR 50.36a for the control of radioactive effluents and for maintaining the doses to members of the public from radioactive effluents as low as reasonably achievable. The program shall be contained in the ODCM, shall be implemented by procedures, and shall include remedial actions to be taken whenever the program limits are exceeded. The program shall include the following elements:

- a. Limitations on the functional capability of radioactive liquid and gaseous monitoring instrumentation including surveillance tests and setpoint determination in accordance with the methodology in the ODCM;
- b. Limitations on the concentrations of radioactive material released in liquid effluents to unrestricted areas, conforming to ten times the concentration values in Appendix B, Table 2, Column 2, to 10 CFR 20.1001 – 20.2402;

5.0 ADMINISTRATIVE CONTROLS

5.5 Programs and Manuals

- c. Monitoring, sampling, and analysis of radioactive liquid and gaseous effluents in accordance with 10 CFR 20.1302 and with the methodology and parameters in the ODCM;
- d. Limitations on the annual and quarterly doses or dose commitment to a member of the public from radioactive materials in liquid effluents released from each unit to unrestricted areas, conforming to 10 CFR 50, Appendix I;
- e. Determination of cumulative dose contributions from radioactive effluents for the current calendar quarter and current calendar year in accordance with the methodology and parameters in the ODCM at least every 31 days. Determination of projected dose contributions from radioactive effluents in accordance with the methodology in the ODCM at least every 31 days;
- f. Limitations on the functional capability and use of the liquid and gaseous effluent treatment systems to ensure that appropriate portions of these systems are used to reduce releases of radioactivity when the projected doses in a period of 31 days would exceed 2% of the guidelines for the annual dose or dose commitment, conforming to 10 CFR 50, Appendix I;
- g. Limitations on the dose rate resulting from radioactive material released in gaseous effluents from the site to areas at or beyond the site boundary shall be in accordance with the following:
 - 1. For noble gases: a dose rate ≤ 500 mrem/yr to the whole body and a dose rate ≤ 3000 mrem/yr to the skin, and
 - 2. For iodine-131, iodine-133, tritium, and all radionuclides in particulate form with half-lives greater than 8 days: a dose rate ≤ 1500 mrem/yr to any organ;
- h. Limitations on the annual and quarterly air doses resulting from noble gases released in gaseous effluents from each unit to areas beyond the site boundary, conforming to 10 CFR 50, Appendix I;
- i. Limitations on the annual and quarterly doses to a member of the public from iodine-131, iodine-133, tritium, and all radionuclides in particulate form with half lives > 8 days in gaseous effluents released from each unit to areas beyond the site boundary, conforming to 10 CFR 50, Appendix I; and
- j. Limitations on the annual dose or dose commitment to any member of the public beyond the site boundary due to releases of radioactivity and to radiation from uranium fuel cycle sources, conforming to 40 CFR 190.

The provisions of SR 3.0.2 and SR 3.0.3 are applicable to the Radioactive Effluent Controls Program surveillance frequency.

5.0 ADMINISTRATIVE CONTROLS

5.5 Programs and Manuals

5.5.5 (Not Used).

5.5.6 (Not Used).

5.5.7 Reactor Coolant Pump Flywheel Inspection Program

This program shall provide for the inspection of each reactor coolant pump flywheel. Surface and volumetric examination of the reactor coolant pump flywheels will be conducted coincident with refueling or maintenance shutdowns such that during 10 year intervals all four reactor coolant pump flywheels will be examined. Such examinations will be performed to the extent possible through the access ports, i.e., those areas of the flywheel accessible without motor disassembly. The surface and volumetric examination may be accomplished by Acoustic Emission Examination as an initial examination method. Should the results of the Acoustic Emission Examination indicate that additional examination is necessary to ensure the structural integrity of the flywheel, then other appropriate NDE methods will be performed on the area of concern.

The provisions of SR 3.0.2 and SR 3.0.3 are applicable to the Reactor Coolant Pump Flywheel Inspection Program inspection frequencies.

5.0 ADMINISTRATIVE CONTROLS

5.5 Programs and Manuals

5.5.8 Inservice Testing Program

This program provides controls for inservice testing of ASME Code Class 1, 2, and 3 components. The program shall include the following:

- a. Testing frequencies specified in Section XI of the ASME Boiler and Pressure Vessel Code and applicable Addenda as follows:

<u>ASME Code terminology for inservice testing activities</u>	<u>Required Frequencies for performing inservice testing activities</u>
Monthly	At least once per 31 days
Every 6 weeks	At least once per 42 days
Quarterly or every 3 months	At least once per 92 days
Semiannually or every 6 months	At least once per 184 days
Every 9 months	At least once per 276 days
Yearly or annually	At least once per 366 days
Biennially or every 2 years	At least once per 731 days

- b. The provisions of SR 3.0.2 are applicable to the above required Frequencies for performing inservice testing activities;
- c. The provisions of SR 3.0.3 are applicable to inservice testing activities; and
- d. Nothing in the ASME Boiler and Pressure Vessel Code shall be construed to supersede the requirements of any TS.

5.5.9 Steam Generator (SG) Tube Surveillance Program

This program provides controls to ensure integrity of the steam generator tubing through a defined inservice surveillance program, and to minimize exposure of personnel to radiation during performance of the surveillance program.

The provisions of SR 3.0.2 and SR 3.0.3 are applicable to the SG Tube Surveillance Program inspection frequencies.

- a. The first steam generator tubing inspection performed in accordance with 5.5.9.b and 5.5.9.c.1 shall be considered as constituting the baseline condition for subsequent inspections.

5.0 ADMINISTRATIVE CONTROLS

5.5 Programs and Manuals

b. Examination Methods:

1. Inservice inspection of steam generator tubing shall include non-destructive examination by eddy-current testing or other equivalent techniques. The inspection equipment shall provide a sensitivity that will detect defects with a penetration of 20 percent or more of the minimum allowable as-manufactured tube wall thickness except for a sleeved tube at the lower sleeve end.
2. For examination of the sleeved steam generator tubing at the lower sleeve end, the indications will be compared to those obtained during the baseline sleeved tube inspection. Significant deviations between these indications will be considered sufficient evidence to warrant designation as a degraded tube. Direct quantification of the 40 percent through-wall plugging limit is available with eddy-current testing.

c. Selection and Testing:

The steam generator sample size is specified in Table 5.5.9-1. The steam generator tube minimum sample size, inspection result classification, and the corresponding action required shall be as specified in Table 5.5.9-2. The inservice inspection of steam generator tubes shall be performed at the frequencies as specified in 5.5.9.d and the inspected tubes shall be verified acceptable per the acceptance criteria of 5.5.9.e. The tubes selected for each inservice inspection shall include at least 3% of the total number of tubes in both steam generators; the tubes selected for these inspections shall be selected on a random basis except:

1. The first sample inspection during each inservice inspection (subsequent to the baseline inspection) of each steam generator shall include:
 - i. All nonplugged tubes that previously had detectable wall penetrations (>20%), except tubes in which the wall penetration has been spanned by a sleeve, and
 - ii. At least 50% of the tubes inspected shall be in those areas where experience has indicated potential problems, except where specific groups are inspected per 5.5.9.c.1.iii.

A tube inspection (pursuant to 5.5.9.e.1.ix) shall be performed on each selected tube. If any selected tube does not permit the passage of the eddy current probe for a tube inspection, this shall be recorded and an adjacent tube shall be selected and subjected to a tube inspection.

5.0 ADMINISTRATIVE CONTROLS

5.5 Programs and Manuals

- iii. Tubes in the following groups may be excluded from the first random sample if all tubes in a group in both steam generators are inspected. The inspection may be concentrated on those portions of the tubes where imperfections were previously found. No credit will be taken for these tubes in meeting minimum sample size requirements. Where only a portion of the tube is inspected, the remainder of the tube will be subjected to the random inspection.
 - (1) Group A-1: Tubes within one, two or three rows of the open inspection lane.
 - (2) Group A-2: Unplugged tubes with sleeves installed.
 - (3) Group A-3: Tubes in the wedge-shaped group on either side of the lane region (Group A-1) as defined by Figure 5.5.9-1.
 - iv. Tubes with axially-oriented tube end cracks (TEC) which have been left inservice for the previous cycle shall be inspected with a rotating coil eddy current technique in the area of the TEC and characterized in accordance with topical report BAW-2346P, Rev.0, during all subsequent SG inspection intervals pursuant to 5.5.9.d. The results of this examination may be excluded from the first random sample. Tubes with axial TECs identified during previous inspections, which meet the criteria to remain in service, will not be included when calculating the inspection category of the OTSG.
 - v. Implementation of the upper tubesheet ODIGA alternate repair criteria requires a 100% bobbin coil inspection of the non-plugged and non-sleeved tubes, spanning the defined region of the upper tubesheet, during all subsequent SG inspection intervals pursuant to 5.5.9.d. Tubes with ODIGA identified during previous inspections, which meet the criteria to remain in service, will not be included when calculating the inspection category for the OTSG. The defined region begins one inch above the upper tubesheet secondary face and ends at the nearest tube roll transition. ODIGA indications detected by the bobbin coil probe shall be characterized using rotating coil probes in accordance with ANO Engineering Report No. 00-R-1005-01.
2. All tubes which have been repaired using the reroll process will have the new roll area inspected during the inservice inspection.

5.0 ADMINISTRATIVE CONTROLS

5.5 Programs and Manuals

3. The second and third sample inspections during each inservice inspection as required by Table 5.5.9-2 may be less than a full tube inspection by concentrating the inspection on those areas of the tube sheet array and on those portions of the tubes where tubes with imperfections were previously found.
4. The results of each sample inspection shall be classified into one of the following three categories:

<u>Category</u>	<u>Inspection Results</u>
C-1	Less than 5% of the total tubes inspected are degraded tubes and none of the inspected tubes are defective.
C-2	One or more tubes, but not more than 1% of the total tubes inspected, are defective, or between 5% and 10% of the total tubes inspected are degraded tubes.
C-3	More than 10% of the total tubes inspected are degraded tubes or more than 1% of the inspected tubes are defective.

NOTES:

- (1) In all inspections, previously degraded tubes whose degradations have not been spanned by a sleeve must exhibit significant (>10%) further wall penetrations to be included in the above percentage calculations.
- (2) Where special inspections are performed pursuant to 5.5.9.c.1.iii, defective or degraded tubes found as a result of the inspection shall be included in determining the Inspection Results Category for that special inspection but need not be included in determining the Inspection Results Category for the general steam generator inspection.
- (3) Where special inspections are performed pursuant to 5.5.9.c.2, defective or degraded tube indications found in the new roll area as a result of the inspection and any indications found above the new roll area, are not included in the determination for the inspection results category of a general steam generator inspection.

5.0 ADMINISTRATIVE CONTROLS

5.5 Programs and Manuals

- d. The above-required inservice inspections of steam generator tubes shall be performed at the following frequencies:
1. The baseline inspection shall be performed during the first refueling shutdown. Subsequent inservice inspections shall be performed at intervals of not less than 10 nor more than 24 calendar months after the previous inspection. If the results of two consecutive inspections for a given group^{*} of tubes following service under all volatile treatment (AVT) conditions fall into the C-1 category or if two consecutive inspections demonstrate that previously observed degradation has not continued and no additional degradation has occurred, the inspection interval for that group may be extended to a maximum of 40 months.
 2. If the results of the inservice inspection of a steam generator performed in accordance with Table 5.5.9-2 at 40-month intervals for a given group^{*} of tubes fall in Category C-3, subsequent inservice inspections shall be performed at intervals of not less than 10 nor more than 20 calendar months after the previous inspection. The increase in inspection frequency shall apply until a subsequent inspection meets the conditions specified in 5.5.9.d.1 and the interval can be extended to 40 months.
 3. Additional unscheduled inservice inspections shall be performed on each steam generator in accordance with the first sample inspection specified in Table 5.5.9-2 during the shutdown subsequent to any of the following conditions:
 - i. Primary-to-secondary leakage in excess of the limits of Specification 3.4.13 (inservice inspection not required if leaks originate from tube-to-tubesheet welds). If the leaking tube is from either Group A-1 or A-3 as defined in Specification 5.5.9.c.1.iii, all of the tubes in the affected group in this steam generator may be inspected in lieu of the first sample inspection specified in Table 5.5.9-2. If the degradation mechanism which caused the leak is limited to a specific portion of the tube length, the inspection per this paragraph may be limited to the affected portion of the tube length. If the results of this inspection fall into the C-3 category, all of the tubes in the same group in the other steam generator will also be similarly inspected.

^{*}A group of tubes means:

(a)	All tubes inspected pursuant to 5.5.9.c.1.iii, or
(b)	All tubes in a steam generator less those inspected pursuant to 5.5.9.c.1.iii.

5.0 ADMINISTRATIVE CONTROLS

5.5 Programs and Manuals

If the leaking tube has been repaired by the reroll process and is leaking in the new roll area, all of the tubes in the steam generator that have been repaired by the reroll process will have the new roll area inspected. If the results of this inspection fall into the C-3 category, all of the tubes with rerolled areas in the other steam generator will also be similarly inspected. This inspection will be in lieu of the first sample inspection specified in Table 5.5.9-2.

- ii. A seismic occurrence greater than the Operating Basis Earthquake,
- iii. A loss-of-coolant accident requiring actuation of the engineered safeguards, or
- iv. A main steam line or feedwater line break.

e. Acceptance Criteria:

1. Terms as used in this program:

- i. Tubing or Tube means that portion of the tube or sleeve which forms the primary system to secondary system pressure boundary.
- ii. Imperfection means an exception to the dimensions, finish or contour of a tube from that required by fabrication drawings or specifications. Eddy current testing indications below 20% of the nominal tube wall thickness, if detectable, may be considered as imperfections.
- iii. Degradation means a service-induced cracking, wastage, wear or general corrosion occurring on either the inside or outside of a tube.
- iv. Degraded Tube means a tube containing imperfections $\geq 20\%$ of the nominal wall thickness caused by degradation, except where all degradation has been spanned by the installation of a sleeve or repaired by a rerolled joint.

The reroll repair process will be used to repair tubes with defects in the upper and lower tubesheet areas as described in topical report, BAW-2303P, Revision 4.

- v. % Degradation means the percentage of the tube wall thickness affected or removed by degradation.

5.0 ADMINISTRATIVE CONTROLS

5.5 Programs and Manuals

- vi. Defect means an imperfection of such severity that it exceeds the plugging limit except where the imperfection has been spanned by the installation of a sleeve. A tube containing a defect in its pressure boundary is defective.
- vii. Plugging Limit means the imperfection depth at or beyond 40% of the nominal tube wall thickness for which the tube shall be sleeved, rerolled, or removed from service because it may become unserviceable prior to the next inspection. This does not apply to ODIGA indications within the defined region of the upper tubesheet. These indications shall be assessed for continued plant operation in accordance with ANO Engineering Report No. 00-R-1005-01, Rev. 1.

Axially-oriented TEC indications in the tube that do not extend beyond the adjacent cladding portion of the tube sheet into the carbon steel portion are not included in this definition. These indications shall be assessed for continued plant operation in accordance with topical report BAW-2346P, Rev. 0.

- viii. Unserviceable describes the condition of a tube if it leaks or contains a defect large enough to affect its structural integrity in the event of an Operating Basis Earthquake, a loss-of-coolant accident, or a steam line or feedwater line break as specified in 5.5.9.d.3.
 - ix. Tube Inspection means an inspection of the steam generator tube from the point of entry completely to the point of exit. For tubes that have been repaired by the reroll process within the tubesheets, that portion of the tube outboard of the new roll can be excluded from future periodic inspection requirements because it is no longer part of the pressure boundary once the repair roll is installed.
2. The steam generator shall be determined OPERABLE after completing the corresponding actions (plug, reroll, or sleeve all tubes exceeding the plugging limit and all tubes containing non-TEC through-wall cracks) required by Table 5.5.9-2.

5.0 ADMINISTRATIVE CONTROLS

5.5 Programs and Manuals

TABLE 5.5.9-1
MINIMUM NUMBER OF STEAM GENERATORS TO BE INSPECTED DURING INSERVICE
INSPECTION

Preservice Inspection	No
No. of Steam Generators per Unit	Two
First Inservice Inspection	Two
Second & Subsequent Inservice Inspection	One ¹

Table Notation:

- ¹ The inservice inspection may be limited to one steam generator on alternating schedule encompassing 3N% of the tubes (where N is the number of steam generators in the plant) if the results of the first or previous inspections indicate that all steam generators are performing in a like manner. Note that under some circumstances, the operating conditions in one or more steam generators may be found to be more severe than those in other steam generators. Under such circumstances the sample sequence shall be modified to inspect the most severe conditions.

5.0 ADMINISTRATIVE CONTROLS

5.5 Programs and Manuals

TABLE 5.5.9-2
STEAM GENERATOR TUBE INSPECTION ^{2,3}

1ST SAMPLE INSPECTION			2 ND SAMPLE INSPECTION		3RD SAMPLE INSPECTION	
Sample Size	Result	Action Required	Result	Action Required	Result	Action Required
A minimum of S Tubes per S.G. ¹	C-1	None	N/A	N/A	N/A	N/A
	C-2	Plug, reroll, or sleeve defective tubes and inspect additional 2S tubes in this S.G.	C-1	None	N/A	N/A
			C-2	Plug, reroll, or sleeve Defective tubes and inspect additional 4S tubes in this S.G.	C-1	None
			C-3	Perform action for C-3 result of first sample	C-2	Plug, reroll, or sleeve defective tubes
	C-3	Inspect all tubes in this S.G. plug, reroll, or sleeve defective tubes and inspect 2S tubes in other S.G.	C-3	Perform action for C-3 result of first sample	C-3	Perform action for C-3 result of first sample
			Other S.G. is C-1	None	N/A	N/A
			Other S.G. is C-2	Perform action for C-2 result of second sample	N/A	N/A
			Other S.G. is C-3	Inspect all tubes in each S.G. and plug, reroll, or sleeve defective tubes.	N/A	N/A

NOTES:

¹ $S = \frac{3N}{n} \%$ Where N is the number of steam generators in the unit, and n is the number of steam generators inspected during an inspection.

² For tubes inspected pursuant to 5.5.9.c.1.iii: No action is required for C-1 results. For C-2 results in one or both steam generators plug, reroll, or sleeve defective tubes. For C-3 results in one or both steam generators, plug, reroll, or sleeve defective tubes and provide a report to NRC pursuant to 5.6.7.


³ No more than ten thousand (10,000) sleeves may be installed in both ANO-1 steam generators combined.

5.0 ADMINISTRATIVE CONTROLS

5.5 Programs and Manuals

FIGURE 5.5.9-1

Upper Tube Sheet View of Wedge Shaped Group (Group A-3) per 5.5.9.c.1.iii

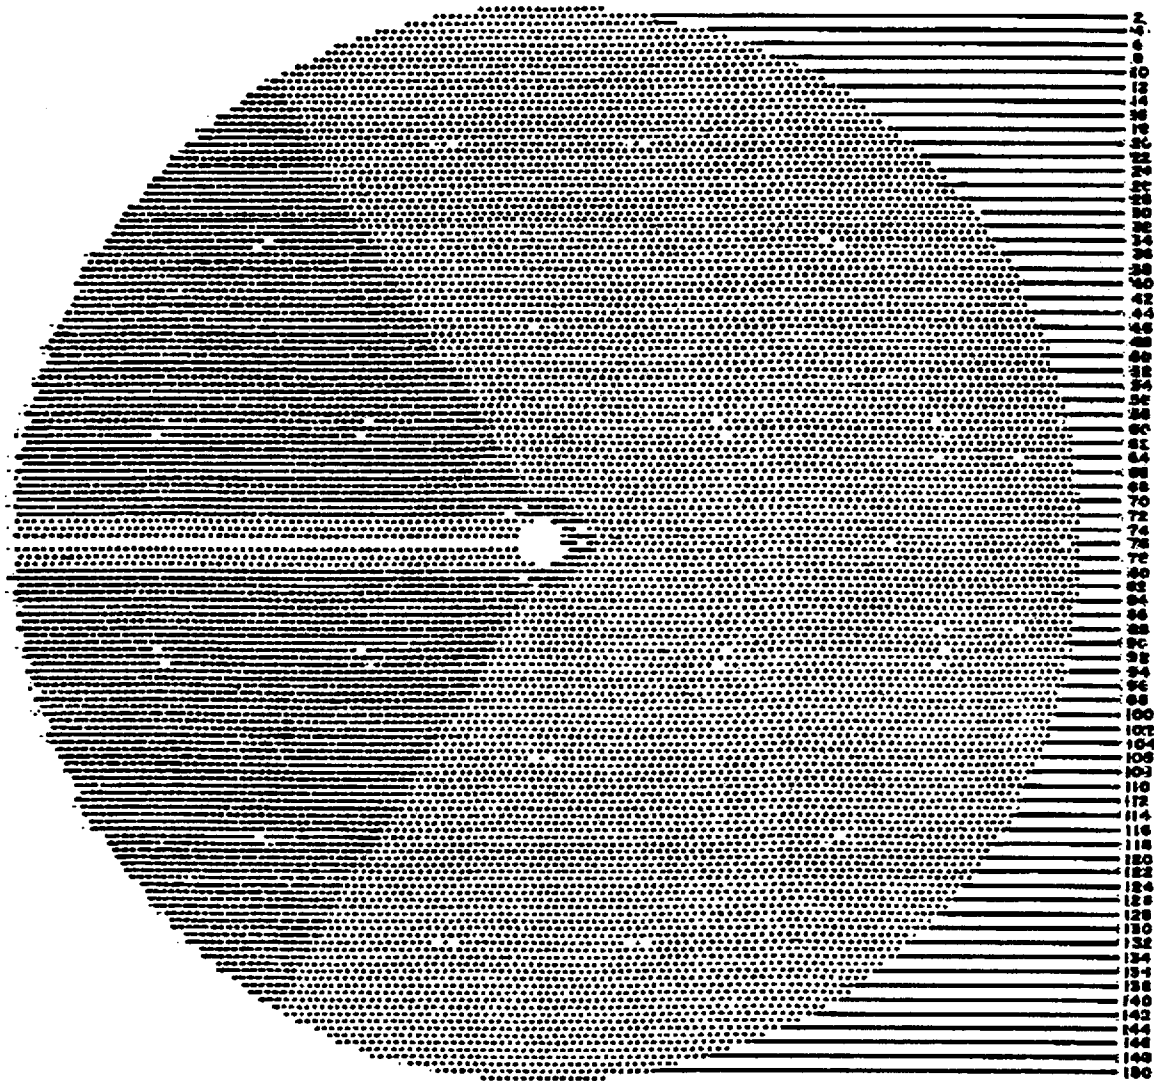

<u>DESCRIPTION</u>	<u>TUBE COUNT</u>
Group A-1: Lane region tubes as defined in 5.5.9.c.1.iii(1)	382
Group A-3: Wedge shaped group depicted by darkened region of figure	4880

5.0 ADMINISTRATIVE CONTROLS

5.5 Programs and Manuals

5.5.10 Secondary Water Chemistry

This program provides controls for monitoring secondary water chemistry to inhibit SG tube degradation. The program shall include:

- a. Identification of a sampling schedule for the critical variables and control points for these variables;
- b. Identification of the procedures used to measure the values of the critical variables;
- c. Identification of process sampling points;
- d. Procedures for the recording and management of data;
- e. Procedures defining corrective actions for all off control point chemistry conditions; and
- f. A procedure identifying the authority responsible for the interpretation of the data and the sequence and timing of administrative events required to initiate corrective action.

5.5.11 Ventilation Filter Testing Program (VFTP)

A program shall be established to implement the following required testing of Engineered Safeguards (ES) ventilation systems filters at the frequencies specified in Regulatory Guide 1.52, Revision 2. The VFTP is applicable to the Penetration Room Ventilation System (PRVS), the Fuel Handling Area Ventilation System (FHAVS), and the Control Room Emergency Ventilation System (CREVS).

- a. Demonstrate that an inplace cold DOP test of the high efficiency particulate (HEPA) filters shows:
 1. $\geq 99\%$ DOP removal for the PRVS when tested at the system design flowrate of $1800 \text{ scfm} \pm 10\%$ and the FHAVS when tested at the system design flowrate of $39000 \text{ cfm} \pm 10\%$; and
 2. $\geq 99.95\%$ DOP removal for the CREVS when tested in accordance with Regulatory Guide 1.52, Revision 2, at the system design flowrate of $2000 \text{ cfm} \pm 10\%$.

5.0 ADMINISTRATIVE CONTROLS

5.5 Programs and Manuals

- b. Demonstrate that an inplace halogenated hydrocarbon test of the charcoal adsorbers shows:
 - 1. $\geq 99\%$ halogenated hydrocarbon removal for the PRVS when tested at the system design flowrate of $1800 \text{ cfm} \pm 10\%$ and FHAVS when tested at the system design flowrate of $39000 \text{ cfm} \pm 10\%$; and
 - 2. $\geq 99.95\%$ halogenated hydrocarbon removal for the CREVS when tested in accordance with Regulatory Guide 1.52, Revision 2, at the system design flowrate of $2000 \text{ cfm} \pm 10\%$.
- c. Demonstrate that a laboratory test of a sample of the charcoal adsorber meets the laboratory testing criteria of ASTM D3803-1989 when tested at 30°C and 95% relative humidity for a methyl iodide penetration of:
 - 1. $< 5\%$ for the PRVS;
 - 2. $< 5\%$ for the FHAVS; and
 - 3. when obtained as described in Regulatory Guide 1.52, Revision 2, for CREVS
 - i. $\leq 2.5\%$ for 2 inch charcoal adsorber beds; and
 - ii. $\leq 0.5\%$ for 4 inch charcoal adsorber beds.
- d. Demonstrate for the PRVS, FHAVS, and CREVS, that the pressure drop across the combined HEPA filters, other filters in the system, and the charcoal adsorbers is < 6 inches of water when tested at the following system design flowrates $\pm 10\%$:

PRVS	1800 cfm
FHAVS	39000 cfm
CREVS	2000 cfm

The provisions of SR 3.0.2 and SR 3.0.3 are applicable to the VFTP test frequencies.

5.0 ADMINISTRATIVE CONTROLS

5.5 Programs and Manuals

5.5.12 Explosive Gas and Storage Tank Radioactivity Monitoring Program

This program provides controls for potentially explosive gas mixtures contained in the Waste Gas System, the quantity of radioactivity contained in gas storage tanks, and the quantity of radioactivity contained in unprotected temporary outdoor liquid storage tanks. The gaseous radioactivity quantities shall be determined following the methodology in Branch Technical Position (BTP) ETSB 11-5, "Postulated Radioactive Release due to Waste Gas System Leak or Failure." The liquid radwaste quantities shall be determined in accordance with the ODCM.

The program shall include:

- a. The limits for concentrations of hydrogen and oxygen in the Waste Gas System and a surveillance program to ensure the limits are maintained. Such limits shall be appropriate to the system's design criteria (i.e., whether or not the system is designed to withstand a hydrogen explosion);
- b. A surveillance program to ensure that the quantity of radioactivity contained in each gas storage tank is less than the amount that would result in a whole body exposure of ≥ 0.5 rem to any individual in an unrestricted area, in the event of an uncontrolled release of the tanks' contents;
- c. A surveillance program to ensure that the quantity of radioactivity contained in all temporary outdoor liquid radwaste tanks: 1) that are not surrounded by liners, dikes, or walls, capable of holding the tanks' contents; and 2) that do not have tank overflows and surrounding area drains connected to the Liquid Radwaste Treatment System is less than the amount that would result in concentrations equal to the limits of 10 CFR 20, Appendix B, Table 2, Column 2, at the nearest potable water supply and the nearest surface water supply in an unrestricted area, in the event of an uncontrolled release of the tanks' contents.

The provisions of SR 3.0.2 and SR 3.0.3 are applicable to the Explosive Gas and Storage Tank Radioactivity Monitoring Program surveillance frequencies.

5.5.13 Diesel Fuel Oil Testing Program

A diesel fuel oil testing program to implement required testing of both new fuel oil and stored fuel oil shall be established. The program shall include sampling and testing requirements, and acceptance criteria, all in accordance with applicable ASTM Standards. The purpose of the program is to establish the following:

- a. Acceptability of new fuel oil for use prior to addition to storage tanks by determining that the fuel oil has:

5.0 ADMINISTRATIVE CONTROLS

5.5 Programs and Manuals

1. an API gravity or an absolute specific gravity within limits,
 2. a flash point and kinematic viscosity within limits for ASTM 2D fuel oil, and
 3. water and sediment within limits;
- b. Within 31 days following addition of new fuel oil to storage tanks, verify that the properties of the new fuel oil, other than those addressed in a. above, are within limits for ASTM 2D fuel oil;
 - c. Total particulate concentration of the fuel oil is ≤ 10 mg/l when tested every 31 days based on ASTM D-2276, Method A-2 or A-3; and
 - d. The provisions of SR 3.0.2 and SR 3.0.3 are applicable to the Diesel Fuel Oil Testing Program surveillance Frequencies.

5.5.14 Technical Specifications (TS) Bases Control Program

This program provides a means for processing changes to the Bases of these Technical Specifications.

- a. Changes to the Bases of the TS shall be made under appropriate administrative controls and reviews.
- b. Licensees may make changes to Bases without prior NRC approval provided the changes do not involve either of the following:
 1. A change in the TS incorporated in the license; or
 2. A change to the updated SAR or Bases that requires NRC approval pursuant to 10 CFR 50.59.

Proposed changes that do not meet these criteria shall be reviewed and approved by the NRC prior to implementation. Changes to the Bases implemented without prior NRC approval shall be provided to the NRC on a frequency consistent with 10 CFR 50.71(e).

- c. The Bases Control Program shall contain provisions to ensure that the Bases are maintained consistent with the SAR.

5.0 ADMINISTRATIVE CONTROLS

5.5 Programs and Manuals

5.5.15 Safety Function Determination Program (SFDP)

This program ensures loss of safety function is detected and appropriate actions taken. Upon entry into LCO 3.0.6, an evaluation shall be made to determine if loss of safety function exists. Additionally, other appropriate limitations and remedial or compensatory actions may be identified to be taken as a result of the support system inoperability and corresponding exception to entering supported system Condition and Required Actions. This program implements the requirements of LCO 3.0.6. The SFDP shall contain the following:

- a. Provisions for cross train checks to ensure a loss of the capability to perform the safety function assumed in the accident analysis does not go undetected;
- b. Provisions for ensuring the plant is maintained in a safe condition if a loss of function condition exists;
- c. Provisions to ensure that an inoperable supported system's Completion Time is not inappropriately extended as a result of multiple support system inoperabilities; and
- d. Other appropriate limitations and remedial or compensatory actions.

A loss of safety function exists when, assuming no concurrent single failure, and assuming no concurrent loss of offsite power or loss of onsite diesel generator(s), a safety function assumed in the accident analysis cannot be performed. For the purpose of this program, a loss of safety function may exist when a support system is inoperable, and:

- a. A required system redundant to the system(s) supported by the inoperable support system is also inoperable; or
- b. A required system redundant to the system(s) in turn supported by the inoperable supported system is also inoperable; or
- c. A required system redundant to the support system(s) for the supported systems (a) and (b) above is also inoperable.

The SFDP identifies where a loss of safety function exists. If a loss of safety function is determined to exist by this program, the appropriate Conditions and Required Actions of the LCO in which the loss of safety function exists are required to be entered.

5.0 ADMINISTRATIVE CONTROLS

5.5 Programs and Manuals

5.5.16 Reactor Building Leakage Rate Testing Program

A program shall be established to implement the leakage rate testing of the reactor building as required by 10 CFR 50.54(o) and 10 CFR 50, Appendix J, Option B, as modified by approved exemptions. This program shall be in accordance with the guidelines contained in Regulatory Guide 1.163, "Performance-Based Containment Leak-Test Program," dated September 1995.

In addition, the reactor building purge supply and exhaust isolation valves shall be leakage rate tested once prior to entering MODE 4 from MODE 5 if not performed within the previous 92 days.

The peak calculated reactor building internal pressure for the design basis loss of coolant accident, P_a , is 54 psig.

The maximum allowable reactor building leakage rate, L_a , shall be 0.20% of containment air weight per day at P_a .

Reactor Building leakage rate acceptance criteria is $\leq 1.0L_a$. During the first unit startup following each test performed in accordance with this program, the leakage rate acceptance criteria are $< 0.60L_a$ for the Type B and Type C tests and $< 0.75L_a$ for Type A tests.

The provisions of SR 3.0.2 do not apply to the test frequencies specified in the Reactor Building Leakage Rate Testing Program.

The provisions of SR 3.0.3 are applicable to the Reactor Building Leakage Rate Testing Program.
