




CONTAINMENT PURGE SYSTEM

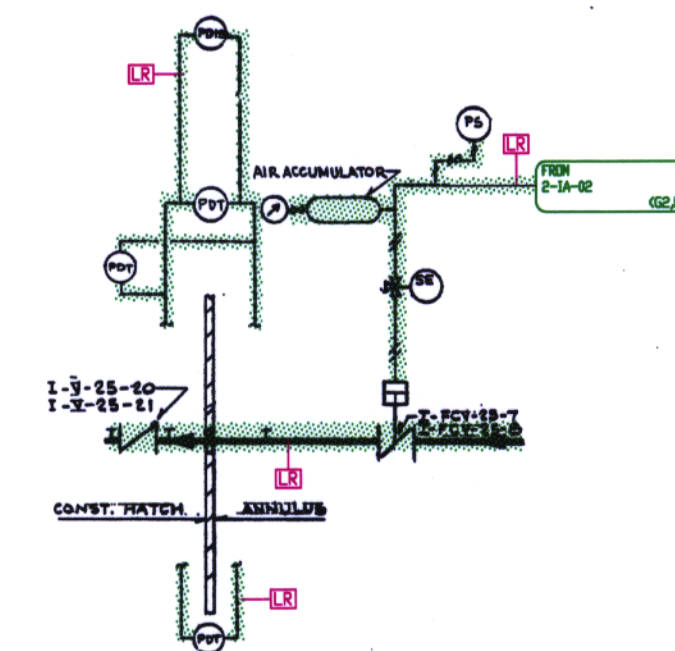

CONTAINMENT VACUUM RELIEF

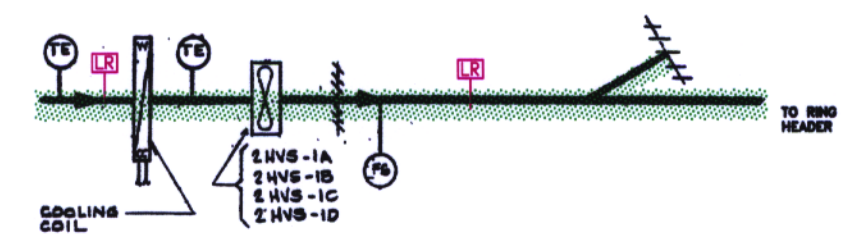

CONTAINMENT COOLING

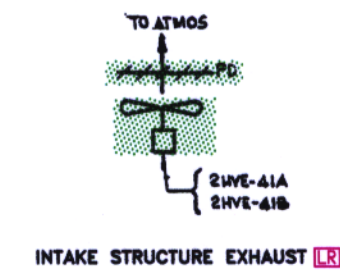

INTAKE STRUCTURE EXHAUST

NOTES:
1. FOR GENERAL NOTES & LEGEND SEE DRAWING NO. 2-NOTES-01.

FLORIDA POWER & LIGHT ST. LUCIE NUCLEAR UNIT 2	
CONTAINMENT & MISCELLANEOUS HVAC	
LICENSE RENEWAL BOUNDARY DRAWING	REVISION
DRAWING NUMBER 2-HVAC-01	0

D-050