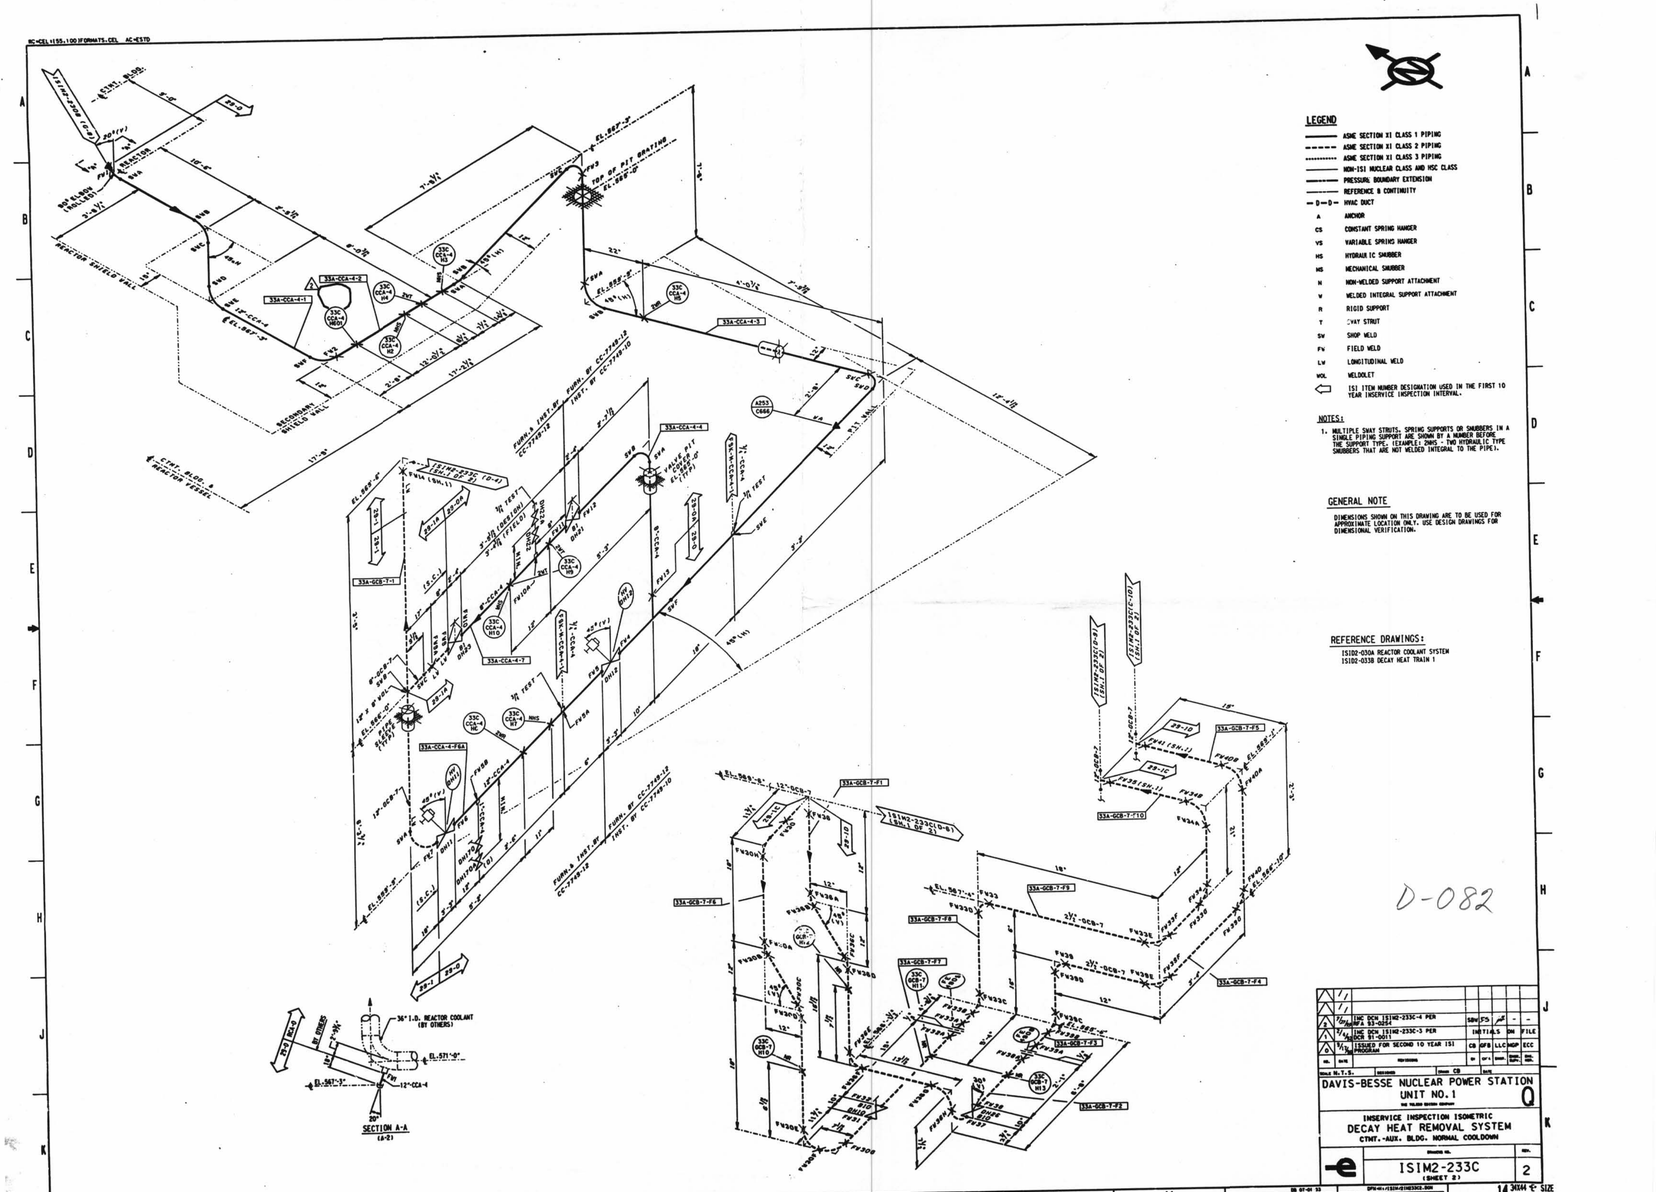
LEGEND
ASME SECTION XI CLASS 1 PIPING
ASME SECTION XI CLASS 2 PIPING
ASME SECTION XI CLASS 3 PIPING
NON-ISI NUCLEAR CLASS AND HSC CLASS
PRESSURE BOUNDARY EXTENSION
REFERENCE B CONTINUITY
HVAC DUCT
A ANCHOR
CS CONSTANT SPRING HANGER
VS VARIABLE SPRING HANGER
HS HYDRAULIC SNUBBER
MS MECHANICAL SNUBBER
N NON-WELDED SUPPORT ATTACHMENT
W WELDED INTEGRAL SUPPORT ATTACHMENT
R RIGID SUPPORT
T ;HAY STRUT
SW SHOP WELD
FW FIELD WELD
LW LONGITUDINAL WELD
WOL WELDOLET
ISI ITEM NUMBER DESIGNATION USED IN THE FIRST 10 YEAR INSERVICE INSPECTION INTERVAL.
NOTES:
1. MULTIPLE SWAY STRUTS, SPRING SUPPORTS OR SNUBBERS IN A SINGLE PIPING SUPPORT ARE SHOWN BY A NUMBER BEFORE THE SUPPORT TYPE. (EXAMPLE: 2HMS - TWO HYDRAULIC TYPE SNUBBERS THAT ARE NOT WELDED INTEGRAL TO THE PIPE).
GENERAL NOTE
DIMENSIONS SHOWN ON THIS DRAWING ARE TO BE USED FOR APPROXIMATE LOCATION ONLY. USE DESIGN DRAWINGS FOR DIMENSIONAL VERIFICATION.
REFERENCE DRAWINGS:
15102-030A REACTOR COOLANT SYSTEM
15102-033B DECAY HEAT TRAIN 1
SECTION A-A
DAVIS-BESSE NUCLEAR POWER STATION
UNIT NO. 1
INSERVICE INSPECTION ISOMETRIC
DECAY HEAT REMOVAL SYSTEM
CTMT.-AUX. BLDG. NORMAL COOLDOWN
ISIM2-233C
SHEET 2
D-082