




A  
B  
C  
D  
E  
F  
G  
H  
J  
K

A  
B  
C  
D  
E  
F  
G  
H  
J  
K

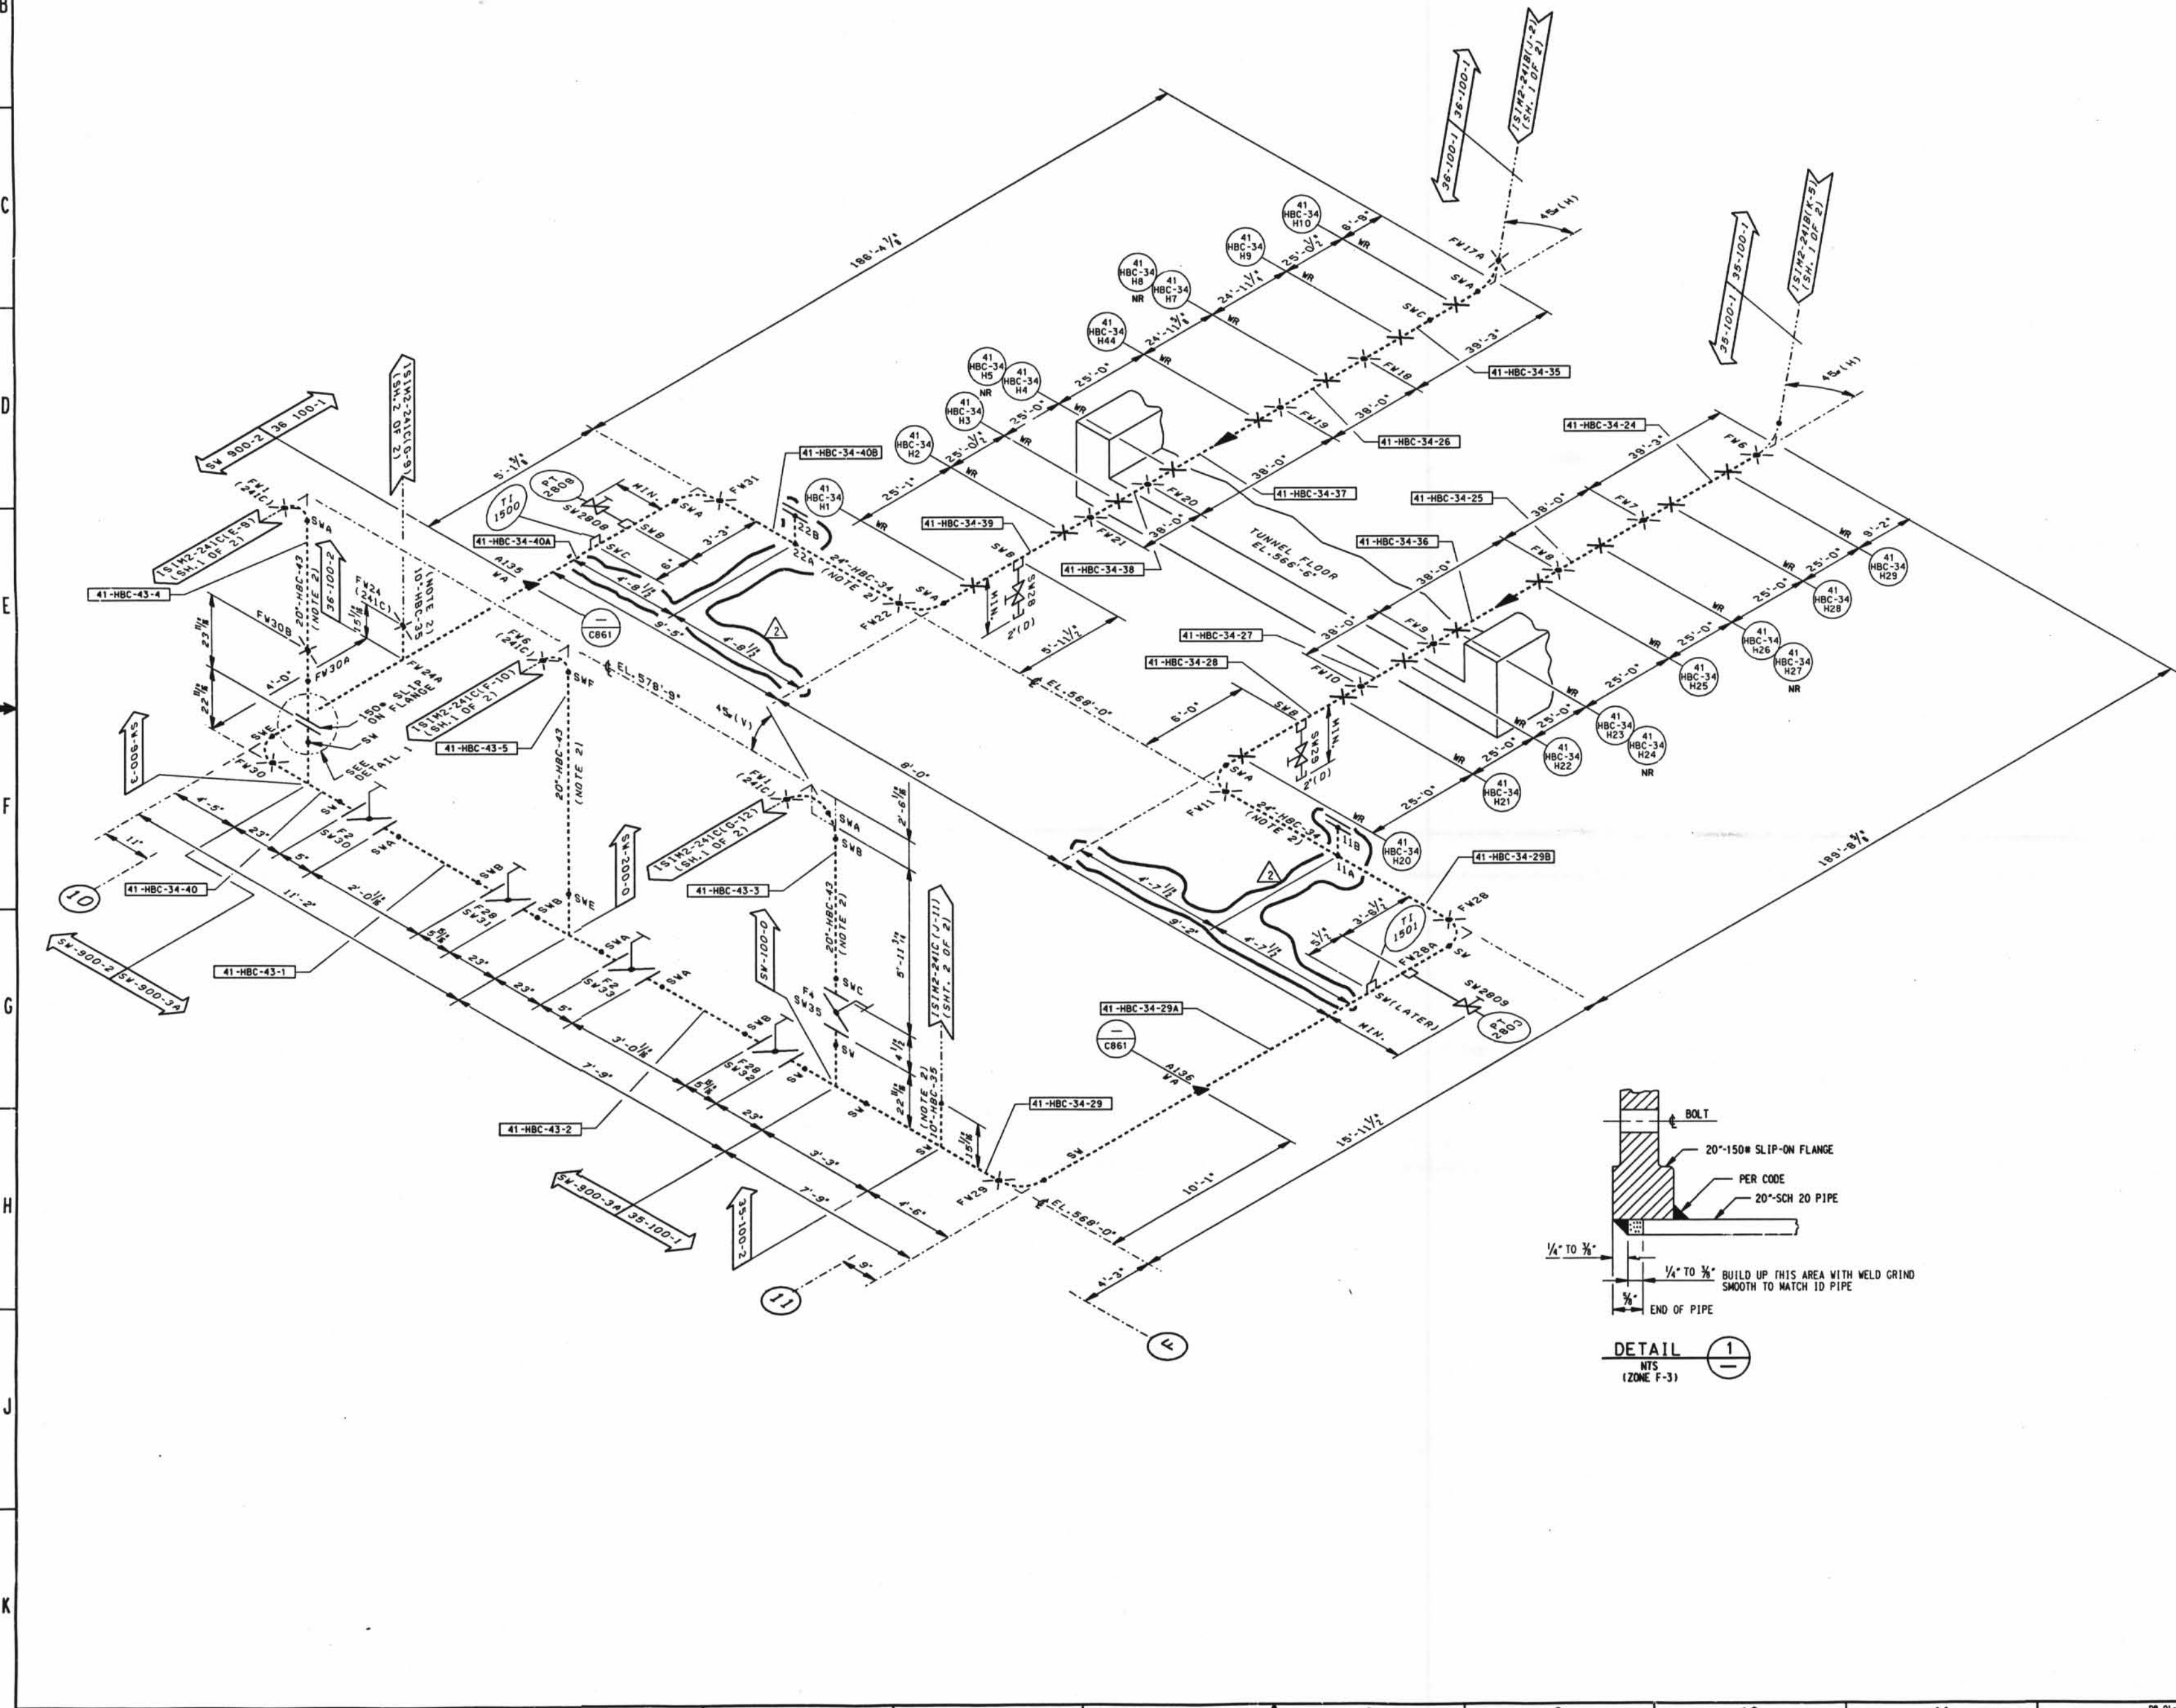


- LEGEND**
- ASME SECTION XI CLASS 1 PIPING
  - ASME SECTION XI CLASS 2 PIPING
  - ASME SECTION XI CLASS 3 PIPING
  - NON-ISI NUCLEAR CLASS AND HSC CLASS
  - PRESSURE BOUNDARY EXTENSION
  - REFERENCE B CONTINUITY
  - D-D- HVAC DUCT
  - A ANCHOR
  - CS CONSTANT SPRING HANGER
  - VS VARIABLE SPRING HANGER
  - HS HYDRAULIC SNUBBER
  - MS MECHANICAL SNUBBER
  - N NON-WELDED SUPPORT ATTACHMENT
  - V WELDED INTEGRAL SUPPORT ATTACHMENT
  - R RIGID SUPPORT
  - T SWAY STRUT
  - SW SHOP WELD
  - FW FIELD WELD
  - LW LONGITUDINAL WELD
  - WOL WELDOLET
  - (S) ITEM NUMBER DESIGNATION USED IN THE FIRST 10 YEAR INSERVICE INSPECTION INTERVAL.

- NOTES:**
- MULTIPLE SWAY STRUTS, SPRING SUPPORTS OR SNUBBERS IN A SINGLE PIPING SUPPORT ARE SHOWN BY A NUMBER BEFORE THE SUPPORT TYPE. (EXAMPLE: 2MS TWO HYDRAULIC TYPE SNUBBERS THAT ARE NOT WELDED INTEGRAL TO THE PIPE).
  - THE SERVICE WATER LINE 10"-HBC-35, 20"-HBC-43 & 24"-HBC-54 WELDS AND SUPPORTS ARE EXEMPT FROM INSERVICE EXAMINATION REQUIREMENTS PER 1WD 1220. THE WELDS AND SUPPORTS SHOWN MAY NOT REPRESENT THE ACTUAL AS-BUILT CONDITION.

**GENERAL NOTE**  
DIMENSIONS SHOWN ON THIS DRAWING ARE TO BE USED FOR APPROXIMATE LOCATION ONLY. USE DESIGN DRAWINGS FOR DIMENSIONAL VERIFICATION.

**REFERENCE DRAWINGS:**  
15102-041A SERVICE WATER PUMPS AND SECONDARY SERVICE WATER SYSTEM  
15102-041B PRIMARY SERVICE WATER SYSTEM

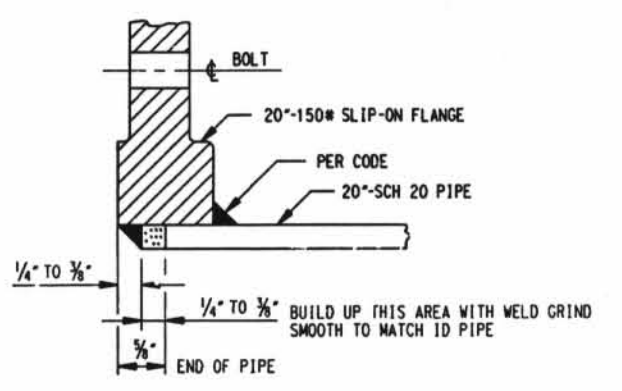

D-134

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	32	33	34	35	36	37	38	39	40	41	42	43	44	45	46	47	48	49	50	51	52	53	54	55	56	57	58	59	60	61	62	63	64	65	66	67	68	69	70	71	72	73	74	75	76	77	78	79	80	81	82	83	84	85	86	87	88	89	90	91	92	93	94	95	96	97	98	99	100
1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	32	33	34	35	36	37	38	39	40	41	42	43	44	45	46	47	48	49	50	51	52	53	54	55	56	57	58	59	60	61	62	63	64	65	66	67	68	69	70	71	72	73	74	75	76	77	78	79	80	81	82	83	84	85	86	87	88	89	90	91	92	93	94	95	96	97	98	99	100

DAVIS-BESSE NUCLEAR POWER STATION  
UNIT NO. 1  
INSERVICE INSPECTION ISOMETRIC  
SERVICE WATER SYSTEM  
VALVE ROOMS AND TUNNEL  
SHEET 2

12.7.95