



Tennessee Valley Authority, Post Office Box 2000, Spring City, Tennessee 37381-2000

DEC 19 2001

10 CFR 50.90

U.S. Nuclear Regulatory Commission  
ATTN: Document Control Desk  
Washington, D. C. 20555

Gentlemen:

In the Matter of ) Docket No.50-390  
Tennessee Valley Authority )

WATTS BAR NUCLEAR PLANT (WBN) UNIT 1 - RESPONSES TO REQUEST FOR  
ADDITIONAL INFORMATION (RAI) REGARDING TRITIUM PRODUCTION -  
INTERFACE ITEM NUMBER 3 - COMPLIANCE WITH DNB CRITERION -  
CLARIFICATION TO PREVIOUS RAI RESPONSE DATED SEPTEMBER 21, 2001  
TAC NO. MB1884

The purpose of this letter to provide clarifications to TVA's response dated September 21, 2001, to NRC's request for additional information regarding the Tritium Production Program Interface Item Number 3, "Compliance With DNB Criterion." The need for this clarification was identified during a telecon on November 28, 2001, between the NRC's WBN Project Manager, the NRC Staff reviewer, the TVA Tritium Program Manager, and Westinghouse representatives. The initial RAI request was made via email from NRC Project Manager for WBN on September 4, 2001, and was formalized in a subsequent letter dated September 14, 2001. Initial information related to this interface issue was supplied by TVA on May 1, 2001, and with the license amendment request dated August 20, 2001. The enclosure provide clarifications to previous TVA responses and revisions to two figure titles.

DO30

U.S. Nuclear Regulatory Commission

Page 2

DEC 19 2001

There are no regulatory commitments made by this letter. If you have any questions about this letter, please contact me at (423) 365-1824.

Sincerely,



P. L. Pace  
Manager, Site Licensing  
and Industry Affairs

Enclosures

cc: See page 3

Subscribed and sworn to before me  
on this 19th day of December 2001

E. Jeannette Long  
Notary Public

My Commission Expires May 21, 2005

U.S. Nuclear Regulatory Commission

Page 3

DEC 19 2001

PLP:RAS

Enclosure

cc (Enclosure):

NRC Resident Inspector  
Watts Bar Nuclear Plant  
1260 Nuclear Plant Road  
Spring City, Tennessee 37381

Mr. L. Mark Padovan, Senior Project Manager  
U.S. Nuclear Regulatory Commission  
MS 08G9  
One White Flint North  
11555 Rockville Pike  
Rockville, Maryland 20852-2738

U.S. Nuclear Regulatory Commission  
Region II  
Sam Nunn Atlanta Federal Center  
61 Forsyth St., SW, Suite 23T85  
Atlanta, Georgia 30303

ENCLOSURE  
TENNESSEE VALLEY AUTHORITY  
WATTS NUCLEAR PLANT (WBN)  
UNIT 1  
DOCKET NO. 390  
RESPONSE TO NRC'S REQUEST FOR ADDITIONAL INFORMATION

For the TVA letter dated September 21, 2001, the following clarifications need to be made:

On Page E-1, insert the following sentence after Response No. 1, Item B.2:

These figures are discussed further in Response 3.

On page E-3, revise Response No. 3 to read as follows (changes denoted by revision bars):

Question No. 3

For the comparisons stated in the first paragraph of Section 2.4.4.5, on page 2-28, please provide the results of the comparisons (i.e., plots, sketches, etc.)

Response No. 3

Figure 3.1 shows the results of the analysis of the Condition I axial power shapes for an equilibrium core of TPBARs. The figure plots DNBR versus Axial Offset, where Axial Offset is defined as the power generated in the top half of the core minus the power generated in the bottom half of the core divided by the total power generated (times 100 to give the standard unit of percent). Each circle or x corresponds to a power shape for a thimble or typical cell, respectively. The dotted line which bounds the data points is taken from the reference power shape analysis for a non-tritium core. This line is used to verify future cycle specific power shapes. The horizontal limit lines show on the figure for the thimble and typical cell correspond to a DNB limiting axial power shape used to analyze such transients as Loss of Flow.

Figures 3.2A/B show the results of the analysis of the Condition II axial power shapes for an equilibrium core of TPBARs for typical and thimble cells, respectively. The figures plot  $\Delta T_{in}$  versus  $\Delta I$ , where  $\Delta I$  is defined as percent of core rated power generated in the top half of the core minus percent of core rated power generated in the bottom half of the core. Each point corresponds to a power shape.

These figures show that the limit lines bound the accident power shapes associated with the tritium cores. The limit lines were established for non-tritium cores and are applicable to the tritium cores. These lines were used as input to establish the  $f(\Delta I)$  function setpoints in the Overtemperature  $\Delta T$  equation.

On pages E-7 and E-8, revise the titles for Figures 3.2A and 3.2B as per attached pages (changes denoted by revision bars):

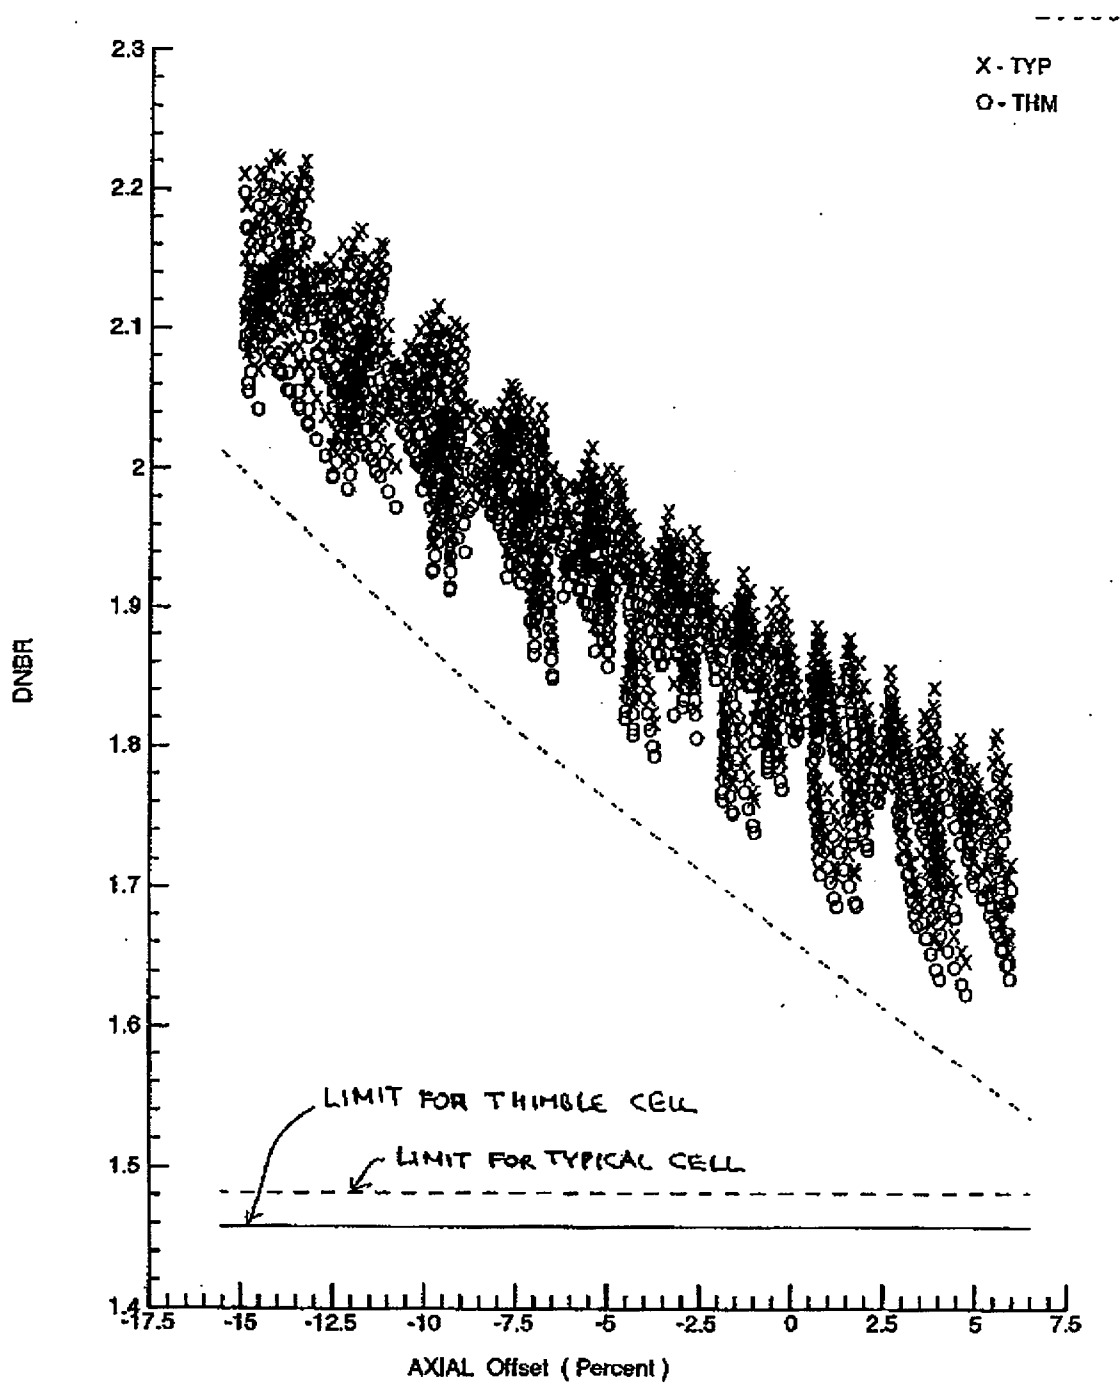


Figure 3.1  
Results of Analysis of Condition I Power Shapes

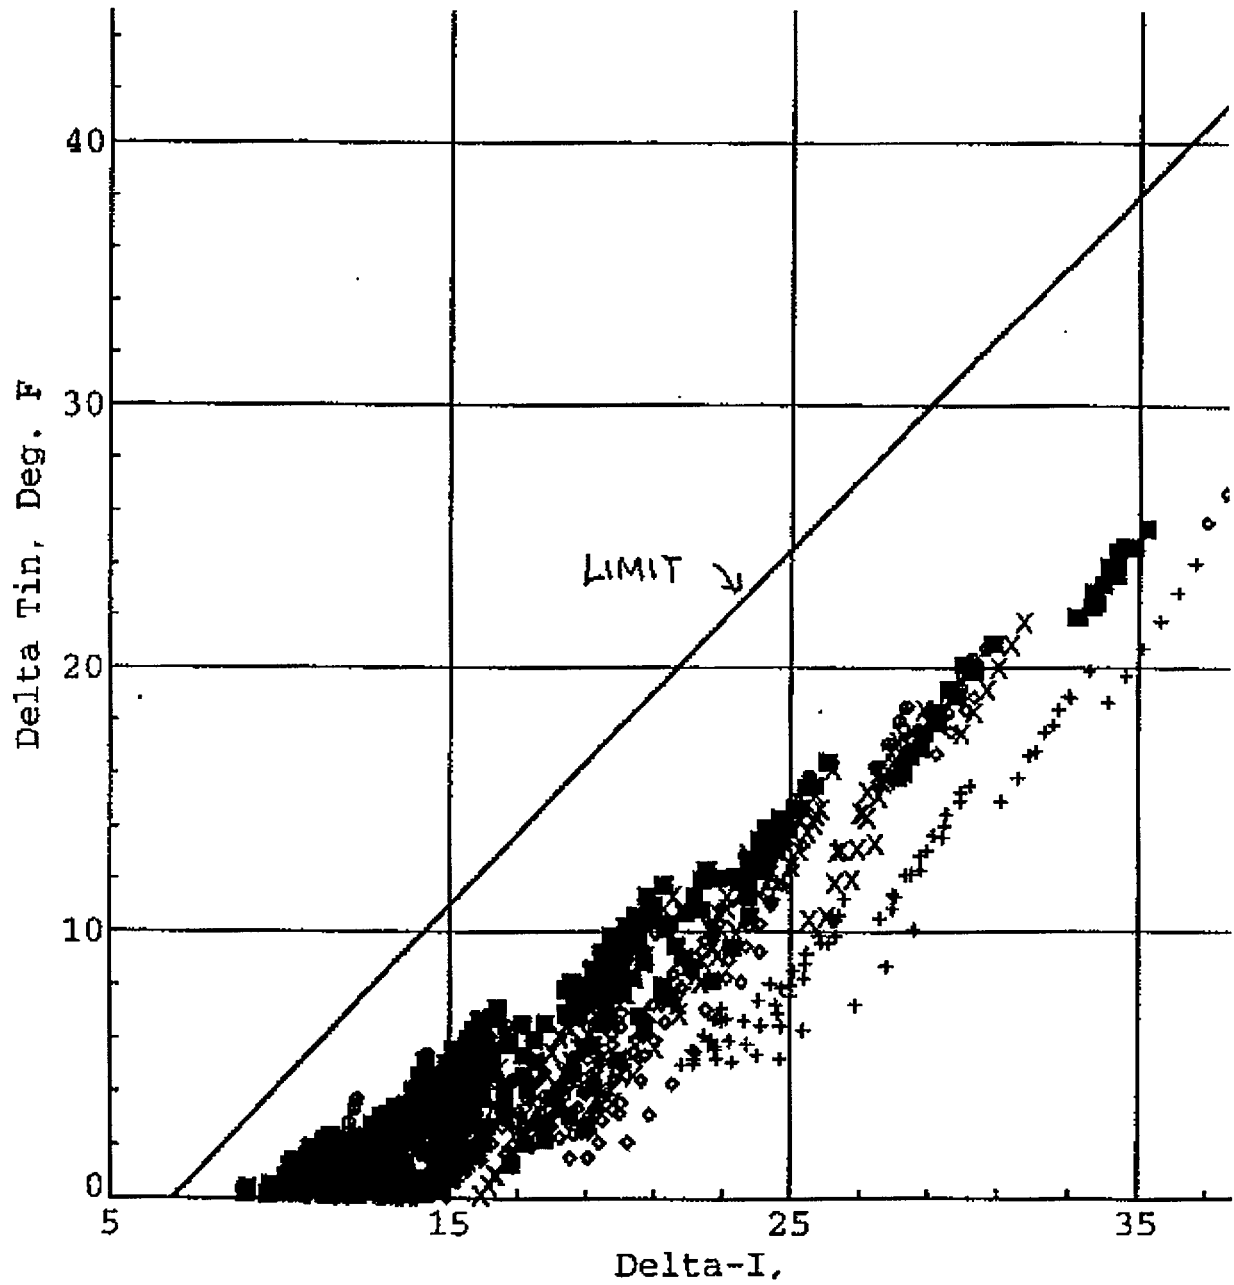


Figure 3.2A  
Results of Analysis of Condition II Power Shapes  
Typical Cell

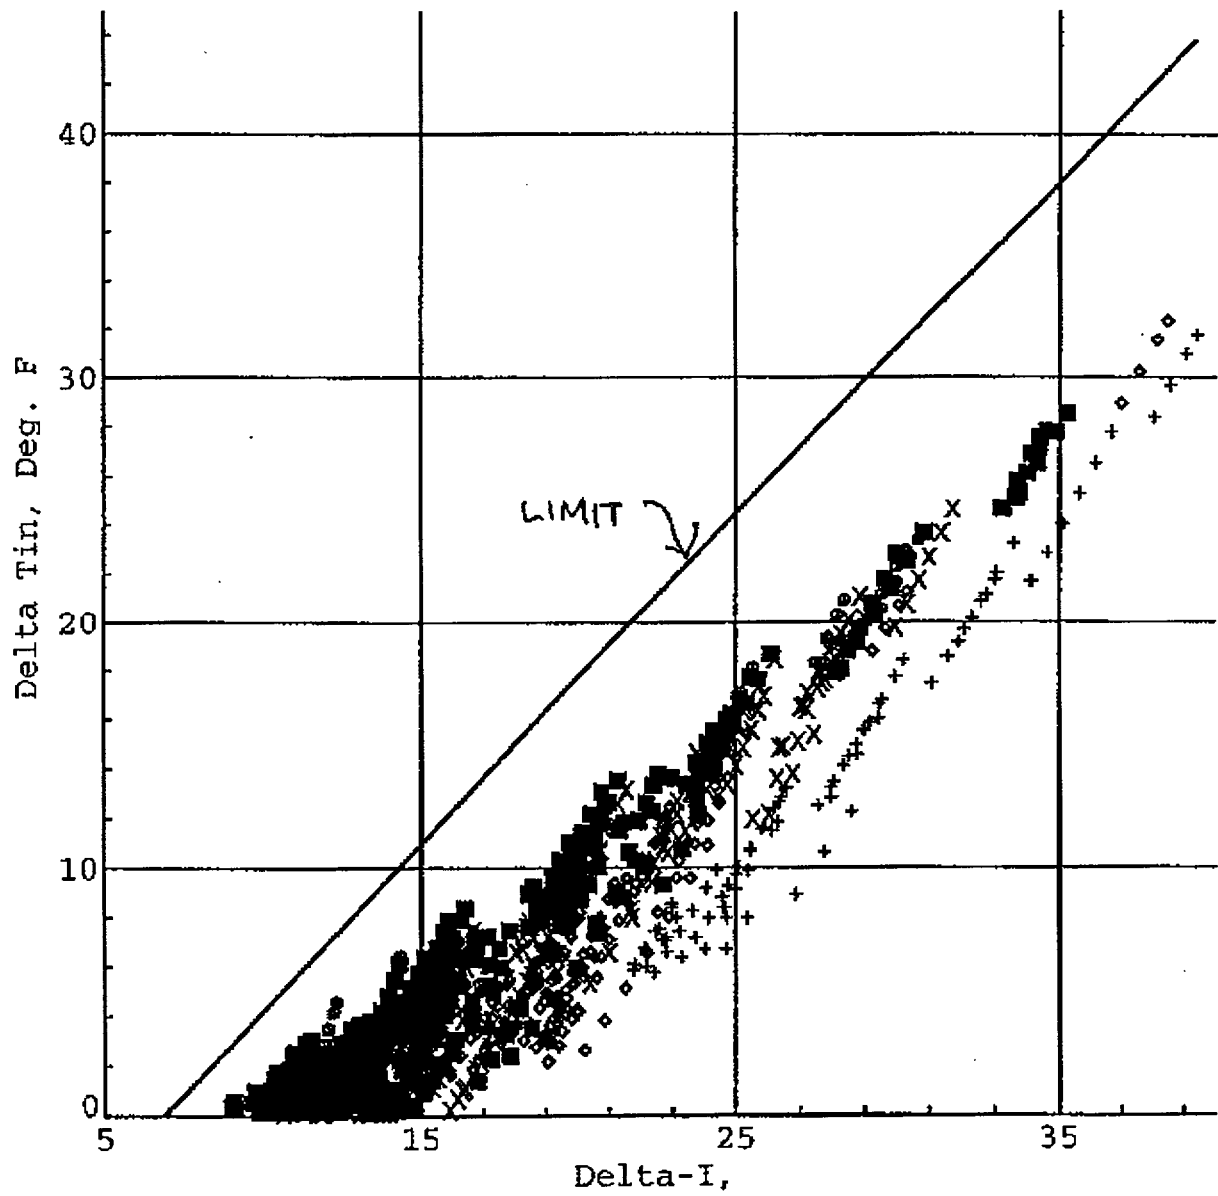


Figure 3.2B  
Results of Analysis of Condition II Power Shapes  
Thimble Cell