


INFO. NOTE:
(REMOVE AT NEXT UPDATE)
REVISION CHANGE IN THE CLOUDED
AREA WAS FOR COLORIZING THE
LINE CLASS CODES

LEGEND

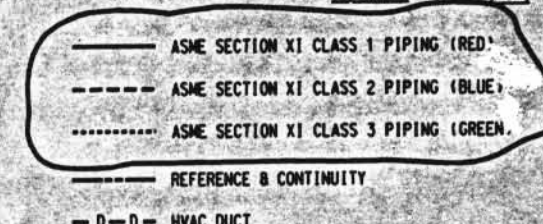

- ISIM2- REFERENCE TO THE PIPING ISOMETRIC DRAWING FOR DETAILS ON THE PIPING CONFIGURATION, AND THE LOCATION AND IDENTIFICATION OF WELDS AND SUPPORTS.
- RESERVED FOR SPECIAL ISI REQUIREMENTS. (MAY BE ACCOMPANIED BY SPECIFIC NOTES).
- REFERENCE TO THE ISI ITEM NUMBER DESIGNATION USED IN THE FIRST 10 YEAR INSERVICE INSPECTION INTERVAL.
- ASME SECTION XI CLASS CHANGE
- ISI PROGRAM BOUNDARY

NOTES:

- DELETED
- FOR ISI BOUNDARY DIAGRAM INDEX SHEET AND GENERAL NOTES, SEE ISID2-001.
- FOR PIPING SYMBOLS AND P & ID INDEX, SEE DRAWING M-001.
- UNLESS OTHERWISE NOTED, ALL VENT CONNECTIONS ARE 1/2" LINE IDENTIFICATION IS THE SAME AS THE HEADER.
- VALVE INTERNALS REMOVED FROM VALVES SW-3 AND SW-4 PER FOR 80-252, REV. A SUPP. 1.

INFO. NOTE:
(REMOVE AT NEXT UPDATE)
REVISION CHANGE IN THE CLOUDED
AREA WAS FOR COLORIZING THE
LINE CLASS CODES

D-4

1	INC. DCH ISID2-006D PER DOR 00-1766	SBW	10/1/80
2	INC. DCH ISID2-006D-5 FOR DOR 95-0033		
3	INC. DCH ISID2-006D-3 FOR RFA 93-0492 & ISID2-006D-4 FOR RFA 93-0452		
4	INC. DCH ISID2-006D-2 FOR DOR 93-0202		
5	INC. DCH ISID2-006D-1 FOR DOR 91-0011		
6	ISSUED FOR SECOND 10 YEAR ISI PROGRAM	JUN	10/1/80

DAVIS-BESSE NUCLEAR POWER STATION
UNIT NO. 1
THE YALE DESIGN COMPANY

INSERVICE INSPECTION DIAGRAM AUXILIARY FEEDWATER SYSTEM	
ISID2-006D	5

DB 08-09-00 DPN 11/11/10 75100000.DGN 14 34244 E SIZE

