

Exelon Generation Company, LLC  
Braidwood Station  
35100 South Rt 53, Suite 84  
Braceville, IL 60407-9619  
Tel. 815-458-2801

www.exeloncorp.com

February 11, 2002  
BW020014

U.S. Nuclear Regulatory Commission  
ATTN: Document Control Desk  
Washington, DC 20555-0001


Braidwood Station, Unit 2  
Facility Operating License Nos. NPF-77  
NRC Docket No. STN 50-457

Subject: Core Operating Limits Report, Braidwood Unit 2 Cycle 9A Sequence  
Number 1

The purpose of this letter is to transmit the Core Operating Limits Report (COLR) for Braidwood Unit 2 Cycle 9A Sequence Number 1, in accordance with Technical Specification 5.6.5, "Core Operating Limits Report (COLR)." This revision of the COLR was recently implemented and provides additional information and clarification.

If you have any questions regarding this matter, please contact Ms. A. Ferko, Regulatory Assurance Manager at (815) 417-2699.

Respectfully,

  
James D. von Suskil  
Site Vice President  
Braidwood Station

Attachment: Core Operating Limits Report, Braidwood Unit 2 Cycle 9A Sequence  
Number 1

cc: Regional Administrator – NRC Region III  
NRC Senior Resident Inspector – Braidwood Station

A001

# **ATTACHMENT 1**

## **Core Operating Limits Report**

**Braidwood Unit 2, Cycle 9A, Sequence Number 1**

NUCLEAR FUEL MANAGEMENT DEPARTMENT  
TRANSMITTAL OF DESIGN INFORMATION

☒ SAFETY RELATED  
☐ NON-SAFETY RELATED  
☐ REGULATORY RELATED

Originating Organization  
☒ Nuclear Fuel Management  
☐ Other (specify) \_\_\_\_\_

TODI No. NFM0100053  
Seq. No. 1  
Page 1 of 14

Station Braidwood Unit 2 Cycle 9A Generic \_\_\_\_\_

To: Lonnie K. Kepley - Braidwood

Subject Braidwood Unit 2 Cycle 9A Core Operating Limits Report in ITS Format and W(z) Function

P. Moravek

Preparer

Preparer's Signature

Date

T. Stevens

Reviewer

Reviewer's Signature

Date

D. Redden

NFM Supervisor

NFM Supervisor's Signature

Date

Status of Information:

☒ Verified  
☐ Unverified  
☐ Engineering Judgement

Method and Schedule of Verification for Unverified TODIs: \_\_\_\_\_

Description of Information:

Attached is the Braidwood Unit 2 Cycle 9A Core Operating Limits Report (COLR) in the ITS format and W(z) function. **The Sequence 1 of this TODI supersedes Sequence 0.**

Purpose of Information:

The attached Core Operating Limits Report (COLR) for Braidwood Station Unit 2 Cycle 9A, with uprate values, has been prepared in accordance with the requirements of Technical Specification 5.6.5 (ITS). In this sequence, the following COLR Sections were revised:

- Section 2.2.2; the SDM limits for MODE 5, applicable for LCO 3.1.1,
- Section 2.3.4, the EOL/ARO/HFP-MTC Surveillance limit at 60 ppm, applicable for LCO 3.1.3,
- Section 2.5.1, the control bank insertion limits, applicable for LCO 3.1.6.
- Section 2.5.4, the control bank overlap limits, applicable for LCO 3.1.6.
- Section 2.13.2, the Reactor Coolant System boron concentration, applicable to TLCO 3.1.k.2)

Braidwood Station is requested to perform a plant review of this document. Upon completion of the plant review, Braidwood Station is to transmit the COLR portion to the Nuclear Regulatory Commission pursuant to Technical Specification 5.6.5. Please provide NFM (Tyrone L. Stevens) with a copy of Braidwood Station's completed plant review and COLR submittal to the NRC.

Source of Information:

Westinghouse Letter CAC-01-131, "Braidwood 2 Cycle 9A COLR data for 3586.6 MWt Operation, " dated April 12, 2001.  
NFM0100054, "RCS Average Temperature DNB Limit, " Seq. 0, dated April 14, 2001.

Supplemental Distribution: A. Ferko / L. S. Dworakowski (BR)

## CORE OPERATING LIMITS REPORT (COLR) for BRAIDWOOD UNIT 2 CYCLE 9A

1.0 CORE OPERATING LIMITS REPORT

This Core Operating Limits Report (COLR) for Braidwood Station Unit 2 Cycle 9A has been prepared in accordance with the requirements of Technical Specification 5.6.5 (ITS).

-----The Technical Specifications affected by this report are listed below:-----

SL	2.1.1	Reactor Core Safety Limits (SLs)
LCO	3.1.1	Shutdown Margin (SDM)
LCO	3.1.3	Moderator Temperature Coefficient
LCO	3.1.4	Rod Group Alignment Limits
LCO	3.1.5	Shutdown Bank Insertion Limits
LCO	3.1.6	Control Bank Insertion Limits
LCO	3.1.8	Physics Tests Exceptions – Mode 2
LCO	3.2.1	Heat Flux Hot Channel Factor ( $F_Q(Z)$ )
LCO	3.2.2	Nuclear Enthalpy Rise Hot Channel Factor ( $F_{\Delta H}^N$ )
LCO	3.2.3	Axial Flux Difference (AFD)
LCO	3.2.5	Departure from Nucleate Boiling Ratio (DNBR)
LCO	3.3.1	Reactor Trip System (RTS) Instrumentation
LCO	3.3.9	Boron Dilution Protection System (BDPS)
LCO	3.4.1	Reactor Coolant System (RCS) DNB Parameters
LCO	3.9.1	Boron Concentration

The portions of the Technical Requirements Manual affected by this report are listed below:

TRM TLCO 3.1.b	Boration Flow Paths - Operating
TRM TLCO 3.1.d	Charging Pumps - Operating
TRM TLCO 3.1.f	Borated Water Sources - Operating
TRM TLCO 3.1.g	Position Indication System – Shutdown
TRM TLCO 3.1.h	Shutdown Margin (SDM) – MODE 1 and MODE 2 with $k_{eff} \geq 1.0$
TRM TLCO 3.1.i	Shutdown Margin (SDM) – MODE 5
TRM TLCO 3.1.j	Shutdown and Control Rods
TRM TLCO 3.1.k	Position Indication System – Shutdown (Special Test Exception)

## CORE OPERATING LIMITS REPORT (COLR) for BRAIDWOOD UNIT 2 CYCLE 9A

## 2.0 OPERATING LIMITS

The cycle-specific parameter limits for the specifications listed in Section 1.0 are presented in the following subsections. These limits are applicable for the entire cycle unless otherwise identified. These limits have been developed using the NRC-approved methodologies specified in Technical Specification 5.6.5.

### 2.1 Reactor Core Limits (SL 2.1.1)

- 2.1.1 In Modes 1 and 2, the combination of Thermal Power, Reactor Coolant System (RCS) highest loop average temperature, and pressurizer pressure shall not exceed the limits specified in Figure 2.1.1.

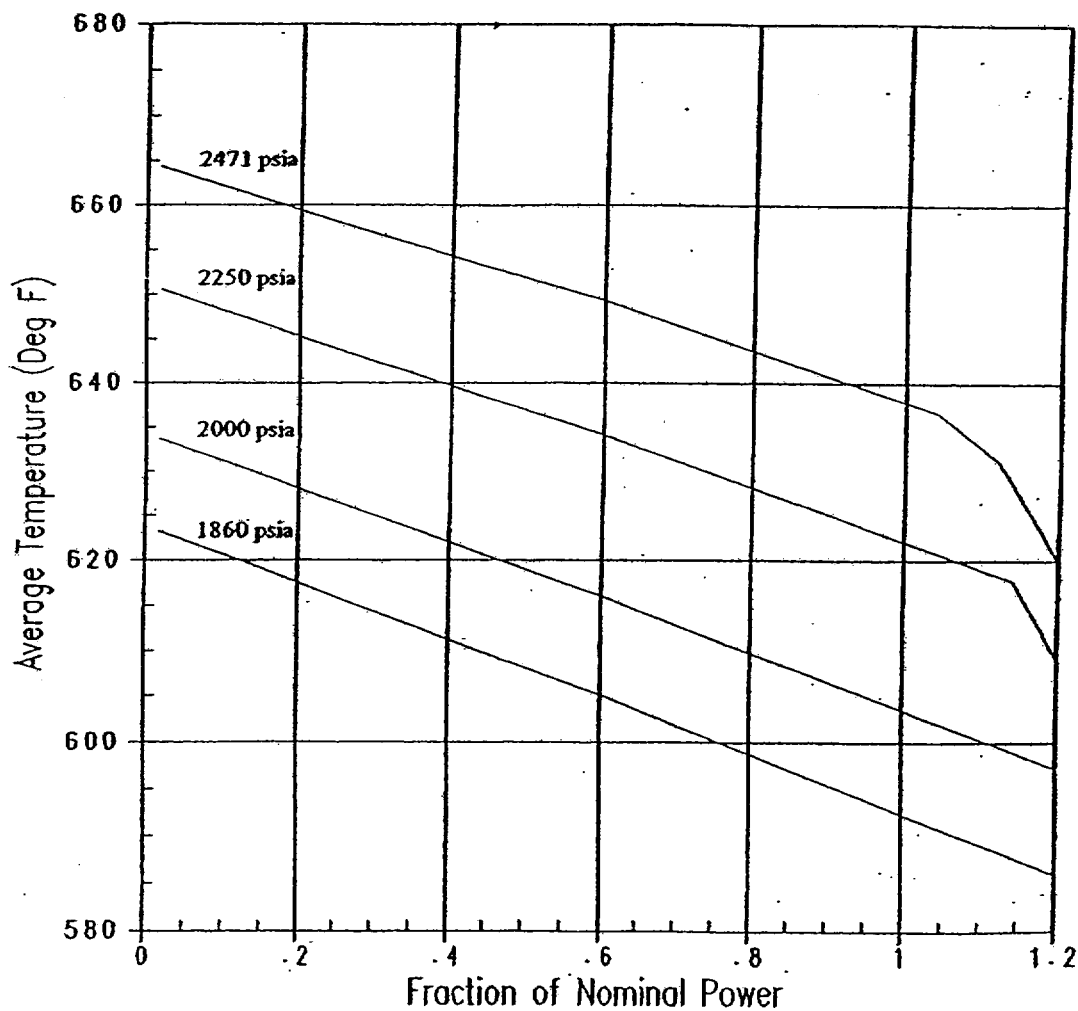


Figure 2.1.1: Reactor Core Limits

2.2 CORE OPERATING LIMITS REPORT (COLR) for BRAIDWOOD UNIT 2 CYCLE 9A  
Shutdown Margin (SDM)

The SDM limit for MODES 1, 2, 3, and 4 is:

- 2.2.1 The SDM shall be greater than or equal to 1.3%  $\Delta k/k$  (LCOs 3.1.1, 3.1.4, 3.1.5, 3.1.6, 3.1.8, 3.3.9; TRM TLCOs 3.1.b, 3.1.d, 3.1.f, 3.1.h, and 3.1.j).

The SDM limit for MODE 5 is:

- 2.2.2 SDM shall be greater than or equal to 1.3%  $\Delta k/k$  (LCO 3.1.1, LCO 3.3.9; TRM TLCOs 3.1.i and 3.1.j).

2.3 Moderator Temperature Coefficient (LCO 3.1.3)

The Moderator Temperature Coefficient (MTC) limits are:

- 2.3.1 The BOL/ARO/HZP-MTC upper limit shall be  $+4.1 \times 10^{-5} \Delta k/k/^{\circ}F$ .  
 2.3.2 The EOL/ARO/HFP-MTC lower limit shall be  $-4.6 \times 10^{-4} \Delta k/k/^{\circ}F$ .  
 2.3.3 The EOL/ARO/HFP-MTC Surveillance limit at 300 ppm shall be  $-3.7 \times 10^{-4} \Delta k/k/^{\circ}F$ .  
 2.3.4 The EOL/ARO/HFP-MTC Surveillance limit at 60 ppm shall be  $-4.3 \times 10^{-4} \Delta k/k/^{\circ}F$ .

where: BOL stands for Beginning of Cycle Life  
 ARO stands for All Rods Out  
 HZP stands for Hot Zero Thermal Power  
 EOL stands for End of Cycle Life  
 HFP stands for Hot Full Thermal Power

2.4 Shutdown Bank Insertion Limit (LCO 3.1.5)

- 2.4.1 All shutdown banks shall be fully withdrawn to at least 224 steps.


2.5 Control Bank Insertion Limits (LCO 3.1.6)

- 2.5.1 The control banks, with the Bank A greater than or equal to 224 steps, shall be limited in physical insertion as shown in Figure 2.5.1.  
 2.5.2 Each control bank shall be considered fully withdrawn from the core at greater than or equal to 224 steps.  
 2.5.3 The control banks shall be operated in sequence by withdrawal of Bank A, Bank B, Bank C and Bank D. The control banks shall be sequenced in reverse order upon insertion.  
 2.5.4 Each control bank not fully withdrawn from the core shall be operated with the following overlap limits as a function of park position:

Park Position (step)	Overlap Limit (step)
225	110
226	111
227	112
228	113
229	114
231	116

## CORE OPERATING LIMITS REPORT (COLR) for BRAIDWOOD UNIT 2 CYCLE 9A

**Figure 2.5.1:**  
**Control Bank Insertion Limits Versus Percent Rated Thermal Power**

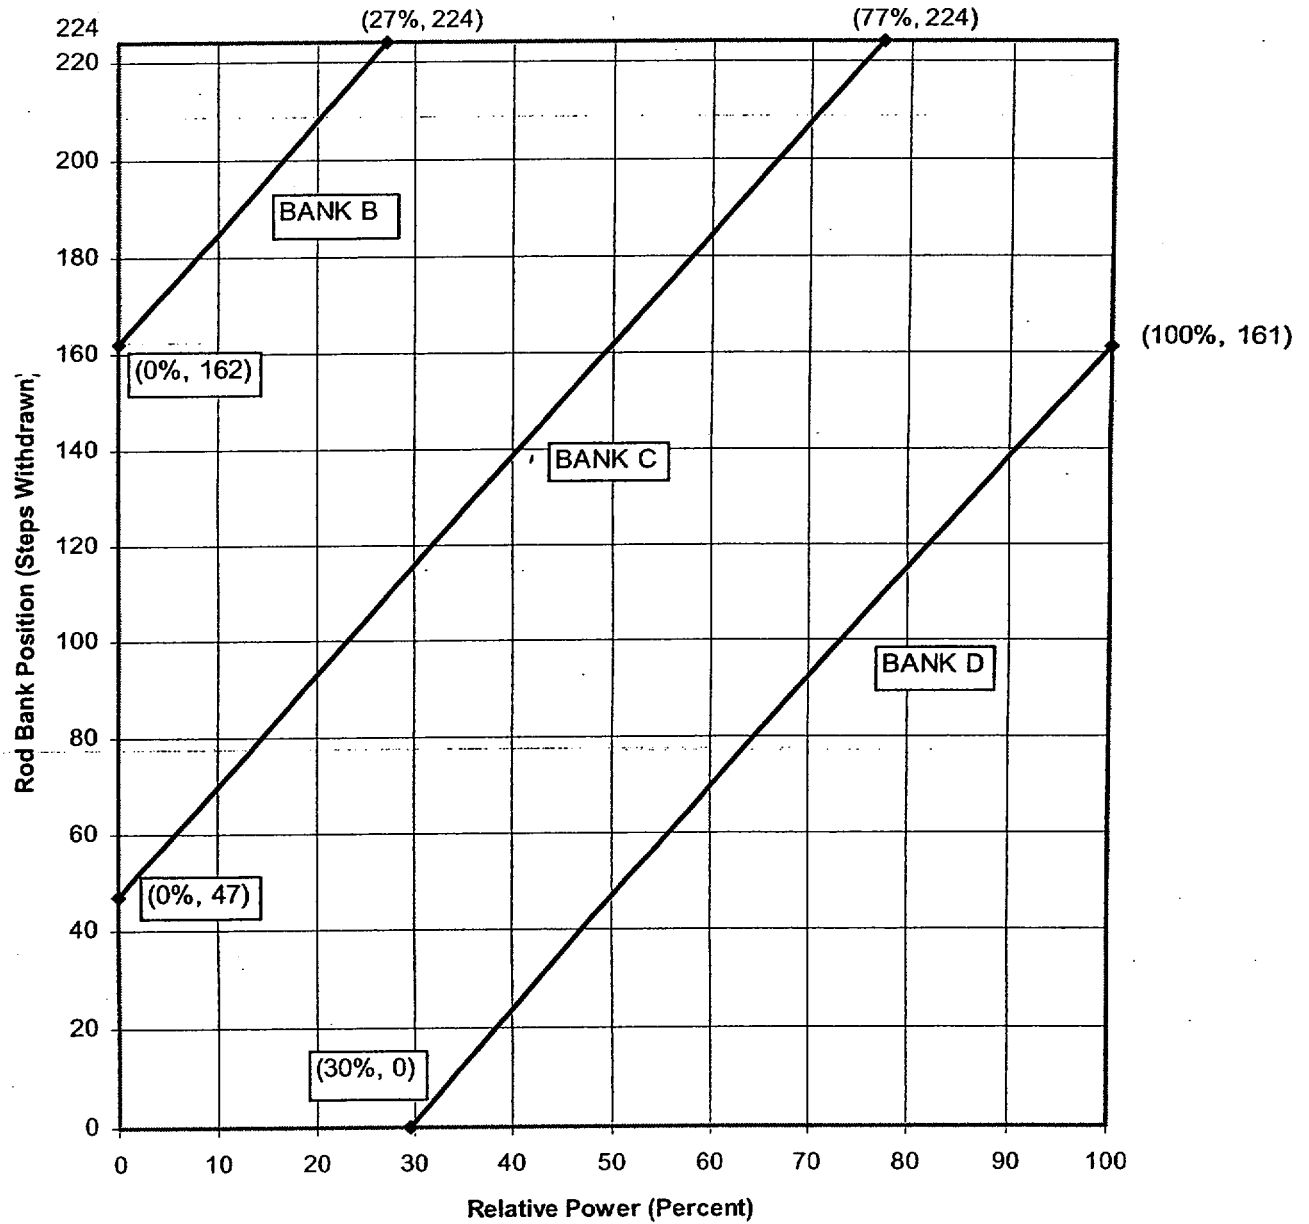

## CORE OPERATING LIMITS REPORT (COLR) for BRAIDWOOD UNIT 2 CYCLE 9A

2.6 Heat Flux Hot Channel Factor ( $F_Q(Z)$ ) (LCO 3.2.1)

## 2.6.1

$$F_Q(Z) \leq \frac{F_Q^{RTP}}{0.5} \times K(Z) \text{ for } P \leq 0.5$$

$$F_Q(Z) \leq \frac{F_Q^{RTP}}{P} \times K(Z) \text{ for } P > 0.5$$

where:  $P$  = the ratio of THERMAL POWER to RATED THERMAL POWER

$$F_Q^{RTP} = 2.60$$

$K(Z)$  is provided in Figure 2.6.1.

2.6.2  $W(Z)$  Values:

a) ~~When PDMS is OPERABLE,  $W(Z) = 1.00000$  for all axial points.~~

b) When PDMS is Inoperable,  $W(Z)$  is provided in Figures 2.6.2.a through 2.6.2.c

The normal operation  $W(Z)$  values have been determined at burnups of 7901, 14000, and 18000 MWD/MTU.

For this cycle, the  $F_Q^C(z)$  penalty factors are equal to 2% per 31 Effective Full Power Days (EFPD). These values shall be used to increase the  $F_Q^W(z)$  as per Surveillance Requirement 3.2.1.2. A 2% penalty factor shall be used at all cycle burnups.

Multiplication Factor = 1.02

## 2.6.3 Uncertainty:

The uncertainty,  $U_{FQ}$ , to be applied to the Heat Flux Hot Channel Factor  $F_Q(Z)$  shall be calculated by the following formula:

$$U_{FQ} = U_{qu} \bullet U_e$$

where:

$U_{qu}$  = Base  $F_Q$  measurement uncertainty = 1.05 when PDMS is Inoperable

$U_e$  = Engineering uncertainty factor = 1.03

## 2.6.4 PDMS Alarms:


$F_Q(Z)$  Warning Setpoint  $\geq 2\%$  of  $F_Q(Z)$  Margin

$F_Q(Z)$  Alarm Setpoint  $\geq 0\%$  of  $F_Q(Z)$  Margin



## CORE OPERATING LIMITS REPORT (COLR) for BRAIDWOOD UNIT 2 CYCLE 9A

Figure 2.6.1:  $K(Z)$  - Normalized  $F_Q(Z)$  as a Function of Core Height

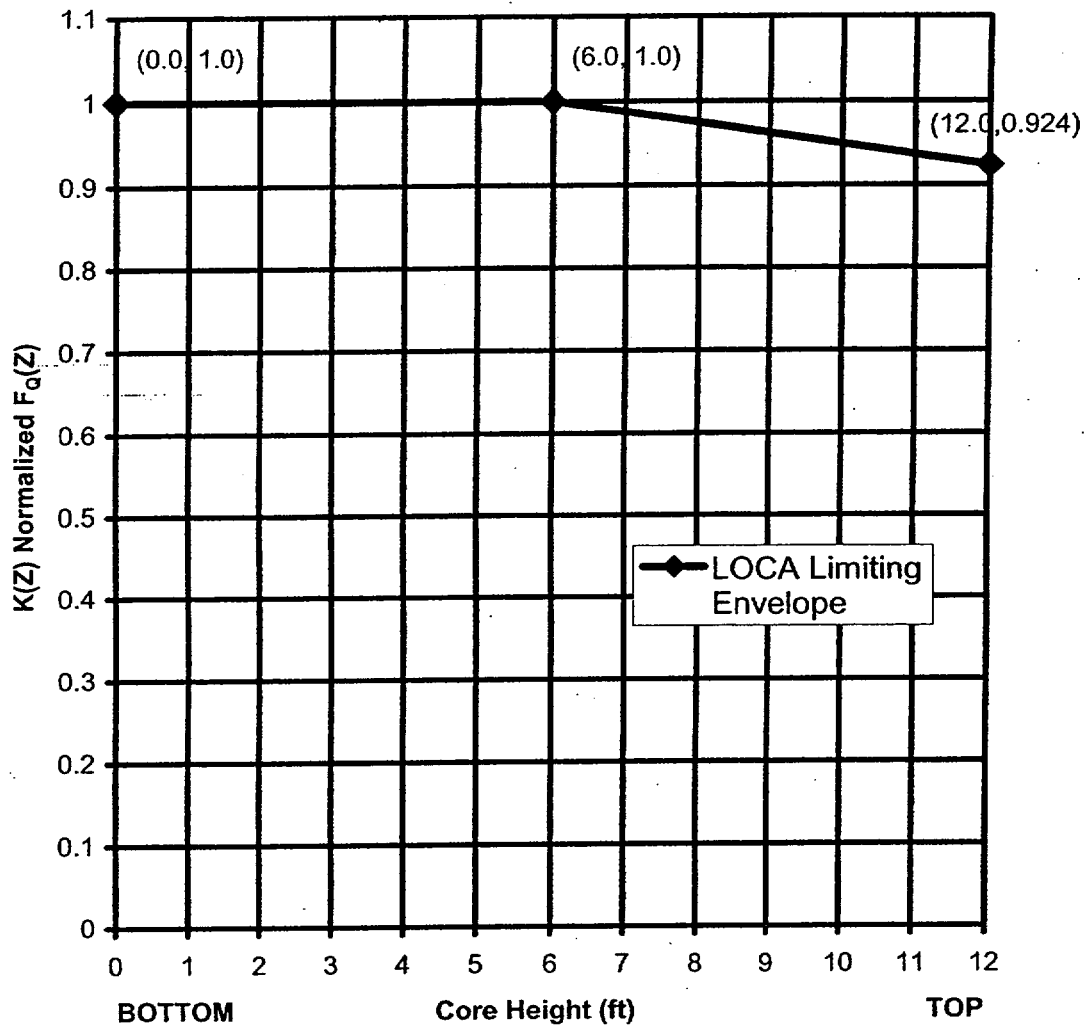

## CORE OPERATING LIMITS REPORT (COLR) for BRAIDWOOD UNIT 2 CYCLE 9A


Height MAX W(Z)

Feet	
0.00	1.0000
0.20	1.0000
0.40	1.0000
0.60	1.0000
0.80	1.0000
1.00	1.0000
1.20	1.0000
1.40	1.0000
1.60	1.0000
1.80	1.1722
2.00	1.1596
2.20	1.1476
2.40	1.1410
2.60	1.1351
2.80	1.1320
3.00	1.1280
3.20	1.1229
3.40	1.1195
3.60	1.1156
3.80	1.1121
4.00	1.1102
4.20	1.1120
4.40	1.1128
4.60	1.1123
4.80	1.1117
5.00	1.1107
5.20	1.1078
5.40	1.1058
5.60	1.1033
5.80	1.1068
6.00	1.1183
6.20	1.1354
6.40	1.1513
6.60	1.1659
6.80	1.1783
7.00	1.1891
7.20	1.1987
7.40	1.2083
7.60	1.2178
7.80	1.2265
8.00	1.2325
8.20	1.2361
8.40	1.2397
8.60	1.2414
8.80	1.2415
9.00	1.2401
9.20	1.2455
9.40	1.2537
9.60	1.2618
9.80	1.2699
10.00	1.2796
10.20	1.2864
10.40	1.0000
10.60	1.0000
10.80	1.0000
11.00	1.0000
11.20	1.0000
11.40	1.0000
11.60	1.0000
11.80	1.0000
12.00	1.0000

Braidwood Unit 2 Cycle 9A

Figure 2.6.2.a

Summary of W(Z) Function at 7501 MWD/MTU  
(Top and Bottom 15% Excluded per WC AP-10216)

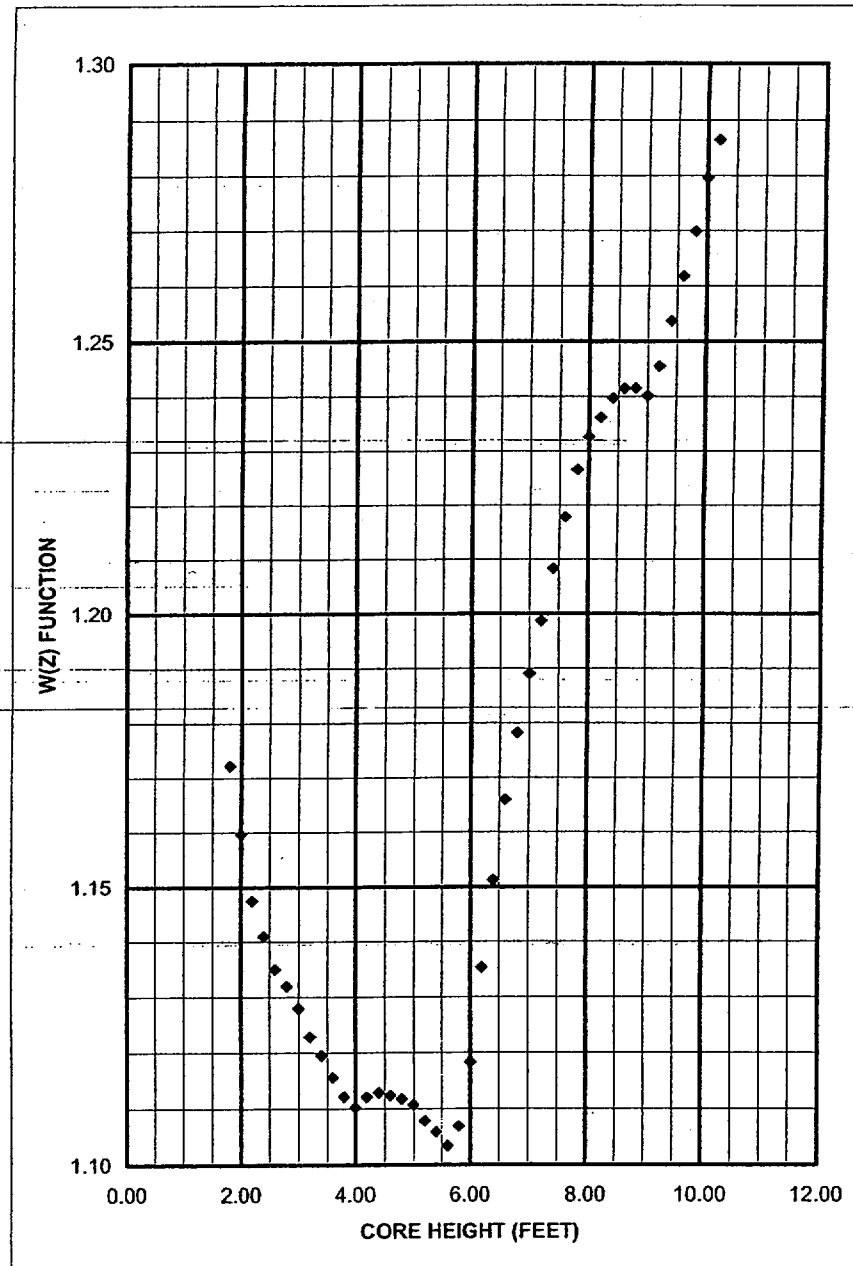


## CORE OPERATING LIMITS REPORT (COLR) for BRAIDWOOD UNIT 2 CYCLE 9A

Height Feet	MAX W(Z)
0.00	1.0000
0.20	1.0000
0.40	1.0000
0.60	1.0000
0.80	1.0000
1.00	1.0000
1.20	1.0000
1.40	1.0000
1.60	1.0000
1.80	1.2474
2.00	1.2279
2.20	1.2133
2.40	1.2027
2.60	1.1881
2.80	1.1761
3.00	1.1664
3.20	1.1547
3.40	1.1501
3.60	1.1507
3.80	1.1504
4.00	1.1490
4.20	1.1475
4.40	1.1526
4.60	1.1574
4.80	1.1620
5.00	1.1645
5.20	1.1649
5.40	1.1656
5.60	1.1725
5.80	1.1880
6.00	1.2005
6.20	1.2100
6.40	1.2176
6.60	1.2222
6.80	1.2248
7.00	1.2262
7.20	1.2246
7.40	1.2227
7.60	1.2178
7.80	1.2122
8.00	1.2038
8.20	1.1929
8.40	1.1817
8.60	1.1710
8.80	1.1761
9.00	1.1813
9.20	1.1900
9.40	1.1957
9.60	1.2260
9.80	1.2620
10.00	1.2910
10.20	1.3190
10.40	1.0000
10.60	1.0000
10.80	1.0000
11.00	1.0000
11.20	1.0000
11.40	1.0000
11.60	1.0000
11.80	1.0000
12.00	1.0000

Braidwood Unit 2 Cycle 9A

Figure 2.6.2.b

Summary of W(Z) Function at 14000 MWD/MNU  
(Top and Bottom 15% Excluded per WCAP-10216)

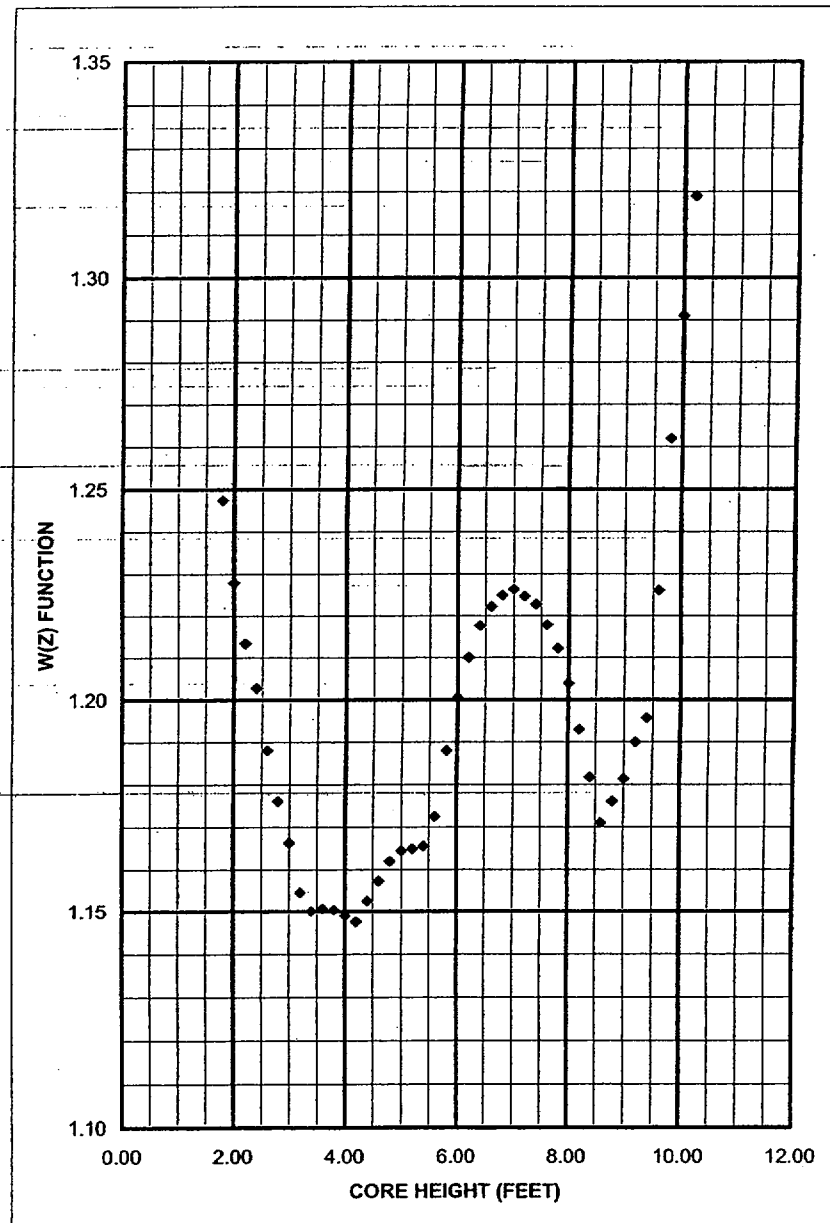


## CORE OPERATING LIMITS REPORT (COLR) for BRAIDWOOD UNIT 2 CYCLE 9A

Height Feet	MAX WZ
0.00	1.0000
0.20	1.0000
0.40	1.0000
0.60	1.0000
0.80	1.0000
1.00	1.0000
1.20	1.0000
1.40	1.0000
1.60	1.0000
1.80	1.2532
2.00	1.2338
2.20	1.2055
2.40	1.1881
2.60	1.1776
2.80	1.1677
3.00	1.1578
3.20	1.1482
3.40	1.1489
3.60	1.1507
3.80	1.1588
4.00	1.1659
4.20	1.1741
4.40	1.1812
4.60	1.1868
4.80	1.1904
5.00	1.1931
5.20	1.1929
5.40	1.1928
5.60	1.2093
5.80	1.2248
6.00	1.2364
6.20	1.2459
6.40	1.2515
6.60	1.2541
6.80	1.2553
7.00	1.2557
7.20	1.2533
7.40	1.2481
7.60	1.2377
7.80	1.2292
8.00	1.2173
8.20	1.2033
8.40	1.1919
8.60	1.1844
8.80	1.1846
9.00	1.1837
9.20	1.1810
9.40	1.2120
9.60	1.2640
9.80	1.3080
10.00	1.3470
10.20	1.3830
10.40	1.0000
10.60	1.0000
10.80	1.0000
11.00	1.0000
11.20	1.0000
11.40	1.0000
11.60	1.0000
11.80	1.0000
12.00	1.0000

Braidwood Unit 2 Cycle 9A

Figure 2.6.2.c

Summary of W(Z) Function at 18000 MWD/MTU  
(Top and Bottom 15% Excluded per WC AP-10216)

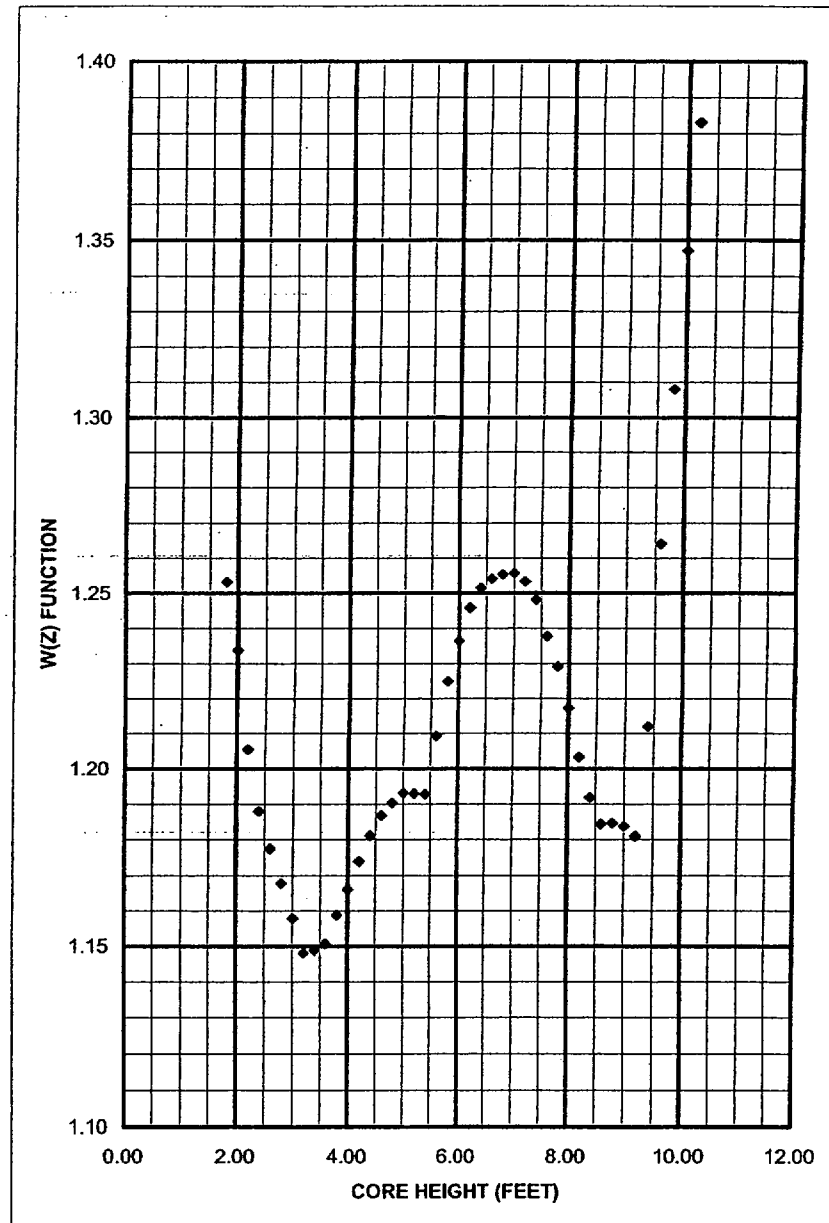

## CORE OPERATING LIMITS REPORT (COLR) for BRAIDWOOD UNIT 2 CYCLE 9A

2.7 Nuclear Enthalpy Rise Hot Channel Factor ( $F_{\Delta H}^N$ ) (LCO 3.2.2)

$$2.7.1 \quad F_{\Delta H}^N \leq F_{\Delta H}^{RTP} [1.0 + PF_{\Delta H}(1.0 - P)]$$

where: P = the ratio of THERMAL POWER to RATED THERMAL POWER

$$F_{\Delta H}^{RTP} = 1.70$$

$$PF_{\Delta H} = 0.3$$

## 2.7.2 Uncertainty when PDMS is inoperable:

The uncertainty,  $U_{F\Delta H}$ , to be applied to the Nuclear Enthalpy Rise Hot Channel Factor  $F_{\Delta H}^N$  shall be calculated by the following formula:

$$U_{F\Delta H} = U_{F\Delta Hm}$$

where:

$$U_{F\Delta Hm} = \text{Base } F_{\Delta H}^N \text{ measurement uncertainty} = 1.04$$

## 2.7.3 PDMS Alarms:

$F_{\Delta H}^N$  Warning Setpoint  $\geq 2\%$  of  $F_{\Delta H}^N$  Margin

$F_{\Delta H}^N$  Alarm Setpoint  $\geq 0\%$  of  $F_{\Delta H}^N$  Margin

2.8 Axial Flux Difference (AFD) (LCO 3.2.3)

2.8.1 When PDMS is Inoperable, the AXIAL FLUX DIFFERENCE (AFD) Acceptable Operation Limits are provided in Figure 2.8.1 or the latest valid PDMS Surveillance Report, whichever is more conservative.

2.8.2 When PDMS is OPERABLE, no AFD Acceptable Operation Limits are applicable.

2.9 Departure from Nucleate Boiling Ratio (DNBR) (LCO 3.2.5)

$$2.9.1 \quad DNBR_{APSL} \geq 1.536$$

The Axial Power Shape Limiting DNBR ( $DNBR_{APSL}$ ) is applicable with THERMAL POWER  $\geq 50\%$  RTP when PDMS is OPERABLE.


## 2.9.2 PDMS Alarms:

DNBR Warning Setpoint  $\geq 2\%$  of DNBR Margin

DNBR Alarm Setpoint  $\geq 0\%$  of DNBR Margin

## CORE OPERATING LIMITS REPORT (COLR) for BRAIDWOOD UNIT 2 CYCLE 9A

Figure 2.8.1 Axial Flux Difference Limits as a Function of Rated Thermal Power

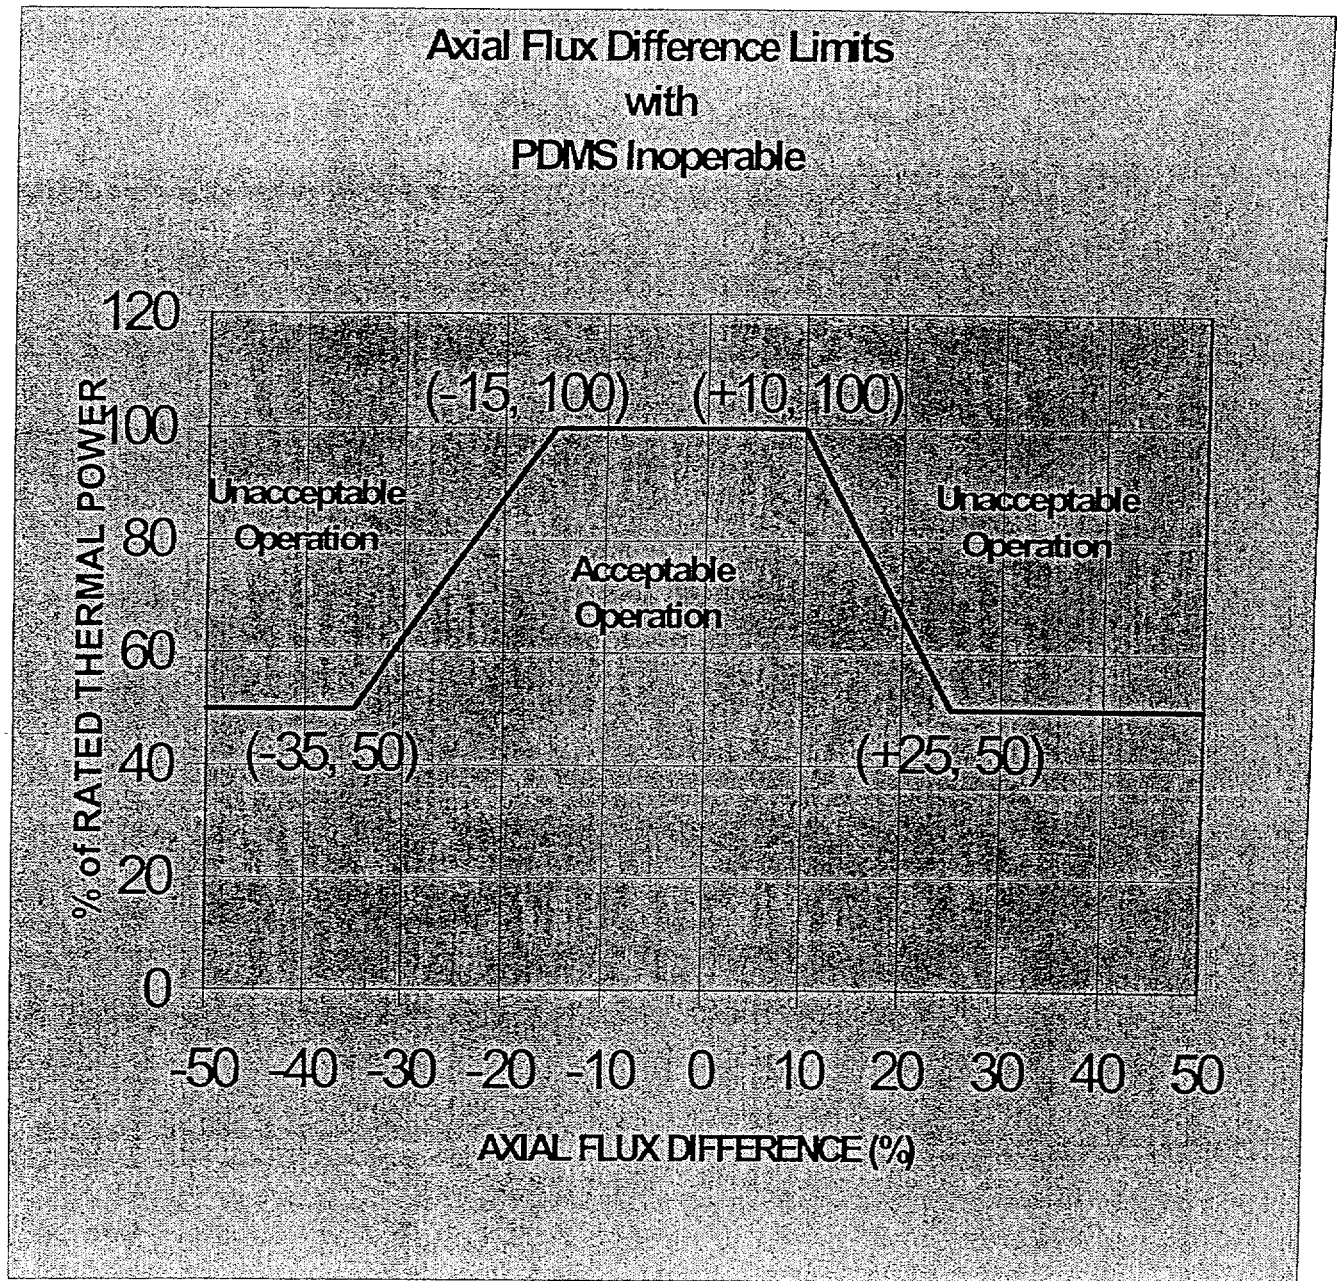

## CORE OPERATING LIMITS REPORT (COLR) for BRAIDWOOD UNIT 2 CYCLE 9A

2.10 Reactor Trip System Overtemperature  $\Delta T$  Setpoint Parameter Values (LCO 3.3.1)

- 2.10.1 The Overtemperature  $\Delta T$  reactor trip setpoint  $K_1$  shall be equal to 1.325.
- 2.10.2 The Overtemperature  $\Delta T$  reactor trip setpoint  $T_{avg}$  coefficient  $K_2$  shall be equal to 0.0297 / °F.
- 2.10.3 The Overtemperature  $\Delta T$  reactor trip setpoint pressure coefficient  $K_3$  shall be equal to 0.00181 / psig.
- 2.10.4 The nominal  $T_{avg}$  at RTP (indicated)  $T'$  shall be less than or equal to 588.0 °F.
- 2.10.5 The nominal RCS operating pressure (indicated)  $P'$  shall be equal to 2235 psig.
- 2.10.6 The measured reactor vessel  $\Delta T$  lead/lag time constant  $\tau_1$  shall be equal to 8 sec.
- 2.10.7 The measured reactor vessel  $\Delta T$  lead/lag time constant  $\tau_2$  shall be equal to 3 sec.
- 2.10.8 The measured reactor vessel  $\Delta T$  lag time constant  $\tau_3$  shall be less than or equal to 2 sec.
- 2.10.9 The measured reactor vessel average temperature lead/lag time constant  $\tau_4$  shall be equal to 33 sec.
- 2.10.10 The measured reactor vessel average temperature lead/lag time constant  $\tau_5$  shall be equal to 4 sec.
- 2.10.11 The measured reactor vessel average temperature lag time constant  $\tau_6$  shall be less than or equal to 2 sec.
- 2.10.12 The  $f_1(\Delta I)$  "positive" breakpoint shall be +10%  $\Delta I$ .
- 2.10.13 The  $f_1(\Delta I)$  "negative" breakpoint shall be -18%  $\Delta I$ .
- 2.10.14 The  $f_1(\Delta I)$  "positive" slope shall be +3.47% / %  $\Delta I$ .
- 2.10.15 The  $f_1(\Delta I)$  "negative" slope shall be -2.61% / %  $\Delta I$ .

2.11 Reactor Trip System Overpower  $\Delta T$  Setpoint Parameter Values (LCO 3.3.1)

- 2.11.1 The Overpower  $\Delta T$  reactor trip setpoint  $K_4$  shall be equal to 1.072.
- 2.11.2 The Overpower  $\Delta T$  reactor trip setpoint  $T_{avg}$  rate/lag coefficient  $K_5$  shall be equal to 0.02 / °F for increasing  $T_{avg}$ .
- 2.11.3 The Overpower  $\Delta T$  reactor trip setpoint  $T_{avg}$  rate/lag coefficient  $K_5$  shall be equal to 0 / °F for decreasing  $T_{avg}$ .

## CORE OPERATING LIMITS REPORT (COLR) for BRAIDWOOD UNIT 2 CYCLE 9A

- 2.11.4 The Overpower  $\Delta T$  reactor trip setpoint  $T_{avg}$  heatup coefficient  $K_6$  shall be equal to  $0.00245 / ^\circ\text{F}$  when  $T > T''$ .
- 2.11.5 The Overpower  $\Delta T$  reactor trip setpoint  $T_{avg}$  heatup coefficient  $K_6$  shall be equal to  $0 / ^\circ\text{F}$  when  $T \leq T''$ .
- 2.11.6 The nominal  $T_{avg}$  at RTP (indicated)  $T''$  shall be less than or equal to  $588.0 ^\circ\text{F}$ .
- 2.11.7 The measured reactor vessel  $\Delta T$  lead/lag time constant  $\tau_1$  shall be equal to 8 sec.
- 2.11.8 The measured reactor vessel  $\Delta T$  lead/lag time constant  $\tau_2$  shall be equal to 3 sec.
- 2.11.9 The measured reactor vessel  $\Delta T$  lag time constant  $\tau_3$  shall be less than or equal to 2 sec.
- 2.11.10 The measured reactor vessel average temperature lag time constant  $\tau_6$  shall be less than or equal to 2 sec.
- 2.11.11 The measured reactor vessel average temperature rate/lag time constant  $\tau_7$  shall be equal to 10 sec.
- 2.11.12 The  $f_2(\Delta I)$  "positive" breakpoint shall be 0 for all  $\Delta I$ .
- 2.11.13 The  $f_2(\Delta I)$  "negative" breakpoint shall be 0 for all  $\Delta I$ .
- 2.11.14 The  $f_2(\Delta I)$  "positive" slope shall be 0 for all  $\Delta I$ .
- 2.11.15 The  $f_2(\Delta I)$  "negative" slope shall be 0 for all  $\Delta I$ .
- 2.12 Reactor Coolant System (RCS) DNB Parameter Limits (LCO 3.4.1)
- 2.12.1 The pressurizer pressure shall be greater than or equal to 2209 psig.
- 2.12.2 The RCS average temperature ( $T_{avg}$ ) shall be less than or equal to  $593.1 ^\circ\text{F}$ .
- 2.12.3 The RCS total flow rate shall be greater than or equal to 386,000 gpm.
- 2.13 Boron Concentration
- 2.13.1 The refueling boron concentration shall be greater than or equal to 2000 ppm (LCO 3.9.1).
- 2.13.2 The Reactor Coolant System boron concentration, with all shutdown and control rods fully withdrawn, shall be greater than or equal to 2143 ppm to maintain adequate shutdown margin for MODES 3, 4, and 5 during performance of rod drop time measurements and during the surveillance of Digital Rod Position Indication (DRPI) for OPERABILITY (TLCO 3.1.g and TLCO 3.1.k.2).



W/O Task: 99222769 01

Status: READY

02/08/02

Desc : EM 2AF01EA-1 BATTERY CHGR CLEAN &amp; INSPECT PM

* Fac	Type	Sub	Document Number	Sheet	Prt	Ole	Image
<input type="checkbox"/>	BRW	DWGC	20E-2-4030AF02		Y	<input type="checkbox"/>	
			Title: SCHEMATIC DIAGRAM AUXILIARY FEEDWATER PUMP 2B (DIE				
<input type="checkbox"/>	BRW	DWGC	20E-2-4030AF12		Y	<input type="checkbox"/>	
			Title: SCHEMATIC DIAGRAM AUXILIARY BUILDING PUMP 2B				
<input type="checkbox"/>	BRW	DWGC	20E-2-4030AF19		Y	<input type="checkbox"/>	
			Title: SCHEMATIC DIAGRAM 32V DC BATTERY CHARGER 2AF01EA-1				
<input type="checkbox"/>	BRW	DWGC	20E-2-4469F		Y	<input type="checkbox"/>	
			Title: EXTERNAL WIRING DIAGRAM AUXILIARY FEEDWATER PUMP 2				
<input type="checkbox"/>	BRW	DWGC	20E-2-4469H		Y	<input type="checkbox"/>	
			Title: INTERNAL WIRING DIAGRAM BATTERY CHARGER 2AF01EA-1				
<input type="checkbox"/>	BRW	PROC STN	BWHS 4002-089		Y	<input type="checkbox"/>	
			Title: AUXILIARY FEEDWATER DIESEL BATTERY CHARGER AC INPU				

More:

Use Execute with Select to create Markup.