


FENOC

FirstEnergy Nuclear Operating Company

Beaver Valley Power Station - Units 1 & 2

**Annual
Radioactive Effluent Release Report
Calendar Year - 2002**

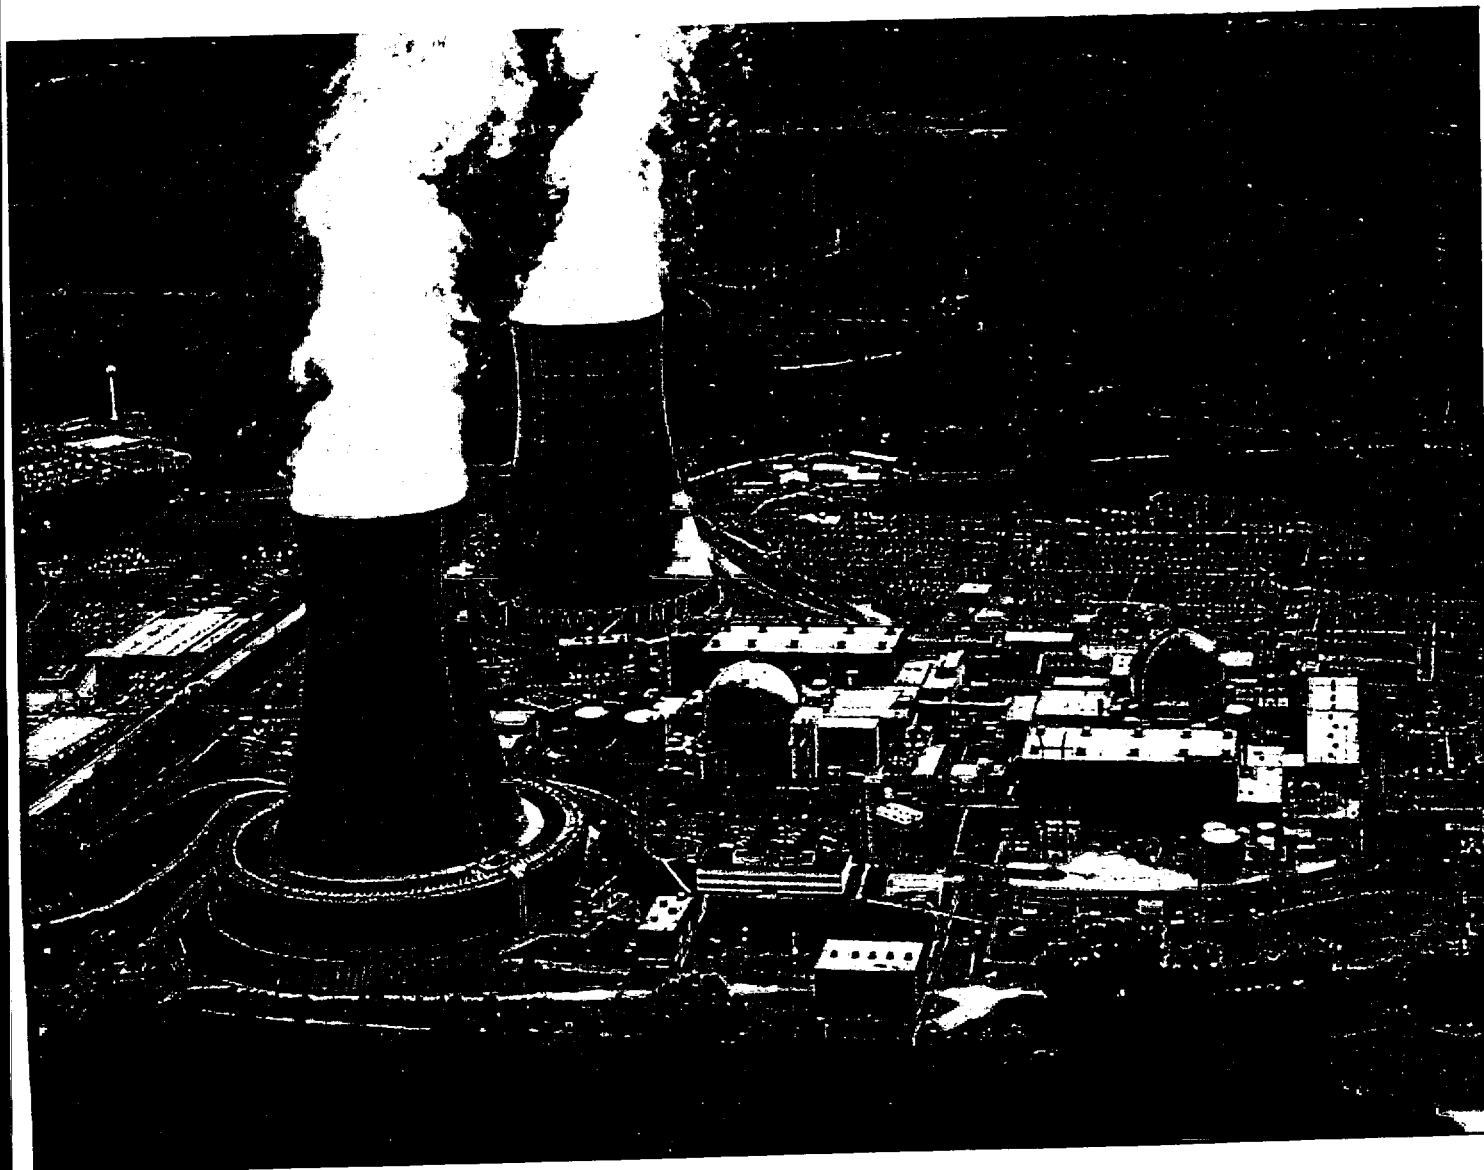



FirstEnergy Nuclear Operating Company

Beaver Valley Power Station
Route 168
P.O. Box 4
Shippingport, PA 15077-0004

Mark B. Bezilla
Site Vice President

724-682-5234
Fax: 724-643-8069

April 25, 2003
L-03-072

U. S. Nuclear Regulatory Commission
Attention: Document Control Desk
Washington, DC 20555-0001

Subject: Beaver Valley Power Station, Unit No. 1 and No. 2
BV-1 Docket No. 50-334, License No. DPR-66
BV-2 Docket No. 50-412, License No. NPF-73
Annual Radioactive Effluent Release Report for 2002

- Reference: 1) FENOC; Beaver Valley Power Station Unit 1 and Unit 2 Technical Specification 6.9.3, Annual Radioactive Effluent Release Report
- 2) USNRC; Regulatory Guide 1.21 - Measuring, Evaluating, and Reporting Radioactivity in Solid Wastes and Releases of Radioactive Materials in Liquid and Gaseous Effluents from Light-Water-Cooled Nuclear Power Plants, Revision 1, June 1974
- 3) FENOC; BV-1 and 2 Offsite Dose Calculation Manual, 1/2-ODC-3.03 Report 6.9.3

The Annual Radioactive Effluent Release Report is hereby submitted for year 2002 for Beaver Valley Power Station (BVPS) Units 1 and 2 in accordance with the requirements of Reference (1). This report also contains the information required by References (2) and (3).


This report is considered a single submittal for the two unit site. This report combines those sections that are common to both units at the site. However, where the two units have separate radwaste systems, the report does specify the releases of radioactive material from each unit. In reference to this, Unit 1 and Unit 2 have shared radwaste systems for gaseous elevated releases and for liquid releases. The report format is summarized in the index.

The following is a summary of the liquid and gaseous effluent control program at BVPS during 2002:

- Unit 1 and 2 discharged $3.16\text{E}+6$ liters of liquid waste (undiluted volume). The total activity discharged from the site was 355 curies of tritium, and 0.147 curies of fission and activation products. The Unit 1 or 2 Total Body Dose for the year was 0.0104 mrem, or 0.345% of the 3 mrem per unit annual limit. The Unit 1 or 2 Highest Organ (GI-LII) Dose for the year was 0.0124 mrem, or 0.124% of the 10 mrem per unit annual limit.
- In 2002, a major project was completed to reduce silica content in the Coolant Recovery Tanks and the Boric Acid Hold Tank. In order to minimize the effects on liquid waste activity and offsite dose consequence, a Reverse-Osmosis skid was used to process and recycle the water. As a result, ~95% of the water (104,000 gallons containing 1,182 curies of tritium) was not discharged to the environment.
- Unit 1 and 2 discharged $1.17\text{E}+4$ cuft of stored gaseous radwaste. The total activity discharged from all site gaseous releases was 167 curies of tritium, and 25.6 curies of fission and activation gases. The Unit 1 or 2 Highest Gamma Air Dose for the year was 0.0081 mrad, or 0.0081% of the 10 mrad per unit annual limit. The Unit 1 or 2 Highest Beta Air Dose for the year was 0.063 mrad, or 0.31% of the 20 mrad per unit annual limit. The Unit 1 or 2 Highest Organ (Thyroid) Dose for the year was 1.18 mrem, or 7.85% of the 15 mrem per unit annual limit.
- There were no abnormal liquid releases during the report period.
- There were no abnormal gaseous releases during the report period.
- All Effluent Monitoring Instrumentation Channels were returned to OPERABLE status within 30 days during 2002.
- There were no ODCM Surveillance Deficiencies during 2002.

There are no regulatory commitments identified in this document. If there are any questions concerning this report, please contact Mr. Larry R. Freeland, Manager, Regulatory Affairs/Performance Improvement at 724-682-5284.

Sincerely,



Mark B. Bezilla

Enclosure

Beaver Valley Power Station, Unit No. 1 and No. 2
Annual Radioactive Effluent Release Report for 2002
L-03-072
Page 3

c: United States Nuclear Regulatory Commission
Regional Administrator, Region I
475 Allendale Road
King of Prussia, PA 19406

United States Nuclear Regulatory Commission
Resident Inspector
Beaver Valley Power Station

American Nuclear Insurers Library
Town Center, Suite 300S
29 South Main Street
West Hartford, CT 06107-2445

Department of Environmental Protection
Bureau of Radiation Protection & Toxicology
P.O. Box 2063
Harrisburg, PA 17120

INPO (Attn: Bill Nestel)
700 Galleria Parkway SE
Suite 100
Atlanta, GA 30339-5957

First Energy Nuclear Operating Company
FENOC

Beaver Valley Power Station - Units 1 & 2

Annual

Radioactive Effluent Release Report
Calendar Year - 2002

Beaver Valley Power Station - Units 1 & 2

Annual Radioactive Effluent Release Report

Calendar Year - 2002

Index

Table No.	Title	Page
	Supplemental Information Page	1
Table 1A	Gaseous Effluents - Summation Of All Releases	2
Table 1B-EB	Gaseous Effluents - Elevated Batch Releases	3
Table 1B-EC	Gaseous Effluents - Elevated Continuous Releases	4
Table 1C-GB1	Gaseous Effluents - Ground Level Batch Releases (Unit 1)	5
Table 1C-GC1	Gaseous Effluents - Ground Level Continuous Releases (Unit 1)	6
Table 1C-GB2	Gaseous Effluents - Ground Level Batch Releases (Unit 2)	7
Table 1C-GC2	Gaseous Effluents - Ground Level Continuous Releases (Unit 2)	8
Table 2A	Liquid Effluents - Summation Of All Releases	9
Table 2B-B	Liquid Effluents - Batch Releases	10
Table 2B-C	Liquid Effluents - Continuous Releases	11
Table 3A	Solid Waste And Irradiated Fuel Shipments (Part 1 of 3)	12
Table 3B	Solid Waste And Irradiated Fuel Shipments (Part 2 of 3)	13
Table 3C	Solid Waste And Irradiated Fuel Shipments (Part 3 of 3)	14
Table 4	Lower Limits Of Detectability	15
Table 5A	Assessment Of Radiation Doses (Unit 1)	16
Table 5B	Assessment Of Radiation Doses (Unit 2)	17
Table 6	Effluent Monitoring Instrumentation Channels Not Returned To Operable Status Within 30 Days	18
Table 7	Total Dose Commitments, Total Effective Dose Equivalents and Population Doses	19
Table 8	Offsite Dose Calculation Manual Surveillance Deficiencies	20
Table 9	Unit 1 and 2 Offsite Dose Calculation Manual Changes (Description)	21
Attachment 1	Joint Frequency Distribution Tables	
Attachment 2	Unit 1 and 2 Offsite Dose Calculation Manual (Complete Copy)	

Annual Radioactive Effluent Release Report

Calendar Year - 2002

Page 1 of 21

Supplemental Information Page

FACILITY: B.V.P.S. Units 1 and 2	LICENSEE: FENOC
---	------------------------

1. Regulatory Limits	
a. Fission and activation gases:	Annual Unit 1 or 2 Dose: 10 mrad from Gamma, & 20 mrad from Beta
b. Iodines & particulates, half-lives > 8 days:	Annual Unit 1 or 2 Dose: 15 mrem to Any Organ
c. Liquid effluents:	Annual Unit 1 or 2 Dose: 3 mrem to Total Body, & 10 mrem to Any Organ

2. Maximum Permissible Concentrations Used in Determining Allowable Release Rates Or Concentrations	
a. Fission and activation gases:	Site Release Rate: 500 mrem/yr to Total Body, & 3000 mrem/yr to the Skin
b. Iodines & particulates, half-lives > 8 days:	Site Release Rate: 1500 mrem/yr to Any Organ
c. Liquid effluents:	Site Release Concentration: 10 times 10 CFR 20 Appendix B, Table 2, EC's

3. Average Energy (Not Applicable To The BVPS ODCM)	
--	--

4. Measurements and Approximations of Total Radioactivity	
The methods used to measure or approximate the total radioactivity in effluents, and the methods used to determine radionuclide composition are as follows:	
a. Fission and activation gases:	Ge Gamma Spectrometry, Liquid Scintillation Counter
b. Iodines:	Ge Gamma Spectrometry
c. Particulates, half-lives > 8 days:	Ge Gamma Spectrometry, Proportional Counter
d. Liquid effluents:	Ge Gamma Spectrometry, Proportional Counter, Liquid Scintillation

5. Batch & Abnormal Release Information	Unit	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Calendar Year
a. Liquid Batch Releases						
1. Number of batch releases		21	25	23	15	84
2. Total time period for batch releases	minutes	5163	6236	6886	4072	22357
3. Maximum time period for a batch release	minutes	1051	972	1130	1033	1130
4. Average time period for batch releases	minutes	246	249	299	271	266
5. Minimum time period for a batch release	minutes	67	70	65	68	65
6. Average river flow during release periods	cuft/sec	41867	65500	9700	28600	36417
b. Gaseous Batch Releases						
1. Number of batch releases		5	5	8	14	32
2. Total time period for batch releases	minutes	5796	1945	3077	19969	30787
3. Maximum time period for a batch release	minutes	4488	900	993	5583	5583
4. Average time period for batch releases	minutes	1159	389	385	1426	962
5. Minimum time period for a batch release	minutes	1	11	60	71	1
c. Abnormal Liquid Releases						
1. Number of releases		NONE	NONE	NONE	NONE	NONE
2. Total activity released	Curies	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
d. Abnormal Gaseous Releases						
1. Number of releases		NONE	NONE	NONE	NONE	NONE
2. Total activity released	Curies	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00

Beaver Valley Power Station - Units 1 & 2**Annual Radioactive Effluent Release Report**

Calendar Year - 2002

Page 2 of 21

Table 1A

Gaseous Effluents - Summation Of All Releases

	Unit	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Calendar Year	Total Error, %
--	------	-------------	-------------	-------------	-------------	---------------	----------------

A. Fission & Activation Gases

1. Site Total release	CI	5.13E-03	4.09E-04	2.41E+00	2.32E+01	2.56E+01	2.65E+01
1a. Unit 1 Gases	CI	2.57E-03	2.05E-04	2.35E+00	1.67E+01	1.91E+01	
1b. Unit 2 Gases	CI	2.57E-03	2.05E-04	6.01E-02	6.51E+00	6.58E+00	
2. Average release rate for period	uCi/sec	6.51E-04	5.19E-05	3.06E-01	2.95E+00	8.14E-01	
3. Percent of applicable limit	%	N/A	N/A	N/A	N/A	N/A	

B. Iodines

1. Site Total iodine - 131	CI	9.93E-07	0.00E+00	0.00E+00	3.64E-04	3.65E-04	2.83E+01
1a. Unit 1 iodine - 131	CI	4.97E-07	0.00E+00	0.00E+00	3.11E-04	3.11E-04	
1b. Unit 2 iodine - 131	CI	4.97E-07	0.00E+00	0.00E+00	5.30E-05	5.35E-05	
2. Average release rate for period	uCi/sec	1.26E-07	0.00E+00	0.00E+00	4.62E-05	1.16E-05	
3. Percent of applicable limit	%	N/A	N/A	N/A	N/A	N/A	

C. Particulates

1. Particulates with half-lives > 8 days	CI	1.85E-04	0.00E+00	0.00E+00	7.48E-03	7.67E-03	3.00E+01
1a. Unit 1 Particulates	CI	0.00E+00	0.00E+00	0.00E+00	3.74E-03	3.74E-03	
1b. Unit 2 Particulates	CI	1.85E-04	0.00E+00	0.00E+00	3.74E-03	3.93E-03	
2. Average release rate for period	uCi/sec	2.35E-05	0.00E+00	0.00E+00	9.49E-04	2.43E-04	
3. Percent of applicable limit	%	N/A	N/A	N/A	N/A	N/A	

D. Gross Alpha

1. Site Gross alpha radioactivity	CI	0.00E+00	0.00E+00	1.11E-06	4.12E-07	1.52E-06	3.00E+01
1a. Unit 1 Gross alpha	CI	0.00E+00	0.00E+00	9.61E-07	3.91E-07	1.35E-06	
1b. Unit 2 Gross alpha	CI	0.00E+00	0.00E+00	1.45E-07	2.18E-08	1.67E-07	
2. Average release rate for period	uCi/sec	0.00E+00	0.00E+00	1.41E-07	5.23E-08	4.83E-08	
3. Percent of applicable limit	%	N/A	N/A	N/A	N/A	N/A	

E. Tritium

1. Site Total release	CI	5.56E+01	4.78E+01	4.14E+01	2.22E+01	1.67E+02	3.29E+01
1a. Unit 1 Tritium	CI	4.68E+01	3.85E+01	3.75E+01	1.78E+01	1.41E+02	
1b. Unit 2 Tritium	CI	8.51E+00	9.25E+00	3.92E+00	4.32E+00	2.60E+01	
2. Average release rate for period	uCi/sec	7.06E+00	6.07E+00	5.25E+00	2.82E+00	5.30E+00	
3. Percent of applicable limit	%	N/A	N/A	N/A	N/A	N/A	

N/A = Not Applicable

The amount of time (in seconds) used to calculate the release rates specified in A.2, B.2, C.2, D.2 and E.2 is the average amount of seconds per calendar quarter (7.88E+06 seconds)

Annual Radioactive Effluent Release Report

Calendar Year - 2002

Page 3 of 21

Table 1B-EB

Gaseous Effluents - Elevated Batch Releases

Nuclides released	Unit	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Calendar Year
1. Fission gases						
argon-41	Ci	LLD	LLD	LLD	LLD	LLD
krypton-85	Ci	5.13E-03	4.09E-04	1.02E-01	2.98E+00	3.09E+00
krypton-85m	Ci	LLD	LLD	LLD	LLD	LLD
krypton-87	Ci	LLD	LLD	LLD	LLD	LLD
krypton-88	Ci	LLD	LLD	LLD	LLD	LLD
xenon-131m	Ci	LLD	LLD	LLD	1.26E-01	1.26E-01
xenon-133	Ci	LLD	LLD	LLD	8.16E+00	8.16E+00
xenon-133m	Ci	LLD	LLD	LLD	1.18E-01	1.18E-01
xenon-135	Ci	LLD	LLD	LLD	1.67E-01	1.67E-01
xenon-135m	Ci	LLD	LLD	LLD	3.30E-03	3.30E-03
xenon-138	Ci	LLD	LLD	LLD	LLD	LLD
unidentified	Ci	NONE	NONE	NONE	NONE	NONE
Total for period	Ci	5.13E-03	4.09E-04	1.02E-01	1.16E+01	1.17E+01
2. Iodines						
iodine-131	Ci	LLD	LLD	LLD	LLD	LLD
iodine-133	Ci	LLD	LLD	LLD	LLD	LLD
iodine-135	Ci	LLD	LLD	LLD	LLD	LLD
Total for period	Ci	ND	ND	ND	ND	ND
3. Particulates						
chromium-51	Ci	LLD	LLD	LLD	LLD	LLD
manganese-54	Ci	LLD	LLD	LLD	LLD	LLD
iron-59	Ci	LLD	LLD	LLD	LLD	LLD
cobalt-57	Ci	LLD	LLD	LLD	LLD	LLD
cobalt-58	Ci	LLD	LLD	LLD	7.48E-03	7.48E-03
cobalt-60	Ci	LLD	LLD	LLD	LLD	LLD
zinc-65	Ci	LLD	LLD	LLD	LLD	LLD
strontium-89	Ci	LLD	LLD	LLD	LLD	LLD
strontium-90	Ci	LLD	LLD	LLD	LLD	LLD
molybdenum-99	Ci	LLD	LLD	LLD	LLD	LLD
cesium-134	Ci	LLD	LLD	LLD	LLD	LLD
cesium-137	Ci	LLD	LLD	LLD	LLD	LLD
barium/lanthanum-140	Ci	LLD	LLD	LLD	LLD	LLD
cerium-141	Ci	LLD	LLD	LLD	LLD	LLD
cerium-144	Ci	LLD	LLD	LLD	LLD	LLD
unidentified	Ci	NONE	NONE	NONE	NONE	NONE
Total for period	Ci	ND	ND	ND	7.48E-03	7.48E-03

LLD = Below the Lower Limit of Detectability, in uCi/cc (Table 4)

ND = None Detected

Annual Radioactive Effluent Release Report

Calendar Year - 2002

Page 4 of 21

Table 1B-EC

Gaseous Effluents - Elevated Continuous Releases

Nuclides released	Unit	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Calendar Year
1. Fission gases						
argon-41	Ci	LLD	LLD	LLD	LLD	LLD
krypton-85	Ci	LLD	LLD	LLD	LLD	LLD
krypton-85m	Ci	LLD	LLD	LLD	LLD	LLD
krypton-87	Ci	LLD	LLD	LLD	LLD	LLD
krypton-88	Ci	LLD	LLD	LLD	LLD	LLD
xenon-131m	Ci	LLD	LLD	LLD	LLD	LLD
xenon-133	Ci	LLD	LLD	LLD	1 40E+00	1 40E+00
xenon-133m	Ci	LLD	LLD	LLD	LLD	LLD
xenon-135	Ci	LLD	LLD	LLD	1 94E-02	1 94E-02
xenon-135m	Ci	LLD	LLD	LLD	LLD	LLD
xenon-138	Ci	LLD	LLD	LLD	LLD	LLD
unidentified	Ci	NONE	NONE	NONE	NONE	NONE
Total for period	Ci	ND	ND	ND	1 42E+00	1 42E+00
2. Iodines						
iodine-131	Ci	9 93E-07	LLD	LLD	1 06E-04	1 07E-04
iodine-133	Ci	LLD	LLD	LLD	LLD	LLD
iodine-135	Ci	LLD	LLD	LLD	LLD	LLD
Total for period	Ci	9 93E-07	ND	ND	1 06E-04	1 07E-04
3. Particulates						
chromium-51	Ci	LLD	LLD	LLD	LLD	LLD
manganese-54	Ci	LLD	LLD	LLD	LLD	LLD
iron-59	Ci	LLD	LLD	LLD	LLD	LLD
cobalt-57	Ci	LLD	LLD	LLD	LLD	LLD
cobalt-58	Ci	LLD	LLD	LLD	LLD	LLD
cobalt-60	Ci	LLD	LLD	LLD	LLD	LLD
zinc-65	Ci	LLD	LLD	LLD	LLD	LLD
strontium-89	Ci	LLD	LLD	LLD	LLD	LLD
strontium-90	Ci	LLD	LLD	LLD	LLD	LLD
molybdenum-99	Ci	LLD	LLD	LLD	LLD	LLD
cesium-134	Ci	LLD	LLD	LLD	LLD	LLD
cesium-137	Ci	LLD	LLD	LLD	LLD	LLD
barium/lanthanum-140	Ci	LLD	LLD	LLD	LLD	LLD
cerium-141	Ci	LLD	LLD	LLD	LLD	LLD
cerium-144	Ci	LLD	LLD	LLD	LLD	LLD
unidentified	Ci	NONE	NONE	NONE	NONE	NONE
Total for period	Ci	ND	ND	ND	ND	ND

LLD = Below the Lower Limit of Detectability, in uCi/cc (Table 4)

ND = None Detected

Beaver Valley Power Station - Unit 1**Annual Radioactive Effluent Release Report**

Calendar Year - 2002

Page 5 of 21

Table 1C-GB1

Gaseous Effluents - Ground Level Batch Releases (Unit 1)

Nuclides released	Unit	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Calendar Year
1. Fission gases						
argon-41	Ci	LLD	LLD	LLD	LLD	LLD
krypton-85	Ci	LLD	LLD	LLD	6.67E+00	6.67E+00
krypton-85m	Ci	LLD	LLD	LLD	LLD	LLD
krypton-87	Ci	LLD	LLD	LLD	LLD	LLD
krypton-88	Ci	LLD	LLD	LLD	LLD	LLD
xenon-131m	Ci	LLD	LLD	LLD	LLD	LLD
xenon-133	Ci	LLD	LLD	LLD	2.52E+00	2.52E+00
xenon-133m	Ci	LLD	LLD	LLD	LLD	LLD
xenon-135	Ci	LLD	LLD	LLD	1.28E-01	1.28E-01
xenon-135m	Ci	LLD	LLD	LLD	LLD	LLD
xenon-138	Ci	LLD	LLD	LLD	LLD	LLD
unidentified	Ci	NONE	NONE	NONE	NONE	NONE
Total for period	Ci	ND	ND	ND	9.32E+00	9.32E+00
2. Iodines						
iodine-131	Ci	LLD	LLD	LLD	LLD	LLD
iodine-133	Ci	LLD	LLD	LLD	LLD	LLD
iodine-135	Ci	LLD	LLD	LLD	LLD	LLD
Total for period	Ci	ND	ND	ND	ND	ND
3. Particulates						
chromium-51	Ci	LLD	LLD	LLD	LLD	LLD
manganese-54	Ci	LLD	LLD	LLD	LLD	LLD
iron-59	Ci	LLD	LLD	LLD	LLD	LLD
cobalt-57	Ci	LLD	LLD	LLD	LLD	LLD
cobalt-58	Ci	LLD	LLD	LLD	LLD	LLD
cobalt-60	Ci	LLD	LLD	LLD	LLD	LLD
zinc-65	Ci	LLD	LLD	LLD	LLD	LLD
strontium-89	Ci	LLD	LLD	LLD	LLD	LLD
strontium-90	Ci	LLD	LLD	LLD	LLD	LLD
molybdenum-99	Ci	LLD	LLD	LLD	LLD	LLD
cesium-134	Ci	LLD	LLD	LLD	LLD	LLD
cesium-137	Ci	LLD	LLD	LLD	LLD	LLD
barium/lanthanum-140	Ci	LLD	LLD	LLD	LLD	LLD
cerium-141	Ci	LLD	LLD	LLD	LLD	LLD
cerium-144	Ci	LLD	LLD	LLD	LLD	LLD
unidentified	Ci	NONE	NONE	NONE	NONE	NONE
Total for period	Ci	ND	ND	ND	ND	ND

LLD = Below the Lower Limit of Detectability, in uCi/cc (Table 4)

ND = None Detected

Beaver Valley Power Station - Unit 1**Annual Radioactive Effluent Release Report**

Calendar Year - 2002

Page 6 of 21

Table 1C-GC1

Gaseous Effluents - Ground Level Continuous Releases (Unit 1)

Nuclides released	Unit	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Calendar Year
1. Fission gases						
argon-41	Ci	LLD	LLD	LLD	LLD	LLD
krypton-85	Ci	LLD	LLD	LLD	LLD	LLD
krypton-85m	Ci	LLD	LLD	LLD	5.20E-01	5.20E-01
krypton-87	Ci	LLD	LLD	LLD	LLD	LLD
krypton-88	Ci	LLD	LLD	LLD	LLD	LLD
xenon-131m	Ci	LLD	LLD	LLD	LLD	LLD
xenon-133	Ci	LLD	LLD	2.30E+00	2.73E-01	2.57E+00
xenon-133m	Ci	LLD	LLD	LLD	LLD	LLD
xenon-135	Ci	LLD	LLD	LLD	1.20E-01	1.20E-01
xenon-135m	Ci	LLD	LLD	LLD	LLD	LLD
xenon-138	Ci	LLD	LLD	LLD	LLD	LLD
unidentified	Ci	NONE	NONE	NONE	NONE	NONE
Total for period	Ci	ND	ND	2.30E+00	9.13E-01	3.21E+00
2. Iodines						
iodine-131	Ci	LLD	LLD	LLD	2.58E-04	2.58E-04
iodine-133	Ci	LLD	LLD	LLD	LLD	LLD
iodine-135	Ci	LLD	LLD	LLD	LLD	LLD
Total for period	Ci	ND	ND	ND	2.58E-04	2.58E-04
3. Particulates						
chromium-51	Ci	LLD	LLD	LLD	LLD	LLD
manganese-54	Ci	LLD	LLD	LLD	LLD	LLD
iron-59	Ci	LLD	LLD	LLD	LLD	LLD
cobalt-57	Ci	LLD	LLD	LLD	LLD	LLD
cobalt-58	Ci	LLD	LLD	LLD	LLD	LLD
strontium-89	Ci	LLD	LLD	LLD	LLD	LLD
strontium-90	Ci	LLD	LLD	LLD	LLD	LLD
zirconium/niobium-95	Ci	LLD	LLD	LLD	LLD	LLD
zirconium/niobium-97	Ci	LLD	LLD	LLD	LLD	LLD
molybdenum-99	Ci	LLD	LLD	LLD	LLD	LLD
cesium-134	Ci	LLD	LLD	LLD	LLD	LLD
cesium-137	Ci	LLD	LLD	LLD	LLD	LLD
barium/lanthanum-140	Ci	LLD	LLD	LLD	LLD	LLD
cerium-141	Ci	LLD	LLD	LLD	LLD	LLD
cerium-144	Ci	LLD	LLD	LLD	LLD	LLD
unidentified	Ci	NONE	NONE	NONE	NONE	NONE
Total for period	Ci	ND	ND	ND	ND	ND

LLD = Below the Lower Limit of Detectability, in uCi/cc (Table 4)

ND = None Detected

Annual Radioactive Effluent Release Report

Calendar Year - 2002

Page 7 of 21

Table 1C-GB2

Gaseous Effluents - Ground Level Batch Releases (Unit 2)

Nuclides released	Unit	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Calendar Year
1. Fission gases						
argon-41	Ci	LLD	LLD	LLD	LLD	LLD
krypton-85	Ci	LLD	LLD	LLD	LLD	LLD
krypton-85m	Ci	LLD	LLD	LLD	LLD	LLD
krypton-87	Ci	LLD	LLD	LLD	LLD	LLD
krypton-88	Ci	LLD	LLD	LLD	LLD	LLD
xenon-131m	Ci	LLD	LLD	LLD	LLD	LLD
xenon-133	Ci	LLD	LLD	LLD	LLD	LLD
xenon-133m	Ci	LLD	LLD	LLD	LLD	LLD
xenon-135	Ci	LLD	LLD	LLD	LLD	LLD
xenon-135m	Ci	LLD	LLD	LLD	LLD	LLD
xenon-138	Ci	LLD	LLD	LLD	LLD	LLD
unidentified	Ci	NONE	NONE	NONE	NONE	NONE
Total for period	Ci	ND	ND	ND	ND	ND
2. Iodines						
iodine-131	Ci	LLD	LLD	LLD	LLD	LLD
iodine-133	Ci	LLD	LLD	LLD	LLD	LLD
iodine-135	Ci	LLD	LLD	LLD	LLD	LLD
Total for period	Ci	ND	ND	ND	ND	ND
3. Particulates						
beryllium-7	Ci	LLD	LLD	LLD	LLD	LLD
chromium-51	Ci	LLD	LLD	LLD	LLD	LLD
manganese-56	Ci	LLD	LLD	LLD	LLD	LLD
cobalt-57	Ci	LLD	LLD	LLD	LLD	LLD
cobalt-58	Ci	LLD	LLD	LLD	LLD	LLD
cobalt-60	Ci	LLD	LLD	LLD	LLD	LLD
zinc-65	Ci	LLD	LLD	LLD	LLD	LLD
strontium-89	Ci	LLD	LLD	LLD	LLD	LLD
strontium-90	Ci	LLD	LLD	LLD	LLD	LLD
zirconium/niobium-97	Ci	LLD	LLD	LLD	LLD	LLD
cesium-134	Ci	LLD	LLD	LLD	LLD	LLD
cesium-137	Ci	LLD	LLD	LLD	LLD	LLD
barium/lanthanum-140	Ci	LLD	LLD	LLD	LLD	LLD
cerium-141	Ci	LLD	LLD	LLD	LLD	LLD
cerium-144	Ci	LLD	LLD	LLD	LLD	LLD
unidentified	Ci	NONE	NONE	NONE	NONE	NONE
Total for period	Ci	ND	ND	ND	ND	ND

LLD = Below the Lower Limit of Detectability, in uCi/cc (Table 4)

ND = None Detected

Beaver Valley Power Station - Unit 2**Annual Radioactive Effluent Release Report**

Calendar Year - 2002

Page 8 of 21

Table 1C-GC2

Gaseous Effluents - Ground Level Continuous Releases (Unit 2)

Nuclides released	Unit	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Calendar Year
1. Fission gases						
argon-41	Ci	LLD	LLD	LLD	LLD	LLD
krypton-85	Ci	LLD	LLD	LLD	LLD	LLD
krypton-85m	Ci	LLD	LLD	LLD	LLD	LLD
krypton-87	Ci	LLD	LLD	LLD	LLD	LLD
krypton-88	Ci	LLD	LLD	LLD	LLD	LLD
xenon-131m	Ci	LLD	LLD	9.14E-03	LLD	9.14E-03
xenon-133	Ci	LLD	LLD	LLD	LLD	LLD
xenon-133m	Ci	LLD	LLD	LLD	2.74E-02	2.74E-02
xenon-135	Ci	LLD	LLD	LLD	LLD	LLD
xenon-135m	Ci	LLD	LLD	LLD	LLD	LLD
xenon-138	Ci	LLD	LLD	LLD	LLD	LLD
unidentified	Ci	NONE	NONE	NONE	NONE	NONE
Total for period	Ci	ND	ND	9.14E-03	2.74E-02	3.65E-02
2. Iodines						
iodine-131	Ci	LLD	LLD	LLD	LLD	LLD
iodine-133	Ci	LLD	LLD	LLD	LLD	LLD
iodine-135	Ci	LLD	LLD	LLD	LLD	LLD
Total for period	Ci	ND	ND	ND	ND	ND
3. Particulates						
chromium-51	Ci	LLD	LLD	LLD	LLD	LLD
manganese-54	Ci	6.21E-06	LLD	LLD	LLD	6.21E-06
iron-59	Ci	LLD	LLD	LLD	LLD	LLD
cobalt-57	Ci	LLD	LLD	LLD	LLD	LLD
cobalt-58	Ci	7.74E-05	LLD	LLD	LLD	7.74E-05
cobalt-60	Ci	4.12E-05	LLD	LLD	LLD	4.12E-05
zinc-65	Ci	LLD	LLD	LLD	LLD	LLD
strontium-89	Ci	LLD	LLD	LLD	LLD	LLD
strontium-90	Ci	LLD	LLD	LLD	LLD	LLD
zirconium/niobium-95	Ci	2.16E-05	LLD	LLD	LLD	2.16E-05
antimony-125	Ci	3.06E-05	LLD	LLD	LLD	3.06E-05
cesium-137	Ci	8.35E-06	LLD	LLD	LLD	8.35E-06
barium/lanthanum-140	Ci	LLD	LLD	LLD	LLD	LLD
cerium-141	Ci	LLD	LLD	LLD	LLD	LLD
cerium-144	Ci	LLD	LLD	LLD	LLD	LLD
unidentified	Ci	NONE	NONE	NONE	NONE	NONE
Total for period	Ci	1.85E-04	ND	ND	ND	1.85E-04

LLD = Below the Lower Limit of Detectability, in uCi/cc (Table 4)

ND = None Detected

Beaver Valley Power Station - Units 1 & 2**Annual Radioactive Effluent Release Report**

Calendar Year - 2002

Page 9 of 21

Table 2A

Liquid Effluents - Summation Of All Releases

	Unit	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Calendar Year	Total Error. %
A. Fission & activation products							
1. Total release (excl. H-3, gas & alpha)	Ci	5.01E-02	5.27E-02	3.22E-02	1.22E-02	1.47E-01	2.60E+01
2. Average diluted concentration	uCi/ml	1.26E-07	9.02E-08	3.45E-08	3.16E-08	6.39E-08	
3. Percent of applicable limit	%	2.01E+00	2.11E+00	1.29E+00	4.89E-01	1.47E+00	
B. Tritium							
1. Total release	Ci	7.83E+01	1.22E+02	7.48E+01	7.96E+01	3.55E+02	2.50E+01
2. Average diluted concentration	uCi/ml	1.97E-04	2.09E-04	7.99E-05	2.06E-04	1.54E-04	
3. Percent of applicable limit	%	1.97E+00	2.09E+00	7.99E-01	2.06E+00	1.54E+00	
C. Dissolved and entrained gases							
1. Total release	Ci	ND	3.96E-05	4.30E-05	6.21E-05	1.45E-04	2.70E+01
2. Average diluted concentration	uCi/ml		6.78E-11	4.59E-11	1.61E-10	6.28E-11	
3. Percent of applicable limit	%		3.39E-05	2.30E-05	8.04E-05	3.14E-05	
D. Gross alpha radioactivity (total release)							
	Ci	LLD	LLD	LLD	LLD	LLD	2.89E+01
E. Volume of waste released (prior to dilution)							
	liters	7.02E+05	9.65E+05	9.61E+05	5.29E+05	3.16E+06	1.12E+01
F. Volume of dilution water used							
	liters	3.97E+08	5.83E+08	9.35E+08	3.86E+08	2.30E+09	2.29E+01

LLD = Below the Lower Limit of Detectability, in uCi/ml (Table 4)

A.3 is based on a historical PA-DEP guide of 10 Ci/yr

B.3 is based on a ODCM limit of 1.00E-2 uCi/ml

C.3 is based on a ODCM limit of 2.00E-04 uCi/ml

The values listed at F are the volumes during actual liquid waste discharge periods. The total dilution volume for a continuous calendar quarter is approximately 1E+10 liters for BVPS-1 & 2 (ie.; ~ 22,800 gpm is the total dilution flowrate from the site)

Beaver Valley Power Station - Units 1 & 2**Annual Radioactive Effluent Release Report**

Calendar Year - 2002

Page 10 of 21

Table 2B-B

Liquid Effluents - Batch Releases

Nuclides released	Unit	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Calendar Year
1. Fission and activation products						
beryllium-7	CI	LLD	LLD	LLD	LLD	LLD
sodium-24	CI	LLD	LLD	LLD	LLD	LLD
chromium-51	CI	2.18E-04	3.83E-04	LLD	LLD	6.01E-04
manganese-54	CI	2.12E-04	3.72E-04	1.64E-04	4.32E-05	7.92E-04
iron-55	CI	9.20E-03	9.28E-03	1.19E-02	4.77E-03	3.51E-02
iron-59	CI	LLD	LLD	LLD	LLD	LLD
cobalt-57	CI	1.20E-04	1.24E-04	7.85E-05	LLD	3.22E-04
cobalt-58	CI	1.42E-02	1.99E-02	5.87E-03	1.25E-03	4.13E-02
cobalt-60	CI	3.11E-03	3.51E-03	2.72E-03	1.56E-03	1.09E-02
zinc-65	CI	LLD	LLD	LLD	LLD	LLD
strontium-89	CI	LLD	8.95E-05	LLD	LLD	8.95E-05
strontium-90	CI	LLD	LLD	LLD	LLD	LLD
zirconium/niobium-95	CI	3.72E-04	5.19E-04	LLD	LLD	8.92E-04
zirconium/niobium-97	CI	8.42E-03	1.42E-03	LLD	1.77E-07	9.84E-03
molybdenum-99	CI	LLD	LLD	LLD	LLD	LLD
technetium-99m	CI	LLD	LLD	LLD	LLD	LLD
tin-113	CI	LLD	LLD	LLD	LLD	LLD
silver-110m	CI	8.49E-03	2.80E-03	1.04E-02	4.22E-03	2.60E-02
antimony-122	CI	LLD	LLD	LLD	LLD	LLD
antimony-124	CI	2.33E-03	3.87E-03	LLD	LLD	6.20E-03
antimony-125	CI	3.29E-03	1.04E-02	1.06E-03	3.16E-04	1.50E-02
iodine-131	CI	LLD	LLD	LLD	LLD	LLD
cesium-134	CI	4.64E-05	3.87E-06	1.66E-06	1.33E-06	5.33E-05
cesium-137	CI	1.03E-04	1.07E-05	2.99E-05	5.68E-05	2.01E-04
barium/lanthanum-140	CI	LLD	LLD	LLD	LLD	LLD
cerium-141	CI	LLD	LLD	LLD	LLD	LLD
cerium-144	CI	LLD	LLD	LLD	LLD	LLD
unidentified	CI	NONE	NONE	NONE	NONE	NONE
Total for period	CI	5.01E-02	5.27E-02	3.22E-02	1.22E-02	1.47E-01

2. Dissolved and entrained gases						
krypton-85	CI	LLD	LLD	LLD	LLD	LLD
xenon-133	CI	LLD	3.96E-05	4.30E-05	6.21E-05	1.45E-04
xenon-133m	CI	LLD	LLD	LLD	LLD	LLD
xenon-135	CI	LLD	LLD	LLD	LLD	LLD
unidentified	CI	NONE	NONE	NONE	NONE	NONE
Total for period	CI	ND	3.96E-05	4.30E-05	6.21E-05	1.45E-04

LLD = Below the Lower Limit of Detectability, in uCi/ml (Table 4)

Beaver Valley Power Station - Units 1 & 2**Annual Radioactive Effluent Release Report**

Calendar Year - 2002

Page 11 of 21

Table 2B-C

Liquid Effluents - Continuous Releases

Nuclides released	Unit	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Calendar Year
-------------------	------	-------------	-------------	-------------	-------------	---------------

1. Fission and activation products

beryllium-7	Ci	N/A	N/A	N/A	N/A	N/A
sodium-24	Ci	N/A	N/A	N/A	N/A	N/A
chromium-51	Ci	N/A	N/A	N/A	N/A	N/A
manganese-54	Ci	N/A	N/A	N/A	N/A	N/A
iron-55	Ci	N/A	N/A	N/A	N/A	N/A
iron-59	Ci	N/A	N/A	N/A	N/A	N/A
cobalt-57	Ci	N/A	N/A	N/A	N/A	N/A
cobalt-58	Ci	N/A	N/A	N/A	N/A	N/A
cobalt-60	Ci	N/A	N/A	N/A	N/A	N/A
zinc-65	Ci	N/A	N/A	N/A	N/A	N/A
strontium-89	Ci	N/A	N/A	N/A	N/A	N/A
strontium-90	Ci	N/A	N/A	N/A	N/A	N/A
zirconium/niobium-95	Ci	N/A	N/A	N/A	N/A	N/A
zirconium/niobium-97	Ci	N/A	N/A	N/A	N/A	N/A
molybdenum-99	Ci	N/A	N/A	N/A	N/A	N/A
technetium-99m	Ci	N/A	N/A	N/A	N/A	N/A
ruthenium-103	Ci	N/A	N/A	N/A	N/A	N/A
silver-110m	Ci	N/A	N/A	N/A	N/A	N/A
antimony-124	Ci	N/A	N/A	N/A	N/A	N/A
antimony-125	Ci	N/A	N/A	N/A	N/A	N/A
iodine-131	Ci	N/A	N/A	N/A	N/A	N/A
iodine-133	Ci	N/A	N/A	N/A	N/A	N/A
cesium-134	Ci	N/A	N/A	N/A	N/A	N/A
cesium-137	Ci	N/A	N/A	N/A	N/A	N/A
barium/lanthanum-140	Ci	N/A	N/A	N/A	N/A	N/A
cerium-141	Ci	N/A	N/A	N/A	N/A	N/A
cerium-144	Ci	N/A	N/A	N/A	N/A	N/A
unidentified	Ci	N/A	N/A	N/A	N/A	N/A
Total for period	Ci	N/A	N/A	N/A	N/A	N/A

2. Dissolved and entrained gases

argon-41	Ci	N/A	N/A	N/A	N/A	N/A
xenon-133	Ci	N/A	N/A	N/A	N/A	N/A
xenon-133m	Ci	N/A	N/A	N/A	N/A	N/A
xenon-135	Ci	N/A	N/A	N/A	N/A	N/A
unidentified	Ci	N/A	N/A	N/A	N/A	N/A
Total for period	Ci	N/A	N/A	N/A	N/A	N/A

N/A = Not Applicable (liquids not discharged in a continuous mode during this period)

Annual Radioactive Effluent Release Report

Calendar Year - 2002

Page 12 of 21

Table 3A

Solid Waste And Irradiated Fuel Shipments (Part 1 of 3)

A. Solid Waste Shipped Offsite For Burial Or Disposal (Not irradiated fuel)			
1. Type of Waste (Spent resins, Filter Sludges, Evaporator Bottoms, Oil)	1st Half	2nd Half	Estimated Total Error
a. Volume Shipped	4.66E+01 m3	4.03E+01 m3	0.00E+00 % (1)
b. Volume Buried	0.00E+00 m3	0.00E+00 m3	0.00E+00 % (1)
c. Total Activity	1.73E+02 Ci	1.49E+02 Ci	3.00E+01 %
2. Estimate of Major Nuclide Composition by Type of Waste On This Table (2)	Percent (%)	Percent (%)	
H-3	0.06 %	0.04 %	
C-14	0.24 %	0.06 %	
Cr-51	0.11 %	0.16 %	
Mn-54	0.88 %	1.34 %	
Fe-55	15.10 %	2.68 %	
Fe-59	0.01 %	0.04 %	
Co-57	0.37 %	0.49 %	
Co-58	35.80 %	70.70 %	
Co-60	15.60 %	6.21 %	
Ni-59	0.19 %	0.11 %	
Ni-63	24.80 %	15.40 %	
Nb-95	0.26 %	0.13 %	
Zr-95	0.36 %	0.10 %	
Ag-110m	1.98 %	0.52 %	
Sn-113	0.02 %	0.08 %	
Sb-124	0.07 %	0.03 %	
Sb-125	0.23 %	0.12 %	
Cs-134	0.98 %	0.36 %	
Cs-137	1.93 %	0.42 %	
Co-144/Pr-144	0.26 %	0.11 %	
3. Number of Shipments	6	5	
a. Type of Container Used	LSA	4	4
	Type A	0	0
	Type B	2	1
	Large Quantity	0	0
b. Solidification Agent Used	Cement	0	0
	Urea Formaldehyde	0	0
	None	6	5
c. Mode of Transport	Truck	6	5
	Rail	0	0
d. Final Destination	Erwin, TN	3	2
	Oak Ridge, TN	3	3
e. Waste Class per 10 CFR Part 61	Class A	4	4
	Class B	2	1
	Class C	0	0
	> Class C	0	0

(1) Since container volumes are provided by the burial site, a calculational error of zero is assumed.

(2) Percent values for any nuclide that are <0.01 % are not shown on this table. Data is available upon request.

Beaver Valley Power Station - Units 1 & 2

Annual Radioactive Effluent Release Report

Calendar Year - 2002

Page 13 of 21

Table 3B

Solid Waste And Irradiated Fuel Shipments (Part 2 of 3)

A. Solid Waste Shipped Offsite For Burial Or Disposal (Not irradiated fuel)			
1. Type of Waste (Dry Compressible Waste, Contaminated Equipment, etc.)	1st Half	2nd Half	Estimated Total Error
a. Volume Shipped	4.25E+02 m3	2.41E+02 m3	0.00E+00 % (1)
b. Volume Buried	5.49E+01 m3	8.20E+01 m3	0.00E+00 % (1)
c. Total Activity	1.03E+01 Ci	8.34E-02 Ci	3.00E+01 %
2. Estimate of Major Nuclide Composition by Type of Waste On This Table (2)	Percent (%)	Percent (%)	
H-3	2.77 %	2.56 %	
C-14	1.76 %	1.27 %	
Cr-51	0.00 %	0.00 %	
Mn-54	3.96 %	0.83 %	
Fe-55	27.00 %	27.30 %	
Co-58	8.78 %	15.60 %	
Co-60	14.60 %	21.40 %	
Ni-59	0.24 %	0.27 %	
Ni-63	10.60 %	15.50 %	
Sr-90	0.09 %	0.01 %	
Nb-95	0.32 %	2.30 %	
Zr-95	0.23 %	1.15 %	
Tc-99	0.05 %	0.01 %	
Ag-110m	0.00 %	2.85 %	
Sb-124	0.00 %	0.03 %	
Sb-125	2.38 %	0.40 %	
I-129	0.05 %	0.02 %	
Cs-134	3.20 %	1.03 %	
Cs-137	23.60 %	4.72 %	
Ce-144/Pr-144	0.00 %	0.15 %	
Pu-241	0.17 %	0.31 %	
3. Number of Shipments	13	5	
a. Type of Container Used	LSA	13	5
	Type A	0	0
	Type B	0	0
	Large Quantity	0	0
b. Solidification Agent Used	Cement	0	0
	Urea Formaldehyde	0	0
	None	13	5
c. Mode of Transport	Truck	13	5
	Rail	0	0
	Other	0	0
d. Final Destination	Oak Ridge, TN	13	5
	Wampum, PA	0	0
e. Waste Class per 10 CFR Part 61	Class A	11	5
	Class B	1	0
	Class C	1	0
	> Class C	0	0

(1) Since container volumes are provided by the burial site, a calculational error of zero is assumed.

(2) Percent values for any nuclide that are <0.01 % are not shown on this table. Data is available upon request.

Beaver Valley Power Station - Units 1 & 2**Annual Radioactive Effluent Release Report**

Calendar Year - 2002

Page 14 of 21

Table 3C

Solid Waste And Irradiated Fuel Shipments (Part 3 of 3)

A. Solid Waste Shipped Offsite For Burial Or Disposal (Not irradiated fuel)				
1. Type of Waste (Irradiated components, Control Rods, etc)		1st Half	2nd Half	Estimated Total Error
a. Volume Shipped		0.00E+00 m3	0.00E+00 m3	0.00E+00 % (1)
b. Volume Buried		0.00E+00 m3	0.00E+00 m3	0.00E+00 % (1)
c. Total Activity		0.00E+00 Ci	0.00E+00 Ci	0.00E+00 %
2. Estimate of Major Nuclide Composition by Type of Waste On This Table (2)		Percent (%)	Percent (%)	
3. Number of Shipments		0	0	
a. Type of Container Used	LSA	0	0	
	Type A	0	0	
	Type B	0	0	
	Large Quantity	0	0	
b. Solidification Agent Used	Cement	0	0	
	Urea Formaldehyde	0	0	
	None	0	0	
c. Mode of Transport	Truck	0	0	
	Rail	0	0	
	Other	0	0	
d. Final Destination	Barnwell, SC	0	0	
	Oak Ridge, TN	0	0	
e. Waste Class per 10 CFR Part 61	Class A	0	0	
	Class B	0	0	
	Class C	0	0	
	> Class C	0	0	
B. No Irradiated Fuel Shipments				

(1) Since container volumes are provided by the burial site, a calculational error of zero is assumed.

(2) Percent values for any nuclide that are <0.01 % are not shown on this table. Data is available upon request.

Annual Radioactive Effluent Release Report

Calendar Year - 2002

Page 15 of 21

Table 4

Lower Limits Of Detectability (LLD)

RWDA-G 1000 cc Gas Grab Sample			RWDA-L 1000 ml Liquid Grab Sample			Filter Paper / Charcoal Continuous Effluent Sample		
Nuclide	(3) Calculated LLD (uCi/cc)	ODCM Required LLD (uCi/cc)	(3) Calculated LLD (uCi/ml)	ODCM Required LLD (uCi/ml)	(3) Calculated (2) LLD (uCi/cc)	ODCM Required LLD (uCi/cc)		
H-3	(4)	1.00E-06	1.00E-06	1E-05		
Na-24		8.06E-08	1.59E-08	5E-07	1.53E-13	1E-11		
Ar-41		1.09E-07	2.16E-08	5E-07		
Cr-51		1.11E-06	2.22E-07	5E-07	1.65E-12	1E-11		
Mn-54		7.45E-08	1.45E-08	5E-07	9.75E-14	1E-11		
Fe-55	(1)	1.00E-06	1E-06		
Fe-59		2.05E-07	4.02E-08	5E-07	2.22E-13	1E-11		
Co-57		7.88E-08	1.81E-08	5E-07	1.15E-13	1E-11		
Co-58		8.95E-08	1.75E-08	5E-07	9.55E-14	1E-11		
Co-60		1.22E-07	2.41E-08	5E-07	2.31E-13	1E-11		
Zn-65		1.66E-07	3.27E-08	5E-07	2.21E-13	1E-11		
Kr-85		4.18E-05	8.17E-06	1E-05		
Kr-85m		9.95E-08	2.16E-08	1E-05		
Kr-87		1.87E-07	3.69E-08	1E-05		
Kr-88		3.16E-07	6.58E-08	1E-05		
Sr-89	(1)	5.00E-08	5E-08	(1)	1.00E-13	
Sr-90	(1)	5.00E-08	5E-08	(1)	1.00E-14	
Sr-92		1.81E-07	3.57E-08	5E-07	1.72E-13	1E-11		
Nb-95		9.80E-08	1.91E-08	5E-07	1.28E-13	1E-11		
Nb-97		1.07E-07	2.09E-08	5E-07	1.60E-13	1E-11		
Zr-95		1.75E-07	3.41E-08	5E-07	3.22E-13	1E-11		
Mo-99		7.43E-08	1.64E-08	5E-07	1.18E-13	1E-11		
Tc-99m		7.24E-08	1.60E-08	5E-07	1.15E-13	1E-11		
Ag-110m		1.20E-07	2.34E-08	5E-07	1.66E-13	1E-11		
Sb-124		1.07E-07	2.09E-08	5E-07	1.05E-13	1E-11		
Sb-125		3.01E-07	5.93E-08	5E-07	4.42E-13	1E-11		
I-131		9.42E-08	1.87E-08	1E-06	1.34E-13	1E-12		
I-133		1.16E-07	2.28E-08	5E-07	8.05E-14	1E-10		
I-135		6.43E-07	1.27E-07	5E-07	5.39E-13	1E-11		
Xe-131m		3.80E-06	8.12E-07	1E-05		
Xe-133		1.82E-07	5.23E-08	1E-05		
Xe-133m		7.97E-07	1.63E-07	1E-05		
Xe-135		8.96E-08	1.82E-08	1E-05		
Xe-135m		1.69E-07	3.30E-08	1E-05		
Xe-137		3.01E-07	5.91E-08	1E-05		
Xe-138		2.83E-07	5.74E-08	1E-05		
Cs-134		1.00E-07	1.95E-08	5E-07	1.67E-13	1E-11		
Cs-137		1.60E-07	3.12E-08	5E-07	2.27E-13	1E-11		
Ba-139		3.90E-07	8.33E-08	5E-07	3.44E-13	1E-11		
Ba-140		3.21E-07	6.28E-08	5E-07	5.22E-13	1E-11		
La-140		9.61E-08	1.90E-08	5E-07	1.85E-13	1E-11		
Ce-141		1.66E-07	3.62E-08	5E-07	1.55E-13	1E-11		
Ce-144		6.08E-07	1.36E-07	5E-07	8.92E-13	1E-11		
Gross Alpha	(1)	1.00E-07	1E-07	(1)	3.51E-15	

(1) Sample analyses performed by a contractor laboratory.

(2) These LLD calculations contain a default weekly continuous sample volume of 2.85E+8 cc. Therefore, grab sample LLD values reflect a different volume (ie; 10 cuft or 2.83E+5 cc).

(3) The calculated LLD's, except those denoted by (1), are from a counter/detector calibration on 12/03/02. These values are typical for other counter/detectors used for effluent counting at BVPS.

(4) Based on counting 50 ml of the water that was bubbled through a 20 liter air sample.

Annual Radioactive Effluent Release Report

Calendar Year - 2002

Page 16 of 21

Table 5A

Assessment Of Radiation Doses

Unit 1 Liquid Effluents											
Batch Releases		1st Quarter		2nd Quarter		3rd Quarter		4th Quarter		Calendar Year	
		Dose	% of ODCM Limit	Dose	% of ODCM Limit	Dose	% of ODCM Limit	Dose	% of ODCM Limit	Dose	% of ODCM Limit
O R G A N (1)	Bone	2.10E-03	0.0420	4.70E-04	0.0094	4.32E-04	0.0086	7.25E-04	0.0145	3.73E-03	0.0373
	Liver	4.68E-03	0.0936	2.28E-03	0.0456	2.35E-03	0.0470	2.60E-03	0.0520	1.19E-02	0.1191
	Total Body	3.80E-03	0.2533	2.12E-03	0.1413	2.16E-03	0.1440	2.27E-03	0.1513	1.04E-02	0.3450
	Thyroid	1.43E-03	0.0286	1.67E-03	0.0334	1.84E-03	0.0368	1.67E-03	0.0334	6.61E-03	0.0661
	Kidney	2.43E-03	0.0486	1.77E-03	0.0354	1.96E-03	0.0392	1.95E-03	0.0390	8.11E-03	0.0811
	Lung	1.85E-03	0.0370	1.81E-03	0.0362	1.95E-03	0.0390	1.81E-03	0.0362	7.42E-03	0.0742
(1) GI-LLI		3.62E-03	0.0724	4.08E-03	0.0816	2.59E-03	0.0518	2.11E-03	0.0422	1.24E-02	0.1240

Unit 1 Gaseous Effluents											
Batch & Continuous Releases		1st Quarter		2nd Quarter		3rd Quarter		4th Quarter		Calendar Year	
		Dose	% of ODCM Limit	Dose	% of ODCM Limit	Dose	% of ODCM Limit	Dose	% of ODCM Limit	Dose	% of ODCM Limit
(2)	Beta Air	1.11E-10	0.0000	8.85E-12	0.0000	2.08E-03	0.0208	6.06E-02	0.6060	6.27E-02	0.3134
(2)	Gamma Air	1.91E-10	0.0000	1.52E-11	0.0000	6.99E-04	0.0140	7.43E-03	0.1486	8.13E-03	0.0813
O R G A N (3)	Bone	2.18E-04	0.0029	9.78E-11	0.0000	0.00E+00	0.0000	3.85E-05	0.0005	2.57E-04	0.0017
	Liver	2.91E-01	3.8800	2.85E-01	3.8000	2.88E-01	3.8400	3.07E-01	4.0933	1.17E+00	7.8067
	Total Body	2.91E-01	3.8800	2.85E-01	3.8000	2.88E-01	3.8400	3.07E-01	4.0933	1.17E+00	7.8067
	Thyroid	2.91E-01	3.8800	2.85E-01	3.8000	2.88E-01	3.8400	3.13E-01	4.1733	1.18E+00	7.8467
	Kidney	2.91E-01	3.8800	2.85E-01	3.8000	2.88E-01	3.8400	3.07E-01	4.0933	1.17E+00	7.8067
	Lung	2.91E-01	3.8800	2.85E-01	3.8000	2.88E-01	3.8400	3.07E-01	4.0933	1.17E+00	7.8067
(3) GI-LLI		2.91E-01	3.8800	2.85E-01	3.8000	2.88E-01	3.8400	3.07E-01	4.0933	1.17E+00	7.8067

- (1) These doses are listed in mrem; they are calculated for the maximum individual for all batch liquid effluents
- (2) These doses are listed in mrad; they are calculated at the site boundary for batch & continuous gaseous effluents (0.4 mi NW)
- (3) These doses are listed in mrem; they are calculated for the most likely exposed real individual (child) via all real pathways at 0.89 mi NW.

Limits used for calculation of percent (%) are from ODCM Appendix C CONTROLS 3.11.1.2, 3.11.2.2 and 3.11.2.3 (considered to be the design objectives).

Annual Radioactive Effluent Release Report

Calendar Year - 2002

Page 17 of 21

Table 5B

Assessment Of Radiation Doses

Unit 2 Liquid Effluents											
Batch Releases		1st Quarter		2nd Quarter		3rd Quarter		4th Quarter		Calendar Year	
		Dose	% of ODCM Limit	Dose	% of ODCM Limit	Dose	% of ODCM Limit	Dose	% of ODCM Limit	Dose	% of ODCM Limit
O R G A N	Bone	2.10E-03	0.0420	4.70E-04	0.0094	4.32E-04	0.0086	7.25E-04	0.0145	3.73E-03	0.0373
	Liver	4.68E-03	0.0936	2.28E-03	0.0456	2.35E-03	0.0470	2.60E-03	0.0520	1.19E-02	0.1191
	Total Body	3.80E-03	0.2533	2.12E-03	0.1413	2.16E-03	0.1440	2.27E-03	0.1513	1.04E-02	0.3450
	Thyroid	1.43E-03	0.0286	1.67E-03	0.0334	1.84E-03	0.0368	1.67E-03	0.0334	6.61E-03	0.0661
	Kidney	2.43E-03	0.0486	1.77E-03	0.0354	1.96E-03	0.0392	1.95E-03	0.0390	8.11E-03	0.0811
	Lung	1.85E-03	0.0370	1.81E-03	0.0362	1.95E-03	0.0390	1.81E-03	0.0362	7.42E-03	0.0742
(1)	GI-LLI	3.62E-03	0.0724	4.08E-03	0.0816	2.59E-03	0.0518	2.11E-03	0.0422	1.24E-02	0.1240

Unit 2 Gaseous Effluents											
Batch & Continuous Releases		1st Quarter		2nd Quarter		3rd Quarter		4th Quarter		Calendar Year	
		Dose	% of ODCM Limit	Dose	% of ODCM Limit	Dose	% of ODCM Limit	Dose	% of ODCM Limit	Dose	% of ODCM Limit
(2)	Beta Air	1.11E-10	0.0000	8.85E-12	0.0000	3.29E-04	0.0033	1.29E-04	0.0013	4.58E-04	0.0023
(2)	Gamma Air	1.91E-10	0.0000	1.52E-11	0.0000	4.64E-06	0.0001	5.18E-05	0.0010	5.64E-05	0.0006
O R G A N	Bone	9.93E-05	0.0013	9.78E-11	0.0000	0.00E+00	0.0000	1.89E-05	0.0003	1.18E-04	0.0008
	Liver	7.19E-02	0.9587	8.75E-02	1.1667	6.90E-02	0.9200	8.88E-02	1.1840	3.17E-01	2.1147
	Total Body	7.19E-02	0.9587	8.75E-02	1.1667	6.90E-02	0.9200	8.88E-02	1.1840	3.17E-01	2.1147
	Thyroid	7.19E-02	0.9587	8.75E-02	1.1667	6.90E-02	0.9200	8.88E-02	1.1840	3.17E-01	2.1147
	Kidney	7.19E-02	0.9587	8.75E-02	1.1667	6.90E-02	0.9200	8.88E-02	1.1840	3.17E-01	2.1147
	Lung	7.20E-02	0.9600	8.75E-02	1.1667	6.90E-02	0.9200	8.88E-02	1.1840	3.17E-01	2.1153
(3)	GI-LLI	7.19E-02	0.9587	8.75E-02	1.1667	6.90E-02	0.9200	8.88E-02	1.1840	3.17E-01	2.1147

- (1) These doses are listed in mrem; they are calculated for the maximum individual for all batch liquid effluents
- (2) These doses are listed in mrad; they are calculated at the site boundary for batch & continuous gaseous effluents (0.4 mi NW)
- (3) These doses are listed in mrem; they are calculated for the most likely exposed real individual (child) via all real pathways at 0.89 mi NW.

Limits used for calculation of percent (%) are from ODCM Appendix C CONTROLS 3.11.1.2, 3.11.2.2 and 3.11.2.3 (considered to be the design objectives).

Annual Radioactive Effluent Release Report
Calendar Year - 2002
Table 6

Page 18 of 21

Effluent Monitoring Instrumentation Channels Not Returned To Operable Status Within 30 Days

All Effluent Monitoring Instrumentation Channels
(as required by 1/2-ODC-3.03 of the Offsite Dose Calculation Manual)
Were Returned To Operable Status Within 30 days
during this report period.

Annual Radioactive Effluent Release Report

Calendar Year - 2002

Page 19 of 21

Table 7

Total Dose Commitments, Total Effective Dose Equivalents and Population Doses

2002 Total Dose Commitment From All Facility Releases To Members of the Public 40 CFR 190.10(a) Environmental Doses				
Organ	(1) Effluent Dose (mrem)	(2) Direct Radiation Dose (mrem)	Total Dose (mrem)	% of ODCM or 40 CFR 190 Limit
Bone	7.83E-03	1.80E+00	1.81E+00	7.23%
Liver	1.51E+00	1.80E+00	3.31E+00	13.24%
Total Body	1.52E+00	1.80E+00	3.32E+00	13.28%
Thyroid	1.51E+00	1.80E+00	3.31E+00	4.41%
Kidney	1.51E+00	1.80E+00	3.31E+00	13.24%
Lung	1.51E+00	1.80E+00	3.31E+00	13.24%
GI-LLI	1.52E+00	1.80E+00	3.32E+00	13.28%
<p>(1) The cumulative dose contributions from liquid and gaseous effluents were determined in accordance with the applicable CONTROLS & SURVEILLANCE REQUIREMENTS listed in 1/2-ODC-3.03 of the ODCM. The dose commitment limits for 40 CFR 190 MEMBERS OF THE PUBLIC (ODCM 1/2-ODC-3.03 Control 3.11.4.1) are as follows:</p> <p>a) <i>< or = 25 mrem / calendar year (for the total body, or any organ except the thyroid)</i></p> <p>b) <i>< or = 75 mrem / calendar year (for the thyroid)</i></p>				
<p>(2) The dose contribution listed for the total body is for Direct Radiation. This was calculated by comparing offsite TLD exposure at the ODCM controlling location (0.8 miles NW; Midland, PA) to TLD exposure at the REMP control location (16.5 miles SSW; Weirton, WV).</p>				

Compliance to 100 mrem Limit of 10 CFR 20.1301 For Total Effective Dose Equivalent

Pursuant to 10 CFR 20.1301(a)(1), the Total Effective Dose Equivalent from licensed operation to the maximum individual during the report period, is 5.61 mrem. This is a summation of Direct Radiation Exposure (calculated by comparing the maximum of all perimeter TLD exposures to TLD exposure at the REMP control location) plus Effluent Doses (calculated per the ODCM).

Members of the Public Doses Due To Their Activities Inside The Site Boundary

The radiation doses for MEMBER(S) OF THE PUBLIC due to their activities inside the site boundary would be no greater than those doses listed in this table to show compliance with 40 CFR Part 190 or 10 CFR 20.1301. Evaluations have shown that the exposure time for individuals not occupationally associated with the plant site is minimal in comparison to the exposure time considered for the dose calculation at or beyond the site boundary. Therefore, a separate assessment of radiation doses from radioactive effluents to MEMBER(S) OF THE PUBLIC, due to their activities inside the site boundary, is not necessary for this report period.

0-50 Mile Population Doses From Liquid and Gaseous Effluents

The 0-50 mile Total Population Dose from liquid and gaseous effluents is 0.700 man-rem (Total Body)

The 0-50 mile Average Population Dose from liquid and gaseous effluents is 0.000175 mrem (Total Body)

Annual Radioactive Effluent Release Report

Calendar Year - 2002
Table 8

Page 20 of 21

Offsite Dose Calculation Manual Surveillance Deficiencies

There were no
Surveillance Deficiencies
(as required by ODCM procedure 1/2-ODC-3.03)
during this report period.

This is regarding
monitoring, sampling & analysis and dose determination.

Annual Radioactive Effluent Release Report

Calendar Year - 2002

Page 21 of 21

Table 9

Unit 1 and 2 Offsite Dose Calculation Manual Changes (Description)

There were four changes made to the ODCM during 2002. See ODCM procedure 1/2-ODC-1.01 for a complete description of the changes and change justification. A brief description of the changes are as follows:

Change (16) of BV-1 and 2 ODCM (Effective April 2002)

- 1) The entire BV-1 and 2 ODCM was converted to the following eight ODC procedures:
 - 1.1) 1/2-ODC-1.01: Index, Matrix & History of ODCM Changes (formerly; Index and App F)
 - 1.2) 1/2-ODC-2.01: Liquid Effluents (formerly; ODCM Section 1 and 5)
 - 1.3) 1/2-ODC-2.02: Gaseous Effluents (formerly; ODCM Section 2 and 5)
 - 1.4) 1/2-ODC-2.03: Rad. Environmental Monitoring Program (formerly; ODCM Section 3)
 - 1.5) 1/2-ODC-2.04: Information Related to 40CFR190 (formerly; ODCM Section 4)
 - 1.6) 1/2-ODC-3.01: Dispersion Calc. & Source Term Inputs (formerly; ODCM App A & B)
 - 1.7) 1/2-ODC-3.02: Bases for ODCM Controls (formerly; ODCM App D)
 - 1.7.1) Duplicated TS Bases 3/4.3.3.1 in ODCM Bases per TS Amendments 246/124.
 - 1.8) 1/2-ODC-3.03: Controls for RETS and REMP Programs (formerly; ODCM App C and E)
 - 1.8.1) Portions of TS 3.3.3.1 were transferred to ODCM Controls per TS Amendments 246/124.
 - 1.8.2) Added clarification to Control 3.3.3.9 Table 3.3-13 Action 30A & 30B.
 - 1.8.3) Added specific plant asset numbers to Control 3.3.3.10 Table 3.3-13 and Table 4.3-13.
 - 1.8.4) Added notation to Control 3.3.3.10 Table 3.3-13 & 4.3-13 for [RM-GW-109 Ch 5].
 - 1.8.5) Replaced Partic. Monitors in Control 3.3.3.10 Tables 3.3-13 & 4.3-13 with P & I Samplers.

Change (17) of BV-1 and 2 ODCM (Effective August 2002)

- 1) Changes to procedure 1/2-ODC-3.03:
 - 1.1) TS 3.11.1.4 & 3.11.2.5 were transferred to ODCM Controls per TS Amendments 250/130.
 - 1.2) Changed the due date of the Annual RETS Report to May 1 per TS Amendments 250/130.
 - 1.3) Changed Control 3.3.3.9 Table 3.3-12 to correct Operability and Action Requirements.
 - 1.4) Corrected specific plant asset numbers shown in Control 3.3.3.10 Tables 3.3-13 & 4.3-13.

Change (18) of the BV-1 and 2 ODCM (Effective October 2002).

- 1) Changes to procedure 1/2-ODC-3.03:
 - 1.1) Added requirement for applicable station groups notification of pending ODCM changes.

Change (19) of BV-1 and 2 ODCM (Effective November 2002)

- 1) Changes to procedure 1/2-ODC-2.01:
 - 1.1) Changed Table 1.1-1a and 1.1-1b to add Zn-65 to the Liquid Source Term.
 - 1.2) Table 1.1-1a was changed to update the source term with previously derived values.
 - 1.3) Updated references.
 - 1.4) Added discussion of why Liquid Waste Evaporators are no longer used at BVPS.

Beaver Valley Power Station - Units 1 & 2

Annual Radioactive Effluent Release Report

Calendar Year - 2002

Attachment 1

Joint Frequency Distribution Tables

Attachment 1

An annual summary of hourly meteorological data, in the form of joint frequency distribution, is provided for the calendar year as specified in the ODCM.

Attachment 1 Clarification

Hourly meteorological data is not provided for specific periods of Abnormal Gaseous Release during the calendar quarters (as indicated in Regulatory Guide 1.21), for the following reasons:

- 1) All Gaseous Releases for the calendar year were determined to be within design objectives. where as, the ODCM Dose and Dose Rate Limits are considered to be the design objectives,
- 2) There were no Abnormal Gaseous Releases during the calendar year.

For a copy of the hourly meteorological data during the calendar quarters, contact Mr. Anthony T. Lonnett at 724-682-7523.

```
PERIODS OF CALM(HOURS):      4
VARIABLE DIRECTION          0
HOURS OF MISSING DATA:     5
```

```
PERIODS OF CALM(HOURS):      4
VARIABLE DIRECTION          0
HOURS OF MISSING DATA:     5
```

```
PERIODS OF CALM(HOURS):      4
VARIABLE DIRECTION          0
HOURS OF MISSING DATA:     5
```

```
PERIODS OF CALM(HOURS):      4
VARIABLE DIRECTION          0
HOURS OF MISSING DATA:     5
```


BEAVER VALLEY JOINT FREQUENCY DISTRIBUTION
WIND SPEED AND DIRECTION 35 FT VERSUS
DELTA TEMPERATURE 150-35FT
JANUARY 1, 2002 THROUGH DECEMBER 31, 2002

SITE: BEAVER VALLEY UNIT: ONE

HOURS AT EACH WIND SPEED AND DIRECTION

PERIOD OF RECORD = 01010101-01123124

STABILITY CLASS: F DT/DZ

ELEVATION: SPEED:SP 35P DIRECTION:DI 35P LAPSE:DT150-

WIND DIRECTION	WIND SPEED (MPH)						TOTAL
	1-3	4-7	8-12	13-18	19-24	>24	
N	18	1	0	0	0	0	19
NNE	22	3	0	0	0	0	25
NE	53	0	0	0	0	0	54
ENE	67	0	0	0	0	0	67
E	111	0	0	0	0	0	111
ESE	207	0	0	0	0	0	207
SE	270	1	0	0	0	0	273
SSE	173	3	0	0	0	0	176
S	168	12	0	0	0	0	180
SSW	61	21	0	0	0	0	82
SW	32	9	2	3	0	0	46
WSW	20	2	0	1	0	0	23
W	12	7	0	0	0	0	19
WNW	13	2	1	0	0	0	16
NW	15	2	0	0	0	0	17
NNW	17	0	0	0	0	0	17
TOTAL	1259	63	3	4	0	0	1332

PERIODS OF CALM(HOURS): 4

VARIABLE DIRECTION 0

HOURS OF MISSING DATA: 5

```
PERIODS OF CALM(HOURS):      4
VARIABLE DIRECTION          0
HOURS OF MISSING DATA:     5
```

SITE: BEAVER VALLEY UNIT: ONE

WIND		WIND SPEED (MPH)					
DIRECTION	1-3	4-7	8-12	13-18	19-24	>24	TOTAL
N	205	128	1	0	0	0	334
NNE	176	66	0	0	0	0	242
NE	300	44	0	0	0	0	345
ENE	347	81	0	0	0	0	428
E	388	52	0	0	0	0	440
ESE	500	35	0	0	0	0	536
SE	669	26	0	0	0	0	697
SSE	502	52	0	0	0	0	554
S	436	141	10	0	0	0	587
SSW	286	247	43	1	0	0	577
SW	224	480	213	21	0	0	938
WSW	158	468	149	17	1	0	793
W	143	485	109	2	0	0	739
WNW	171	315	49	1	0	0	536
NW	240	316	27	0	0	0	583
NNW	204	210	12	0	0	0	426
TOTAL	4949	3146	613	42	1	0	8755
PERIODS OF CALM (HOURS):			4				
VARIABLE DIRECTION		0					
HOURS OF MISSING DATA:			5				

WIND		WIND SPEED (MPH)					
DIRECTION	1-3	4-7	8-12	13-18	19-24	>24	TOTAL
N	4	34	33	0	0	0	71
NNE	5	16	25	3	0	0	49
NE	4	14	15	0	0	0	33
ENE	2	30	17	1	0	0	50
E	1	22	17	1	0	0	41
ESE	0	18	19	0	0	0	37
SE	1	28	31	1	0	0	61
SSE	1	33	27	1	0	0	62
S	1	22	41	2	0	0	66
SSW	1	16	39	8	0	0	64
SW	0	20	41	9	0	0	70
WSW	4	30	48	9	0	0	91
W	2	57	73	21	3	0	156
WNW	3	45	66	25	1	0	140
NW	6	35	20	4	1	0	66
NNW	2	31	27	0	0	0	60
TOTAL	37	451	539	85	5	0	1117
PERIODS OF CALM(HOURS):			0				
VARIABLE DIRECTION		0					
HOURS OF MISSING DATA:			5				

BEAVER VALLEY JOINT FREQUENCY DISTRIBUTION
WIND SPEED AND DIRECTION 150 FT VERSUS
DELTA TEMPERATURE 150-35FT
JANUARY 1, 2002 THROUGH DECEMBER 31, 2002

SITE: BEAVER VALLEY UNIT: ONE

HOURS AT EACH WIND SPEED AND DIRECTION

PERIOD OF RECORD = 01010101-01123124

STABILITY CLASS: B DT/DZ

ELEVATION: SPEED:SP150P DIRECTION:DI150P LAPSE:DT150-

WIND DIRECTION	WIND SPEED (MPH)						TOTAL
	1-3	4-7	8-12	13-18	19-24	>24	
N	1	7	2	0	0	0	10
NNE	0	5	3	0	0	0	8
NE	1	3	1	0	0	0	5
ENE	0	2	4	0	0	0	6
E	0	4	1	0	0	0	5
ESE	0	3	0	0	0	0	3
SE	0	2	2	1	0	0	5
SSE	1	4	3	0	0	0	8
S	2	4	4	1	0	0	11
SSW	1	3	10	0	0	0	14
SW	3	5	11	4	0	0	23
WSW	2	8	13	4	1	0	28
W	5	17	11	9	1	0	43
WNW	0	8	14	8	2	0	32
NW	3	2	6	1	0	0	12
NNW	1	7	4	0	0	0	12
TOTAL	20	84	89	28	4	0	225

PERIODS OF CALM(HOURS): 0

VARIABLE DIRECTION 0

HOURS OF MISSING DATA: 5

BEAVER VALLEY JOINT FREQUENCY DISTRIBUTION
WIND SPEED AND DIRECTION 150 FT VERSUS
DELTA TEMPERATURE 150-35FT
JANUARY 1, 2002 THROUGH DECEMBER 31, 2002

SITE: BEAVER VALLEY UNIT: ONE

HOURS AT EACH WIND SPEED AND DIRECTION

PERIOD OF RECORD = 01010101-01123124

STABILITY CLASS: C DT/DZ

ELEVATION: SPEED:SP150P DIRECTION:DI150P LAPSE:DT150-

WIND DIRECTION	WIND SPEED (MPH)						TOTAL
	1-3	4-7	8-12	13-18	19-24	>24	
N	3	9	4	0	0	0	16
NNE	3	6	0	0	0	0	9
NE	0	3	0	0	0	0	3
ENE	1	3	1	0	0	0	5
E	0	3	2	0	0	0	5
ESE	0	2	0	0	0	0	2
SE	1	4	2	0	0	0	7
SSE	1	3	2	0	0	0	6
S	1	6	10	1	0	0	18
SSW	0	4	6	2	0	0	12
SW	1	1	14	5	0	0	21
WSW	4	9	8	5	4	0	30
W	1	14	25	6	2	0	48
WNW	5	12	12	8	1	0	38
NW	0	5	8	5	0	0	18
NNW	5	6	1	1	0	0	13
TOTAL	26	90	95	33	7	0	251

PERIODS OF CALM (HOURS) : 0

VARIABLE DIRECTION 0

HOURS OF MISSING DATA: 5

```
PERIODS OF CALM(HOURS):      0
VARIABLE DIRECTION          0
HOURS OF MISSING DATA:     5
```

```
PERIODS OF CALM(HOURS):      0
VARIABLE DIRECTION          0
HOURS OF MISSING DATA:     5
```


BEAVER VALLEY JOINT FREQUENCY DISTRIBUTION
WIND SPEED AND DIRECTION 150 FT VERSUS
DELTA TEMPERATURE 150-35FT
JANUARY 1, 2002 THROUGH DECEMBER 31, 2002

SITE: BEAVER VALLEY UNIT: ONE

HOURS AT EACH WIND SPEED AND DIRECTION

PERIOD OF RECORD = 01010101-01123124

STABILITY CLASS: F DT/DZ

ELEVATION: SPEED:SP150P DIRECTION:DI150P LAPSE:DT150-

WIND DIRECTION	WIND SPEED (MPH)						TOTAL
	1-3	4-7	8-12	13-18	19-24	>24	
N	74	24	1	0	0	0	99
NNE	130	35	0	0	0	0	165
NE	146	68	0	0	0	0	214
ENE	62	34	1	0	0	0	97
E	20	13	0	0	0	0	33
ESE	12	9	1	0	0	0	22
SE	19	10	0	0	0	0	29
SSE	18	11	4	0	0	0	33
S	30	28	9	0	0	0	67
SSW	67	63	9	0	0	0	139
SW	98	57	12	2	2	0	171
WSW	58	42	7	0	1	0	108
W	28	19	4	4	0	0	55
WNW	16	11	1	1	0	0	29
NW	20	5	0	1	0	0	26
NNW	33	12	0	0	0	0	45
TOTAL	831	441	49	8	3	0	1332

PERIODS OF CALM (HOURS): 0

VARIABLE DIRECTION 0

HOURS OF MISSING DATA: 5

BEAVER VALLEY JOINT FREQUENCY DISTRIBUTION
WIND SPEED AND DIRECTION 150 FT VERSUS
DELTA TEMPERATURE 150-35FT
JANUARY 1, 2002 THROUGH DECEMBER 31, 2002

SITE: BEAVER VALLEY UNIT: ONE

HOURS AT EACH WIND SPEED AND DIRECTION

PERIOD OF RECORD = 01010101-01123124

STABILITY CLASS: G DT/DZ

ELEVATION: SPEED:SP150P DIRECTION:DI150P LAPSE:DT150-

WIND DIRECTION	WIND SPEED (MPH)						TOTAL
	1-3	4-7	8-12	13-18	19-24	>24	
N	32	5	0	0	0	0	37
NNE	66	30	0	0	0	0	96
NE	91	37	0	0	0	0	128
ENE	26	12	1	0	0	0	39
E	19	7	0	0	0	0	26
ESE	7	5	0	0	0	0	12
SE	15	18	1	0	0	0	34
SSE	16	13	3	0	0	0	32
S	23	29	2	0	0	0	54
SSW	68	59	3	0	0	0	130
SW	68	40	4	1	0	0	113
WSW	37	24	7	0	0	1	69
W	17	10	2	0	0	0	29
WNW	13	3	0	0	0	0	16
NW	18	0	1	0	0	0	19
NNW	16	1	0	0	0	0	17
TOTAL	532	293	24	1	0	1	851

PERIODS OF CALM(HOURS): 0

VARIABLE DIRECTION 0

HOURS OF MISSING DATA: 5

```
PERIODS OF CALM(HOURS):      0
VARIABLE DIRECTION          0
HOURS OF MISSING DATA:     5
```

BEAVER VALLEY JOINT FREQUENCY DISTRIBUTION
WIND SPEED AND DIRECTION 500 FT VERSUS
DELTA TEMPERATURE 500-35FT
JANUARY 1, 2002 THROUGH DECEMBER 31, 2002

SITE: BEAVER VALLEY UNIT: ONE

HOURS AT EACH WIND SPEED AND DIRECTION

PERIOD OF RECORD = 01010101-01123124

STABILITY CLASS: A DT/DZ

ELEVATION: SPEED:SP500P DIRECTION:DI500P LAPSE:DT500-

WIND DIRECTION	WIND SPEED(MPH)						TOTAL
	1-3	4-7	8-12	13-18	19-24	>24	
N	0	0	0	0	0	0	0
NNE	0	0	0	1	0	0	1
NE	0	0	3	2	0	0	5
ENE	0	2	4	0	0	0	6
E	0	0	1	1	0	0	2
ESE	0	0	2	0	0	0	2
SE	0	1	11	1	0	0	13
SSE	0	0	3	0	0	0	3
S	0	0	1	0	0	0	1
SSW	0	1	0	0	0	0	1
SW	0	0	0	0	0	0	0
WSW	0	0	0	0	0	0	0
W	0	0	1	0	0	0	1
WNW	0	0	0	0	0	0	0
NW	0	0	0	0	0	0	0
NNW	0	0	0	0	0	0	0
TOTAL	0	4	26	5	0	0	35

PERIODS OF CALM(HOURS): 1

VARIABLE DIRECTION 0

HOURS OF MISSING DATA: 57

SITE: BEAVER VALLEY UNIT: ONE

WIND		WIND SPEED (MPH)					
DIRECTION	1-3	4-7	8-12	13-18	19-24	>24	TOTAL
N	0	0	6	0	0	0	6
NNE	0	0	1	1	0	0	2
NE	0	2	4	0	0	0	6
ENE	0	1	5	0	0	0	6
E	0	0	6	0	0	0	6
ESE	0	1	4	2	0	0	7
SE	0	4	8	0	0	0	12
SSE	0	0	5	0	0	0	5
S	0	1	6	2	0	0	9
SSW	0	1	1	0	0	0	2
SW	0	0	0	0	0	0	0
WSW	0	1	3	1	0	0	5
W	0	1	2	0	0	0	3
WNW	0	0	1	1	0	0	2
NW	0	0	2	0	0	0	2
NNW	0	0	1	0	0	0	1
TOTAL	0	12	55	7	0	0	74
PERIODS OF CALM(HOURS):							1
VARIABLE DIRECTION							0
HOURS OF MISSING DATA:							57

BEAVER VALLEY JOINT FREQUENCY DISTRIBUTION
WIND SPEED AND DIRECTION 500 FT VERSUS
DELTA TEMPERATURE 500-35FT
JANUARY 1, 2002 THROUGH DECEMBER 31, 2002

SITE: BEAVER VALLEY UNIT: ONE

HOURS AT EACH WIND SPEED AND DIRECTION

PERIOD OF RECORD = 01010101-01123124

STABILITY CLASS: C DT/DZ

ELEVATION: SPEED:SP500P DIRECTION:DI500P LAPSE:DT500-

WIND DIRECTION	WIND SPEED (MPH)						TOTAL
	1-3	4-7	8-12	13-18	19-24	>24	
N	0	4	13	2	0	0	19
NNE	0	1	4	3	0	0	8
NE	0	2	5	1	0	0	8
ENE	0	3	11	0	0	0	14
E	0	4	4	0	0	0	8
ESE	0	5	7	2	0	0	14
SE	0	4	7	3	0	0	14
SSE	0	7	13	0	0	0	20
S	0	3	9	1	0	0	13
SSW	1	0	10	2	0	0	13
SW	0	0	7	4	0	0	11
WSW	0	1	13	4	0	0	18
W	0	4	13	2	1	0	20
WNW	0	6	6	12	5	0	29
NW	0	3	12	4	0	0	19
NNW	0	0	10	0	0	0	10
TOTAL	1	47	144	40	6	0	238

PERIODS OF CALM(HOURS): 1

VARIABLE DIRECTION 0

HOURS OF MISSING DATA: 57

```
PERIODS OF CALM(HOURS):      1
VARIABLE DIRECTION          0
HOURS OF MISSING DATA:     57
```

WIND		WIND SPEED(MPH)					
DIRECTION	1-3	4-7	8-12	13-18	19-24	>24	TOTAL
N	14	30	46	29	1	0	120
NNE	24	20	15	10	0	0	69
NE	23	29	13	2	0	0	67
ENE	38	51	31	8	0	0	128
E	35	74	30	6	0	0	145
ESE	25	53	43	6	1	0	128
SE	29	46	39	21	3	0	138
SSE	20	48	34	28	5	0	135
S	23	37	72	52	10	0	194
SSW	27	37	54	44	14	0	176
SW	36	49	69	122	44	3	323
WSW	52	86	50	28	7	3	226
W	43	81	69	25	8	1	227
WNW	21	62	45	14	1	0	143
NW	28	25	14	10	1	0	78
NNW	13	26	26	11	0	0	76
TOTAL	451	754	650	416	95	7	2373
PERIODS OF CALM(HOURS):	1						
VARIABLE DIRECTION	0						
HOURS OF MISSING DATA:	57						

BEAVER VALLEY JOINT FREQUENCY DISTRIBUTION
WIND SPEED AND DIRECTION 500 FT VERSUS
DELTA TEMPERATURE 500-35FT
JANUARY 1, 2002 THROUGH DECEMBER 31, 2002

SITE: BEAVER VALLEY UNIT: ONE

HOURS AT EACH WIND SPEED AND DIRECTION

PERIOD OF RECORD = 01010101-01123124
STABILITY CLASS: F DT/DZ
ELEVATION: SPEED:SP500P DIRECTION:DI500P LAPSE:DT500-

WIND DIRECTION	WIND SPEED (MPH)						TOTAL
	1-3	4-7	8-12	13-18	19-24	>24	
N	10	20	6	0	0	0	36
NNE	14	20	4	1	0	0	39
NE	22	18	6	0	0	0	47
ENE	22	24	17	0	0	0	63
E	25	30	14	0	0	0	69
ESE	19	29	14	1	0	0	63
SE	27	32	16	8	0	0	83
SSE	15	50	23	17	0	0	105
S	13	26	35	18	0	0	92
SSW	19	33	39	16	0	0	107
SW	17	30	60	40	13	0	160
WSW	20	48	21	0	0	0	89
W	25	53	27	5	0	0	110
WNW	18	27	3	1	0	0	49
NW	11	18	5	0	0	0	34
NNW	11	8	4	0	0	0	23
TOTAL	288	466	294	107	13	0	1169
PERIODS OF CALM (HOURS):	1						
VARIABLE DIRECTION	0						
HOURS OF MISSING DATA:	57						

```
PERIODS OF CALM(HOURS):      1
VARIABLE DIRECTION          0
HOURS OF MISSING DATA:     57
```

```
PERIODS OF CALM(HOURS):      1
VARIABLE DIRECTION          0
HOURS OF MISSING DATA:     57
```

Beaver Valley Power Station - Units 1 & 2

Annual Radioactive Effluent Release Report

Calendar Year - 2002

Attachment 2

Unit 1 and 2 Offsite Dose Calculation Manual Changes

Attachment 2

Attached is a complete copy of the ODCM that includes:

Change 16, Effective April, 2002

Change 17, Effective August, 2002

Change 18, Effective October, 2002

Change 19, Effective November, 2002

Attachment 2 Clarification

A complete copy of the ODCM has been sent to the following offices:

**United States Nuclear Regulatory Commission
Document Control Desk
Washington, DC 20555**

**United States Nuclear Regulatory Commission
Regional Administrator, Region 1
475 Allendale Road
King of Prussia, PA 19406**

For a complete copy of the ODCM, contact Mr. Anthony T Lonnett at 724-682-7523.