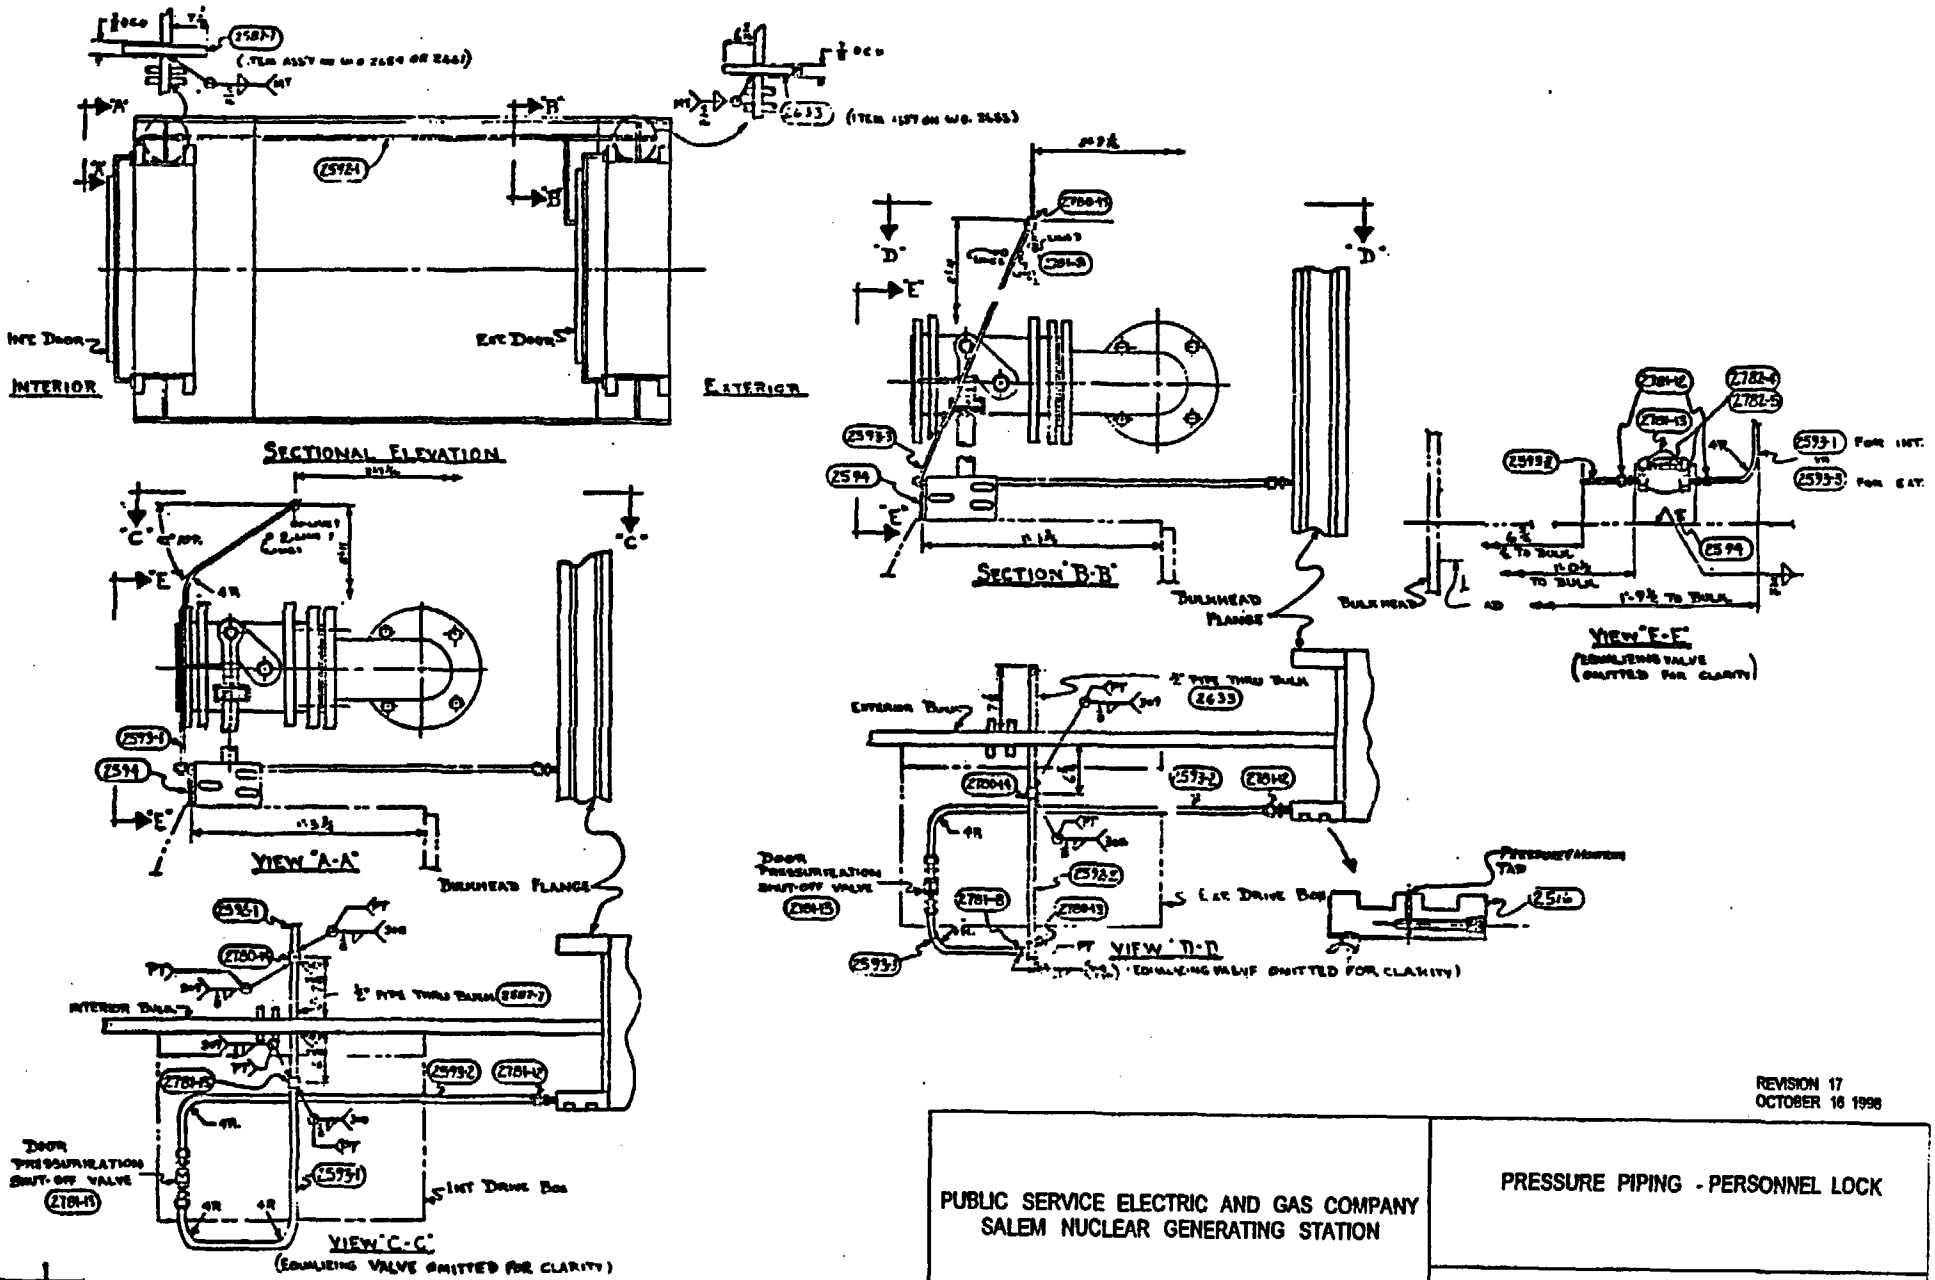

REVISION 17
OCTOBER 16 1998

PUBLIC SERVICE ELECTRIC AND GAS COMPANY SALEM NUCLEAR GENERATING STATION	PRESSURE PIPING - PERSONNEL LOCK
	Updated FSAR — FIG. 3.8-37

2 of 4