

MANUAL HARD COPY DISTRIBUTION
DOCUMENT TRANSMITTAL 2003-29467

USER INFORMATION

Name: ~~GERLACH ROSE M~~ EMPL#: 28401 CA#: 0363
Address: ~~NUCSA2~~
Phone#: 254-3194

TRANSMITTAL INFORMATION:

TO: ~~GERLACH ROSE M~~ 06/24/2003
LOCATION: DOCUMENT CONTROL DESK
FROM: NUCLEAR RECORDS DOCUMENT CONTROL CENTER (NUCSA-2)
THE FOLLOWING CHANGES HAVE OCCURRED TO THE HARDCOPY OR ELECTRONIC MANUAL ASSIGNED TO YOU:

131 - 131 - DAMAGE CONTROL TEAM COORDINATOR (DCTC): EMERGENCY PLAN-POSITION
SPECIFIC PROCEDURE

REMOVE MANUAL TABLE OF CONTENTS DATE: 04/16/2003


ADD MANUAL TABLE OF CONTENTS DATE: 06/23/2003

CATEGORY: PROCEDURES TYPE: EP
ID: EP-PS-131
REPLACE: REV:8


UPDATES FOR HARD COPY MANUALS WILL BE DISTRIBUTED WITHIN 5 DAYS IN ACCORDANCE WITH DEPARTMENT PROCEDURES. PLEASE MAKE ALL CHANGES AND ACKNOWLEDGE COMPLETE IN YOUR NIMS INBOX UPON RECEIPT OF HARD COPY. FOR ELECTRONIC MANUAL USERS, ELECTRONICALLY REVIEW THE APPROPRIATE DOCUMENTS AND ACKNOWLEDGE COMPLETE IN YOUR NIMS INBOX.

A045

EMERGENCY ORGANIZATION CONTROL ROOM

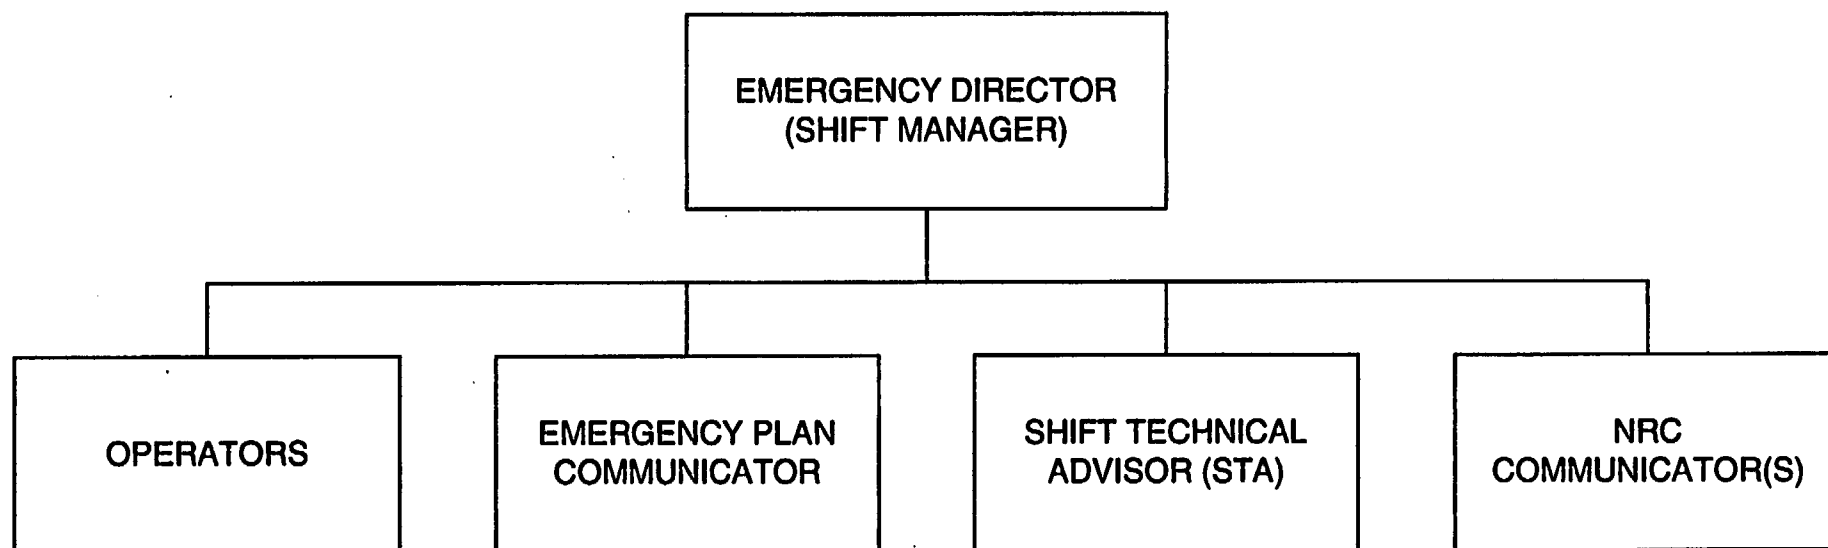

TSC ORGANIZATION

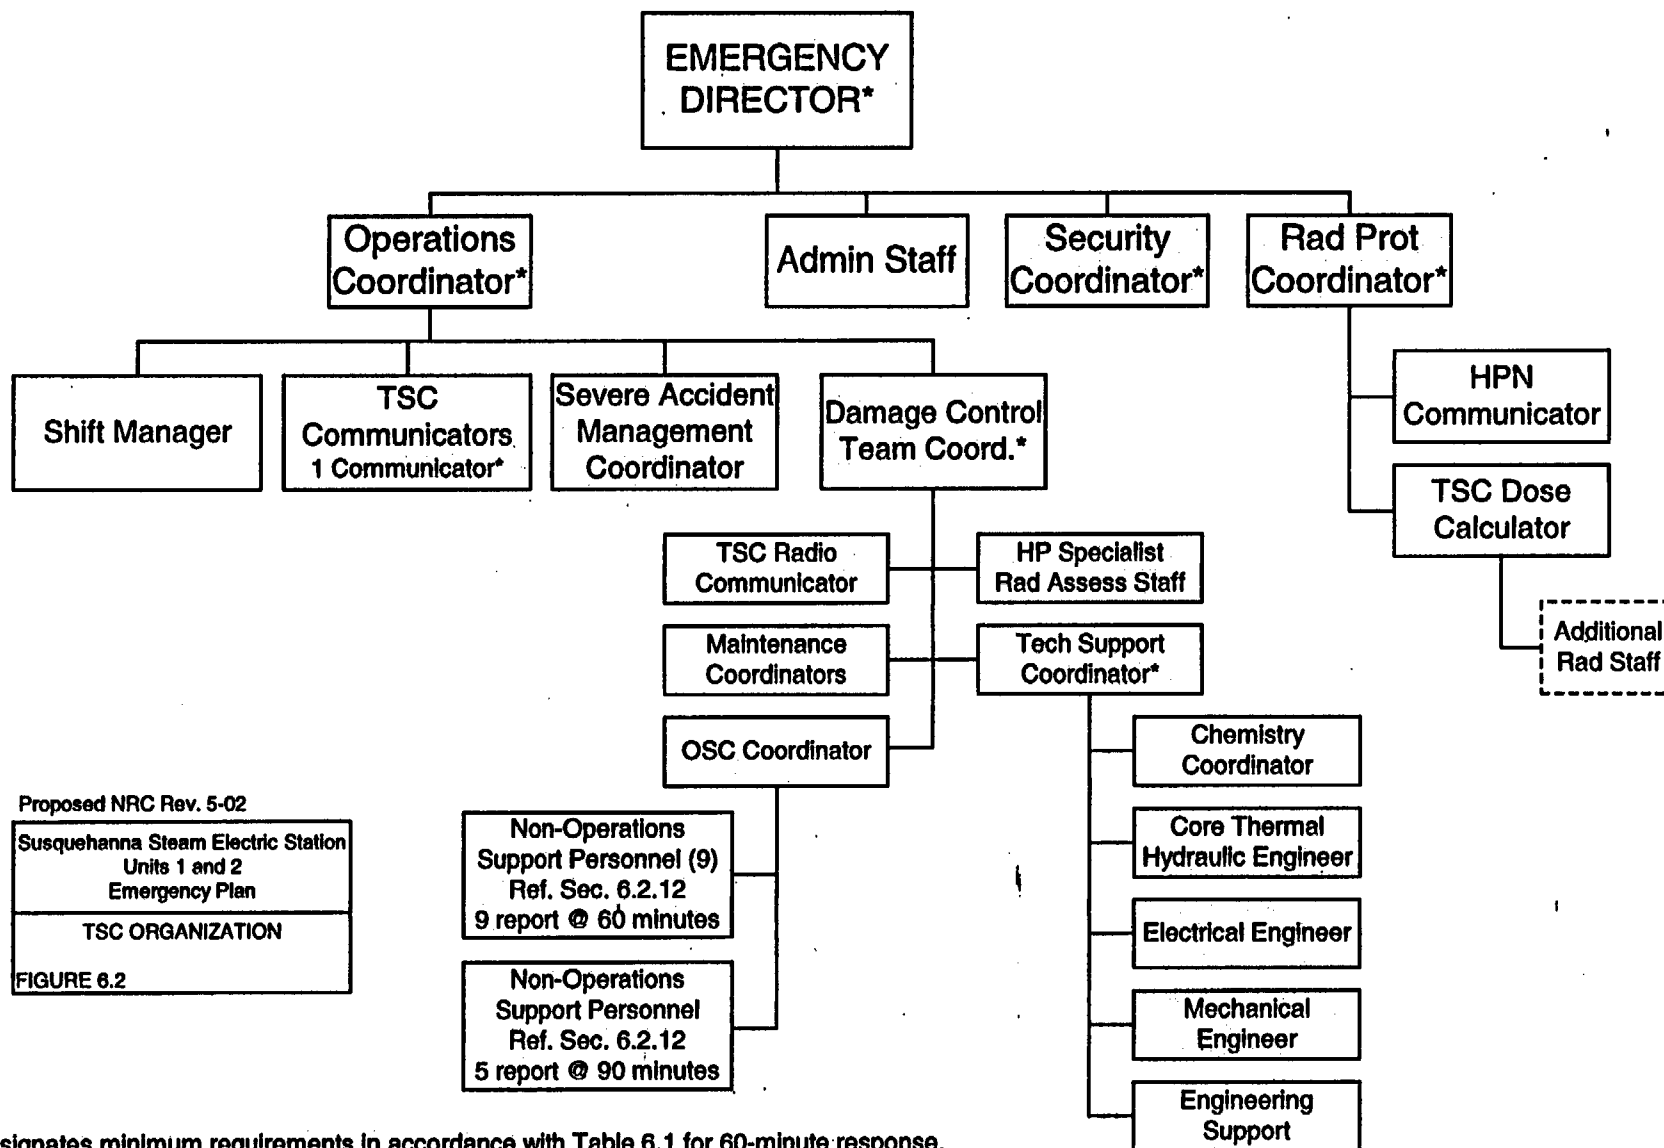

Proposed NRC Rev. 5-02

Susquehanna Steam Electric Station
Units 1 and 2
Emergency Plan

TSC ORGANIZATION

FIGURE 6.2

Non-Operations
Support Personnel (9)
Ref. Sec. 6.2.12
9 report @ 60 minutes


Non-Operations
Support Personnel
Ref. Sec. 6.2.12
5 report @ 90 minutes

Designates minimum requirements in accordance with Table 6.1 for 60-minute response.

----- Individuals may be located in the OSC, TSC, or Field.

* Designates positions required for TSC activation.

EOF ORGANIZATION

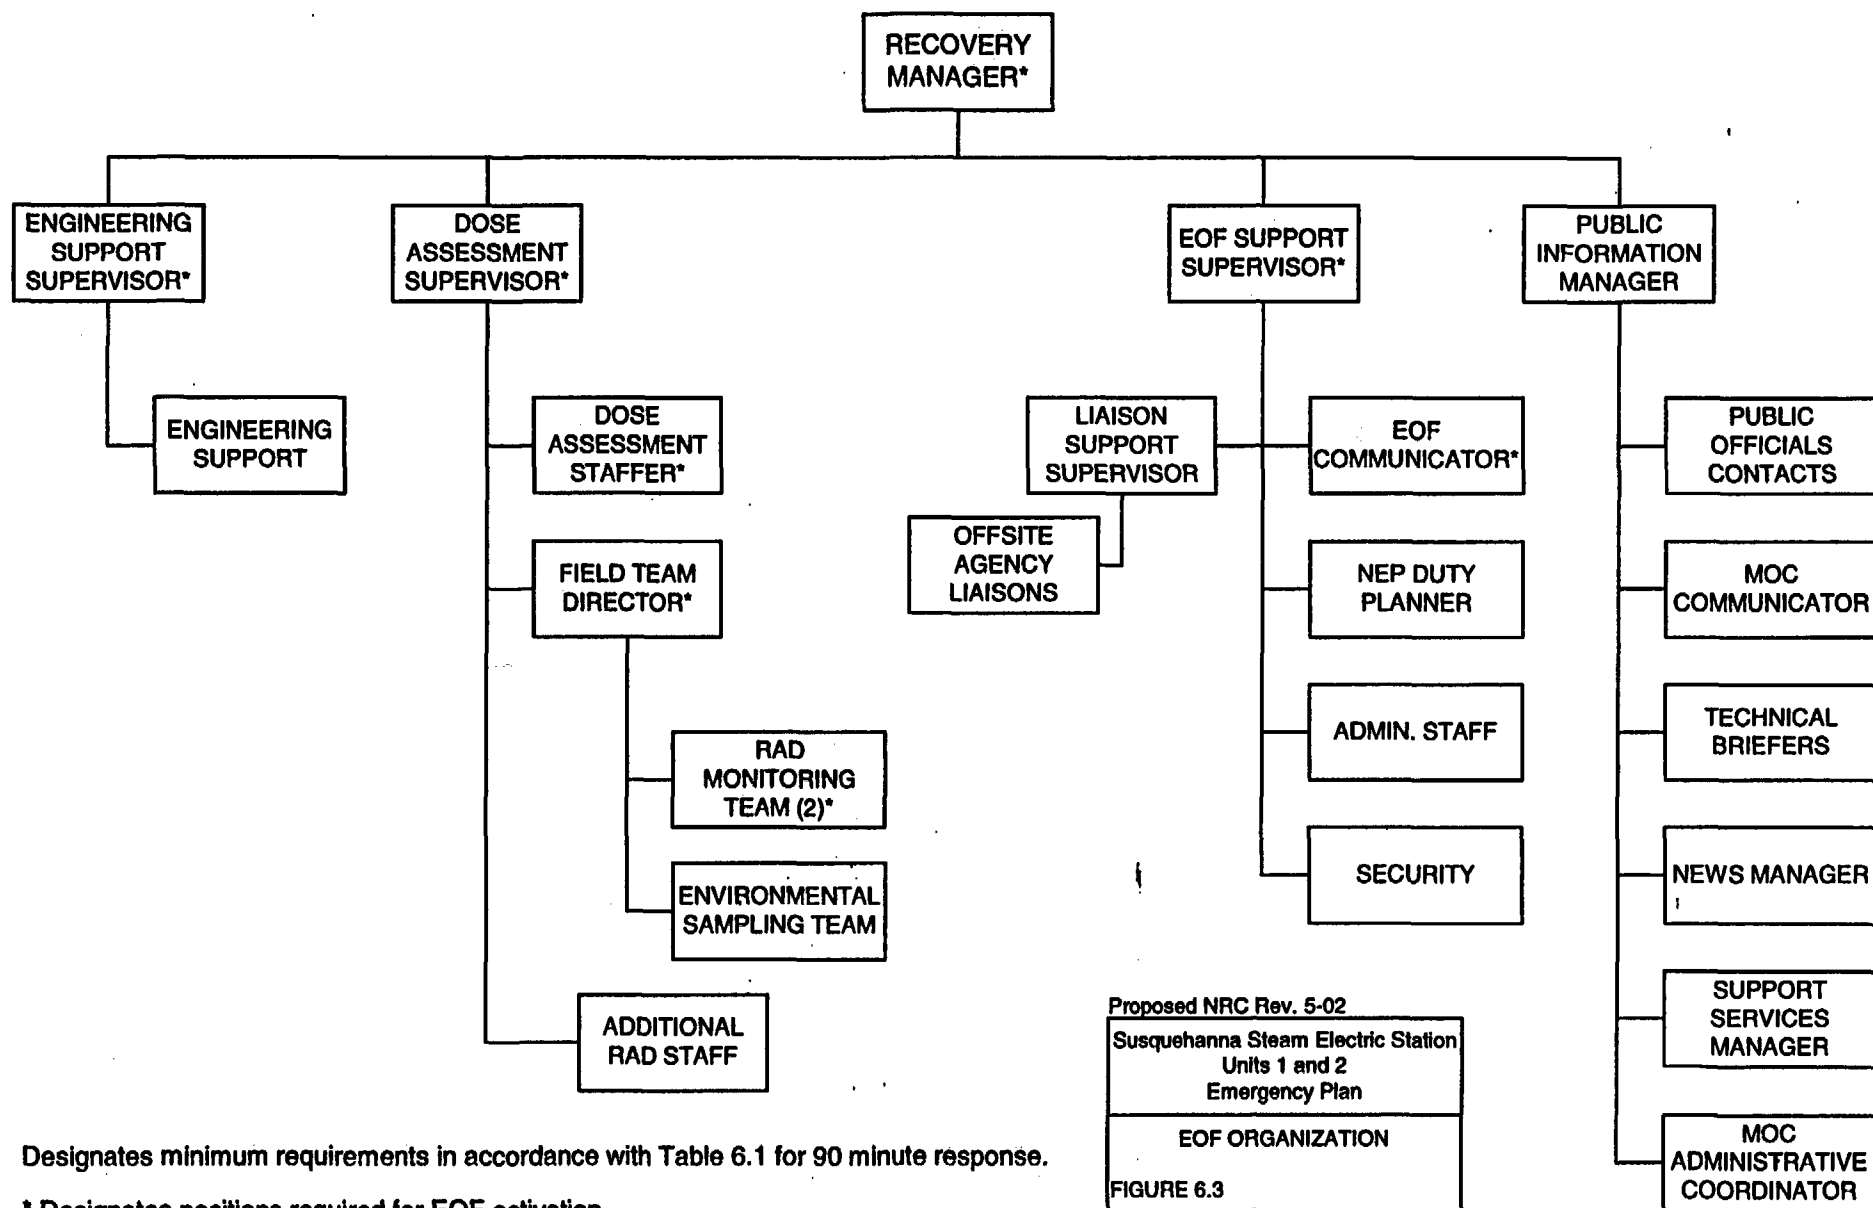

Designates minimum requirements in accordance with Table 6.1 for 90 minute response.

* Designates positions required for EOF activation.