



Tennessee Valley Authority, Post Office Box 2000, Soddy-Daisy, Tennessee 37384-2000

July 17, 2003

U.S. Nuclear Regulatory Commission  
ATTN: Document Control Desk  
Washington, D.C. 20555

Gentlemen:

In the Matter of	)	Docket Nos. 50-327
Tennessee Valley Authority	)	50-328


**SEQUOYAH NUCLEAR PLANT (SQN) - UNITS 1 AND 2 - WITHDRAWAL OF  
TECHNICAL SPECIFICATION (TS) CHANGE 03-02, "REVISION OF  
ULTIMATE HEAT SINK (UHS) TEMPERATURE AND ELEVATION  
REQUIREMENTS"**

Reference: TVA letter to NRC dated May 22, 2003, "Sequoyah  
Nuclear Plant (SQN) - Units 1 and 2 - Technical  
Specification (TS) Change 03-02, "Revision of  
Ultimate Heat Sink (UHS) Temperature and  
Elevation Requirements"

On May 22, 2003, (referenced letter) TVA requested a TS change to increase the maximum UHS temperature from 84.5 degrees Fahrenheit (F) to 87.0 degrees F and revise the minimum river level from 670 feet to 674 feet. Based on preliminary NRC review, it appears that the request will require more than minimal modification to support the NRC review. Therefore, TVA withdraws the request to make the necessary changes and will resubmit in the near future.

If you have any questions about this change, please telephone me at (423) 843-7170 or Jim Smith at (423) 843-6672.

Sincerely,

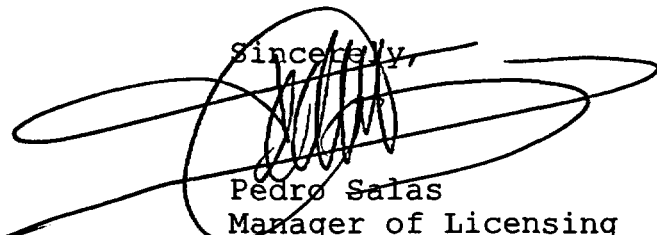

Pedro Salas  
Manager of Licensing  
and Industry Affairs

cc: See page 2

D030

U.S. Nuclear Regulatory Commission  
Page 2  
July 17, 2003

cc: Framatome ANP, Inc.  
P. O. Box 10935  
Lynchburg, Virginia 24506-0935  
ATTN: Mr. Frank Masseth

Mr. Michael L. Marshall, Jr., Senior Project Manager  
U.S. Nuclear Regulatory Commission  
Mail Stop O-8G9A  
One White Flint North  
11555 Rockville Pike  
Rockville, Maryland 20852-2739

Mr. Lawrence E. Nanney, Director  
Division of Radiological Health  
Third Floor  
L&C Annex  
401 Church Street  
Nashville, Tennessee 37243-1532