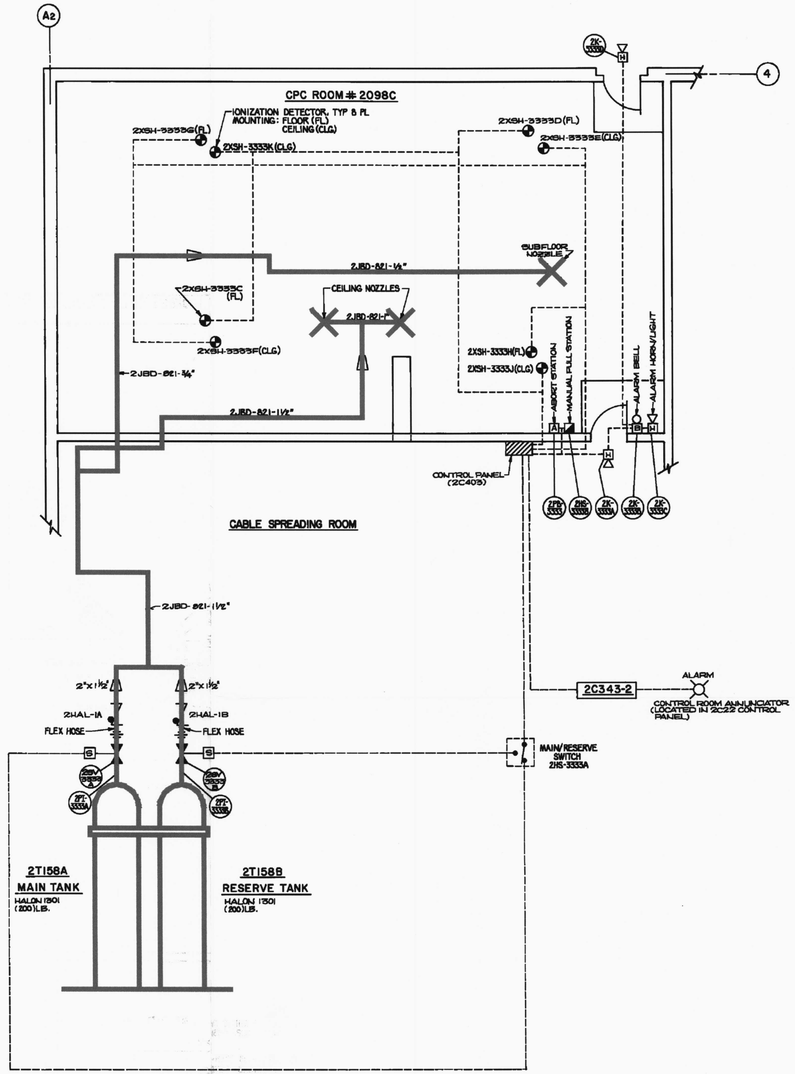

HALON FIRE SUPPRESSION SYSTEM CPC ROOM NO. 2098C

N.T.S.

NOTES:

1. SEE DRAWINGS M-2445 AND E-2561, SH 12 FOR ADDITIONAL HALON SUPPRESSION SYSTEM INFORMATION.
2. DETECTORS 2XSH-3333K, J, E, & F ARE CEILING SMOKE DETECTORS. DETECTORS 2XSH-3333C, D, G, & H ARE FALSE FLOOR SMOKE DETECTORS.

LEGEND	
LINE COLOR	SYSTEM/AMR REPORT
	HALON FIRE PROTECTION AND REACTOR COOLANT PUMP MOTOR OIL LEAKAGE COLLECTION/82-R-2885-12
	LICENSE RENEWAL BOUNDARY

ARKANSAS NUCLEAR ONE
UNIT 2
RUSSELLVILLE, ARKANSAS

PIPING & INSTRUMENT DIAGRAM
HALON FIRE SUPPRESSION SYSTEM

DRAWING NO	SHEET	REVISION
LRA-M-2219	6	0

BASED ON M-2219 SH 6 REV 2

RED "A" IF ORIGINAL

D-32