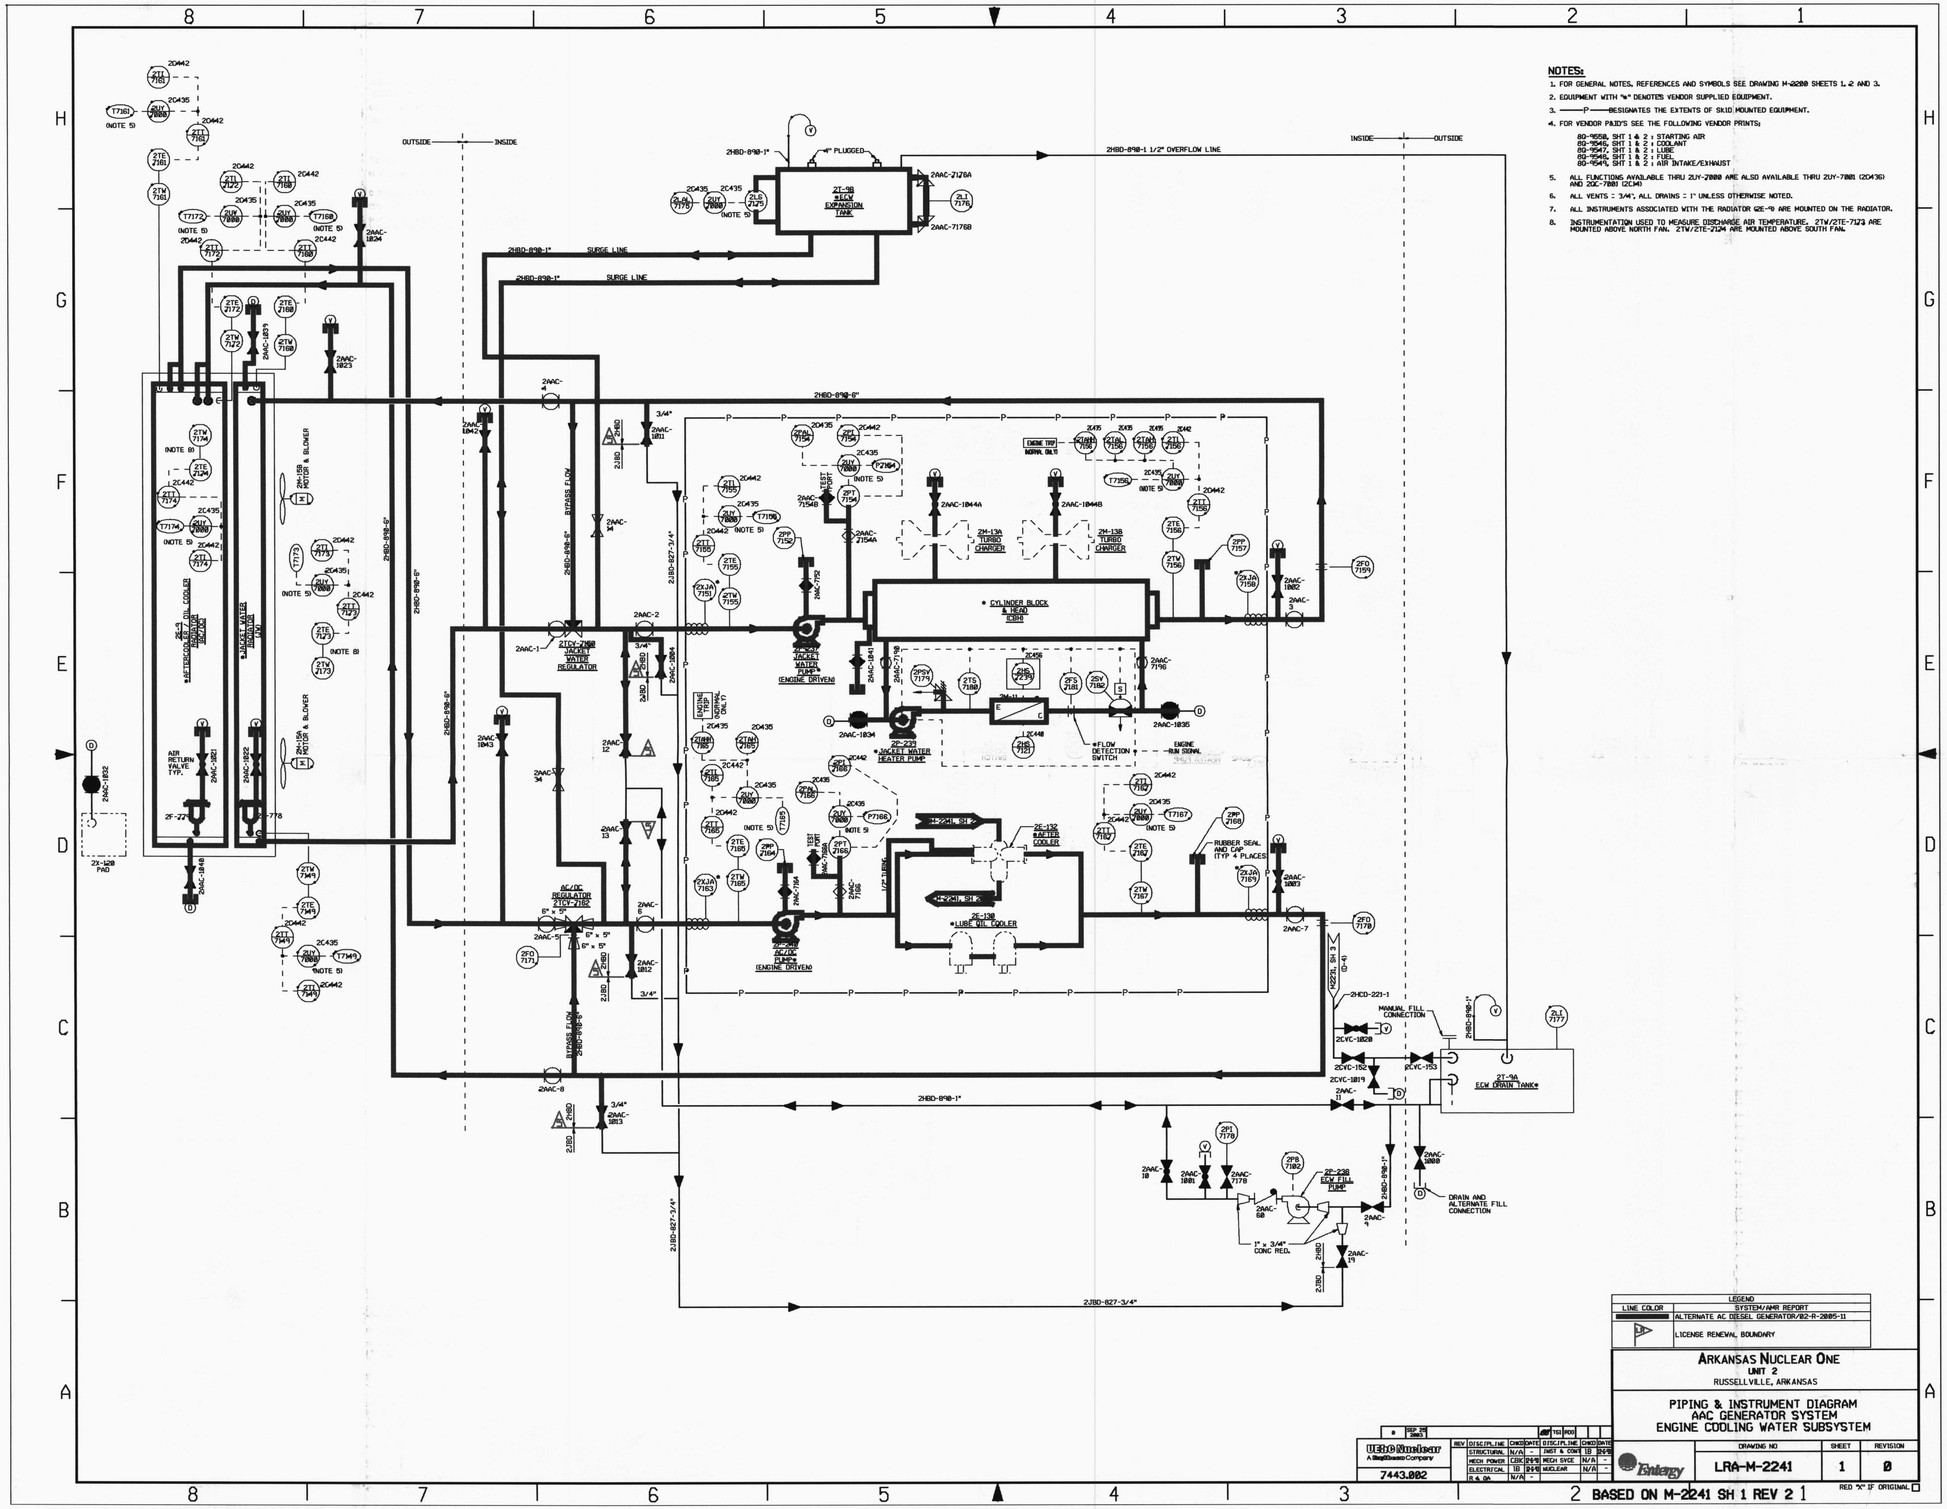

NOTES:

1. FOR GENERAL NOTES, REFERENCES AND SYMBOLS SEE DRAWING M-2200 SHEETS 1, 2 AND 3.
2. EQUIPMENT WITH "*" DENOTES VENDOR SUPPLIED EQUIPMENT.
3. ——P—— DESIGNATES THE EXTENTS OF SKID MOUNTED EQUIPMENT.
4. FOR VENDOR PAID'S SEE THE FOLLOWING VENDOR PRINTS;
   - 80-9558, SHT 1 & 2 : STARTING AIR
   - 80-9545, SHT 1 & 2 : COOLANT
   - 80-9547, SHT 1 & 2 : LUBE
   - 80-9548, SHT 1 & 2 : FUEL
   - 80-9547, SHT 1 & 2 : AIR INTAKE/EXHAUST
5. ALL FUNCTIONS AVAILABLE THRU 2UY-7000 ARE ALSO AVAILABLE THRU 2UY-7001 (2C436) AND 2UC-7001 (2CM)
6. ALL VENTS = 3/4", ALL DRAINS = 1" UNLESS OTHERWISE NOTED.
7. ALL INSTRUMENTS ASSOCIATED WITH THE RADIATOR (2E-9) ARE MOUNTED ON THE RADIATOR.
8. INSTRUMENTATION USED TO MEASURE DISCHARGE AIR TEMPERATURE. 2TW/2TE-7173 ARE MOUNTED ABOVE NORTH FAN. 2TW/2TE-7174 ARE MOUNTED ABOVE SOUTH FAN.

LEGEND	
LINE COLOR	SYSTEM/AMR REPORT
	ALTERNATE AC DIESEL GENERATOR/82-R-2085-11
	LICENSE RENEWAL BOUNDARY

ARKANSAS NUCLEAR ONE
UNIT 2
RUSSELLVILLE, ARKANSAS

PIPING & INSTRUMENT DIAGRAM
AAC GENERATOR SYSTEM
ENGINE COOLING WATER SUBSYSTEM

DRAWING NO	SHEET	REVISION
LRA-M-2241	1	0

Entergy

Ultra Flusher
A Bay Shores Company
7443.002

REV	DISCIPLINE	CHKD	DATE
	STRUCTURAL	N/A	-
	MECH POWER	CDK	8/98
	ELECTRICAL	TB	8/98
	R & QA	N/A	-

DISCIPLINE	CHKD	DATE
INST & CONT	TB	8/98
MECH SYCE	N/A	-
NUCLEAR	N/A	-

RED "X" IF ORIGINAL

BASED ON M-2241 SH 1 REV 2

D-49