

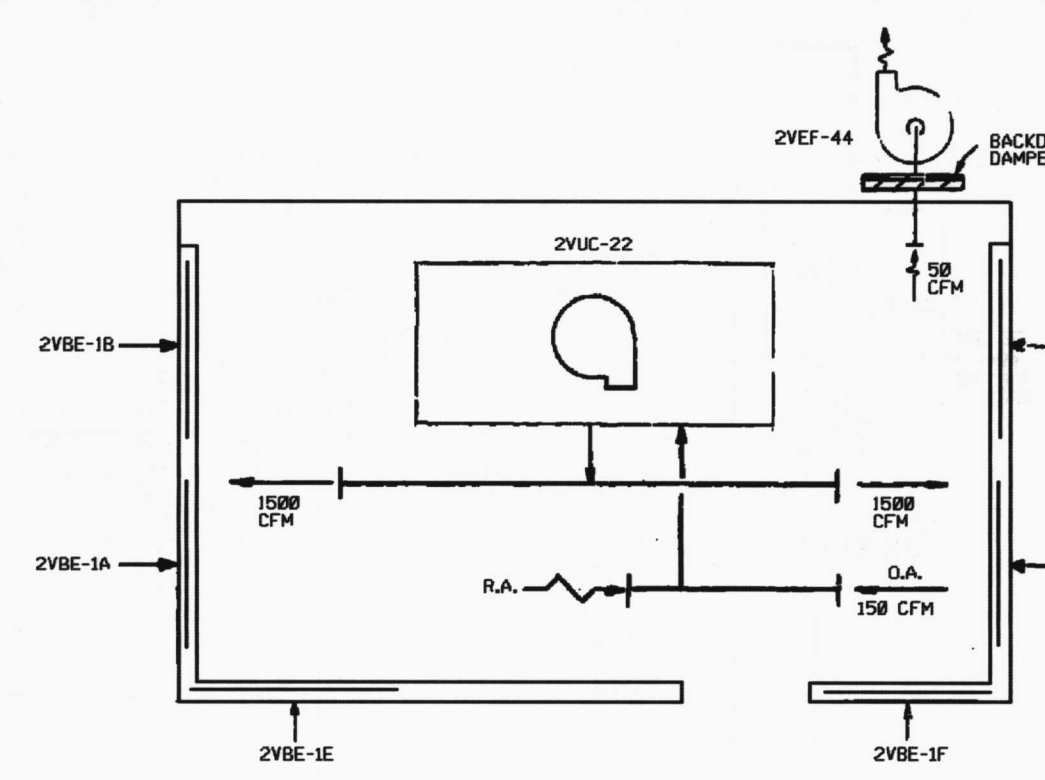


NOTES

1. FOR GENERAL NOTES AND DRAWING INDEX, SEE DWG. NO. M-2178.
2. FOR CONTROL DIAGRAMS, SEE DWG. NO. 2260 SHEET 2.
3. FOR LOGIC DIAGRAMS, SEE DWG. NO. M-2425, M-2431 & M-2433 SHT. 5.
4. ALL EQUIP. SUPPORTS AND DUCT SUPPORTS IN THE EMERGENCY DIESEL FUEL STORAGE AREA SHALL BE DESIGNED FOR A SEISMIC CLASS 1 CONSTRUCTION.
5. FOUR SUPPLY FANS AND FOUR FILTERS ARE BROUGHT FROM UNIT 1.
6. FOR MOUNTED MANUAL VOLUME DAMPER.
7. "ZONE XXX" DENOTES THE FIRE ZONE WHICH IS SERVED BY THE RESPECTIVE FANS SHOWN ON THIS DRAWING.

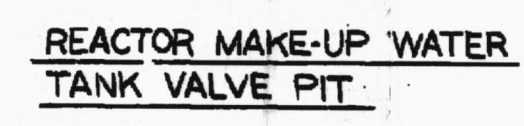

GUARD HOUSE

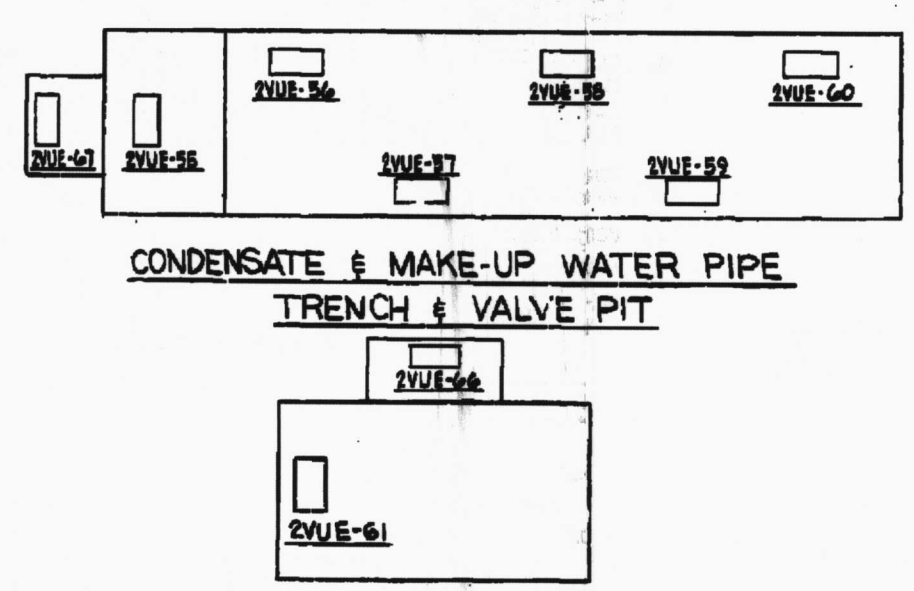