



**LR-E03-0475**

November 20, 2003

New Jersey Department of  
Environmental Protection  
Division of Water Quality  
Bureau of Permit Management  
P.O. Box 029  
Trenton, NJ 08625-0029  
Certified Mail Number 7001 1140 0003 0724 6288

**NEW JERSEY POLLUTANT DISCHARGE ELIMINATION SYSTEM  
DISCHARGE MONITORING REPORTS  
SALEM GENERATING STATION  
PERMIT NO. NJ0005622**

Attached is the Discharge Monitoring Report for Salem Generating Station containing the information as required in Permit No. NJ0005622, for the month of October 2003.

This report is required by and prepared specifically for the Environmental Protection Agency (EPA) and the New Jersey Department of Environmental Protection (NJDEP). It presents only the observed results of measurements and analyses required to be performed by the above agencies. The choice of the measurement devices and analytical methods is controlled by EPA and NJDEP, not by the company, and there are limitations on the accuracy of such measurement devices and analytical techniques even when used and maintained as required. Accordingly, this report is not intended as an assertion that any instrument has measured, or any reading or analytical result represents, the true value with absolute accuracy, nor is it an endorsement of the suitability of any analytical or measurement procedure.

Sincerely,

A handwritten signature in black ink, appearing to read "A. Christopher Bakken III".

A. Christopher Bakken III  
Sr. Vice President – Site Operations

Attachments

IE25

NJPDES Report  
October 2003

- C     Executive Director – DRBC  
       USNRC – Document Control Desk Unit#1-50-272 Unit#2-50-311  
       Manager – Nuclear Safety & Licensing  
       C. McAuliffe, Esq.  
       D. Hurka  
       E. Keating  
       SCH03-037

NJPDES Report  
Explanation of Deviations  
October 2003

The following excursions are included in the attached report and are explained below. Excursions have not endangered nor significantly impacted public health or the environment.

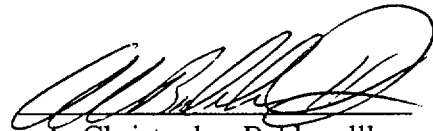
<u>DSN NO.</u>	<u>EXPLANATION</u>
----------------	--------------------

None	
------	--

COUNTY OF SALEM  
STATE OF NEW JERSEY


I, A. Christopher. Bakken III, of full age, being duly sworn according to law, upon my oath depose and say:

1. I A. Christopher Bakken III, Sr. Vice President of Site Operations for PSEG Nuclear, and as such, am authorized to sign Salem's Discharge Monitoring Reports submitted to the New Jersey Department of Environmental Protection pursuant to the Station's New Jersey Pollutant Discharge Elimination System permit.
2. I have reviewed the attached Discharge Monitoring Reports. Pursuant to N.J. A. C. 7:14A-2.4, I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments and that based on my inquiry of those individuals responsible for obtaining the information, I believe the submitted information is true, accurate and complete. I am aware that there are significant penalties for submitting false information including the possibility of fine and imprisonment.
3. The signature on the attached Discharge Monitoring Reports is my signature and I am submitting this affidavit in satisfaction of the requirement that my signature be notarized.



A. Christopher Bakken III  
Sr. Vice President  
Site Operations

Sworn and subscribed before me  
this 20 day of Nov 2003



SHERI L. HUSTON  
NOTARY PUBLIC OF NEW JERSEY  
My Commission Expires 12/08/2003



TO: James Eggers  
Engineering Supervisor - Licensing  
PSEG Power

November 4, 2003  
Report No. TP03069

**SUBJECT: DETERMINATION OF CIRCULATING WATER FLOW AT  
SALEM GENERATING STATION**

CONDUCTED BY: Victor Simpson  
Sr. Test Engineer, Maplewood Testing Services

**SUMMARY**

The Mechanical Division of Maplewood Testing Services conducted a series of test runs at Salem Unit No. 1 to determine the capacities of the circulating water pumps shown in the table below.

Work was performed under SAP work orders:  
30080157, 30080114, 30080190, 30080115, 30080243, 30080158

Final results are as follows:

**SUMMARY OF TEST RESULTS**

Pump No.	CMS Pump Desig.	Test Date	Measured Pump Capacity (gpm)	Pump Suction Head (ft h <sub>2</sub> o)	Pump Discharge Head (ft h <sub>2</sub> o)	Total Static Head (ft h <sub>2</sub> o)
11A	E	10/21/03	152819	-8.4	14.5	22.8
11B	A	10/21/03	165565	-9.3	13.5	22.7
12A	H	10/21/03	159649	-10.0	12.5	22.4
12B	F	10/21/03	152720	-12.7	7.5	20.1
13A	M	10/21/03	154686	-12.9	10.5	23.3
13B	I	10/21/03	147910	-12.8	8.7	21.5

Note: Pump suction heads and discharge heads corrected to elevation 100'

James Eggers  
Engineering Supervisor - Licensing  
PSEG Power

November 4, 2003  
Report No. TP03069

### TEST METHOD

The circulating water flow rate was determined by fluorometry using MTS Mechanical Division Work Instruction TPG-19 Rev. 6 "Water Flow Using The Turner Fluorometer". Rhodamine WT dye was injected into the bell mouth of each pump using 1/2 inc PVC pipe with a carrier flow of screen wash water at 3 gallons per minute.

The dye was injected at a known rate using a peristaltic pump and a class A burette to measure rate. The diluted sample was retrieved and monitored by taking a sample from the inlet water box piping. The ratio of the injected concentration to the sample concentration multiplied by the injection flow rate yielded the circulator flow rate.

The total static head was obtained by measuring the pump suction head in feet from elevation 100' and the pump discharge head in feet of water at the water box inlet. After correcting for elevation, the total pump head was calculated as the pump discharge head minus the pump suction head.

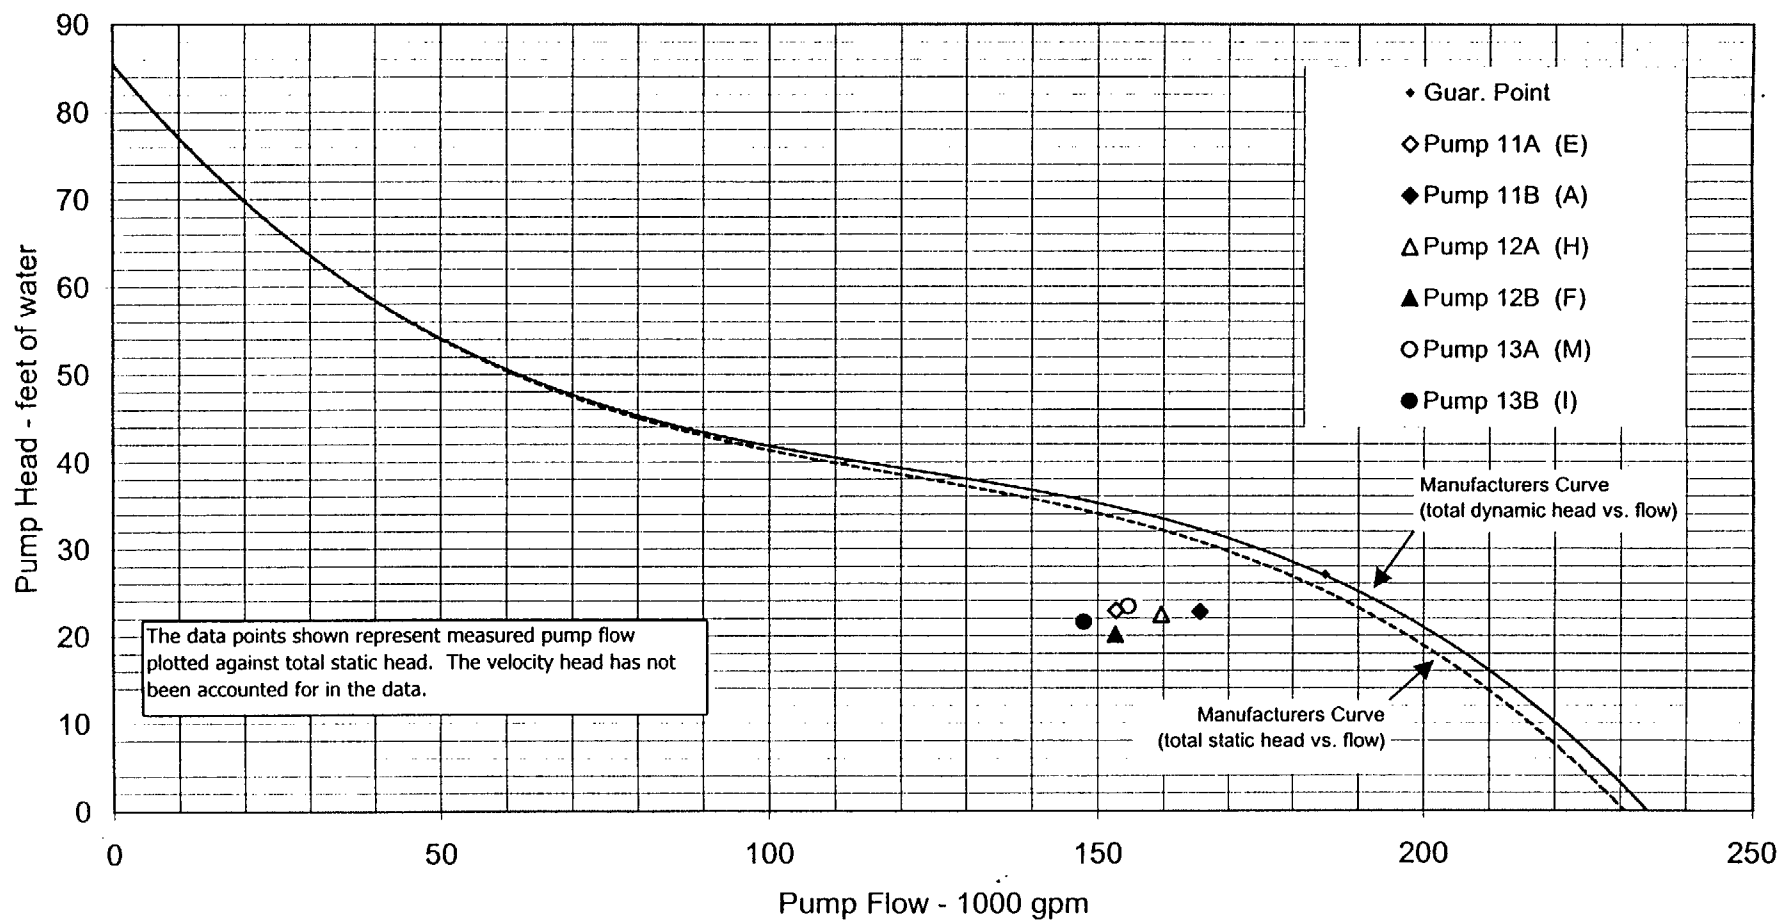


Senior Supervising Test Engineer  
MTS Mechanical Division

c D Hurka  
F Todd  
R Swartzwelder

D:\My Documents\report.doc

# **Salem Generating Station - Unit No.1** **Total Pump Head vs. Pump Flow**



New Jersey Department of Environmental Protection  
Division of Water Quality  
**Surface Water Discharge Monitoring Report Submittal Form**

PI 46814

NJPDES PERMIT	MONITORING PERIOD	MONITORED LOCATION:												
<b>NJ0005622</b>	<table border="1" style="display: inline-table;"><tr><td>Month</td><td>Day</td><td>Year</td></tr><tr><td style="text-align: center;">10</td><td style="text-align: center;">1</td><td style="text-align: center;">2003</td></tr></table> To <table border="1" style="display: inline-table;"><tr><td>Month</td><td>Day</td><td>Year</td></tr><tr><td style="text-align: center;">10</td><td style="text-align: center;">31</td><td style="text-align: center;">2003</td></tr></table>	Month	Day	Year	10	1	2003	Month	Day	Year	10	31	2003	<b>FACA - SW Outfall FACA</b>
Month	Day	Year												
10	1	2003												
Month	Day	Year												
10	31	2003												

**PERMITTEE:**

PSEG CO  
80 PARK PLZ  
MAIL CODE - T17  
NEWARK, NJ 07102

**LOCATION OF ACTIVITY:**

PSEG NUCLEAR LLC  
ALLOWAY CREEK NECK RD  
LOWER ALLOWAYS CREEK, NJ 08038-0000

**REPORT RECIPIENT:**

PSEG NUCLEAR LLC  
PO BOX 236/N21  
HANCOCKS BRIDGE, NJ 08038

**REGION / COUNTY: Southern / Salem County**

**CHECK IF APPLICABLE:**    ☐ No Discharge this Monitoring Period    ☐ Monitoring Report Comments Attached

**WHO MUST SIGN** The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey Water Pollution Control Act provides for penalties up to \$50,000 per violation.

A. Christopher Bakken III, Sr. Vice-President – Site Operations

N/A

NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR \*LICENSED OPERATOR

GRADE AND REGISTRY NUMBER (IF APPLICABLE)

11/20/2003

856-339-5700

SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR \*LICENSED OPERATOR

DATE

AREA CODE/PHONE NUMBER

*\*For a local agency where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have received and reviewed the attached discharge monitoring reports.

N/A

N/A

N/A

N/A

NAME AND TITLE

SIGNATURE

DATE

AREA CODE/PHONE NUMBER



# Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:

FACILITY NAME:

NJ0005622

FACA SW Outfall FACA

10/1/2003 TO 10/31/2003

PSEG NUCLEAR LLC

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Temperature, oC 00010 G Raw Sew/influent	SAMPLE MEASUREMENT	*****	*****	*****	*****	17.5	21.7	DEG.C	0	Continuous	CONTIN
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	REPORT 01DAMX			Continuous	CONTIN
	MDL										
Temperature, oC 00010 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	24.7	29.9	DEG.C	0	Continuous	CONTIN
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	43.3 01DAMX			Continuous	CONTIN
	MDL										
Temperature, oC 00010 2 Effluent Net Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	7.1	9.0	DEG.C	0	1/Day	CALCTD
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	15.3 01DAMX			1/Day	CALCTD
	MDL										
Lab Certification #  99999 99 Lab	SAMPLE MEASUREMENT	17327	06427		17451						
	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #			Not Applicable	NOT AP
	MDL										

Comments: If there are any questions in regards to the monitoring report form, please contact Susan Rosenwinkel of the BPSP - Region 2 at (609)292-4860 or via email at "srosenwi@dep.state.nj.us".

New Jersey Department of Environmental Protection  
Division of Water Quality

PI 46814

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT	MONITORING PERIOD							MONITORED LOCATION:												
NJ0005622	<table border="1"> <tr><th>Month</th></tr> <tr><td>10</td></tr> </table>	Month	10	<table border="1"> <tr><th>Day</th></tr> <tr><td>1</td></tr> </table>	Day	1	<table border="1"> <tr><th>Year</th></tr> <tr><td>2003</td></tr> </table>	Year	2003	To	<table border="1"> <tr><th>Month</th></tr> <tr><td>10</td></tr> </table>	Month	10	<table border="1"> <tr><th>Day</th></tr> <tr><td>31</td></tr> </table>	Day	31	<table border="1"> <tr><th>Year</th></tr> <tr><td>2003</td></tr> </table>	Year	2003	FACB - SW Outfall FACB
Month																				
10																				
Day																				
1																				
Year																				
2003																				
Month																				
10																				
Day																				
31																				
Year																				
2003																				

**PERMITTEE:**

PSEG CO  
80 PARK PLZ  
MAIL CODE - T17  
NEWARK, NJ 07102

**LOCATION OF ACTIVITY:**

PSEG NUCLEAR LLC  
ALLOWAY CREEK NECK RD  
LOWER ALLOWAYS CREEK, NJ 08038-0000

**REPORT RECIPIENT:**


PSEG NUCLEAR LLC  
PO BOX 236/N21  
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE: ☐ No Discharge this Monitoring Period ☐ Monitoring Report Comments Attached

**WHO MUST SIGN** The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey Water Pollution Control Act provides for penalties up to \$50,000 per violation.

A. Christopher Bakken III, Sr. Vice-President – Site Operations		N/A	
NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR		GRADE AND REGISTRY NUMBER (IF APPLICABLE)	
		11/20/2003	856-339-5700
SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR		DATE	AREA CODE/PHONE NUMBER

*\*For a local agency where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have received and reviewed the attached discharge monitoring reports.

N/A	N/A	N/A	N/A
NAME AND TITLE	SIGNATURE	DATE	AREA CODE/PHONE NUMBER

# Surface Water Discharge Monitoring Report

PI 40814

PERMIT NUMBER: MONITORED LOCATION: MONITORING PERIOD: FACILITY NAME:

NJ0005622

FACB SW Outfall FACB

10/1/2003 TO 10/31/2003

PSEG NUCLEAR LLC

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Temperature, oC 00010 G Raw Sew/Influent	SAMPLE MEASUREMENT	*****	*****	*****	*****	17.5	21.7	DEG.C	0	Continuous	CONTIN
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	REPORT 01DAMX		Continuous	CONTIN	
	MDL										
Temperature, oC 00010 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	22.9	31.2	DEG.C	0	Continuous	CONTIN
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	43.3 01DAMX		Continuous	CONTIN	
	MDL										
Temperature, oC 00010 2 Effluent Net Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	5.4	9.5	DEG.C	0	1/Day	CALCTD
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	15.3 01DAMX		1/Day	CALCTD	
	MDL										
Lab Certification #  99999 99 Lab	SAMPLE MEASUREMENT	17327	06431		17451						
	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #		Not Applic	NOT AP	
	MDL										

Comments: If there are any questions in regards to the monitoring report form, please contact Susan Rosenwinkel of the BPSP - Region 2 at (609)292-4860 or via email at "srosenwi@dep.state.nj.us".

New Jersey Department of Environmental Protection  
Division of Water Quality

PI 46814

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT	MONITORING PERIOD						MONITORED LOCATION:	
NJ0005622	Month 10	Day 1	Year 2003	To	Month 10	Day 31	Year 2003	FACC - SW Outfall FACC

**PERMITTEE:**

PSEG CO  
80 PARK PLZ  
MAIL CODE - T17  
NEWARK, NJ 07102

**LOCATION OF ACTIVITY:**

PSEG NUCLEAR LLC  
ALLOWAY CREEK NECK RD  
LOWER ALLOWAYS CREEK, NJ 08038-0000

**REPORT RECIPIENT:**

PSEG NUCLEAR LLC  
PO BOX 236/N21  
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

**CHECK IF APPLICABLE:**

☐

No Discharge this Monitoring Period

☐

Monitoring Report Comments Attached

**WHO MUST SIGN** The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey Water Pollution Control Act provides for penalties up to \$50,000 per violation.

A. Christopher Bakken III, Sr. Vice-President – Site Operations

N/A

NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR \*LICENSED OPERATOR GRADE AND REGISTRY NUMBER (IF APPLICABLE)



11/20/2003

856-339-5700

SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR \*LICENSED OPERATOR DATE AREA CODE/PHONE NUMBER

*\*For a local agency where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6(F5) that I have received and reviewed the attached discharge monitoring reports.

N/A

N/A

N/A

N/A

NAME AND TITLE

SIGNATURE

DATE

AREA CODE/PHONE NUMBER

# Surface Water Discharge Monitoring Report

PI 45814

**PERMIT NUMBER:** NJ0005622     
 **MONITORED LOCATION:** FACC SW Outfall FACC     
 **MONITORING PERIOD:** 10/1/2003 TO 10/31/2003     
 **FACILITY NAME:** PSEG NUCLEAR LLC

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Flow, In Conduit or Thru Treatment Plant 50050 G Raw Sew/influent	SAMPLE MEASUREMENT	1739	2698	MGD	*****	*****	*****	*****	0	1/Day	CALCTD
	PERMIT REQUIREMENT	3024 01MOAV	REPORT 01DAMX		*****	*****	*****			1/Day	CALCTD
	MDL										
Thermal Discharge Million BTUs per Hr 00015 2 Effluent Net Value	SAMPLE MEASUREMENT	8291	14627	MBTU/HR	*****	*****	*****	*****	0	1/Day	CALCTD
	PERMIT REQUIREMENT	REPORT 01MOAV	30600 01DAMX		*****	*****	*****			1/Day	CALCTD
	MDL										
Lab Certification #  99999 99 Lab	SAMPLE MEASUREMENT	17327	06431		17451						
	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #			Not Applic	NOT AP
	MDL										

Comments: If there are any questions in regards to the monitoring report form, please contact Susan Rosenwinkel of the BPSP - Region 2 at (609)292-4860 or via email at "srosenwi@dep.state.nj.us".

New Jersey Department of Environmental Protection  
Division of Water Quality  
**Surface Water Discharge Monitoring Report Submittal Form**

PI 46814

NJPDES PERMIT	MONITORING PERIOD	MONITORED LOCATION:														
<b>NJ0005622</b>	<table border="1" style="width: 100%; border-collapse: collapse;"><tr><td style="width: 15%;">Month</td><td style="width: 15%;">Day</td><td style="width: 15%;">Year</td><td style="width: 10%; text-align: center;">To</td><td style="width: 15%;">Month</td><td style="width: 15%;">Day</td><td style="width: 15%;">Year</td></tr><tr><td style="text-align: center;">10</td><td style="text-align: center;">1</td><td style="text-align: center;">2003</td><td></td><td style="text-align: center;">10</td><td style="text-align: center;">31</td><td style="text-align: center;">2003</td></tr></table>	Month	Day	Year	To	Month	Day	Year	10	1	2003		10	31	2003	<b>048C - SW Outfall 48C</b>
Month	Day	Year	To	Month	Day	Year										
10	1	2003		10	31	2003										

**PERMITTEE:**

PSEG CO  
80 PARK PLZ  
MAIL CODE - T17  
NEWARK, NJ 07102

**LOCATION OF ACTIVITY:**

PSEG NUCLEAR LLC  
ALLOWAY CREEK NECK RD  
LOWER ALLOWAYS CREEK, NJ 08038-0000

**REPORT RECIPIENT:**


PSEG NUCLEAR LLC  
PO BOX 236/N21  
HANCOCKS BRIDGE, NJ 08038

**REGION / COUNTY: Southern / Salem County**

**CHECK IF APPLICABLE:**    ☐ No Discharge this Monitoring Period    ☐ Monitoring Report Comments Attached

**WHO MUST SIGN** The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey Water Pollution Control Act provides for penalties up to \$50,000 per violation.

<u>A. Christopher Bakken III, Sr. Vice-President – Site Operations</u>	N/A
<b>NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR</b>	<b>GRADE AND REGISTRY NUMBER (IF APPLICABLE)</b>
	11/20/2003      856-339-5700
<b>SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR</b>	<b>DATE      AREA CODE/PHONE NUMBER</b>

*\*For a local agency where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have received and reviewed the attached discharge monitoring reports.

N/A	N/A	N/A	N/A
<b>NAME AND TITLE</b>	<b>SIGNATURE</b>	<b>DATE</b>	<b>AREA CODE/PHONE NUMBER</b>

# Surface Water Discharge Monitoring Report

PI 43814

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:

FACILITY NAME:

NJ0005622

048C SW Outfall 48C

10/1/2003 TO 10/31/2003

PSEG NUCLEAR LLC

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Flow, In Conduit or Thru Treatment Plant 50050 1 Effluent Gross Value	SAMPLE MEASUREMENT	0.1438	0.4440	MGD	*****	*****	*****	*****	0	1/Day	CALCTD
	PERMIT REQUIREMENT	REPORT 01MOAV	REPORT 01DAMX		*****	*****	*****			1/Day	CALCTD
	MDL										
Solids, Total Suspended 00530 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	8	10	MG/L	0	2/Month	COMPOS
	PERMIT REQUIREMENT	*****	*****		*****	30 01MOAV	100 01DAMX			2/Month	COMPOS
	MDL										
Nitrogen, Ammonia Total (as N) 00610 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	11	17	MG/L	0	2/Month	COMPOS
	PERMIT REQUIREMENT	*****	*****		*****	35 01MOAV	70 01DAMX			2/Month	COMPOS
	MDL										
Petroleum Hydrocarbons 00551 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	1	1	MG/L	0	2/Month	GRAB
	PERMIT REQUIREMENT	*****	*****		*****	10 01MOAV	15 01DAMX			2/Month	GRAB
	MDL										
Carbon, Tot Organic (TOC) 00680 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	34	47	MG/L	0	2/Month	COMPOS
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	50 01DAMX			2/Month	COMPOS
	MDL										
Lab Certification #  99999 99 Lab	SAMPLE MEASUREMENT	17327	06431		17451						
	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #			Not Applic	NOT AP
	MDL										

Comments: If there are any questions in regards to the monitoring report form, please contact Susan Rosenwinkel of the BPSP - Region 2 at (609)292-4680 or via email at "srosenwi@dep.state.nj.us".

New Jersey Department of Environmental Protection  
Division of Water Quality  
Surface Water Discharge Monitoring Report Submittal Form

PI 46814

NJPDES PERMIT	MONITORING PERIOD	MONITORED LOCATION:												
NJ0005622	<table border="1" style="display: inline-table; border-collapse: collapse;"><tr><td style="padding: 2px;">Month</td><td style="padding: 2px;">Day</td><td style="padding: 2px;">Year</td></tr><tr><td style="text-align: center;">10</td><td style="text-align: center;">1</td><td style="text-align: center;">2003</td></tr></table> To <table border="1" style="display: inline-table; border-collapse: collapse;"><tr><td style="padding: 2px;">Month</td><td style="padding: 2px;">Day</td><td style="padding: 2px;">Year</td></tr><tr><td style="text-align: center;">10</td><td style="text-align: center;">31</td><td style="text-align: center;">2003</td></tr></table>	Month	Day	Year	10	1	2003	Month	Day	Year	10	31	2003	481A - SW Outfall 481A
Month	Day	Year												
10	1	2003												
Month	Day	Year												
10	31	2003												

**PERMITTEE:**

PSEG CO  
80 PARK PLZ  
MAIL CODE - T17  
NEWARK, NJ 07102

**LOCATION OF ACTIVITY:**

PSEG NUCLEAR LLC  
ALLOWAY CREEK NECK RD  
LOWER ALLOWAYS CREEK, NJ 08038-0000

**REPORT RECIPIENT:**


PSEG NUCLEAR LLC  
PO BOX 236/N21  
HANCOCKS BRIDGE, NJ 08038

**REGION / COUNTY: Southern / Salem County**

**CHECK IF APPLICABLE:**    ☐ No Discharge this Monitoring Period    ☐ Monitoring Report Comments Attached

**WHO MUST SIGN** The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey Water Pollution Control Act provides for penalties up to \$50,000 per violation.

A. Christopher Bakken III, Sr. Vice-President – Site Operations	N/A
	
NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR	GRADE AND REGISTRY NUMBER (IF APPLICABLE)
SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR	DATE
<small>*For a local agency where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:</small>	

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have received and reviewed the attached discharge monitoring reports.

N/A	N/A	N/A	N/A
NAME AND TITLE	SIGNATURE	DATE	AREA CODE/PHONE NUMBER



# Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:

FACILITY NAME:

NJ0005622

481A SW Outfall 481A

10/1/2003 TO 10/31/2003

PSEG NUCLEAR LLC

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Flow, In Conduit or Thru Treatment Plant 50050 1 Effluent Gross Value	SAMPLE MEASUREMENT	494	510	MGD	*****	*****	*****	*****	0	1/Day	CALCTD
	PERMIT REQUIREMENT	REPORT 01MOAV	REPORT 01DAMX		*****	*****	*****			1/Day	CALCTD
	MDL										
pH 00400 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	7.3	*****	7.7	SU	0	1/Week	GRAB
	PERMIT REQUIREMENT	*****	*****		6.0 01DAMN	*****	9.0 01DAMX			1/Week	GRAB
	MDL										
pH 00400 7 Intake From Stream	SAMPLE MEASUREMENT	*****	*****	*****	7.6	*****	7.8	SU	0	1/Week	GRAB
	PERMIT REQUIREMENT	*****	*****		REPORT 01DAMN	*****	REPORT 01DAMX			1/Week	GRAB
	MDL										
LC50 Statre 96hr Acu Cyprinodon TAN6A 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	CODE=N	*****	*****	%EFFL	0	CODE=N	CODE=N
	PERMIT REQUIREMENT	*****	*****		50 01DAMN	*****	*****			2/Year	COMPOS
	MDL										
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 1	SAMPLE MEASUREMENT	*****	*****	*****	*****	CODE=N	CODE=N	MG/L	0	CODE=N	CODE=N
	PERMIT REQUIREMENT	*****	*****		*****	0.3 01MOAV	0.5 01DAMX			3/Week	GRAB
	MDL										
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 2	SAMPLE MEASUREMENT	*****	*****	*****	*****	<0.1	<0.1	MG/L	0	3/Week	GRAB
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	0.2 01DAMX			3/Week	GRAB
	MDL										

Comments: The permittee is required to perform acute toxicity testing on a minimum of one representative CWS outfall while DSN 48C is being routed to that outfall.

New Jersey Department of Environmental Protection  
Division of Water Quality  
**Surface Water Discharge Monitoring Report Submittal Form**

PI 46814

NJPDES PERMIT	MONITORING PERIOD							MONITORED LOCATION:
NJ0005622	Month	Day	Year	To	Month	Day	Year	482A - SW Outfall 482A
	10	1	2003		10	31	2003	

**PERMITTEE:**

PSEG CO  
80 PARK PLZ  
MAIL CODE - T17  
NEWARK, NJ 07102

**LOCATION OF ACTIVITY:**

PSEG NUCLEAR LLC  
ALLOWAY CREEK NECK RD  
LOWER ALLOWAYS CREEK, NJ 08038-0000

**REPORT RECIPIENT:**

PSEG NUCLEAR LLC  
PO BOX 236/N21  
HANCOCKS BRIDGE, NJ 08038

**REGION / COUNTY:** Southern / Salem County

**CHECK IF APPLICABLE:**    ☐ No Discharge this Monitoring Period    ☐ Monitoring Report Comments Attached

**WHO MUST SIGN** The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey Water Pollution Control Act provides for penalties up to \$50,000 per violation.

A. Christopher Bakken III, Sr. Vice-President – Site Operations

N/A

NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR \*LICENSED OPERATOR

GRADE AND REGISTRY NUMBER (IF APPLICABLE)

11/20/2003

856-339-5700

SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR \*LICENSED OPERATOR

DATE

AREA CODE/PHONE NUMBER

*\*For a local agency where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have received and reviewed the attached discharge monitoring reports.

N/A

N/A

N/A

N/A

NAME AND TITLE

SIGNATURE

DATE

AREA CODE/PHONE NUMBER

# Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:

FACILITY NAME:

NJ0005622

482A SW Outfall 482A

10/1/2003 TO 10/31/2003

PSEG NUCLEAR LLC

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Flow, In Conduit or Thru Treatment Plant 50050 1 Effluent Gross Value	SAMPLE MEASUREMENT	462	473	MGD	*****	*****	*****	*****	0	1/Day	CALCTD
	PERMIT REQUIREMENT	REPORT 01MOAV	REPORT 01DAMX		*****	*****	*****			1/Day	CALCTD
	MDL										
pH 00400 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	7.3	*****	7.7	SU	0	1/Week	GRAB
	PERMIT REQUIREMENT	*****	*****		6.0 01DAMN	*****	9.0 01DAMX			1/Week	GRAB
	MDL										
pH 00400 7 Intake From Stream	SAMPLE MEASUREMENT	*****	*****	*****	7.6	*****	7.8	SU	0	1/Week	GRAB
	PERMIT REQUIREMENT	*****	*****		REPORT 01DAMN	*****	REPORT 01DAMX			1/Week	GRAB
	MDL										
LC50 Statre 96hr Acu Cyprinodon TAN6A 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	CODE=N	*****	*****	%EFFL	0	CODE=N	CODE=N
	PERMIT REQUIREMENT	*****	*****		50 01DAMN	*****	*****			2/Year	COMPOS
	MDL										
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 1	SAMPLE MEASUREMENT	*****	*****	*****	*****	CODE=N	CODE=N	MG/L	0	CODE=N	CODE=N
	PERMIT REQUIREMENT	*****	*****		*****	0.3 01MOAV	0.5 01DAMX			3/Week	GRAB
	MDL										
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 2	SAMPLE MEASUREMENT	*****	*****	*****	*****	LO.1	LO.1	MG/L	0	3/Week	GRAB
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	0.2 01DAMX			3/Week	GRAB
	MDL										

Comments: The permittee is required to perform acute toxicity testing on a minimum of one representative CWS outfall while DSN 48C is being routed to that outfall.

New Jersey Department of Environmental Protection  
Division of Water Quality

PI 46814

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT	MONITORING PERIOD	MONITORED LOCATION:												
NJ0005622	<table border="1"><tr><th>Month</th><th>Day</th><th>Year</th></tr><tr><td>10</td><td>1</td><td>2003</td></tr></table> To <table border="1"><tr><th>Month</th><th>Day</th><th>Year</th></tr><tr><td>10</td><td>31</td><td>2003</td></tr></table>	Month	Day	Year	10	1	2003	Month	Day	Year	10	31	2003	483A - SW Outfall 483A
Month	Day	Year												
10	1	2003												
Month	Day	Year												
10	31	2003												

**PERMITTEE:**

PSEG CO  
80 PARK PLZ  
MAIL CODE - T17  
NEWARK, NJ 07102

**LOCATION OF ACTIVITY:**

PSEG NUCLEAR LLC  
ALLOWAY CREEK NECK RD  
LOWER ALLOWAYS CREEK, NJ 08038-0000

**REPORT RECIPIENT:**

PSEG NUCLEAR LLC  
PO BOX 236/N21  
HANCOCKS BRIDGE, NJ 08038

**REGION / COUNTY:** Southern / Salem County

**CHECK IF APPLICABLE:** ☐ No Discharge this Monitoring Period ☐ Monitoring Report Comments Attached

**WHO MUST SIGN** The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey Water Pollution Control Act provides for penalties up to \$50,000 per violation.

A. Christopher Bakken III, Sr. Vice-President – Site Operations

N/A

NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR \*LICENSED OPERATOR

GRADE AND REGISTRY NUMBER (IF APPLICABLE)



11/20/2003

856-339-5700

SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR \*LICENSED OPERATOR

DATE

AREA CODE/PHONE NUMBER

*\*For a local agency where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have received and reviewed the attached discharge monitoring reports.

N/A

N/A

N/A

N/A

NAME AND TITLE

SIGNATURE

DATE

AREA CODE/PHONE NUMBER

# Surface Water Discharge Monitoring Report

PI 45814

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:

FACILITY NAME:

NJ0005622

483A SW Outfall 483A

10/1/2003 TO 10/31/2003

PSEG NUCLEAR LLC

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Flow, In Conduit or Thru Treatment Plant 50050 1 Effluent Gross Value	SAMPLE MEASUREMENT	431	462	MGD	*****	*****	*****	*****	0	1/Day	CALCTD
	PERMIT REQUIREMENT	REPORT 01MOAV	REPORT 01DAMX		*****	*****	*****			1/Day	CALCTD
	MDL										
pH 00400 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	7.4	*****	7.7	SU	0	1/Week	GRAB
	PERMIT REQUIREMENT	*****	*****		6.0 01DAMN	*****	9.0 01DAMX			1/Week	GRAB
	MDL										
pH 00400 7 Intake From Stream	SAMPLE MEASUREMENT	*****	*****	*****	7.6	*****	7.8	SU	0	1/Week	GRAB
	PERMIT REQUIREMENT	*****	*****		REPORT 01DAMN	*****	REPORT 01DAMX			1/Week	GRAB
	MDL										
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 1	SAMPLE MEASUREMENT	*****	*****	*****	*****	CODE=N	CODE=N	MG/L	0	CODE=N	CODE=N
	PERMIT REQUIREMENT	*****	*****		*****	0.3 01MOAV	0.5 01DAMX			3/Week	GRAB
	MDL										
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 2	SAMPLE MEASUREMENT	*****	*****	*****	*****	<0.1	<0.1	MG/L	0	3/Week	GRAB
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	0.2 01DAMX			3/Week	GRAB
	MDL										
Temperature, oC 00010 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	24.7	31.7	DEG.C	0	1/Day	CONTIN
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	REPORT 01DAMX			1/Day	CONTIN
	MDL										

Comments: Any questions in regards to the monitoring report form can be directed to S. Rosenwinkel of the BPSP - Region 2 at (609)292-4860.

# Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER: MONITORED LOCATION: MONITORING PERIOD: FACILITY NAME:

NJ0005622

483A SW Outfall 483A

10/1/2003 TO 10/31/2003

PSEG NUCLEAR LLC

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Lab Certification #  99999 99 Lab	SAMPLE MEASUREMENT	17327	06431		17451						
	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #			Not Applic	NOT AP
	MDC										

Comments: Any questions in regards to the monitoring report form can be directed to S. Rosenwinkel of the BPSP - Region 2 at (609)292-4860.

New Jersey Department of Environmental Protection  
Division of Water Quality  
**Surface Water Discharge Monitoring Report Submittal Form**

PI 46814

NJPDES PERMIT	MONITORING PERIOD	MONITORED LOCATION:														
<b>NJ0005622</b>	<table border="1" style="width: 100%; border-collapse: collapse;"><tr><td style="width: 15%;">Month</td><td style="width: 15%;">Day</td><td style="width: 15%;">Year</td><td style="width: 10%; text-align: center;">To</td><td style="width: 15%;">Month</td><td style="width: 15%;">Day</td><td style="width: 15%;">Year</td></tr><tr><td style="text-align: center;">10</td><td style="text-align: center;">1</td><td style="text-align: center;">2003</td><td></td><td style="text-align: center;">10</td><td style="text-align: center;">31</td><td style="text-align: center;">2003</td></tr></table>	Month	Day	Year	To	Month	Day	Year	10	1	2003		10	31	2003	<b>484A - SW Outfall 484A</b>
Month	Day	Year	To	Month	Day	Year										
10	1	2003		10	31	2003										

**PERMITTEE:**

PSEG CO  
80 PARK PLZ  
MAIL CODE - T17  
NEWARK, NJ 07102

**LOCATION OF ACTIVITY:**

PSEG NUCLEAR LLC  
ALLOWAY CREEK NECK RD  
LOWER ALLOWAYS CREEK, NJ 08038-0000

**REPORT RECIPIENT:**

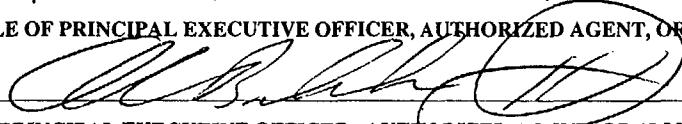
PSEG NUCLEAR LLC  
PO BOX 236/N21  
HANCOCKS BRIDGE, NJ 08038

**REGION / COUNTY: Southern / Salem County**

**CHECK IF APPLICABLE:**    ☐ No Discharge this Monitoring Period    ☐ Monitoring Report Comments Attached

**WHO MUST SIGN** The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey Water Pollution Control Act provides for penalties up to \$50,000 per violation.

A. Christopher Bakken III, Sr. Vice-President – Site Operations	N/A
	
NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR	GRADE AND REGISTRY NUMBER (IF APPLICABLE)
	11/20/2003      856-339-5700
SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR	DATE      AREA CODE/PHONE NUMBER

*\*For a local agency where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have received and reviewed the attached discharge monitoring reports.

N/A	N/A	N/A	N/A
NAME AND TITLE	SIGNATURE	DATE	AREA CODE/PHONE NUMBER



# Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:

FACILITY NAME:

NJ0005622

484A SW Outfall 484A

10/1/2003 TO 10/31/2003

PSEG NUCLEAR LLC

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Flow, In Conduit or Thru Treatment Plant 50050 1 Effluent Gross Value	SAMPLE MEASUREMENT	170	483	MGD	*****	*****	*****	*****	0	1/Day	CALCTD
	PERMIT REQUIREMENT	REPORT 01MOAV	REPORT 01DAMX		*****	*****	*****			1/Day	CALCTD
	MDL										
pH 00400 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	7.4	*****	7.7	SU	0	1/Week	GRAB
	PERMIT REQUIREMENT	*****	*****		6.0 01DAMN	*****	9.0 01DAMX			1/Week	GRAB
	MDL										
pH 00400 7 Intake From Stream	SAMPLE MEASUREMENT	*****	*****	*****	7.6	*****	7.8	SU	0	1/Week	GRAB
	PERMIT REQUIREMENT	*****	*****		REPORT 01DAMN	*****	REPORT 01DAMX			1/Week	GRAB
	MDL										
LC50 Statre 96hr Acu Cyprinodon TAN6A 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	CODE=N	*****	*****	%EFFL	0	CODE=N	CODE=N
	PERMIT REQUIREMENT	*****	*****		50 01DAMN	*****	*****			2/Year	COMPOS
	MDL										
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 1	SAMPLE MEASUREMENT	*****	*****	*****	*****	20.1	20.1	MG/L	0	3/Week	GRAB
	PERMIT REQUIREMENT	*****	*****		*****	0.3 01MOAV	0.5 01DAMX			3/Week	GRAB
	MDL										
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 2	SAMPLE MEASUREMENT	*****	*****	*****	*****	20.1	20.1	MG/L	0	3/Week	GRAB
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	0.2 01DAMX			3/Week	GRAB
	MDL										

Comments: The permittee is required to perform acute toxicity testing on a minimum of one representative CWS outfall while DSN 48C is being routed to that outfall.



New Jersey Department of Environmental Protection  
Division of Water Quality

PI 46814

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT	MONITORING PERIOD							MONITORED LOCATION:
NJ0005622	Month	Day	Year	To	Month	Day	Year	485A - SW Outfall 485A
	10	1	2003		10	31	2003	

**PERMITTEE:**

PSEG CO  
80 PARK PLZ  
MAIL CODE - T17  
NEWARK, NJ 07102

**LOCATION OF ACTIVITY:**

PSEG NUCLEAR LLC  
ALLOWAY CREEK NECK RD  
LOWER ALLOWAYS CREEK, NJ 08038-0000

**REPORT RECIPIENT:**

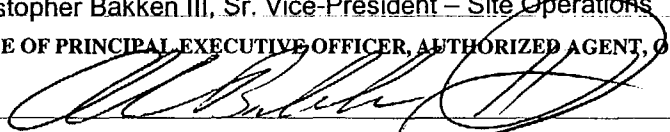
PSEG NUCLEAR LLC  
PO BOX 236/N21  
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE: ☐ No Discharge this Monitoring Period ☐ Monitoring Report Comments Attached

**WHO MUST SIGN** The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey Water Pollution Control Act provides for penalties up to \$50,000 per violation.

A. Christopher Bakken III, Sr. Vice-President – Site Operations		N/A	
NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR		GRADE AND REGISTRY NUMBER (IF APPLICABLE)	
		11/20/2003	856-339-5700
SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR		DATE	AREA CODE/PHONE NUMBER

*\*For a local agency where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have received and reviewed the attached discharge monitoring reports.

N/A	N/A	N/A	N/A
NAME AND TITLE	SIGNATURE	DATE	AREA CODE/PHONE NUMBER

# Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:

FACILITY NAME:

NJ0005622

485A SW Outfall 485A

10/1/2003 TO 10/31/2003

PSEG NUCLEAR LLC

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Flow, In Conduit or Thru Treatment Plant 50050 1 Effluent Gross Value	SAMPLE MEASUREMENT	148	457	MGD	*****	*****	*****	*****	0	1/Day	CALCTD
	PERMIT REQUIREMENT	REPORT 01MOAV	REPORT 01DAMX		*****	*****	*****			1/Day	CALCTD
	MDL										
pH 00400 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	7.3	*****	7.7	SU	0	1/Week	GRAB
	PERMIT REQUIREMENT	*****	*****		6.0 01DAMN	*****	9.0 01DAMX			1/Week	GRAB
	MDL										
pH 00400 7 Intake From Stream	SAMPLE MEASUREMENT	*****	*****	*****	7.6	*****	7.8	SU	0	1/Week	GRAB
	PERMIT REQUIREMENT	*****	*****		REPORT 01DAMN	*****	REPORT 01DAMX			1/Week	GRAB
	MDL										
LC50 Statre 96hr Acu Cyprinodon TAN6A 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	CODE = N	*****	*****	%EFFL	0	CODE = N	CODE = N
	PERMIT REQUIREMENT	*****	*****		50 01DAMN	*****	*****			2/Year	COMPOS
	MDL										
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 1	SAMPLE MEASUREMENT	*****	*****	*****	*****	<0.1	<0.1	MG/L	0	3/Week	GRAB
	PERMIT REQUIREMENT	*****	*****		*****	0.3 01MOAV	0.5 01DAMX			3/Week	GRAB
	MDL										
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 2	SAMPLE MEASUREMENT	*****	*****	*****	*****	<0.1	<0.1	MG/L	0	3/Week	GRAB
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	0.2 01DAMX			3/Week	GRAB
	MDL										

Comments: The permittee is required to perform acute toxicity testing on a minimum of one representative CWS outfall while DSN 48C is being routed to that outfall.

# Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:


FACILITY NAME:

NJ0005622

485A SW Outfall 485A

10/1/2003 TO 10/31/2003

PSEG NUCLEAR LLC

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Temperature, oC 00010 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	23.7	32.1	DEG.C	0	1/Day	CONTIN
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	REPORT 01DAMX			1/Day	CONTIN
	MDL										
Lab Certification #	SAMPLE MEASUREMENT	17327	06431		17451						
99999 99 Lab	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #			Not Applic	NOT AP
	MDL										

Comments: The permittee is required to perform acute toxicity testing on a minimum of one representative CWS outfall while DSN 48C is being routed to that outfall.

New Jersey Department of Environmental Protection  
Division of Water Quality

PI 46814

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT	MONITORING PERIOD	MONITORED LOCATION:												
NJ0005622	<table border="1"><tr><th>Month</th><th>Day</th><th>Year</th></tr><tr><td>10</td><td>1</td><td>2003</td></tr></table> To <table border="1"><tr><th>Month</th><th>Day</th><th>Year</th></tr><tr><td>10</td><td>31</td><td>2003</td></tr></table>	Month	Day	Year	10	1	2003	Month	Day	Year	10	31	2003	486A - SW Outfall 486A
Month	Day	Year												
10	1	2003												
Month	Day	Year												
10	31	2003												

**PERMITTEE:**

PSEG CO  
80 PARK PLZ  
MAIL CODE - T17  
NEWARK, NJ 07102

**LOCATION OF ACTIVITY:**

PSEG NUCLEAR LLC  
ALLOWAY CREEK NECK RD  
LOWER ALLOWAYS CREEK, NJ 08038-0000

**REPORT RECIPIENT:**

PSEG NUCLEAR LLC  
PO BOX 236/N21  
HANCOCKS BRIDGE, NJ 08038

**REGION / COUNTY:** Southern / Salem County

**CHECK IF APPLICABLE:** ☐ No Discharge this Monitoring Period ☐ Monitoring Report Comments Attached

**WHO MUST SIGN** The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey Water Pollution Control Act provides for penalties up to \$50,000 per violation.

\_\_\_\_° A. Christopher Bakken III, Sr. Vice-President – Site Operations \_\_\_\_\_ N/A  
NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR \*LICENSED OPERATOR GRADE AND REGISTRY NUMBER (IF APPLICABLE)  
\_\_\_\_\_  
SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR \*LICENSED OPERATOR DATE 11/20/2003 AREA CODE/PHONE NUMBER 856-339-5700  
\*For a local agency where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have received and reviewed the attached discharge monitoring reports.

____ N/A _____	____ N/A _____	____ N/A _____	____ N/A _____
NAME AND TITLE	SIGNATURE	DATE	AREA CODE/PHONE NUMBER

# Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:


FACILITY NAME:

NJ0005622

486A SW Outfall 486A

10/1/2003 TO 10/31/2003

PSEG NUCLEAR LLC

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Flow, In Conduit or Thru Treatment Plant 50050 1 Effluent Gross Value	SAMPLE MEASUREMENT	110	418	MGD	*****	*****	*****	*****	0	1/Day	CALCTD
	PERMIT REQUIREMENT	REPORT 01MOAV	REPORT 01DAMX		*****	*****	*****			1/Day	CALCTD
	MDL										
pH 00400 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	7.4	*****	7.7	SU	0	1/Week	GRAB
	PERMIT REQUIREMENT	*****	*****		6.0 01DAMN	*****	9.0 01DAMX			1/Week	GRAB
	MDL										
pH 00400 7 Intake From Stream	SAMPLE MEASUREMENT	*****	*****	*****	7.6	*****	7.8	SU	0	1/Week	GRAB
	PERMIT REQUIREMENT	*****	*****		REPORT 01DAMN	*****	REPORT 01DAMX			1/Week	GRAB
	MDL										
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 1	SAMPLE MEASUREMENT	*****	*****	*****	*****	<0.1	<0.1	MG/L	0	3/Week	GRAB
	PERMIT REQUIREMENT	*****	*****		*****	0.3 01MOAV	0.5 01DAMX			3/Week	GRAB
	MDL										
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 2	SAMPLE MEASUREMENT	*****	*****	*****	*****	<0.1	<0.1	MG/L	0	3/Week	GRAB
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	0.2 01DAMX			3/Week	GRAB
	MDL										
Temperature, oC 00010 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	22.3	31.6	DEG.C	0	1/Day	CONTIN
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	REPORT 01DAMX			1/Day	CONTIN
	MDL										

Comments: Any questions in regards to the monitoring report form can be directed to S. Rosenwinkel of the BPSP - Region 2 at (609)292-4860.

# Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER: MONITORED LOCATION: MONITORING PERIOD: FACILITY NAME:

NJ0005622

486A SW Outfall 486A

10/1/2003 TO 10/31/2003

PSEG NUCLEAR LLC

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Lab Certification #	SAMPLE MEASUREMENT	17327	06431		17451						
99999 99	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #			Not Applic	NOT AP
Lab	MDI										

Comments: Any questions in regards to the monitoring report form can be directed to S. Rosenwinkel of the BPSP - Region 2 at (609)292-4860.

New Jersey Department of Environmental Protection  
Division of Water Quality

PI 46814

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT	MONITORING PERIOD							MONITORED LOCATION:
NJ0005622	Month	Day	Year	To	Month	Day	Year	487B - SW Outfall 487B
	10	1	2003		10	31	2003	

**PERMITTEE:**

PSEG CO  
80 PARK PLZ  
MAIL CODE - T17  
NEWARK, NJ 07102

**LOCATION OF ACTIVITY:**

PSEG NUCLEAR LLC  
ALLOWAY CREEK NECK RD  
LOWER ALLOWAYS CREEK, NJ 08038-0000

**REPORT RECIPIENT:**

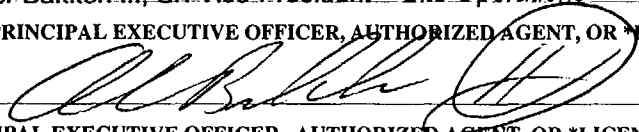
PSEG NUCLEAR LLC  
PO BOX 236/N21  
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE: ☒ No Discharge this Monitoring Period ☐ Monitoring Report Comments Attached

**WHO MUST SIGN** The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey Water Pollution Control Act provides for penalties up to \$50,000 per violation.

A. Christopher Bakken III, Sr. Vice-President – Site Operations		N/A	
NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR		GRADE AND REGISTRY NUMBER (IF APPLICABLE)	
		11/20/2003	856-339-5700
SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR		DATE	AREA CODE/PHONE NUMBER

\*For a local agency where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have received and reviewed the attached discharge monitoring reports.

N/A	N/A	N/A	N/A
NAME AND TITLE	SIGNATURE	DATE	AREA CODE/PHONE NUMBER

New Jersey Department of Environmental Protection  
Division of Water Quality

PI 46814

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT	MONITORING PERIOD	MONITORED LOCATION:													
NJ0005622	<table border="1"><tr><td>Month</td><td>Day</td><td>Year</td><td rowspan="2">To</td><td>Month</td><td>Day</td><td>Year</td></tr><tr><td>10</td><td>1</td><td>2003</td><td>10</td><td>31</td><td>2003</td></tr></table>	Month	Day	Year	To	Month	Day	Year	10	1	2003	10	31	2003	489A - SW Outfall 489A
Month	Day	Year	To	Month		Day	Year								
10	1	2003		10	31	2003									

**PERMITTEE:**

PSEG CO  
80 PARK PLZ  
MAIL CODE - T17  
NEWARK, NJ 07102

**LOCATION OF ACTIVITY:**

PSEG NUCLEAR LLC  
ALLOWAY CREEK NECK RD  
LOWER ALLOWAYS CREEK, NJ 08038-0000

**REPORT RECIPIENT:**

PSEG NUCLEAR LLC  
PO BOX 236/N21  
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE: ☐ No Discharge this Monitoring Period ☐ Monitoring Report Comments Attached

**WHO MUST SIGN** The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey Water Pollution Control Act provides for penalties up to \$50,000 per violation.

A. Christopher Bakken III, Sr. Vice-President – Site Operations

N/A

NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR \*LICENSED OPERATOR

GRADE AND REGISTRY NUMBER (IF APPLICABLE)

11/20/2003

856-339-5700

SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR \*LICENSED OPERATOR

DATE

AREA CODE/PHONE NUMBER

*\*For a local agency where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have received and reviewed the attached discharge monitoring reports.

N/A

N/A

N/A

N/A

NAME AND TITLE

SIGNATURE

DATE

AREA CODE/PHONE NUMBER



# Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:

FACILITY NAME:

NJ0005622

489A SW Outfall 489A

10/1/2003 TO 10/31/2003

PSEG NUCLEAR LLC

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Flow, In Conduit or Thru Treatment Plant 50050 1 Effluent Gross Value	SAMPLE MEASUREMENT	0.1354	0.1354	MGD	*****	*****	*****	*****	0	1/Month	CALCTD
	PERMIT REQUIREMENT	REPORT 01MOAV	REPORT 01DAMX		*****	*****	*****			1/Month	CALCTD
	MDL										
pH 00400 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	7.5	*****	7.5	SU	0	1/Month	GRAB
	PERMIT REQUIREMENT	*****	*****		6.0 01DAMN	*****	9.0 01DAMX			1/Month	GRAB
	MDL										
Solids, Total Suspended 00530 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	26	26	*****	MG/L	0	1/Month	GRAB
	PERMIT REQUIREMENT	*****	*****		100 01DAMX	30 01MOAV	*****			1/Month	GRAB
	MDL										
Petroleum Hydrocarbons 00551 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	1	1	MG/L	0	1/Month	GRAB
	PERMIT REQUIREMENT	*****	*****		*****	10 01MOAV	15 01DAMX			1/Month	GRAB
	MDL										
Carbon, Tot Organic (TOC) 00680 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	12	12	MG/L	0	1/Month	GRAB
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	50 01DAMX			1/Month	GRAB
	MDL										
Lab Certification # 99999 99 Lab	SAMPLE MEASUREMENT	17327	06431		17451						
	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #			Not Applic	NOT AP
	MDL										

Comments: If there are any questions in regards to the monitoring report form, please contact Susan Rosenwinkel of the the BPSP - Region 2 at (609)292-4860 or via email at "srosenwi@dep.state.nj.us".