

September 17, 2003

TSTF-03-07

Dr. William D. Beckner, Director
Operating Reactor Improvements Program
Division of Regulatory Improvement Programs
Office of Nuclear Reactor Regulation
U.S. Nuclear Regulatory Commission
Washington, DC 20555-0001

SUBJECT: TSTF-459, TSTF-460, and TSTF-465

Dear Dr. Beckner:

Enclosed for NRC consideration are the following Technical Specification Task Force Travelers:


TSTF-459, Revision 0, "Eliminate the requirement to have one RHR Shutdown Cooling System in operation;"

TSTF-460, Revision 0, "Control Rod Scram Time Testing Frequency;" and


TSTF-465, Revision 0, "Addition of time performance Surveillance Requirement (SR) note to Source Range Monitor (SRM) SRs."

Any NRC review fees associated with these Travelers should be billed to the Boiling Water Reactors Owners Group.

Should you have any questions, please do not hesitate to contact us.




Steve Wideman (WOG)



Patricia Furio (CEOG)



Tom Silk (BWROG)

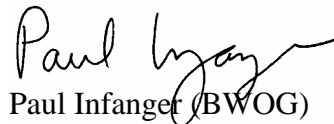

Paul Infanger (BWOG)

Enclosure

cc: K, Putnam, BWROG

Technical Specification Task Force

Improved Standard Technical Specifications Change Traveler

Eliminate the requirement to have one RHR Shutdown Cooling System in operation

NUREGs Affected: ☐ 1430 ☐ 1431 ☐ 1432 ☒ 1433 ☒ 1434

Classification: 3) Improve Specifications

Recommended for CLIIP?: Yes

Correction or Improvement: Improvement

Industry Contact: Tom Silko, (802) 258-4146, tsilko@entergy.com

See attached.

Revision History

OG Revision 0

Revision Status: Closed

Revision Proposed by:

Revision Description:
Original Issue

Owners Group Review Information

Date Originated by OG: 16-May-97

Owners Group Comments:

2/14/2001 - discussed by TSTF. Needs Safety Evaluation quality justification and be marked on Revision 2 pages.

Owners Group Resolution: Approved Date: 21-Sep-99

OG Revision 1

Revision Status: Active

Revision Proposed by: BWROG

Revision Description:

Remarked on Revision 2 pages and expanded justification to SE quality.

Owners Group Review Information

Date Originated by OG: 21-May-03

Owners Group Comments:

(No Comments)

Owners Group Resolution: Approved Date: 21-May-03

TSTF Review Information

TSTF Received Date: 08-Aug-03

Date Distributed for Review: 12-Aug-03

OG Review Completed: ☒ BWOG ☒ WOG ☒ CEOG ☒ BWROG

TSTF Comments:

(No Comments)

17-Sep-03

OG Revision 1**Revision Status: Active**

TSTF Resolution: Approved

Date: 26-Aug-03

NRC Review Information

NRC Received Date: 19-Sep-03

Affected Technical Specifications

LCO 3.9.8	RHR - High Water Level	
LCO 3.9.8 Bases	RHR - High Water Level	
Action 3.9.8.C	RHR - High Water Level Change Description: Deleted	
Action 3.9.8.C Bases	RHR - High Water Level Change Description: Deleted	
SR 3.9.8.1	RHR - High Water Level	
SR 3.9.8.1 Bases	RHR - High Water Level	
LCO 3.9.9	RHR - Low Water Level	
LCO 3.9.9 Bases	RHR - Low Water Level	
Action 3.9.9.C	RHR - Low Water Level Change Description: Deleted	
Action 3.9.9.C Bases	RHR - Low Water Level Change Description: Deleted	
SR 3.9.9.1	RHR - Low Water Level	
SR 3.9.9.1 Bases	RHR - Low Water Level	
LCO 3.4.8	RHR Shutdown Cooling System - Hot Shutdown	NUREG(s)- 1433 Only
LCO 3.4.8 Bases	RHR Shutdown Cooling System - Hot Shutdown	NUREG(s)- 1433 Only
Appl. 3.4.8 Bases	RHR Shutdown Cooling System - Hot Shutdown	NUREG(s)- 1433 Only
Action 3.4.8.A Bases	RHR Shutdown Cooling System - Hot Shutdown	NUREG(s)- 1433 Only
Action 3.4.8.B	RHR Shutdown Cooling System - Hot Shutdown Change Description: Deleted	NUREG(s)- 1433 Only

17-Sep-03

Action 3.4.8.B Bases	RHR Shutdown Cooling System - Hot Shutdown Change Description: Deleted	NUREG(s)- 1433 Only
SR 3.4.8.1	RHR Shutdown Cooling System - Hot Shutdown	NUREG(s)- 1433 Only
SR 3.4.8.1 Bases	RHR Shutdown Cooling System - Hot Shutdown	NUREG(s)- 1433 Only
LCO 3.4.9	RHR Shutdown Cooling System - Cold Shutdown	NUREG(s)- 1433 Only
LCO 3.4.9 Bases	RHR Shutdown Cooling System - Cold Shutdown	NUREG(s)- 1433 Only
Appl. 3.4.9 Bases	RHR Shutdown Cooling System - Cold Shutdown	NUREG(s)- 1433 Only
Action 3.4.9.A Bases	RHR Shutdown Cooling System - Cold Shutdown	NUREG(s)- 1433 Only
Action 3.4.9.B	RHR Shutdown Cooling System - Cold Shutdown Change Description: Deleted	NUREG(s)- 1433 Only
Action 3.4.9.B Bases	RHR Shutdown Cooling System - Cold Shutdown Change Description: Deleted	NUREG(s)- 1433 Only
SR 3.4.9.1	RHR Shutdown Cooling System - Cold Shutdown	NUREG(s)- 1433 Only
SR 3.4.9.1 Bases	RHR Shutdown Cooling System - Cold Shutdown	NUREG(s)- 1433 Only
Appl. 3.9.8 Bases	RHR - High Water Level	NUREG(s)- 1433 Only
Appl. 3.9.9 Bases	RHR - Low Water Level	NUREG(s)- 1433 Only
LCO 3.4.9	RHR Shutdown Cooling System - Hot Shutdown	NUREG(s)- 1434 Only
LCO 3.4.9 Bases	RHR Shutdown Cooling System - Hot Shutdown	NUREG(s)- 1434 Only
Appl. 3.4.9 Bases	RHR Shutdown Cooling System - Hot Shutdown	NUREG(s)- 1434 Only
Action 3.4.9.A Bases	RHR Shutdown Cooling System - Hot Shutdown	NUREG(s)- 1434 Only
Action 3.4.9.B	RHR Shutdown Cooling System - Hot Shutdown Change Description: Deleted	NUREG(s)- 1434 Only
Action 3.4.9.B Bases	RHR Shutdown Cooling System - Hot Shutdown Change Description: Deleted	NUREG(s)- 1434 Only
SR 3.4.9.1	RHR Shutdown Cooling System - Hot Shutdown	NUREG(s)- 1434 Only
SR 3.4.9.1 Bases	RHR Shutdown Cooling System - Hot Shutdown	NUREG(s)- 1434 Only
LCO 3.4.10	RHR Shutdown Cooling System - Cold Shutdown	NUREG(s)- 1434 Only
LCO 3.4.10 Bases	RHR Shutdown Cooling System - Cold Shutdown	NUREG(s)- 1434 Only
Appl. 3.4.10 Bases	RHR Shutdown Cooling System - Cold Shutdown	NUREG(s)- 1434 Only

17-Sep-03

Action	3.4.10.A Bases	RHR Shutdown Cooling System - Cold Shutdown	NUREG(s)- 1434 Only
Action	3.4.10.B	RHR Shutdown Cooling System - Cold Shutdown Change Description: Deleted	NUREG(s)- 1434 Only
Action	3.4.10.B Bases	RHR Shutdown Cooling System - Cold Shutdown Change Description: Deleted	NUREG(s)- 1434 Only
SR	3.4.10.1	RHR Shutdown Cooling System - Cold Shutdown	NUREG(s)- 1434 Only
SR	3.4.10.1 Bases	RHR Shutdown Cooling System - Cold Shutdown	NUREG(s)- 1434 Only

17-Sep-03

1.0 Description

This change will revise the BWR/4 and BWR/6 ISTS NUREGs to not require an RHR Shutdown Cooling System to be in operation in MODE 3 with reactor steam dome pressure < [the RHR cut in permissive pressure], MODE 4, and MODE 5 with irradiated fuel in the reactor pressure vessel.

2.0 Proposed Change

The Limiting Conditions for Operation (LCOs) of the following Specifications are revised to eliminate the requirement that at least one RHR shutdown cooling system must be in operation.

- BWR/4 LCO 3.4.8, RHR Shutdown Cooling System - Hot Shutdown
- BWR/4 LCO 3.4.9, RHR Shutdown Cooling System - Cold Shutdown
- BWR/4 LCO 3.9.8, RHR - High Water Level
- BWR/4 LCO 3.9.9, RHR - Low Water Level
- BWR/6 LCO 3.4.9, RHR Shutdown Cooling System - Hot Shutdown
- BWR/6 LCO 3.4.10, RHR Shutdown Cooling System - Cold Shutdown
- BWR/6 LCO 3.9.8, RHR - High Water Level
- BWR/6 LCO 3.9.9, RHR - Low Water Level

LCO Notes allowing the operating RHR shutdown cooling subsystem to be stopped are removed and ACTIONS related to no operating RHR shutdown cooling subsystem are eliminated.

The Surveillance of each of the Specifications listed above is revised from verifying that an RHR shutdown cooling subsystem is operating every 12 hours to verifying every 31 days that each required RHR shutdown cooling subsystem manual, power operated, and automatic valve in the flow path that is not locked, sealed, or otherwise secured in position, is aligned or can be aligned to its correct position.

3.0 Background

The RHR Shutdown Cooling (SDC) System one mode of operation of the RHR System. This mode is associated with a UFSAR “Power Generation Objective,” such that the system can “remove decay and residual heat from the reactor core to achieve and maintain a cold shutdown condition.” This normal operational mode of RHR utilizes a single suction path from one recirculation loop, which is common to both RHR divisions. Due to the inherent single failure nature of this common flow path, these valves are not required to perform an opening safety function. Also, the RHR SDC provides circulation of the reactor coolant to aid in the measurement of average reactor coolant temperature. The RHR SDC System is not required for mitigation of any event or accident evaluated in the safety analyses.

The change to the subject LCOs will allow RHR SDC operation to be established based on the plant conditions and will facilitate operational evolutions, such as in-vessel inspections and RHR SDC relief valve testing.

4.0 Technical Analysis

In the original development of the ISTS NUREGs, the BWROG commented to the NRC that the requirement to have one RHR SDC subsystem in operation does not meet the criteria specified in 10CFR 50.36(c)(2)(ii). RHR SDC subsystems are only required to be operating when desired by plant operations to reduce reactor coolant temperature. Its operation may also be desired on occasion to ensure adequate core flow to allow for accurate average reactor coolant temperature monitoring. Monitoring of average reactor coolant temperature may be accomplished by continuous or intermittent operation of the subsystems, or by other systems and is associated with normal operational monitoring.

Industry commitment to NUMARC 91-06, Shutdown Risk Management, requires that plants have a conservative estimate of the time to boil for the reactor coolant system. Continuous, forced reactor coolant flow solely for the purpose of mixing to measure reactor coolant temperature is overly conservative. Natural circulation will provide sufficient mixing to obtain a reasonable estimate of average reactor coolant temperature. Periodic measurement of reactor coolant temperature or the use of temporary or alternate temperature measurement instruments, when combined with a conservatively calculated time to boil, are sufficient to assure plant safety.

Unlike Pressurized Water Reactors, Boiling Water Reactors do not use boron in the reactor coolant for normal shutdown margin. Therefore, continuous operation of RHR SDC to ensure mixing of a borated solution is also not required for this purpose. BWRs may use the Standby Liquid Control (SLC) System to inject boron into the reactor coolant system, but SLC is not required to be OPERABLE in the Applicability of these LCOs.

The RHR SDC System is still required to be OPERABLE with this change. The system pumps can be started and stopped as dictated by plant conditions. Reactor coolant temperature can be controlled as plant conditions dictate, including maintaining adequate control to avoid inadvertently changing MODE.

Continuous operation of a SDC subsystem is not required to adequately perform the decay heat removal function. Establishing coolant circulation during shutdown conditions for the purpose of temperature indication of the reactor coolant is related to plant specific procedures for measuring reactor coolant system temperature.

Allowing the stopping (and subsequent re-starting) of RHR pumps is allowed by the current RHR SDC Specifications to change operating loops or by the Notes to the various RHR-SDC LCOs. Furthermore, the actual cooling function provided by the RHR service water system (providing cooling water to the RHR heat exchanger) is not required to be continuously operating. Operability of the RHR-SDC system, which includes the required pumps, presumes the ability to start (and re-start) any required pump. As such, these changes do not introduce any new or different failure modes nor any increased risk of loss of decay heat removal capability.

The revised Specifications are similar to the Specifications governing other required modes of RHR operation. Specification 3.6.2.3, “RHR Suppression Pool Cooling,” requires two RHR subsystems to be OPERABLE, but does not require a system to be in operation. It is assumed that the pumps can and will be started as required for plant safety.

The RHR-SDC Surveillance Requirement is also revised to require periodic verification that the system is aligned, or can be aligned, for operation. This is consistent with the Surveillance for Specification 3.6.2.3. The Frequency of 31 days is justified because the valves are operated under procedural control, improper valve position would affect only a single subsystem, the probability of an event requiring initiation of the system is low, and the subsystem is a manually initiated system. This Frequency has been shown to be acceptable based on operating experience.

5.0 Regulatory Analysis

5.1 No Significant Hazards Consideration

The TSTF has evaluated whether or not a significant hazards consideration is involved with the proposed generic change by focusing on the three standards set forth in 10 CFR 50.92, “Issuance of amendment,” as discussed below:

1. Does the proposed change involve a significant increase in the probability or consequences of an accident previously evaluated?

Response: No.

The proposed change allows the Residual Heat Removal Shutdown Cooling (RHR SDC) System to not be in continuous operation. The RHR SDC System is not a precursor to any accident previously evaluated. The RHR SDC System is not required for mitigation of any accident previously evaluated. The proposed changes do not adversely affect accident the design assumptions, conditions, or configuration of the facility. The proposed changes do not alter or prevent the ability of structures, systems, and components (SSCs) from performing their intended function.

Therefore, it is concluded that this change does not significantly increase the probability or consequences of an accident previously evaluated.

2. Does the proposed change create the possibility of a new or different kind of accident from any accident previously evaluated?

Response: No.

The proposed change allows the Residual Heat Removal Shutdown Cooling (RHR SDC) System to not be in continuous operation. This revision will not impact the accident analysis. The changes will not alter the methods of operation of the RHR SDC System. No new or different accidents result. The changes do not involve a physical alteration of

the plant (i.e., no new or different type of equipment will be installed) or a change in the methods governing normal plant operation. The changes do not alter assumptions made in the safety analysis.

Therefore, the possibility of a new or different kind of accident from any accident previously evaluated is not created.

3. Does the proposed change involve a significant reduction in a margin of safety?

Response: No.

The proposed changes do not alter the manner in which safety limits, limiting safety system settings or limiting conditions for operation are determined. The safety analysis acceptance criteria are not affected by these changes. The proposed changes will not result in plant operation in a configuration outside the design basis. The level of redundancy required for the RHR SDC system is unaffected. The proposed changes do not adversely affect systems that respond to safely shutdown the plant and to maintain the plant in a safe shutdown condition.

Therefore, it is concluded that this change does not involve a significant reduction in the margin of safety.

Based on the above, the TSTF concludes that the proposed change presents no significant hazards considerations under the standards set forth in 10 CFR 50.92(c), and, accordingly, a finding of “no significant hazards consideration” is justified.

5.2 Applicable Regulatory Requirements/Criteria

The proposed change to the Improved Standard Technical Specifications do not change the design requirements for the RHR Shutdown Cooling System and the RHR shutdown Cooling System will continue to comply with applicable regulatory requirements and criteria. The system design will still be consistent with GDC 34, Residual heat removal. In conclusion, based on the considerations discussed above, (1) there is reasonable assurance that the health and safety of the public will not be endangered by operation in the proposed manner, (2) such activities will be conducted in compliance with the Commission’s regulations, and (3) the approval of the proposed change will not be inimical to the common defense and security or to the health and safety of the public.

6.0 Environmental Consideration

A review has determined that the proposed change would not change a requirement with respect to installation or use of a facility component located within the restricted area, as defined in 10 CFR 20, or would not change an inspection or surveillance requirement. The proposed change does not involve (i) a significant hazards consideration, (ii) a significant change in the types or

significant increase in the amounts of any effluent that may be released offsite, or (iii) a significant increase in individual or cumulative occupational radiation exposure. Accordingly, the proposed change meets the eligibility criterion for categorical exclusion set forth in 10 CFR 51.22(c)(9). Therefore, pursuant to 10 CFR 51.22(b), no environmental impact statement or environmental assessment need be prepared in connection with the proposed change.

7.0 References

None.

INSERT 1

manual, power operated, and automatic valve in the flow path that is not locked, sealed, or otherwise secured in position, is aligned or can be aligned to its correct position.

INSERT 2

Verifying the correct alignment for manual, power operated, and automatic valves in the RHR-shutdown cooling flow path provides assurance that the proper flow paths will exist for RHR operation. This SR does not apply to valves that are locked, sealed, or otherwise secured in position since these were verified to be in the correct position prior to locking, sealing, or securing. A valve that can be manually (locally or remotely) aligned is allowed to be in a non-RHR shutdown cooling position provided the valve can be repositioned. This SR does not require any testing or valve manipulation; rather, it involves verification that those valves capable of potentially being mispositioned are in the correct position. This SR does not apply to valves that cannot be inadvertently misaligned, such as check valves.

The Frequency of 31 days is justified because the valves are operated under procedural control, improper valve position would affect only a single subsystem, the probability of an event requiring initiation of the system is low, and the subsystem is a manually initiated system. This Frequency has been shown to be acceptable based on operating experience.

3.4 REACTOR COOLANT SYSTEM (RCS)

3.4.8 Residual Heat Removal (RHR) Shutdown Cooling System - Hot Shutdown

LCO 3.4.8

Two RHR shutdown cooling subsystems shall be OPERABLE, and, with no recirculation pump in operation, at least one RHR shutdown cooling subsystem shall be in operation.

- NOTES -

1. Both RHR shutdown cooling subsystems and recirculation pumps may be not in operation for up to 2 hours per 8 hours period.
2. One RHR shutdown cooling subsystem may be inoperable for up to 2 hours for the performance of Surveillances.

APPLICABILITY: MODE 3, with reactor steam dome pressure < [the RHR cut in permissive pressure].

ACTIONS

- NOTES -

1. LCO 3.0.4 is not applicable.
2. Separate Condition entry is allowed for each RHR shutdown cooling subsystem.

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or two RHR shutdown cooling subsystems inoperable.	A.1 Initiate action to restore RHR shutdown cooling subsystem(s) to OPERABLE status.	Immediately
	<u>AND</u>	
	A.2 Verify an alternate method of decay heat removal is available for each inoperable RHR shutdown cooling subsystem.	1 hour
	<u>AND</u>	

ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
	A.3 Be in MODE 4.	24 hours
B. No RHR shutdown cooling subsystem in operation. <u>AND</u> No recirculation pump in operation.	B.1 Initiate action to restore one RHR shutdown cooling subsystem or one recirculation pump to operation.	Immediately
	<u>AND</u> B.2 Verify reactor coolant circulation by an alternate method.	1 hour from discovery of no reactor coolant circulation
	<u>AND</u> B.3 Monitor reactor coolant temperature and pressure.	<u>AND</u> Once per 12 hours thereafter Once per hour

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.4.8.1 ----- <p style="text-align: center;">- NOTE -</p> Not required to be met until 2 hours after reactor steam dome pressure is < [the RHR cut in permissive pressure]. ----- Verify <u>one</u> RHR shutdown cooling subsystem or <u>recirculation pump is operating</u> .	 <div style="text-align: center;"> 31 days 12 hours </div>

each required

Insert 1

3.4 REACTOR COOLANT SYSTEM (RCS)

3.4.9 Residual Heat Removal (RHR) Shutdown Cooling System - Cold Shutdown

LCO 3.4.9

Two RHR shutdown cooling subsystems shall be OPERABLE, and, with no recirculation pump in operation, at least one RHR shutdown cooling subsystem shall be in operation.

- NOTES -

1. Both RHR shutdown cooling subsystems and recirculation pumps may be not in operation for up to 2 hours per 8 hours period.

2. One RHR shutdown cooling subsystem may be inoperable for up to 2 hours for the performance of Surveillances.

APPLICABILITY: MODE 4.

ACTIONS


- NOTE -

Separate Condition entry is allowed for each shutdown cooling subsystem.

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or two RHR shutdown cooling subsystems inoperable.	A.1 Verify an alternate method of decay heat removal is available for each inoperable RHR shutdown cooling subsystem.	1 hour <u>AND</u> Once per 24 hours thereafter
B. No RHR shutdown cooling subsystem in operation. <u>AND</u> No recirculation pump in operation.	B.1 Verify reactor coolant circulating by an alternate method. <u>AND</u>	1 hour from discovery of no reactor coolant circulation <u>AND</u> Once per 12 hours thereafter

RHR Shutdown Cooling System - Cold Shutdown
3.4.9

ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
	B.2 Monitor reactor coolant temperature.	Once per hour

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
SR 3.4.9.1 Verify one RHR shutdown cooling subsystem of recirculation pump is operating.	12 hours 31 days

each required

Insert 1

3.9 REFUELING OPERATIONS

3.9.8 Residual Heat Removal (RHR) - High Water Level

LCO 3.9.8

One RHR shutdown cooling subsystem shall be OPERABLE ~~and in~~
~~operation~~

- NOTE -
The required RHR shutdown cooling subsystem may be not in operation
for up to 2 hours per 8 hour period.

APPLICABILITY: MODE 5 with irradiated fuel in the reactor pressure vessel (RPV) and the
water level \geq [23] ft above the top of the [RPV flange].

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. Required RHR shutdown cooling subsystem inoperable.	A.1 Verify an alternate method of decay heat removal is available.	1 hour <u>AND</u> Once per 24 hours thereafter
B. Required Action and associated Completion Time of Condition A not met.	B.1 Suspend loading irradiated fuel assemblies into the RPV. <u>AND</u> B.2 Initiate action to restore [secondary] containment to OPERABLE status. <u>AND</u>	Immediately Immediately

ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
	B.3 Initiate action to restore one standby gas treatment subsystem to OPERABLE status.	Immediately
	<u>AND</u>	
	B.4 Initiate action to restore isolation capability in each required [secondary] containment penetration flow path not isolated.	Immediately
C. No RHR shutdown cooling subsystem in operation.	C.1 Verify reactor coolant circulation by an alternate method.	1 hour from discovery of no reactor coolant circulation
	<u>AND</u>	
	C.2 Monitor reactor coolant temperature.	Once per 12 hours thereafter
		Once per hour

SURVEILLANCE REQUIREMENTS

	SURVEILLANCE	FREQUENCY
SR 3.9.8.1	Verify <u>one</u> RHR shutdown cooling subsystem <u>is operating</u>	<u>12 hours</u> <u>31 days</u>

Insert 1

3.9 REFUELING OPERATIONS

3.9.9 Residual Heat Removal (RHR) - Low Water Level

LCO 3.9.9

Two RHR shutdown cooling subsystems shall be OPERABLE, and one RHR shutdown cooling subsystem shall be in operation.

- NOTE -

The required operating shutdown cooling subsystem may be not in operation for up to 2 hours per 8 hour period.

APPLICABILITY: MODE 5 with irradiated fuel in the reactor pressure vessel (RPV) and the water level < [23] ft above the top of the [RPV flange].

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or two required RHR shutdown cooling subsystem inoperable.	A.1 Verify an alternate method of decay heat removal is available for each inoperable required RHR shutdown cooling subsystem.	1 hour <u>AND</u> Once per 24 hours thereafter
B. Required Action and associated Completion Time of Condition A not met.	B.1 Initiate action to restore [secondary] containment to OPERABLE status. <u>AND</u> B.2 Initiate action to restore one standby gas treatment subsystem to OPERABLE status. <u>AND</u>	Immediately Immediately

ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
	B.3 Initiate action to restore isolation capability in each required [secondary] containment penetration flow path not isolated.	Immediately
C. No RHR shutdown cooling subsystem in operation.	C.1 Verify reactor coolant circulation by an alternate method. <u>AND</u> C.2 Monitor reactor coolant temperature.	1 hour from discovery of no reactor coolant circulation <u>AND</u> Once per 12 hours thereafter Once per hour

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.9.9.1	Verify <u>one</u> RHR shutdown cooling subsystem <u>is operating</u>	<u>12 hours</u> <u>31 days</u>

Insert 1

B 3.4 REACTOR COOLANT SYSTEM (RCS)

B 3.4.8 Residual Heat Removal (RHR) Shutdown Cooling System - Hot Shutdown

BASES

BACKGROUND	<p>Irradiated fuel in the shutdown reactor core generates heat during the decay of fission products and increases the temperature of the reactor coolant. This decay heat must be removed to reduce the temperature of the reactor coolant to $\leq 200^{\circ}\text{F}$. This decay heat removal is in preparation for performing refueling or maintenance operations, or for keeping the reactor in the Hot Shutdown condition.</p> <p>The two redundant, manually controlled shutdown cooling subsystems of the RHR System provide decay heat removal. Each loop consists of two motor driven pumps, a heat exchanger, and associated piping and valves. Both loops have a common suction from the same recirculation loop. Each pump discharges the reactor coolant, after circulation through the respective heat exchanger, to the reactor via the associated recirculation loop. The RHR heat exchangers transfer heat to the RHR Service Water System (LCO 3.7.1, "Residual Heat Removal Service Water (RHRSW) System").</p>
APPLICABLE SAFETY ANALYSES	<p>Decay heat removal by operation of the RHR System in the shutdown cooling mode is not required for mitigation of any event or accident evaluated in the safety analyses. Decay heat removal is, however, an important safety function that must be accomplished or core damage could result. The RHR shutdown cooling subsystem satisfies Criterion 4 of 10 CFR 50.36(c)(2)(ii).</p>
LCO	<p>Two RHR shutdown cooling subsystems are required to be OPERABLE, and when no recirculation pump is in operation, one shutdown cooling subsystem must be in operation. An OPERABLE RHR shutdown cooling subsystem consists of one OPERABLE RHR pump, one heat exchanger, and the associated piping and valves. The two subsystems have a common suction source and are allowed to have a common heat exchanger and common discharge piping. Thus, to meet the LCO, both pumps in one loop or one pump in each of the two loops must be OPERABLE. Since the piping and heat exchangers are passive components that are assumed not to fail, they are allowed to be common to both subsystems. Each shutdown cooling subsystem is considered OPERABLE if it can be manually aligned (remote or local) in the shutdown cooling mode for removal of decay heat. In MODE 3, one RHR shutdown cooling subsystem can provide the required cooling, but two subsystems are required to be OPERABLE to provide redundancy.</p>

BASES

LCO (continued)

Operation of one subsystem can maintain or reduce the reactor coolant temperature as required. However, to ensure adequate core flow to allow for accurate average reactor coolant temperature monitoring, nearly continuous operation is required.

Note 1 permits both RHR shutdown cooling subsystems to not be in operation for a period of 2 hours in an 8 hour period. Note 2 allows one RHR shutdown cooling subsystem to be inoperable for up to 2 hours for the performance of Surveillance tests. These tests may be on the affected RHR System or on some other plant system or component that necessitates placing the RHR System in an inoperable status during the performance. This is permitted because the core heat generation can be low enough and the heatup rate slow enough to allow some changes to the RHR subsystems or other operations requiring RHR flow interruption and loss of redundancy. (A)

APPLICABILITY

In MODE 3 with reactor steam dome pressure below [the RHR cut in permissive pressure] (i.e., the actual pressure at which the interlock resets) the RHR System may be operated in the shutdown cooling mode to remove decay heat to reduce or maintain coolant temperature. Otherwise, a recirculation pump is required to be in operation. as desired

is required to be OPERABLE so that it

In MODES 1 and 2, and in MODE 3 with reactor steam dome pressure greater than or equal to [the RHR cut in permissive pressure], this LCO is not applicable. Operation of the RHR System in the shutdown cooling mode is not allowed above this pressure because the RCS pressure may exceed the design pressure of the shutdown cooling piping. Decay heat removal at reactor pressures greater than or equal to the RHR cut in permissive pressure is typically accomplished by condensing the steam in the main condenser. Additionally, in MODE 2 below this pressure, the OPERABILITY requirements for the Emergency Core Cooling Systems (ECCS) (LCO 3.5.1, "ECCS - Operating") do not allow placing the RHR shutdown cooling subsystem into operation.

The requirements for decay heat removal in MODES 4 and 5 are discussed in LCO 3.4.9, "Residual Heat Removal (RHR) Shutdown Cooling System - Cold Shutdown," LCO 3.9.8, "Residual Heat Removal (RHR) - High Water Level," and LCO 3.9.9, "Residual Heat Removal (RHR) - Low Water Level."

BASES

ACTIONS

A Note to the ACTIONS excludes the MODE change restriction of LCO 3.0.4. This exception allows entry into the applicable MODE(S) while relying on the ACTIONS even though the ACTIONS may eventually require plant shutdown. This exception is acceptable due to the redundancy of the OPERABLE subsystems, the low pressure at which the plant is operating, the low probability of an event occurring during operation in this condition, and the availability of alternate methods of decay heat removal capability.

A second Note has been provided to modify the ACTIONS related to RHR shutdown cooling subsystems. Section 1.3, Completion Times, specifies once a Condition has been entered, subsequent divisions, subsystems, components or variables expressed in the Condition, discovered to be inoperable or not within limits, will not result in separate entry into the Condition. Section 1.3 also specifies Required Actions of the Condition continue to apply for each additional failure, with Completion Times based on initial entry into the Condition. However, the Required Actions for inoperable shutdown cooling subsystems provide appropriate compensatory measures for separate inoperable shutdown cooling subsystems. As such, a Note has been provided that allows separate Condition entry for each inoperable RHR shutdown cooling subsystem.

A.1, A.2, and A.3

With one required RHR shutdown cooling subsystem inoperable for decay heat removal, except as permitted by LCO Note 2, the inoperable subsystem must be restored to OPERABLE status without delay. In this condition, the remaining OPERABLE subsystem can provide ^{the} necessary decay heat removal. The overall reliability is reduced, however, because a single failure in the OPERABLE subsystem could result in reduced RHR shutdown cooling capability. Therefore, an alternate method of decay heat removal must be provided. ^{any}

With both RHR shutdown cooling subsystems inoperable, an alternate method of decay heat removal must be provided in addition to that provided for the initial RHR shutdown cooling subsystem inoperability. This re-establishes backup decay heat removal capabilities, similar to the requirements of the LCO. The 1 hour Completion Time is based on the decay heat removal function and the probability of a loss of the available decay heat removal capabilities.

The required cooling capacity of the alternate method should be ensured by verifying (by calculation or demonstration) its capability to maintain or reduce temperature. Decay heat removal by ambient losses can be

BASES

ACTIONS (continued)

considered as, or contributing to, the alternate method capability. Alternate methods that can be used include (but are not limited to) the Spent Fuel Pool Cooling System and the Reactor Water Cleanup System.

However, due to the potentially reduced reliability of the alternate methods of decay heat removal, it is also required to reduce the reactor coolant temperature to the point where MODE 4 is entered.

B.1, B.2, and B.3

With no RHR shutdown cooling subsystem and no recirculation pump in operation, except as permitted by LCO Note 1, reactor coolant circulation by the RHR shutdown cooling subsystem or recirculation pump must be restored without delay.

Until RHR or recirculation pump operation is re-established, an alternate method of reactor coolant circulation must be placed into service. This will provide the necessary circulation for monitoring coolant temperature. The 1 hour Completion Time is based on the coolant circulation function and is modified such that the 1 hour is applicable separately for each occurrence involving a loss of coolant circulation. Furthermore, verification of the functioning of the alternate method must be reconfirmed every 12 hours thereafter. This will provide assurance of continued temperature monitoring capability.

During the period when the reactor coolant is being circulated by an alternate method (other than by the required RHR shutdown cooling subsystem or recirculation pump), the reactor coolant temperature and pressure must be periodically monitored to ensure proper function of the alternate method. The once per hour Completion Time is deemed appropriate.

SURVEILLANCE REQUIREMENTS

SR 3.4.8.1

Insert 2 →

This Surveillance verifies that one RHR shutdown cooling subsystem or recirculation pump is in operation and circulating reactor coolant. The required flow rate is determined by the flow rate necessary to provide sufficient decay heat removal capability. The Frequency of 12 hours is sufficient in view of other visual and audible indications available to the operator for monitoring the RHR subsystem in the control room.

BASES

SURVEILLANCE REQUIREMENTS (continued)

OPERABILITY

ability to
align and
operate shutdown
cooling is

This Surveillance is modified by a Note allowing sufficient time to align the RHR System for shutdown cooling operation after clearing the pressure interlock that isolates the system, or for placing a recirculation pump in operation. The Note takes exception to the requirements of the Surveillance being met (i.e., forced coolant circulation is not required for this initial 2 hour period), which also allows entry into the Applicability of this Specification in accordance with SR 3.0.4 since the Surveillance will not be "not met" at the time of entry into the Applicability.

REFERENCES

None.

B 3.4 REACTOR COOLANT SYSTEM (RCS)

B 3.4.9 Residual Heat Removal (RHR) Shutdown Cooling System - Cold Shutdown

BASES

BACKGROUND Irradiated fuel in the shutdown reactor core generates heat during the decay of fission products and increases the temperature of the reactor coolant. This decay heat must be removed to maintain the temperature of the reactor coolant $\leq 200^{\circ}\text{F}$. This decay heat removal is in preparation for performing refueling or maintenance operations, or for keeping the reactor in the Cold Shutdown condition.

The two redundant, manually controlled shutdown cooling subsystems of the RHR System provide decay heat removal. Each loop consists of two motor driven pumps, a heat exchanger, and associated piping and valves. Both loops have a common suction from the same recirculation loop. Each pump discharges the reactor coolant, after circulation through the respective heat exchanger, to the reactor via the associated recirculation loop. The RHR heat exchangers transfer heat to the RHR Service Water System.

APPLICABLE SAFETY ANALYSES Decay heat removal by operation of the RHR System in the shutdown cooling mode is not required for mitigation of any event or accident evaluated in the safety analyses. Decay heat removal is, however, an important safety function that must be accomplished or core damage could result. The RHR Shutdown Cooling System satisfies Criterion 4 of 10 CFR 50.36(c)(2)(ii).

LCO Two RHR shutdown cooling subsystems are required to be OPERABLE, and when no recirculation pump is in operation, one RHR shutdown cooling subsystem must be in operation. An OPERABLE RHR shutdown cooling subsystem consists of one OPERABLE RHR pump, one heat exchanger, and the associated piping and valves. The two subsystems have a common suction source and are allowed to have a common heat exchanger and common discharge piping. Thus, to meet the LCO, both pumps in one loop or one pump in each of the two loops must be OPERABLE. Since the piping and heat exchangers are passive components that are assumed not to fail, they are allowed to be common to both subsystems. In MODE 4, the RHR cross tie valve (2E11-F010) may be opened to allow pumps in one loop to discharge through the opposite recirculation loop to make a complete subsystem. Additionally, each shutdown cooling subsystem is considered OPERABLE if it can be manually aligned (remote or local) in the shutdown cooling mode for removal of decay heat. In MODE 4, one RHR shutdown cooling

BASES

LCO (continued)

subsystem can provide the required cooling, but two subsystems are required to be OPERABLE to provide redundancy. Operation of one subsystem can maintain or reduce the reactor coolant temperature as required. (However, to ensure adequate core flow to allow for accurate average reactor coolant temperature monitoring, nearly continuous operation is required.)

Note 1 permits both RHR shutdown cooling subsystems to not be in operation for a period of 2 hours in an 8 hour period. Note 2 allows one RHR shutdown cooling subsystem to be inoperable for up to 2 hours for the performance of Surveillance tests. These tests may be on the affected RHR System or on some other plant system or component that necessitates placing the RHR System in an inoperable status during the performance. This is permitted because the core heat generation can be low enough and the heatup rate slow enough to allow some changes to the RHR subsystems or other operations requiring RHR flow interruption and loss of redundancy. (A)

APPLICABILITY

is required to be
OPERABLE so that
it

In MODE 4, the RHR Shutdown Cooling System may be operated in the shutdown cooling mode to remove decay heat to maintain coolant temperature below 200°F. (Otherwise, a recirculation pump is required to be in operation.)

In MODES 1 and 2, and in MODE 3 with reactor steam dome pressure greater than or equal to the RHR cut in permissive pressure, this LCO is not applicable. Operation of the RHR System in the shutdown cooling mode is not allowed above this pressure because the RCS pressure may exceed the design pressure of the shutdown cooling piping. Decay heat removal at reactor pressures greater than or equal to the RHR cut in permissive pressure is typically accomplished by condensing the steam in the main condenser. Additionally, in MODE 2 below this pressure, the OPERABILITY requirements for the Emergency Core Cooling Systems (ECCS) (LCO 3.5.1, "ECCS - Operating") do not allow placing the RHR shutdown cooling subsystem into operation.

The requirements for decay heat removal in MODE 3 below the cut in permissive pressure and in MODE 5 are discussed in LCO 3.4.8, "Residual Heat Removal (RHR) Shutdown Cooling System - Hot Shutdown," LCO 3.9.8, "Residual Heat Removal (RHR) - High Water Level," and LCO 3.9.9, "Residual Heat Removal (RHR) - Low Water Level."

BASES

ACTIONS

A Note has been provided to modify the ACTIONS related to RHR shutdown cooling subsystems. Section 1.3, Completion Times, specifies once a Condition has been entered, subsequent divisions, subsystems, components or variables expressed in the Condition, discovered to be inoperable or not within limits, will not result in separate entry into the Condition. Section 1.3 also specifies Required Actions of the Condition continue to apply for each additional failure, with Completion Times based on initial entry into the Condition. However, the Required Actions for inoperable shutdown cooling subsystems provide appropriate compensatory measures for separate inoperable shutdown cooling subsystems. As such, a Note has been provided that allows separate Condition entry for each inoperable RHR shutdown cooling subsystem.

A.1

With one of the two required RHR shutdown cooling subsystems inoperable, except as permitted by LCO Note 2, the remaining subsystem is capable of providing the required decay heat removal. However, the overall reliability is reduced. Therefore, an alternate method of decay heat removal must be provided. With both RHR shutdown cooling subsystems inoperable, an alternate method of decay heat removal must be provided in addition to that provided for the initial RHR shutdown cooling subsystem inoperability. This re-establishes backup decay heat removal capabilities, similar to the requirements of the LCO. The 1 hour Completion Time is based on the decay heat removal function and the probability of a loss of the available decay heat removal capabilities. Furthermore, verification of the functional availability of these alternate method(s) must be reconfirmed every 24 hours thereafter. This will provide assurance of continued heat removal capability.

The required cooling capacity of the alternate method should be ensured by verifying (by calculation or demonstration) its capability to maintain or reduce temperature. Decay heat removal by ambient losses can be considered as, or contributing to, the alternate method capability. Alternate methods that can be used include (but are not limited to) the Spent Fuel Pool Cooling System and the Reactor Water Cleanup System.

B.1 and B.2

With no RHR shutdown cooling subsystem and no recirculation pump in operation, except as permitted by LCO Note 1, and until RHR or recirculation pump operation is re-established, an alternate method of reactor coolant circulation must be placed into service. This will provide the necessary circulation for monitoring coolant temperature. The 1 hour

BASES

ACTIONS (continued)

Completion Time is based on the coolant circulation function and is modified such that the 1 hour is applicable separately for each occurrence involving a loss of coolant circulation. Furthermore, verification of the functioning of the alternate method must be reconfirmed every 12 hours thereafter. This will provide assurance of continued temperature monitoring capability.

During the period when the reactor coolant is being circulated by an alternate method (other than by the required RHR Shutdown Cooling System or recirculation pump), the reactor coolant temperature and pressure must be periodically monitored to ensure proper function of the alternate method. The once per hour Completion Time is deemed appropriate.

SURVEILLANCE
REQUIREMENTS

SR 3.4.9.1

Insert 2

This Surveillance verifies that one RHR shutdown cooling subsystem or recirculation pump is in operation and circulating reactor coolant. The required flow rate is determined by the flow rate necessary to provide sufficient decay heat removal capability. The Frequency of 12 hours is sufficient in view of other visual and audible indications available to the operator for monitoring the RHR subsystem in the control room.

REFERENCES

None.

B 3.9 REFUELING OPERATIONS

B 3.9.8 Residual Heat Removal (RHR) - High Water Level

BASES

BACKGROUND The purpose of the RHR System in MODE 5 is to remove decay heat and sensible heat from the reactor coolant, as required by GDC 34. Each of the two shutdown cooling loops of the RHR System can provide the required decay heat removal. Each loop consists of two motor driven pumps, a heat exchanger, and associated piping and valves. Both loops have a common suction from the same recirculation loop. Each pump discharges the reactor coolant, after it has been cooled by circulation through the respective heat exchangers, to the reactor via the associated recirculation loop or to the reactor via the low pressure coolant injection path. The RHR heat exchangers transfer heat to the RHR Service Water System. The RHR shutdown cooling mode is manually controlled.

In addition to the RHR subsystems, the volume of water above the reactor pressure vessel (RPV) flange provides a heat sink for decay heat removal.

APPLICABLE SAFETY ANALYSES With the unit in MODE 5, the RHR System is not required to mitigate any events or accidents evaluated in the safety analyses. The RHR System is required for removing decay heat to maintain the temperature of the reactor coolant.

The RHR System satisfies Criterion 4 of 10 CFR 50.36(c)(2)(ii).

LCO Only one RHR shutdown cooling subsystem is required to be OPERABLE ~~and in operation~~ in MODE 5 with irradiated fuel in the RPV and the water level \geq [23] ft above the RPV flange. Only one subsystem is required because the volume of water above the RPV flange provides backup decay heat removal capability.

An OPERABLE RHR shutdown cooling subsystem consists of an RHR pump, a heat exchanger, valves, piping, instruments, and controls to ensure an OPERABLE flow path. In MODE 5, the RHR cross tie valve is not required to be closed; thus, the valve may be opened to allow pumps in one loop to discharge through the opposite loop's heat exchanger to make a complete subsystem.

Additionally, each RHR shutdown cooling subsystem is considered OPERABLE if it can be manually aligned (remote or local) in the shutdown cooling mode for removal of decay heat. Operation (either

BASES

LCO (continued)

continuous or intermittent) of one subsystem can maintain and reduce the reactor coolant temperature as required. However, to ensure adequate core flow to allow for accurate average reactor coolant temperature monitoring, nearly continuous operation is required. A Note is provided to allow a 2 hour exception for the operating subsystem to not be in operation every 8 hours.

APPLICABILITY

One RHR shutdown cooling subsystem must be OPERABLE ~~and in operation~~ in MODE 5, with irradiated fuel in the reactor pressure vessel and with the water level \geq [23] feet above the top of the RPV flange, to provide decay heat removal. RHR System requirements in other MODES are covered by LCOs in Section 3.4, Reactor Coolant System (RCS); Section 3.5, Emergency Core Cooling Systems (ECCS) and Reactor Core Isolation Cooling (RCIC) System; and Section 3.6, Containment Systems. RHR Shutdown Cooling System requirements in MODE 5 with irradiated fuel in the reactor pressure vessel and with the water level $<$ [23] ft above the RPV flange are given in LCO 3.9.9.

ACTIONS

A.1

With no RHR shutdown cooling subsystem OPERABLE, an alternate method of decay heat removal must be established within 1 hour. In this condition, the volume of water above the RPV flange provides adequate capability to remove decay heat from the reactor core. However, the overall reliability is reduced because loss of water level could result in reduced decay heat removal capability. The 1 hour Completion Time is based on decay heat removal function and the probability of a loss of the available decay heat removal capabilities. Furthermore, verification of the functional availability of these alternate method(s) must be reconfirmed every 24 hours thereafter. This will ensure continued heat removal capability.

Alternate decay heat removal methods are available to the operators for review and preplanning in the unit's Operating Procedures. For example, this may include the use of the Reactor Water Cleanup System, operating with the regenerative heat exchanger bypassed. The method used to remove the decay heat should be the most prudent choice based on unit conditions.

BASES

ACTIONS (continued)

B.1, B.2, B.3, and B.4

If no RHR shutdown cooling subsystem is OPERABLE and an alternate method of decay heat removal is not available in accordance with Required Action A.1, actions shall be taken immediately to suspend operations involving an increase in reactor decay heat load by suspending loading of irradiated fuel assemblies into the RPV.

Additional actions are required to minimize any potential fission product release to the environment. This includes ensuring secondary containment is OPERABLE; one standby gas treatment subsystem is OPERABLE; and secondary containment isolation capability (i.e., one secondary containment isolation valve and associated instrumentation are OPERABLE or other acceptable administrative controls to assure isolation capability) in each associated penetration not isolated that is assumed to be isolated to mitigate radioactive releases. This may be performed as an administrative check, by examining logs or other information to determine whether the components are out of service for maintenance or other reasons. It is not necessary to perform the Surveillances needed to demonstrate the OPERABILITY of the components. If, however, any required component is inoperable, then it must be restored to OPERABLE status. In this case, a surveillance may need to be performed to restore the component to OPERABLE status. Actions must continue until all required components are OPERABLE.

C.1 and C.2

If no RHR Shutdown Cooling System is in operation, an alternate method of coolant circulation is required to be established within 1 hour. The Completion Time is modified such that the 1 hour is applicable separately for each occurrence involving a loss of coolant circulation.

During the period when the reactor coolant is being circulated by an alternate method (other than by the required RHR Shutdown Cooling System), the reactor coolant temperature must be periodically monitored to ensure proper functioning of the alternate method. The once per hour Completion Time is deemed appropriate.

BASES

SURVEILLANCE
REQUIREMENTS

SR 3.9.8.1

Insert 2

This Surveillance demonstrates that the RHR subsystem is in operation and circulating reactor coolant.

The required flow rate is determined by the flow rate necessary to provide sufficient decay heat removal capability. The Frequency of 12 hours is sufficient in view of other visual and audible indications available to the operator for monitoring the RHR subsystem in the control room.

REFERENCES

None.

B 3.9 REFUELING OPERATIONS

B 3.9.9 Residual Heat Removal (RHR) - Low Water Level

BASES

BACKGROUND	The purpose of the RHR System in MODE 5 is to remove decay heat and sensible heat from the reactor coolant, as required by GDC 34. Each of the two shutdown cooling loops of the RHR System can provide the required decay heat removal. Each loop consists of two motor driven pumps, a heat exchanger, and associated piping and valves. Both loops have a common suction from the same recirculation loop. Each pump discharges the reactor coolant, after it has been cooled by circulation through the respective heat exchangers, to the reactor via the associated recirculation loop or to the reactor via the low pressure coolant injection path. The RHR heat exchangers transfer heat to the RHR Service Water System. The RHR shutdown cooling mode is manually controlled.
-------------------	--

APPLICABLE SAFETY ANALYSES	With the unit in MODE 5, the RHR System is not required to mitigate any events or accidents evaluated in the safety analyses. The RHR System is required for removing decay heat to maintain the temperature of the reactor coolant.
---	--

The RHR System satisfies Criterion 4 of 10 CFR 50.36(c)(2)(ii).

LCO	In MODE 5 with irradiated fuel in the reactor pressure vessel (RPV) and the water level < 23 ft above the reactor pressure vessel (RPV) flange both RHR shutdown cooling subsystems must be OPERABLE.
------------	---

An OPERABLE RHR shutdown cooling subsystem consists of an RHR pump, a heat exchanger, valves, piping, instruments, and controls to ensure an OPERABLE flow path. To meet the LCO, both pumps in one loop or one pump in each of the two loops must be OPERABLE. In MODE 5, the RHR cross tie valve is not required to be closed; thus, the valve may be opened to allow pumps in one loop to discharge through the opposite loop's heat exchanger to make a complete subsystem.

Additionally, each RHR shutdown cooling subsystem is considered OPERABLE if it can be manually aligned (remote or local) in the shutdown cooling mode for removal of decay heat. Operation (either continuous or intermittent) of one subsystem can maintain and reduce the reactor coolant temperature as required. However, to ensure adequate core flow to allow for accurate average reactor coolant temperature monitoring, nearly continuous operation is required. A Note is provided to

BASES

LCO (continued)

allow a 2 hour exception for the operating subsystem ~~to not be in operation every 8 hours.~~

APPLICABILITY

Two RHR shutdown cooling subsystems are required to be OPERABLE ☒ and ~~one must be in operation~~ in MODE 5, with irradiated fuel in the RPV and with the water level < [23] ft above the top of the RPV flange, to provide decay heat removal. RHR System requirements in other MODES are covered by LCOs in Section 3.4, Reactor Coolant System (RCS); Section 3.5, Emergency Core Cooling Systems (ECCS) and Reactor Core Isolation Cooling (RCIC) System; and Section 3.6, Containment Systems. RHR Shutdown Cooling System requirements in MODE 5 with irradiated fuel in the RPV and with the water level \geq [23] ft above the RPV flange are given in LCO 3.9.8, "Residual Heat Removal (RHR) - High Water Level."

ACTIONS

A.1

With one of the two required RHR shutdown cooling subsystems inoperable, the remaining subsystem is capable of providing the required decay heat removal. However, the overall reliability is reduced. Therefore an alternate method of decay heat removal must be provided. With both required RHR shutdown cooling subsystems inoperable, an alternate method of decay heat removal must be provided in addition to that provided for the initial RHR shutdown cooling subsystem inoperability. This re-establishes backup decay heat removal capabilities, similar to the requirements of the LCO. The 1 hour Completion Time is based on the decay heat removal function and the probability of a loss of the available decay heat removal capabilities. Furthermore, verification of the functional availability of this alternate method(s) must be reconfirmed every 24 hours thereafter. This will ensure continued heat removal capability.

Alternate decay heat removal methods are available to the operators for review and preplanning in the unit's Operating Procedures. For example, this may include the use of the Reactor Water Cleanup System, operating with the regenerative heat exchanger bypassed. The method used to remove decay heat should be the most prudent choice based on unit conditions.

BASES

ACTIONS (continued)

B.1, B.2, and B.3

With the required decay heat removal subsystem(s) inoperable and the required alternate method(s) of decay heat removal not available in accordance with Required Action A.1, additional actions are required to minimize any potential fission product release to the environment. This includes ensuring secondary containment is OPERABLE; one standby gas treatment subsystem is OPERABLE; and secondary containment isolation capability (i.e., one secondary containment isolation valve and associated instrumentation are OPERABLE or other acceptable administrative controls to assure isolation capability) in each associated penetration not isolated that is assumed to be isolated to mitigate radioactive releases. This may be performed as an administrative check, by examining logs or other information to determine whether the components are out of service for maintenance or other reasons. It is not necessary to perform the Surveillances needed to demonstrate the OPERABILITY of the components. If, however, any required component is inoperable, then it must be restored to OPERABLE status. In this case, the surveillance may need to be performed to restore the component to OPERABLE status. Actions must continue until all required components are OPERABLE.

C.1 and C.2

If no RHR subsystem is in operation, an alternate method of coolant circulation is required to be established within 1 hour. The Completion Time is modified such that the 1 hour is applicable separately for each occurrence involving a loss of coolant circulation.

During the period when the reactor coolant is being circulated by an alternate method (other than by the required RHR Shutdown Cooling System), the reactor coolant temperature must be periodically monitored to ensure proper functioning of the alternate method. The once per hour Completion Time is deemed appropriate.

SURVEILLANCE
REQUIREMENTS

SR 3.9.9.1

Insert 2

This Surveillance demonstrates that one RHR shutdown cooling subsystem is in operation and circulating reactor coolant. The required flow rate is determined by the flow rate necessary to provide sufficient decay heat removal capability.

BASES

SURVEILLANCE REQUIREMENTS (continued)

The Frequency of 12 hours is sufficient in view of other visual and audible indications available to the operator for monitoring the RHR subsystems in the control room.

REFERENCES None.

3.4 REACTOR COOLANT SYSTEM (RCS)

3.4.9 Residual Heat Removal (RHR) Shutdown Cooling System - Hot Shutdown

LCO 3.4.9

Two RHR shutdown cooling subsystems shall be OPERABLE, and, with no recirculation pump in operation, at least one RHR shutdown cooling subsystem shall be in operation.

- NOTES -

1. Both RHR shutdown cooling subsystems and recirculation pumps may be not in operation for up to 2 hours per 8 hours period.
2. One RHR shutdown cooling subsystem may be inoperable for up to 2 hours for performance of Surveillances.

APPLICABILITY: MODE 3 with reactor steam dome pressure < [the RHR cut in permissive pressure].

ACTIONS

- NOTES -

1. LCO 3.0.4 is not applicable.
2. Separate Condition entry is allowed for each RHR shutdown cooling subsystem.

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or two RHR shutdown cooling subsystems inoperable.	A.1 Initiate action to restore RHR shutdown cooling subsystem to OPERABLE status. <u>AND</u>	Immediately

RHR Shutdown Cooling System - Hot Shutdown
3.4.9

ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
	A.2 Verify an alternate method of decay heat removal is available for each inoperable RHR shutdown cooling subsystem.	1 hour
	<u>AND</u>	
	A.3 Be in MODE 4.	24 hours
B. No RHR shutdown cooling subsystem in operation.	B.1 Initiate action to restore one RHR shutdown cooling subsystem or one recirculation pump to operation.	Immediately
<u>AND</u>	<u>AND</u>	
No recirculation pump in operation.	B.2 Verify reactor coolant circulation by an alternate method.	1 hour from discovery of no reactor coolant circulation
	<u>AND</u>	<u>AND</u>
	B.3 Monitor reactor coolant temperature and pressure.	Once per 12 hours thereafter
		Once per hour

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
<p>SR 3.4.9.1</p> <p style="text-align: center;">- NOTE -</p> <p>Not required to be met until 2 hours after reactor steam dome pressure is < [the RHR cut in permissive pressure].</p> <p><i>each required</i> → Verify one RHR shutdown cooling subsystem of recirculation pump is operating.</p>	<p><i>31 days</i></p> <p><i>12 hours</i></p>

Insert 1

3.4 REACTOR COOLANT SYSTEM (RCS)

3.4.10 Residual Heat Removal (RHR) Shutdown Cooling System - Cold Shutdown

LCO 3.4.10

Two RHR shutdown cooling subsystems shall be OPERABLE, and, with no recirculation pump in operation, at least one RHR shutdown cooling subsystem shall be in operation.

- NOTE -

1. Both RHR shutdown cooling subsystems and recirculation pumps may be not in operation for up to 2 hours per 8 hours period.
2. One RHR shutdown cooling subsystem may be inoperable for up to 2 hours for the performance of Surveillances.

APPLICABILITY: MODE 4.

ACTIONS

- NOTE -

Separate Condition entry is allowed for each RHR shutdown cooling subsystem.

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or two RHR shutdown cooling subsystems inoperable.	A.1 Verify an alternate method of decay heat removal is available for each inoperable RHR shutdown cooling subsystem.	1 hour <u>AND</u> Once per 24 hours thereafter

RHR Shutdown Cooling System - Cold Shutdown
3.4.10

ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
<p>B. No RHR shutdown cooling subsystem in operation.</p> <p><u>AND</u></p> <p>No recirculation pump in operation.</p>	<p>B.1 Verify reactor coolant circulating by an alternate method.</p> <p><u>AND</u></p> <p>B.2 Monitor reactor coolant temperature and pressure.</p>	<p>1 hour from discovery of no reactor coolant circulation</p> <p><u>AND</u></p> <p>Once per 12 hours thereafter</p> <p>Once per hour</p>

SURVEILLANCE REQUIREMENTS

	SURVEILLANCE	FREQUENCY
SR 3.4.10.1	<p>Verify one RHR shutdown cooling subsystem of</p> <p>recirculation pump is operating.</p>	<p>12 hours</p> <p>31 days</p>

Insert 1

3.9 REFUELING OPERATIONS

3.9.8 Residual Heat Removal (RHR) - High Water Level

LCO 3.9.8

One RHR shutdown cooling subsystem shall be OPERABLE ~~and in~~
~~operation.~~

- NOTE -

The required RHR shutdown cooling subsystem may be not in operation for up to 2 hours per 8 hour period.

APPLICABILITY: MODE 5 with irradiated fuel in the reactor pressure vessel (RPV) and with the water level \geq [22 ft 8 inches] above the top of the [reactor pressure vessel (RPV) flange].

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. Required RHR shutdown cooling subsystem inoperable.	A.1 Verify an alternate method of decay heat removal is available.	1 hour <u>AND</u> Once per 24 hours thereafter
B. Required Action and associated Completion Time of Condition A not met.	B.1 Suspend loading irradiated fuel assemblies into the RPV. <u>AND</u> B.2 Initiate action to restore [primary or secondary] containment to OPERABLE status. <u>AND</u>	Immediately Immediately

ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
	B.3 Initiate action to restore one standby gas treatment subsystem to OPERABLE status.	Immediately
	<u>AND</u>	
	B.4 Initiate action to restore isolation capability in each required secondary containment penetration flow path not isolated.	Immediately
C. No RHR shutdown cooling subsystem in operation.	C.1 Verify reactor coolant circulation by an alternate method.	1 hour from discovery of no reactor coolant circulation
	<u>AND</u>	
	C.2 Monitor reactor coolant temperature.	Once per 12 hours thereafter
		Once per hour

SURVEILLANCE REQUIREMENTS

	SURVEILLANCE	FREQUENCY
SR 3.9.8.1	Verify one RHR shutdown cooling subsystem is operating.	12 hours 31 days

Insert 1

3.9 REFUELING OPERATIONS

3.9.9 Residual Heat Removal (RHR) - Low Water Level

LCO 3.9.9

Two RHR shutdown cooling subsystems shall be OPERABLE, and
~~one RHR shutdown cooling subsystem shall be in operation.~~

- NOTE -

The required operating shutdown cooling subsystem may be not in operation for up to 2 hours per 8 hour period.

APPLICABILITY: MODE 5 with irradiated fuel in the reactor pressure vessel and with the water level < [23] ft above the top of the [reactor pressure vessel flange].

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or two RHR shutdown cooling subsystems inoperable.	A.1 Verify an alternate method of decay heat removal is available for each inoperable RHR shutdown cooling subsystem.	1 hour <u>AND</u> Once per 24 hours thereafter
B. Required Action and associated Completion Time of Condition A not met.	B.1 Initiate action to restore [primary or secondary] containment to OPERABLE status. <u>AND</u> B.2 Initiate action to restore one standby gas treatment subsystem to OPERABLE status. <u>AND</u>	Immediately Immediately

ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
	B.3 Initiate action to restore isolation capability in each required secondary containment penetration flow path not isolated.	Immediately
C. No RHR shutdown cooling subsystem in operation.	C.1 Verify reactor coolant circulation by an alternate method.	1 hour from discovery of no reactor coolant circulation
	AND	AND
	C.2 Monitor reactor coolant temperature.	Once per 12 hours thereafter Once per hour

SURVEILLANCE REQUIREMENTS

SURVEILLANCE		FREQUENCY
SR 3.9.9.1	Verify one RHR shutdown cooling subsystem is operating	12 hours 31 days

Insert 1

B 3.4 REACTOR COOLANT SYSTEM (RCS)

B 3.4.9 Residual Heat Removal (RHR) Shutdown Cooling System - Hot Shutdown

BASES

BACKGROUND	<p>Irradiated fuel in the shutdown reactor core generates heat during the decay of fission products and increases the temperature of the reactor coolant. This decay heat must be removed to reduce the temperature of the reactor coolant to $\leq 200^{\circ}\text{F}$. This decay heat removal is in preparation for performing refueling or maintenance operations, or for keeping the reactor in the Hot Shutdown condition.</p> <p>The two redundant, manually controlled shutdown cooling subsystems of the RHR System provide decay heat removal. Each loop consists of a motor driven pump, two heat exchangers in series, and associated piping and valves. Both loops have a common suction from the same recirculation loop. Each pump discharges the reactor coolant, after circulation through the respective heat exchanger, to the reactor via separate feedwater lines or to the reactor via the LPCI injection path. The RHR heat exchangers transfer heat to the Standby Service Water System (LCO 3.7.1, "[Standby Service Water (SSW)] System and [Ultimate Heat Sink (UHS)]").</p>
APPLICABLE SAFETY ANALYSES	<p>Decay heat removal by the RHR System in the shutdown cooling mode is not required for mitigation of any event or accident evaluated in the safety analyses. Decay heat removal is, however, an important safety function that must be accomplished or core damage could result. The RHR Shutdown Cooling System satisfies Criterion 4 of 10 CFR 50.36(c)(2)(ii).</p>
LCO	<p>Two RHR shutdown cooling subsystems are required to be OPERABLE, and, when no recirculation pump is in operation, one shutdown cooling subsystem must be in operation. An OPERABLE RHR shutdown cooling subsystem consists of one OPERABLE RHR pump, two heat exchangers in series, and the associated piping and valves. Each shutdown cooling subsystem is considered OPERABLE if it can be manually aligned (remote or local) in the shutdown cooling mode for removal of decay heat. In MODE 3, one RHR shutdown cooling subsystem can provide the required cooling, but two subsystems are required to be OPERABLE to provide redundancy. Operation of one subsystem can maintain or reduce the reactor coolant temperature as required. However, to ensure adequate core flow to allow for accurate average reactor coolant temperature monitoring, nearly continuous operation is required.</p>

BASES

LCO (continued)

Note 1 permits both RHR shutdown cooling subsystems and recirculation pumps to not be in operation for a period of 2 hours in an 8 hour period.

- (A) Note 2 allows one RHR shutdown cooling subsystem to be inoperable for up to 2 hours for performance of surveillance tests. These tests may be on the affected RHR System or on some other plant system or component that necessitates placing the RHR System in an inoperable status during the performance. This is permitted because the core heat generation can be low enough and the heatup rate slow enough to allow some changes to the RHR subsystems or other operations requiring RHR flow interruption and loss of redundancy.

APPLICABILITY

is required to be
OPERABLE so
that it

In MODE 3 with reactor steam dome pressure below the RHR cut in permissive pressure (i.e., the actual pressure at which the interlock resets) the RHR Shutdown Cooling System may be operated in the shutdown cooling mode to remove decay heat to reduce or maintain coolant temperature. Otherwise, a recirculation pump is required to be in operation. as desired

In MODES 1 and 2, and in MODE 3 with reactor steam dome pressure greater than or equal to the RHR cut in permissive pressure, this LCO is not applicable. Operation of the RHR System in the shutdown cooling mode is not allowed above this pressure because the RCS pressure may exceed the design pressure of the shutdown cooling piping. Decay heat removal at reactor pressures greater than or equal to the RHR cut in permissive pressure is typically accomplished by condensing the steam in the main condenser. Additionally, in MODE 2 below this pressure, the OPERABILITY requirements for the Emergency Core Cooling Systems (ECCS) (LCO 3.5.1, "ECCS - Operating") do not allow placing the RHR shutdown cooling subsystem into operation.

The requirements for decay heat removal in MODES 4 and 5 are discussed in LCO 3.4.10, "Residual Heat Removal (RHR) Shutdown Cooling System - Cold Shutdown," LCO 3.9.8, "Residual Heat Removal (RHR) - High Water Level," and LCO 3.9.9, "Residual Heat Removal (RHR) - Low Water Level."

ACTIONS

A Note to the ACTIONS excludes the MODE change restriction of LCO 3.0.4. This exception allows entry into the applicable MODE(S) while relying on the ACTIONS even though the ACTIONS may eventually require plant shutdown. This exception is acceptable due to the redundancy of the OPERABLE subsystems, the low pressure at which the plant is operating, the low probability of an event occurring during

BASES

ACTIONS (continued)

operation in this condition, and the availability of alternate methods of decay heat removal capability.

A second Note has been provided to modify the ACTIONS related to RHR shutdown cooling subsystems. Section 1.3, Completion Times, specifies once a Condition has been entered, subsequent divisions, subsystems, components or variables expressed in the Condition, discovered to be inoperable or not within limits, will not result in separate entry into the Condition. Section 1.3 also specifies Required Actions of the Condition continue to apply for each additional failure, with Completion Times based on initial entry into the Condition. However, the Required Actions for inoperable shutdown cooling subsystems provide appropriate compensatory measures for separate inoperable shutdown cooling subsystems. As such, a Note has been provided that allows separate Condition entry for each inoperable RHR shutdown cooling subsystem.

A.1, A.2, and A.3

With one required RHR shutdown cooling subsystem inoperable for decay heat removal, except as permitted by LCO Note 2, ^{the} the inoperable subsystem must be restored to OPERABLE status without delay. In this condition, the remaining OPERABLE subsystem can provide ~~the~~ ^{any} necessary decay heat removal. The overall reliability is reduced, however, because a single failure in the OPERABLE subsystem could result in reduced RHR shutdown cooling capability. Therefore an alternate method of decay heat removal must be provided.

With both RHR shutdown cooling subsystems inoperable, an alternate method of decay heat removal must be provided in addition to that provided for the initial RHR shutdown cooling subsystem inoperability. This re-establishes backup decay heat removal capabilities, similar to the requirements of the LCO. The 1 hour Completion Time is based on the decay heat removal function and the probability of a loss of the available decay heat removal capabilities.

The required cooling capacity of the alternate method should be ensured by verifying (by calculation or demonstration) its capability to maintain or reduce temperature. Decay heat removal by ambient losses can be considered as, or contributing to, the alternate method capability. Alternate methods that can be used include (but are not limited to) the Spent Fuel Pool Cooling System or the Reactor Water Cleanup System.

BASES

ACTIONS (continued)

However, due to the potentially reduced reliability of the alternate methods of decay heat removal, it is also required to reduce the reactor coolant temperature to the point where MODE 4 is entered.

B.1, B.2, and B.3

With no RHR shutdown cooling subsystem and no recirculation pump in operation, except as is permitted by LCO Note 1, reactor coolant circulation by the RHR shutdown cooling subsystem or one recirculation pump must be restored without delay.

Until RHR or recirculation pump operation is re-established, an alternate method of reactor coolant circulation must be placed into service. This will provide the necessary circulation for monitoring coolant temperature. The 1 hour Completion Time is based on the coolant circulation function and is modified such that the 1 hour is applicable separately for each occurrence involving a loss of coolant circulation. Furthermore, verification of the functioning of the alternate method must be reconfirmed every 12 hours thereafter. This will provide assurance of continued temperature monitoring capability.

During the period when the reactor coolant is being circulated by an alternate method (other than by the required RHR shutdown cooling subsystem or recirculation pump), the reactor coolant temperature and pressure must be periodically monitored to ensure proper function of the alternate method. The once per hour Completion Time is deemed appropriate.

SURVEILLANCE
REQUIREMENTS

SR 3.4.9.1

Insert 2

This Surveillance verifies that one RHR shutdown cooling subsystem or recirculation pump is in operation and circulating reactor coolant. The required flow rate is determined by the flow rate necessary to provide sufficient decay heat removal capability. The Frequency of 12 hours is sufficient in view of other visual and audible indications available to the operator for monitoring the RHR subsystem in the control room.

ability to align
and operate shutdown
cooling

This Surveillance is modified by a Note ^{OPERABILITY} allowing sufficient time to align the RHR System for shutdown cooling operation after clearing the pressure interlock that isolates the system, or for placing a recirculation pump in operation. The Note takes exception to the requirements of the Surveillance being met (i.e., forced coolant circulation is not required for this initial 2 hour period), which also allows entry into the Applicability of

B 3.4 REACTOR COOLANT SYSTEM (RCS)

B 3.4.10 Residual Heat Removal (RHR) Shutdown Cooling System - Cold Shutdown

BASES

BACKGROUND

Irradiated fuel in the shutdown reactor core generates heat during the decay of fission products and increases the temperature of the reactor coolant. This decay heat must be removed to maintain the temperature of the reactor coolant at $\leq 200^{\circ}\text{F}$. This decay heat removal is in preparation for performing refueling or maintenance operations, or for keeping the reactor in the Cold Shutdown condition.

The two redundant, manually controlled shutdown cooling subsystems of the RHR System provide decay heat removal. Each loop consists of a motor driven pump, two heat exchangers in series, and associated piping and valves. Both loops have a common suction from the same recirculation loop. Each pump discharges the reactor coolant, after circulation through the respective heat exchanger, to the reactor via separate feedwater lines or to the reactor via the LPCI injection path. The RHR heat exchangers transfer heat to the Standby Service Water System.

APPLICABLE SAFETY ANALYSES

Decay heat removal by the RHR System in the shutdown cooling mode is not required for mitigation of any event or accident evaluated in the safety analyses. Decay heat removal is, however, an important safety function that must be accomplished or core damage could result. The RHR Shutdown Cooling System satisfies Criterion 4 of 10 CFR 50.36(c)(2)(ii).

LCO

Two RHR shutdown cooling subsystems are required to be OPERABLE, and, when no recirculation pump is in operation, one RHR shutdown cooling subsystem must be in operation. An OPERABLE RHR shutdown cooling subsystem consists of one OPERABLE RHR pump, two heat exchangers in series, and the associated piping and valves. Each shutdown cooling subsystem is considered OPERABLE if it can be manually aligned (remote or local) in the shutdown cooling mode for removal of decay heat. In MODE 4, one RHR shutdown cooling subsystem can provide the required cooling, but two subsystems are required to be OPERABLE to provide redundancy. Operation of one subsystem can maintain and reduce the reactor coolant temperature as required. However, to ensure adequate core flow to allow for accurate average reactor coolant temperature monitoring, nearly continuous operation is required.

BASES

LCO (continued)

- A** → Note 1 permits both RHR shutdown cooling subsystems and recirculation pumps to not be in operation for a period of 2 hours in an 8-hour period.
- Note 2 allows one RHR shutdown cooling subsystem to be inoperable for up to 2 hours for performance of surveillance tests. These tests may be on the affected RHR System or on some other plant system or component that necessitates placing the RHR System in an inoperable status during the performance. This is permitted because the core heat generation can be low enough and the heatup rate slow enough to allow some changes to the RHR subsystems or other operations requiring RHR flow interruption and loss of redundancy.

APPLICABILITY

is required to be
OPERABLE so that
it

In MODE 4, the RHR System may be operated in the shutdown cooling mode to remove decay heat to maintain coolant temperature below 200°F. Otherwise, a recirculation pump is required to be in operation.

In MODES 1 and 2, and in MODE 3 with reactor steam dome pressure greater than or equal to the RHR cut in permissive pressure, this LCO is not applicable. Operation of the RHR System in the shutdown cooling mode is not allowed above this pressure because the RCS pressure may exceed the design pressure of the shutdown cooling piping. Decay heat removal at reactor pressures greater than or equal to the RHR cut in permissive pressure is typically accomplished by condensing the steam in the main condenser. Additionally, in MODE 2 below this pressure, the OPERABILITY requirements for the Emergency Core Cooling Systems (ECCS) (LCO 3.5.1, "ECCS - Operating") do not allow placing the RHR shutdown cooling subsystem into operation.

The requirements for decay heat removal in MODE 3 below the cut in permissive pressure and in MODE 5 are discussed in LCO 3.4.9, "Residual Heat Removal (RHR) Shutdown Cooling System - Hot Shutdown," LCO 3.9.8, "Residual Heat Removal (RHR) - High Water Level," and LCO 3.9.9, "Residual Heat Removal (RHR) - Low Water Level."

ACTIONS

A Note has been provided to modify the ACTIONS related to RHR shutdown cooling subsystems. Section 1.3, Completion Times, specifies once a Condition has been entered, subsequent divisions, subsystems, components or variables expressed in the Condition, discovered to be inoperable or not within limits, will not result in separate entry into the Condition. Section 1.3 also specifies Required Actions of the Condition continue to apply for each additional failure, with Completion Times based on initial entry into the Condition. However, the Required Actions

BASES

ACTIONS (continued)

for inoperable shutdown cooling subsystems provided appropriate compensatory measures for separate inoperable shutdown cooling subsystems. As such, a Note has been provided that allows separate Condition entry for each inoperable RHR shutdown cooling subsystem.

A.1

With one of the two required RHR shutdown cooling subsystems inoperable except as permitted by LCO Note 2, ^{the} the remaining subsystem is capable of providing the required decay heat removal. However, the overall reliability is reduced. Therefore, an alternate method of decay heat removal must be provided. With both RHR shutdown cooling subsystems inoperable, an alternate method of decay heat removal must be provided in addition to that provided for the initial RHR shutdown cooling subsystem inoperability. This re-establishes backup decay heat removal capabilities, similar to the requirements of the LCO. The 1 hour Completion Time is based on the decay heat removal function and the probability of a loss of the available decay heat removal capabilities. Furthermore, verification of the functional availability of these alternate method(s) must be reconfirmed every 24 hours thereafter. This will provide assurance of continued heat removal capability.

The required cooling capacity of the alternate method should be ensured by verifying (by calculation or demonstration) its capability to maintain or reduce temperature. Decay heat removal by ambient losses can be considered as, or contributing to the alternate method capability. Alternate methods that can be used include (but are not limited to) the Spent Fuel Pool Cooling System or the Reactor Water Cleanup System.

B.1 and B.2

With no RHR shutdown cooling subsystem and no recirculation pump in operation, except as is permitted by LCO Note 1, and until RHR or recirculation pump operation is re-established, an alternate method of reactor coolant circulation must be placed into service. This will provide the necessary circulation for monitoring coolant temperature. The 1 hour Completion Time is based on the coolant circulation function and is modified such that the 1 hour is applicable separately for each occurrence involving a loss of coolant circulation. Furthermore, verification of the functioning of the alternate method must be reconfirmed every 12 hours thereafter. This will provide assurance of continued temperature monitoring capability.

BASES

ACTIONS (continued)

During the period when the reactor coolant is being circulated by an alternate method (other than by the required RHR shutdown cooling system or recirculation pump), the reactor coolant temperature and pressure must be periodically monitored to ensure proper function of the alternate method. The once per hour Completion Time is deemed appropriate.

SURVEILLANCE
REQUIREMENTS

SR 3.4.10.1

Insert 2

This Surveillance verifies that one RHR shutdown cooling subsystem or recirculation pump is in operation and circulating reactor coolant. The required flow rate is determined by the flow rate necessary to provide sufficient decay heat removal capability. The Frequency of 12 hours is sufficient in view of other visual and audible indications available to the operator for monitoring the RHR subsystem in the control room.

REFERENCES

None.

BASES

LCO (continued)

reactor coolant temperature as required. However, to ensure adequate core flow to allow for accurate average reactor coolant temperature monitoring, nearly continuous operation is required. A Note is provided to allow a 2 hour exception for the operating subsystem to not be in operation every 8 hours.

APPLICABILITY

One RHR shutdown cooling subsystem must be OPERABLE in MODE 5, with irradiated fuel in the RPV and with the water level \geq [22 ft 8 inches] above the top of the RPV flange, to provide decay heat removal. RHR System requirements in other MODES are covered by LCOs in Section 3.4, Reactor Coolant System (RCS); Section 3.5, Emergency Core Cooling Systems (ECCS) and Reactor Core Isolation Cooling (RCIC) System; and Section 3.6, Containment Systems. RHR Shutdown Cooling System requirements in MODE 5, with irradiated fuel in the reactor pressure vessel and with the water level $<$ [22 ft 8 inches] above the RPV flange, are given in LCO 3.9.9, "Residual Heat Removal (RHR) - Low Water Level."

ACTIONS

A.1

With no RHR shutdown cooling subsystem OPERABLE, an alternate method of decay heat removal must be established within 1 hour. In this condition, the volume of water above the RPV flange provides adequate capability to remove decay heat from the reactor core. However, the overall reliability is reduced because loss of water level could result in reduced decay heat removal capability. The 1 hour Completion Time is based on the decay heat removal function and the probability of a loss of the available decay heat removal capabilities. Furthermore, verification of the functional availability of these alternate method(s) must be reconfirmed every 24 hours thereafter. This will ensure continued heat removal capability.

Alternate decay heat removal methods are available to the operators for review and preplanning in the unit's Operating Procedures. For example, this may include the use of the Reactor Water Cleanup System, operating with the regenerative heat exchanger bypassed. The method used to remove the decay heat should be the most prudent choice based on unit conditions.

BASES

ACTIONS (continued)

B.1, B.2, B.3, and B.4

If no RHR shutdown cooling subsystem is OPERABLE and an alternate method of decay heat removal is not available in accordance with Required Action A.1, actions shall be taken immediately to suspend operations involving an increase in reactor decay heat load by suspending the loading of irradiated fuel assemblies into the RPV.

Additional actions are required to minimize any potential fission product release to the environment. This includes ensuring secondary containment is OPERABLE; one standby gas treatment subsystem is OPERABLE; and secondary containment isolation capability (i.e., one secondary containment isolation valve and associated instrumentation are operable or other acceptable administrative controls to assure isolation capability) in each associated penetration not isolated that is assumed to be isolated to mitigate radioactivity releases. This may be performed as an administrative check, by examining logs or other information to determine whether the components are out of service for maintenance or other reasons. It is not necessary to perform the Surveillances needed to demonstrate the OPERABILITY of the components. If, however, any required component is inoperable, then it must be restored to OPERABLE status. In this case, a surveillance may need to be performed to restore the component to OPERABLE status. Actions must continue until all required components are OPERABLE.

C.1 and C.2

If no RHR shutdown cooling subsystem is in operation, an alternate method of coolant circulation is required to be established within 1 hour. The Completion Time is modified such that 1 hour is applicable separately for each occurrence involving a loss of coolant circulation.


During the period when the reactor coolant is being circulated by an alternate method (other than by the required RHR Shutdown Cooling System), the reactor coolant temperature must be periodically monitored to ensure proper functioning of the alternate method. The once per hour Completion Time is deemed appropriate.

BASES

SURVEILLANCE
REQUIREMENTS

SR 3.9.8.1

Insert 2



~~This Surveillance demonstrates that the RHR subsystem is in operation and circulating reactor coolant. The required flow rate is determined by the flow rate necessary to provide sufficient decay heat removal capability. The Frequency of 12 hours is sufficient in view of other visual and audible indications available to the operator for monitoring the RHR subsystem in the control room.~~

REFERENCES

None.

B 3.9 REFUELING OPERATIONS

B 3.9.9 Residual Heat Removal (RHR) - Low Water Level

BASES

BACKGROUND	The purpose of the RHR System in MODE 5 is to remove decay heat and sensible heat from the reactor coolant, as required by GDC 34. Each of the two shutdown cooling loops of the RHR System can provide the required decay heat removal. Each loop consists of one motor driven pump, a heat exchanger, and associated piping and valves. Both loops have a common suction from the same recirculation loop. Each pump discharges the reactor coolant, after it has been cooled by circulation through the respective heat exchangers, to the reactor via separate feedwater lines, to the upper containment pool via a common single flow distribution sparger, or to the reactor via the low pressure coolant injection path. The RHR heat exchangers transfer heat to the Standby Service Water System. The RHR shutdown cooling mode is manually controlled.
-------------------	--

APPLICABLE SAFETY ANALYSES	With the unit in MODE 5, the RHR System is not required to mitigate any events or accidents evaluated in the safety analyses. The RHR System is required for removing decay heat to maintain the temperature of the reactor coolant.
---	--

The RHR System satisfies Criterion 4 of 10 CFR 50.36(c)(2)(ii).

LCO	In MODE 5 with irradiated fuel in the reactor pressure vessel (RPV) and with the water level < 22 ft 8 inches above the RPV flange both RHR shutdown cooling subsystems must be OPERABLE.
------------	---

An OPERABLE RHR shutdown cooling subsystem consists of an RHR pump, a heat exchanger, valves, piping, instruments, and controls to ensure an OPERABLE flow path.

Additionally, each RHR shutdown cooling subsystem is considered OPERABLE if it can be manually aligned (remote or local) in the shutdown cooling mode for removal of decay heat. Operation (either continuous or intermittent) of one subsystem can maintain and reduce the reactor coolant temperature as required. However, to ensure adequate core flow to allow for accurate average reactor coolant temperature monitoring, nearly continuous operation is required. A Note is provided to allow a 2 hour exception for the operating subsystem to not be in operation every 8 hours.

BASES

ACTIONS (continued)

associated instrumentation are operable or other acceptable administrative controls to assure isolation capability) in each associated penetration not isolated that is assumed to be isolated to mitigate radioactivity releases. This may be performed as an administrative check, by examining logs or other information to determine whether the components are out of service for maintenance or other reasons. It is not necessary to perform the Surveillances needed to demonstrate the OPERABILITY of the components. If, however, any required component is inoperable, then it must be restored to OPERABLE status. In this case, a surveillance may need to be performed to restore the component to OPERABLE status. Actions must continue until all required components are OPERABLE.

C.1 and C.2

If no RHR shutdown cooling subsystem is in operation, an alternate method of coolant circulation is required to be established within 1 hour. The Completion Time is modified such that the 1 hour is applicable separately for each occurrence involving a loss of coolant circulation.

During the period when the reactor coolant is being circulated by an alternate method (other than by the required RHR Shutdown Cooling System), the reactor coolant temperature must be periodically monitored to ensure proper function of the alternate method. The once per hour Completion Time is deemed appropriate.

SURVEILLANCE
REQUIREMENTS

SR 3.9.9.1

Insert 2 →

This Surveillance demonstrates that one RHR shutdown cooling subsystem is in operation and circulating reactor coolant. The required flow rate is determined by the flow rate necessary to provide sufficient decay heat removal capability. The Frequency of 12 hours is sufficient in view of other visual and audible indications available to the operator for monitoring the RHR subsystem in the control room.

REFERENCES

None.

Technical Specification Task Force

Improved Standard Technical Specifications Change Traveler

Control Rod Scram Time Testing Frequency

NUREGs Affected: ☐ 1430 ☐ 1431 ☐ 1432 ☒ 1433 ☒ 1434

Classification: 1) Technical Change

Recommended for CLIIP?: Yes

Correction or Improvement: Improvement

Industry Contact: Tom Silko, (802) 258-4146, tsilko@entergy.com

1.0 Description

The proposed Traveler changes NUREG-1433 (BWR/4) and NUREG-1434 (BWR/6) by revising the Frequency of SR 3.1.4.2, control rod scram time testing, from "120 days cumulative operation in MODE 1" to "[200] days cumulative operation in MODE 1." The Bases are revised to limit the percentage of the tested rods which can be "slow" from 20% to 7.5%.

2.0 Proposed Change

NUREG-1433, SR 3.1.4.2 states, "Verify, for a representative sample, each tested control rod scram time is within the limits of Table 3.1.4-1 with reactor steam dome pressure \geq [800] psig." NUREG-1434, SR 3.1.4.2 states, "Verify, for a representative sample, each tested control rod scram time is within the limits of Table 3.1.4-1 with reactor steam dome pressure \geq [950] psig." Both SRs have a Frequency of "120 days cumulative operation in MODE 1." The proposed change revises the Frequency to "[200] days cumulative operation in MODE 1." The Bases are revised to reference the new Frequency and to reduce the percentage of the tested rods which can be "slow" from 20% to 7.5%.

3.0 Background

Control rod scram time is verified following each refueling. Additional testing of a sample of control rods is required to verify the continued performance of the scram function during the cycle. A representative sample contains at least 10% of the control rods. The sample remains representative if no more than 20% of the control rods in the sample tested are determined to be "slow." With more than 20% of the sample declared to be "slow" per the criteria in Table 3.1.4-1, additional control rods are tested until this 20% criterion (e.g., 20% of the entire sample size) is satisfied, or until the total number of "slow" control rods (throughout the core, from all surveillances) exceeds the LCO limit. For planned testing, the control rods selected for the sample should be different for each test.

17-Sep-03

4.0 Technical Analysis

Industry operating experience has shown the control rod scram rates to be highly reliable. For example, at the Grand Gulf Nuclear Station, out of 7,660 control rod insertion tests, only 12 control rods have been slower than the insertion time limit (with the exception of test data from an anomalous cycle). The control rod drive system has shown to be highly reliable. This high reliability supports the extension of the Surveillance Frequency from 120 days of cumulative operation in MODE 1 to 200 days.

The current TS Bases states that the acceptance criteria have been met if 20 percent or fewer of the random sample control rods that are tested within the 120 day surveillance period are found to be slow. The Bases are revised to change the control rod insertion time acceptance criterion for percentage of slow rods allowed, be reduced to 7.5 percent of the random at-power surveillance sample when the surveillance period is extended to 200 cumulative days of operation in MODE 1. The more restrictive 7.5 percent acceptance criterion for testing the random sample is consistent with the TS 3.1.4 objective of ensuring that no more than 14 OPERABLE control rods are slow at any given time.

Plants submitting amendments to extend the Surveillance Frequency should demonstrate the reliability of the control rod insertion system, based on historical control rod scram time test data, and by the more restrictive acceptance criterion for the number of slow rods allowed during at-power surveillance testing. The justification provided should be comparable to that used in References 1 and 2.

The proposed change is consistent with the amendment requests in References 1, 2, and 3 and the NRC's approvals in References 4 and 5.

17-Sep-03

5.0 Regulatory Analysis

5.1 No Significant Hazards Consideration

The TSTF has evaluated whether or not a significant hazards consideration is involved with the proposed generic change by focusing on the three standards set forth in 10 CFR 50.92, "Issuance of amendment," as discussed below:

1. Does the change involve a significant increase in the probability or consequences of an accident previously evaluated?

Response: No.

The proposed change extends the Frequency for testing control rod scram time testing from every 120 days of cumulative MODE 1 operation to [200] days of cumulative MODE 1 operation. The Frequency of Surveillance testing is not an initiator of any accident previously evaluated. The Frequency of Surveillance testing does not affect the ability to mitigate any accident previously evaluated, as the tested component is still required to be OPERABLE. Therefore, the proposed change does not involve a significant increase in the probability or consequences of an accident previously evaluated.

2. Does the change create the possibility of a new or different kind of accident from any accident previously evaluated?

Response: No.

The proposed change extends the Frequency for testing control rod scram time testing from every 120 days of cumulative MODE 1 operation to [200] days of cumulative MODE 1 operation. The proposed change does not result in any new or different modes of plant operation. Therefore, the proposed change does not create the possibility of a new or different kind of accident from any previously evaluated.

3. Does the proposed change involve a significant reduction in a margin of safety?

Response: No.

The proposed change extends the Frequency for testing control rod scram time testing from every 120 days of cumulative MODE 1 operation to [200] days of cumulative MODE 1 operation. The proposed change continues to test the control rod scram time to ensure the assumptions in the safety analysis are protected. Therefore, the proposed change does not involve a significant reduction in a margin of safety.

5.2 Applicable Regulatory Requirements / Criteria

The proposed change does not affect any OPERABILITY requirements and the test Frequency being revised is not specified in regulations. As a result, no regulatory requirements or criteria are affected.

17-Sep-03

6.0 Environmental Consideration

The proposed amendment does not involve (i) a significant hazards consideration, (ii) a significant change in the types or significant increase in the amounts of any effluent that may be released offsite, or (iii) a significant increase in individual or cumulative occupational radiation exposure. Accordingly, the proposed amendment meets the eligibility criterion for categorical exclusion set forth in 10 CFR 51.22(c)(9). Therefore, pursuant to 10 CFR 51.22(b), no environmental impact statement or environmental assessment need be prepared in connection with the proposed amendment.

7.0 References

1. Letter from William A. Eaton, Entergy Operations, Inc. (GNRO-2001/00002) to NRC, "Grand Gulf Nuclear Station, Docket No. 50-416, License No. NPF-29, Control Rod Scram Time Testing Frequency, Proposed Amendment to the Operating License, LDC 2001-001," dated January 25, 2001.
2. Letter from William A. Eaton, Entergy Operations, Inc. (GNRO-2002/00012) to NRC, "Grand Gulf Nuclear Station, Docket No. 50-416, Supplement to Amendment Request Concerning Control Rod Scram Time Testing Frequency," dated February 20, 2002.
3. Letter from William R. Brian, Entergy Operations, Inc. (LAR 2001-35) to NRC, "River Bend Station, Unit 1, Docket No. 50-458, License Amendment Request, Control Rod Scram Time Testing Frequency," dated July 10, 2002.
4. Letter from S. Patrick Sekerak, NRC, to Mr. William A. Eaton, Entergy Operations, Inc., Grand Gulf Nuclear Station, Unit 1 - Issuance of License Amendment re: Control Rod Scram Time Testing Frequency, dated May 14, 2002.
5. Letter from Michael Webb, NRC, to Mr. Paul D. Hinnenkamp, Entergy Operations, Inc., River Bend Station Unit 1 - Issuance of Amendment Re: Control Rod Testing Frequency, dated December 12, 2002

Revision History

OG Revision 0

Revision Status: Closed

Revision Proposed by: Grand Gulf

Revision Description:
Original Issue

Owners Group Review Information

Date Originated by OG: 21-Aug-02

Owners Group Comments:
(No Comments)

Owners Group Resolution: Superceeded Date: 21-May-03

OG Revision 1

Revision Status: Active

Revision Proposed by: Grand Gulf

Revision Description:
Bracketed the 200 day Frequency, added additional information on plant-specific justification of new Frequency.

17-Sep-03

OG Revision 1**Revision Status: Active**

Owners Group Review Information

Date Originated by OG: 21-May-03

Owners Group Comments:
(No Comments)Owners Group Resolution: Approved Date: 21-May-03

TSTF Review Information

TSTF Received Date: 11-Aug-03

Date Distributed for Review: 12-Aug-03

OG Review Completed: ☒ BWOG ☒ WOG ☒ CEOG ☒ BWROGTSTF Comments:
(No Comments)

TSTF Resolution: Approved

Date: 26-Aug-03

NRC Review Information

NRC Received Date: 07-Sep-03

Affected Technical Specifications

SR 3.1.4.2 Control Rod Scram Times

SR 3.1.4.2 Bases Control Rod Scram Times

17-Sep-03

3.1 REACTIVITY CONTROL SYSTEMS

3.1.4 Control Rod Scram Times

- LCO 3.1.4
- a. No more than [10] OPERABLE control rods shall be "slow," in accordance with Table 3.1.4-1, and
 - b. No more than 2 OPERABLE control rods that are "slow" shall occupy adjacent locations.

APPLICABILITY: MODES 1 and 2.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. Requirements of the LCO not met.	A.1 Be in MODE 3.	12 hours

SURVEILLANCE REQUIREMENTS

- NOTE -

During single control rod scram time Surveillances, the control rod drive (CRD) pumps shall be isolated from the associated scram accumulator.

SURVEILLANCE		FREQUENCY
SR 3.1.4.1	Verify each control rod scram time is within the limits of Table 3.1.4-1 with reactor steam dome pressure \geq [800] psig.	Prior to exceeding 40% RTP after each reactor shutdown \geq 120 days
SR 3.1.4.2	Verify, for a representative sample, each tested control rod scram time is within the limits of Table 3.1.4-1 with reactor steam dome pressure \geq [800] psig.	420 days cumulative operation in MODE 1

[200]

BASES

SURVEILLANCE REQUIREMENTS (continued)

testing can be performed. To ensure that scram time testing is performed within a reasonable time following a shutdown ≥ 120 days or longer, control rods are required to be tested before exceeding 40% RTP following the shutdown. This Frequency is acceptable considering the additional surveillances performed for control rod OPERABILITY, the frequent verification of adequate accumulator pressure, and the required testing of control rods affected by fuel movement within the associated core cell and by work on control rods or the CRD System.

SR 3.1.4.2

Additional testing of a sample of control rods is required to verify the continued performance of the scram function during the cycle. A representative sample contains at least 10% of the control rods. The sample remains representative if no more than 20% of the control rods in the sample tested are determined to be "slow." With more than 20% of the sample declared to be "slow" per the criteria in Table 3.1.4-1, additional control rods are tested until this 20% criterion (e.g., 20% of the entire sample size) is satisfied, or until the total number of "slow" control rods (throughout the core, from all surveillances) exceeds the LCO limit. For planned testing, the control rods selected for the sample should be different for each test. Data from inadvertent scrams should be used whenever possible to avoid unnecessary testing at power, even if the control rods with data may have been previously tested in a sample. The 420 day Frequency is based on operating experience that has shown control rod scram times do not significantly change over an operating cycle. This Frequency is also reasonable based on the additional Surveillances done on the CRDs at more frequent intervals in accordance with LCO 3.1.3 and LCO 3.1.5, "Control Rod Scram Accumulators."

[200]

7.5%

SR 3.1.4.3

When work that could affect the scram insertion time is performed on a control rod or the CRD System, testing must be done to demonstrate that each affected control rod retains adequate scram performance over the range of applicable reactor pressures from zero to the maximum permissible pressure. The scram testing must be performed once before declaring the control rod OPERABLE. The required scram time testing must demonstrate the affected control rod is still within acceptable limits. The limits for reactor pressures < 800 psig are established based on a high probability of meeting the acceptance criteria at reactor pressures ≥ 800 psig. Limits for ≥ 800 psig are found in Table 3.1.4-1. If testing demonstrates the affected control rod does not meet these limits, but is

3.1 REACTIVITY CONTROL SYSTEMS

3.1.4 Control Rod Scram Times

- LCO 3.1.4
- a. No more than [14] OPERABLE control rods shall be "slow," in accordance with Table 3.1.4-1 and
 - b. No more than 2 OPERABLE control rods that are "slow" shall occupy adjacent locations.

APPLICABILITY: MODES 1 and 2.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. Requirements of the LCO not met.	A.1 Be in MODE 3.	12 hours

SURVEILLANCE REQUIREMENTS

- NOTE -

During single control rod scram time Surveillances, the control rod drive (CRD) pumps shall be isolated from the associated scram accumulator.

SURVEILLANCE		FREQUENCY
SR 3.1.4.1	Verify each control rod scram time is within the limits of Table 3.1.4-1 with reactor steam dome pressure \geq [950] psig.	Prior to exceeding 40% RTP after each reactor shutdown \geq 120 days
SR 3.1.4.2	Verify, for a representative sample, each tested control rod scram time is within the limits of Table 3.1.4-1 with reactor steam dome pressure \geq [950] psig.	<div style="display: flex; align-items: center;"> <div> 120 days cumulative operation in MODE 1 </div> <div style="border: 1px solid black; padding: 2px; margin-left: 10px;">[200]</div> </div>

BASES

SURVEILLANCE REQUIREMENTS (continued)

at reactor steam dome pressure ≥ 950 psig ensures that the scram times will be within the specified limits at higher pressures. Limits are specified as a function of reactor pressure to account for the sensitivity of the scram insertion times with pressure and to allow a range of pressures over which scram time testing can be performed. To ensure scram time testing is performed within a reasonable time following a shutdown ≥ 120 days, control rods are required to be tested before exceeding 40% RTP. This Frequency is acceptable, considering the additional surveillances performed for control rod OPERABILITY, the frequent verification of adequate accumulator pressure, and the required testing of control rods affected by fuel movement within the associated core cell and by work on control rods or the CRD System.

SR 3.1.4.2

Additional testing of a sample of control rods is required to verify the continued performance of the scram function during the cycle. A representative sample contains at least 10% of the control rods. The sample remains representative if no more than 20% of the control rods in the sample tested are determined to be "slow." If more than 20% of the sample is declared to be "slow" per the criteria in Table 3.1.4-1, additional control rods are tested until this 20% criterion (e.g., 20% of the entire sample size) is satisfied, or until the total number of "slow" control rods (throughout the core, from all Surveillances) exceeds the LCO limit. For planned testing, the control rods selected for the sample should be different for each test. Data from inadvertent scrams should be used whenever possible to avoid unnecessary testing at power, even if the control rods with data were previously tested in a sample. The 420 day Frequency is based on operating experience that has shown control rod scram times do not significantly change over an operating cycle. This Frequency is also reasonable, based on the additional Surveillances done on the CRDs at more frequent intervals in accordance with LCO 3.1.3 and LCO 3.1.5, "Control Rod Scram Accumulators."

7.5%

[200]

SR 3.1.4.3

When work that could affect the scram insertion time is performed on a control rod or the CRD System, testing must be done to demonstrate that each affected control rod retains adequate scram performance over the range of applicable reactor pressures from zero to the maximum permissible pressure. The scram testing must be performed once before declaring the control rod OPERABLE. The required scram time testing must demonstrate that the affected control rod is still within acceptable

Technical Specification Task Force

Improved Standard Technical Specifications Change Traveler

Addition of time performance Surveillance Requirement (SR) note to Source Range Monitor (SRM) SRsNUREGs Affected: ☐ 1430 ☐ 1431 ☐ 1432 ☒ 1433 ☒ 1434

Classification: 3) Improve Specifications

Recommended for CLIIP?: Yes

Correction or Improvement: Improvement

Industry Contact: Tom Silko, (802) 258-4146, tsilko@entergy.com

1.0 Description

A time allowance Note is being added to the Source Range Monitor (SRM) Surveillance Requirements (SRs) 3.3.1.2.3 and 3.3.1.2.4. This change provides a time allowance to perform the subject SRs following sudden entry into MODE 3 due to a reactor scram.

These two SRs are not routinely performed in MODE 1 and thus will likely not be in periodicity. With the two SRs out of periodicity, sudden entry into MODE 3 due to a scram results in the immediate entry into SR 3.0.3 for the SRMs, which would remain in effect until the two SRs were completed. In STS, it atypical to have a forced entry into SR 3.0.3 due to an anticipated operational occurrence (in this case, a scram) and the situation presents a administrative distraction to Operators involved in scram recovery activities. Therefore, the addition of a specific time allowance note to perform the two SRs is being proposed.

2.0 Proposed Change

A 12-hour time allowance note is added to SRs 3.3.1.2.3 (SRM CHANNEL CHECK) and 3.3.1.2.4 (SRM COUNT RATE/SIGNAL-TO-NOISE). This change provides a time allowance to perform the SRs for the situation involving sudden entry into MODE 3 due to a reactor scram. The added Note is the same as that currently used for SR 3.3.1.2.6 (SRM CHANNEL FUNCTIONAL TEST/SIGNAL-TO-NOISE RATIO) and 3.3.1.2.7 (SRM CHANNEL CALIBRATION). This change is applicable to the Boiling Water Reactor (BWR) Standard Technical Specifications (STS), Revision 2 of NUREG-1433 and NUREG-1434. See the attached mark-ups for the specific changes.

12-Sep-03

3.0 Background

The primary use of the SRMs is during plant start-up. During start-up, the SRMs provide the operator with information relative to the neutron flux level at very low flux levels in the core. As such, the SRM indication is used by the operator to monitor the approach to criticality and determine when criticality is achieved. The SRMs are maintained fully inserted until the count rate is greater than a minimum allowed count rate (a control rod block is set at this condition), at which time they are partially withdrawn. After the Intermediate Range Monitors (IRMs) are on range 3 or above, the SRMs are fully withdrawn from the core, where they remain during normal power operation.

The SRMs are required to be OPERABLE in MODES 2, 3, 4, and 5 prior to the IRMs being on scale on Range 3 to provide for neutron monitoring. In MODE 1, the APRMs provide adequate monitoring of reactivity changes in the core; therefore, the SRMs are not required. In MODE 2, with IRMs on Range 3 or above, the IRMs provide adequate monitoring and the SRMs are not required. The SRMs have no safety function and are not assumed to function during any FSAR design basis accident or transient analysis. However, the SRMs do provide the only onscale monitoring of neutron flux levels during startup and refueling.

As noted above, the SRMs are fully withdrawn from the reactor during startup. Accordingly, SRs 3.3.1.2.3 (SRM CHANNEL CHECK) and SR 3.3.1.2.4 (SRM COUNT RATE/SIGNAL-TO-NOISE) are not performed at power and thus will routinely be out of periodicity during MODE 1 power operation. A reactor scram results in a sudden entry into MODE 3 from MODE 1, which reestablishes TS requirements for SRM operability. However, with the two SRs out of periodicity, the entry into MODE 3 results in the immediate entry into SR 3.0.3 for the SRMs, which would remain in effect until the SRs were completed.

In STS, it is atypical to have a forced entry into SR 3.0.3 due to an anticipated operational occurrence (in this case, a scram) and the situation presents an administrative distraction to Operators involved in scram recovery activities. Hence, a time allowance to perform the SR is needed to avoid the unnecessary invocation of SR 3.0.3 for surveillance tests not met within the required Frequency. To address this situation, this TSTF proposes the addition of a 12-hour time allowance note to perform SR 3.3.1.2.3 and SR 3.3.1.2.4. This change also promotes consistency with existing SRs 3.3.1.2.6 (SRM CHANNEL FUNCTIONAL TEST/SIGNAL-TO-NOISE RATIO) and 3.3.1.2.7 (SRM CHANNEL CALIBRATION), which both already have a 12-hour performance note.

12-Sep-03

4.0 Technical Analysis

A reactor scram can result in an sudden unplanned entry into MODE 3. TS 3.3.1.2, SRM Instrumentation, requires SRM operability in MODE 3. The required SRs for MODE 3 are listed in TS Table 3.3.1.2-1 and include SR 3.3.1.2.3 (SRM CHANNEL CHECK), SR 3.3.1.2.4 (SRM COUNT RATE/SIGNAL-TO-NOISE), SR 3.3.1.2.6 (SRM CHANNEL FUNCTIONAL TEST/SIGNAL-TO-NOISE RATIO) and 3.3.1.2.7 (SRM CHANNEL CALIBRATION).

Since the SRMs are fully withdrawn from the reactor during startup and there are no operability requirements for the SRMs in MODE 1, none of the above four SRM SRs are required to be performed during normal power operation. So, on a reactor scram, it would not be unusual for all four of the SRs to be out of periodicity. SRs 3.3.1.2.6 and 3.3.1.2.7 both currently have 12-hour performance Notes, which provide a nominal time period to perform the SRs. In current STS, however, SR 3.3.1.2.3 and SR 3.3.1.2.4, do not have a similar performance Note, which would result in the immediate entry into SR 3.0.3 for the SRMs until the SRs were completed.

The current SRM TS are primarily constructed with start-up activities in mind. In a shutdown condition with the SRMs fully inserted, all of the SRM SRs can be readily performed and maintained in periodicity.

Therefore, it is simple to maintain MODE 3 SRs in periodicity and, during startup, transition into Mode 2 and subsequently MODE 1. After the IRMs are on Range 3, SRM operability is no longer required and the SRMs are withdrawn.

A scram results in sudden entry into Mode 3, which reestablishes TS requirements for SRM operability. With SR 3.3.1.2.3 or SR 3.3.1.2.4 out of periodicity, this situation results in the immediate entry into SR 3.0.3 for the SRMs due to SRs not being within the required Frequency. The invocation of SR 3.0.3 allows an additional 24 hours to perform SRs, which are discovered out of frequency. Therefore, the addition of a 12 hour time allowance note is conservative with respect to the 24-hour time allowance provided by SR 3.0.3. In this regard, the proposed TSTF change is administrative in that it simply establishes TS provisions to avoid to a forced entry into SR 3.0.3.

The proposed 12-hour allowance to perform the SRs is reasonable based on the small safety significance of the delay in completing the SR, the inability to perform the SR prior to entering the Applicability, and the recognition that the most probable result of the SR being performed is verification of conformance with the TS requirements.

12-Sep-03

5.0 Regulatory Analysis

A change to Boiling Water Reactor (BWR) Standard Technical Specifications (STS), Revision 2 of NUREG-1433 and NUREG-1434 is being proposed by the Technical Specifications Task Force (TSTF) to add a 12-hour time allowance note to SRs 3.3.1.2.3 (SRM CHANNEL CHECK) and 3.3.1.2.4 (SRM COUNT RATE/SIGNAL-TO-NOISE).

5.1 No Significant Hazards Consideration

The Technical Specifications Task Force (TSTF) has evaluated whether or not a significant hazards consideration is involved with the proposed generic change by focusing on the three standards set forth in 10 CFR 50.92, "Issuance of amendment" as discussed below. In accordance with the criteria set forth in 10 CFR 50.92, the TSTF has evaluated these proposed Standard Technical Specifications changes and determined that they do not represent a significant hazards consideration. The following is provided in support of this conclusion.

1. Does the proposed change involve a significant increase in the probability or consequences of an accident previously evaluated?

Response: No

This change provides Notes to SRs 3.3.1.2.3 and 3.3.1.2.4 to avoid those Surveillances being declared not met within the required Frequency due to an expected transition into MODE 3. The Frequency of Surveillances is not an initiator of any accident previously evaluated. Consequently, the probability of an accident previously evaluated is not significantly increased. The Frequency of Surveillances has no effect on the consequences of an accident as the most likely outcome of any Surveillance is verification that the equipment is OPERABLE. Therefore, the proposed change does not involve a significant increase in the probability or consequences of an accident previously evaluated.

2. Does the proposed change create the possibility of a new or different kind of accident from any accident previously evaluated?

Response: No

The proposed change does not involve a physical alteration of the plant, add any new equipment, or require any existing equipment to be operated in a manner different from the present design. Therefore, the proposed change does not create the possibility of a new or different kind of accident from any accident previously evaluated.

3. Does the proposed change involve a significant reduction in a margin of safety?

Response: No

This change provides Notes to SRs 3.3.1.2.3 and 3.3.1.2.4 to avoid those Surveillances being declared not met within the required Frequency due to an expected transition into MODE 3. Should the Notes not be adopted, plants would continue to invoke SR 3.0.3 until the Surveillances can be performed. SR 3.0.3 would allow 24 hours to perform the missed Surveillances, while the proposed Notes allow only 12 hours. For these reasons, the proposed change does not involve a significant reduction in the margin of safety.

12-Sep-03

Based on the above, the TSTF concludes that the proposed change presents no significant hazards consideration under the standards set forth in 10 CFR 50.92(c), and, accordingly, a finding of “no significant hazards consideration” is justified.

5.2 Applicable Regulatory Requirements/Criteria

In STS, it customary to require performance of applicable SRs prior to entry into the specified condition of the Applicability, whenever feasible. In some cases, however, due to plant conditions it may not always possible to perform the SRs prior to entry. For these situations, it is typical to have a SR performance Note which allows a reasonable time period to perform the SR.

For the situation described in this TSTF, a reactor scram results in the sudden entry into a plant condition (MODE 3) that requires the operability of the SRMs. The required SRs will be out of periodicity, which results in a forced entry into SR 3.0.3. In using STS, it is atypical to have a forced entry into SR 3.0.3 due to an anticipated operational occurrence (in this case, a scram) and the situation presents a administrative distraction to Operators involved in scram recovery activities. Therefore, this TSTF proposes the addition of a time allowance note to allow performance of the SRs. This is consistent with STS general practice and meets regulatory objectives.

Based on the considerations discussed above, (1) there is reasonable assurance that the health and safety of the public will not be endangered by operation in the proposed manner, (2) such activities will be conducted in compliance with the Commission’s regulations, and (3) the approval of the proposed change will not be inimical to the common defense and security or to the health and safety of the public.”

6.0 Environmental Consideration

The proposed change does not involve (i) a significant hazards consideration, (ii) a significant change in the types or significant increase in the amounts of any effluent that may be released offsite, or (iii) a significant increase in individual or cumulative occupational radiation exposure. Accordingly, the proposed change meets the eligibility criterion for categorical exclusion set forth in 10 CFR 51.22(c)(9). Therefore, pursuant to 10 CFR 51.22(b), no environmental impact statement or environmental assessment need be prepared in connection with the proposed change.

7.0 References

None

Revision History

OG Revision 0

Revision Status: Closed

Revision Proposed by: BWROG

Revision Description:
Original Issue

12-Sep-03

OG Revision 0**Revision Status: Closed****Owners Group Review Information**

Date Originated by OG: 27-Jun-00

Owners Group Comments:

Traveler must be marked on Revision 2 pages and have an SE quality justification prior to TSTF review.

Discussed at 8 21/02 BWROG meeting. BWROG prioritized change and wanted BWROG-81 to address the BF proposed change.

Owners Group Resolution: Superceeded Date: 08-Nov-00

OG Revision 1**Revision Status: Active**

Revision Proposed by: Browns Ferry

Revision Description:

Revised to mark on ISTS Revision 2 pages and upgraded justification to Safety Evaluation quality.

Owners Group Review Information

Date Originated by OG: 21-Aug-02

Owners Group Comments:

(No Comments)

Owners Group Resolution: Approved Date: 21-Aug-02

TSTF Review Information

TSTF Received Date: 25-Nov-02

Date Distributed for Review: 12-Aug-03

OG Review Completed: ☒ BWOG ☒ WOG ☒ CEOG ☒ BWROG

TSTF Comments:

WOG chairman pointed out that change is applicable to PWRs. Will consider PWR-specific change if beneficial.

TSTF Resolution: Approved

Date: 12-Sep-03

NRC Review Information

NRC Received Date: 18-Sep-03

Affected Technical Specifications

SR 3.3.1.2.3 SRM Instrumentation

SR 3.3.1.2.3 Bases SRM Instrumentation

SR 3.3.1.2.4 SRM Instrumentation

12-Sep-03

SR 3.3.1.2.4 Bases

SRM Instrumentation

12-Sep-03

Insert 1

The Note to SR 3.3.1.2.3 allows the Surveillance to be delayed until entry into the specified condition of the Applicability (THERMAL POWER decreased to IRM Range 2 or below). The allowance to enter the Applicability with the 24 hour Frequency not met is reasonable based on the limited time of 12 hours and the most probable result of performing the Surveillance being the verification of conformance with the requirements.

Insert 2

Note 2 to the surveillance allows the Surveillance to be delayed until entry into the specified condition of the Applicability (THERMAL POWER decreased to IRM Range 2 or below). The allowance to enter the Applicability with the 24 hour Frequency not met is reasonable based on the limited time of 12 hours and the most probable result of performing the Surveillance being the verification of conformance with the requirements.

ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
	E.2 Initiate action to fully insert all insertable control rods in core cells containing one or more fuel assemblies.	Immediately

SURVEILLANCE REQUIREMENTS

- NOTE -

Refer to Table 3.3.1.2-1 to determine which SRs apply for each applicable MODE or other specified conditions.

SURVEILLANCE		FREQUENCY
SR 3.3.1.2.1	Perform CHANNEL CHECK.	12 hours
SR 3.3.1.2.2	<p>- NOTES -</p> <ol style="list-style-type: none"> Only required to be met during CORE ALTERATIONS. One SRM may be used to satisfy more than one of the following. <p>Verify an OPERABLE SRM detector is located in:</p> <ol style="list-style-type: none"> The fueled region, The core quadrant where CORE ALTERATIONS are being performed, when the associated SRM is included in the fueled region, and A core quadrant adjacent to where CORE ALTERATIONS are being performed, when the associated SRM is included in the fueled region. 	12 hours
SR 3.3.1.2.3	Perform CHANNEL CHECK.	24 hours

BWR/4 STS

3.3.1.2 - 2

Rev. 2, 04/30/01

- NOTE -

Not required to be performed until 12 hours after IRMs on Range 2 or below.

2. Not required to be performed until 12 hours after IRMs on Range 2 or below.

SRM Instrumentation
3.3.1.2

SURVEILLANCE REQUIREMENTS (continued)

SURVEILLANCE	FREQUENCY
<p>SR 3.3.1.2.4 -----</p> <p style="text-align: center;">- NOTE -</p> <p>1. Not required to be met with less than or equal to four fuel assemblies adjacent to the SRM and no other fuel assemblies in the associated core quadrant.</p> <p>Verify count rate is:</p> <p>a. $\geq [3.0]$ cps with a signal to noise ratio $\geq [2:1]$ or</p> <p>b. $\geq [0.7]$ cps with a signal to noise ratio $\geq [20:1]$.</p>	<p>12 hours during CORE ALTERATIONS</p> <p>AND</p> <p>24 hours</p>
<p>SR 3.3.1.2.5 Perform CHANNEL FUNCTIONAL TEST [and determination of signal to noise ratio].</p>	<p>7 days</p>
<p>SR 3.3.1.2.6 -----</p> <p style="text-align: center;">- NOTE -</p> <p>Not required to be performed until 12 hours after IRMs on Range 2 or below.</p> <p>Perform CHANNEL FUNCTIONAL TEST [and determination of signal to noise ratio].</p>	<p>31 days</p>
<p>SR 3.3.1.2.7 -----</p> <p style="text-align: center;">- NOTES -</p> <p>1. Neutron detectors are excluded.</p> <p>2. Not required to be performed until 12 hours after IRMs on Range 2 or below.</p> <p>Perform CHANNEL CALIBRATION.</p>	<p>[18] months</p>

BASES

ACTIONS (continued)

Action (once required to be initiated) to insert control rods must continue until all insertable rods in core cells containing one or more fuel assemblies are inserted.

SURVEILLANCE
REQUIREMENTS

The SRs for each SRM Applicable MODE or other specified conditions are found in the SRs column of Table 3.3.1.2-1.

SR 3.3.1.2.1 and SR 3.3.1.2.3


Performance of the CHANNEL CHECK ensures that a gross failure of instrumentation has not occurred. A CHANNEL CHECK is normally a comparison of the parameter indicated on one channel to a similar parameter on another channel. It is based on the assumption that instrument channels monitoring the same parameter should read approximately the same value. Significant deviations between the instrument channels could be an indication of excessive instrument drift in one of the channels or something even more serious. A CHANNEL CHECK will detect gross channel failure; thus, it is key to verifying the instrumentation continues to operate properly between each CHANNEL CALIBRATION.

Agreement criteria are determined by the plant staff based on a combination of the channel instrument uncertainties, including indication and readability. If a channel is outside the criteria, it may be an indication that the instrument has drifted outside its limit.

The Frequency of once every 12 hours for SR 3.3.1.2.1 is based on operating experience that demonstrates channel failure is rare. While in MODES 3 and 4, reactivity changes are not expected; therefore, the 12 hour Frequency is relaxed to 24 hours for SR 3.3.1.2.3. The CHANNEL CHECK supplements less formal, but more frequent, checks of channels during normal operational use of the displays associated with the channels required by the LCO.

SR 3.3.1.2.2

To provide adequate coverage of potential reactivity changes in the core, one SRM is required to be OPERABLE in the quadrant where CORE ALTERATIONS are being performed, and the other OPERABLE SRM must be in an adjacent quadrant containing fuel. Note 1 states that the SR is required to be met only during CORE ALTERATIONS. It is not required to be met at other times in MODE 5 since core reactivity changes are not occurring. This Surveillance consists of a review of plant

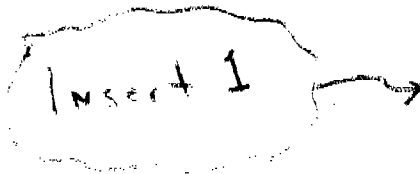

BASES

SURVEILLANCE REQUIREMENTS (continued)

logs to ensure that SRMs required to be OPERABLE for given CORE ALTERATIONS are, in fact, OPERABLE. In the event that only one SRM is required to be OPERABLE, per Table 3.3.1.2-1, footnote (b), only the a. portion of this SR is required. Note 2 clarifies that more than one of the three requirements can be met by the same OPERABLE SRM. The 12 hour Frequency is based upon operating experience and supplements operational controls over refueling activities that include steps to ensure that the SRMs required by the LCO are in the proper quadrant.

SR 3.3.1.2.4

This Surveillance consists of a verification of the SRM instrument readout to ensure that the SRM reading is greater than a specified minimum count rate, which ensures that the detectors are indicating count rates indicative of neutron flux levels within the core. With few fuel assemblies loaded, the SRMs will not have a high enough count rate to satisfy the SR. Therefore, allowances are made for loading sufficient "source" material, in the form of irradiated fuel assemblies, to establish the minimum count rate.

To accomplish this, the SR is modified by a Note that states that the count rate is not required to be met on an SRM that has less than or equal to four fuel assemblies adjacent to the SRM and no other fuel assemblies are in the associated core quadrant. With four or less fuel assemblies loaded around each SRM and no other fuel assemblies in the associated core quadrant, even with a control rod withdrawn, the configuration will not be critical.

The Frequency is based upon channel redundancy and other information available in the control room, and ensures that the required channels are frequently monitored while core reactivity changes are occurring. When no reactivity changes are in progress, the Frequency is relaxed from 12 hours to 24 hours.

Insert 2

SR 3.3.1.2.5 and SR 3.3.1.2.6

Performance of a CHANNEL FUNCTIONAL TEST demonstrates the associated channel will function properly. A successful test of the required contact(s) of a channel relay may be performed by the verification of the change of state of a single contact of the relay. This clarifies what is an acceptable CHANNEL FUNCTIONAL TEST of a relay. This is acceptable because all of the other required contacts of the relay are verified by other Technical Specifications and non-Technical

ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
	E.2 Initiate action to insert all insertable control rods in core cells containing one or more fuel assemblies.	Immediately

SURVEILLANCE REQUIREMENTS

- NOTE -

Refer to Table 3.3.1.2-1 to determine which SRs apply for each applicable MODE or other specified conditions.

SURVEILLANCE		FREQUENCY
SR 3.3.1.2.1	Perform CHANNEL CHECK.	12 hours
SR 3.3.1.2.2	<p>- NOTES -</p> <ol style="list-style-type: none"> Only required to be met during CORE ALTERATIONS. One SRM may be used to satisfy more than one of the following. <p>Verify an OPERABLE SRM detector is located in:</p> <ol style="list-style-type: none"> The fueled region, The core quadrant where CORE ALTERATIONS are being performed when the associated SRM is included in the fueled region, and A core quadrant adjacent to where CORE ALTERATIONS are being performed, when the associated SRM is included in the fueled region. 	12 hours
SR 3.3.1.2.3	Perform CHANNEL CHECK.	24 hours

BWR/6 STS

3.3.1.2 - 2

Rev. 2, 04/30/01

- NOTE -

Not required to be performed until 12 hours after IRMs on Range 2 or below.

1. Not required to be performed until 12 hours after IRMs on Range 2 or below.

SRM Instrumentation
3.3.1.2

SURVEILLANCE REQUIREMENTS (continued)

SURVEILLANCE	FREQUENCY
<p>SR 3.3.1.2.4</p> <p style="text-align: center;">- NOTE -</p> <p>① Not required to be met with less than or equal to four fuel assemblies adjacent to the SRM and no other fuel assemblies in the associated core quadrant.</p> <p>Verify count rate is either:</p> <p>a. $\geq [3.0]$ cps with a signal to noise ratio $\geq [2:1]$ or</p> <p>b. $\geq [0.7]$ cps with a signal to noise ratio $\geq [20:1]$.</p>	<p>12 hours during CORE ALTERATIONS</p> <p>AND</p> <p>24 hours</p>
<p>SR 3.3.1.2.5</p> <p>Perform CHANNEL FUNCTIONAL TEST [and determination of signal to noise ratio].</p>	<p>7 days</p>
<p>SR 3.3.1.2.6</p> <p style="text-align: center;">- NOTE -</p> <p>Not required to be performed until 12 hours after IRMs on Range 2 or below.</p> <p>Perform CHANNEL FUNCTIONAL TEST [and determination of signal to noise ratio].</p>	<p>31 days</p>
<p>SR 3.3.1.2.7</p> <p style="text-align: center;">- NOTES -</p> <p>1. Neutron detectors are excluded.</p> <p>2. Not required to be performed until 12 hours after IRMs on Range 2 or below.</p> <p>Perform CHANNEL CALIBRATION.</p>	<p>[18] months</p>

BASES

ACTIONS (continued)

Action (once required to be initiated) to insert control rods must continue until all insertable rods in core cells containing one or more fuel assemblies are inserted.

SURVEILLANCE
REQUIREMENTS

The SRs for each SRM Applicable MODE or other specified condition are found in the SRs column of Table 3.3.1.2-1.

SR 3.3.1.2.1 and SR 3.3.1.2.3

Performance of the CHANNEL CHECK ensures that a gross failure of instrumentation has not occurred. A CHANNEL CHECK is normally a comparison of the parameter indicated on one channel to the same parameter indicated on other similar channels. It is based on the assumption that instrument channels monitoring the same parameter should read approximately the same value. Significant deviations between the instrument channels could be an indication of excessive instrument drift in one of the channels or something even more serious. A CHANNEL CHECK will detect gross channel failure; thus, it is key to verifying the instrumentation continues to operate properly between each CHANNEL CALIBRATION.

Agreement criteria are determined by the plant staff, based on a combination of the channel instrument uncertainties, including indication and readability. If a channel is outside the criteria, it may be an indication that the instrument has drifted outside its limit.

The Frequency of once every 12 hours for SR 3.3.1.2.1 is based on operating experience that demonstrates channel failure is rare. While in MODES 3 and 4, reactivity changes are not expected; therefore, the 12 hour Frequency is relaxed to 24 hours for SR 3.3.1.2.3. The CHANNEL CHECK supplements less formal, but more frequent, checks of channels during normal operational use of the displays associated with the channels required by the LCO.

Insert 1

SR 3.3.1.2.2

To provide adequate coverage of potential reactivity changes in the core, one SRM is required to be OPERABLE in the quadrant where CORE ALTERATIONS are being performed, and the other OPERABLE SRM must be in an adjacent quadrant containing fuel. Note 1 states that this SR is required to be met only during CORE ALTERATIONS. It is not required to be met at other times in MODE 5 since core reactivity changes are not occurring. This Surveillance consists of a review of plant

BASES

SURVEILLANCE REQUIREMENTS (continued)

logs to ensure that SRMs required to be OPERABLE for given CORE ALTERATIONS are, in fact, OPERABLE. In the event that only one SRM is required to be OPERABLE, per Table 3.3.1.2-1, footnote (b), only the a. portion of this SR is required. Note 2 clarifies that more than one of the three requirements can be met by the same OPERABLE SRM. The 12 hour Frequency is based upon operating experience and supplements operational controls over refueling activities, which include steps to ensure that the SRMs required by the LCO are in the proper quadrant.

SR 3.3.1.2.4

This Surveillance consists of a verification of the SRM instrument readout to ensure that the SRM reading is greater than a specified minimum count rate. This ensures that the detectors are indicating count rates indicative of neutron flux levels within the core. With few fuel assemblies loaded, the SRMs will not have a high enough count rate to satisfy the SR. Therefore, allowances are made for loading sufficient "source" material, in the form of irradiated fuel assemblies, to establish the minimum count rate.

To accomplish this, the SR is modified by a Note that states that the count rate is not required to be met on an SRM that has less than or equal to four fuel assemblies adjacent to the SRM and no other fuel assemblies are in the associated core quadrant. With four or less fuel assemblies loaded around each SRM and no other fuel assemblies in the associated quadrant, even with a control rod withdrawn the configuration will not be critical.

The Frequency is based upon channel redundancy and other information available in the control room, and ensures that the required channels are frequently monitored while core reactivity changes are occurring. When no reactivity changes are in progress, the Frequency is relaxed from 12 hours to 24 hours.

Insert 2

SR 3.3.1.2.5 and SR 3.3.1.2.6

Performance of a CHANNEL FUNCTIONAL TEST demonstrates the associated channel will function properly. A successful test of the required contact(s) of a channel relay may be performed by the verification of the change of state of a single contact of the relay. This clarifies what is an acceptable CHANNEL FUNCTIONAL TEST of a relay. This is acceptable because all of the other required contacts of the relay are verified by other Technical Specifications and non-Technical