

- a. Surveillance Requirement 4.1.A.2 - RPS Logic System  
Functional Test
- b. Surveillance Requirement 4.1.A.2 - Primary & Secondary  
Containment Logic System  
Functional Test
- c. Surveillance Requirement 4.2.J.2 - Feedwater Pump trip Logic  
System Functional Test
- d. Surveillance Requirement 4.6.F.1.b - Relief Value Logic System  
Functional Test
- e. Surveillance Requirement 4.9.A.9 - Simultaneous Diesel  
Generator Start
- f. Surveillance Requirement 4.9.A.10 - Diesel Storage Tank  
Cleaning (Unit 3 and  
Unit 2/3 only)

Each of the above Surveillance Requirements shall be successfully demonstrated prior to entering into MODE 2 on the first plant startup following the fifteenth refueling outage (D2R15).

(7) Additional Conditions

The Additional Conditions contained in Appendix B, as revised through Amendment No. 163, are hereby incorporated into this license. The licensee shall operate the facility in accordance with the Additional Conditions.

(8) Deleted

(9) Fuel Burnup

The maximum rod average burnup for any rod shall be limited to 60 GWD/MTU until the completion of an NRC environmental assessment supporting an increased limit.

- K. Deleted.
- L. Deleted. [Amdt. 87, 7-24-86]
- M. Deleted. [Amdt. 85, 12-12-85]
- N. By Amendment No. 144, the license is amended to allow, on a one time temporary basis, operation of Dresden, Unit 3, with the corner room structural steel members in the Low Pressure Coolant Injection Corner Rooms outside the Undated Final Safety Analysis Report (UFSAR) design parameters. Operation under these conditions is allowed up to and including the next scheduled refueling outage (D3R14).

The repairs to Dresden, Unit 3, corner room structural steel shall restore the steel design margins to the current UFSAR (updated through Revision 1A) design criteria. The design of the modifications to the Dresden, Unit 3, corner room structural steel members will be based on use of elastic section modules and the structural steel stresses will be limited to 1.6 of the American Institute of Steel Construction (AISC allowables). The modifications to Dresden, Unit 3, corner room structural steel will be implemented during the upcoming D3R14 refueling outage.

During this interim period of operation, should vibratory ground motion exceeding the UFSAR Operating Basis Earthquake (OBE) design parameters, Dresden, Unit 3, will be shut down for inspection and will not start up without prior NRC approval.

O. Additional Conditions

The Additional Conditions contained in Appendix B, as revised through Amendment No. 158, are hereby incorporated into this license. The licensee shall operate the facility in accordance with the Additional Conditions.

P. Deleted

Q. Fuel Burnup

The maximum rod average burnup for any rod shall be limited to 60 CWD/MTU until the completion of an NRC environmental assessment supporting an increased limit.

- R. Exelon Generation Company, LLC shall provide the Director of the Office of Nuclear Reactor Regulation, a copy of any application, at the time it is filed, to transfer (excluding grants of security interests or liens) from Exelon Generation Company, LLC to its direct or indirect parent, or to any other affiliated company, facilities for the production, transmission, or distribution of electric energy having a depreciated book value exceeding ten percent (10%) of Exelon Generation Company, LLC's consolidated net utility plant, as recorded on Exelon Generation Company, LLC's books of account.

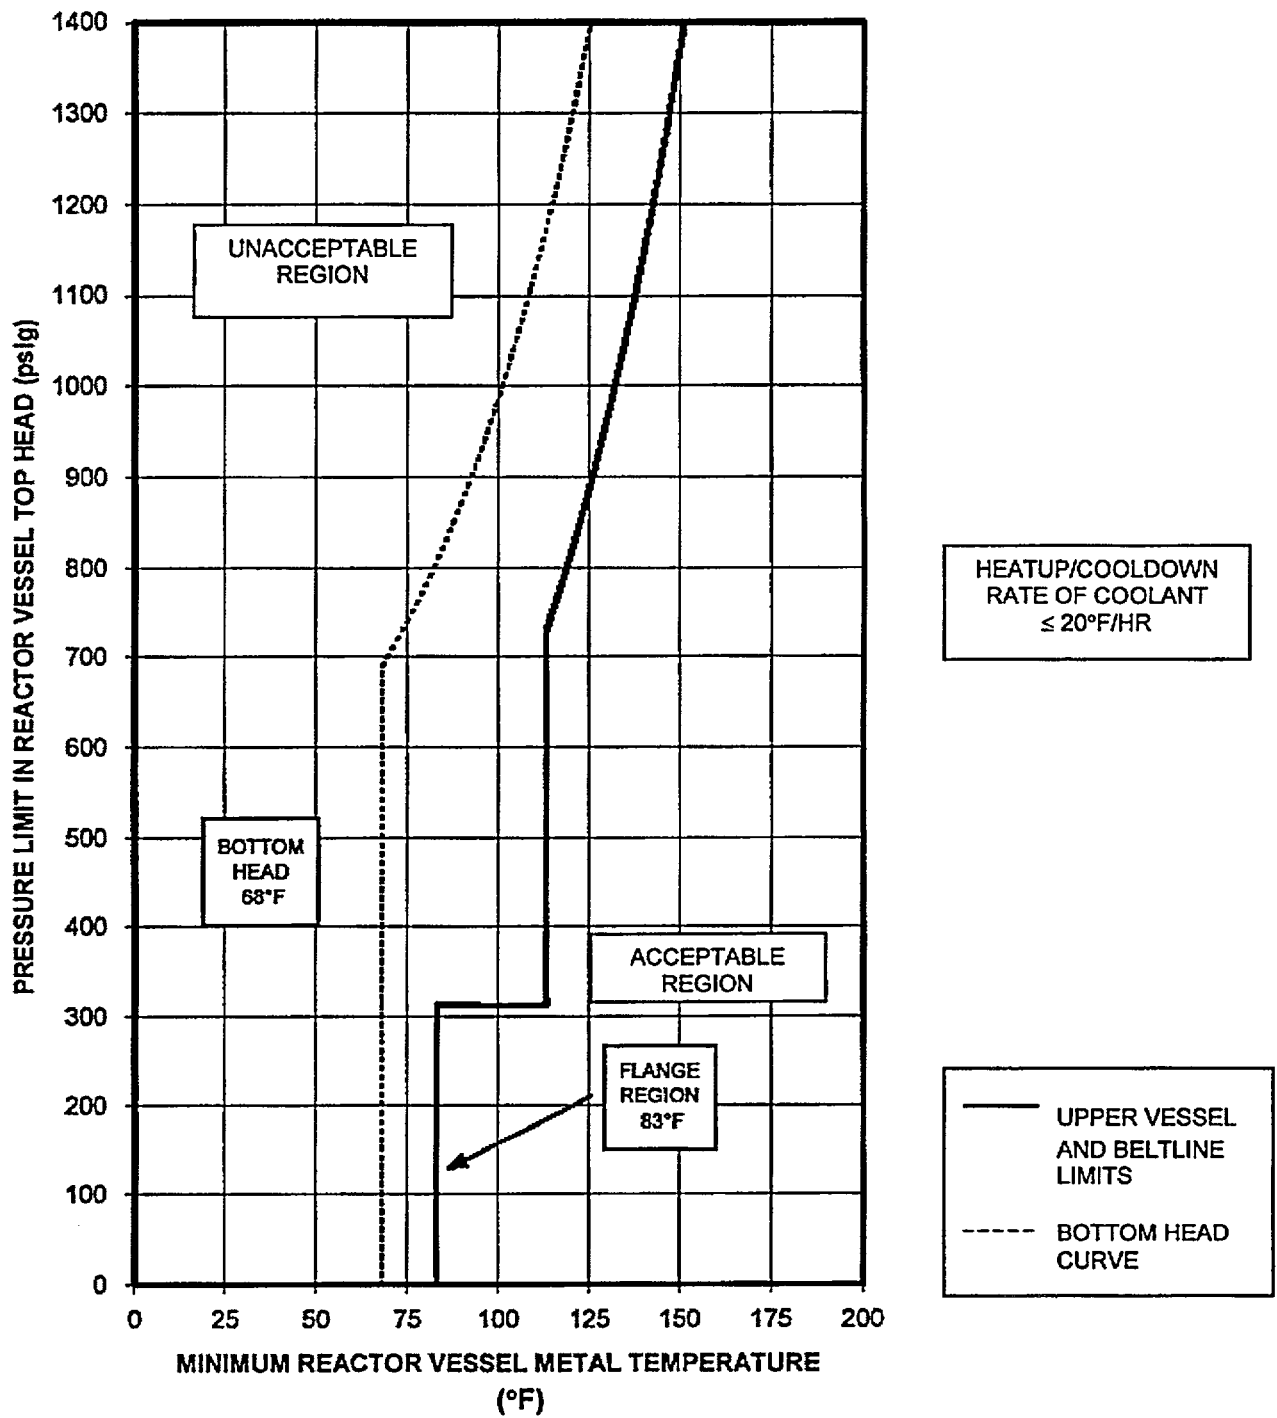


Figure 3.4.9-1 (Page 1 of 1)  
Non-Nuclear Inservice Leak and Hydrostatic Testing Curve  
(Valid to 32 EFY)

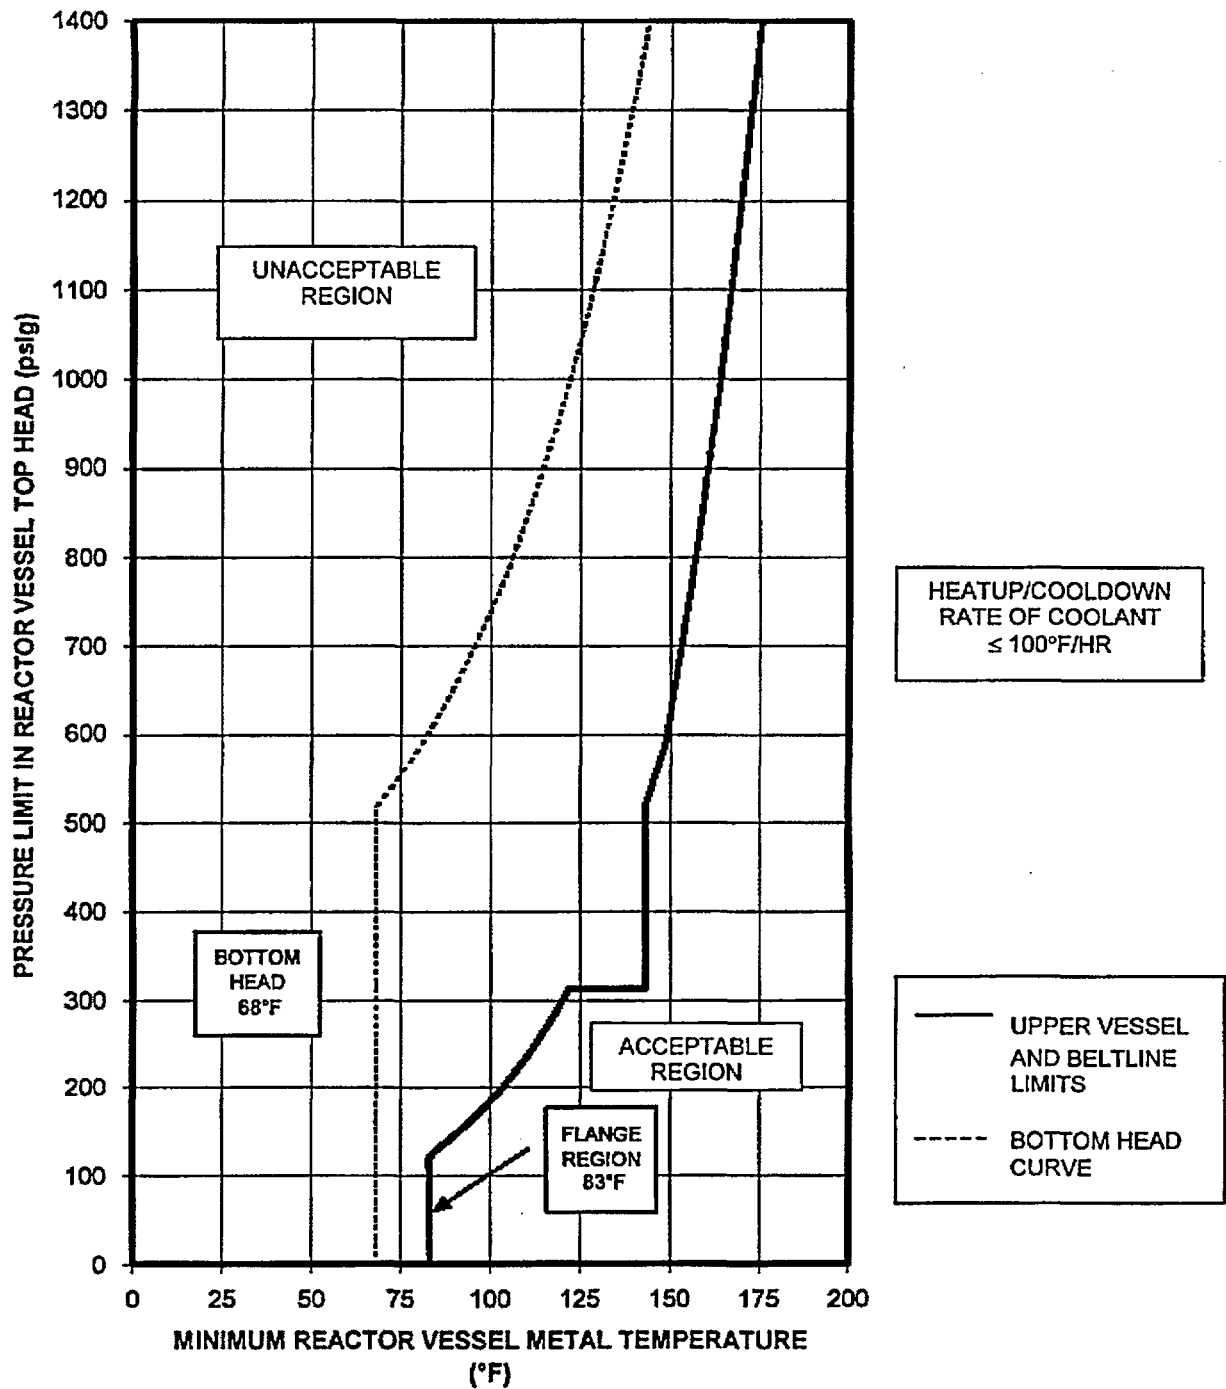


Figure 3.4.9-2 (Page 1 of 1)  
Non-Nuclear Heatup/Cooldown Curve  
(Valid to 32 EFY)

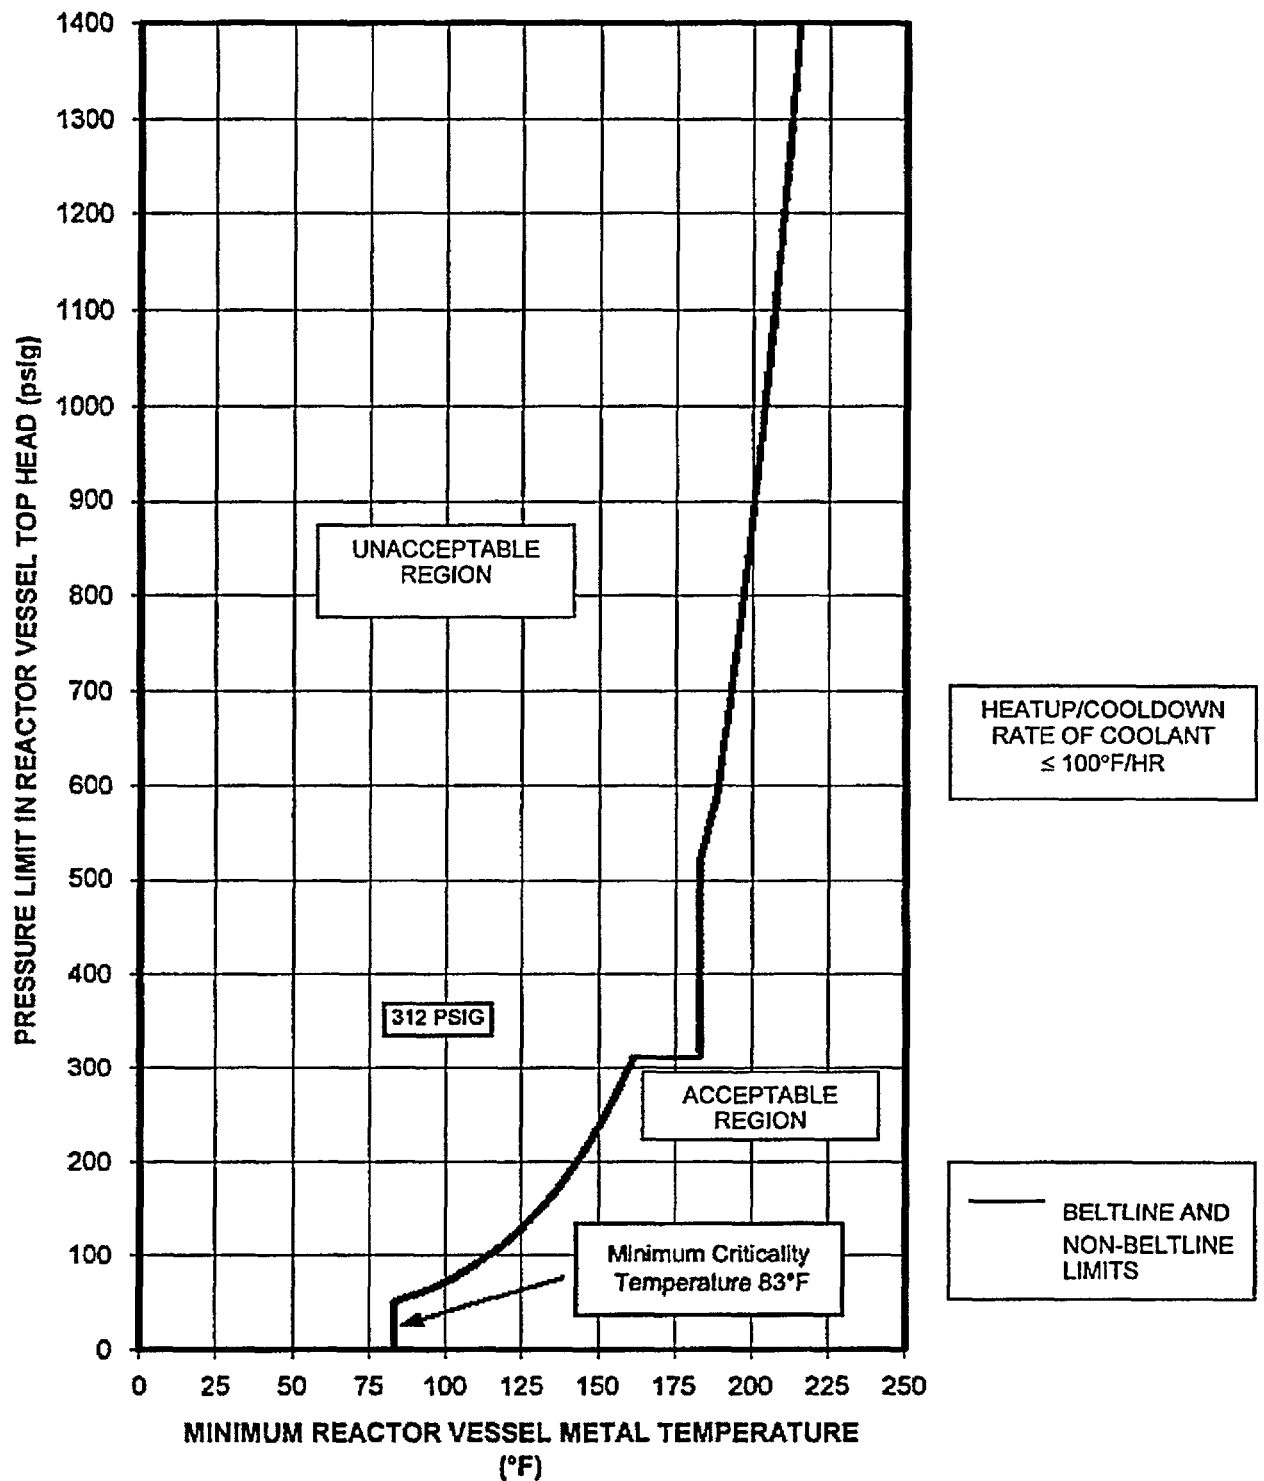


Figure 3.4.9-3 (Page 1 of 1)  
Critical Operations Curve  
(Valid to 32 EFPY)