



MAY 14 2004

L-PI-04-061  
TS 5.6.2  
ISFSI TS 6.2

U S Nuclear Regulatory Commission  
ATTN: Document Control Desk  
Washington, DC 20555

Prairie Island Nuclear Generating Plant Units 1 and 2  
Dockets 50-282, 50-306 and 72-10  
License Nos. DPR-42, DPR-60 and SNM-2506

2003 Annual Radiological Environmental Monitoring Report

Pursuant to Prairie Island Nuclear Generating Plant Technical Specification (PI TS) 5.6.2, Appendix A to Operating Licenses DPR-42 and DPR-60, and pursuant to Prairie Island Independent Spent Fuel Storage Installation Technical Specification (ISFSI TS) 6.2, Appendix A to Materials License SNM-2506, the Nuclear Management Company, LLC submits one copy of the Annual Radiological Environmental Monitoring Report for the period January 1, 2003 through December 31, 2003.

Summary of Commitments

This letter contains no new commitments and no revisions to existing commitments.

Please address any comments or questions regarding this letter to Mr. Jack Leveille at 651-388-1121.

*Richard Graham for*

Joseph M. Solymossy  
Site Vice-President, Prairie Island Nuclear Generating Plant Units 1 and 2  
Nuclear Management Company, LLC

Enclosure (1)

CC Regional Administrator, USNRC, Region III  
Project Manager, Prairie Island Nuclear Generating Plant, USNRC, NRR  
NRC Resident Inspector – Prairie Island Nuclear Generating Plant  
Dr. John House, USNRC, Region III  
Director of NMSS, USNRC  
Tim Donakowski, State of Minnesota


**ENCLOSURE 1**

**Annual report to the United States Nuclear Regulatory Commission**

**Radiation Environmental Monitoring Program**

**January 1 to December 31, 2003**

**(64 pages follow)**



Environmental, Inc.  
Midwest Laboratory  
an Allegheny Technologies Co.

700 Landwehr Road • Northbrook, IL 60062-2310  
ph. (847) 564-0700 • fax (847) 564-4517

XCEL ENERGY CORPORATION  
PRAIRIE ISLAND NUCLEAR GENERATING PLANT

Docket No. 50-282  
50-306

License No. DPR-42  
DPR-60

ISFSI  
Docket No. 72-10

SNM-2506

ANNUAL REPORT  
TO THE  
UNITED STATES NUCLEAR REGULATORY COMMISSION

Radiation Environmental Monitoring Program


January 1 to December 31, 2003

Prepared under Contract by

ENVIRONMENTAL, Inc.  
MIDWEST LABORATORY

Project No. 8010

Approved:

  
\_\_\_\_\_  
Bronia Grob, M.S.  
Laboratory Manager

## PREFACE

The staff of Environmental, Inc., Midwest Laboratory was responsible for the acquisition of data presented in this report. Samples were collected by members of the staff of the Prairie Island Nuclear Generating Plant, operated by Nuclear Management Company, LLC for XCEL Energy Corporation. The report was prepared by Environmental, Inc., Midwest Laboratory.

## TABLE OF CONTENTS

<u>Section</u>	<u>Page</u>
Preface .....	ii
List of Tables .....	iv
List of Figures .....	v
1.0 INTRODUCTION .....	1
2.0 SUMMARY .....	2
3.0 RADIATION ENVIRONMENTAL MONITORING PROGRAM (REMP) .....	3
3.1 Program Design and Data Interpretation .....	3
3.2 Program Description .....	4
3.3 Program Execution .....	5
3.4 Laboratory Procedures .....	5
3.5 Program Modifications .....	6
3.6 Land Use Census .....	6
4.0 RESULTS AND DISCUSSION .....	7
4.1 Atmospheric Nuclear Detonations and Nuclear Accidents .....	7
4.2 Summary of Preoperational Data .....	7
4.3 Program Findings .....	8
5.0 FIGURES AND TABLES .....	12
6.0 REFERENCES CITED .....	25
 <u>APPENDICES</u>	
A Interlaboratory Comparison Program Results .....	A-1
Attachment 1, Acceptance Criteria for "Spiked" Samples .....	A-2
B Data Reporting Conventions.....	B-1
C Maximum Permissible Concentrations of Radioactivity in Air and Water Above Natural Background in Unrestricted Areas.....	C-1
D Sampling Location Maps .....	D-1

## LIST OF TABLES

<u>No.</u>	<u>Title</u>	<u>Page</u>
5.1	Sample Collection and Analysis Program.....	15
5.2	Sampling Locations.....	16
5.3	Missed Collections and Analyses .....	19
5.4	Radiation Environmental Monitoring Program Summary.....	20

In addition, the following tables are in the Appendices:

### Appendix A

A-1	U.S. Environmental Protection Agency's Crosscheck Program results.....	A1-1
A-2	Crosscheck Program Results; (TLDs).....	A2-1
A-3	In-house "Spiked" Samples .....	A3-1
A-4	In-house "Blank" Samples .....	A4-1
A-5	In-house "Duplicate" Samples.....	A5-1
A-6	Department of Energy MAPEP comparison results.....	A6-1
A-7	Environmental Measurements Laboratory Quality (EML) Assessment Program comparison results.....	A7-1

### Appendix C

C-1	Maximum Permissible Concentrations of Radioactivity in Air and Water Above Natural Background in Unrestricted Areas .....	C-2
-----	------------------------------------------------------------------------------------------------------------------------------	-----

## LIST OF FIGURES

<u>No.</u>	<u>Title</u>	<u>Page</u>
5.1	Offsite Ambient Radiation (TLDs), average of inner and outer ring indicator locations versus control .....	13
5.2	Airborne Particulates; analysis for gross beta, average mean of all indicator locations (P-2,3,4,6) versus control location (P-1) .....	14

## 1.0 INTRODUCTION

This report summarizes and interprets results of the Radiation Environmental Monitoring Program (REMP) conducted by Environmental, Inc., Midwest Laboratory at the Prairie Island Nuclear Generating Plant, Red Wing, Minnesota, during the period January - December, 2003. This program monitors the levels of radioactivity in the air, terrestrial, and aquatic environments in order to assess the impact of the plant on its surroundings.

Tabulations of the individual analyses made during the year are not included in this report. These data are included in a reference document (Environmental, Inc., Midwest Laboratory, 2004b) available at Prairie Island Nuclear Generating Plant.

Prairie Island Nuclear Generating Plant is located on the Mississippi River in Goodhue County, Minnesota, owned by Xcel Energy Corporation and operated by Nuclear Management Company, LLC. The plant has two 575 MWe pressurized water reactors. Unit 1 achieved initial criticality on 1 December 1973. Commercial operation at full power began on 16 December 1973. Unit 2 achieved initial criticality on 17 December 1974. Commercial operation at full power began on 21 December 1974.



## 2.0 SUMMARY

The Radiation Environmental Monitoring Program (REMP) required by the U.S. Nuclear Regulatory Commission (NRC) Technical Specifications for the Prairie Island Nuclear Generating Plant and the Independent Spent Fuel Storage Installation (ISFSI) is described. Results for 2003 are summarized and discussed.

Program findings show background levels of radioactivity in the environmental samples collected in the vicinity of the Prairie Island Nuclear Generating Plant.

### 3.0 RADIATION ENVIRONMENTAL MONITORING PROGRAM (REMP)

#### 3.1 Program Design and Data Interpretation

The purpose of the Radiation Environmental Monitoring Program (REMP) at the Prairie Island Nuclear Generating Plant is to assess the impact of the plant on its environment. For this purpose, samples are collected from the air, terrestrial, and aquatic environments and analyzed for radioactive content. In addition, ambient gamma radiation levels are monitored by thermoluminescent dosimeters (TLDs).

Sources of environmental radiation include the following:

- (1) Natural background radiation arising from cosmic rays and primordial radionuclides;
- (2) Fallout from atmospheric nuclear detonations;
- (3) Releases from nuclear power plants;
- (4) Industrial and medical radioactive waste; and
- (5) Fallout from nuclear accidents.

In interpreting the data, effects due to the plant must be distinguished from those due to other sources.

A major interpretive aid in assessment of these effects is the design of the monitoring program at the Prairie Island Plant which is based on the indicator-control concept. Most types of samples are collected both at indicator locations (nearby, downwind, or downstream) and at control locations (distant, upwind, or upstream). A plant effect would be indicated if the radiation level at an indicator location was significantly larger than that at the control location. The difference would have to be greater than could be accounted for by typical fluctuations in radiation levels arising from other sources.

An additional interpretive technique involves analyses for specific radionuclides present in the environmental samples collected from the plant site. The plant's monitoring program includes analyses for tritium and iodine-131. Most samples are also analyzed for gamma-emitting isotopes with results for the following groups quantified: zirconium-95, cesium-137, cerium-144, beryllium-7, and potassium-40. The first three gamma-emitting isotopes were selected as radiological impact indicators because of the different characteristic proportions in which they appear in the fission product mix produced by a nuclear reactor and that produced by a nuclear detonation. Each of the three isotopes is produced in roughly equivalent amounts by a reactor: each constitutes about 10% of the total activity of fission products 10 days after reactor shutdown. On the other hand, 10 days after a nuclear explosion, the contributions of zirconium-95, cerium-144, and cesium-137 to the activity of the resulting debris are in the approximate ratio 4:1:0.03 (Eisenbud, 1963). Beryllium-7 is of cosmogenic origin and potassium-40 is a naturally-occurring isotope. They were chosen as calibration monitors and should not be considered radiological impact indicators.

The other group quantified consists of niobium-95, ruthenium-103 and -106, cesium-134, barium-lanthanum-140, and cerium-141. These isotopes are released in small quantities by nuclear power plants, but to date their major source of injection into the general environment has been atmospheric nuclear testing. Nuclides of the final group, manganese-54, iron-59, cobalt-58 and -60, and zinc-65, are activation products and arise from activation of corrosion products. They are typical components of a nuclear power plant's effluents, but are not produced in significant quantities by nuclear detonations.

### 3.1 Program Design and Data Interpretation (continued)

Other means of distinguishing sources of environmental radiation are employed in interpreting the data. Current radiation levels are compared with previous levels, including those measured before the Plant became operational. Results of the plant's monitoring program can be related to those obtained in other parts of the world. Finally, results can be related to events known to cause elevated levels of radiation in the environment, e.g., atmospheric nuclear detonations.

### 3.2 Program Description

The sampling and analysis schedule for the radiation environmental monitoring program at Prairie Island is summarized in Table 5.1 and briefly reviewed below. Table 5.2 defines the sampling location codes used in Table 5.1 and specifies for each location its type (indicator or control) and its distance, direction, and sector relative to the reactor site or ISFSI facility, as appropriate. To assure that sampling is carried out in a reproducible manner, detailed sampling procedures have been prescribed (Prairie Island Nuclear Generating Plant, 2003). Maps of fixed sampling locations are included in Appendix D.

To monitor the air environment, airborne particulates are collected on membrane filters by continuous pumping at five locations. Airborne iodine is collected by continuous pumping through charcoal filters at these same locations. Filters are changed and counted weekly. Particulate filters are analyzed for gross beta activity and charcoal filters for iodine-131. Quarterly composites of particulate filters from each location are determined by gamma spectroscopy. One of the five locations is a control (P-1), and four are indicators (P-2, P-3, P-4, and P-6).

Offsite ambient gamma radiation is monitored at thirty-four locations, using  $\text{CaSO}_4:\text{Dy}$  dosimeters with four sensitive areas at each location: ten in an inner ring in the general area of the site boundary, fifteen in the outer ring within a 4-5 mile radius, eight at special interest locations, and one control location, 11.1 miles distant from the plant. They are replaced and measured quarterly. Also, a complete emergency set of TLDs for the inner ring, outer ring and special interest locations are placed in the field at the same time as regular sets. The emergency set is returned to EIML quarterly for annealing and repackaging.

Ambient gamma radiation is monitored at the Independent Spent Fuel Storage Installation (ISFSI) Facility by twenty  $\text{CaSO}_4:\text{Dy}$  dosimeters. Twelve dosimeters are located inside of the earthen berm in direct line of sight from the storage casks and eight dosimeters are located outside of the earthen berm. They are replaced and measured quarterly.

Milk samples are collected monthly from five farms (four indicator and one control) and analyzed for iodine-131 and gamma-emitting isotopes. The milk is collected biweekly during the growing season (May - October), because the milk animals may be on pasture.

For additional monitoring of the terrestrial environment, green leafy vegetables (cabbage) are collected annually from the highest D/Q garden and a control location (P-38), and analyzed for gamma-emitting isotopes, including iodine-131. Corn is collected annually only if fields are irrigated with river water and analyzed for gamma-emitting isotopes. Well water and ground water are collected quarterly from four locations near the plant and analyzed for tritium and gamma-emitting isotopes.

River water is collected weekly at two locations, one upstream of the plant (P-5) and one downstream (P-6, Lock and Dam No.3). Monthly composites are analyzed for gamma-emitting isotopes. Quarterly composites are analyzed for tritium.

### 3.2 Program Description (continued)

Drinking water is collected weekly from the City of Red Wing well. Monthly composites are analyzed for gross beta, iodine-131, and gamma-emitting isotopes. Quarterly composites are analyzed for tritium.

The aquatic environment is also monitored by semi-annual upstream and downstream collections of fish, periphyton or invertebrates, and bottom sediments. Shoreline sediment is collected semi-annually from one location. All samples are analyzed for gamma-emitting isotopes.

### 3.3 Program Execution

The Program was executed as described in the preceding section with the following exceptions:

- (1) A partial air particulate/air iodine sample was collected from location P-1, the week ending 10-14-03. The low volume was due to sampler pump failure.
- (2) No air particulate/air iodine sample was available from location P-6 for the week ending 11-14-03, due to a sampler pump failure.
- (3) Milk samples were not available from P-37 (Welsch Farm) for the months of January, February and March of 2003.

Deviations from the program are summarized in Table 5.3.

### 3.4 Laboratory Procedures

Analyses for iodine-131 in milk and drinking water utilize a sensitive radiochemical procedure involving the separation of the element by ion-exchange and subsequent beta counting. Gamma-spectroscopic analysis is performed using a high-purity germanium (HPGe) detector. Levels of airborne iodine-131 in charcoal samples are measured by gamma spectroscopy.

Levels of iodine-131 in cabbage are determined by gamma spectrometry.

Tritium levels are determined by liquid scintillation technique.

Analytical Procedures used by Environmental, Inc. are on file and are available for inspection. Procedures are based on those prescribed by the Health and Safety Laboratory of the U.S. Dep't of Energy, Edition 28, 1997, U.S. Environmental Protection Agency for Measurement of Radioactivity in Drinking Water, 1980, and the U.S. Environmental Protection Agency, EERF, Radiochemical Procedures Manual, 1984.

Environmental, Inc., Midwest Laboratory has a comprehensive quality control/quality assurance program designed to assure the reliability of the data obtained. Details of the Quality Assurance Program are presented elsewhere (Environmental, Inc., Midwest Laboratory, 2003). The program includes participation in Interlaboratory Comparison (Crosscheck) programs and results are presented in Appendix A.

### 3.5 Program Modifications

One extra garden location was sampled for broadleaf vegetation in 2003.

### 3.6 Land Use Census

In accordance with the Prairie Island Nuclear Generating Plant Offsite Dose Calculation Manual, H4, (ODCM) a land use census is conducted in order to identify the location of the nearest milk animal, the nearest residence, and the nearest garden of greater than 500 ft<sup>2</sup> producing fresh leafy vegetables in each of the 16 meteorological sectors within a distance of 5 miles. This census is conducted at least once per 12 months between the dates of May 1 and October 31. If new locations yield a calculated dose or dose equivalent (via the same exposure pathway) twenty percent greater than the required locations per the ODCM, then the new locations are added to the radiation environmental monitoring program within 30 days, and sampling locations having lower calculated doses or a lower dose commitment may be deleted from this monitoring program after October 31 of the year in which the land use census was conducted.

This land use census insures the updating of the radiation environmental monitoring program should sampling locations change within the 5 mile radius from the plant.

The 2003 Land Use Census was completed in September, 2003. There were no changes in any of the highest D/Q locations for dairy, nearest residence, or garden sites in 2003. The critical receptor location did not change in 2003, based on the results of the land use census.

No downstream irrigation of corn was discovered within 5 miles of the Prairie Island Plant. Therefore, no corn samples were collected for analysis.

## 4.0 RESULTS AND DISCUSSION

All scheduled collections and analyses were made except those listed in Table 5.3.

The results are summarized in Table 5.4 in a format recommended by the Nuclear Regulatory Commission in Regulatory Guide 4.8. For each type of analysis of each sampled medium, this table lists the mean and range for all indicator locations and for all control locations. The locations with the highest mean and range are also shown.

### 4.1 Atmospheric Nuclear Detonations and Nuclear Accidents

There were no reported atmospheric nuclear tests in 2003. The last reported test was conducted on October 16, 1980 by the People's Republic of China. There were no reported accidents involving a release to the environment at nuclear reactor facilities in 2003.

### 4.2 Summary of Preoperational Data

The following constitutes a summary of preoperational studies conducted at the Prairie Island Nuclear Power Plant during the years 1970 to 1973, to determine background levels expected in the environment, and provided, where applicable, as a means for comparison with present day levels. Strict comparisons, however, are difficult, since background levels of radiation were much higher in these years due to radioactive fallout from the atmosphere. Gross beta measurements in fallout declined yearly from a level of  $12,167 \text{ pCi/m}^2$  to  $1,020 \text{ pCi/m}^2$ , and these declining values are reflected throughout the various media tested.

In the air environment, ambient gamma radiation (TLDs) averaged  $9.4 \text{ mR/4 weeks}$  during preoperational studies. Gross beta in air particulates declined from levels of 0.38 to  $0.037 \text{ pCi/m}^3$ . Average present day levels have stabilized at around  $0.025 \text{ pCi/m}^3$ . Airborne radioiodine remained below detection levels.

In the terrestrial environment of 1970 to 1973, milk, agricultural crops, and soil were monitored. In milk samples, low levels of Cs-137, I-131, and Sr-90 were detected. Cs-137 levels declined from 16.5 to  $8.6 \text{ pCi/L}$ . Present day measurements for both Cs-137 and I-131 are below detection levels. Agricultural crop measurements averaged  $57.7 \text{ pCi/g}$  for gross beta and  $0.47 \text{ pCi/g}$  for Cs-137. Gross beta measured in soil averaged  $52 \text{ pCi/g}$ .

The aqueous environment was monitored by testing of river, well and lake waters, bottom sediments, fish, aquatic vegetation and periphyton. Specific location comparison of drinking, river and well water concentrations for tritium and gross beta are not possible. However, tritium background levels, measured at eight separate locations, declined steadily from an average concentration of  $1020 \text{ pCi/L}$  to  $490 \text{ pCi/L}$ . Present day environmental levels of tritium are below detection limits. Values for gross beta, measured from 1970 to 1973, averaged  $9.9 \text{ pCi/L}$  in downstream Mississippi River water,  $8.2 \text{ pCi/L}$  for well water, and  $11.0 \text{ pCi/L}$  for lake water. Gamma emitters were below the lower limit of detection (LLD). In bottom sediments, gross beta background levels were determined at  $51.0 \text{ pCi/g}$ . Cs-137 activity during preoperational studies in 1973 measured  $0.25 \text{ pCi/g}$  upstream and  $0.21 \text{ pCi/g}$  downstream. The lower levels occasionally observed today can still be attributed to residual activity from atmospheric fallout. Gross beta in fish, measured in both flesh and skeletal samples, averaged 7.3 and  $11.7 \text{ pCi/g}$ , respectively. Gross beta background levels in aquatic vegetation, algae and periphyton samples measured  $76.0 \text{ pCi/g}$ ,  $46.0 \text{ pCi/g}$ , and  $13.6 \text{ pCi/g}$ , respectively.

#### 4.3 Program Findings

Slight tritium activity was detected in two downstream river water composites (pg. 11). It was determined that the collections coincided with planned radioactive discharges from the plant. All other results indicate background levels of radioactivity in environmental samples collected in the vicinity of the Prairie Island Nuclear Generating Plant.

##### Ambient Radiation (TLDs)

Ambient radiation was measured in the general area of the site boundary, at the outer ring 4 - 5 mi distant from the Plant, at special interest areas and at one control location. The means ranged from 15.4 mR/91 days at inner ring locations to 16.7 mR/91 days at outer ring locations. The mean at special locations was 15.5 mR/91 days and 16.0 mR/91 days at the control location. The dose rates measured at the inner and outer ring and the control locations were similar to those observed from 1988 through 2002. The results are tabulated below. No plant effect on ambient gamma radiation was indicated (Figure 5-1).

Year	Average (Inner and Outer Rings)	Control
1988	15.4	16.0
1989	16.5	16.7
1990	15.9	16.3
1991	14.9	14.5
1992	16.3	14.8
1993	15.9	15.4
1994	15.2	16.0
1995	15.6	16.6
1996	14.8	16.4
1997	15.1	16.0
1998	16.7	17.3
1999	16.6	17.5
2000	17.0	17.1
2001	16.8	17.2
2002	17.4	16.9
2003	16.2	16.0

Ambient gamma radiation as measured by thermoluminescent dosimetry.  
Average quarterly dose rates (mR/91 days).

##### ISFSI Facility Operations Monitoring

Ambient radiation was measured inside the ISFSI earth berm, outside the ISFSI earth berm and at two special locations between the plant ISFSI and the Prairie Island Indian Community. The mean dose rates measured 79.7 mR/91 days inside the ISFSI earth berm and 18.9 mR/91 days outside the ISFSI earth berm. No additional casks were placed on the ISFSI pad in 2003, a total of seventeen loaded casks remain. The higher levels inside the earth berm are expected, due to the loaded spent fuel casks being in direct line-of-sight of the TLDs. The ambient radiation levels measured outside the earth berm show a slight increase as compared to other offsite dose rates around the plant. If the dose rates outside the earth berm are an indication of gamma skyshine from the casks, they are consistent with predictions given in the ISFSI Safety Analysis Report, Table 7A-7, "Total Skyshine Dose Rate". The cumulative average of the two special Prairie Island Indian Community TLDs measured 14.8 and 14.3 mR/91 days. Although the skyshine neutron dose rates are not directly measured, the neutron levels measured next to the casks are below the levels predicted in the ISFSI SAR Report, Table 7A-4, "TN-40 Dose Rates at Short Distances". Therefore, the skyshine dose rates at farther distances from the casks should be at or below the calculated dose rates. No spent fuel storage effect on offsite ambient gamma radiation was indicated (Fig. 5-1).

### Airborne Particulates

The average annual gross beta concentrations in airborne particulates were slightly higher at the indicator versus the control locations (0.027 pCi/m<sup>3</sup> and 0.025 pCi/m<sup>3</sup>, respectively) and similar to levels observed from 1988 through 2002. The results are tabulated below.

Year	Average of Indicators	Control
Concentration (pCi/m <sup>3</sup> )		
1988	0.030	0.030
1989	0.028	0.027
1990	0.024	0.023
1991	0.025	0.025
1992	0.023	0.021
1993	0.022	0.019
1994	0.022	0.022
1995	0.022	0.022
1996	0.023	0.020
1997	0.021	0.021
1998	0.022	0.018
1999	0.024	0.022
2000	0.025	0.025
2001	0.023	0.023
2002	0.028	0.023
2003	0.027	0.025

Average annual gross beta concentrations in airborne particulates.

A spring peak in beta activity had been observed almost annually for many years (Wilson *et al.*, 1969). It had been attributed to fallout of nuclides from the stratosphere (Gold *et al.*, 1964). It was pronounced in 1981, occurred to a lesser degree in 1982, and has not occurred since 1983. Typically, the highest averages for gross beta occur during the months of January and December, and the first and fourth quarters, as in 1988 through 2003.

Two pieces of evidence indicate conclusively that the elevated activity observed during the winter months was not attributable to the Plant operation. In the first place, elevated activity of similar size occurred simultaneously at both indicator and control locations. Secondly, an identical pattern was observed at the Monticello Nuclear Generating Plant, about 100 miles distant from the Prairie Island Nuclear Generating Plant (Xcel Energy Corp., 2004).

Gamma spectroscopic analysis of quarterly composites of air particulate filters yielded similar results for indicator and control locations. Beryllium-7, which is produced continuously in the upper atmosphere by cosmic radiation (Arnold and Al-Salih, 1955), was detected in all samples. All other gamma-emitting isotopes were below their respective LLD limits.

### Airborne Iodine

Weekly levels of airborne iodine-131 were below the lower limit of detection (LLD) of 0.07 pCi/m<sup>3</sup> in all samples. There was no indication of a plant effect.



### Milk

Iodine-131 results were below the detection limit of 1.0 pCi/L in all samples. Cs-137 results were below the LLD level of 15 pCi/L in all samples. No other gamma-emitting isotopes, except naturally-occurring potassium-40, were detected in any milk samples. This is consistent with the findings of the National Center for Radiological Health that most radiocontaminants in feed do not find their way into milk due to the selective metabolism of the cow. The common exceptions are radioisotopes of potassium, cesium, strontium, barium, and iodine (National Center for Radiological Health, 1968).

In summary, the milk data for 2003 show no radiological effects of the plant operation.

### Drinking Water

In drinking water from the City of Red Wing well, tritium activity measured below the LLD level of 182 pCi/L in all samples.

Gross beta concentrations averaged 9.9 pCi/L throughout the year, ranging from 8.1–14.3 pCi/L. These concentrations were similar to or slightly higher than levels observed from 1988 through 2002. The most likely contribution is the relatively high levels of naturally-occurring radium. Gamma spectroscopy indicates the presence of lead and bismuth isotopes, which are daughters of the radium decay chain. There is no indication from the 2003 data of any effect of plant operation.

<u>Year</u>		Gross Beta (pCi/L)
1988		8.0
1989		7.0
1990		7.0
1991		8.0
1992		7.6
1993		7.5
1994		5.8
1995		3.9
1996		6.3
1997		5.1
1998		5.4
1999		5.3
2000		10.1
2001		8.3
2002		8.7
2003		9.9

Average annual concentrations; Gross beta in drinking water.

### River Water

For the second and third quarters of 2003, measurable tritium was detected in downstream river water composites, at concentrations of 1135 and 259 pCi/L, respectively. This is well below the Environmental Protection Agency's drinking water standard of 20,000 pCi/L. For the remaining upstream and downstream collections, tritium levels measured below the LLD level of 161 pCi/L.

Gamma-emitting isotopes were below detection limits in all samples.

### Well Water

At the control well P-41, Huppert Farm and four indicator wells (P-8, Community Center, P-6, Lock and Dam No. 3, P-9, Plant Well No. 2 and P-24, Suter Farm ) no tritium was detected above the LLD level of 163 pCi/L. Gamma-emitting isotopes were below detection limits in all samples.

In summary, well water data for 2003 show no radiological effects of the plant operation.

### Crops

Three samples of broadleaf vegetation, cabbage leaves, were collected in July and analyzed for gamma-emitting isotopes, including iodine-131. The I-131 level was below 0.026 pCi/g wet weight in all samples. With the exception of naturally-occurring potassium-40, all other gamma-emitting isotopes were below their respective detection limits. There was no indication of a plant effect.

Field sampling personnel conducted an annual land use survey and found no river water taken for irrigation into fields within 5 miles downstream from the Prairie Island Plant. The collection and analysis of corn samples was not required.

### Fish

Fish samples were collected in May and September, 2003 and analyzed for gamma emitting isotopes. Only naturally-occurring potassium-40 was detected, and there was no significant difference between upstream and downstream results. There was no indication of a plant effect.

### Aquatic Insects or Periphyton

Aquatic insects (invertebrates) or periphyton were collected in May and September, 2003. All gamma-emitting isotopes were below their respective detection limits. There was no indication of a plant effect.

### Bottom and Shoreline Sediments

Upstream, downstream and downstream recreational area shoreline sediment collections were made in May and September, 2003 and analyzed for gamma-emitting isotopes. The only gamma-emitting isotope detected was naturally-occurring potassium-40. There was no indication of a plant effect.

## 5.0 FIGURES AND TABLES

Figure 5-1. Offsite Ambient Radiation (TLDs); average of inner and outer ring indicator locations versus control location.




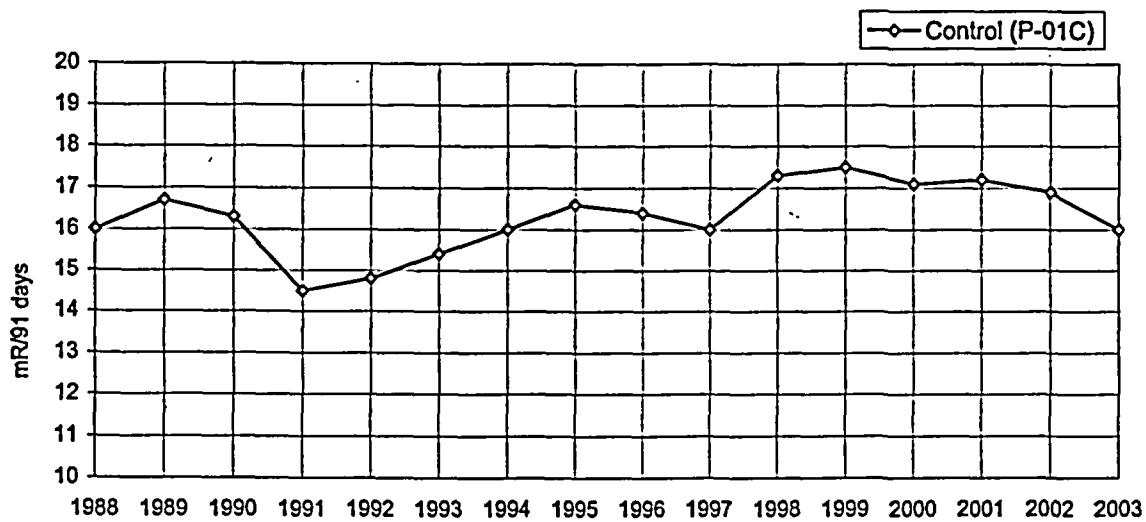


Figure 5-2. Airborne Particulates; analysis for gross beta, average mean of all indicator locations versus control location.

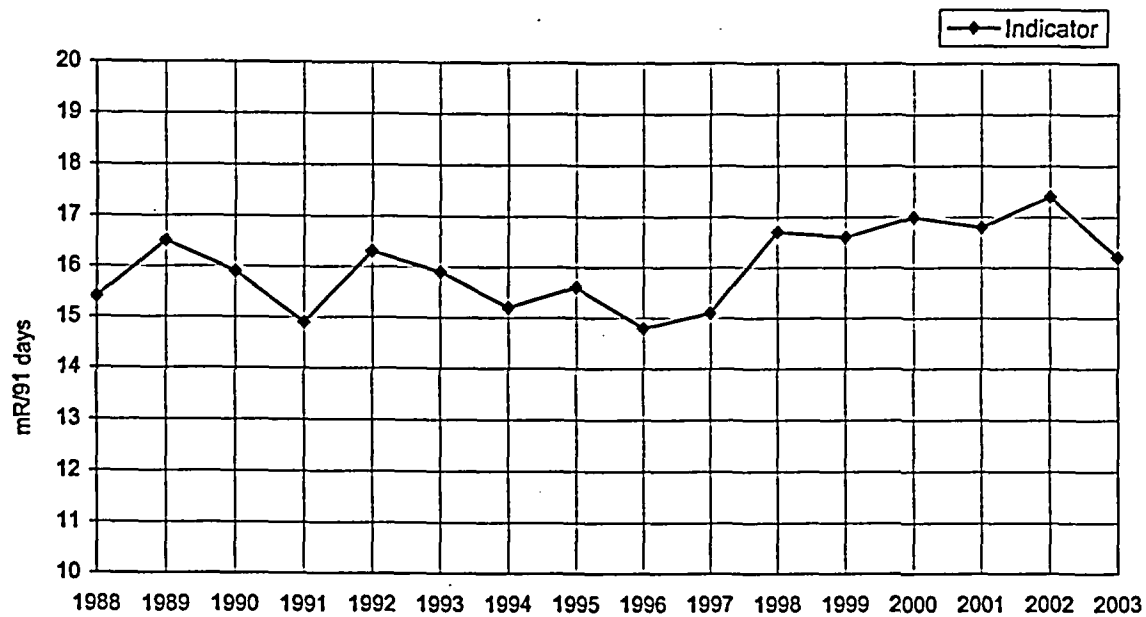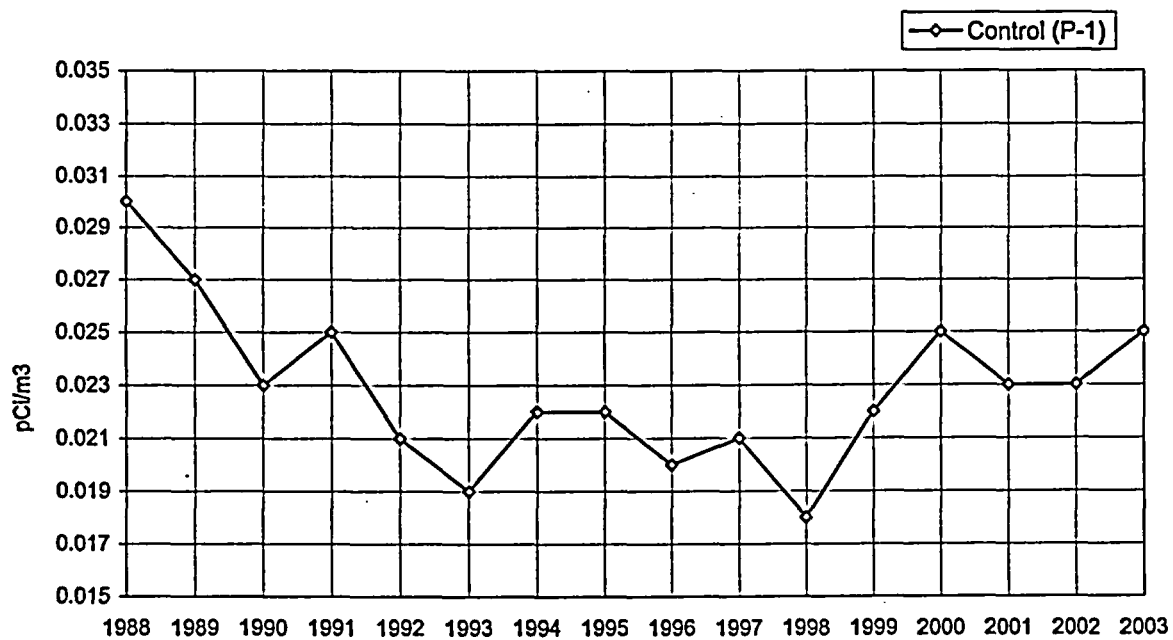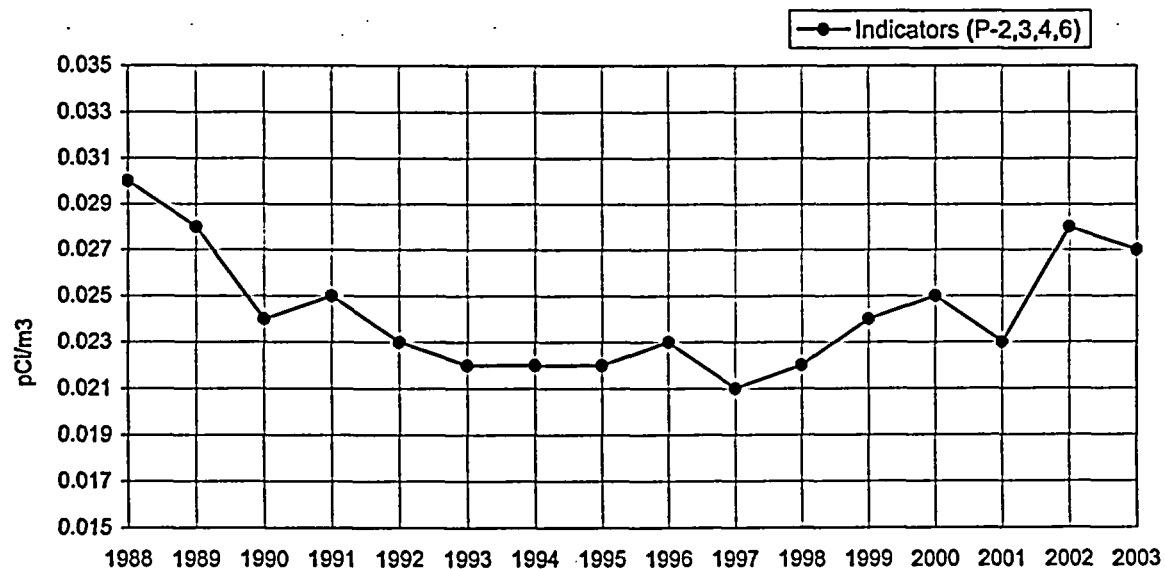

# PRAIRIE ISLAND

**Table 5.1. Sample collection and analysis program, Prairie Island Nuclear Generating Plant.**

Medium	Location		Collection Type and Frequency <sup>b</sup>	Analysis Type and Frequency <sup>c</sup>
	No.	Codes (and Type) <sup>a</sup>		
Ambient radiation (TLD's)	54	P-01A - P-10A P-01B - P-15B P-01S - P-08S P-01IA - P-08IA P-01IB - P-08IB P-01IX- P-04IX, P-01C	C/Q	Ambient gamma
Airborne Particulates	5	P-1(C), P-2, P-3, P-4, P-6	C/W	GB, GS (QC of each location)
Airborne Iodine	5	P-1(C), P-2, P-3, P-4, P-6	C/W	I-131
Milk	5	P-14, P-18, P-37, P-41 (C), P-42	G/M <sup>d</sup>	I-131, GS
River water	2	P-5(C), P-6	G/W	GS(MC), H-3(QC)
Drinking water	1	P-11	G/W	GB(MC), I-131(MC) GS (MC), H-3 (QC)
Well water	5	P-6, P-8, P-9, P-24, P-41 (C)	G/Q	H-3, GS
Edible cultivated crops - leafy green vegetables	2	P-38(C), P-24	G/A	GS (I-131)
Fish (one species, edible portion)	2	P-19(C), P-13	G/SA	GS
Periphyton or Invertebrates	2	P-40(C), P-6	G/SA	GS
Bottom sediment	2	P-20(C), P-6	G/SA	GS
Shoreline sediment	1	P-12	G/SA	GS

<sup>a</sup> Location codes are defined in Table D-2. Control stations are indicated by (C). All other stations are indicators.

<sup>b</sup> Collection type is coded as follows: C/ = continuous, G/ = grab. Collection frequency is coded as follows:

W= weekly, M = monthly, Q = quarterly, SA = semiannually, A = annually.

<sup>c</sup> Analysis type is coded as follows: GB = gross beta, GS = gamma spectroscopy, H-3 = tritium, I-131 = Iodine-131.

Analysis frequency is coded as follows: MC = monthly composite, QC = quarterly composite.

<sup>d</sup> Milk is collected biweekly during the grazing season (May - October).

## PRAIRIE ISLAND

**Table 5.2. Sampling locations, Prairie Island Nuclear Generating Plant.**

Code	Type <sup>a</sup>	Collection Site	Sample Type <sup>b</sup>	Distance and Direction from Reactor
P-1	C	Air Station P-1	AP, AI	11.8 ml @ 316°/NNW
P-2		Air Station P-2	AP, AI	0.5 ml @ 294°/WNW
P-3		Air Station P-3	AP, AI	0.8 ml @ 313°/NW
P-4		Air Station P-4	AP, AI	0.4 ml @ 359°/N
P-5	C	Upstream of Plant	RW	1.8 ml @ 11°/N
P-6		Lock and Dam #3 & Air Station P-6	AP, AI, RW WW, BS, BO <sup>c</sup>	1.6 ml @ 129°/SE
P-8		Community Center	WW	1.0 ml @ 321°/WNW
P-9		Plant Well #2	WW	0.3 ml @ 306°/NW
P-11		Red Wing Service Center	DW	3.3 ml @ 158°/SSE
P-12		Downstream of Plant	SS	3.0 ml @ 116°/ESE
P-13		Downstream of Plant	F <sup>c</sup>	3.5 ml @ 113°/ESE
P-14		Gustafson Farm	M	2.3 ml @ 173°/S
P-18		Christiansen Farm	M	3.8 ml @ 88°/E
P-19	C	Upstream of Plant	F <sup>c</sup>	1.3 ml @ 0°/N
P-20	C	Upstream of Plant	BS	0.9 ml @ 45°/NE
P-24		Suter Residence	VE, WW	0.6 ml @ 158°/SSE
P-37		Welsch Farm	M	4.1 ml @ 87°/E
P-38	C	Cain Residence	VE	14.2 ml @ 359°/N
P-40	C	Upstream of Plant	BO <sup>c</sup>	0.4 ml @ 0°/N
P-41	C	Huppert Farm	M, WW	13.8 ml @ 354°/N
P-42		Rother Farm	M	4.3 ml @ 264°/W
<u>General Area of the Site Boundary</u>				
P-01A		Property Line	TLD	0.4 ml @ 359°/N
P-02A		Property Line	TLD	0.3 ml @ 10°/N
P-03A		Property Line	TLD	0.5 ml @ 183°/S
P-04A		Property Line	TLD	0.4 ml @ 204°/SWW
P-05A		Property Line	TLD	0.4 ml @ 225°/SW
P-06A		Property Line	TLD	0.4 ml @ 249°/WSW
P-07A		Property Line	TLD	0.4 ml @ 268°/W
P-08A		Property Line	TLD	0.4 ml @ 291°/WNW
P-09A		Property Line	TLD	0.7 ml @ 317°/NW
P-10A		Property Line	TLD	0.5 ml @ 333°/NNW

## PRAIRIE ISLAND

**Table 5.2. Sampling locations, Prairie Island Nuclear Generating Plant, (continued).**

Code	Type <sup>a</sup>	Collection Site	Sample Type <sup>b</sup>	Distance and Direction from Reactor
<u>Approximately 4 to 5 miles Distant from the Plant</u>				
P-01B		Thomas Killian Residence	TLD	4.7 ml @ 355°/N
P-02B		Roy Kinneman Residence	TLD	4.8 ml @ 17°/NNE
P-03B		Wayne Anderson Farm	TLD	4.9 ml @ 46°/NE
P-04B		Nelson Drive (Road)	TLD	4.2 ml @ 61°/ENE
P-05B		County Road E and Coulee	TLD	4.2 ml @ 102°/ESE
P-06B		William Hauschilt Residence	TLD	4.4 ml @ 112°/ESE
P-07B		Red Wing Public Works	TLD	4.7 ml @ 140°/SE
P-08B		David Wnuk Residence	TLD	4.1 ml @ 165°/SSE
P-09B		Highway 19 South	TLD	4.2 ml @ 187°/S
P-10B		Cannondale Farm	TLD	4.9 ml @ 200°/SSW
P-11B		Wallace Weberg Farm	TLD	4.5 ml @ 221°/SW
P-12B		Ray Gergen Farm	TLD	4.6 ml @ 251°/WSW
P-13B		Thomas O'Rourke Farm	TLD	4.4 ml @ 270°/W
P-14B		David J. Anderson Farm	TLD	4.9 ml @ 306°/NW
P-15B		Holst Farms	TLD	3.8 ml @ 345°/NNW
<u>Special Interest Locations</u>				
P-01S		Federal Lock & Dam #3	TLD	1.6 ml @ 129°/SE
P-02S		Charles Suter Residence	TLD	0.5 ml @ 155°/SSE
P-03S		Carl Gustafson Farm	TLD	2.2 ml @ 173°/S
P-04S		Richard Burt Residence	TLD	2.0 ml @ 202°/SSW
P-05S		Kinney Store	TLD	2.0 ml @ 270°/W
P-06S		Earl Flynn Farm	TLD	2.5 ml @ 299°/WNW
P-07S		Indian Community	TLD	0.7 ml @ 271°/W
P-08S		Indian Community	TLD	0.7 ml @ 287°/NWW
P-01C	C	Robert Kinneman Farm	TLD	11.1 ml @ 331°/NNW



## PRAIRIE ISLAND

**Table 5.2. Sampling locations, Prairie Island Nuclear Generating Plant, (continued).**

Code	Type <sup>a</sup>	Collection Site	Type of Sample <sup>b</sup>	Approximate Distance and Direction from ISFSI Center.
<u>ISFSI Area Inside Earth Berm</u>				
P-01IA		ISFSI Nuisance Fence	TLD	190' @ 45°/NE
P-02IA		ISFSI Nuisance Fence	TLD	360' @ 82°/E
P-03IA		ISFSI Nuisance Fence	TLD	370' @ 100°/E
P-04IA		ISFSI Nuisance Fence	TLD	200' @ 134°/SE
P-05IA		ISFSI Nuisance Fence	TLD	180' @ 219°/SW
P-06IA		ISFSI Nuisance Fence	TLD	320' @ 258°/WSW
P-07IA		ISFSI Nuisance Fence	TLD	320' @ 281°/WNW
P-08IA		ISFSI Nuisance Fence	TLD	190' @ 318°/NW
P-01IX		ISFSI Nuisance Fence	TLD	140' @ 180°/S
P-02IX		ISFSI Nuisance Fence	TLD	310' @ 270°/W
P-03IX		ISFSI Nuisance Fence	TLD	140' @ 0°/N
P-04IX		ISFSI Nuisance Fence	TLD	360' @ 90°/E
<u>ISFSI Area Outside Earth Berm</u>				
P-01IB		ISFSI Berm Area	TLD	340' @ 3°/N
P-02IB		ISFSI Berm Area	TLD	380' @ 28°/NNE
P-03IB		ISFSI Berm Area	TLD	560' @ 85°/E
P-04IB		ISFSI Berm Area	TLD	590' @ 165°/SSE
P-05IB		ISFSI Berm Area	TLD	690' @ 186°/S
P-06IB		ISFSI Berm Area	TLD	720' @ 201°/SSW
P-07IB		ISFSI Berm Area	TLD	610' @ 271°/W
P-08IB		ISFSI Berm Area	TLD	360' @ 332°/NNW

<sup>a</sup> "C" denotes control location. All other locations are indicators.

<sup>b</sup> Sample Codes:

AP	Airborne particulates	F	Fish
AI	Airborne iodine	M	Milk
BS	Bottom (river) sediments	SS	Shoreline Sediments
BO	Bottom organisms (periphyton or macroinvertebrates)	SW	Surface Water
		VE	Vegetation/vegetables
DW	Drinking water	WW	Well water

<sup>c</sup> Distance and direction data for fish and bottom organisms are approximate since availability of sample specimen may vary at any one location.

Table 5.3. Missed collections and analyses at the Prairie Island Nuclear Generating Plant.

All required samples were collected and analyzed as scheduled with the following exceptions:

Sample Type	Analysis	Location	Collection Date or Period	Reason for not conducting REMP as required	Plans for Preventing Recurrence
MI	Gamma, I-131	P-37	1/15/2003 through 3/4/2003	Welsch farm temporarily out of dairy business.	Welsch will inform the PINGP upon resumption of operation in Spring, 2003.
AP/AI	Beta, I-131	P-01	10/14/2003	Partial sample collected; low volume due to open fuse.	Sampler pump was replaced.
AP/AI	Beta, I-131	P-06	11/14/2003	Sampler pump failure; open fuse.	Sampler pump was replaced.

Table 5.4 Radiological Environmental Monitoring Program Summary

Name of Facility Prairie Island Nuclear Power Station  
 Location of Facility Goodhue, Minnesota  
 ( County, State )

Docket No. 50-282, 50-306  
 Reporting Period January-December, 2003

Sample Type (Units)	Type and Number of Analyses <sup>a</sup>	LLD <sup>b</sup>	Indicator Locations Mean (F) <sup>c</sup> Range <sup>c</sup>	Location with Highest Annual Mean		Control Locations Mean (F) <sup>c</sup> Range <sup>c</sup>	Number Non-Routine Results <sup>a</sup>
				Location <sup>d</sup>	Mean (F) <sup>e</sup> Range <sup>e</sup>		
TLD (Inner Ring, Area at Site Boundary) mR/91 days)	Gamma 40	3.0	15.4 (40/40) (12.7-17.5)	P-06A 0.4 mi @ 249° WSW	16.2 (4/4) (14.5-17.5)	(See Control below.)	0
TLD (Outer Ring, 4-5 mi. distant) mR/91 days)	Gamma 60	3.0	16.7 (60/60) (12.9-20.1)	P-02B, Roy Kinneman, 4.8 mi @ 17° NNE	18.9 (4/4) (18.0-19.9)	(See Control below.)	0
TLD (Special Interest Areas) mR/91 days)	Gamma 32	3.0	15.5 (32/32) (12.6-20.2)	P-03S, Gustafson Farm, 2.2 mi @ 173° /S	18.5 (4/4) (16.6-20.2)	(See Control below.)	0
TLD (Control) mR/91 days)	Gamma 4	3.0	None	P-01C, R. Kinneman, 11.1 mi @ 331° /NNW	16.0 (4/4) (15.0-17.0)	16.0 (4/4) (15.0-17.0)	0
Airborne Particulates (pCi/m <sup>3</sup> )	GB 259	0.005	0.027 (207/207) (0.005-0.049)	P-06, Air Station 1.6 mi @ 129° /SE	0.028 (51 /51) (0.014-0.048)	0.025 (52/52) (0.011-0.047)	0
	GS 20						
	Be-7	0.015	0.064 (16/16) (0.036-0.083)	P-06, Air Station 1.6 mi @ 129° /SE	0.067 (4/4) (0.051-0.076)	0.055 (4/4) (0.034-0.067)	0
	Mn-54	0.0007	< LLD	-	-	< LLD	0
	Co-58	0.0006	< LLD	-	-	< LLD	0
	Co-60	0.0007	< LLD	-	-	< LLD	0
	Zn-65	0.0011	< LLD	-	-	< LLD	0
	Zr-Nb-95	0.0010	< LLD	-	-	< LLD	0
	Ru-103	0.0007	< LLD	-	-	< LLD	0
	Ru-106	0.0063	< LLD	-	-	< LLD	0
	Cs-134	0.0007	< LLD	-	-	< LLD	0
	Cs-137	0.0006	< LLD	-	-	< LLD	0
	Ba-La-140	0.0016	< LLD	-	-	< LLD	0
	Ce-141	0.0014	< LLD	-	-	< LLD	0
	Ce-144	0.0039	< LLD	-	-	< LLD	0
Airborne Iodine (pCi/m <sup>3</sup> )	I-131 259	0.07	< LLD	-	-	< LLD	0

Table 5.4 Radiological Environmental Monitoring Program Summary

Name of Facility Prairie Island Nuclear Power Station  
 Location of Facility Goodhue, Minnesota  
 ( County, State )

Docket No. 50-282, 50-306  
 Reporting Period January-December, 2003

Sample Type (Units)	Type and Number of Analyses <sup>a</sup>	LLD <sup>b</sup>	Indicator Locations Mean (F) <sup>c</sup> Range <sup>c</sup>	Location with Highest Annual Mean		Control Locations Mean (F) <sup>c</sup> Range <sup>c</sup>	Number Non-Routine Results <sup>a</sup>
				Location <sup>d</sup>	Mean (F) <sup>c</sup> Range <sup>c</sup>		
Milk (pCi/L)	I-131 87	1.0	< LLD	-	-	< LLD	0
	GS 87						
	K-40	200	1403 (69/69) (1197-1602)	P-37, Welsch Farm 4.1 mi @ 87° /E	1439 (15 /15) (1275-1602)	1381 (18/18) (1202-1584)	0
	Cs-134	15	< LLD	-	-	< LLD	0
	Cs-137	15	< LLD	-	-	< LLD	0
	Ba-La-140	15	< LLD	-	-	< LLD	0
River Water (pCi/L)	H-3 8	161	697 (2/4) (259-1135)	P-6, Lock and Dam #3 1.6 mi @ 129°/SE	697 (2/4) (259-1135)	< LLD	0
	GS 24						
	Mn-54	15	< LLD	-	-	< LLD	0
	Fe-59	30	< LLD	-	-	< LLD	0
	Co-58	15	< LLD	-	-	< LLD	0
	Co-60	15	< LLD	-	-	< LLD	0
	Zn-65	30	< LLD	-	-	< LLD	0
	Zr-Nb-95	15	< LLD	-	-	< LLD	0
	Cs-134	15	< LLD	-	-	< LLD	0
	Cs-137	18	< LLD	-	-	< LLD	0
	Ba-La-140	15	< LLD	-	-	< LLD	0
	Ce-144	57	< LLD	-	-	< LLD	0

Table 5.4 Radiological Environmental Monitoring Program Summary

Name of Facility Prairie Island Nuclear Power Station  
 Location of Facility Goodhue, Minnesota  
 ( County, State )

Docket No. 50-282, 50-306  
 Reporting Period January-December, 2003

Sample Type (Units)	Type and Number of Analyses <sup>a</sup>	LLD <sup>b</sup>	Indicator Locations Mean (F) <sup>c</sup> Range <sup>c</sup>	Location with Highest Annual Mean		Control Locations Mean (F) <sup>c</sup> Range <sup>c</sup>	Number Non-Routine Results <sup>a</sup>
				Location <sup>d</sup>	Mean (F) <sup>c</sup> Range <sup>c</sup>		
Drinking Water (pCi/L)	GB 12	1.0	9.9 (12/12) (8.1-14.3)	P-11, Red Wing S.C. 3.3 mi @ 158° /SSE	9.9 (12/12) (8.1-14.3)	None	0
	I-131 12	1.0	< LLD		-	None	0
	H-3 4	161	< LLD		-	None	0
	GS 12						
	Mn-54 15		< LLD		-	None	0
	Fe-59 30		< LLD		-	None	0
	Co-58 15		< LLD		-	None	0
	Co-60 15		< LLD		-	None	0
	Zn-65 30		< LLD		-	None	0
	Zr-Nb-95 15		< LLD		-	None	0
	Cs-134 10		< LLD		-	None	0
	Cs-137 18		< LLD		-	None	0
	Ba-La-140 15		< LLD		-	None	0
	Ce-144 57		< LLD		-	None	0
Well Water (pCi/L)	H-3 20	163	< LLD	-	-	< LLD	0
	GS 20						
	Mn-54 15		< LLD	-	-	< LLD	0
	Fe-59 30		< LLD	-	-	< LLD	0
	Co-58 15		< LLD	-	-	< LLD	0
	Co-60 15		< LLD	-	-	< LLD	0
	Zn-65 30		< LLD	-	-	< LLD	0
	Zr-Nb-95 15		< LLD	-	-	< LLD	0
	Cs-134 10		< LLD	-	-	< LLD	0
	Cs-137 18		< LLD	-	-	< LLD	0
	Ba-La-140 15		< LLD	-	-	< LLD	0
	Ce-144 55		< LLD	-	-	< LLD	0
Crops - Cabbage (pCi/gwet)	I-131 3	0.026	< LLD	-	-	< LLD	0

Table 5.4 Radiological Environmental Monitoring Program Summary

Name of Facility Prairie Island Nuclear Power Station  
 Location of Facility Goodhue, Minnesota  
 ( County, State )

Docket No. 50-282, 50-306  
 Reporting Period January-December, 2003

Sample Type (Units)	Type and Number of Analyses <sup>a</sup>	LLD <sup>b</sup>	Indicator Locations Mean (F) <sup>c</sup> Range <sup>c</sup>	Location with Highest Annual Mean		Control Locations Mean (F) <sup>c</sup> Range <sup>c</sup>	Number Non-Routine Results <sup>a</sup>
				Location <sup>d</sup>	Mean (F) <sup>c</sup> Range <sup>c</sup>		
Fish (pCi/g wet)	GS 4						
	K-40	0.10	2.84 (2/2) (2.39-3.29)	P-19, Upstream 1.3 ml. @ 0°/N	2.86 (2/2) (2.59-3.13)	2.86 (2/2) (2.59-3.13)	0
	Mn-54	0.016	< LLD	-	-	< LLD	0
	Fe-59	0.046	< LLD	-	-	< LLD	0
	Co-58	0.015	< LLD	-	-	< LLD	0
	Co-60	0.016	< LLD	-	-	< LLD	0
	Zn-65	0.042	< LLD	-	-	< LLD	0
	Zr-Nb-95	0.025	< LLD	-	-	< LLD	0
	Cs-134	0.020	< LLD	-	-	< LLD	0
	Cs-137	0.017	< LLD	-	-	< LLD	0
	Ba-La-140	0.19	< LLD	-	-	< LLD	0
Invertebrates (pCi/g wet)	GS 4						
	Be-7	0.44	< LLD	-	-	< LLD	0
	K-40	0.98	< LLD	P-40, Upstream 0.4 ml @ 0°/N	1.59 (1/2)	1.59 (1/2)	0
	Mn-54	0.045	< LLD	-	-	< LLD	0
	Co-58	0.049	< LLD	-	-	< LLD	0
	Co-60	0.044	< LLD	-	-	< LLD	0
	Zn-65	0.080	< LLD	-	-	< LLD	0
	Zr-Nb-95	0.060	< LLD	-	-	< LLD	0
	Ru-103	0.058	< LLD	-	-	< LLD	0
	Ru-106	0.32	< LLD	-	-	< LLD	0
	Cs-134	0.045	< LLD	-	-	< LLD	0
	Cs-137	0.039	< LLD	-	-	< LLD	0
	Ba-La-140	0.26	< LLD	-	-	< LLD	0
	Ce-141	0.079	< LLD	-	-	< LLD	0
	Ce-144	0.20	< LLD	-	-	< LLD	0

Table 5.4 Radiological Environmental Monitoring Program Summary

Name of Facility Prairie Island Nuclear Power Station  
 Location of Facility Goodhue, Minnesota  
 ( County, State )

Docket No. 50-282, 50-306  
 Reporting Period January-December, 2003

Sample Type (Units)	Type and Number of Analyses <sup>a</sup>	LLD <sup>b</sup>	Indicator Locations Mean (F) <sup>c</sup> Range <sup>c</sup>	Location with Highest Annual Mean		Control Locations Mean (F) <sup>c</sup> Range <sup>c</sup>	Number Non-Routine Results <sup>d</sup>
				Location <sup>d</sup>	Mean (F) <sup>c</sup> Range <sup>c</sup>		
Bottom and Shoreline Sediments (pCi/g dry)	GS 6						
	Be-7	0.18	< LLD	-	-	< LLD	0
	K-40	0.10	6.96 (4/4) (5.89-7.85)	P-20, Upstream 0.9 mi. @ 45° /NE	9.05 (2/2) (8.79-9.30)	9.05 (2/2) (8.79-9.30)	0
	Mn-54	0.022	< LLD	-	-	< LLD	0
	Co-58	0.026	< LLD	-	-	< LLD	0
	Co-60	0.016	< LLD	-	-	< LLD	0
	Zn-65	0.063	< LLD	-	-	< LLD	0
	Zr-Nb-95	0.040	< LLD	-	-	< LLD	0
	Ru-103	0.027	< LLD	-	-	< LLD	0
	Ru-106	0.17	< LLD	-	-	< LLD	0
	Cs-134	0.028	< LLD	-	-	< LLD	0
	Cs-137	0.020	< LLD	-	-	< LLD	0
	Ba-La-140	0.17	< LLD	-	-	< LLD	0
	Ce-141	0.047	< LLD	-	-	< LLD	0
	Ce-144	0.11	< LLD	-	-	< LLD	0

<sup>a</sup> GB = gross beta, GS = gamma scan.

<sup>b</sup> LLD = nominal lower limit of detection based on a 4.66 sigma counting error for background sample.

<sup>c</sup> Mean and range are based on detectable measurements only. Fraction of detectable measurements at specified locations is indicated in parentheses (F).

<sup>d</sup> Locations are specified: (1) by name, and/or station code (Table 2) and (2) by distance (miles) and direction relative to reactor site.

<sup>e</sup> Non-routine results are those which exceed ten times the control station value. If no control station value is available, the result is considered non-routine if it exceeds ten times the typical preoperational value for the medium or location.

## 6.0 REFERENCES CITED

Arnold, J. R. and H. A. Al-Salih. 1955. Beryllium-7 Produced by Cosmic Rays. Science 121: 451-453.

Eisenbud, M. 1963. Environmental Radioactivity, McGraw-Hill, New York, New York, pp. 213, 275 and 276.

Environmental, Inc., Midwest Laboratory

\_\_\_\_\_. 2001a through 2004a. Radiation Environmental Monitoring for Monticello Nuclear Generating Plant, Complete Analysis Data Tables, January-December, 2000 through 2003.

\_\_\_\_\_. 2001b through 2004b. Radiation Environmental Monitoring for Prairie Island Nuclear Generating Plant, Complete Analysis Data Tables, January - December, 2000-2003.

\_\_\_\_\_. 2000. Quality Assurance Program Manual, Rev. 0, 01 October 2003.

\_\_\_\_\_. 2000. Quality Control Procedures Manual, Rev. 0, 21 September 2000.

\_\_\_\_\_. 2000. Quality Control Program, Rev. 0, 21 August 2003.

Gold, S., H. W. Barkhau, B. Shlein, and B. Kahn, 1964. Measurement of Naturally Occurring Radionuclides in Air, in the Natural Environment, University of Chicago Press, Chicago, Illinois, 369-382.

Hazleton Environmental Sciences Corporation.

\_\_\_\_\_. 1979a to 1983a. Radiation Environmental Monitoring for Monticello Nuclear Generating Plant, Complete Analysis Data Tables, January - December 1978 through 1982.

\_\_\_\_\_. 1979b to 1983b. Radiation Environmental Monitoring for Prairie Island Nuclear Generating Plant, Complete Analysis Data Tables, January - December 1978 through 1982.

Hohenemser, C. M. Deicher, A. Ernst, H. Hofsass, G. Lindner, E. Racknagel. 1986. "Chernobyl," Chemtech, October 1986, pp. 596-605.

National Center for Radiological Health, 1968. Radiological Health and Data Reports, Vol. 9, No. 12, 730-746.

Northern States Power Company.

\_\_\_\_\_. 1972. Prairie Island Nuclear Generating Plant, Environmental Monitoring and Ecological Studies Program, January 1, 1971 to December 31, 1971. Minneapolis, Minnesota.

\_\_\_\_\_. 1973. Prairie Island Nuclear Generating Plant, Environmental Monitoring and Ecological Studies Program, January 1, 1972 to December 31, 1972. Minneapolis, Minnesota.

\_\_\_\_\_. 1974. Prairie Island Nuclear Generating Plant, Environmental Monitoring and Ecological Studies Program, Volume 1, January 1, 1973 to December 31, 1973. Minneapolis, Minnesota.

\_\_\_\_\_. 1979 to 2003. Prairie Island Nuclear Generating Plant, Annual Radiation Environmental Monitoring Report to the U.S. Nuclear Regulatory Commission, January 1 to December 31, 1978 through 2002. Minneapolis, Minnesota.



## 6.0 REFERENCES CITED (continued)

Prairie Island Nuclear Generating Plant, 2003. Radiological Environmental Monitoring for Prairie Island Nuclear Generating Plant, Radiation Protection Implementing Procedures, 4700 series.

Teledyne Brown Engineering Environmental Services, Midwest Laboratory. 1984a to 2000a. Radiation Environmental Monitoring for Monticello Nuclear Generating Plant, Complete Analysis Data Tables, January - December, 1983 through 1999.

\_\_\_\_\_. 1984b to 2000b. Radiation Environmental Monitoring for Prairie Island Nuclear Generating Plant, Complete Analysis Data Tables, January - December, 1983 through 1999.

U.S. Dep't of Energy 1997 HASL-300, Edition 28, Procedures Manual, Environmental Measurements Laboratory, New York, NY.

U.S. Environmental Protection Agency . 1980. Prescribed Procedures for Measurement of Radioactivity in Drinking Water, Cincinnati, Ohio (EPA-600/4-80-032).

\_\_\_\_\_. 1984. Eastern Environmental Radiation Facility, Radiochemistry Procedures Manual, Montgomery, Alabama (EPA-520/5-84-006).

Wilson, D. W., G. M. Ward and J. E. Johnson. 1969. In Environmental Contamination by Radioactive Materials, International Atomic Energy Agency. p.125.

Xcel Energy Corporation. 2004. Monticello Nuclear Generating Plant, Annual Radiation Environmental Monitoring Report to the U.S. Nuclear Regulatory Commission, January 1 to December 31, 2003 (prepared by Environmental, Inc., Midwest Laboratory). Northbrook, Illinois

# PRAIRIE ISLAND

Table D-1. Sample collection and analysis program, Prairie Island Nuclear Generating Plant.

Medium	Location		Collection Type and Frequency <sup>b</sup>	Analysis Type and Frequency <sup>c</sup>
	No.	Codes (and Type) <sup>a</sup>		
Ambient radiation (TLD's)	54	P-01A - P-10A P-01B - P-15B P-01S - P-08S P-01IA - P-08IA P-01IB - P-08IB P-01IX- P-04IX, P-01C	C/Q	Ambient gamma
Airborne Particulates	5	P-1(C), P-2, P-3, P-4, P-6	C/W	GB, GS (QC of each location)
Airborne Iodine	5	P-1(C), P-2, P-3, P-4, P-6	C/W	I-131
Milk	5	P-14, P-18, P-37, P-42 P-41 [C]	G/M <sup>d</sup>	I-131, GS
River water	2	P-5(C), P-6	G/W	GS(MC), H-3(QC)
Drinking water	1	P-11	G/W	GB(MC), I-131(MC) GS (MC), H-3 (QC)
Well water	5	P-6, P-8, P-9, P-24, P-41 (C)	G/Q	H-3, GS
Edible cultivated crops - leafy green vegetables	2	P-38(C), P-24	G/A	GS (I-131)
Fish (one species, edible portion)	2	P-19(C), P-13	G/SA	GS
Periphyton or invertebrates	2	P-40(C), P-6	G/SA	GS
Bottom sediment	2	P-20(C), P-6	G/SA	GS
Shoreline sediment	1	P-12	G/SA	GS

<sup>a</sup> Location codes are defined in Table D-2. Control stations are indicated by (C). All other stations are indicators.

<sup>b</sup> Collection type is coded as follows: C/ = continuous, G/ = grab. Collection frequency is coded as follows: W= weekly, M = monthly, Q = quarterly, SA = semiannually, A = annually.

<sup>c</sup> Analysis type is coded as follows: GB = gross beta, GS = gamma spectroscopy, H-3 = tritium, I-131 = iodine 131. Analysis frequency is coded as follows: MC = monthly composite, QC = quarterly composite.

<sup>d</sup> Milk is collected biweekly during the grazing season (May - October).

# PRAIRIE ISLAND

Table D-2. Sampling locations, Prairie Island Nuclear Generating Plant.

Code	Type <sup>a</sup>	Collection Site	Sample Type <sup>b</sup>	Distance and Direction from Reactor
P-1	C	Air Station P-1	AP, AI	11.8 mi @ 316°/NNW
P-2		Air Station P-2	AP, AI	0.5 mi @ 294°/WNW
P-3		Air Station P-3	AP, AI	0.8 mi @ 313°/NW
P-4		Air Station P-4	AP, AI	0.4 mi @ 359°/N
P-5	C	Upstream of Plant	RW	1.8 mi @ 11°/N
P-6		Lock and Dam #3 & Air Station P-6	AP, AI, RW WW, BS, BO <sup>c</sup>	1.6 mi @ 129°/SE
P-8		Community Center	WW	1.0 mi @ 321°/WNW
P-9		Plant Well #2	WW	0.3 mi @ 306°/NW
P-11		Red Wing Service Center	DW	3.3 mi @ 158°/SSE
P-12		Downstream of Plant	SS	3.0 mi @ 116°/ESE
P-13		Downstream of Plant	F <sup>c</sup>	3.5 mi @ 113°/ESE
P-14		Gustafson Farm	M	2.3 mi @ 173°/S
P-18		Christiansen Farm	M	3.8 mi @ 88°/E
P-19	C	Upstream of Plant	F <sup>c</sup>	1.3 mi @ 0°/N
P-20	C	Upstream of Plant	BS	0.9 mi @ 45°/NE
P-24		Suter Residence	VE, WW	0.6 mi @ 158°/SSE
P-37		Welsch Farm	M	4.1 mi @ 87°/E
P-38	C	Cain Residence	VE	14.2 mi @ 359°/N
P-40	C	Upstream of Plant	BO <sup>c</sup>	0.4 mi @ 0°/N
P-41	C	Huppert Farm	M, WW	13.8 mi @ 354°/N
P-42		Rother Farm	M	4.3 mi. @ 264°/W
<u>General Area of the Site Boundary</u>				
P-01A		Property Line	TLD	0.4 mi @ 359°/N
P-02A		Property Line	TLD	0.3 mi @ 10°/N
P-03A		Property Line	TLD	0.5 mi @ 183°/S
P-04A		Property Line	TLD	0.4 mi @ 204°/SWW
P-05A		Property Line	TLD	0.4 mi @ 225°/SW
P-06A		Property Line	TLD	0.4 mi @ 249°/WSW
P-07A		Property Line	TLD	0.4 mi @ 268°/W
P-08A		Property Line	TLD	0.4 mi @ 291°/WNW
P-09A		Property Line	TLD	0.7 mi @ 317°/NW
P-10A		Property Line	TLD	0.5 mi @ 333°/NNW

## PRAIRIE ISLAND

Table D-2. Sampling locations, Prairie Island Nuclear Generating Plant, (continued).

Code	Type <sup>a</sup>	Collection Site	Sample Type <sup>b</sup>	Distance and Direction from Reactor
<u>Approximately 4 to 5 miles Distant from the Plant</u>				
P-01B		Thomas Killian Residence	TLD	4.7 mi @ 355°/N
P-02B		Roy Kinneman Residence	TLD	4.8 mi @ 17°/NNE
P-03B		Wayne Anderson Farm	TLD	4.9 mi @ 46°/NE
P-04B		Nelson Drive (Road)	TLD	4.2 mi @ 61°/ENE
P-05B		County Road E and Coulee	TLD	4.2 mi @ 102°/ESE
P-06B		William Hauschbilt Residence	TLD	4.4 mi @ 112°/ESE
P-07B		Red Wing Public Works	TLD	4.7 mi @ 140°/SE
P-08B		David Wnuk Residence	TLD	4.1 mi @ 165°/SSE
P-09B		Highway 19 South	TLD	4.2 mi @ 187°/S
P-10B		Cannondale Farm	TLD	4.9 mi @ 200°/SSW
P-11B		Wallace Weberg Farm	TLD	4.5 mi @ 221°/SW
P-12B		Ray Gergen Farm	TLD	4.6 mi @ 251°/WSW
P-13B		Thomas O'Rourke Farm	TLD	4.4 mi @ 270°/W
P-14B		David J. Anderson Farm	TLD	4.9 mi @ 306°/NW
P-15B		Holst Farms	TLD	3.8 mi @ 345°/NNW
<u>Special Interest Locations</u>				
P-01S		Federal Lock & Dam #3	TLD	1.6 mi @ 129°/SE
P-02S		Charles Suter Residence	TLD	0.5 mi @ 155°/SSE
P-03S		Carl Gustafson Farm	TLD	2.2 mi @ 173°/S
P-04S		Richard Burt Residence	TLD	2.0 mi @ 202°/SSW
P-05S		Kinney Store	TLD	2.0 mi @ 270°/W
P-06S		Earl Flynn Farm	TLD	2.5 mi @ 299°/WNW
P-07S		Indian Community	TLD	0.7 mi @ 271°/W
P-08S		Indian Community	TLD	0.7 mi @ 287°/NWW
P-01C	C	Robert Kinneman Farm	TLD	11.1 mi @ 331°/NNW

# PRAIRIE ISLAND

Table D-2. Sampling locations, Prairie Island Nuclear Generating Plant, (continued).


Code	Type <sup>a</sup>	Collection Site	Type of Sample <sup>b</sup>	Approximate Distance and Direction from ISFSI Center.
<u>ISFSI Area Inside Earth Berm</u>				
P-01IA		ISFSI Nuisance Fence	TLD	190' @ 45°/NE
P-02IA		ISFSI Nuisance Fence	TLD	360' @ 82°/E
P-03IA		ISFSI Nuisance Fence	TLD	370' @ 100°/E
P-04IA		ISFSI Nuisance Fence	TLD	200' @ 134°/SE
P-05IA		ISFSI Nuisance Fence	TLD	180' @ 219°/SW
P-06IA		ISFSI Nuisance Fence	TLD	320' @ 258°/WSW
P-07IA		ISFSI Nuisance Fence	TLD	320' @ 281°/WNW
P-08IA		ISFSI Nuisance Fence	TLD	190' @ 318°/NW
P-01IX		ISFSI Nuisance Fence	TLD	140' @ 180°/S
P-02IX		ISFSI Nuisance Fence	TLD	310' @ 270°/W
P-03IX		ISFSI Nuisance Fence	TLD	140' @ 0°/N
P-04IX		ISFSI Nuisance Fence	TLD	360' @ 90°/E
<u>ISFSI Area Outside Earth Berm</u>				
P-01IB		ISFSI Berm Area	TLD	340' @ 3°/N
P-02IB		ISFSI Berm Area	TLD	380' @ 28°/NNE
P-03IB		ISFSI Berm Area	TLD	560' @ 85°/E
P-04IB		ISFSI Berm Area	TLD	590' @ 165°/SSE
P-05IB		ISFSI Berm Area	TLD	690' @ 186°/S
P-06IB		ISFSI Berm Area	TLD	720' @ 201°/SSW
P-07IB		ISFSI Berm Area	TLD	610' @ 271°/W
P-08IB		ISFSI Berm Area	TLD	360' @ 332°/NNW

<sup>a</sup> "C" denotes control location. All other locations are indicators.

<sup>b</sup> Sample Codes:

AP	Airborne particulates	F	Fish
AI	Airborne Iodine	M	Milk
BS	Bottom (river) sediments	SS	Shoreline Sediments
BO	Bottom organisms	SW	Surface Water
	(periphyton or macroinvertebrates)	VE	Vegetation/vegetables
DW	Drinking water	WW	Well water

<sup>c</sup> Distance and direction data for fish and bottom organisms are approximate since availability of sample specimen may vary at any one location.



Environmental, Inc.  
Midwest Laboratory  
an Allegheny Technologies Co.

700 Landwehr Road • Northbrook, IL 60062-2 •  
(847) 584-0700 fax (847) 584-4517

## APPENDIX A

### INTERLABORATORY COMPARISON PROGRAM RESULTS

**NOTE:** Environmental Inc., Midwest Laboratory participates in intercomparison studies administered by Environmental Resources Associates, and serves as a replacement for studies conducted previously by the U.S. EPA Environmental Monitoring Systems Laboratory, Las Vegas, Nevada. Results are reported in Appendix A. TLD Intercomparison results, in-house spikes, blanks, duplicates and mixed analyte performance evaluation program results are also reported. Appendix A is updated four times a year; the complete Appendix is included in March, June, September and December monthly progress reports only.

January, 2003 through December, 2003

## Appendix A

### Interlaboratory Comparison Program Results

Environmental, Inc., Midwest Laboratory, formerly Teledyne Brown Engineering Environmental Services Midwest Laboratory has participated in interlaboratory comparison (crosscheck) programs since the formulation of its quality control program in December 1971. These programs are operated by agencies which supply environmental type samples containing concentrations of radionuclides known to the issuing agency but not to participant laboratories. The purpose of such a program is to provide an independent check on a laboratory's analytical procedures and to alert it of any possible problems.

Participant laboratories measure the concentration of specified radionuclides and report them to the issuing agency. Several months later, the agency reports the known values to the participant laboratories and specifies control limits. Results consistently higher or lower than the known values or outside the control limits indicate a need to check the instruments or procedures used.

Results in Table A-1 were obtained through participation in the environmental sample crosscheck program administered by Environmental Resources Associates, serving as a replacement for studies conducted previously by the U.S. EPA Environmental Monitoring Systems Laboratory, Las Vegas, Nevada.

The results in Table A-2 were obtained for Thermoluminescent Dosimeters (TLDs), via International Intercomparison of Environmental Dosimeters under the sponsorships listed in Table A-2. Results of internal laboratory testing is also listed.

Table A-3 lists results of the analyses on in-house "spiked" samples for the past twelve months. All samples are prepared using NIST traceable sources. Data for previous years available upon request.

Table A-4 lists results of the analyses on in-house "blank" samples for the past twelve months. Data for previous years available upon request.

Table A-5 list results of the in-house "duplicate" program for the past twelve months. Acceptance is based on the difference of the results being less than the sum of the errors. Data for previous years available upon request.

The results in Table A-6 were obtained through participation in the Mixed Analyte Performance Evaluation Program.

The results in Table A-7 were obtained through participation in the Environmental Measurement Laboratory Quality Assessment Program.

Attachment A lists acceptance criteria for "spiked" samples.

Out-of-limit results are explained directly below the result.

Attachment A

ACCEPTANCE CRITERIA FOR "SPIKED" SAMPLES

LABORATORY PRECISION: ONE STANDARD DEVIATION VALUES FOR VARIOUS ANALYSES<sup>a</sup>

Analysis	Level	One standard deviation for single determination
Gamma Emitters	5 to 100 pCi/liter or kg > 100 pCi/liter or kg	5.0 pCi/liter 5% of known value
Strontium-89 <sup>b</sup>	5 to 50 pCi/liter or kg > 50 pCi/liter or kg	5.0 pCi/liter 10% of known value
Strontium-90 <sup>b</sup>	2 to 30 pCi/liter or kg > 30 pCi/liter or kg	5.0 pCi/liter 10% of known value
Potassium-40	> 0.1 g/liter or kg	5% of known value
Gross alpha	20 pCi/liter > 20 pCi/liter	5.0 pCi/liter 25% of known value
Gross beta	100 pCi/liter > 100 pCi/liter	5.0 pCi/liter 5% of known value
Tritium	4,000 pCi/liter  > 4,000 pCi/liter	1s = (pCi/liter) = 169.85 x (known) <sup>0.0933</sup> 10% of known value
Radium-226,-228	0.1 pCi/liter	15% of known value
Plutonium	0.1 pCi/liter, gram, or sample	10% of known value
Iodine-131, Iodine-129 <sup>b</sup>	55 pCi/liter > 55 pCi/liter	6.0 pCi/liter 10% of known value
Uranium-238, Nickel-63 <sup>b</sup> Technetium-99 <sup>b</sup>	35 pCi/liter > 35 pCi/liter	6.0 pCi/liter 15% of known value
Iron-55 <sup>b</sup>	50 to 100 pCi/liter > 100 pCi/liter	10 pCi/liter 10% of known value
Others <sup>b</sup>	---	20% of known value

<sup>a</sup> From EPA publication, "Environmental Radioactivity Laboratory Intercomparison Studies Program, Fiscal Year, 1981-1982, EPA-600/4-81-004.

<sup>b</sup> Laboratory limit.



TABLE A-1. Interlaboratory Comparison Crosscheck program, Environmental Resource Associates (ERA)<sup>a</sup>.

Lab Code	Date	Analysis	Concentration (pCi/L)		
			Laboratory Result <sup>b</sup>	ERA Result <sup>c</sup>	Control Limits
STW-973	02/17/03	Sr-89	17.0 ± 0.5	15.9 ± 5.0	7.2 - 24.6
STW-973	02/17/03	Sr-90	8.9 ± 0.3	9.0 ± 5.0	0.4 - 17.7
STW-974	02/17/03	Ba-133	14.5 ± 0.9	19.5 ± 5.0	10.8 - 28.2
STW-974	02/17/03	Co-60	37.5 ± 0.9	37.4 ± 5.0	28.7 - 46.1
STW-974	02/17/03	Cs-134	18.2 ± 0.6	17.8 ± 5.0	9.1 - 26.5
STW-974	02/17/03	Cs-137	42.7 ± 1.0	44.2 ± 5.0	35.5 - 52.9
STW-974	02/17/03	Zn-65	56.8 ± 2.2	60.3 ± 6.0	49.9 - 70.7
STW-975 <sup>d</sup>	02/17/03	Gr. Alpha	18.4 ± 0.3	37.6 ± 9.4	21.3 - 53.9
STW-975	02/17/03	Gr. Beta	11.7 ± 0.5	8.6 ± 5.0	0.0 - 17.2
STW-976	02/17/03	Ra-226	4.1 ± 0.1	4.7 ± 0.7	3.5 - 6.0
STW-976	02/17/03	Ra-228	7.6 ± 0.5	6.5 ± 1.6	3.7 - 9.3
STW-976	02/17/03	Uranium	52.9 ± 1.9	53.7 ± 5.4	44.4 - 63.0
STW-983	05/19/03	H-3	1290.0 ± 25.0	1250.0 ± 331.0	678.0 - 1820.0
STW-984	05/19/03	I-131	19.7 ± 1.3	20.8 ± 3.0	15.6 - 26.0
STW-985	05/19/03	Gr. Alpha	54.4 ± 3.0	70.3 ± 17.6	39.9 - 101.0
STW-985	05/19/03	Ra-226	14.9 ± 0.2	16.5 ± 2.5	12.2 - 20.8
STW-985	05/19/03	Ra-228	13.1 ± 0.6	10.3 ± 2.6	5.8 - 14.8
STW-985	05/19/03	Uranium	14.5 ± 0.4	15.1 ± 3.0	9.9 - 20.3
STW-986	05/19/03	Co-60	56.9 ± 8.6	63.8 ± 5.0	55.1 - 72.5
STW-986 <sup>e</sup>	05/19/03	Cs-134	61.6 ± 6.6	75.7 ± 5.0	67.0 - 84.4
STW-986	05/19/03	Cs-137	143.0 ± 1.2	150.0 ± 7.5	137.0 - 163.0
STW-986	05/19/03	Gr. Beta	309.0 ± 2.7	363.0 ± 54.5	269.0 - 457.0
STW-986	05/19/03	Sr-89	33.1 ± 0.2	31.3 ± 5.0	22.6 - 40.0
STW-986	05/19/03	Sr-90	28.8 ± 1.3	27.4 ± 5.0	18.7 - 36.1
STW-988	08/18/03	Ra-226	13.3 ± 1.1	13.4 ± 2.0	9.9 - 16.9
STW-988	08/18/03	Ra-228	11.5 ± 1.0	12.5 ± 3.1	7.1 - 17.9
STW-988	08/18/03	Uranium	12.3 ± 0.4	11.4 ± 3.0	6.2 - 16.6
STW-989	08/18/03	Ba-133	18.1 ± 1.9	20.7 ± 5.0	12.0 - 29.4
STW-989	08/18/03	Co-60	35.9 ± 1.3	37.4 ± 5.0	28.7 - 46.1
STW-989	08/18/03	Cs-134	32.6 ± 1.8	32.6 ± 5.0	23.9 - 41.3
STW-989	08/18/03	Cs-137	48.3 ± 0.6	44.3 ± 5.0	35.6 - 53.0
STW-989	08/18/03	Zn-65	58.9 ± 2.1	60.2 ± 6.0	49.8 - 70.6
STW-990	08/18/03	Gr. Alpha	41.8 ± 3.4	56.2 ± 16.3	36.9 - 93.3
STW-990 <sup>f</sup>	08/18/03	Gr. Beta	51.3 ± 3.0	31.6 ± 5.0	22.9 - 40.3
STW-991	08/18/03	Sr-89	57.2 ± 4.3	58.8 ± 5.0	50.1 - 67.5
STW-991	08/18/03	Sr-90	21.2 ± 0.9	20.6 ± 5.0	11.9 - 29.3

TABLE A-1. Interlaboratory Comparison Crosscheck program, Environmental Resource Associates (ERA)<sup>a</sup>.

Lab Code	Date	Analysis	Concentration (pCi/L)		
			Laboratory Result <sup>b</sup>	ERA Result <sup>c</sup>	Control Limits
STW-997	11/18/03	Gr. Alpha	37.0 ± 2.0	29.5 ± 7.4	16.7 - 42.3
STW-997	11/18/03	Gr. Beta	26.5 ± 0.8	26.3 ± 5.0	17.6 - 35.0
STW-998	11/18/03	I-131	14.8 ± 0.3	16.5 ± 3.0	11.3 - 21.7
STW-999	11/18/03	Ra-226	17.2 ± 1.1	17.8 ± 2.7	13.2 - 22.4
STW-999	11/18/03	Ra-228	6.6 ± 0.3	6.8 ± 1.7	3.8 - 9.7
STW-999	11/18/03	Uranium	11.7 ± 0.3	11.7 ± 3.0	6.5 - 16.9
STW-1000	11/18/03	H-3	15900.0 ± 174.0	14300.0 ± 1430.0	11800.0 - 16800.0
STW-1001	11/18/03	Gr. Alpha	32.9 ± 0.3	54.2 ± 3.0	30.7 - 77.7
STW-1001	11/18/03	Ra-226	16.5 ± 0.9	16.1 ± 2.4	11.9 - 20.3
STW-1001	11/18/03	Ra-228	6.2 ± 0.5	5.5 ± 1.4	3.1 - 7.9
STW-1001	11/18/03	Uranium	9.7 ± 1.5	9.3 ± 13.6	4.1 - 14.5
STW-1002	11/18/03	Co-60	27.7 ± 1.9	27.7 ± 5.0	19.0 - 36.4
STW-1002	11/18/03	Cs-134	21.5 ± 1.1	23.4 ± 5.0	17.6 - 29.2
STW-1002	11/18/03	Cs-137	66.3 ± 2.8	64.2 ± 5.0	55.5 - 72.9
STW-1002	11/18/03	Gr. Beta	159.0 ± 2.5	168.0 ± 5.0	124.0 - 212.0
STW-1002	11/18/03	Sr-89	48.5 ± 0.4	50.4 ± 5.0	41.7 - 59.1
STW-1002	11/18/03	Sr-90	10.1 ± 3.0	10.2 ± 25.2	1.5 - 18.9

<sup>a</sup> Results obtained by Environmental, Inc., Midwest Laboratory as a participant in the environmental samples crosscheck program operated by Environmental Resources Associates (ERA).

<sup>b</sup> Unless otherwise indicated, the laboratory result is given as the mean ± standard deviation for three determinations.

<sup>c</sup> Results are presented as the known values, expected laboratory precision (1 sigma, 1 determination) and control limits as provided by ERA.

<sup>d</sup> Recount of the original sample still low. The ERA blank was spiked in the lab; known value of 20.1 pCi/L, measured 21.5 ± 1.1 pCi/L. No explanation for ERA test failure.

<sup>e</sup> Lower bias observed for gamma spectroscopic analysis. The undiluted sample was reanalyzed; Results of reanalysis, Co-60: 62.3 pCi/L., Cs-134: 69.2 pCi/L., Cs-137: 152.3 pCi/L.

<sup>f</sup> Reason for deviation unknown. A recount of the original planchets averaged 43.4 pCi/L. Cs-137 activity by gamma spectroscopy; 28.3 pCi/L. Result of reanalysis; 29.3 pCi/L.

TABLE A-2. Crosscheck program results; Thermoluminescent Dosimetry, (TLDs).

Lab Code	TLD Type	Date	Description	Known Value	mR	
					Lab Result ± 2 sigma	Control Limits
<u>Environmental, Inc.</u>						
2003-1	CaSO4: Dy Cards	8/8/2003	Reader 1, 120	4.69	4.74 ± 0.54	3.28 - 6.10
2003-1	CaSO4: Dy Cards	8/8/2003	Reader 1, 150	3.00	3.02 ± 0.20	2.10 - 3.90
2003-1	CaSO4: Dy Cards	8/8/2003	Reader 1, 180	2.08	1.89 ± 0.45	1.46 - 2.70
2003-1	CaSO4: Dy Cards	8/8/2003	Reader 1, 180	2.08	2.11 ± 0.22	1.46 - 2.70
2003-1	CaSO4: Dy Cards	8/8/2003	Reader 1, 30	75.00	84.40 ± 4.87	52.50 - 97.50
2003-1	CaSO4: Dy Cards	8/8/2003	Reader 1, 60	18.75	19.11 ± 1.86	13.13 - 24.38
2003-1	CaSO4: Dy Cards	8/8/2003	Reader 1, 60	18.75	22.82 ± 5.41	13.13 - 24.38
2003-1	CaSO4: Dy Cards	8/8/2003	Reader 1, 90	8.33	9.05 ± 1.17	5.83 - 10.83
2003-1	CaSO4: Dy Cards	8/8/2003	Reader 1, 90	8.33	7.60 ± 1.08	5.83 - 10.83
<u>Environmental, Inc.</u>						
2003-2	CaSO4: Dy Cards	1/12/2004	Reader 1, 30	61.96	73.50 ± 2.58	43.37 - 80.55
2003-2	CaSO4: Dy Cards	1/12/2004	Reader 1, 60	15.49	19.70 ± 0.51	10.84 - 20.14
2003-2	CaSO4: Dy Cards	1/12/2004	Reader 1, 60	15.49	16.93 ± 1.37	10.84 - 20.14
2003-2	CaSO4: Dy Cards	1/12/2004	Reader 1, 90	6.88	8.06 ± 0.60	4.82 - 8.94
2003-2	CaSO4: Dy Cards	1/12/2004	Reader 1, 90	6.88	6.64 ± 0.58	4.82 - 8.94
2003-2	CaSO4: Dy Cards	1/12/2004	Reader 1, 120	3.87	4.39 ± 0.17	2.71 - 5.03
2003-2	CaSO4: Dy Cards	1/12/2004	Reader 1, 150	2.48	2.34 ± 0.18	1.74 - 3.22
2003-2	CaSO4: Dy Cards	1/12/2004	Reader 1, 150	2.48	2.51 ± 0.16	1.74 - 3.22
2003-2	CaSO4: Dy Cards	1/12/2004	Reader 1, 180	1.72	2.01 ± 0.13	1.20 - 2.24

TABLE A-3. In-House "Spike" Samples

Lab Code	Sample Type	Date	Analysis	Concentration (pCi/L) <sup>a</sup>		
				Laboratory results 2s, n=1 <sup>b</sup>	Known Activity	Control Limits <sup>c</sup>
SPW-356	water	1/2/2003	Sr-90	34.04 ± 1.57	30.93	24.74 - 37.12
W-10303	water	1/3/2003	Gr. Beta	63.24 ± 1.20	63.90	53.90 - 73.90
W-11303	water	1/13/2003	Gr. Beta	59.75 ± 1.10	63.90	53.90 - 73.90
W-12103	water	1/21/2003	Gr. Beta	61.56 ± 1.59	63.99	53.99 - 73.99
SPAP-446	Air Filter	1/31/2003	Gr. Beta	1.49 ± 0.02	1.52	-8.48 - 11.52
SPW-468	water	1/31/2003	H-3	95982.00 ± 865.00	89607.00	71685.60 - 107528.40
W-20703	water	2/7/2003	Fe-55	9095.00 ± 114.00	10587.00	8469.60 - 12704.40
SPU-1347	Urine	3/1/2003	H-3	1724.00 ± 412.00	1784.33	1101.27 - 2467.39
DW-30303	water	3/3/2003	Gr. Beta	65.44 ± 0.59	63.90	53.90 - 73.90
SPCH-964	Charcoal	3/8/2003	I-131(G)	73.37 ± 0.28	69.45	59.45 - 79.45
SPMI-1086	Milk	3/13/2003	Cs-137	57.18 ± 8.03	49.50	39.50 - 59.50
SPMI-1086	Milk	3/13/2003	I-131	75.13 ± 12.01	67.60	54.08 - 81.12
SPMI-1086	Milk	3/13/2003	I-131(G)	65.81 ± 1.06	67.56	57.56 - 77.56
SPW-1088	water	3/13/2003	Co-60	27.16 ± 4.79	28.20	18.20 - 38.20
SPW-1088	water	3/13/2003	Cs-137	51.74 ± 9.15	49.50	39.50 - 59.50
SPW-1088	water	3/13/2003	I-131(G)	68.14 ± 12.92	67.60	57.60 - 77.60
SPW-1088	water	3/13/2003	I-131	76.94 ± 1.13	67.56	54.05 - 81.07
SPVE-1110	Vegetation	3/14/2003	I-131(G)	122.80 ± 16.80	124.00	111.60 - 136.40
SPW-1194	water	3/21/2003	Co-60	31.09 ± 6.28	28.15	18.15 - 38.15
SPW-1194	water	3/21/2003	Cs-137	55.11 ± 0.13	49.50	39.50 - 59.50
SPW-1194	water	3/21/2003	I-131(G)	66.17 ± 9.15	67.60	57.60 - 77.60
W-32103	water	3/21/2003	C-14	5201.00 ± 16.60	4966.00	2979.60 - 6952.40
SPCH-1429	Charcoal	4/1/2003	I-131(G)	8.83 ± 0.11	9.18	-0.82 - 19.18
W-40103	water	4/1/2003	Gr. Beta	67.74 ± 0.52	63.39	53.39 - 73.39
SPF-1407	Fish	4/2/2003	Cs-134	0.58 ± 0.03	0.59	0.35 - 0.83
SPF-1407	Fish	4/2/2003	Cs-137	1.29 ± 0.06	1.32	0.79 - 1.85
SPAP-1409	Air Filter	4/2/2003	Gr. Beta	1.44 ± 0.02	1.51	-8.49 - 11.51
SPU-41203	Urine	4/12/2003	H-3	1798.50 ± 409.30	1784.33	1101.27 - 2467.39
SPU-41703	Urine	4/17/2003	H-3	1625.10 ± 401.30	1784.33	1101.27 - 2467.39
SPW-2022	water	4/25/2003	H-3	89007.00 ± 798.00	88463.00	70770.40 - 106155.60
SPW-2053	water	4/28/2003	Cs-137	45.70 ± 9.44	49.35	39.35 - 59.35
SPW-2053	water	4/28/2003	Sr-90	47.51 ± 1.87	44.47	35.58 - 53.36
SPMI-2055	Milk	4/28/2003	Cs-137	61.65 ± 7.17	65.80	55.80 - 75.80
SPMI-2055	Milk	4/28/2003	Sr-90	38.45 ± 1.59	44.74	35.79 - 53.69
W-50603	water	5/6/2003	Gr. Beta	70.95 ± 0.53	63.39	53.39 - 73.39
W-60303	water	6/3/2003	Gr. Beta	63.00 ± 0.51	65.73	55.73 - 75.73
SPW-3960	water	7/15/2003	H-3	88700.00 ± 822.00	87369.00	69895.20 - 104842.80
SPMI-4019	Milk	7/18/2003	Cs-137	47.17 ± 7.22	49.11	39.11 - 59.11
SPMI-4019	Milk	7/18/2003	Sr-89	40.95 ± 4.88	49.49	39.49 - 59.49
SPMI-4019	Milk	7/18/2003	Sr-90	45.30 ± 1.73	44.24	35.39 - 53.09
SPW-4023	water	7/18/2003	Cs-137	51.92 ± 6.24	49.11	39.11 - 59.11
SPW-4023	water	7/18/2003	Sr-89	42.49 ± 10.23	49.49	39.49 - 59.49
SPW-4023	water	7/18/2003	Sr-90	49.69 ± 3.04	44.24	35.39 - 53.09
SPW-4518	water	8/8/2003	Fe-55	8176.00 ± 107.00	9330.00	7464.00 - 11196.00

TABLE A-3. In-House "Spike" Samples

Lab Code	Sample Type	Date	Analysis	Concentration (pCi/L)		
				Laboratory results 2s, n=1 <sup>b</sup>	Known Activity	Control Limits <sup>c</sup>
SPW-6197	water	10/16/2003	Tc-99	540.14 ± 54.00	539.73	377.81 - 701.65
SPAP-3958	Air Filter	10/28/2003	Gr. Beta	1.45 ± 0.02	1.50	-8.50 - 11.50
SPW-6401	water	10/28/2003	H-3	84867.00 ± 826.00	85984.00	68787.20 - 103180.80
SPAP-6403	Air Filter	10/28/2003	Gr. Beta	1.71 ± 0.02	1.49	-8.51 - 11.49
SPF-6418	Fish	10/28/2003	Cs-134	0.50 ± 0.02	0.49	0.29 - 0.69
SPF-6418	Fish	10/28/2003	Cs-137	1.37 ± 0.05	1.30	0.78 - 1.82
SPW-6421	water	10/28/2003	Fe-55	104.18 ± 1.26	88.18	68.18 - 108.18
SPMI-7459	Milk	12/12/2003	Cs-134	41.06 ± 2.45	41.88	31.88 - 51.88
SPMI-7459	Milk	12/12/2003	Cs-137	48.48 ± 4.99	48.64	38.64 - 58.64
SPMI-7459	Milk	12/12/2003	Sr-89	55.94 ± 4.12	65.80	52.64 - 78.96
SPMI-7459	Milk	12/12/2003	Sr-90	41.86 ± 1.57	43.80	35.04 - 52.56
SPW-7461	water	12/12/2003	Cs-134	44.07 ± 1.49	41.88	31.88 - 51.88
SPW-7461	water	12/12/2003	Cs-137	50.26 ± 2.67	48.64	38.64 - 58.64
SPW-7461	water	12/12/2003	Sr-89	56.41 ± 4.87	65.80	52.64 - 78.96
SPW-7461	water	12/12/2003	Sr-90	48.44 ± 1.84	43.80	35.04 - 52.56

<sup>c</sup> Control limits are based on Attachment A, Page A2 of this report.

NOTE: For fish, Jello is used for the Spike matrix. For Vegetation, cabbage is used for the Spike matrix.

TABLE A-4. In-House "Blank" Samples

Lab Code	Sample Type	Date	Analysis	Concentration (pCi/L) <sup>a</sup>		Acceptance Criteria (4.66 σ)
				Laboratory results (4.66σ)		
				LLD	Activity <sup>b</sup>	
SPW-357	water	1/2/2003	Sr-90	0.50	0.12 ± 0.25	1
W-10303	water	1/3/2003	Gr. Beta	0.12	0.022 ± 0.10	3.2
W-11303	water	1/13/2003	Gr. Beta	0.14	0.035 ± 0.10	3.2
W-12103	water	1/21/2003	Gr. Beta	0.12	0.029 ± 0.09	3.2
SPAP-447	Air Filter	1/31/2003	Gr. Beta	0.00	-0.0034 ± 0.00	3.2
SPW-469	water	1/31/2003	H-3	160.20	19.3 ± 80.30	200
W-20103	water	2/1/2003	Gr. Beta	0.17	0.0 ± 0.12	3.2
W-20703	water	2/7/2003	Fe-55	802.00	149 ± 498.00	1000
DW-30303		3/3/2003	Gr. Beta	0.15	0.007 ± 0.11	3.2
SPCH-965	Charcoal Cani:	3/8/2003	I-131(G)	0.01		9.6
SPMI-1087	Milk	3/13/2003	Cs-134	7.49		10
SPMI-1087	Milk	3/13/2003	Cs-137	7.90		10
SPMI-1087	Milk	3/13/2003	I-131	0.33	-0.013 ± 0.18	0.5
SPMI-1087	Milk	3/13/2003	I-131(G)	7.76		20
SPW-1089	water	3/13/2003	Co-60	4.48		10
SPW-1089	water	3/13/2003	Cs-134	5.60		10
SPW-1089	water	3/13/2003	Cs-137	4.32		10
SPW-1089	water	3/13/2003	I-131	0.29	-0.050 ± 0.16	0.5
SPVE-1111	Vegetation	3/14/2003	I-131(G)	7.53		20
W-32103	water	3/21/2003	C-14	17.50	-0.4 ± 9.200	200
SPCH-1430	Charcoal Cani:	4/1/2003	I-131(G)	0.01		9.6
W-40103	water	4/1/2003	Gr. Beta	0.14	-0.11 ± 0.100	3.2
SPF-1408	Fish	4/2/2003	Cs-134	0.01		100
SPF-1408	Fish	4/2/2003	Cs-137	0.01		100
SPAP-1410	Air Filter	4/2/2003	Gr. Beta	0.00	-0.0029 ± 0.002	3.2
SPU-41203	Urine	4/12/2003	H-3	653.99	542.28 ± 364.780	200
SPU-41703	Urine	4/17/2003	H-3	648.35	100.1 ± 344.800	200
SPW-2054	water	4/28/2003	Cs-137	3.16		10
SPW-2054	water	4/28/2003	Sr-89	0.55	0.45 ± 0.50	5
SPW-2054	water	4/28/2003	Sr-90	0.55	0.072 ± 0.260	1
SPMI-2056 <sup>c</sup>	Milk	4/28/2003	Sr-90	0.77	0.66 ± 0.430	1
SPMI-2056	Milk	4/28/2003	Cs-137	2.74		10
SPMI-2056	Milk	4/28/2003	I-131(G)	3.54		20
W-50603	water	5/6/2003	Gr. Beta	0.12	0 ± 0.090	3.2
W-60303	water	6/3/2003	Gr. Beta	0.14	-0.035 ± 0.095	3.2
SPW-3960	water	7/15/2003	H-3	156.60	53.4 ± 80.200	200
SPMI-4018	Milk	7/18/2003	Cs-137	4.10		10
SPMI-4018	Milk	7/18/2003	Sr-89	0.73	0.39 ± 0.880	5
SPMI-4018 <sup>c</sup>	Milk	7/18/2003	Sr-90	0.51	0.93 ± 0.340	1
SPW-4024	water	7/18/2003	Sr-89	0.83	0.21 ± 0.730	5
SPW-4024	water	7/18/2003	Sr-90	0.62	0.09 ± 0.300	1
SPW-4519	water	8/8/2003	Fe-55	527.00	87 ± 369.000	1000
SPW-6401	water	10/28/2003	H-3	163.80	-23.8 ± 85.000	200

TABLE A-4. In-House "Blank" Samples

Lab Code	Sample Type	Date	Analysis	Concentration (pCi/L) <sup>a</sup>		
				Laboratory results (4.66σ)		Acceptance Criteria (4.66 σ)
				LLD	Activity <sup>b</sup>	
SPAP-6404	Air Filter	10/28/2003	Gr. Beta	0.87	-0.99 ± 0.440	3.2
SPF-6419	Fish	10/28/2003	Cs-134	0.01		100
SPF-6419	Fish	10/28/2003	Cs-137	0.01		100
SPMI-7460	Milk	12/12/2003	Cs-134	4.52		10
SPMI-7460	Milk	12/12/2003	Cs-137	5.77		10
SPMI-7460 <sup>c</sup>	Milk	12/12/2003	Sr-90	0.50	1.26 ± 0.370	1

<sup>a</sup> Liquid sample results are reported in pCi/Liter, air filters( pCi/filter), charcoal (pCi/charcoal canister), and solid samples (pCi/kg).

<sup>b</sup> The activity reported is the net activity result.

<sup>c</sup> Low levels of Sr-90 are still detected in the environment. A concentration of (1-5 pCi/L) in milk is not unusual.

TABLE A-5. In-House "Duplicate" Samples

Lab Code	Date	Analysis	Concentration (pCi/L) <sup>a</sup>		Averaged Result
			First Result	Second Result	
MI-24, 25	1/2/2003	K-40	1362.00 ± 117.00	1377.00 ± 188.00	1369.50 ± 110.72
MI-24, 25	1/2/2003	Sr-90	1.45 ± 0.40	2.21 ± 0.50	1.83 ± 0.32
CF-47, 48	1/2/2003	Gr. Beta	2.72 ± 0.10	2.84 ± 0.10	2.78 ± 0.07
CF-47, 48	1/2/2003	K-40	2.61 ± 0.31	2.32 ± 0.12	2.47 ± 0.17
AP-8827, 8828	1/2/2003	Be-7	0.06 ± 0.01	0.05 ± 0.02	0.05 ± 0.01
AP-8869, 8870	1/2/2003	Be-7	0.04 ± 0.02	0.05 ± 0.02	0.05 ± 0.01
MI-119, 120	1/8/2003	K-40	1351.90 ± 116.10	1234.70 ± 108.70	1293.30 ± 79.52
MI-119, 120	1/8/2003	Sr-90	2.22 ± 0.43	1.88 ± 0.40	2.05 ± 0.30
MI-213, 214	1/14/2003	K-40	1372.30 ± 104.80	1303.80 ± 109.10	1338.05 ± 75.64
MI-213, 214	1/14/2003	Sr-90	1.81 ± 0.41	2.29 ± 0.45	2.05 ± 0.31
MI-262, 263	1/15/2003	K-40	1399.20 ± 200.70	1347.70 ± 126.40	1373.45 ± 118.59
S-696, 697	1/29/2003	Gr. Alpha	24.70 ± 4.89	23.23 ± 4.64	23.97 ± 3.37
S-696, 697	1/29/2003	Gr. Beta	22.89 ± 2.67	22.71 ± 2.73	22.80 ± 1.91
MI-448, 449	2/3/2003	K-40	1159.70 ± 157.90	1396.40 ± 106.20	1278.05 ± 95.15
SW-470, 471	2/3/2003	Gr. Beta	13.62 ± 1.23	15.21 ± 1.21	14.42 ± 0.86
SW-470, 471	2/3/2003	K-40 (ICP)	5.10 ± 0.51	5.20 ± 0.52	5.15 ± 0.36
SW-470, 471	2/3/2003	K-40	5.80 ± 0.51	5.90 ± 0.52	5.85 ± 0.36
MI-517, 518	2/4/2003	K-40	1437.70 ± 125.50	1357.70 ± 188.00	1397.70 ± 113.02
MI-541, 542	2/5/2003	K-40	1443.00 ± 194.80	1385.20 ± 190.10	1414.10 ± 136.09
MI-620, 621	2/11/2003	K-40	1294.70 ± 115.10	1234.10 ± 165.10	1264.40 ± 100.63
DW-922, 923	3/4/2003	I-131	0.67 ± 0.16	0.79 ± 0.16	0.73 ± 0.11
CF-1048, 1049 b	3/10/2003	K-40	3.09 ± 0.12	2.67 ± 0.07	2.88 ± 0.07
LW-1152, 1153	3/13/2003	H-3	1147.26 ± 122.56	1094.42 ± 120.92	1120.84 ± 86.09
F-1120, 1121	3/14/2003	Cs-137	0.04 ± 0.02	0.05 ± 0.01	0.05 ± 0.01
F-1120, 1121	3/14/2003	Gr. Beta	2.04 ± 0.06	2.11 ± 0.06	2.08 ± 0.04
F-1120, 1121	3/14/2003	K-40	1.93 ± 0.38	1.89 ± 0.25	1.91 ± 0.23
DW-1278, 1279	3/25/2003	I-131	0.37 ± 0.22	0.34 ± 0.29	0.36 ± 0.18
SO-1380, 1381	3/25/2003	Gr. Beta	18.60 ± 2.68	20.53 ± 2.83	19.57 ± 1.95
LW-1299, 1300	3/27/2003	Gr. Beta	2.35 ± 0.55	2.48 ± 0.56	2.42 ± 0.39
LW-1320, 1321	3/27/2003	H-3	487.12 ± 104.43	422.00 ± 102.00	454.56 ± 72.99
W-1403, 1404	3/31/2003	Sr-90	0.96 ± 0.32	1.10 ± 0.42	1.03 ± 0.26
AP-2019, 2020	3/31/2003	Be-7	0.07 ± 0.01	0.08 ± 0.01	0.07 ± 0.01
MI-1422, 1423	4/1/2003	K-40	1410.00 ± 176.00	1340.00 ± 114.00	1375.00 ± 104.85
MI-2170, 2171	4/1/2003	K-40	1452.30 ± 129.10	1472.50 ± 191.00	1462.40 ± 115.27
MI-1422, 1423	4/2/2003	Sr-90	1.84 ± 0.42	1.15 ± 0.39	1.50 ± 0.29
AP-1633, 1634	4/2/2003	Be-7	0.05 ± 0.01	0.06 ± 0.01	0.06 ± 0.01
AP-1871, 1872	4/2/2003	Be-7	0.07 ± 0.01	0.07 ± 0.01	0.07 ± 0.01
AP-1974, 1975	4/2/2003	Be-7	0.08 ± 0.02	0.07 ± 0.02	0.08 ± 0.01
LW-1828, 1829	4/11/2003	Gr. Beta	2.49 ± 0.58	3.42 ± 0.63	2.96 ± 0.43
S-1544, 1545	4/15/2003	K-40	15.84 ± 2.36	15.41 ± 2.02	15.63 ± 1.55
DW-1913, 1914	4/15/2003	I-131	0.29 ± 0.21	0.42 ± 0.19	0.36 ± 0.14
MI-1996, 1997	4/21/2003	Sr-90	2.05 ± 0.74	3.25 ± 0.91	2.65 ± 0.58
MI-1996, 1997	4/22/2003	K-40	1580.20 ± 118.90	1602.10 ± 120.40	1591.15 ± 84.61



TABLE A-5. In-House "Duplicate" Samples

Lab Code	Date	Analysis	Concentration (pCi/L) <sup>a</sup>		Averaged Result
			First Result	Second Result	
LW-2063, 2064	4/28/2003	Gr. Beta	2.33 ± 0.66	2.68 ± 0.60	2.51 ± 0.45
SWU-2275, 2276	4/28/2003	Gr. Beta	3.62 ± 0.67	4.60 ± 0.71	4.11 ± 0.49
G-2149, 2150	4/30/2003	Be-7	0.71 ± 0.19	0.69 ± 0.20	0.70 ± 0.14
TD-2339, 2340	5/1/2003	H-3	221.00 ± 91.00	161.00 ± 88.00	191.00 ± 63.29
SO-2381, 2382	5/1/2003	Cs-137	0.11 ± 0.03	0.10 ± 0.02	0.10 ± 0.02
SO-2381, 2382	5/1/2003	Gr. Alpha	11.14 ± 5.15	10.39 ± 5.60	10.77 ± 3.80
SO-2381, 2382	5/1/2003	Gr. Beta	35.18 ± 4.69	39.66 ± 5.24	37.42 ± 3.52
SO-2381, 2382	5/1/2003	K-40	18.29 ± 0.84	17.83 ± 0.84	18.06 ± 0.59
SO-2381, 2382	5/1/2003	Sr-90	0.06 ± 0.02	0.10 ± 0.02	0.08 ± 0.01
DW-2317, 2318	5/6/2003	I-131	1.77 ± 0.27	1.47 ± 0.26	1.62 ± 0.19
BS-2595, 2596	5/6/2003	Cs-137	0.06 ± 0.02	0.06 ± 0.02	0.06 ± 0.02
BS-2595, 2596	5/6/2003	K-40	13.74 ± 0.62	14.10 ± 0.73	13.92 ± 0.48
U-2484, 2485	5/9/2003	H-3	512.00 ± 100.00	370.00 ± 95.00	441.00 ± 68.97
SO-2645, 2646	5/14/2003	Be-7	1.18 ± 0.42	1.21 ± 0.35	1.19 ± 0.27
SO-2645, 2646	5/14/2003	Cs-137	0.11 ± 0.04	0.09 ± 0.05	0.10 ± 0.03
SO-2645, 2646	5/14/2003	K-40	16.50 ± 1.13	15.33 ± 1.09	15.91 ± 0.79
MI-2696, 2697	5/19/2003	K-40	1320.40 ± 124.50	1394.10 ± 113.00	1357.25 ± 84.07
MI-2696, 2697	5/19/2003	Sr-90	1.49 ± 0.47	2.01 ± 0.45	1.75 ± 0.32
SO-2787, 2788	5/28/2003	Cs-137	0.27 ± 0.04	0.23 ± 0.04	0.25 ± 0.03
SO-2787, 2788	5/28/2003	Gr. Beta	19.62 ± 1.73	20.81 ± 1.72	20.21 ± 1.22
SO-2787, 2788	5/28/2003	K-40	14.77 ± 1.02	14.41 ± 1.00	14.59 ± 0.71
MI-2840, 2841	5/28/2003	K-40	1179.50 ± 167.80	1401.70 ± 120.20	1290.60 ± 103.20
SWU-2864, 2865	5/28/2003	Gr. Beta	3.39 ± 0.59	3.41 ± 0.64	3.40 ± 0.43
BS-2888, 2889	5/29/2003	Cs-137	0.05 ± 0.02	0.07 ± 0.04	0.06 ± 0.02
BS-2888, 2889	5/29/2003	K-40	9.70 ± 0.83	10.17 ± 0.87	9.93 ± 0.60
W-3230, 3231	5/30/2003	Gr. Beta	4.33 ± 1.00	3.28 ± 1.22	3.81 ± 0.79
TD-3036, 3037	6/2/2003	H-3	529.50 ± 100.00	585.50 ± 102.00	557.50 ± 71.42
SL-2909, 2910 b	6/3/2003	Gr. Beta	7.10 ± 0.15	7.60 ± 0.16	7.35 ± 0.11
SL-2909, 2910	6/3/2003	K-40	3.90 ± 0.67	3.49 ± 0.52	3.70 ± 0.42
SW-3080, 3081	6/10/2003	Gr. Alpha	4.63 ± 1.90	4.47 ± 1.71	4.55 ± 1.28
SW-3080, 3081	6/10/2003	Gr. Beta	9.07 ± 1.29	8.98 ± 1.28	9.02 ± 0.91
VE-3172, 3173	6/11/2003	K-40	2.62 ± 0.35	3.17 ± 0.58	2.90 ± 0.34
F-3742, 3743	6/11/2003	Gr. Beta	3.47 ± 0.13	3.71 ± 0.14	3.59 ± 0.10
F-3742, 3743	6/11/2003	K-40	2.94 ± 0.39	2.70 ± 0.40	2.82 ± 0.28
SO-3325, 3326	6/13/2003	Gr. Beta	20.95 ± 1.88	19.97 ± 2.01	20.46 ± 1.38
MI-3253, 3254	6/17/2003	K-40	1329.40 ± 121.80	1417.60 ± 130.90	1373.50 ± 89.40
MI-3297, 3298	6/17/2003	Sr-90	2.14 ± 0.57	2.27 ± 0.50	2.21 ± 0.38
WW-3380, 3381	6/23/2003	Gr. Beta	5.58 ± 0.69	5.03 ± 0.69	5.31 ± 0.49
SWT-3403, 3404	6/24/2003	Gr. Beta	2.80 ± 0.56	2.63 ± 0.55	2.72 ± 0.39
MI-3424, 3425	6/24/2003	K-40	1422.80 ± 185.40	1216.20 ± 170.10	1319.50 ± 125.80
SW-3862, 3863	6/24/2003	Gr. Beta	3.66 ± 1.18	3.70 ± 1.22	3.68 ± 0.85
G-3479, 3480	6/25/2003	Be-7	1.52 ± 0.25	1.43 ± 0.28	1.47 ± 0.19
G-3479, 3480	6/25/2003	K-40	5.02 ± 0.45	5.10 ± 0.48	5.06 ± 0.33
LW-3809, 3810	6/30/2003	Gr. Beta	2.12 ± 0.76	2.39 ± 0.72	2.25 ± 0.52

TABLE A-5. In-House "Duplicate" Samples

Lab Code	Date	Analysis	Concentration (pCi/L) <sup>a</sup>		Averaged Result
			First Result	Second Result	
LW-3809, 3810	6/30/2003	H-3	2814.09 ± 167.99	2812.17 ± 167.94	2813.13 ± 118.77
AP-4105, 4106	6/30/2003	Be-7	0.07 ± 0.01	0.07 ± 0.01	0.07 ± 0.01
G-3572, 3573	7/1/2003	Be-7	0.91 ± 0.24	0.81 ± 0.28	0.86 ± 0.18
G-3572, 3573	7/1/2003	Gr. Beta	6.35 ± 0.15	6.35 ± 0.15	6.35 ± 0.11
G-3572, 3573	7/1/2003	K-40	5.44 ± 0.55	5.68 ± 0.28	5.56 ± 0.31
G-3572, 3573	7/1/2003	Sr-90	0.01 ± 0.00	0.02 ± 0.00	0.01 ± 0.00
MI-3601, 3602	7/1/2003	K-40	1318.60 ± 117.40	1435.10 ± 117.80	1376.85 ± 83.16
MI-3601, 3602	7/1/2003	Sr-90	0.86 ± 0.51	1.74 ± 0.60	1.30 ± 0.39
AP-3933, 3934	7/1/2003	Be-7	0.07 ± 0.01	0.07 ± 0.01	0.07 ± 0.01
AP-4061, 4062	7/2/2003	Be-7	0.07 ± 0.01	0.08 ± 0.01	0.08 ± 0.01
AP-4147, 4148	7/2/2003	Be-7	0.08 ± 0.01	0.07 ± 0.01	0.07 ± 0.01
AP-4084, 4085	7/3/2003	Be-7	0.09 ± 0.02	0.08 ± 0.02	0.08 ± 0.01
LW-3786, 3787	7/9/2003	Gr. Beta	2.13 ± 0.56	2.93 ± 0.62	2.53 ± 0.42
WW-4168, 4169	7/11/2003	Gr. Beta	3.79 ± 1.87	4.48 ± 1.98	4.14 ± 1.36
CF-3975, 3976	7/14/2003	Be-7	1.64 ± 0.81	1.66 ± 0.57	1.65 ± 0.50
CF-3975, 3976	7/14/2003	K-40	6.54 ± 0.75	6.19 ± 0.50	6.36 ± 0.45
MI-4020, 4021	7/16/2003	K-40	1350.90 ± 174.90	1199.80 ± 153.20	1275.35 ± 116.25
DW-4272, 4273	7/29/2003	Gr. Beta	2.35 ± 0.92	2.29 ± 0.89	2.32 ± 0.64
SWU-4461, 4462	7/30/2003	Gr. Beta	2.28 ± 0.44	1.93 ± 0.43	2.10 ± 0.31
SL-4398, 4399	8/4/2003	Be-7	4.55 ± 1.05	4.50 ± 1.10	4.53 ± 0.76
SL-4398, 4399 b	8/4/2003	Gr. Beta	3.41 ± 0.12	3.12 ± 0.11	3.27 ± 0.08
SL-4398, 4399	8/4/2003	K-40	2.47 ± 0.67	2.44 ± 0.87	2.46 ± 0.55
G-4419, 4420	8/4/2003	Be-7	3.98 ± 0.63	3.93 ± 0.57	3.96 ± 0.42
G-4419, 4420	8/4/2003	Gr. Beta	5.38 ± 0.14	5.35 ± 0.16	5.37 ± 0.11
G-4419, 4420	8/4/2003	K-40	4.42 ± 0.66	4.32 ± 0.74	4.37 ± 0.50
TD-4550, 4551	8/4/2003	H-3	327.30 ± 95.10	390.20 ± 92.10	358.75 ± 66.19
MI-4482, 4483	8/6/2003	K-40	1301.40 ± 115.20	1370.30 ± 116.80	1335.85 ± 82.03
MI-4482, 4483	8/6/2003	Sr-90	0.81 ± 0.30	0.85 ± 0.31	0.83 ± 0.21
G-4526, 4527	8/6/2003	Be-7	1.47 ± 0.29	1.42 ± 0.28	1.45 ± 0.20
G-4526, 4527	8/6/2003	K-40	5.42 ± 0.56	5.21 ± 0.63	5.31 ± 0.42
SWU-4609, 4610	8/6/2003	Gr. Beta	3.22 ± 0.63	2.67 ± 0.64	2.95 ± 0.45
CW-4694, 4695	8/6/2003	Gr. Beta	1.48 ± 0.34	1.09 ± 0.34	1.29 ± 0.24
CW-4694, 4695	8/6/2003	H-3	22776.41 ± 428.73	21831.75 ± 420.10	22304.08 ± 300.12
LW-4673, 4674	8/13/2003	Gr. Beta	2.86 ± 0.65	3.75 ± 0.71	3.30 ± 0.48
MI-4735, 4736	8/19/2003	K-40	1396.30 ± 127.90	1410.10 ± 120.20	1403.20 ± 87.76
MI-4756, 4757	8/19/2003	Sr-90	1.66 ± 0.47	1.53 ± 0.44	1.60 ± 0.32
VE-4832, 4833	8/20/2003	K-40	1.96 ± 0.50	1.43 ± 0.47	1.70 ± 0.34
MI-4860, 4861	8/26/2003	K-40	1312.10 ± 191.80	1307.80 ± 109.30	1309.95 ± 110.38
SO-5082, 5083	8/28/2003	Cs-137	0.01 ± 0.00	0.01 ± 0.00	0.01 ± 0.00
SO-5082, 5083	8/28/2003	Gr. Beta	20.02 ± 1.84	20.92 ± 2.03	20.47 ± 1.37
CW-5349, 5350	8/31/2003	Gr. Beta	1.45 ± 0.39	1.55 ± 0.45	1.50 ± 0.30
CW-5349, 5350	8/31/2003	H-3	24429.50 ± 444.42	24744.25 ± 447.18	24586.88 ± 315.23
ME-4968, 4969	9/2/2003	Gr. Beta	4.90 ± 0.23	5.18 ± 0.24	5.04 ± 0.17
ME-4968, 4969	9/2/2003	K-40	2.46 ± 0.41	2.68 ± 0.37	2.57 ± 0.28

TABLE A-5. In-House "Duplicate" Samples

Lab Code	Date	Analysis	Concentration (pCi/L) <sup>a</sup>		Averaged Result
			First Result	Second Result	
DW-4989, 4990	9/2/2003	Gr. Beta	2.20 ± 1.04	3.19 ± 1.14	2.70 ± 0.77
MI-5154, 5155	9/8/2003	K-40	1365.50 ± 116.70	1456.70 ± 119.10	1411.10 ± 83.37
MI-5154, 5155	9/8/2003	Sr-90	1.19 ± 0.39	1.39 ± 0.39	1.29 ± 0.28
AP-6177, 6178	9/29/2003	Be-7	0.07 ± 0.01	0.06 ± 0.01	0.06 ± 0.01
SWU-5773, 5774	9/30/2003	Gr. Beta	2.55 ± 0.63	2.83 ± 0.60	2.69 ± 0.44
AP-6102, 6103	9/30/2003	Be-7	0.07 ± 0.01	0.05 ± 0.01	0.06 ± 0.01
G-5631, 5632	10/1/2003	Be-7	1.88 ± 0.48	2.21 ± 0.40	2.05 ± 0.31
G-5631, 5632	10/1/2003	Gr. Beta	5.87 ± 0.09	5.85 ± 0.08	5.86 ± 0.06
G-5631, 5632	10/1/2003	K-40	5.24 ± 0.77	5.26 ± 0.58	5.25 ± 0.48
SO-5660, 5661	10/1/2003	Cs-137	0.15 ± 0.04	0.16 ± 0.05	0.16 ± 0.03
SO-5660, 5661	10/1/2003	Gr. Alpha	12.72 ± 3.72	14.86 ± 3.88	13.79 ± 2.69
SO-5660, 5661	10/1/2003	Gr. Beta	32.42 ± 3.09	33.60 ± 3.04	33.01 ± 2.17
SO-5660, 5661	10/1/2003	K-40	18.93 ± 0.87	18.25 ± 1.19	18.59 ± 0.74
SO-5660, 5661	10/1/2003	Sr-90	0.03 ± 0.01	0.03 ± 0.01	0.03 ± 0.01
AP-6334, 6335	10/1/2003	Be-7	0.06 ± 0.01	0.06 ± 0.01	0.06 ± 0.01
AP-6363, 6364	10/2/2003	Be-7	0.07 ± 0.02	0.07 ± 0.02	0.07 ± 0.01
MI-5794, 5795	10/6/2003	Sr-90	1.37 ± 0.37	1.02 ± 0.37	1.19 ± 0.26
MI-5838, 5839	10/8/2003	K-40	1364.30 ± 124.10	1414.40 ± 110.40	1389.35 ± 83.05
MI-5838, 5839	10/8/2003	Sr-90	0.76 ± 0.30	1.00 ± 0.34	0.88 ± 0.23
BS-5938, 5939	10/8/2003	Cs-137	0.18 ± 0.03	0.20 ± 0.05	0.19 ± 0.03
BS-5938, 5939	10/8/2003	K-40	15.59 ± 0.70	16.69 ± 0.80	16.14 ± 0.53
SS-5959, 5960	10/13/2003	K-40	7.49 ± 0.42	7.29 ± 0.63	7.39 ± 0.38
MI-6011, 6012	10/13/2003	K-40	1165.20 ± 118.70	1191.20 ± 99.50	1178.20 ± 77.44
MI-6034, 6035	10/14/2003	Sr-90	0.86 ± 0.33	0.90 ± 0.34	0.88 ± 0.24
VE-6055, 6056	10/15/2003	Gr. Beta	5.18 ± 0.18	5.33 ± 0.18	5.25 ± 0.13
VE-6055, 6056	10/15/2003	K-40	5.31 ± 0.57	4.52 ± 0.51	4.92 ± 0.38
MI-6291, 6292	10/21/2003	K-40	1935.60 ± 147.70	1936.10 ± 116.50	1935.85 ± 94.06
MI-6291, 6292	10/21/2003	Sr-90	1.22 ± 0.39	1.41 ± 0.37	1.31 ± 0.27
SS-6435, 6436	10/21/2003	Cs-137	0.05 ± 0.02	0.05 ± 0.03	0.05 ± 0.02
SS-6435, 6436	10/21/2003	K-40	14.08 ± 0.54	14.28 ± 0.80	14.18 ± 0.48
CF-6313, 6314	10/22/2003	K-40	14.56 ± 0.45	14.70 ± 0.95	14.63 ± 0.53
SO-6528, 6529	10/22/2003	Cs-137	0.15 ± 0.03	0.16 ± 0.05	0.16 ± 0.03
SO-6528, 6529	10/22/2003	K-40	17.46 ± 0.69	17.90 ± 1.05	17.68 ± 0.63
SO-6393, 6394	10/25/2003	Cs-137	0.09 ± 0.03	0.10 ± 0.04	0.10 ± 0.03
SO-6393, 6394	10/25/2003	Gr. Beta	23.21 ± 1.98	21.76 ± 1.91	22.48 ± 1.38
SO-6393, 6394	10/25/2003	K-40	13.98 ± 0.80	14.57 ± 0.86	14.27 ± 0.59
SWT-6507, 6508	10/28/2003	Gr. Beta	2.64 ± 0.52	2.63 ± 0.53	2.63 ± 0.37
DW-6647, 6648	10/31/2003	I-131	0.46 ± 0.27	0.61 ± 0.31	0.53 ± 0.21
BS-6603, 6604	11/3/2003	Cs-137	9.03 ± 0.82	8.60 ± 1.13	8.82 ± 0.70
BS-6603, 6604	11/3/2003	Gr. Beta	26.83 ± 1.94	27.18 ± 1.95	27.01 ± 1.38
SO-6670, 6671	11/5/2003	Cs-137	0.15 ± 0.04	0.13 ± 0.04	0.14 ± 0.03
SO-6670, 6671	11/5/2003	K-40	12.96 ± 0.66	12.95 ± 0.72	12.96 ± 0.49
S-7067, 7068	11/10/2003	Cs-137	0.21 ± 0.05	0.19 ± 0.08	0.20 ± 0.05
MI-6818, 6819	11/11/2003	K-40	1695.50 ± 129.80	1709.40 ± 143.00	1702.45 ± 96.56

TABLE A-5. In-House "Duplicate" Samples

Lab Code	Date	Analysis	Concentration (pCi/L) <sup>a</sup>		Averaged Result
			First Result	Second Result	
MI-6818, 6819	11/11/2003	Sr-90	2.01 ± 0.41	1.59 ± 0.39	1.80 ± 0.28
WL-6987, 6988	11/17/2003	Fe-55	603.49 ± 53.32	619.65 ± 53.97	611.57 ± 37.93
SO-7156, 7157	11/21/2003	Cs-137	0.74 ± 0.08	0.77 ± 0.07	0.76 ± 0.06
SO-7156, 7157	11/21/2003	Gr. Alpha	14.90 ± 4.24	19.25 ± 4.45	17.07 ± 3.07
SO-7156, 7157	11/21/2003	Gr. Beta	22.97 ± 3.12	25.51 ± 2.98	24.24 ± 2.16
SO-7156, 7157	11/21/2003	K-40	12.51 ± 1.06	12.94 ± 1.07	12.73 ± 0.75
S-7281, 7282	11/24/2003	Cs-137	0.82 ± 0.15	1.16 ± 0.20	0.99 ± 0.12
SWU-7198, 7199	11/25/2003	Gr. Beta	2.60 ± 0.53	2.54 ± 0.55	2.57 ± 0.38
DW-7221, 7222	11/25/2003	Gr. Beta	12.32 ± 1.40	12.38 ± 1.43	12.35 ± 1.00
SW-7133, 7134	12/1/2003	Gr. Beta	2.10 ± 0.23	2.46 ± 0.23	2.28 ± 0.16
SW-7133, 7134	12/1/2003	K-40	1.50 ± 0.15	1.40 ± 0.14	1.45 ± 0.10
W-7519, 7520	12/1/2003	Fe-55	3.03 ± 0.65	3.12 ± 0.64	3.08 ± 0.46
SW-7805, 7806	12/1/2003	Sr-90	0.59 ± 0.32	0.56 ± 0.33	0.58 ± 0.23
VE-7399, 7400	12/9/2003	Gr. Beta	4.99 ± 0.15	5.24 ± 0.15	5.11 ± 0.11
VE-7399, 7400	12/9/2003	K-40	5.04 ± 0.46	5.34 ± 0.74	5.19 ± 0.43
SW-7540, 7541	12/9/2003	Gr. Alpha	2.64 ± 1.36	2.10 ± 1.19	2.37 ± 0.91
SW-7540, 7541	12/9/2003	Gr. Beta	6.62 ± 1.22	5.89 ± 1.35	6.25 ± 0.91
LW-7736, 7737	12/26/2003	Gr. Beta	2.62 ± 0.54	2.83 ± 0.56	2.73 ± 0.39
AP-7868, 7869	12/30/2003	Be-7	0.05 ± 0.01	0.04 ± 0.01	0.04 ± 0.01
AP-7952, 7953	12/30/2003	Be-7	0.04 ± 0.01	0.04 ± 0.01	0.04 ± 0.01
AP-7994, 7995	12/31/2003	Be-7	0.05 ± 0.02	0.05 ± 0.01	0.05 ± 0.01

Note: Duplicate analyses are performed on every twentieth sample received in-house. Results are not listed for those analyses with activities that measure below the LLD.

<sup>a</sup> Results are reported in units of pCi/L, except for air filters (pCi/Filter), food products, vegetation, soil, sediment (pCi/g).

<sup>b</sup> 200 minute count time or longer, resulting in lower error.

TABLE A-6. Department of Energy's Mixed Analyte Performance Evaluation Program (MAPEP)<sup>a</sup>.

Lab Code	Type	Date	Analysis	Concentration <sup>b</sup>		
				Laboratory result	Known Activity	Control Limits <sup>c</sup>
STW-972	water	12/01/02	Am-241	0.56 ± 0.06	0.58 ± 0.09	0.40 - 0.75
STW-972	water	12/01/02	Co-57	57.10 ± 1.90	57.00 ± 5.70	39.90 - 74.10
STW-972	water	12/01/02	Co-60	38.30 ± 0.60	38.20 ± 3.82	26.74 - 49.66
STW-972	water	12/01/02	Cs-134	395.30 ± 10.10	421.00 ± 42.10	294.70 - 547.30
STW-972	water	12/01/02	Cs-137	316.40 ± 5.30	329.00 ± 32.90	230.30 - 427.70
STW-972	water	12/01/02	Fe-55	94.90 ± 24.50	96.00 ± 9.60	67.20 - 124.80
STW-972	water	12/01/02	Mn-54	33.40 ± 0.10	32.90 ± 3.29	23.03 - 42.77
STW-972	water	12/01/02	Ni-63	123.80 ± 5.50	136.50 ± 13.70	95.55 - 177.45
STW-972	water	12/01/02	Pu-238	0.66 ± 0.06	0.83 ± 0.08	0.58 - 1.08
STW-972	water	12/01/02	Pu-239/40	0.001 ± 0.001	0.000 ± 0.000	0.000 - 0.005
STW-972	water	12/01/02	Sr-90	13.80 ± 1.00	12.31 ± 1.23	8.62 - 16.00
STW-972	water	12/01/02	Tc-99	128.10 ± 3.80	132.00 ± 13.20	92.40 - 171.60
STW-972	water	12/01/02	U-233/4	1.60 ± 0.09	1.54 ± 0.15	1.08 - 2.00
STW-972	water	12/01/02	U-238	1.64 ± 0.09	1.60 ± 0.16	1.12 - 2.08
STW-972	water	12/01/02	Zn-65	540.40 ± 9.90	516.00 ± 51.60	361.20 - 670.80
STSO-987	soil	01/01/03	Co-57	534.36 ± 2.61	530.00 ± 53.00	371.00 - 689.00
STSO-987	soil	01/01/03	Co-60	442.16 ± 2.31	420.00 ± 42.00	294.00 - 546.00
STSO-987	soil	01/01/03	Cs-134	211.00 ± 2.30	238.00 ± 23.80	166.60 - 309.40
STSO-987	soil	01/01/03	Cs-137	849.50 ± 3.30	832.00 ± 83.20	582.40 - 1081.60
STSO-987	soil	01/01/03	K-40	716.50 ± 12.80	652.00 ± 65.20	456.40 - 847.60
STSO-987	soil	01/01/03	Mn-54	148.76 ± 2.84	137.00 ± 13.70	95.90 - 178.10
STSO-987	soil	01/01/03	Ni-63	597.10 ± 23.50	770.00 ± 77.00	539.00 - 1001.00
STSO-987	soil	01/01/03	Pu-238	67.05 ± 3.10	66.90 ± 6.70	46.83 - 86.97
STSO-987	soil	01/01/03	Pu-239/40	52.80 ± 3.60	52.70 ± 5.30	36.90 - 68.50
STSO-987	soil	01/01/03	Sr-90	609.50 ± 9.80	714.00 ± 71.40	499.80 - 928.20
STSO-987	soil	01/01/03	U-233/4	99.50 ± 7.60	89.00 ± 8.90	62.30 - 115.70
STSO-987	soil	01/01/03	U-238	508.60 ± 42.20	421.00 ± 42.10	294.70 - 547.30
STSO-987	soil	01/01/03	Zn-65	492.70 ± 28.10	490.00 ± 49.00	343.00 - 637.00

<sup>a</sup> Results obtained by Environmental, Inc., Midwest Laboratory as a participant in the Department of Energy's Mixed Analyte Performance Evaluation Program, Idaho Operations office, Idaho Falls, Idaho

<sup>b</sup> All results are in Bq/kg or Bq/L as requested by the Department of Energy.

<sup>c</sup> MAPEP results are presented as the known values and expected laboratory precision (1 sigma, 1 determination) and control limits as defined by the MAPEP.

TABLE A-7. Environmental Measurements Laboratory Quality Assessment Program (EML)

Lab Code	Type	Date	Analysis	Concentration <sup>a</sup>		Control Limits <sup>c</sup>
				Laboratory results	EML Result <sup>b</sup>	
STW-977	water	03/01/03	Gr. Alpha	304.30 ± 53.10	377.50	0.58 - 1.29
STW-977	water	03/01/03	Gr. Beta	615.80 ± 14.70	627.50	0.61 - 1.43
STW-978	water	03/01/03	Am-241	2.00 ± 0.10	2.13	0.79 - 1.41
STW-978	water	03/01/03	Co-60	221.30 ± 1.20	234.00	0.80 - 1.20
STW-978 <sup>a</sup>	water	03/01/03	Cs-134	23.30 ± 1.10	30.50	0.80 - 1.30
STW-978	water	03/01/03	Cs-137	61.40 ± 0.60	63.80	0.80 - 1.22
STW-978 <sup>e</sup>	water	03/01/03	H-3	341.90 ± 22.70	390.00	0.78 - 2.45
STW-978	water	03/01/03	Pu-238	3.70 ± 0.20	3.33	0.74 - 1.20
STW-978	water	03/01/03	Pu-239/40	4.40 ± 0.10	3.92	0.79 - 1.20
STW-978	water	03/01/03	Sr-90	4.60 ± 0.30	4.34	0.69 - 1.34
STW-978	water	03/01/03	Uranium	5.10 ± 0.60	4.29	0.75 - 1.33
STSO-979	soil	03/01/03	Ac-228	55.60 ± 2.50	57.60	0.80 - 1.38
STSO-979	soil	03/01/03	Am-241	12.42 ± 0.90	15.60	0.65 - 2.28
STSO-979	soil	03/01/03	Bi-212	57.70 ± 3.20	60.60	0.50 - 1.34
STSO-979	soil	03/01/03	Bi-214	60.40 ± 3.20	67.00	0.78 - 1.42
STSO-979	soil	03/01/03	Cs-137	1416.80 ± 70.00	1450.00	0.80 - 1.25
STSO-979	soil	03/01/03	K-40	653.80 ± 11.90	636.00	0.80 - 1.32
STSO-979	soil	03/01/03	Pb-212	51.10 ± 5.20	57.90	0.78 - 1.32
STSO-979	soil	03/01/03	Pb-214	64.70 ± 5.10	71.10	0.76 - 1.46
STSO-979	soil	03/01/03	Pu-239/40	24.40 ± 0.30	23.40	0.71 - 1.30
STSO-979	soil	03/01/03	Sr-90	54.50 ± 2.60	64.40	0.67 - 2.90
STSO-979	soil	03/01/03	Uranium	245.00 ± 1.50	249.00	0.71 - 1.32
STVE-980	Vegetation	03/01/03	Am-241	3.10 ± 0.20	3.51	0.73 - 2.02
STVE-980	Vegetation	03/01/03	Cm-244	1.40 ± 0.50	2.01	0.61 - 1.59
STVE-980	Vegetation	03/01/03	Co-60	12.60 ± 0.40	12.10	0.80 - 1.44
STVE-980	Vegetation	03/01/03	Cs-137	449.70 ± 6.20	444.00	0.80 - 1.31
STVE-980	Vegetation	03/01/03	K-40	1159.00 ± 38.60	1120.00	0.79 - 1.39
STVE-980	Vegetation	03/01/03	Pu-239/40	4.80 ± 0.40	5.17	0.69 - 1.31
STVE-980	Vegetation	03/01/03	Sr-90	659.70 ± 50.40	650.00	0.55 - 1.21
STAP-981	Air Filter	03/01/03	Am-241	0.27 ± 0.10	0.34	0.70 - 2.34
STAP-981	Air Filter	03/01/03	Co-60	30.20 ± 0.30	33.50	0.80 - 1.26
STAP-981	Air Filter	03/01/03	Cs-137	90.30 ± 1.30	99.70	0.80 - 1.32
STAP-981	Air Filter	03/01/03	Mn-54	41.80 ± 0.60	43.80	0.80 - 1.35
STAP-981	Air Filter	03/01/03	Pu-238	0.52 ± 0.10	0.52	0.67 - 1.33
STAP-981	Air Filter	03/01/03	Pu-239/40	0.35 ± 0.10	0.33	0.73 - 1.26
STAP-981	Air Filter	03/01/03	Sr-90	2.50 ± 0.10	2.80	0.53 - 1.84
STAP-981	Air Filter	03/01/03	Uranium	0.51 ± 0.10	0.50	0.79 - 2.10
STAP-982	Air Filter	03/01/03	Gr. Alpha	0.90 ± 0.10	1.17	0.73 - 1.43
STAP-982	Air Filter	03/01/03	Gr. Beta	1.50 ± 0.10	1.50	0.76 - 1.36

TABLE A-7. Environmental Measurements Laboratory Quality Assessment Program (EML)

Lab Code	Type	Date	Analysis	Concentration <sup>a</sup>		Control Limits <sup>c</sup>
				Laboratory results	EML Result <sup>b</sup>	
STW-992	water	09/02/03	Am-241	9.78 ± 0.32	8.76	0.79 - 1.41
The September, 2003 results are preliminary. Control limits used were taken from the March, 2003 data. Control limits may vary slightly when the final study is published.						
STW-992	water	09/02/03	Co-60	468.30 ± 4.10	513.00	0.80 - 1.20
STW-992	water	09/02/03	Cs-134	53.90 ± 0.80	63.00	0.80 - 1.30
STW-992	water	09/02/03	Cs-137	76.10 ± 1.40	80.30	0.80 - 1.22
STW-992	water	09/02/03	H-3	355.20 ± 12.80	446.30	0.78 - 2.45
STW-992	water	09/02/03	Pu-238	1.71 ± 0.07	2.07	0.74 - 1.20
STW-992	water	09/02/03	Pu-239/40	4.24 ± 0.01	4.99	0.79 - 1.20
STW-992	water	09/02/03	Sr-90	6.70 ± 0.50	7.04	0.69 - 1.34
STW-992	water	09/02/03	Uranium	6.03 ± 0.14	5.69	0.75 - 1.33
STW-993	water	09/02/03	Gr. Alpha	688.00 ± 7.60	622.00	0.58 - 1.29
STW-993	water	09/02/03	Gr. Beta	1985.00 ± 111.00	1948.00	0.61 - 1.43
STSO-994	soil	09/02/03	Am-241	19.70 ± 1.50	18.40	0.65 - 2.28
STSO-994	soil	09/02/03	Cs-137	1928.00 ± 19.00	1973.00	0.80 - 1.25
STSO-994	soil	09/02/03	K-40	533.00 ± 79.00	488.00	0.80 - 1.32
STSO-994	soil	09/02/03	Pu-238	15.30 ± 0.80	14.60	0.59 - 2.88
STSO-994	soil	09/02/03	Pu-239/40	32.50 ± 2.30	30.40	0.71 - 1.30
STSO-994	soil	09/02/03	Sr-90	69.80 ± 2.30	80.30	0.67 - 2.90
STSO-994	soil	09/02/03	Uranium	228.30 ± 17.10	259.30	0.71 - 1.32
STAP-995	Air Filter	09/02/03	Am-241	0.64 ± 0.05	0.44	0.70 - 2.34
STAP-995	Air Filter	09/02/03	Co-60	48.50 ± 0.40	55.10	0.80 - 1.26
STAP-995	Air Filter	09/02/03	Cs-137	51.20 ± 1.10	54.80	0.80 - 1.32
STAP-995	Air Filter	09/02/03	Mn-54	53.70 ± 1.10	58.00	0.80 - 1.35
STAP-995	Air Filter	09/02/03	Pu-238	0.24 ± 0.05	0.23	0.67 - 1.33
STAP-995	Air Filter	09/02/03	Pu-239/40	0.41 ± 0.10	0.40	0.73 - 1.26
STAP-995	Air Filter	09/02/03	Sr-90	1.90 ± 0.10	2.06	0.53 - 1.84
STAP-995	Air Filter	09/02/03	Uranium	0.80 ± 0.06	0.82	0.79 - 2.10
STAP-996	Air Filter	09/02/03	Gr. Alpha	3.23 ± 0.07	3.11	0.73 - 1.43
STAP-996	Air Filter	09/02/03	Gr. Beta	4.18 ± 0.03	3.89	0.76 - 1.36

<sup>a</sup> Results are reported in Bq/L with the following exceptions: Air Filters (Bq/Filter), Soil and Vegetation (Bq/kg).

<sup>b</sup> The EML result listed is the mean of replicate determinations for each nuclide ± the standard error of the mean.

<sup>c</sup> Control limits are reported by EML as the ratio of Reported Value / EML value.

<sup>d</sup> A low bias for Cs-134 activity has been observed in the past. No errors have been found in the library or efficiency.  
Additional spike analyses will be performed and a correction factored into the calculation.

<sup>e</sup> Reporting error.

APPENDIX B

DATA REPORTING CONVENTIONS



## Data Reporting Conventions

1.0. All activities, except gross alpha and gross beta, are decay corrected to collection time or the end of the collection period.

### 2.0. Single Measurements

Each single measurement is reported as follows:  $x \pm s$

where:  $x$  = value of the measurement;  
 $s$  = 2s counting uncertainty (corresponding to the 95% confidence level).

In cases where the activity is less than the lower limit of detection  $L$ , it is reported as:  $<L$ ,  
where  $L$  = the lower limit of detection based on 4.66s uncertainty for a background sample.

### 3.0. Duplicate analyses

3.1 Individual results: For two analysis results;  $x_1 \pm s_1$  and  $x_2 \pm s_2$

Reported result:  $x \pm s$ ; where  $x = (1/2)(x_1 + x_2)$  and  $s = (1/2)\sqrt{s_1^2 + s_2^2}$

3.2. Individual results:  $<L_1, <L_2$  Reported result:  $<L$ , where  $L$  = lower of  $L_1$  and  $L_2$

3.3. Individual results:  $x \pm s, <L$  Reported result:  $x \pm s$  if  $x \geq L$ ;  $<L$  otherwise.

### 4.0. Computation of Averages and Standard Deviations

4.1 Averages and standard deviations listed in the tables are computed from all of the individual measurements over the period averaged; for example, an annual standard deviation would not be the average of quarterly standard deviations. The average  $\bar{x}$  and standard deviation  $s$  of a set of  $n$  numbers  $x_1, x_2, \dots, x_n$  are defined as follows:

$$\bar{x} = \frac{1}{n} \sum x \quad s = \sqrt{\frac{\sum (x - \bar{x})^2}{n-1}}$$

4.2 Values below the highest lower limit of detection are not included in the average.

4.3 If all values in the averaging group are less than the highest LLD, the highest LLD is reported.

4.4 If all but one of the values are less than the highest LLD, the single value  $x$  and associated two sigma error is reported.

4.5 In rounding off, the following rules are followed:

4.5.1. If the number following those to be retained is less than 5, the number is dropped, and the retained number  $s$  are kept unchanged. As an example, 11.443 is rounded off to 11.44.

4.5.2. If the number following those to be retained is equal to or greater than 5, the number is dropped and the last retained number is raised by 1. As an example, 11.445 is rounded off to 11.45.

## **APPENDIX C**

### **Maximum Permissible Concentrations of Radioactivity in Air and Water Above Background in Unrestricted Areas**

Table C-1. Maximum permissible concentrations of radioactivity in air and water above natural background in unrestricted areas<sup>a</sup>.

Air (pCi/m <sup>3</sup> )		Water (pCi/L)	
Gross alpha	1 x 10 <sup>-3</sup>	Strontium-89	8,000
Gross beta	1	Strontium-90	500
Iodine-131 <sup>b</sup>	2.8 x 10 <sup>-1</sup>	Cesium-137	1,000
		Barium-140	8,000
		Iodine-131	1,000
		Potassium-40 <sup>c</sup>	4,000
		Gross alpha	2
		Gross beta	10
		Tritium	1 x 10 <sup>6</sup>

<sup>a</sup> Taken from Table 2 of Appendix B to Code of Federal Regulations Title 10, Part 20, and appropriate footnotes. Concentrations may be averaged over a period not greater than one year.


<sup>b</sup> Value adjusted by a factor of 700 to reduce the dose resulting from the air-grass-cow-milk-child pathway.

<sup>c</sup> A natural radionuclide.

**APPENDIX D**

**Sampling Location Maps**


# TLD LOCATIONS ONE MILE RADIUS

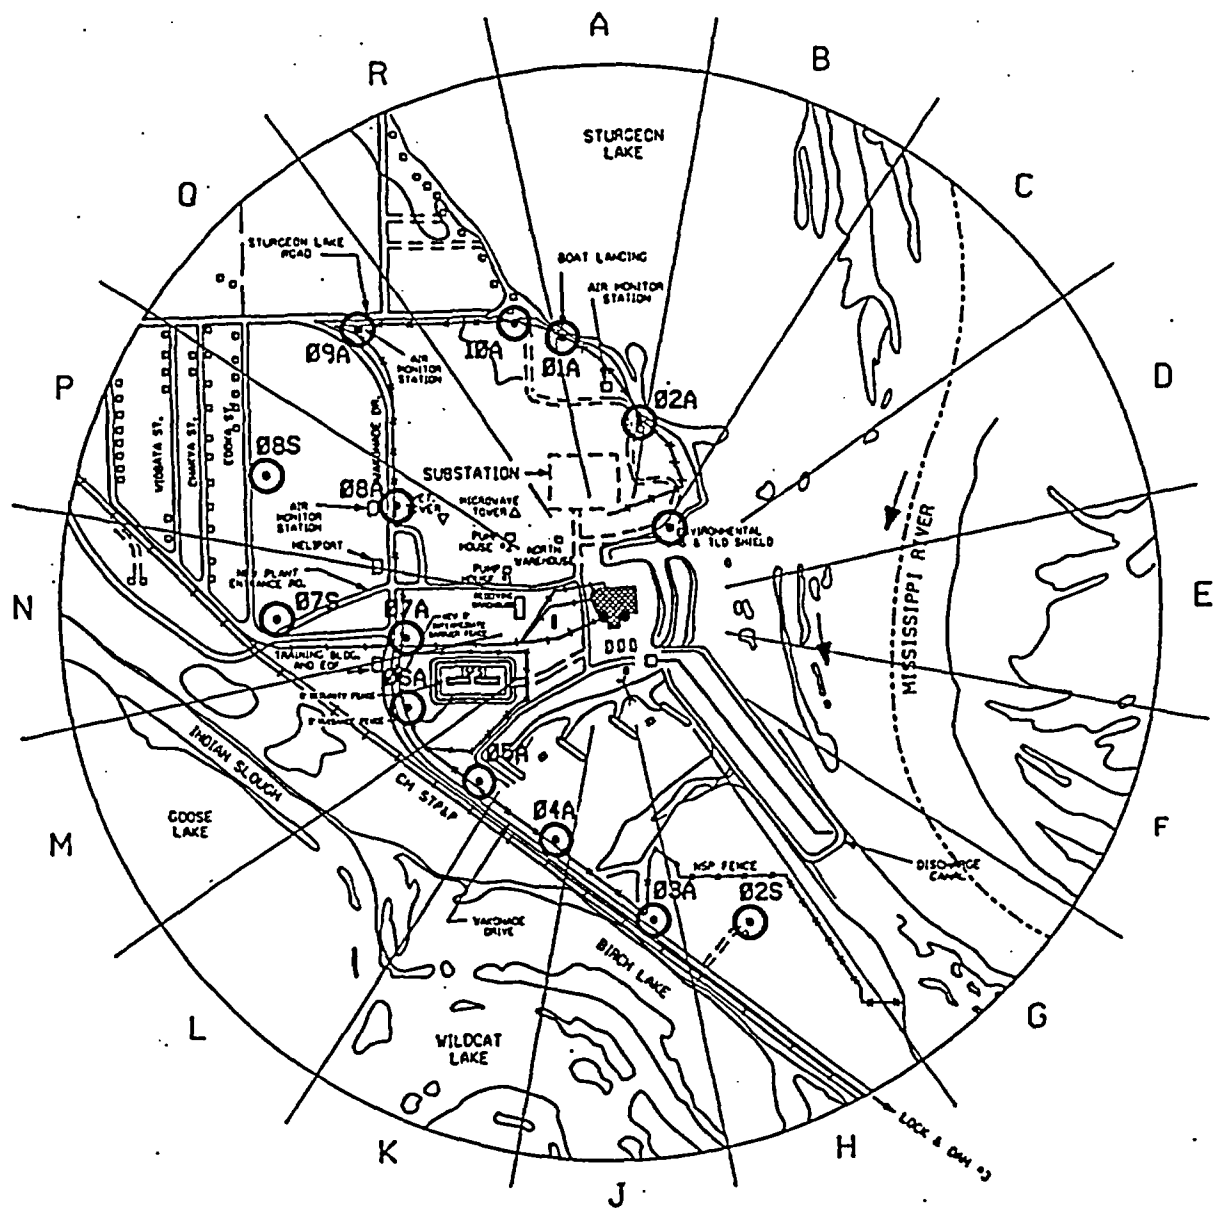


PLANT AREA ENLARGED PLAN [1.00 MILE RADIUS]  
[NO SCALE]

MONITORING LEGEND:  
 ○ N.S.P. TLD POINTS

# TLD LOCATIONS

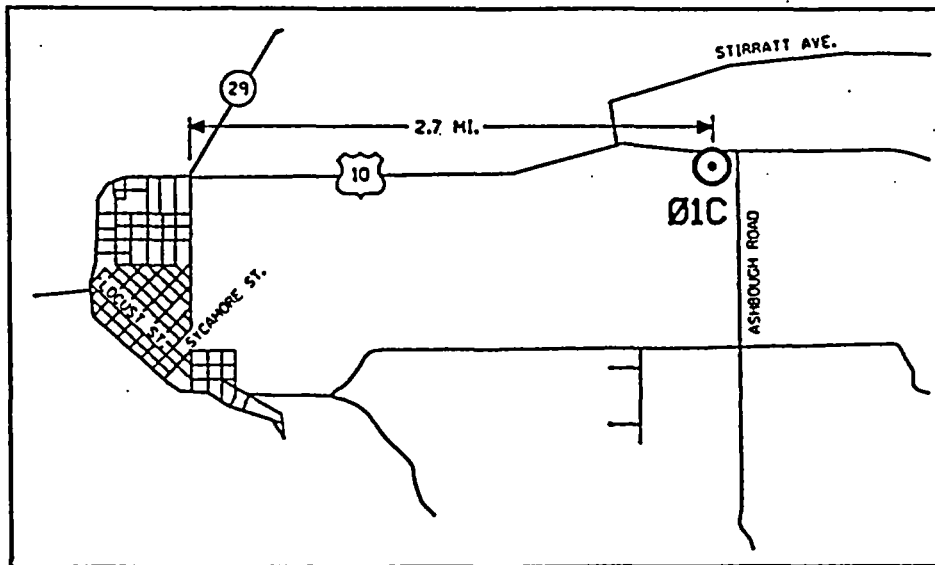

## CONTROL POINTS PRESCOTT, WISCONSIN

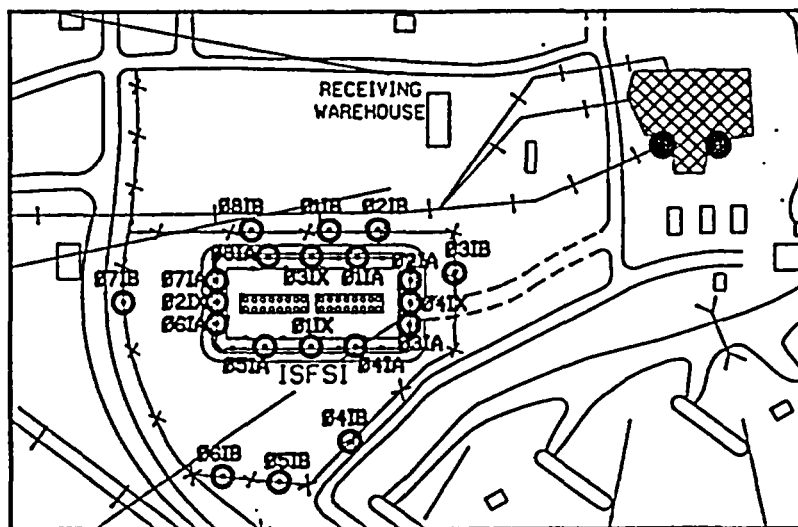


## ISFSI AREA TLD LOCATIONS


### MONITORING LEGEND:

⊙ N.S.P. TLD POINTS

# TLD LOCATIONS FIVE MILE RADIUS

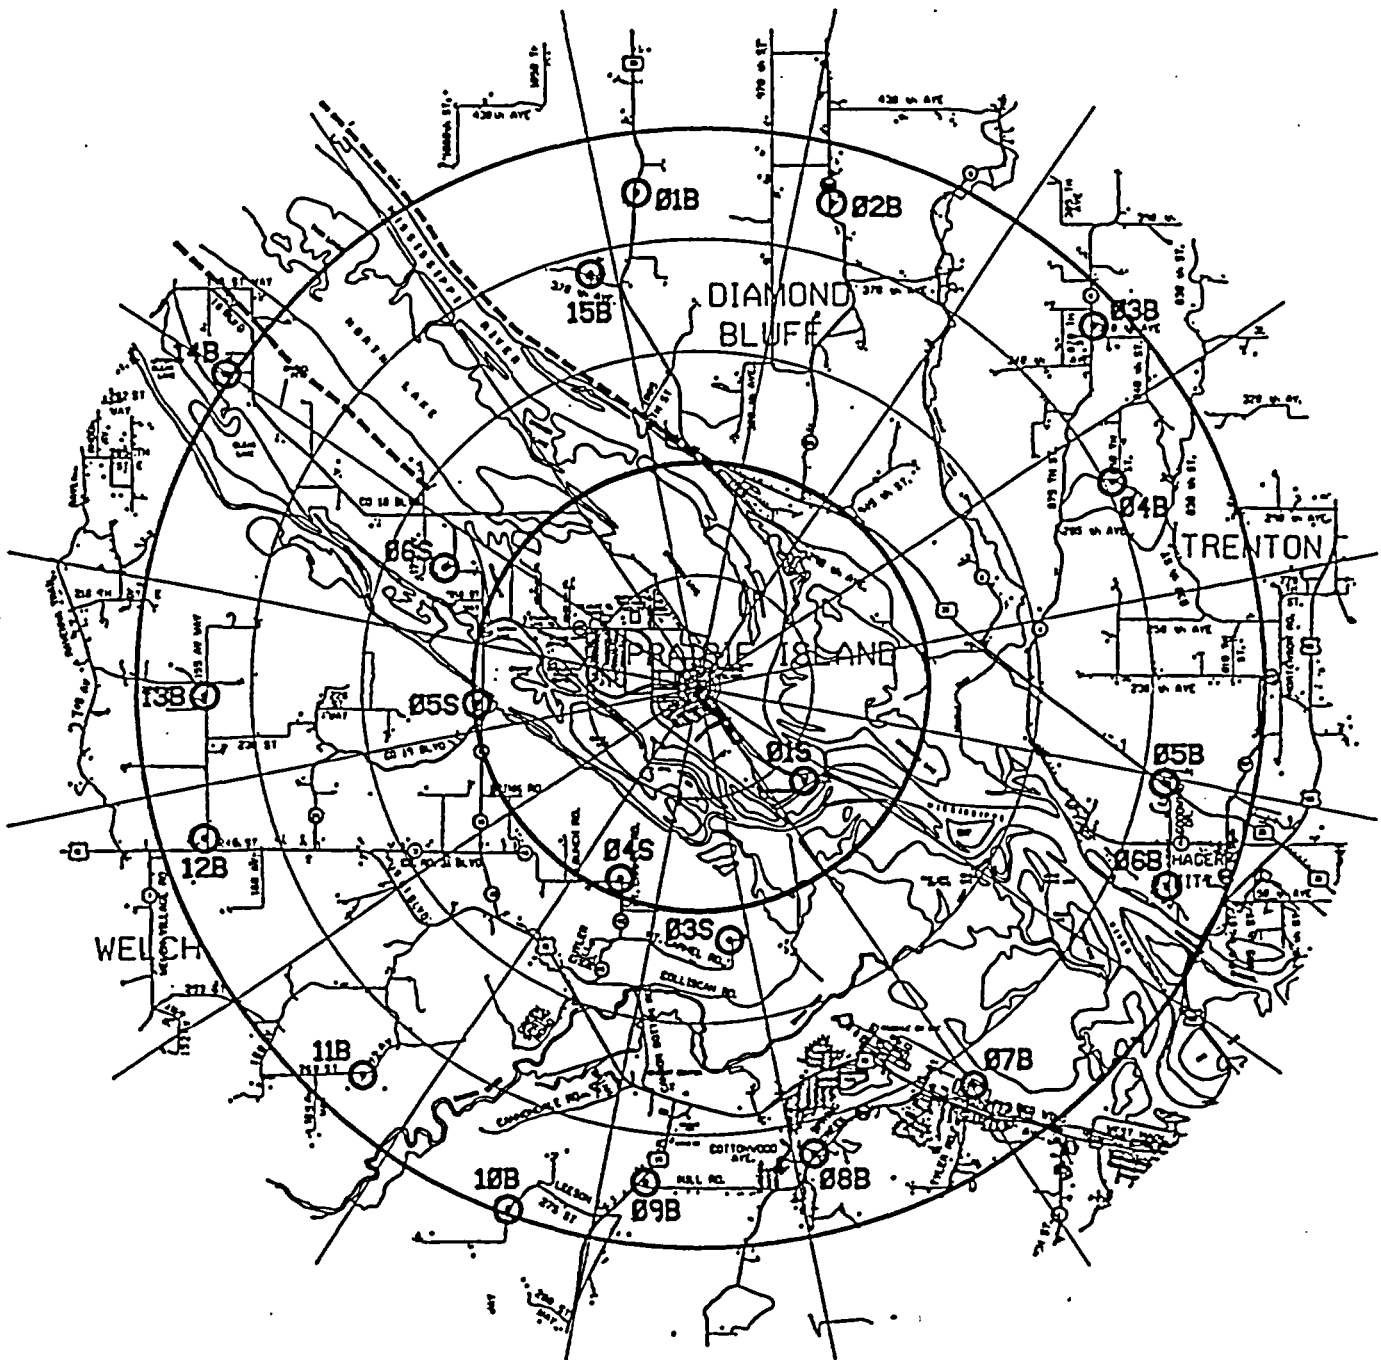

# ENVIRONMENTAL SAMPLING POINTS ONE MILE RADIUS

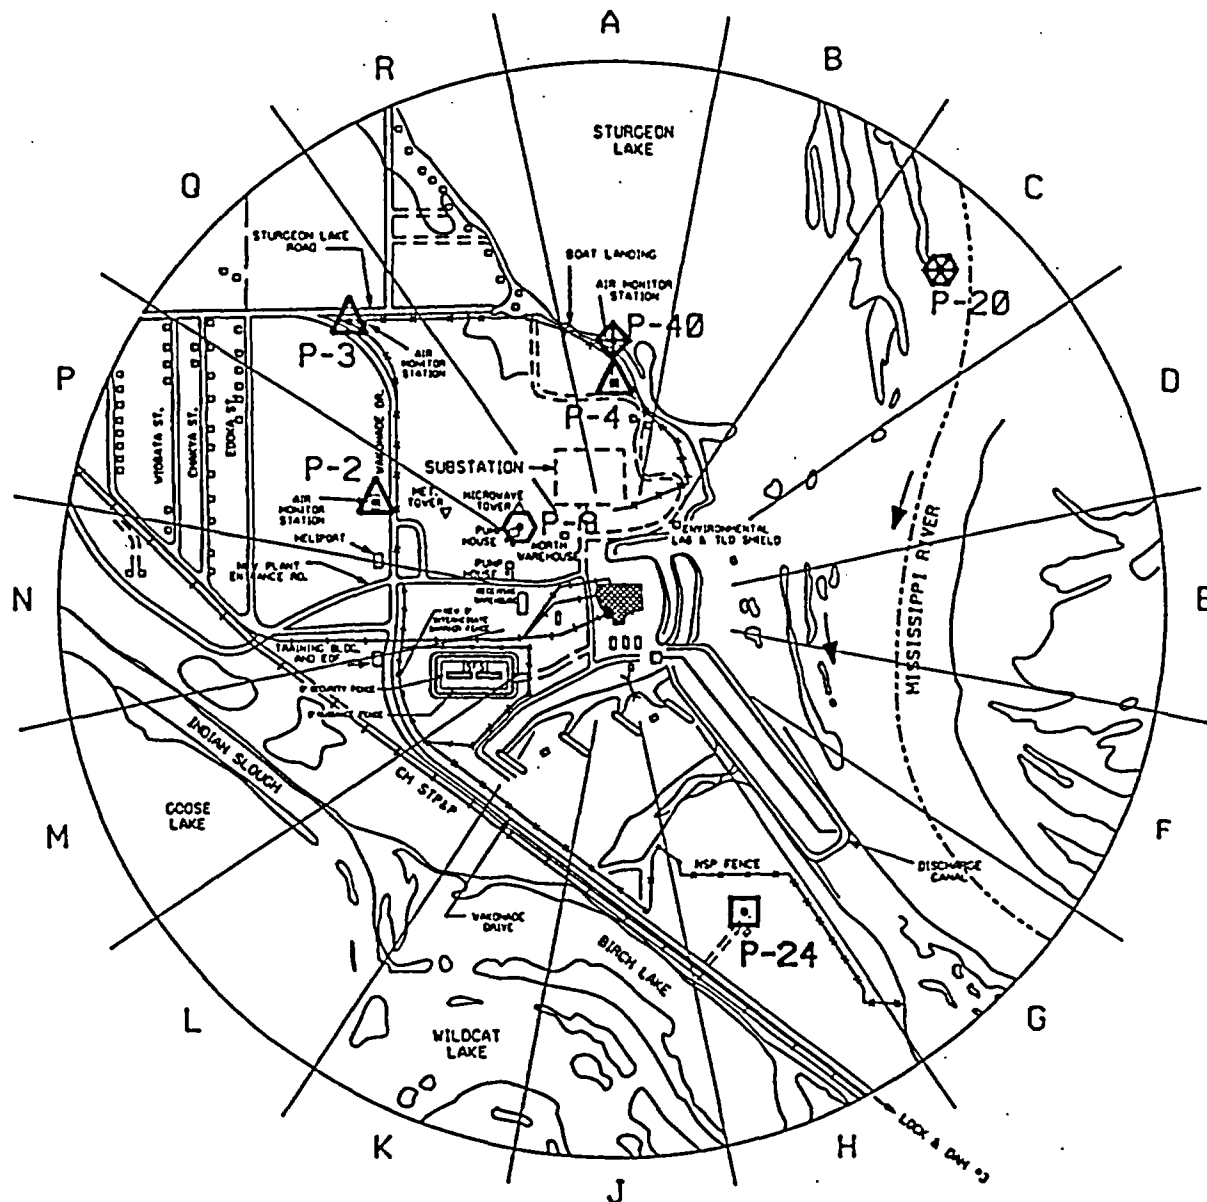


PLANT AREA ENLARGED PLAN [1.00 MILE RADIUS]  
[NO SCALE]

## MONITORING LEGEND





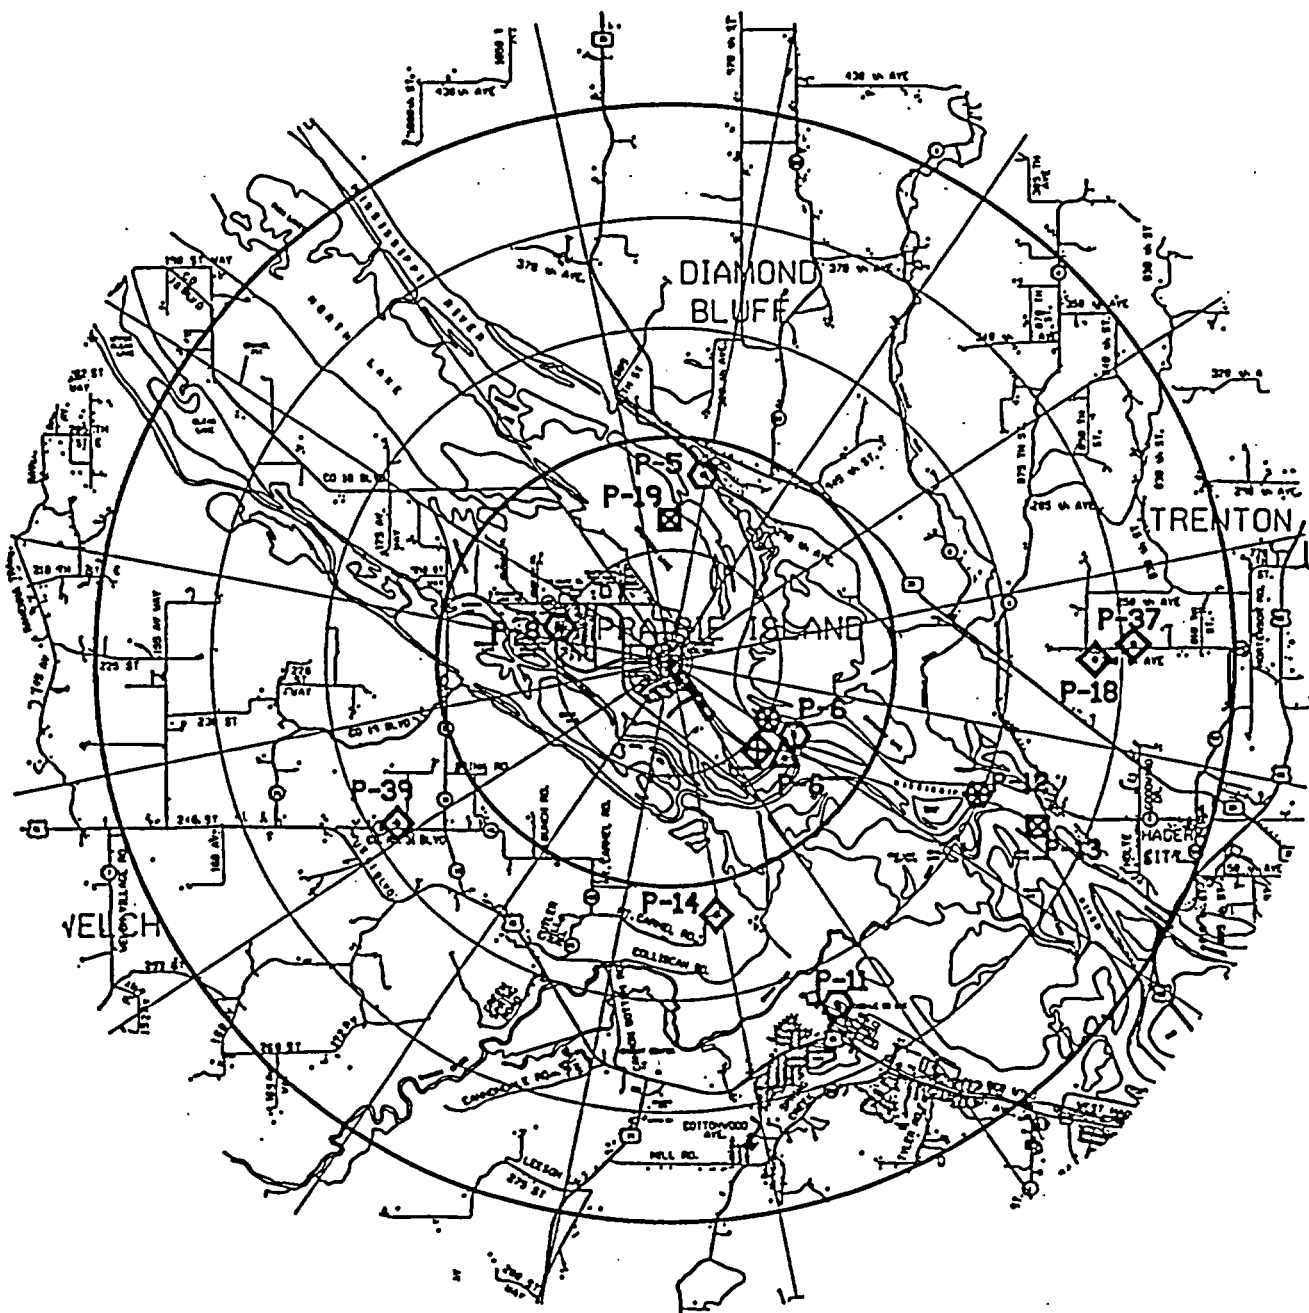


◆ MILK SAMPLING POINT ID NUMBERS P-14, P-18, P-25, P-37, P-39	⊠ FISH SAMPLING POINT ID NUMBERS P-13, P-19
▲ AIR SAMPLING POINT ID NUMBERS P-1, P-2, P-3, P-4, P-6	⬠ INVERTEBRATES POINT ID NUMBERS P-6, P-40
⬡ WATER SAMPLING POINT ID NUMBERS P-5, P-6, P-8, P-9, P-11, P-25	⬢ SEDIMENT SAMPLING POINT ID NUMBERS P-6, P-12, P-20
□ VEGETATION / VEGETABLES ID NUMBERS P-24, P-38	




# ENVIRONMENTAL SAMPLING POINTS FIVE MILE RADIUS



## MONITORING LEGEND



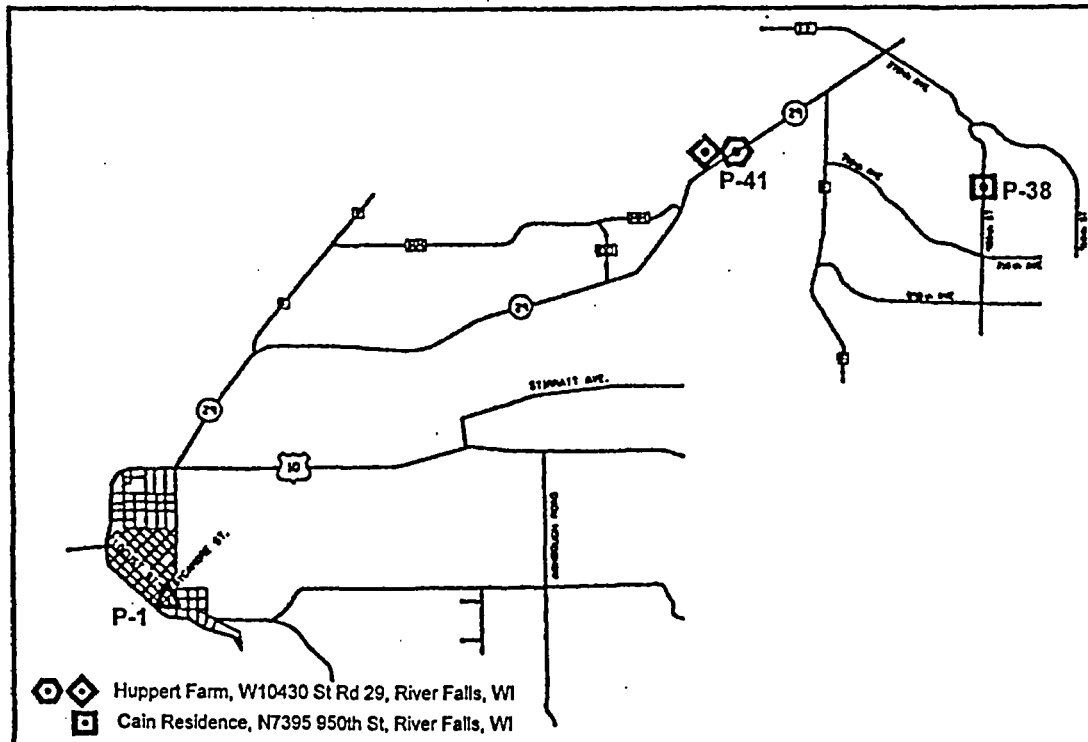

- |                                                                                                                                                       |                                                                                                                                           |
|-------------------------------------------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------|
|  MILK SAMPLING POINT ID NUMBERS<br>P-14, P-18, P-25, P-37, P-39    |  FISH SAMPLING POINT ID NUMBERS<br>P-13, P-19          |
|  AIR SAMPLING POINT ID NUMBERS<br>P-1, P-2, P-3, P-4, P-6          |  INVERTEBRATES POINT ID NUMBERS<br>P-6, P-48           |
|  WATER SAMPLING POINT ID NUMBERS<br>P-5, P-6, P-8, P-9, P-11, P-25 |  SEDIMENT SAMPLING POINT ID NUMBERS<br>P-6, P-12, P-29 |
|  VEGETATION / VEGETABLES ID NUMBERS<br>P-24, P-38                  |                                                                                                                                           |

## ENVIRONMENTAL SAMPLING POINTS



### CONTROL POINTS PRESCOTT, WISCONSIN

#### Monitoring Legend

-  Milk Sampling Point ID Numbers  
P-14, P-18, P-37, P-39, P-41
-  Air Sampling Point ID Numbers  
P-1, P-2, P-3, P-4, P-6
-  Water Sampling Point ID Numbers  
P-5, P-6, P-8, P-9, P-11, P-41
-  Vegetation / Vegetables Point ID Numbers  
P-24, P-38