VIRGINIA ELECTRIC AND POWER COMPANY
RICHMOND, VIRGINIA 23261

November 16, 2004

U.S. Nuclear Regulatory Commission
Attention: Document Control Desk
Washington, D.C. 20555

Serial No. 04-380B
NL&OS/ETS R0
Docket Nos. 50-338/339
License Nos. NPF-4/7

VIRGINIA ELECTRIC AND POWER COMPANY (DOMINION)
NORTH ANNA POWER STATION UNITS 1 AND 2
EDITORIAL CORRECTION FOR
PROPOSED TECHNICAL SPECIFICATIONS CHANGE REQUEST
REACTOR COOLANT SYSTEM PRESSURE/TEMPERATURE LIMITS
LTOPS SETPOINTS AND LTOPS ENABLE TEMPERATURES

In a letter dated July 1, 2004 (Serial No. 04-380), Dominion requested an amendment to Facility Operating License Numbers NPF-4 and NPF-7 in the form of changes to the Technical Specifications for North Anna Power Station Units 1 and 2. The proposed changes will provide Reactor Coolant System (RCS) pressure/temperature (P/T) operating limits, Low Temperature Overpressure Protection System (LTOPS) setpoint allowable values, and LTOPS enable temperature (T_{enable}) values to cumulative core burnups up to 50.3 Effective Full Power Years (EFPY) and 52.3 EFPY, which correspond to the period of the renewed license, for Units 1 and 2, respectively. During a recent review of the proposed technical specification change, a typographical error was identified in the proposed Technical Specification package. Specifically, the cooldown rate was incorrect in the title of Figure 3.4.4-2. The corrected marked-up and proposed pages are provided in the attachment to this letter.

Dominion continues to request a six-month implementation period to accommodate the numerous licensing basis changes necessary to implement the revised pressure/temperature limits. The current pressure/temperature limits remain valid to the years 2018 (32.3 EFPY) and 2020 (34.3 EFPY) for North Anna Unit 1 and 2, respectively. The extended implementation time will have no impact on safe operation of North Anna Units 1 and 2.

Should you have any questions or require additional information, please contact Mr. Thomas Shaub at (804) 273-2763.

Very truly yours,

Leslie N. Hartz
Vice President – Nuclear Engineering

Attachment

cc: U.S. Nuclear Regulatory Commission
Region II
Sam Nunn Atlanta Federal Center
61 Forsyth Street, SW
Suite 23T85
Atlanta, Georgia 30303

Mr. J. E. Reasor, Jr.
Old Dominion Electric Cooperative
Innsbrook Corporate Center
4201 Dominion Blvd.
Suite 300
Glen Allen, Virginia 23060

Commissioner
Bureau of Radiological Health
1500 East Main Street
Suite 240
Richmond, Virginia 23218

Mr. M. T. Widmann
NRC Senior Resident Inspector
North Anna Power Station

Mr. S. R. Monarque
NRC Project Manager
U. S. Nuclear Regulatory Commission
One White Flint North
11555 Rockville Pike
Mail Stop 8-H12
Rockville, Maryland 20852

Subject: Editorial Correction to License Amendment RCS PT Limits and LTOP Enable Setpoints

COMMONWEALTH OF VIRGINIA)
)
COUNTY OF HENRICO)

The foregoing document was acknowledged before me, in and for the County and Commonwealth aforesaid, today by Leslie N. Hartz who is Vice President – Nuclear Engineering of Virginia Electric and Power Company. She has affirmed before me that she is duly authorized to execute and file the foregoing document in behalf of that Company, and that the statements in the document are true to the best of her knowledge and belief.

Acknowledged before me this 16TH day of November, 2004.

My Commission Expires: May 31, 2006.

Vicki L. Hull
Notary Public

(SEAL)

Attachment
(Serial No. 04-380B)
Virginia Electric and Power Company
North Anna Power Station Units 1 and 2

Corrected Marked-up and Proposed Technical Specification Pages
Proposed Technical Specification Changes for
Reactor Coolant System Pressure/Temperature Limits
LTOPS Setpoints and LTOPS Enable Temperatures

North Anna Power Station
Units 1 and 2
Virginia Electric and Power Company
(Dominion)

NEW FIGURE 3.4.3-2

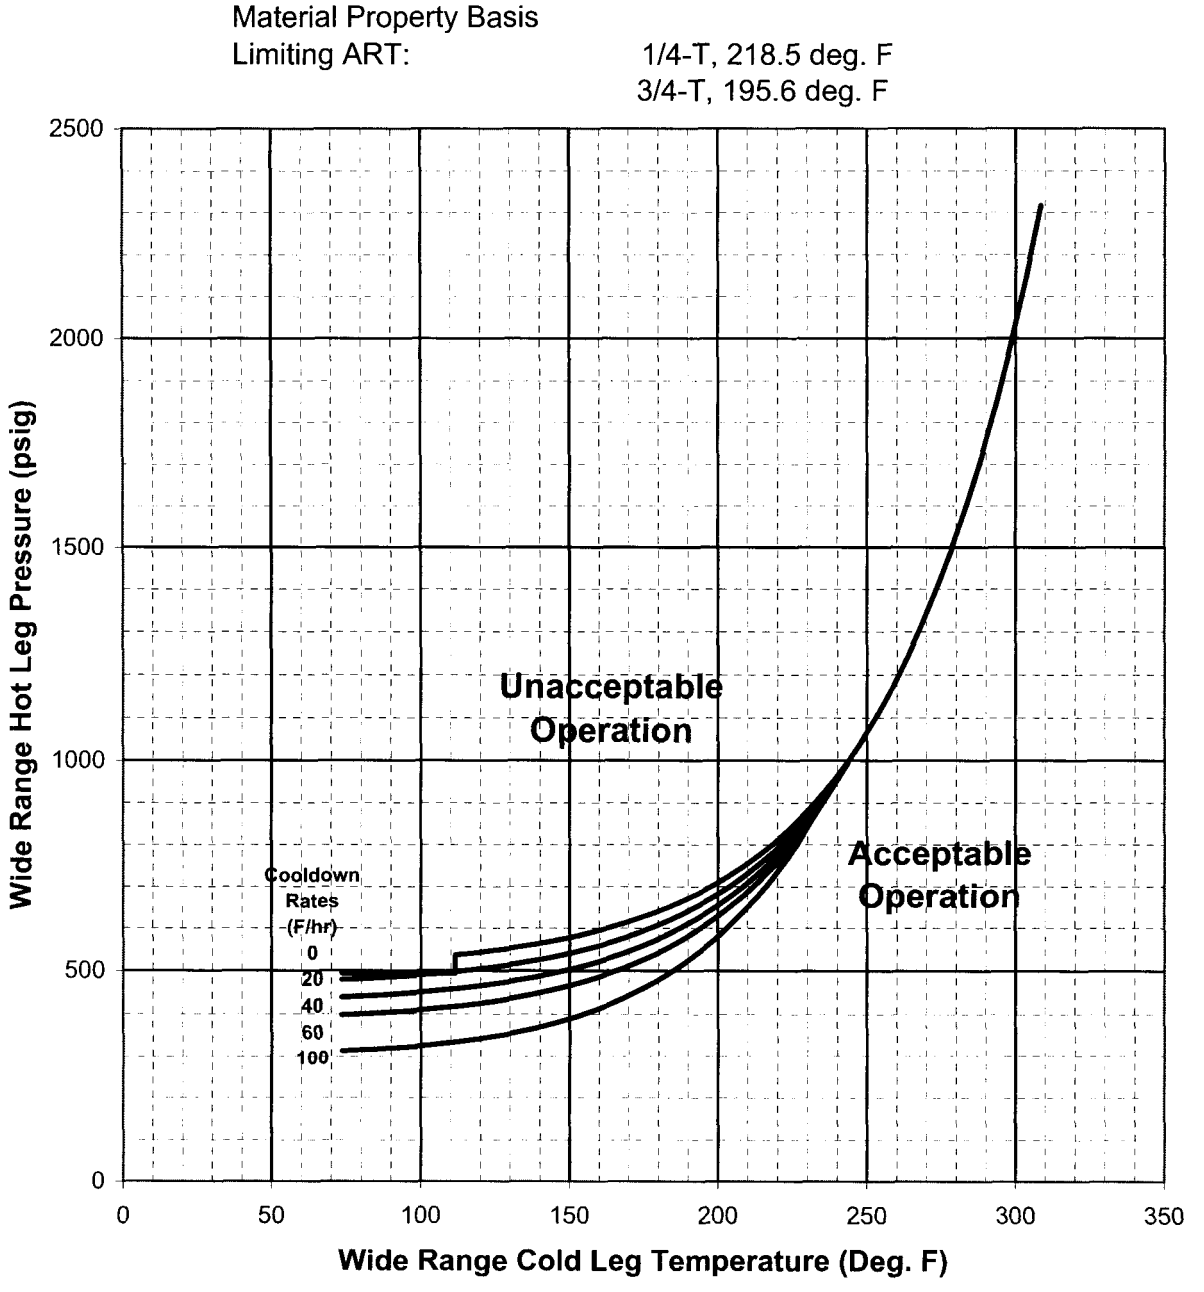

Figure 3.4.3-2 (page 1 of 1)
North Anna Units 1 and 2 Reactor Coolant System Cooldown Limitations
(Cooldown Rates up to 100°F/hr),
Applicable for the first 50.3 EFPY for Unit 1, and 52.3 EFPY for Unit 2
(Including Margins for Instrumentation Errors)

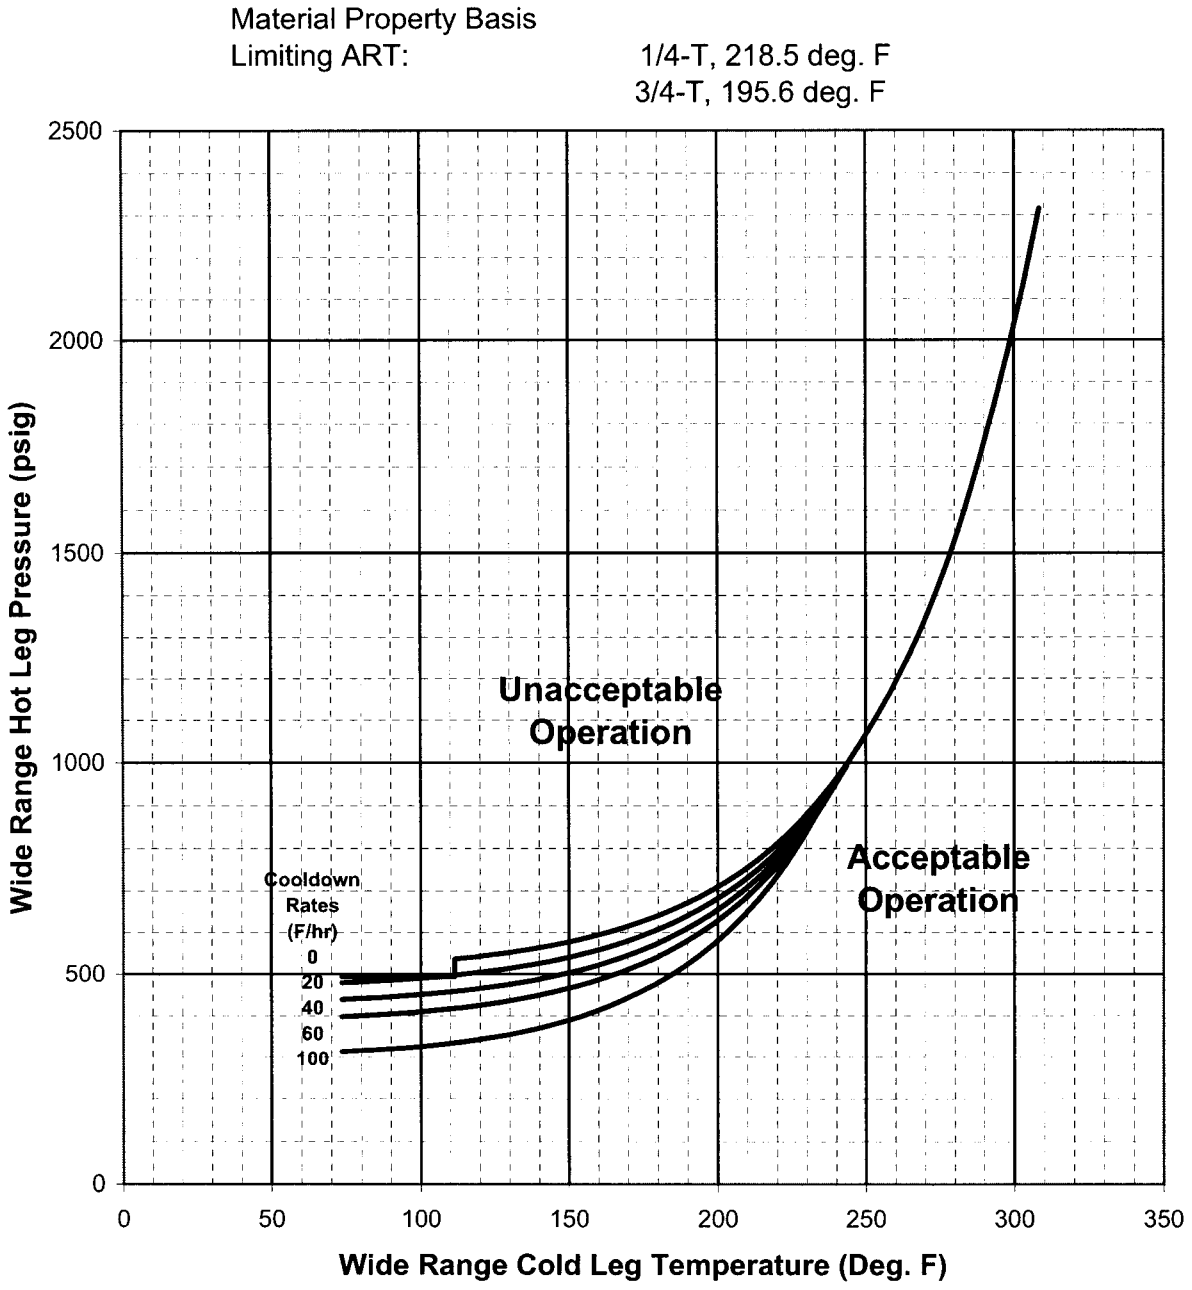

Figure 3.4.3-2 (page 1 of 1)
North Anna Units 1 and 2 Reactor Coolant System Cooldown Limitations
(Cooldown Rates up to 100°F/hr),
Applicable for the first 50.3 EFPY for Unit 1, and 52.3 EFPY for Unit 2
(Including Margins for Instrumentation Errors)