

MANUAL HARD COPY DISTRIBUTION
DOCUMENT TRANSMITTAL 2004-48843

USER INFORMATION:

Name: ~~GERACH*ROSE M~~ EMPL#: 028401 CA#: 0363

Address: ~~NUCSA-2~~

Phone#: ~~252-3194~~

TRANSMITTAL INFORMATION:

TO: ~~GERACH*ROSE M~~ 11/23/2004

LOCATION: ~~USNRC~~

FROM: NUCLEAR RECORDS DOCUMENT CONTROL CENTER (NUCSA-2)

THE FOLLOWING CHANGES HAVE OCCURRED TO THE HARDCOPY OR ELECTRONIC MANUAL ASSIGNED TO YOU:

TRM2 - TECHNICAL REQUIREMENTS MANUAL UNIT 2

REMOVE MANUAL TABLE OF CONTENTS DATE: 11/08/2004

ADD MANUAL TABLE OF CONTENTS DATE: 11/22/2004

CATEGORY: DOCUMENTS TYPE: TRM2

ID: TEXT 2.2

REMOVE: REV:1

ADD: REV: 2

CATEGORY: DOCUMENTS TYPE: TRM2

ID: TEXT 3.2.1

REMOVE: REV:2

ADD: REV: 3

CATEGORY: DOCUMENTS TYPE: TRM2

ID: TEXT 3.3.9

REMOVE: REV:0

ADD: REV: 1

CATEGORY: DOCUMENTS TYPE: TRM2

ID: TEXT B3.3.9

REMOVE: REV:0

ADD: REV: 1

CATEGORY: DOCUMENTS TYPE: TRM2

ID: TEXT LOES

REMOVE: REV:7

ADD: REV: 8

CATEGORY: DOCUMENTS TYPE: TRM2

ID: TEXT TOC

REMOVE: REV:2

A001

ADD: REV: 3

UPDATES FOR HARD COPY MANUALS WILL BE DISTRIBUTED WITHIN 5 DAYS IN ACCORDANCE WITH DEPARTMENT PROCEDURES. PLEASE MAKE ALL CHANGES AND ACKNOWLEDGE COMPLETE IN YOUR NIMS INBOX UPON RECEIPT OF HARD COPY. FOR ELECTRONIC MANUAL USERS, ELECTRONICALLY REVIEW THE APPROPRIATE DOCUMENTS AND ACKNOWLEDGE COMPLETE IN YOUR NIMS INBOX.

SSSES MANUAL

Manual Name: TRM2

Manual Title: TECHNICAL REQUIREMENTS MANUAL UNIT 2

Table Of Contents

Issue Date: 11/22/2004

<u>Procedure Name</u>	<u>Rev</u>	<u>Issue Date</u>	<u>Change ID</u>	<u>Change Number</u>
TRM2	N/A	08/01/2003		

Title: TECHNICAL REQUIREMENTS MANUAL UNIT 2 (07/28/2003)

LDCN 3749

TEXT LOES 8 11/22/2004

Title: LIST OF EFFECTIVE SECTIONS

TEXT TOC 3 11/22/2004

Title: TABLE OF CONTENTS

TEXT 1.1 0 11/19/2002

Title: USE AND APPLICATION DEFINITIONS

TEXT 2.1 0 11/19/2002

Title: PLANT PROGRAMS AND SETPOINTS PLANT PROGRAMS

TEXT 2.2 2 11/22/2004

Title: PLANT PROGRAMS AND SETPOINTS INSTRUMENT TRIP SETPOINT TABLE

TEXT 3.0 0 11/19/2002

Title: APPLICABILITY TECHNICAL REQUIREMENT FOR OPERATION (TRO) APPLICABILITY

TEXT 3.1.1 0 11/19/2002

Title: REACTIVITY CONTROL SYSTEMS ANTICIPATED TRANSIENT WITHOUT SCRAM ALTERNATE ROD INJECTION (ATWS-ARI) INSTRUMENTATION

TEXT 4.3 0 09/27/2003

Title: ADMINISTRATIVE CONTROLS SAFETY LIMIT VIOLATION

TEXT 3.1.2 0 11/19/2002

Title: REACTIVITY CONTROL SYSTEMS CONTROL ROD DRIVE (CRD) HOUSING SUPPORT

TEXT 3.1.3 0 11/19/2002

Title: REACTIVITY CONTROL SYSTEMS CONTROL ROD BLOCK INSTRUMENTATION

SSES MANUAL

Manual Name: TRM2

Manual Title: TECHNICAL REQUIREMENTS MANUAL UNIT 2

TEXT 3.1.4 0 11/19/2002

Title: REACTIVITY CONTROL SYSTEMS CONTROL ROD SCRAM ACCUMULATORS INSTRUMENTATION AND CHECK VALVE

TEXT 3.2.1 3 11/22/2004

Title: CORE OPERATING LIMITS CORE OPERATING LIMITS REPORT (COLR)

TEXT 3.3.1 0 11/19/2002

Title: INSTRUMENTATION RADIATION MONITORING INSTRUMENTATION

TEXT 3.3.2 0 11/19/2002

Title: INSTRUMENTATION SEISMIC MONITORING INSTRUMENTATION

TEXT 3.3.3 0 11/19/2002

Title: INSTRUMENTATION METEOROLOGICAL MONITORING INSTRUMENTATION

TEXT 3.3.4 0 11/19/2002

Title: INSTRUMENTATION TRM POST-ACCIDENT MONITORING INSTRUMENTATION

TEXT 3.3.5 0 11/19/2002

Title: INSTRUMENTATION THIS PAGE INTENTIONALLY LEFT BLANK

TEXT 3.3.6 1 10/22/2003

Title: INSTRUMENTATION TRM ISOLATION ACTUATION INSTRUMENTATION

TEXT 3.3.7 0 11/19/2002

Title: INSTRUMENTATION MAIN TURBINE OVERSPEED PROTECTION SYSTEM

TEXT 3.3.8 1 10/22/2003

Title: INSTRUMENTATION TRM RPS INSTRUMENTATION

TEXT 3.3.9 1 11/22/2004

Title: INSTRUMENTATION LPRM UPSCALE ALARM INSTRUMENTATION

TEXT 3.3.10 0 11/19/2002

Title: INSTRUMENTATION REACTOR RECIRCULATION PUMP MG SET STOPS

SSSES MANUAL

Manual Name: TRM2

Manual Title: TECHNICAL REQUIREMENTS MANUAL UNIT 2

TEXT 3.3.11 1 10/22/2003

Title: INSTRUMENTATION MVP ISOLATION INSTRUMENTATION

TEXT 3.4.1 0 11/19/2002

Title: REACTOR COOLANT SYSTEM REACTOR COOLANT SYSTEM CHEMISTRY

TEXT 3.4.2 0 11/19/2002

Title: REACTOR COOLANT SYSTEM STRUCTURAL INTEGRITY

TEXT 3.4.3 0 11/19/2002

Title: REACTOR COOLANT SYSTEM REACTOR COOLANT SYSTEM (RCS)

TEXT 3.4.4 0 11/19/2002

Title: REACTOR COOLANT SYSTEM REACTOR RECIRCULATION FLOW AND ROD LINE LIMIT

TEXT 3.4.5 0 11/18/2002

Title: REACTOR COOLANT SYSTEM REACTOR VESSEL MATERIALS

TEXT 3.5.1 0 11/19/2002

Title: ECCS AND RCIC ADS MANUAL INHIBIT

TEXT 3.5.2 0 11/19/2002

Title: ECCS AND RCIC ECCS AND RCIC SYSTEM MONITORING INSTRUMENTATION

TEXT 3.5.3 0 11/19/2002

Title: ECCS AND RCIC LONG TERM NITROGEN SUPPLY TO ADS

TEXT 3.6.1 0 11/19/2002

Title: CONTAINMENT VENTING OR PURGING

TEXT 3.6.2 0 11/19/2002

Title: CONTAINMENT SUPPRESSION CHAMBER-TO-DRYWELL VACUUM BREAKER POSITION INDICATION

TEXT 3.6.3 0 11/19/2002

Title: CONTAINMENT SUPPRESSION POOL ALARM INSTRUMENTATION

SSS MANUAL

Manual Name: TRM2

Manual Title: TECHNICAL REQUIREMENTS MANUAL UNIT 2

TEXT 3.6.4 0 11/19/2002
Title: CONTAINMENT PRIMARY CONTAINMENT CLOSED SYSTEM BOUNDARIES

TEXT 3.7.1 0 11/19/2002
Title: PLANT SYSTEMS EMERGENCY SERVICE WATER SYSTEM (ESW) SHUTDOWN

TEXT 3.7.2 0 11/19/2002
Title: PLANT SYSTEMS ULTIMATE HEAT SINK (UHS) AND GROUND WATER LEVEL

TEXT 3.7.3.1 0 11/19/2002
Title: PLANT SYSTEMS FIRE SUPPRESSION WATER SUPPLY SYSTEM

TEXT 3.7.3.2 0 11/19/2002
Title: PLANT SYSTEMS SPRAY AND SPRINKLER SYSTEMS

TEXT 3.7.3.3 0 11/19/2002
Title: PLANT SYSTEMS CO2 SYSTEMS

TEXT 3.7.3.4 0 11/19/2002
Title: PLANT SYSTEMS HALON SYSTEMS

TEXT 3.7.3.5 0 11/19/2002
Title: PLANT SYSTEMS FIRE HOSE STATIONS

TEXT 3.7.3.6 0 11/19/2002
Title: PLANT SYSTEMS YARD FIRE HYDRANTS AND HYDRANT HOSE HOUSES

TEXT 3.7.3.7 0 11/19/2002
Title: PLANT SYSTEMS FIRE RATED ASSEMBLIES

TEXT 3.7.3.8 1 01/12/2004
Title: PLANT SYSTEMS FIRE DETECTION INSTRUMENTATION

TEXT 3.7.4 0 11/19/2002
Title: PLANT SYSTEMS SOLID RADWASTE SYSTEM

SSES MANUAL

Manual Name: TRM2

Manual Title: TECHNICAL REQUIREMENTS MANUAL UNIT 2

TEXT 3.7.5.1	0	11/19/2002	Title: PLANT SYSTEMS MAIN CONDENSER OFFGAS HYDROGEN MONITOR
TEXT 3.7.5.2	0	11/19/2002	Title: PLANT SYSTEMS MAIN CONDENSER OFFGAS EXPLOSIVE GAS MIXTURE
TEXT 3.7.5.3	0	11/19/2002	Title: PLANT SYSTEMS LIQUID HOLDUP TANKS
TEXT 3.7.6	0	11/19/2002	Title: PLANT SYSTEMS ESSW PUMPHOUSE VENTILATION
TEXT 3.7.7	0	11/19/2002	Title: PLANT SYSTEMS MAIN CONDENSER OFFGAS PRETREATMENT LOGARITHMIC RADIATION MONITORING INSTRUMENTATION
TEXT 3.7.8	0	11/19/2002	Title: PLANT SYSTEMS SNUBBERS
TEXT 3.7.9	0	11/19/2002	Title: PLANT SYSTEMS CONTROL STRUCTURE HVAC
TEXT 3.7.10	0	11/19/2002	Title: PLANT SYSTEMS SPENT FUEL STORAGE POOLS (SFSPS)
TEXT 3.8.1	0	11/19/2002	Title: ELECTRICAL POWER PRIMARY CONTAINMENT PENETRATION CONDUCTOR OVERCURRENT PROTECTIVE DEVICES
TEXT 3.8.2.1	0	11/19/2002	Title: ELECTRICAL POWER MOTOR OPERATED VALVES (MOV) THERMAL OVERLOAD PROTECTION - CONTINUOUS
TEXT 3.8.2.2	1	09/17/2004	Title: ELECTRICAL POWER MOTOR OPERATED VALVES (MOV) THERMAL OVERLOAD PROTECTION - AUTOMATIC
TEXT 3.8.3	0	11/19/2002	Title: ELECTRICAL POWER DIESEL GENERATOR (DG) MAINTENANCE ACTIVITIES

SSS MANUAL

Manual Name: TRM2

Manual Title: TECHNICAL REQUIREMENTS MANUAL UNIT 2

TEXT 3.8.4	0	11/19/2002
Title: ELECTRICAL POWER 24 VDC ELECTRICAL SUBSYSTEM		
TEXT 3.8.5	0	11/19/2002
Title: ELECTRICAL POWER DEGRADED VOLTAGE PROTECTION		
TEXT 3.8.6	0	11/19/2002
Title: ELECTRICAL POWER EMERGENCY SWITCHGEAR ROOM COOLING		
TEXT 3.9.1	0	11/19/2002
Title: REFUELING OPERATIONS DECAY TIME		
TEXT 3.9.2	0	11/19/2002
Title: REFUELING OPERATIONS COMMUNICATIONS		
TEXT 3.9.3	0	11/19/2002
Title: REFUELING OPERATIONS REFUELING PLATFORM		
TEXT 3.10.1	0	11/19/2002
Title: MISCELLANEOUS SEALED SOURCE CONTAMINATION		
TEXT 3.10.2	0	11/19/2002
Title: MISCELLANEOUS SHUTDOWN MARGIN TEST RPS INSTRUMENTATION		
TEXT 3.10.3	0	11/19/2002
Title: MISCELLANEOUS INDEPENDENT SPENT FUEL STORAGE INSTALLATION (ISFSI)		
TEXT 3.10.4	0	11/19/2002
Title: MISCELLANEOUS LEADING EDGE FLOW METER (LEFM)		
TEXT 3.11.1.1	0	11/19/2002
Title: RADIOACTIVE EFFLUENTS LIQUID EFFLUENTS CONCENTRATION		
TEXT 3.11.1.2	0	11/19/2002
Title: RADIOACTIVE EFFLUENTS LIQUID EFFLUENTS DOSE		

4

1

—

•

•

•



• •

IL:

•

•

•

• • • •

SSES MANUAL

Manual Name: TRM2

Manual Title: TECHNICAL REQUIREMENTS MANUAL UNIT 2

TEXT B3.2.1	0	11/19/2002
Title: CORE OPERATING LIMITS BASES CORE OPERATING LIMITS REPORT (COLR)		
TEXT B3.3.1	0	11/19/2002
Title: INSTRUMENTATION BASES RADIATION MONITORING INSTRUMENTATION		
TEXT B3.3.2	0	11/19/2002
Title: INSTRUMENTATION BASES SEISMIC MONITORING INSTRUMENTATION		
TEXT B3.3.3	0	11/19/2002
Title: INSTRUMENTATION BASES METEOROLOGICAL MONITORING INSTRUMENTATION		
TEXT B3.3.4	0	11/19/2002
Title: INSTRUMENTATION BASES TRM POST ACCIDENT MONITORING (PAM) INSTRUMENTATION		
TEXT B3.3.5	0	11/19/2002
Title: INSTRUMENTATION BASES THIS PAGE INTENTIONALLY LEFT BLANK		
TEXT B3.3.6	1	10/22/2003
Title: INSTRUMENTATION BASES TRM ISOLATION ACTUATION INSTRUMENTATION		
TEXT B3.3.7	0	11/19/2002
Title: INSTRUMENTATION BASES MAIN TURBINE OVERSPEED PROTECTION SYSTEM		
TEXT B3.3.8	1	10/22/2003
Title: INSTRUMENTATION BASES TRM RPS INSTRUMENTATION		
TEXT B3.3.9	1	11/22/2004
Title: INSTRUMENTATION BASES LPRM UPSCALE ALARM INSTRUMENTATION		
TEXT B3.3.10	0	11/19/2002
Title: INSTRUMENTATION BASES REACTOR RECIRCULATION PUMP MG SET STOPS		
TEXT B3.3.11	1	10/22/2003
Title: INSTRUMENTATION BASES MVP ISOLATION INSTRUMENTATION		

SSES MANUAL

Manual Name: TRM2

Manual Title: TECHNICAL REQUIREMENTS MANUAL UNIT 2

TEXT B3.4.1 0 11/19/2002

Title: REACTOR COOLANT SYSTEM BASES REACTOR COOLANT SYSTEM CHEMISTRY

TEXT B3.4.2 0 11/19/2002

Title: REACTOR COOLANT SYSTEM BASES STRUCTURAL INTEGRITY

TEXT B3.4.3 0 11/19/2002

Title: REACTOR COOLANT SYSTEM BASES HIGH/LOW PRESSURE INTERFACE LEAKAGE MONITOR

TEXT B3.4.4 0 11/19/2002

Title: REACTOR COOLANT SYSTEM BASES REACTOR RECIRCULATION FLOW AND ROD LINE LIMIT

TEXT B3.4.5 0 11/19/2002

Title: REACTOR COOLANT SYSTEM BASES REACTOR VESSEL MATERIALS

TEXT B3.5.1 0 11/19/2002

Title: ECCS AND RCIC BASES ADS MANUAL INHIBIT

TEXT B3.5.2 0 11/19/2002

Title: ECCS AND RCIC BASES ECCS AND RCIC SYSTEM MONITORING INSTRUMENTATION

TEXT B3.5.3 0 11/19/2002

Title: ECCS AND RCIC BASES LONG TERM NITROGEN SUPPLY TO ADS

TEXT B3.6.1 0 11/19/2002

Title: CONTAINMENT BASES VENTING OR PURGING

TEXT B3.6.2 0 11/19/2002

Title: CONTAINMENT BASES SUPPRESSION CHAMBER-TO-DRYWELL VACUUM BREAKER POSITION INDICATION

TEXT B3.6.3 0 11/19/2002

Title: CONTAINMENT BASES SUPPRESSION POOL ALARM INSTRUMENTATION

TEXT B3.6.4 0 11/19/2002

Title: CONTAINMENT BASES PRIMARY CONTAINMENT CLOSED SYSTEM BOUNDARIES

2

—

•

•

•

409

• **•** **•**

SSES MANUAL

Manual Name: TRM2

Manual Title: TECHNICAL REQUIREMENTS MANUAL UNIT 2

TEXT B3.7.5.2 0 11/19/2002

Title: PLANT SYSTEMS BASES MAIN CONDENSER OFFGAS EXPLOSIVE GAS MIXTURE

TEXT B3.7.5.3 0 11/19/2002

Title: PLANT SYSTEMS BASES LIQUID HOLDUP TANKS

TEXT B3.7.6 0 11/19/2002

Title: PLANT SYSTEMS BASES ESSW PUMPHOUSE VENTILATION

TEXT B3.7.7 0 11/19/2002

Title: PLANT SYSTEMS BASES MAIN CONDENSER OFFGAS PRETREATMENT LOGARITHMIC RADIATION MONITORING INSTRUMENTATION

TEXT B3.7.8 0 11/19/2002

Title: PLANT SYSTEMS BASES SNUBBERS

TEXT B3.7.9 0 11/19/2002

Title: PLANT SYSTEMS BASES CONTROL STRUCTURE HVAC

TEXT B3.7.10 0 11/19/2002

Title: PLANT SYSTEMS BASES SPENT FUEL STORAGE POOLS

TEXT B3.8.1 0 11/19/2002

Title: ELECTRICAL POWER BASES PRIMARY CONTAINMENT PENETRATION CONDUCTOR OVERCURRENT PROTECTIVE DEVICES

TEXT B3.8.2.1 0 11/19/2002

Title: ELECTRICAL POWER BASES MOTOR OPERATED VALVES (MOV) THERMAL OVERLOAD PROTECTION - CONTINUOUS

TEXT B3.8.2.2 1 09/17/2004

Title: ELECTRICAL POWER BASES MOTOR OPERATED VALVES (MOV) THERMAL OVERLOAD PROTECTION - AUTOMATIC

TEXT B3.8.3 0 11/19/2002

Title: ELECTRICAL POWER BASES DIESEL GENERATOR (DG) MAINTENANCE ACTIVITIES

TEXT B3.8.4 0 11/19/2002

Title: ELECTRICAL POWER BASES 24 VDC ELECTRICAL POWER SUBSYSTEM

SSS MANUAL

Manual Name: TRM2

Manual Title: TECHNICAL REQUIREMENTS MANUAL UNIT 2

TEXT B3.8.5	0	11/19/2002
Title: ELECTRICAL POWER BASES DEGRADED VOLTAGE PROTECTION		
TEXT B3.8.6	0	11/19/2002
Title: ELECTRICAL POWER BASES EMERGENCY SWITCHGEAR ROOM COOLING		
TEXT B3.9.1	0	11/19/2002
Title: REFUELING OPERATIONS BASES DECAY TIME		
TEXT B3.9.2	0	11/19/2002
Title: REFUELING OPERATIONS BASES COMMUNICATIONS		
TEXT B3.9.3	0	11/19/2002
Title: REFUELING OPERATIONS BASES REFUELING PLATFORM		
TEXT B3.10.1	0	11/19/2002
Title: MISCELLANEOUS BASES SEALED SOURCE CONTAMINATION		
TEXT B3.10.2	0	11/19/2002
Title: MISCELLANEOUS BASES SHUTDOWN MARGIN TEST RPS INSTRUMENTATION		
TEXT B3.10.3	0	11/19/2002
Title: MISCELLANEOUS BASES INDEPENDENT SPENT FUEL STORAGE INSTALLATION (ISFSI)		
TEXT B3.10.4	0	11/19/2002
Title: MISCELLANEOUS BASES LEADING EDGE FLOW METER (LEFM)		
TEXT B3.11.1.1	0	11/19/2002
Title: RADIOACTIVE EFFLUENTS BASES LIQUID EFFLUENTS CONCENTRATION		
TEXT B3.11.1.2	0	11/19/2002
Title: RADIOACTIVE EFFLUENTS BASES LIQUID EFFLUENTS DOSE		
TEXT B3.11.1.3	0	11/19/2002
Title: RADIOACTIVE EFFLUENTS BASES LIQUID WASTE TREATMENT SYSTEM		

SSES MANUAL

Manual Name: TRM2

Manual Title: TECHNICAL REQUIREMENTS MANUAL UNIT 2

TEXT B3.11.1.4	0	11/19/2002		
Title: RADIOACTIVE EFFLUENTS BASES LIQUID RADWASTE EFFLUENT MONITORING INSTRUMENTATION				
TEXT B3.11.1.5	0	11/19/2002		
Title: RADIOACTIVE EFFLUENTS BASES RADIOACTIVE LIQUID PROCESS MONITORING INSTRUMENTATION				
TEXT B3.11.2.1	0	11/19/2002		
Title: RADIOACTIVE EFFLUENTS BASES DOSE RATE				
TEXT B3.11.2.2	0	11/19/2002		
Title: RADIOACTIVE EFFLUENTS BASES DOSE - NOBLE GASES				
TEXT B3.11.2.3	0	11/19/2002		
Title: RADIOACTIVE EFFLUENTS BASES DOSE - IODINE, TRITIUM, AND RADIONUCLIDES IN PARTICULATES FORM				
TEXT B3.11.2.4	0	11/19/2002		
Title: RADIOACTIVE EFFLUENTS BASES GASEOUS RADWASTE TREATMENT SYSTEM				
TEXT B3.11.2.5	2	10/27/2004		
Title: RADIOACTIVE EFFLUENTS BASES VENTILATION EXHAUST TREATMENT SYSTEM				
TEXT B3.11.2.6	1	01/27/2004		
Title: RADIOACTIVE EFFLUENTS BASES RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION				
			LDCN	3614
TEXT B3.11.3	0	11/19/2002		
Title: RADIOACTIVE EFFLUENTS BASES TOTAL DOSE				
TEXT B3.11.4.1	0	11/19/2002		
Title: RADIOACTIVE EFFLUENTS BASES MONITORING PROGRAM				
TEXT B3.11.4.2	0	11/19/2002		
Title: RADIOACTIVE EFFLUENTS BASES LAND USE CENSUS				
TEXT B3.11.4.3	0	11/19/2002		
Title: RADIOACTIVE EFFLUENTS BASES INTERLABORATORY COMPARISON PROGRAM				

SSS MANUAL

Manual Name: TRM2

Manual Title: TECHNICAL REQUIREMENTS MANUAL UNIT 2

TEXT B3.12.1	0	11/19/2002		
Title: LOADS CONTROL PROGRAM BASES CRANE TRAVEL-SPENT FUEL STORAGE POOL				
TEXT B3.12.2	0	11/19/2002		
Title: LOADS CONTROL PROGRAM BASES HEAVY LOADS REQUIREMENTS				
TEXT B3.12.3	0	11/19/2002		
Title: LOADS CONTROL PROGRAM BASES LIGHT LOADS REQUIREMENTS				
TEXT 3.11.2.1	1	01/27/2004		
Title: RADIOACTIVE EFFLUENTS DOSE RATE				
TEXT 3.11.2.6	1	01/27/2004		
Title: RADIOACTIVE EFFLUENTS RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION				
			LDCN	3614
TEXT 4.1	0	09/27/2003		
Title: ADMINISTRATIVE CONTROLS ORGANIZATION				
TEXT 4.2	0	09/27/2003		
Title: ADMINISTRATIVE CONTROLS REPORTABLE EVENT ACTION				
TEXT 4.4	0	09/27/2003		
Title: ADMINISTRATIVE CONTROLS PROCEDURES & PROGRAMS				
TEXT 4.5	0	09/27/2003		
Title: ADMINISTRATIVE CONTROLS REPORTING REQUIREMENTS				
TEXT 4.6	0	09/27/2003		
Title: ADMINISTRATIVE CONTROLS RADIATION PROTECTION PROGRAM				
TEXT 4.7	0	09/27/2003		
Title: ADMINISTRATIVE CONTROLS TRAINING				

SUSQUEHANNA STEAM ELECTRIC STATION
LIST OF EFFECTIVE SECTIONS (TECHNICAL REQUIREMENTS MANUAL)

PPL Rev. 8

<u>Section</u>	<u>Title</u>	<u>Effective Date</u>
TOC	TABLE OF CONTENTS	11/15/2004
1.0	USE AND APPLICATION	
	Page TRM / 1.0-1	08/31/1998
	Page TRM / 1.0-2	10/04/2002
	Page TRM / 1.0-3	08/31/1998
2.0	PLANT PROGRAMS	
	Page 2.0-1	08/31/1998
	Pages TRM / 2.0-2 through TRM / 2.0-4	06/25/2002
	Page TRM / 2.0-5	04/12/1999
	Pages TRM / 2.0-6 through TRM / 2.0-14	11/12/2004
3.0	APPLICABILITY	
	Pages TRM / 3.0-1 and TRM / 3.0-2	04/08/1999
	Page TRM / 3.0-3	03/15/2002
	Page TRM / 3.0-4	04/08/1999
3.1	REACTIVITY CONTROL SYSTEMS	
	Pages 3.1-1 through 3.1-6	08/31/1998
	Pages TRM / 3.1-7 and TRM / 3.1-8	06/05/2002
	Pages TRM / 3.1-9 and TRM / 3.1-9a	02/18/1999
	Page TRM / 3.1-10	02/18/1999
3.2	CORE OPERATING LIMITS REPORT	
	Page 3.2-1	08/31/1998
	Pages TRM / 3.2-2 through TRM / 3.2-38	11/12/2004
3.3	INSTRUMENTATION	
	Pages TRM / 3.3-1 through TRM / 3.3-3	07/16/1999
	Page TRM / 3.3-4	11/28/2000
	Pages 3.3-5 through 3.3-8	08/31/1998
	Pages TRM / 3.3-9 and TRM / 3.3-9a	12/17/1998
	Pages TRM / 3.3-10 and TRM / 3.3-11	12/17/1998
	Page TRM / 3.3-12	03/30/2001
	Pages TRM / 3.3-13 and TRM / 3.3-14	12/14/1998
	Page TRM / 3.3-15	10/22/2003
	Page TRM / 3.3-16	06/27/2001
	Pages TRM / 3.3-17 and TRM / 3.3-18	06/14/2002
	Pages TRM / 3.3-19 and TRM / 3.3-20	10/22/2003
	Page TRM / 3.3-21	11/12/2004
	Pages TRM / 3.3-21a through TRM / 3.3-21d	11/12/2004
	Pages TRM / 3.3-22 through TRM / 3.3-24	05/16/2003
	Page TRM / 3.3-25	10/22/2003

LIST OF EFFECTIVE SECTIONS (TECHNICAL REQUIREMENTS MANUAL)

<u>Section</u>	<u>Title</u>	<u>Effective Date</u>
3.4	REACTOR COOLANT SYSTEM	
	Pages 3.4-1 through 3.4-5	10/23/1998
	Pages 3.4-6 through 3.4-13	08/31/1998
3.5	EMERGENCY CORE COOLING AND RCIC	
	Pages 3.5-1 through 3.5-3	08/31/1998
	Page TRM / 3.5-4	04/17/2000
	Pages 3.5-5 through 3.5-7	08/31/1998
3.6	CONTAINMENT	
	Pages 3.6-1 through 3.6-4	08/31/1998
	Page TRM / 3.6-5	01/07/2002
	Page 3.6-6	08/31/1998
	Pages TRM / 3.6-7 through TRM / 3.6-9	12/31/2002
3.7	PLANT SYSTEMS	
	Pages TRM / 3.7-1 and TRM / 3.7-2	07/29/1999
	Page 3.7-3	08/31/1998
	Pages TRM / 3.7-4 through TRM / 3.7-10	08/02/1999
	Page TRM / 3.7-11	01/21/2000
	Pages TRM / 3.7-12 through TRM / 3.7-27	08/02/1999
	Pages TRM / 3.7-28 through TRM / 3.7-31	11/16/2001
	Page TRM / 3.7-32	01/09/2004
	Page TRM / 3.7-33	10/05/2002
	Pages TRM / 3.7-34 through TRM / 3.7-36	02/01/1999
	Pages 3.7-37 through 3.7-39	08/31/1998
	Pages TRM / 3.7-40 and TRM / 3.7-40a	08/11/2000
	Pages 3.7-41 and 3.7-42	08/31/1998
	Pages 3.7-43 through 3.7-47	10/13/1998
	Page TRM / 3.7-48	03/08/2003
	Pages TRM / 3.7-49 and TRM / 3.7-50	03/09/2001
	Pages TRM / 3.7-51 and TRM / 3.7-52	04/15/2003
	Page TRM / 3.7-53	07/29/1999
3.8	ELECTRICAL POWER	
	Pages TRM / 3.8-1 and TRM / 3.8-2	04/02/2002
	Page 3.8-3	08/31/1998
	Page TRM / 3.8-4	12/31/2002
	Pages TRM / 3.8-5 and TRM / 3.8-6	04/02/2002
	Pages TRM / 3.8-7 through TRM / 3.8-8	08/31/1998
	Page TRM / 3.8-9	08/24/2001
	Page 3.8-10	08/31/1998
	Page TRM / 3.8-11	08/10/2004
	Pages 3.8-12 through 3.8-14	08/31/1998

SUSQUEHANNA STEAM ELECTRIC STATION
LIST OF EFFECTIVE SECTIONS (TECHNICAL REQUIREMENTS MANUAL)

PPL Rev. 8

<u>Section</u>	<u>Title</u>	<u>Effective Date</u>
	Pages TRM / 3.8-15 through TRM / 3.8-17	04/02/2002
	Page 3.8-18	02/01/1999
	Page TRM / 3.8-19	04/02/2002
	Page TRM / 3.8-20	02/01/1999
	Pages TRM / 3.8-21 through TRM / 3.8-23	06/06/1999
	Pages 3.8-24 and 3.8-25	08/31/1998
3.9	REFUELING OPERATIONS Pages 3.9-1 through 3.9-3	08/31/1998
3.10	MISCELLANEOUS Pages 3.10-1 through 3.10-4	08/30/1998
	Page TRM / 3.10-5	03/08/2003
	Page TRM / 3.10-6	06/05/2002
	Page TRM / 3.10-7	04/07/2000
		Corrected
	Page TRM / 3.10-8	04/17/2002
3.11	RADIOACTIVE EFFLUENTS Pages 3.11-1 through 3.11-12	08/31/1998
	Pages 3.11-13 through 3.11-16	09/01/1998
	Pages 3.11-17 and 3.11-18	08/31/1998
	Page TRM / 3.11-19	01/21/2004
	Pages 3.11-20 and 3.11-21	08/31/1998
	Pages TRM / 3.11-22 through TRM / 3.11-24	04/02/2002
	Page 3.11-25	09/01/1998
	Pages TRM / 3.11-26 through TRM / 3.11-32	01/21/2004
	Pages 3.11-33 through 3.11-47	08/31/1998
3.12	LOADS CONTROL PROGRAM Pages TRM / 3.12-1 through TRM / 3.12-5	02/05/1999
4.0	ADMINISTRATIVE CONTROLS Pages 4.0-1 through 4.0-8	08/31/1998

SUSQUEHANNA STEAM ELECTRIC STATION
LIST OF EFFECTIVE SECTIONS (TECHNICAL REQUIREMENTS MANUAL)

PPL Rev. 8

<u>Section</u>	<u>Title</u>	<u>Effective Date</u>
B 3.0	APPLICABILITY BASES	
	Pages B 3.0-1 through B 3.0-10	08/31/1998
	Pages TRM / B 3.0-11 through TRM / B 3.0-15	03/15/2002
B 3.1	REACTIVITY CONTROL SYSTEMS BASES	
	Pages TRM / B 3.1-1 through TRM / B 3.1-3	07/13/1999
	Page B 3.1-4	08/31/1998
	Pages TRM / B 3.1-5 through TRM / B 3.1-7	07/13/1999
	Page TRM / B 3.1-8	02/18/1999
B 3.2	CORE OPERATING LIMITS BASES	
	Page B 3.2-1	08/31/1998
B 3.3	INSTRUMENTATION BASES	
	Page TRM/B 3.3-1	04/07/2000
	Page B 3.3-2	08/31/1998
	Pages TRM / B 3.3-3 and TRM / B 3.3-3A	12/29/2000
	Pages TRM / B 3.3-4 through TRM / B 3.3-6	03/21/2003
	Pages TRM / B 3.3-7 through TRM / B 3.3-9	03/30/2001
	Pages B 3.3-10 through B 3.3-12	08/31/1998
	Page TRM / B3.3-13	10/22/2003
	Page TRM / B 3.3-14	06/25/2002
	Page TRM / B 3.3-14a	06/14/2002
	Page TRM / B 3.3-14b	06/14/2002
	Page TRM / B 3.3-15	10/22/2003
	Page TRM / B 3.3-16	10/22/2003
	Page TRM / B 3.3-17	10/22/2003
	Pages TRM / B 3.3-18 and TRM / B 3.3-19	11/12/2004
	Pages TRM / B 3.3-19a through TRM / B 3.3.19e	11/12/2004
	Pages TRM / B 3.3-20 and TRM / B 3.3-21	05/16/2003
	Page TRM / B3.3-22	10/22/2003
	Page TRM / B3.3-23	05/16/2003
B 3.4	REACTOR COOLANT SYSTEM BASES	
	Pages B 3.4-1 through B 3.4-4	08/31/1998
	Page TRM / B 3.4-5	10/15/1999
	Page B 3.4-6	08/31/1998
B 3.5	ECCS AND RCIC BASES	
	Pages B 3.5-1 through B 3.5-5	08/31/1998
B 3.6	CONTAINMENT BASES	
	Page TRM / B 3.6-1	07/26/2001
	Page TRM / B 3.6-2	02/01/1999
	Page B 3.6-3	08/31/1998

SUSQUEHANNA STEAM ELECTRIC STATION
LIST OF EFFECTIVE SECTIONS (TECHNICAL REQUIREMENTS MANUAL)

PPL Rev. 8

<u>Section</u>	<u>Title</u>	<u>Effective Date</u>
	Page TRM / B 3.6-4	09/23/1999
	Page TRM / B 3.6-5	01/07/2002
	Pages TRM / B 3.6-6 through TRM / B 3.6-11	12/31/2002
B 3.7	PLANT SYSTEMS BASES	
	Pages B 3.7-1 and B 3.7-2	08/31/1998
	Pages TRM / B 3.7-3 through TRM / B 3.7-7	08/02/1999
	Page TRM / B 3.7-7a	08/02/1999
	Pages TRM / B 3.7-8 through TRM / B 3.7-10	08/02/1999
	Page TRM / B 3.7-10a	08/02/1999
	Pages TRM / B 3.7-11 through TRM / B 3.7-14	08/02/1999
	Page TRM / B 3.7-14a and TRM / B 3.7-14b	01/09/2004
	Pages TRM / B 3.7-15 and TRM / B 3.7-16	02/01/1999
	Pages B 3.7-17 through B 3.7-20	08/31/1998
	Pages TRM / B 3.7-21 through TRM/B 3.7-21a	05/11/2001
	Pages TRM/B 3.7-22 and TRM/B 3.7-23	04/07/2000
	Pages B 3.7-24 through B 3.7-30	08/31/1998
	Pages TRM / B 3.7-31 and TRM / B 3.7-32	03/09/2001
	Page TRM / B 3.7-33	04/15/2003
	Pages TRM / B 3.7-34 and TRM / B 3.7-35	07/05/2000
B 3.8	ELECTRICAL POWER BASES	
	Pages TRM / B 3.8-1 and TRM / B 3.8-2	04/02/2002
	Page TRM / B 3.8-2a	04/02/2002
	Page TRM / B 3.8-3	04/02/2002
	Page TRM / B 3.8-3a	04/02/2002
	Page TRM / B 3.8-4	04/02/2002
	Page TRM / B 3.8-4a	08/10/2004
	Page TRM / B 3.8-5	08/31/1998
	Pages TRM / B 3.8-6 through TRM / B 3.8-17	04/02/2002
B.3.9	REFUELING OPERATIONS BASES	
	Pages B 3.9-1 and B 3.9-2	08/31/1998
	Pages B 3.9-3 through B 3.9-7	10/23/1998
B 3.10	MISCELLANEOUS BASES	
	Pages B 3.10-1 through B 3.10-2	08/31/1998
	Page TRM / B 3.10-3	03/08/2003
	Pages TRM / B 3.10-4 and TRM / B 3.10-5	08/23/1999
	Pages TRM / B 3.10-6 and TRM / 3.10-7	04/17/2002
B 3.11	RADIOACTIVE EFFLUENTS BASES	
	Pages B 3.11-1 through B 3.11-9	08/31/1998
	Pages TRM / B 3.11-10	02/01/1999

SUSQUEHANNA STEAM ELECTRIC STATION
LIST OF EFFECTIVE SECTIONS (TECHNICAL REQUIREMENTS MANUAL)

PPL Rev. 8

<u>Section</u>	<u>Title</u>	<u>Effective Date</u>
	Pages TRM/B 3.11-11 and TRM/B 3.11-11a	04/07/2000
	Pages TRM/B 3.11-12 and TRM/B 3.11-13	02/01/1999
	Page TRM / B 3.11-14	11/01/1999
	Page TRM / B 3.11-15	02/01/1999
	Pages B 3.11-16 through B 3.11-19	08/31/1998
	Page TRM / B 3.11-20	04/02/2002
	Page TRM / B 3.11-20a	04/02/2002
	Page TRM / B 3.11-21	10/15/2004
	Page TRM / B 3.11-22	10/15/2004
	Page TRM / B 3.11.23	04/02/2002
	Page TRM / B 3.11-23a	04/02/2002
	Pages TRM / B 3.11-24 and TRM / B 3.11-25	01/21/2004
	Pages B 3.11-26 through B 3.11-35	08/31/1998
	Page TRM / B 3.11-36	02/12/1999
B.3.12	LOADS CONTROL PROGRAM BASES	
	Pages TRM / B 3.12-1 through TRM / B 3.12-3	02/05/1999

TRM2 text LOES.doc
11/11/04

SUSQUEHANNA STEAM ELECTRIC STATION
TABLE OF CONTENTS (TECHNICAL REQUIREMENTS MANUAL)

PPL Rev. 3

<u>SECTION</u>	<u>TITLE</u>	<u>PAGE</u>
1.0	USE AND APPLICATION	1.0-1
1.1	Definitions.....	TRM/1.0-2
2.0	PLANT PROGRAMS	2.0-1
2.1	Plant Programs	2.0-1
2.2	Instrument Trip Setpoint Table	TRM/2.0-5
3.0	APPLICABILITY	TRM/3.0-1
3.0	(TRO) - TR for Operation (TRO) Applicability	TRM/3.0-1
3.0	(TRS) - TR Surveillance (TRS) Applicability.....	TRM/3.0-3
3.1	REACTIVITY CONTROL SYSTEMS	3.1-1
3.1.1	Alternate Rod Injection	3.1-1
3.1.2	CRD Housing Support	3.1-4
3.1.3	Control Rod Block Instrumentation	3.1-5
3.1.4	Control Rod Scram Accumulators Instrumentation and Check Valve	TRM/3.1-9
3.2	CORE OPERATING LIMITS REPORT	3.2-1
3.2.1	Core Operating Limits Report.....	3.2-1
3.3	INSTRUMENTATION	TRM/3.3-1
3.3.1	Radiation Monitoring Instrumentation	TRM/3.3-1
3.3.2	Seismic Monitoring Instrumentation.....	TRM/3.3-4
3.3.3	Meteorological Monitoring Instrumentation	3.3-7
3.3.4	TRM Post-Accident Monitoring Instrumentation.....	TRM/3.3-9
3.3.5	Section Not Used.....	TRM/3.3-12
3.3.6	TRM Containment Isolation Instrumentation.....	TRM/3.3-13
3.3.7	Turbine Overspeed Protection System.....	TRM/3.3-17
3.3.8	Section Not Used.....	TRM/3.3-19
3.3.9	OPRM Instrumentation	TRM/3.3-21
3.3.10	Reactor Recirculation Pump MG Set Electrical and Mechanical Stops	TRM/3.3-22
3.3.11	MVP Isolation Instrumentation	TRM/3.3-24
3.4	REACTOR COOLANT SYSTEM	3.4-1
3.4.1	Reactor Coolant System Chemistry.....	3.4-1
3.4.2	Structural Integrity.....	3.4-6
3.4.3	High/Low Pressure Interface Leakage Monitors	3.4-9
3.4.4	Reactor Recirculation Flow and Rod Line Limit.....	3.4-12
3.4.5	Reactor Vessel Material Surveillances Program.....	3.4-13
3.5	EMERGENCY CORE COOLING AND RCIC	3.5-1
3.5.1	ADS Manual Inhibit.....	3.5-1
3.5.2	ECCS and RCIC System Monitoring Instrumentation	3.5-3

SUSQUEHANNA STEAM ELECTRIC STATION
TABLE OF CONTENTS (TECHNICAL REQUIREMENTS MANUAL)

PPL Rev. 3

<u>SECTION</u>	<u>TITLE</u>	<u>PAGE</u>
3.5.3	Long Term Nitrogen Supply to ADS	3.5-6
3.6	CONTAINMENT	3.6-1
3.6.1	VENTING or PURGING	3.6-1
3.6.2	Suppression Chamber-to-Drywell Vacuum Breaker Position Indication	3.6-3
3.6.3	Suppression Pool Alarm Instrumentation.....	3.6-4
3.6.4	Primary Containment Closed System Boundaries	TRM/3.6-7
3.7	PLANT SYSTEMS.....	TRM/3.7-1
3.7.1	Emergency Service Water System (Shutdown).....	TRM/3.7-1
3.7.2	Ultimate Heat Sink and Ground Water Level.....	3.7-3
3.7.3.1	Fire Suppression Water Supply System.....	TRM/3.7-4
3.7.3.2	Spray and Sprinkler Systems	TRM/3.7-8
3.7.3.3	CO2 systems	TRM/3.7-12
3.7.3.4	Halon Systems	TRM/3.7-16
3.7.3.5	Fire Hose Stations	TRM/3.7-18
3.7.3.6	Yard Fire Hydrants and Hydrant Hose Houses.....	TRM/3.7-22
3.7.3.7	Fire Rated Assemblies.....	TRM/3.7-24
3.7.3.8	Fire Detection Instrumentation.....	TRM/3.7-26
3.7.4	Solid Radwaste System.....	TRM/3.7-35
3.7.5.1	Main Condenser Offgas Hydrogen Monitor	3.7-38
3.7.5.2	Main Condenser Explosive Gas Mixture	3.7-39
3.7.5.3	Liquid Holdup Tanks.....	TRM/3.7-40
3.7.6	ESSW Pumphouse Ventilation.....	3.7-41
3.7.7	Main Condenser Offgas Pretreatment Logarithmic Radiation Monitoring Instrumentation	3.7-42
3.7.8	Snubbers	3.7-44
3.7.9	Control Structure HVAC.....	TRM/3.7-50
3.7.10	Spent Fuel Storage Pools (SFSPs)	TRM/3.7-51
3.8	ELECTRICAL POWER.....	TRM/3.8-1
3.8.1	Primary Containment Penetration Conductor Overcurrent Protective Devices	TRM/3.8-1
3.8.2.1	Motor Operated Valves Thermal Overload Protection - Continuous	TRM/3.8-5
3.8.2.2	Motor Operated Valves Thermal Overload Protection - Automatic.....	TRM/3.8-11
3.8.3	Diesel Generator (DG) Maintenance Activities	3.8-13
3.8.4	24VDC Electrical Power Subsystem.....	TRM/3.8-15
3.8.5	Degraded Voltage Protection	TRM/3.8-21
3.8.6	Emergency Switchgear Room Cooling	3.8-24
3.9	REFUELING OPERATIONS.....	3.9-1
3.9.1	Decay Time	3.9-1
3.9.2	Communications.....	3.9-2

SUSQUEHANNA STEAM ELECTRIC STATION
TABLE OF CONTENTS (TECHNICAL REQUIREMENTS MANUAL)

PPL Rev. 3

<u>SECTION</u>	<u>TITLE</u>	<u>PAGE</u>
3.9.3	Refueling Platform.....	3.9-3
3.10	MISCELLANEOUS.....	3.10-1
3.10.1	Sealed Source Contamination.....	3.10-1
3.10.2	MODE 5 Shutdown Margin Test RPS Instrumentation	3.10-4
3.10.3	Independent Spent Fuel Storage Installation (ISFSI).....	TRM/3.10-7
3.10.4	Leading Edge Flow Meter (LEFM).....	TRM/3.10-8
3.11	RADIOACTIVE EFFLUENTS.....	3.11-1
3.11.1	Liquid Effluents.....	3.11-1
3.11.1.1	Liquid Effluents Concentration.....	3.11-1
3.11.1.2	Liquid Effluents Dose	3.11-4
3.11.1.3	Liquid Waste Treatment System	3.11-6
3.11.1.4	Liquid Radwaste Effluent Monitoring Instrumentation.....	3.11-8
3.11.1.5	Radioactive Liquid Process Monitoring Instrumentation	3.11-13
3.11.2	Gaseous Effluents.....	3.11-17
3.11.2.1	Dose Rate.....	3.11-17
3.11.2.2	Dose - Noble Gases	3.11-20
3.11.2.3	Dose - Iodine, Tritium, and Radionuclides in Particulate Form	3.11-21
3.11.2.4	Gaseous Radwaste Treatment System	TRM/3.11-22
3.11.2.5	Ventilation Exhaust Treatment System.....	TRM/3.11-23
3.11.2.6	Radioactive Gaseous Effluent Monitoring Instrumentation.....	3.11-26
3.11.3	Total Dose	3.11-33
3.11.4	Radiological Environmental Monitoring.....	3.11-35
3.11.4.1	Monitoring Program	3.11-35
3.11.4.2	Land Use Census	3.11-45
3.11.4.3	Interlaboratory Comparison Program.....	3.11-47
3.12	LOADS CONTROL PROGRAM.....	TRM/3.12-1
3.12.1	Crane Travel - Spent Fuel Storage Pool.....	TRM/3.12-1
3.12.2	Heavy Loads Requirements	TRM/3.12-3
3.12.3	Light Loads Requirements.....	TRM/3.12-5
4.0	ADMINISTRATIVE CONTROLS.....	4.0-1
4.1	Organization	4.0-1
4.2	Reportable Event Action.....	4.0-2
4.3	Safety Limit Violation.....	4.0-3
4.4	Procedures and Programs.....	4.0-4
4.5	Reporting Requirements.....	4.0-5
4.6	Radiation Protection Program.....	4.0-7
4.7	Training.....	4.0-8

SUSQUEHANNA STEAM ELECTRIC STATION
TABLE OF CONTENTS (TECHNICAL REQUIREMENTS MANUAL)

PPL Rev. 3

<u>SECTION</u>	<u>TITLE</u>	<u>PAGE</u>
B 3.0	(TRO) - TR for Operation (TRO) Applicability	B 3.0-1
B 3.0	(TRS) - TR Surveillance (TRS) Applicability.....	B 3.0-9
B 3.1.1	Alternate Rod Injection	TRM/B 3.1-1
B 3.1.2	CRD Housing Support.....	B 3.1-4
B 3.1.3	Control Rod Block Instrumentation	TRM/B 3.1-5
B 3.1.4	Control Rod Scram Accumulators Instrumentation and Check Valve	TRM/B 3.1-8
B 3.2.1	Core Operating Limits Report (COLR).....	B 3.2-1
B 3.3.1	Radiation Monitoring Instrumentation	TRM/B 3.3-1
B 3.3.2	Seismic Monitoring Instrumentation.....	B 3.3-2
B 3.3.3	Meteorological Monitoring Instrumentation	TRM/B 3.3-3
B 3.3.4	TRM Post-Accident Monitoring Instrumentation.....	TRM/B 3.3-4
B 3.3.5	Section Not Used.....	TRM/B 3.3-7
B 3.3.6	TRM Containment Isolation Instrumentation.....	B 3.3-10
B 3.3.7	Turbine Overspeed Protection System.....	TRM/B 3.3-14
B 3.3.8	Section Not Used.....	TRM/B 3.3-15
B 3.3.9	OPRM Instrumentation	TRM/B 3.3-18
B 3.3.10	Reactor Recirculation Pump MG Set Electrical and Mechanical Stops	TRM/B 3.3-20
B 3.3.11	MVP Isolation Instrumentation	TRM/B 3.3-22
B 3.4.1	Reactor Coolant System Chemistry.....	B 3.4-1
B 3.4.2	Structural Integrity.....	B 3.4-2
B 3.4.3	High/Low Pressure Interface Leakage Monitors	B 3.4-4
B 3.4.4	Reactor Recirculation Flow and Rod Line Limit	TRM/B 3.4-5
B 3.4.5	Reactor Vessel Material Surveillances Program.....	B 3.4-6
B 3.5.1	ADS Manual Inhibit.....	B 3.5-1
B 3.5.2	ECCS and RCIC System Monitoring Instrumentation	B 3.5-3
B 3.5.3	Long Term Nitrogen Supply to ADS	B 3.5-4
B 3.6.1	VENTING or PURGING	TRM/B 3.6-1
B 3.6.2	Suppression Chamber-to-Drywell Vacuum Breaker Position Indication	B 3.6-3
B 3.6.3	Suppression Pool Alarm Instrumentation.....	B 3.6-4
B 3.6.4	Primary Containment Closed System Boundaries.....	TRM/B 3.6-6
B 3.7.1	Emergency Service Water System (Shutdown).....	B 3.7-1
B 3.7.2	Ultimate Heat Sink and Ground Water Level.....	B 3.7-2
B 3.7.3.1	Fire Suppression Water Supply System	TRM/B 3.7-3
B 3.7.3.2	Spray and Sprinkler Systems	TRM/B 3.7-5
B 3.7.3.3	CO2 systems	TRM/B 3.7-7
B 3.7.3.4	Halon Systems	TRM/B 3.7-8

SUSQUEHANNA STEAM ELECTRIC STATION
TABLE OF CONTENTS (TECHNICAL REQUIREMENTS MANUAL)

PPL Rev. 3

<u>SECTION</u>	<u>TITLE</u>	<u>PAGE</u>
B 3.7.3.5	Fire Hose Stations	TRM/B 3.7-10
B 3.7.3.6	Yard Fire Hydrants and Hydrant Hose Houses.....	TRM/B 3.7-11
B 3.7.3.7	Fire Rated Assemblies.....	TRM/B 3.7-12
B 3.7.3.8	Fire Detection Instrumentation.....	TRM/B 3.7-14
B 3.7.4	Solid Radwaste System.....	TRM/B 3.7-15
B 3.7.5.1	Main Condenser Offgas Hydrogen Monitor	B 3.7-17
B 3.7.5.2	Main Condenser Explosive Gas Mixture	B 3.7-19
B 3.7.5.3	Liquid Holdup Tanks.....	B 3.7-20
B 3.7.6	ESSW Pumphouse Ventilation.....	TRM/B 3.7-21
B 3.7.7	Main Condenser Offgas Pretreatment Logarithmic Radiation Monitoring Instrumentation	TRM/B 3.7-22
B 3.7.8	Snubbers	B 3.7-24
B 3.7.9	Control Structure HVAC.....	TRM/B 3.7-31
B 3.7.10	Spent Fuel Storage Pools.....	TRM/B 3.7-33
B 3.8.1	Primary Containment Penetration Conductor Overcurrent Protective Devices	TRM/B 3.8-1
B 3.8.2.1	Motor Operated Valves Thermal Overload Protection - Continuous	TRM/B 3.8-3
B 3.8.2.2	Motor Operated Valves Thermal Overload Protection - Automatic.....	TRM/B 3.8-4
B 3.8.3	Diesel Generator (DG) Maintenance Activities	TRM/B 3.8-5
B 3.8.4	24VDC Electrical Power Subsystem.....	TRM/B 3.8-6
B 3.8.5	Degraded Voltage Protection	TRM/B 3.8-16
B 3.8.6	Emergency Switchgear Room Cooling	TRM/B 3.8-17
B 3.9.1	Decay Time	B 3.9-1
B 3.9.2	Communications.....	B 3.9-2
B 3.9.3	Refueling Platform.....	B 3.9-3
B 3.10.1	Sealed Source Contamination	B 3.10-1
B 3.10.2	MODE 5 Shutdown Margin Test RPS Instrumentation	B 3.10-2
B 3.10.3	Independent Spent Fuel Storage Installation (ISFSI).....	TRM/B 3.10-4
B 3.10.4	Leading Edge Flow Meter (LEFM)	TRM/B 3.10-6
B 3.11.1.1	Liquid Effluents Concentration.....	B 3.11-1
B 3.11.1.2	Liquid Effluents Dose	B 3.11-4
B 3.11.1.3	Liquid Waste Treatment System	B 3.11-6
B 3.11.1.4	Liquid Radwaste Effluent Monitoring Instrumentation.....	B 3.11-7
B 3.11.1.5	Radioactive Liquid Process Monitoring Instrumentation	TRM/B 3.11-10
B 3.11.2.1	Dose Rate.....	TRM/B 3.11-12
B 3.11.2.2	Dose - Noble Gases	B 3.11-16
B 3.11.2.3	Dose - Iodine, Tritium, and Radionuclides in Particulate Form	B 3.11-18
B 3.11.2.4	Gaseous Radwaste Treatment System.....	TRM/B 3.11-20
B 3.11.2.5	Ventilation Exhaust Treatment System.....	TRM/B 3.11-21

SUSQUEHANNA STEAM ELECTRIC STATION
TABLE OF CONTENTS (TECHNICAL REQUIREMENTS MANUAL)

PPL Rev. 3

<u>SECTION</u>	<u>TITLE</u>	<u>PAGE</u>
B 3.11.2.6	Radioactive Gaseous Effluent Monitoring Instrumentation.....	TRM/B 3.11-24
B 3.11.3	Total Dose	B 3.11-26
B 3.11.4.1	Monitoring Program	B 3.11-28
B 3.11.4.2	Land Use Census	B 3.11-34
B 3.11.4.3	Interlaboratory Comparison Program.....	TRM/B 3.11-36
B 3.12	LOADS CONTROL PROGRAM.....	TRM/B 3.12-1
B.3.12.1	Crane Travel - Spent Fuel Storage Pool	TRM/B 3.12-1
B.3.12.2	Heavy Loads Requirements	TRM/B 3.12-2
B.3.12.3	Light Loads Requirements.....	TRM/B 3.12-3

TRM2 Text TOC
11/11/04

2.0 PLANT PROGRAMS AND SETPOINTS

2.2 Instrument Trip Setpoint Table

The Instrument Trip Setpoint Limits in Table 2.2-1 are the Trip Setpoint value limits that were contained in the Instrumentation Setpoint tables for protection systems and other functions important to safety that were included in the scope of the original Standard Technical Specifications. Actual instrument setpoints are established utilizing the Allowable Values specified in the Technical Specifications and Technical Requirements. Allowable Values are established in the Reference LCOs and TROs identified in this Table. TRO references are enclosed in square brackets.

Instrumentation process setpoints for the listed subsystems and trip functions are set consistent with the Trip Setpoint Limit Column of Table 2.2-1. Actual setpoints are established in accordance with engineering procedures.

Alarm setpoints and other non-protection system trip settings as may be found in the Technical Specifications or in the Technical Requirements are not included in this table.

Reference NDAP-QA-1104 Setpoint Change Control

TABLE 2.2-1 (Page 1 of 8)
INSTRUMENTATION SETPOINTS

SYSTEM/REFERENCE LCO [TRO]		TRIP FUNCTION	TRIP SETPOINT
2.2.1	Reactor Protection		
2.2.1.1	3.3.1.1	Intermediate Range Monitor, Neutron Flux - High	$\leq 120/125$ divisions of full scale
2.2.1.2	3.3.1.1	Average Power Range Monitor, Neutron Flux - High Setdown	$\leq 15\%$ of RATED THERMAL POWER
2.2.1.3	3.3.1.1	Average Power Range Monitor, Flow Biased Simulated Thermal Power - High Two Loop Operation	See COLR - TRO 3.2
2.2.1.4	3.3.1.1	Average Power Range Monitor, Flow Biased Simulated Thermal Power - High Single Loop Operation	See COLR - TRO 3.2
2.2.1.5	3.3.1.1	Average Power Range Monitor, Flow Biased Simulated Thermal Power - High Flow Clamped	$\leq 113.5\%$ of RATED THERMAL POWER
2.2.1.6	3.3.1.1	Average Power Range Monitor, Fixed Neutron Flux - High	$\leq 118\%$ of RATED THERMAL POWER
2.2.1.7	3.3.1.1	Reactor Vessel Steam Dome Pressure - High	≤ 1087 psig
2.2.1.8	3.3.1.1	Reactor Vessel Water Level - Low, Level 3	≥ 13.0 inches ^(a)
2.2.1.9	3.3.1.1	Main Steam Isolation Valve - Closure	$\leq 10\%$ closed
2.2.1.10		This Section Not Used	
2.2.1.11	3.3.1.1	Drywell Pressure - High	≤ 1.72 psig
2.2.1.12	3.3.1.1	Scram Discharge Volume Water Level - High - Level Transmitter	≤ 65 gallons
2.2.1.13	3.3.1.1	Scram Discharge Volume Water Level - High - Float Switch	≤ 61 gallons
2.2.1.14	3.3.1.1	Turbine Stop Valve - Closure	$\leq 5.5\%$ closed
2.2.1.15	3.3.1.1	Turbine Control Valve Fast Closure, Trip Oil Pressure - Low	≥ 500 psig

(continued)

(a) See Figure 2.2-1

TABLE 2.2-1 (Page 2 of 8)
INSTRUMENTATION SETPOINTS

SYSTEM/REFERENCE LCO [TRO]		TRIP FUNCTION	TRIP SETPOINT
2.2.1.16 OPRM Instrumentation			
2.2.1.16.1	3.3.1.3	Sp Cell Signal Amplitude	See COLR – TRO 3.2
2.2.1.16.2	3.3.1.3	N2 Confirmation Count Permissive	See COLR – TRO 3.2
2.2.1.16.3	[3.3.9]	TOL Period Confirmation Tolerance	0.10 sec
2.2.1.16.4	[3.3.9]	Ta Averaging Filter	5 sec
2.2.1.16.5	[3.3.9]	Fc Conditioning Filter Cutoff Frequency	1.5 Hz
2.2.1.16.6	[3.3.9]	Tmin Minimum Oscillation Period	1.0 sec
2.2.1.16.7	[3.3.9]	Tmax Maximum Oscillation Period	3.5 sec
2.2.1.16.8	[3.3.9]	Noise Floor Peak Discrimination Threshold	1
2.2.1.16.9	[3.3.9]	Minimum LPRM/Cell Cell Operability Requirement	2
2.2.1.16.10	[3.3.9]	S1 Peak Threshold Setpoint	1.20
2.2.1.16.11	[3.3.9]	S2 Valley Threshold Setpoint	0.85
2.2.1.16.12	[3.3.9]	Smax Max. Amplitude Trip Setpoint	1.50
2.2.1.16.13	[3.3.9]	DR3 Growth Rate Factor Setpoint	1.60
2.2.1.16.14	[3.3.9]	T1 lo S1 to S2 Timer Range	0.5 sec
2.2.1.16.15	[3.3.9]	T1 hi S1 to S2 Timer Range	1.75 sec
2.2.1.16.16	[3.3.9]	T2 lo S2 to (S3 or Smax) Timer Range	0.5 sec
2.2.1.16.17	[3.3.9]	T2 hi S2 to (S3 or Smax) Timer Range	1.75 sec
2.2.2 Isolation Actuation Instrumentation			
2.2.2.1 Primary Containment Isolation			
2.2.2.1.1	3.3.6.1	Reactor Vessel Water Level Low, Level 3	≥ 13.0 inches ^(a)
2.2.2.1.2	3.3.6.1	Reactor Vessel Water Level Low Low, Level 2	≥ -38.0 inches ^(a)
2.2.2.1.3	3.3.6.1	Reactor Vessel Water Level Low Low Low, Level 1	≥ -129 inches ^(a)
2.2.2.1.4	3.3.6.1	Drywell Pressure - High	≤ 1.72 psig
2.2.2.1.5	3.3.6.1/[3.3.6]	SGTS Exhaust Radiation - High	≤ 23.0 mR/hr
2.2.2.1.6	[3.3.6]	Main Steam Line Radiation - High High	$\leq 15 \times$ full power background without hydrogen injection

(continued)

TABLE 2.2-1 (Page 3 of 8)
INSTRUMENTATION SETPOINTS

SYSTEM/REFERENCE LCO [TRO]		TRIP FUNCTION	TRIP SETPOINT
2.2.2.2 Secondary Containment Isolation			
2.2.2.2.1	3.3.6.2	Reactor Vessel Water Level - Low Low, Level 2	≥ -38.0 inches ^(a)
2.2.2.2.2	3.3.6.2	Drywell Pressure - High	≤ 1.72 psig
2.2.2.2.3	3.3.6.2	Refuel Floor High Exhaust Duct Radiation - High	≤ 18 mR/hr
2.2.2.2.4	3.3.6.2	Railroad Access Shaft Exhaust Duct Radiation - High	≤ 5 mR/hr
2.2.2.2.5	3.3.6.2	Refuel Floor Wall Exhaust Duct Radiation - High	≤ 21 mR/hr
2.2.2.3 Main Steam Line Isolation			
2.2.2.3.1	3.3.6.1	Reactor Vessel Water Level - Low Low Low, Level 1	≥ -129 inches ^(a)
2.2.2.3.2	3.3.6.1	Main Steam Line Pressure - Low	≥ 861 psig
2.2.2.3.3	3.3.6.1	Main Steam Line Flow - High	≤ 113 psid
2.2.2.3.4	3.3.6.1	Condenser Vacuum - Low	≥ 9.0 inches Hg vacuum
2.2.2.3.5	3.3.6.1	Reactor Building Main Steam Line Tunnel Temperature - High	$\leq 177^{\circ}\text{F}$
2.2.2.3.6		This Section Not Used	
2.2.2.3.7	[3.3.6]	Reactor Building Main Steam Line Tunnel Δ Temperature - High	$\leq 99^{\circ}\text{F}$
2.2.2.3.8	[3.3.6]	Turbine Building Main Steam Tunnel Temperature - High	$\leq 197^{\circ}\text{F}$
2.2.2.4 Reactor Water Cleanup System Isolation			
2.2.2.4.1	3.3.6.1	Reactor Vessel Water Level - Low Low, Level 2	≥ -38 inches ^(a)
2.2.2.4.2	3.3.6.1	RWCU Δ Flow - High	≤ 59 gpm
2.2.2.4.3	3.3.6.1	RWCU Flow - High	≤ 462 gpm
2.2.2.4.4	3.3.6.1	RWCU Penetration Area Temperature - High	$\leq 131^{\circ}\text{F}$
2.2.2.4.5	[3.3.6]	RWCU Penetration Room Area Δ Temperature - High	$\leq 69^{\circ}\text{F}$
2.2.2.4.6	3.3.6.1	RWCU Pump Area Temperature - High	$\leq 147^{\circ}\text{F}$
2.2.2.4.7	[3.3.6]	RWCU Pump Room Area Δ Temperature - High	$\leq 69^{\circ}\text{F}$
2.2.2.4.8	3.3.6.1	RWCU Heat Exchanger Area Temperature - High	$\leq 147^{\circ}\text{F}$
2.2.2.4.9	[3.3.6]	RWCU Heat Exchanger Room Area Δ Temperature - High	$\leq 69^{\circ}\text{F}$

(continued)

^(a) See Figure 2.2-1

TABLE 2.2-1 (Page 4 of 8)
INSTRUMENTATION SETPOINTS

SYSTEM/REFERENCE LCO [TRO]		TRIP FUNCTION	TRIP SETPOINT
2.2.2.5 Reactor Core Isolation Cooling System Isolation			
2.2.2.5.1	3.3.6.1	RCIC Steam Line Δ Pressure - High	≤ 188 inches H ₂ O
2.2.2.5.2	3.3.6.1	RCIC Steam Supply Line Pressure - Low	≥ 60 psig
2.2.2.5.3	3.3.6.1	RCIC Turbine Exhaust Diaphragm Pressure - High	≤ 10.0 psig
2.2.2.5.4	3.3.6.1	RCIC Equipment Room Temperature - High	$\leq 167^{\circ}\text{F}$
2.2.2.5.5	3.3.6.1	RCIC Pipe Routing Area Temperature - High	$\leq 167^{\circ}\text{F}$
2.2.2.5.6	3.3.6.1	RCIC Emergency Area Cooler Temperature - High	$\leq 167^{\circ}\text{F}$
2.2.2.5.7	3.3.6.1	Drywell Pressure - High	≤ 1.72 psig
2.2.2.5.8	[3.3.6]	RCIC Equipment Room Δ Temperature - High	$\leq 89^{\circ}\text{F}$
2.2.2.5.9	[3.3.6]	RCIC Pipe Routing Area Δ Temperature - High	$\leq 89^{\circ}\text{F}$
2.2.2.6 High Pressure Coolant Injection System Isolation			
2.2.2.6.1	3.3.6.1	HPCI Steam Line Δ Pressure - High	≤ 370 inches H ₂ O
2.2.2.6.2	3.3.6.1	HPCI Steam Supply Line Pressure - Low	≥ 104 psig
2.2.2.6.3	3.3.6.1	HPCI Turbine Exhaust Diaphragm Pressure - High	≤ 10 psig
2.2.2.6.4	3.3.6.1	HPCI Equipment Room Temperature - High	$\leq 167^{\circ}\text{F}$
2.2.2.6.5	3.3.6.1	HPCI Emergency Area Cooler Temperature - High	$\leq 167^{\circ}\text{F}$
2.2.2.6.6	3.3.6.1	HPCI Pipe Routing Area Temperature - High	$\leq 167^{\circ}\text{F}$
2.2.2.6.7	3.3.6.1	Drywell Pressure - High	≤ 1.72 psig
2.2.2.6.8	[3.3.6]	HPCI Equipment Room Δ Temperature - High	$\leq 89^{\circ}\text{F}$
2.2.2.6.9	[3.3.6]	HPCI Pipe Routing Area Δ Temperature - High	$\leq 89^{\circ}\text{F}$
2.2.2.7 Shutdown Cooling/System Isolation			
2.2.2.7.1	3.3.6.1	Reactor Vessel Water Level - Low, Level 3	≥ 13.0 inches ^(a)
2.2.2.7.2	3.3.6.1	Reactor Vessel Steam Dome Pressure - High	≤ 98 psig
2.2.2.7.3	[3.3.6]	RHR Flow - High	$\leq 25,000$ gpm
2.2.3 ECCS Actuation			
2.2.3.1 Core Spray System			
2.2.3.1.1	3.3.5.1	Reactor Vessel Water Level - Low Low Low, Level 1	≥ -129 inches ^(a)
2.2.3.1.2	3.3.5.1	Drywell Pressure - High	≤ 1.72 psig
2.2.3.1.3	3.3.5.1	Reactor Vessel Steam Dome Pressure - Low - Injection permissive	$\geq 413, \leq 427$ psig

(continued)

^(a) See Figure 2.2-1

TABLE 2.2-1 (Page 5 of 8)
INSTRUMENTATION SETPOINTS

SYSTEM/REFERENCE LCO [TRO]		TRIP FUNCTION	TRIP SETPOINT
2.2.3.2	LPCI Mode of RHR System		
2.2.3.2.1	3.3.5.1	Reactor Vessel Water Level - Low Low Low, Level 1	≥ -129 inches ^(a)
2.2.3.2.2	3.3.5.1	Drywell Pressure - High	≤ 1.72 psig
2.2.3.2.3	3.3.5.1	Reactor Vessel Steam Dome Pressure - Low, Injection permissive	$\geq 413, \leq 427$ psig
2.2.3.2.4	3.3.5.1	Reactor Vessel Steam Dome Pressure - Low, Recirculation Discharge Valve permissive	≥ 236 psig, decreasing
2.2.3.3	HPCI System		
2.2.3.3.1	3.3.5.1	Reactor Vessel Water Level - Low Low, Level 2	≥ -38 inches ^(a)
2.2.3.3.2	3.3.5.1	Drywell Pressure - High	≤ 1.72 psig
2.2.3.3.3	3.3.5.1	Condensate Storage Tank Level - Low	≥ 36.0 inches above tank bottom
2.2.3.3.4	3.3.5.1	Reactor Vessel Water Level - High, Level 8	≤ 54 inches
2.2.3.4	Automatic Depressurization System (ADS)		
2.2.3.4.1	3.3.5.1	Reactor Vessel Water Level - Low Low Low, Level 1	≥ -129 inches
2.2.3.4.2	3.3.5.1	Drywell Pressure - High	≤ 1.72 psig
2.2.3.4.3	3.3.5.1	ADS Timer	≤ 102 seconds
2.2.3.4.4	3.3.5.1	Core Spray Pump Discharge Pressure - High	$\geq 135, \leq 155$ psig
2.2.3.4.5	3.3.5.1	Low Pressure Coolant Injection Pump Discharge Pressure - High	$\geq 121, \leq 129$ psig
2.2.3.4.6	3.3.5.1	Reactor Vessel Water Level - Low, Level 3 Confirmatory	≥ 13 inches
2.2.3.4.7	3.3.5.1	ADS Drywell Pressure Bypass Timer	≤ 420 seconds
2.2.3.5	Loss of Power - ECCS Actuation		
2.2.3.5.1	4.16kv ESS Bus Undervoltage (Loss of Voltage < 20%)		
2.2.3.5.1.1	3.3.8.1	Bus Undervoltage	$\geq 823.2, \leq 856.8$ Volts
2.2.3.5.1.2	3.3.8.1	Time delay	$\geq 0.4, \leq 0.6$ seconds

(continued)

^(a) See Figure 2.2-1

TABLE 2.2-1 (Page 6 of 8)
INSTRUMENTATION SETPOINTS

SYSTEM/REFERENCE LCO [TRO]		TRIP FUNCTION	TRIP SETPOINT
2.2.3.5.2	4.16kV ESS Bus Undervoltage (Degraded Voltage < 65%)		
2.2.3.5.2.1	3.3.8.1	Bus Undervoltage	$\geq 2641.1, \leq 2748.9$ Volts
2.2.3.5.2.2	3.3.8.1	Time delay	$\geq 2.7, \leq 3.3$ seconds
2.2.3.5.3	4.16kV ESS Bus Undervoltage (Degraded Voltage, < 93%)		
2.2.3.5.3.1	3.3.8.1	Bus Undervoltage	$\geq 3829.3, \leq 3906.7$ Volts
2.2.3.5.3.2	3.3.8.1	Time Delay (Non-LOCA)	≥ 4 minute, 30 seconds
2.2.3.5.3.4	3.3.8.1	Time Delay (LOCA)	≤ 5 minute, 30 seconds $\geq 9, \leq 11$ seconds
2.2.3.5.4	480V ESS Bus 0B565 Undervoltage (Degraded Voltage, < 65%)		
2.2.3.5.4.1	[3.8.5]	480V Basis	$\geq 308.9, \leq 315.1$ Volts
2.2.3.5.4.2	[3.8.5]	Time Delay	$\geq 4.5, \leq 5.5$ seconds
2.2.3.5.5	480V ESS Bus 0B565 Undervoltage (Degraded Voltage, < 92%)		
2.2.3.5.5.1	[3.8.5]	480V Basis	$\geq 437.6, \leq 446.4$ Volts
2.2.3.5.5.2	[3.8.5]	Time Delay	$\geq 9, \leq 11$ seconds
2.2.4	ATWS Alternate Rod Injection and Recirculation Pump Trip		
2.2.4.1	3.3.4.2/[3.1.1]	Reactor Vessel, Water Level - Low Low, Level 2	≥ -38 inches ^(a)
2.2.4.1	3.3.4.2/[3.1.1]	Reactor Vessel Steam Dome Pressure - High	≤ 1135 psig
2.2.5	End of Cycle Recirculation Pump Trip		
2.2.5.1	3.3.4.1	Turbine Stop Valve-Closure	$\leq 5.5\%$ closed
2.2.5.2	3.3.4.1	Turbine Control Valve - Fast Closure	≥ 500 psig
2.2.6	Reactor Core Isolation Cooling System Actuation		
2.2.6.1	3.3.5.2	Reactor Vessel Water Level - Low Low, Level 2	≥ -38 inches ^(a)
2.2.6.2	3.3.5.2	Reactor Vessel Water Level - High, Level 8	≤ 54 inches ^(a)
2.2.6.3	3.3.5.2	Condensate Storage Tank Level - Low	≥ 36.0 inches above tank bottom

(continued)

^(a) See Figure 2.2-1

TABLE 2.2-1 (Page 7 of 8)
INSTRUMENTATION SETPOINTS

SYSTEM/REFERENCE LCO [TRO]		TRIP FUNCTION	TRIP SETPOINT
2.2.7	Control Rod Block		
2.2.7.1	Rod Block Monitor		
2.2.7.1.1	3.3.2	Low Power Range Upscale - Two Loop Operation	$\leq 0.58W + 52\%$
2.2.7.1.2	3.3.2	Low Power Range Upscale - Single Loop Operation	$\leq 0.58W + 47\%$
2.2.7.1.3		Downscale	5%
2.2.7.2	APRM		
2.2.7.2.1	[3.1.3]	Flow Biased Simulated Thermal Power-High - Two Loop Operation	See COLR - TRO 3.2
2.2.7.2.2	[3.1.3]	Flow Biased Simulated Thermal Power High - Single Loop Operation	See COLR - TRO 3.2
2.2.7.2.3	[3.1.3]	Flow Biased Simulated Thermal Power High - High Flow Clamped	$\leq 108\%$ of RATED THERMAL POWER
2.2.7.2.4	[3.1.3]	Downscale	$\geq 5\%$ of RATED THERMAL POWER
2.2.7.2.5	[3.1.3]	Neutron Flux - High Setdown	$\leq 12\%$ of RATED THERMAL POWER
2.2.7.3	Source Range Monitors		
2.2.7.3.1	[3.1.3]	Upscale	$\leq 2E5$ cps
2.2.7.3.2	[3.1.3]	Downscale	≥ 0.7 cps ^(b)
2.2.7.4	Intermediate Range Monitors		
2.2.7.4.1	[3.1.3]	Upscale	$\leq 108/125$ divisions of full scale
2.2.7.4.2	[3.1.3]	Downscale	$\geq 5/125$ divisions of full scale
2.2.7.5	Scram Discharge Volume		
2.2.7.5.1	[3.1.3]	Water Level - High	≤ 35.9 gallons
2.2.7.6	Reactor Coolant System Recirculation Flow		
2.2.7.6.1	[3.1.3]	Upscale	114%
2.2.7.6.2	[3.1.3]	Comparator	$\leq 10\%$ flow deviation

(continued)

^(b) Provided signal-to-noise ratio is ≥ 2 . Otherwise, ≥ 3 cps.

TABLE 2.2-1 (Page 8 of 8)
INSTRUMENTATION SETPOINTS

SYSTEM/REFERENCE LCO [TRO]		TRIP FUNCTION	TRIP SETPOINT
2.2.8	CREOASS		
2.2.8.1	3.3.7.1	Main Control Room Outside Air Intake Radiation Monitor	≤ 5 mR/hr
2.2.8.1.1	3.3.7.1	Reactor Vessel Water Level - Low Low, Level 2	≥ -38.0 inches ^(a)
2.2.8.1.2	3.3.7.1	Drywell Pressure - High	≤ 1.72 psig
2.2.8.1.3	3.3.7.1	Refuel Floor High Exhaust Duct Radiation - High	≤ 18 mR/hr
2.2.8.1.4	3.3.7.1	Railroad Access Shaft Exhaust Duct Radiation - High	≤ 5 mR/hr
2.2.8.1.5	3.3.7.1	Refuel Floor Wall Exhaust Duct Radiation - High	≤ 21 mR/hr
2.2.9	Feedwater/Main Turbine Trip System Actuation		
2.2.9.1	3.3.2.2	Reactor Vessel Level - High	≤ 54.0 inches ^(a)
2.2.10	MVP Isolation		
2.2.10.1	[3.3.11]	Main Steam Line Radiation - High High	≤ 15 x full power background without hydrogen injection

^(a) See Figure 2.2-1

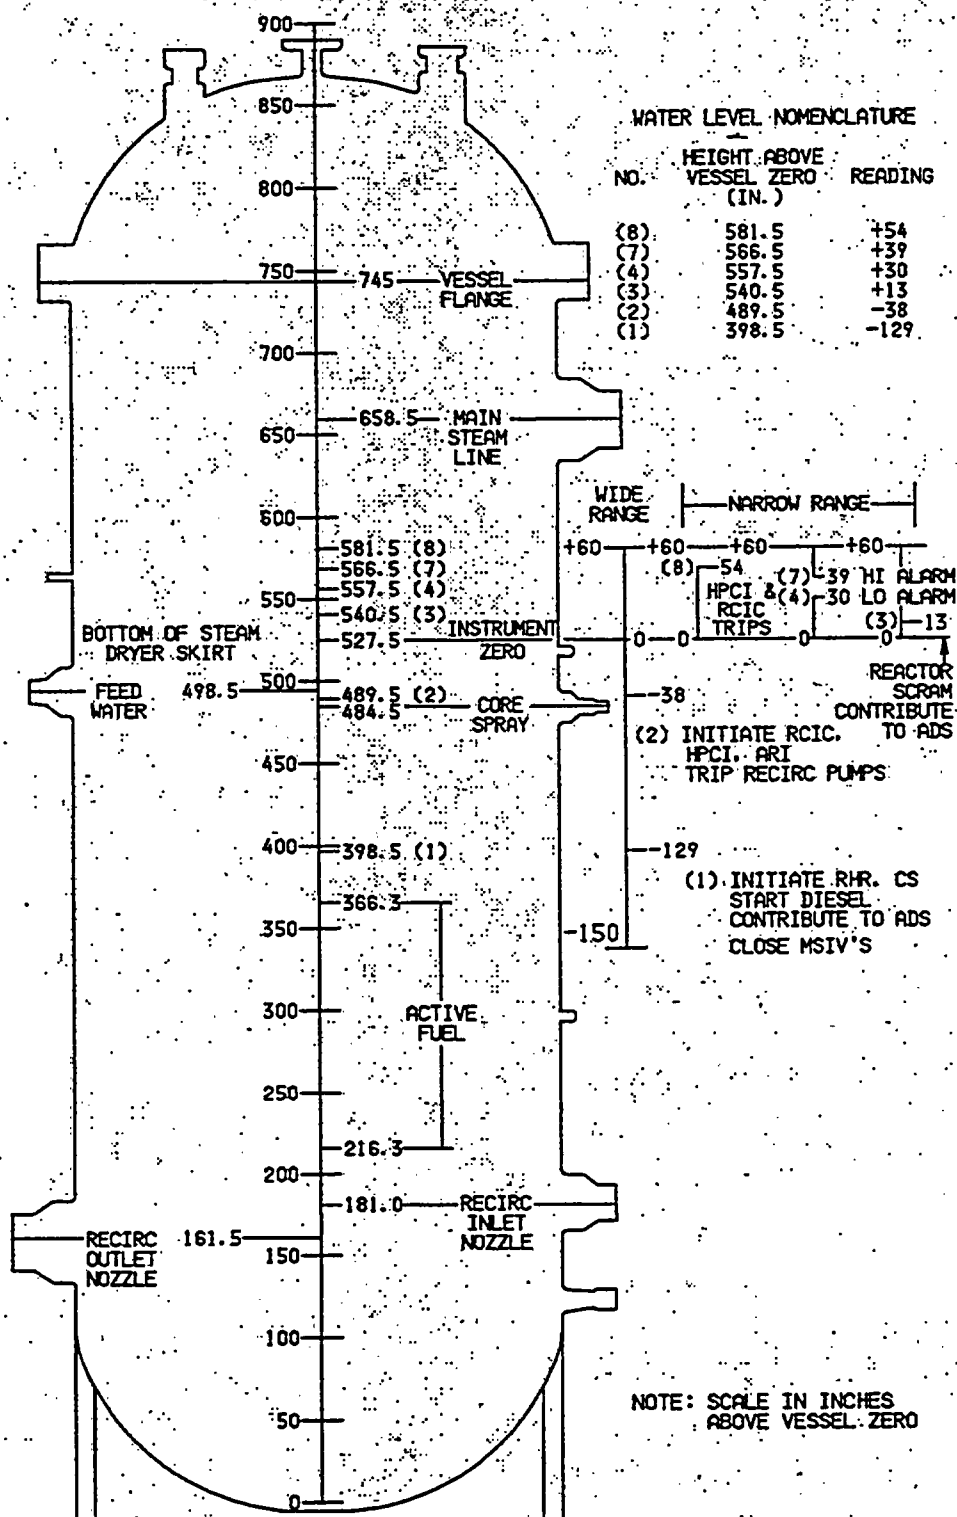


FIGURE 2.2-1
REACTOR VESSEL WATER LEVEL

CADAM ID: F102..2.1A

3.2 Core Operating Limits Report (COLR)

3.2.1 Core Operating Limits Report (COLR)

TRO 3.2.1 The Core Operating Limits specified in the attached COLR shall be met.

APPLICABILITY: Specified in the referenced Technical Specifications.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. Core Operating Limits not met.	A.1 Perform action(s) described in referenced Technical Specification.	Specified in referenced Technical Specifications.

TECHNICAL REQUIREMENT SURVEILLANCE

SURVEILLANCE	FREQUENCY
<p>NOTE</p> <p>No associated Surveillances. Surveillances are implemented in the applicable Technical Specifications.</p>	N/A

Susquehanna SES Unit 2 Cycle 12

CORE OPERATING LIMITS REPORT

**Nuclear Fuels
Engineering**

November 2004



CORE OPERATING LIMITS REPORT REVISION DESCRIPTION INDEX

Rev. No.	Affected Sections	Description/Purpose of Revision
0	ALL	Issuance of this COLR is in support of Unit 2 Cycle 12 operation.
1	5.0 6.0 8.0	<p>This revision adds a text box to all appropriate plots. This text box indicates that for all bypass operable cases, four bypass valves are assumed operable. For the bypass inoperable cases, the text box indicates that two or more bypass valves are assumed inoperable.</p> <p>This revision was generated in response to Facility Operating License Amendment 185 which altered SR 3.7.6.1.</p> <p>This revision is administrative in nature and no underlying calculations or plotted data were altered.</p>
2	TOC 1.0 9.0 10.0	<p>This revision adds the Power / Flow map to the COLR. Section 1.0 was revised to include the stability regions as part of the COLR. The Power / Flow map was added as Section 9.0. The Reference section was renumbered as Section 10.0 and a stability reference added.</p> <p>This revision is administrative in nature since the Power / Flow map is already included in NDAP-QA-0338.</p>
3	5.0 8.0 10.0	<p>The figures within Section 5.0 and Section 8.0 are revised to incorporate the 0.02 MCPR Safety Limit reduction approved by Amendment No. 191.</p> <p>Figure 5.2-2 is revised to correct the Operating Limit error documented by CR 606127.</p>
4	TOC 1.0 2.0 9.0 10.0 11.0	<p>This revision changes the Power / Flow map and adds setpoints for the OPRM system. The change to the Power / Flow map provides direction when the OPRM system is OPERABLE and inoperable. The setpoints for the OPRM system are set to reliably detect and suppress anticipated stability related power oscillations while providing a high degree of confidence that the MCPR safety limit is not violated.</p>

**SUSQUEHANNA STEAM ELECTRIC STATION
Unit 2 Cycle 12
CORE OPERATING LIMITS REPORT**

Table of Contents

1.0	<u>INTRODUCTION</u>	4
2.0	<u>DEFINITIONS</u>	5
3.0	<u>SHUTDOWN MARGIN</u>	6
4.0	<u>AVERAGE PLANAR LINEAR HEAT GENERATION RATE (APLHGR)</u>	7
5.0	<u>MINIMUM CRITICAL POWER RATIO (MCPR)</u>	9
6.0	<u>LINEAR HEAT GENERATION RATE (LHGR)</u>	20
7.0	<u>AVERAGE POWER RANGE MONITOR (APRM) GAIN AND SETPOINTS</u>	23
8.0	<u>RECIRCULATION LOOPS - SINGLE LOOP OPERATION</u>	26
9.0	<u>POWER / FLOW MAP</u>	33
10.0	<u>OPRM SETPOINTS</u>	35
11.0	<u>REFERENCES</u>	36

1.0 INTRODUCTION

This CORE OPERATING LIMITS REPORT for Susquehanna Unit 2 Cycle 12 is prepared in accordance with the requirements of Susquehanna Unit 2, Technical Specification 5.6.5. As required by Technical Specifications 5.6.5, core shutdown margin, the core operating limits, APRM setpoints, and OPRM setpoints presented herein were developed using NRC-approved methods and are established such that all applicable limits of the plant safety analysis are met.

2.0 DEFINITIONS

Terms used in this COLR but not defined in Section 1.0 of the Technical Specifications or Section 1.1 of the Technical Requirements Manual are provided below.

- 2.1 The AVERAGE BUNDLE EXPOSURE shall be equal to the total energy produced by the bundle divided by the total initial weight of uranium in the fuel bundle.
- 2.2 The AVERAGE PLANAR EXPOSURE at a specified height shall be equal to the total energy produced per unit length at the specified height divided by the total initial weight of uranium per unit length at that height.
- 2.3 The FRACTION OF LIMITING POWER DENSITY (FLPD) shall be the LHGR existing at a given height divided by the applicable LHGR for APRM Setpoint Limit for that bundle type.
- 2.4 The FRACTION OF RATED THERMAL POWER (F RTP) shall be the measured THERMAL POWER divided by the RATED THERMAL POWER.
- 2.5 FDLRX is the ratio of the maximum LHGR calculated by the core monitoring system for each fuel bundle divided by the LHGR limit for the applicable fuel bundle type.
- 2.6 MFLCPR is the ratio of the applicable MCPR operating limit for the applicable fuel bundle type divided by the MCPR calculated by the core monitoring system for each fuel bundle.
- 2.7 MAPRAT is the ratio of the maximum APLHGR calculated by the core monitoring system for each fuel bundle divided by the APLGHR limit for the applicable fuel bundle type.
- 2.8 FDLRC is the ratio of the maximum LHGR calculated by the core monitoring system for each fuel bundle divided by the LHGR for APRM Setpoint Limit for the applicable fuel bundle type.
- 2.9 OPRM is the Oscillation Power Range Monitor. The Oscillation Power Range Monitor (OPRM) will reliably detect and suppress anticipated stability related power oscillations while providing a high degree of confidence that the MCPR safety limit is not violated.
- 2.10 N_p is the OPRM setpoint for the number of consecutive confirmations of oscillation half-cycles that will be considered evidence of a stability related power oscillation.
- 2.11 S_p is the OPRM trip setpoint for the peak to average OPRM signal.
- 2.12 F_p is the core flow, in Mlbm / hr, below which the OPRM RPS trip is activated.

3.0 SHUTDOWN MARGIN

3.1 Technical Specification Reference

Technical Specification 3.1.1

3.2 Description

The SHUTDOWN MARGIN shall be equal to or greater than:

a) 0.38% $\Delta k/k$ with the highest worth rod analytically determined

OR

b) 0.28% $\Delta k/k$ with the highest worth rod determined by test

Since core reactivity will vary during the cycle as a function of fuel depletion and poison burnup, Beginning of Cycle (BOC) SHUTDOWN MARGIN (SDM) tests must also account for changes in core reactivity during the cycle. Therefore, the SDM measured at BOC must be equal to or greater than the applicable requirement from either 3.2.a or 3.2.b plus an adder, "R". The adder, "R", is the difference between the calculated value of maximum core reactivity (that is, minimum SDM) during the operating cycle and the calculated BOC core reactivity. If the value of "R" is zero (that is, BOC is the most reactive point in the cycle) no correction to the BOC measured value is required.

The SHUTDOWN MARGIN limits provided in 3.2a and 3.2b are applicable in MODES 1, 2, 3, 4, and 5. This includes core shuffling.

4.0 AVERAGE PLANAR LINEAR HEAT GENERATION RATE (APLHGR)

4.1 Technical Specification Reference


Technical Specification 3.2.1

4.2 Description

The APLHGRs for ATRIUM™-10 fuel shall not exceed the limit shown in Figure 4.2-1.

The APLHGR limits in Figure 4.2-1 are valid for Main Turbine Bypass Operable and Inoperable and EOC-RPT Operable and Inoperable in Two Loop operation. The APLHGR limits for Single Loop operation are provided in Section 8.0.

SSS UNIT 2 CYCLE 12

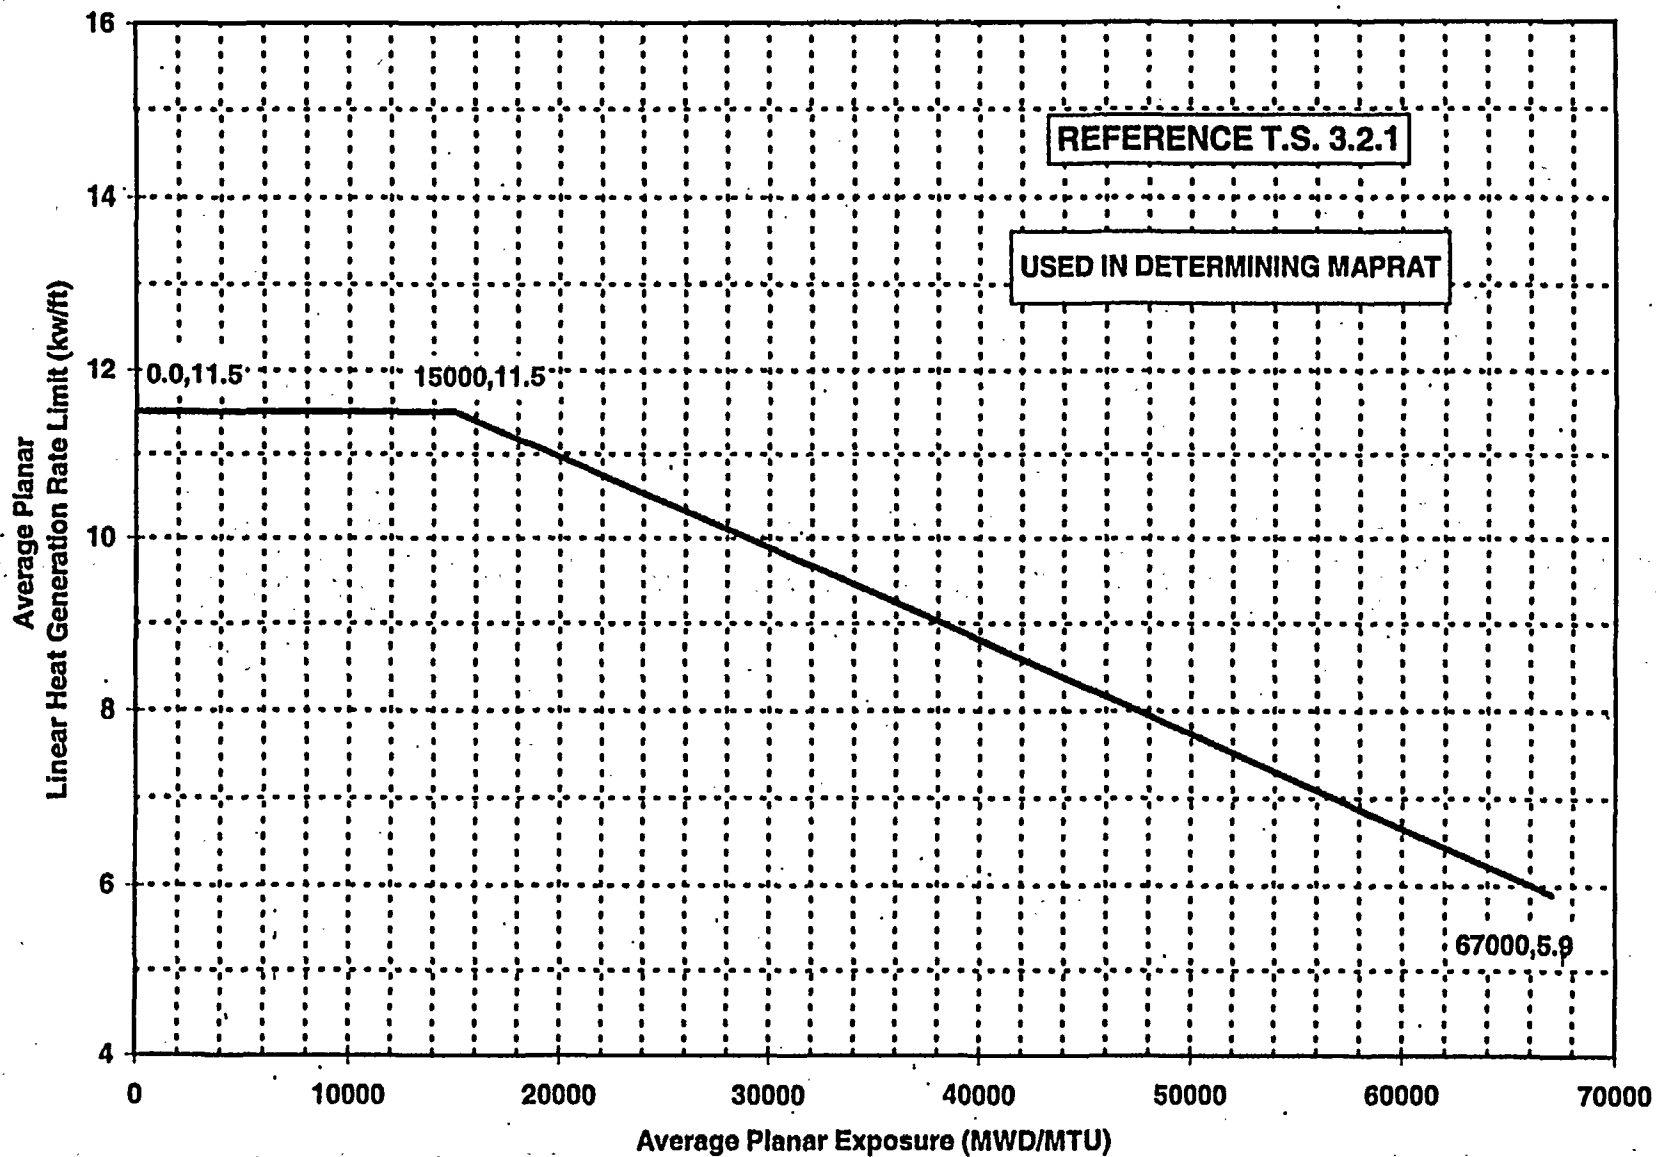

AVERAGE PLANAR LINEAR HEAT GENERATION RATE LIMIT VERSUS
AVERAGE PLANAR EXPOSURE TWO LOOP OPERATION
ATRIUM™-10 FUEL
FIGURE 4.2-1

5.0 MINIMUM CRITICAL POWER RATIO (MCPR)

5.1 Technical Specification Reference

Technical Specification 3.2.2, 3.7.6, and 3.3.4.1

5.2 Description

The MCPR limit is specified as a function of core power, core flow, average scram insertion time per Section 5.3 and plant equipment operability status. The MCPR limits for all fuel types (ATRIUM™-10) shall be the greater of the Flow-Dependent or the Power-Dependent MCPR, depending on the applicable equipment operability status.

a) EOC-RPT and Main Turbine Bypass Operable

Figure 5.2-1: Flow-Dependent MCPR value determined from BOC to EOC

Figure 5.2-2: Power-Dependent MCPR value determined from BOC to EOC

b) Main Turbine Bypass Inoperable / EOC-RPT Operable

Figure 5.2-3: Flow-Dependent MCPR value determined from BOC to EOC

Figure 5.2-4: Power-Dependent MCPR value determined from BOC to EOC

c) EOC-RPT Inoperable / Main Turbine Bypass Operable

Figure 5.2-5: Flow-Dependent MCPR value determined from BOC to EOC

Figure 5.2-6: Power-Dependent MCPR value determined from BOC to EOC

The MCPR limits in Figures 5.2-1 through 5.2-6 are valid for Two Loop operation.


The MCPR limits for Single Loop operation are provided in Section 8.0.

5.3 Average Scram Time Fraction

Table 5.3-1 provides the relationship between average scram time to control rod position and scram time fraction. The evaluation of scram insertion time data, as it relates to the attached table should be performed per Reactor Engineering procedures.


EOC-RPT and Main Turbine Bypass Operable

SSES UNIT 2 CYCLE 12

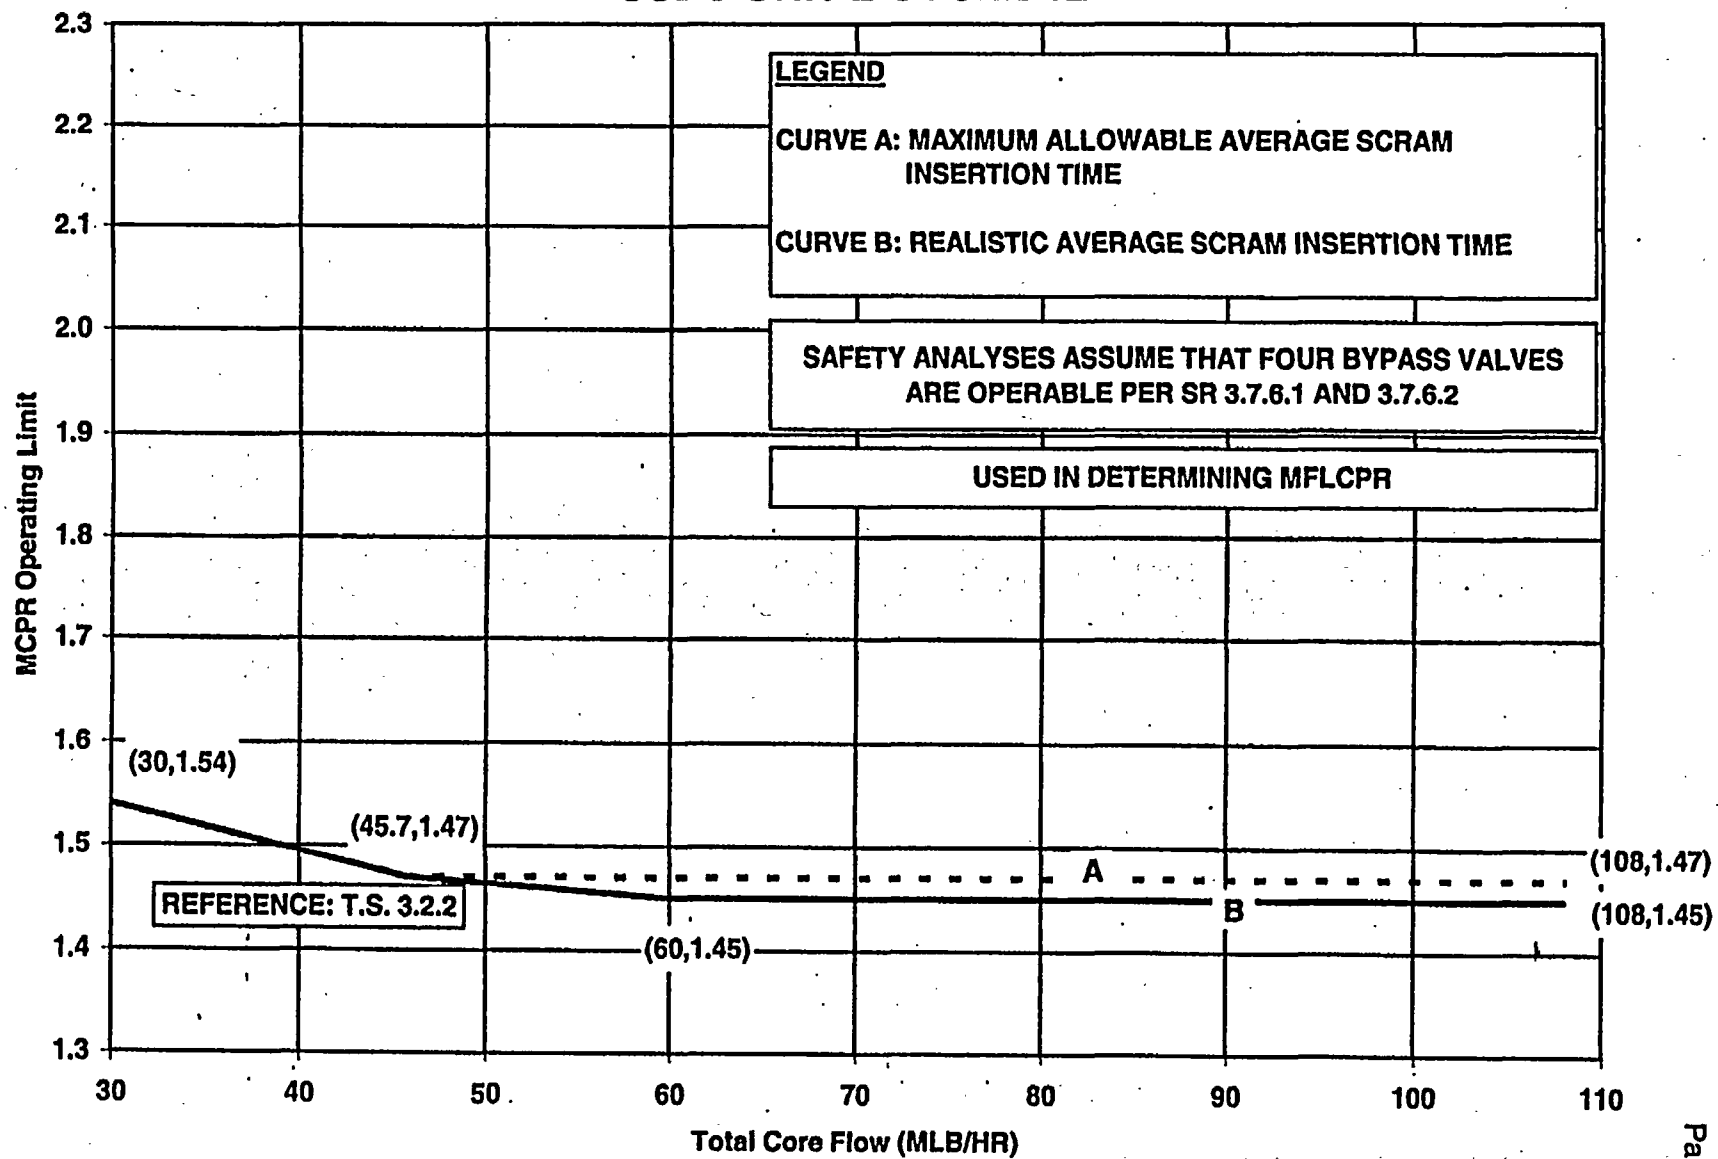

MCPR OPERATING LIMIT VERSUS TOTAL CORE FLOW
 EOC-RPT AND MAIN TURBINE BYPASS OPERABLE
 TWO LOOP OPERATION (BOC TO EOC)
 FIGURE 5.2-1


SSES UNIT 2 CYCLE 12

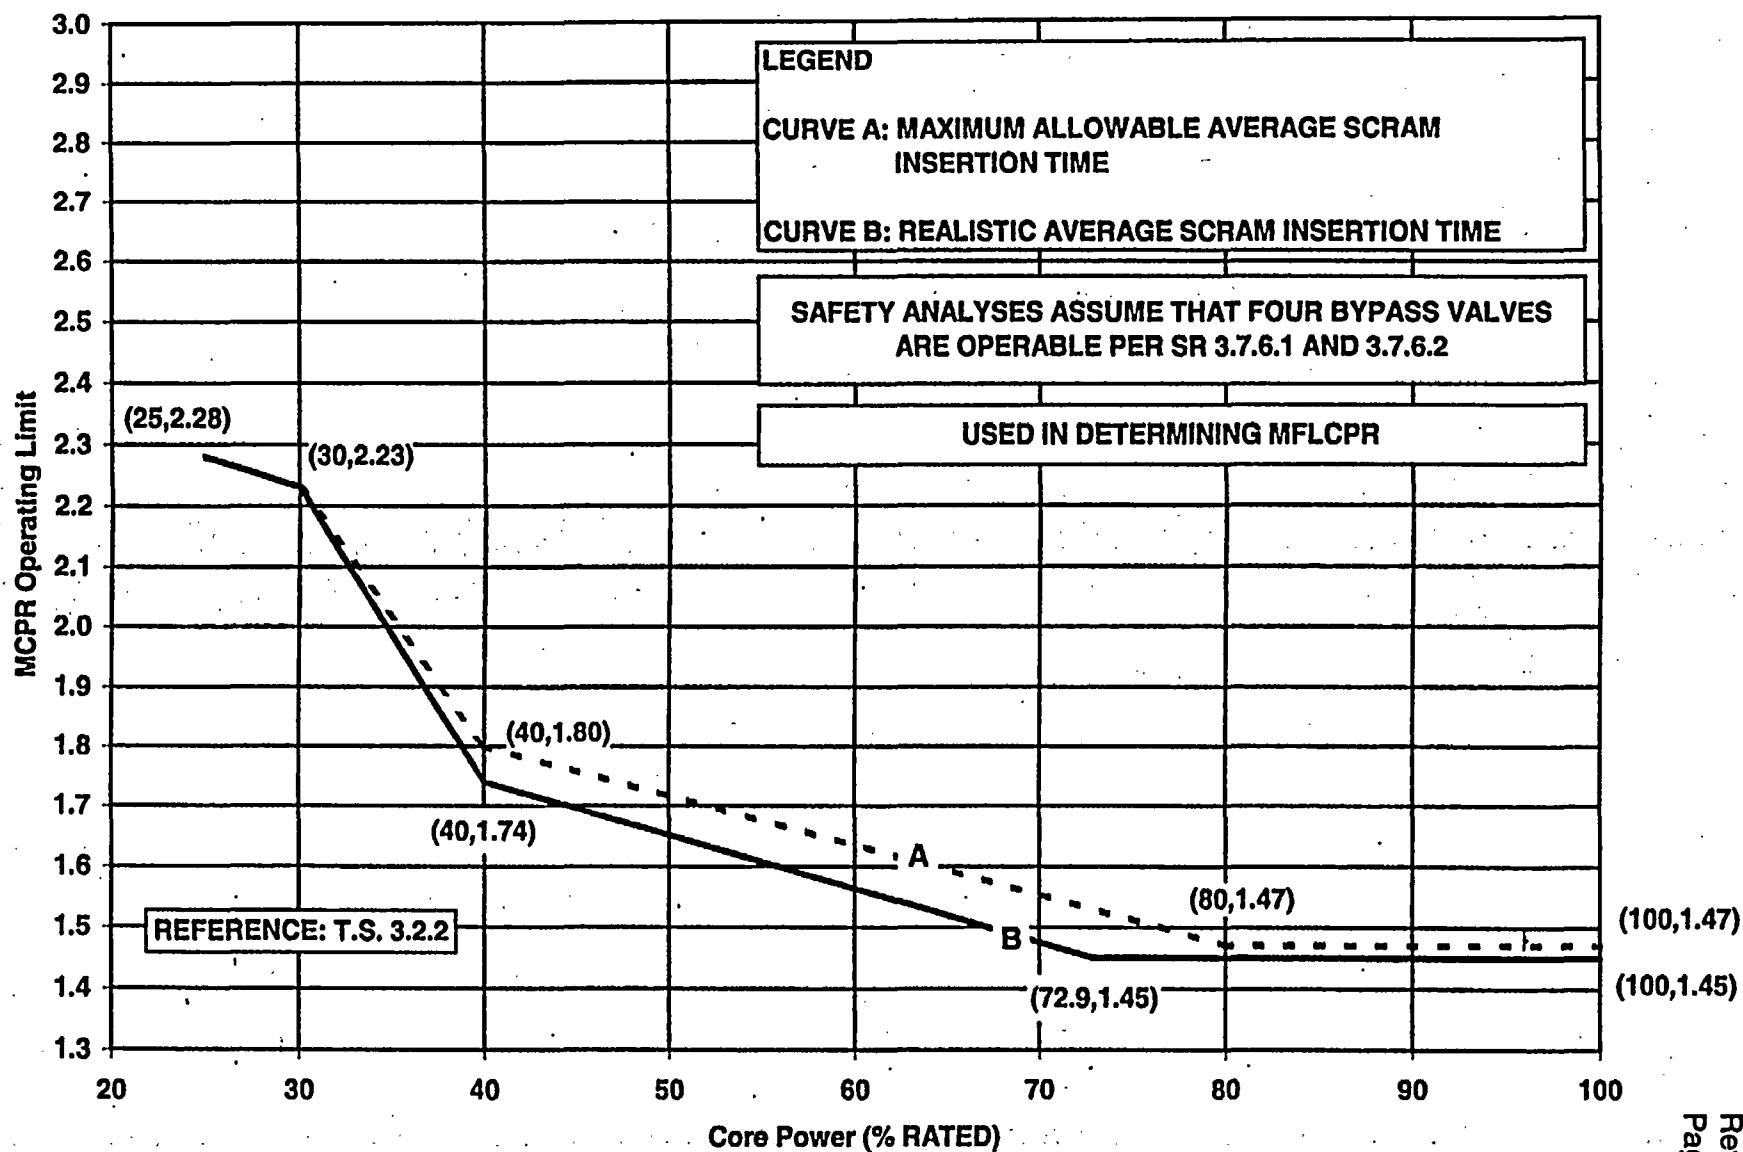

MCPR OPERATING LIMIT VERSUS CORE POWER
EOC-RPT AND MAIN TURBINE BYPASS OPERABLE
TWO LOOP OPERATION (BOC TO EOC)
FIGURE 5.2-2


Main Turbine Bypass Inoperable / EOC-RPT Operable

SSES UNIT 2 CYCLE 12

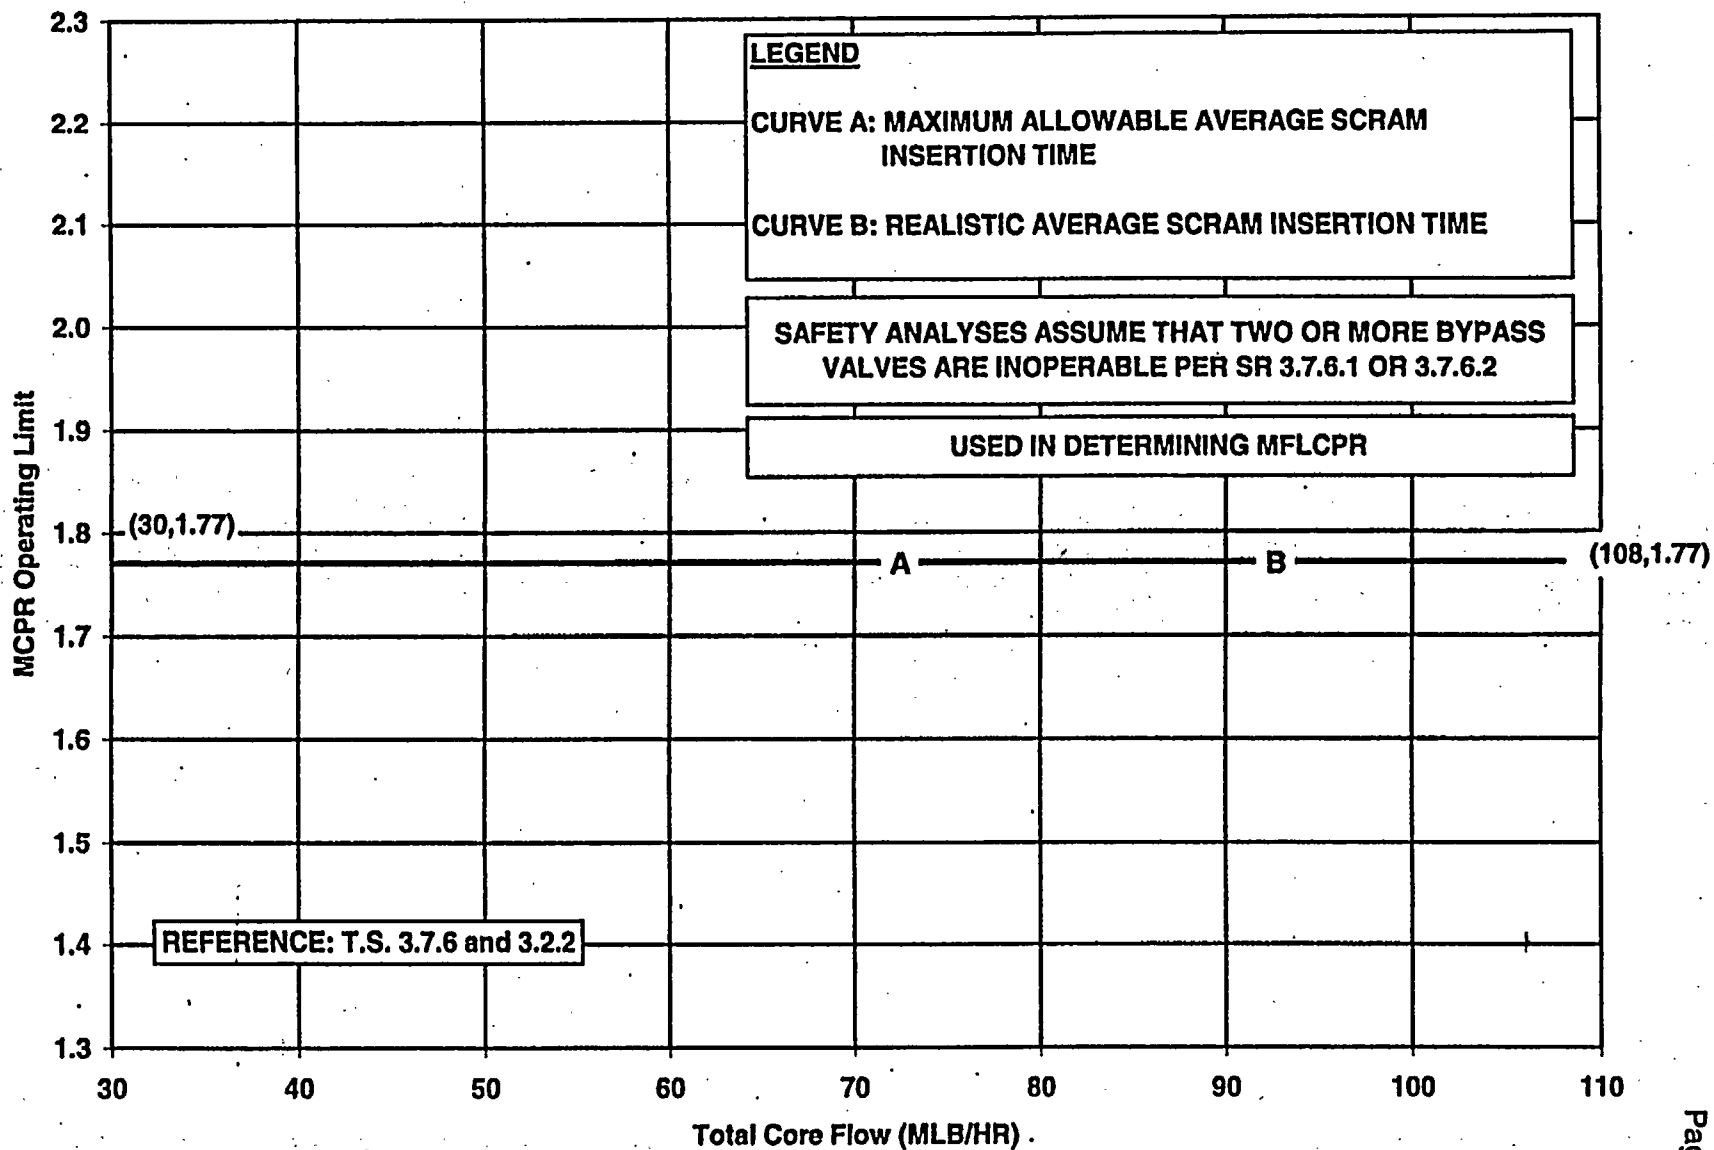

MCPR OPERATING LIMIT VERSUS TOTAL CORE FLOW
MAIN TURBINE BYPASS INOPERABLE / EOC-RPT OPERABLE
TWO LOOP OPERATION (BOC TO EOC)
FIGURE 5.2-3


SSES UNIT 2 CYCLE 12

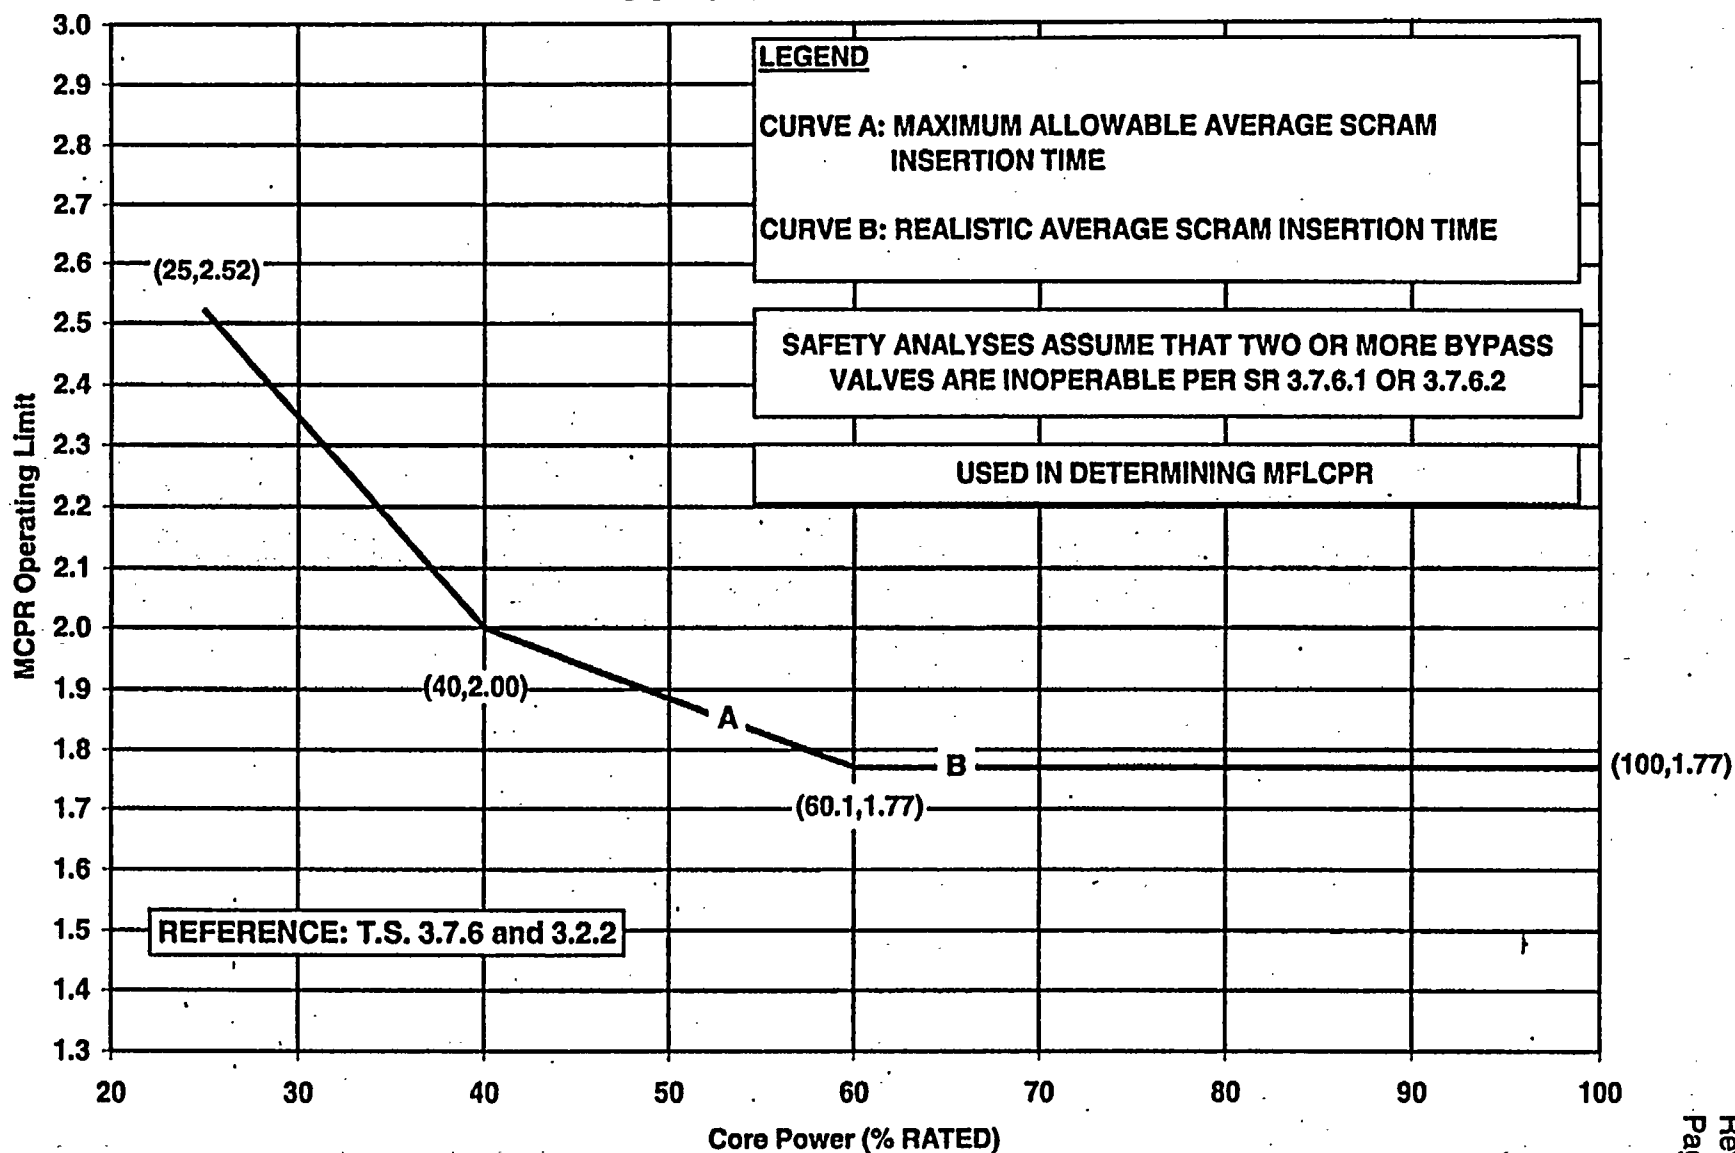

MCPR OPERATING LIMIT VERSUS CORE POWER
MAIN TURBINE BYPASS INOPERABLE / EOC-RPT OPERABLE
TWO LOOP OPERATION (BOC to EOC)
FIGURE 5.2-4


EOC-RPT Inoperable / Main Turbine Bypass Operable

SSES UNIT 2 CYCLE 12

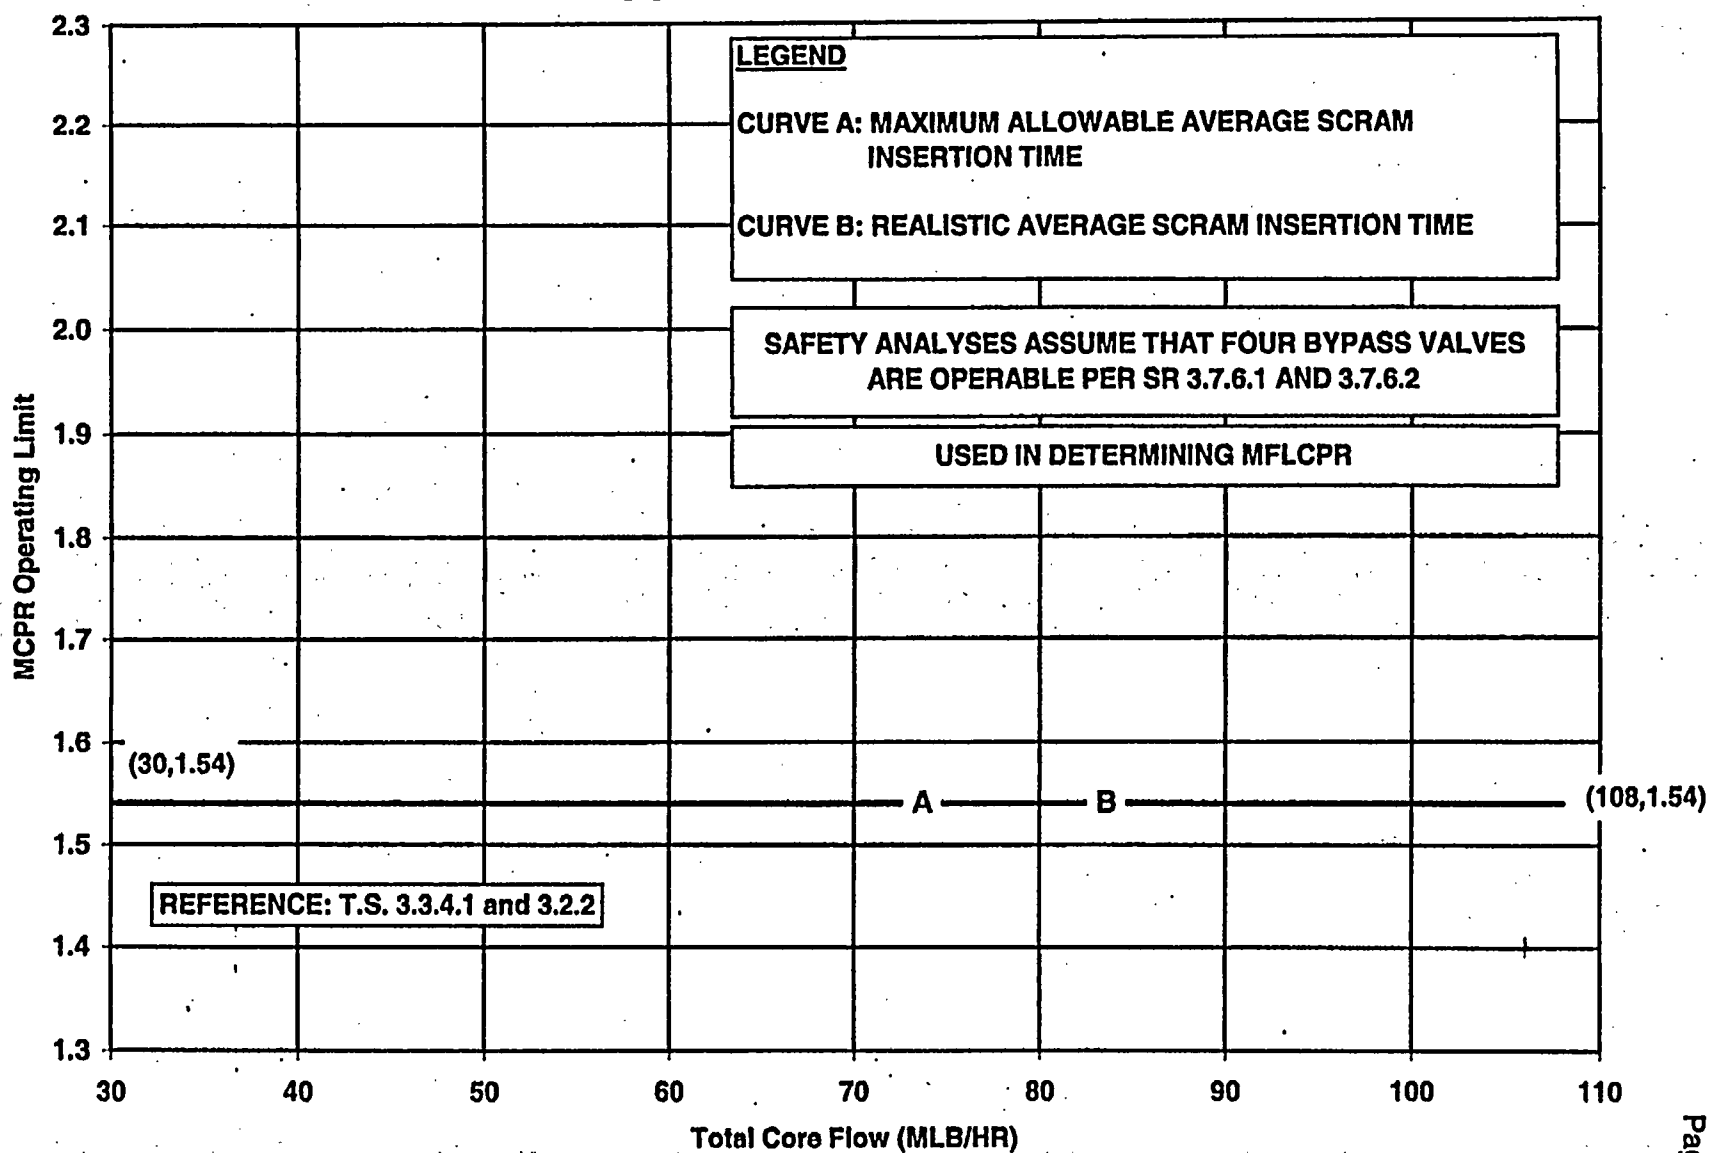

**MCPR OPERATING LIMIT VERSUS TOTAL CORE FLOW
EOC-RPT INOPERABLE / MAIN TURBINE BYPASS OPERABLE
TWO LOOP OPERATION (BOC TO EOC)
FIGURE 5.2-5**

SSES UNIT 2 CYCLE 12

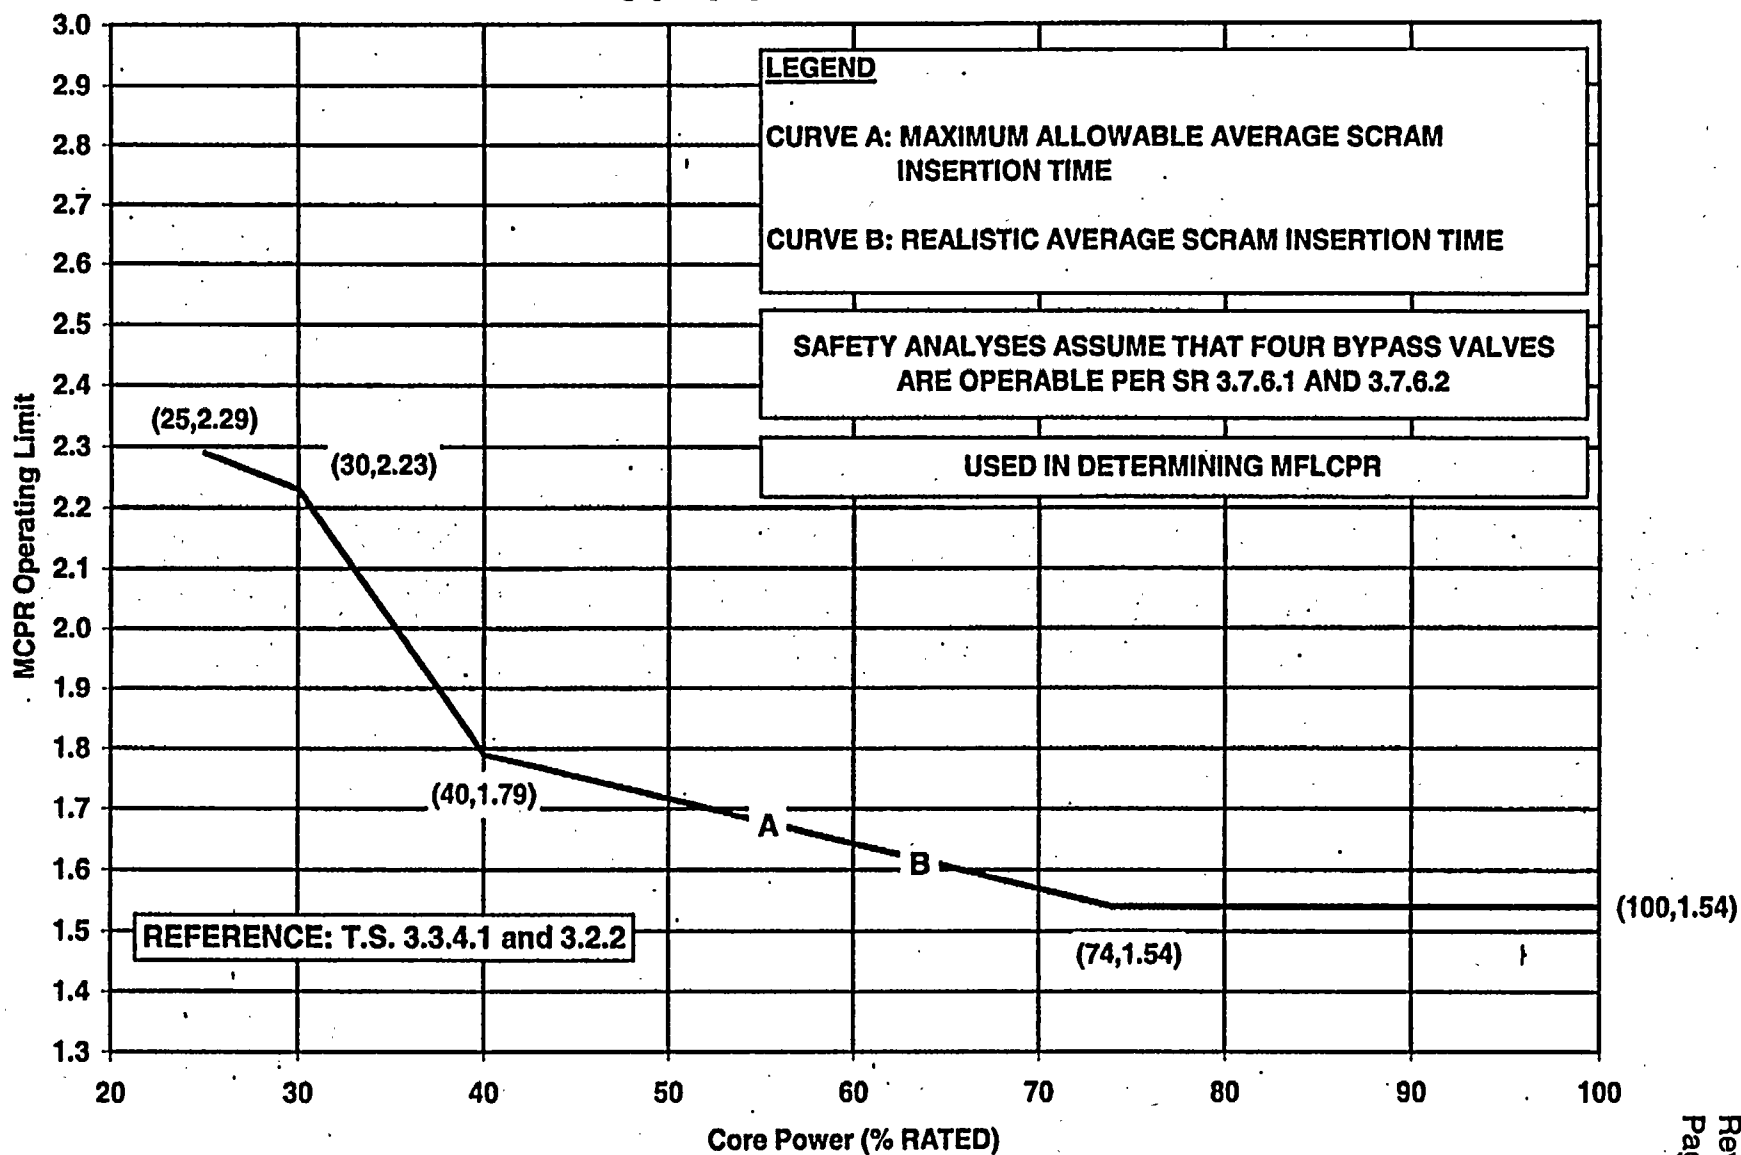

MCPR OPERATING LIMIT VERSUS CORE POWER
EOC-RPT INOPERABLE / MAIN TURBINE BYPASS OPERABLE
TWO LOOP OPERATION (BOC to EOC)
FIGURE 5.2-6

Table 5.3-1

**Average Scram Time Fraction Table For Use With Scram Time Dependent
MCPR Operating Limits**

Control Rod Position	Average Scram Time to Position (seconds)					
	45	39	25	5	Scram Time Fraction	Average Scram Insertion Time
45	0.470	0.480	0.490	0.500	0.510	0.520
39	0.630	0.676	0.722	0.768	0.814	0.860
25	1.500	1.582	1.664	1.746	1.828	1.910
5	2.700	2.848	2.996	3.144	3.292	3.440
Scram Time Fraction	0.000	0.200	0.400	0.600	0.800	1.000
Average Scram Insertion Time	Realistic					Maximum Allowable

6.0 LINEAR HEAT GENERATION RATE (LHGR)

6.1 Technical Specification Reference

Technical Specification 3.2.3 and 3.7.6

6.2 Description

The LHGR limits are specified below as a function of Main Turbine Bypass operability for each fuel type as follows:

Main Turbine Bypass Operable


The LHGR for ATRIUMTM-10 fuel shall not exceed the LHGR limit determined from Figure 6.2-1.

Main Turbine Bypass Inoperable

The LHGR for ATRIUMTM-10 fuel shall not exceed the LHGR limit determined from Figure 6.2-2.


The LHGR limits in Figures 6.2-1 and 6.2-2 are valid for Two Loop and Single Loop operation.

SSES UNIT 2 CYCLE 12

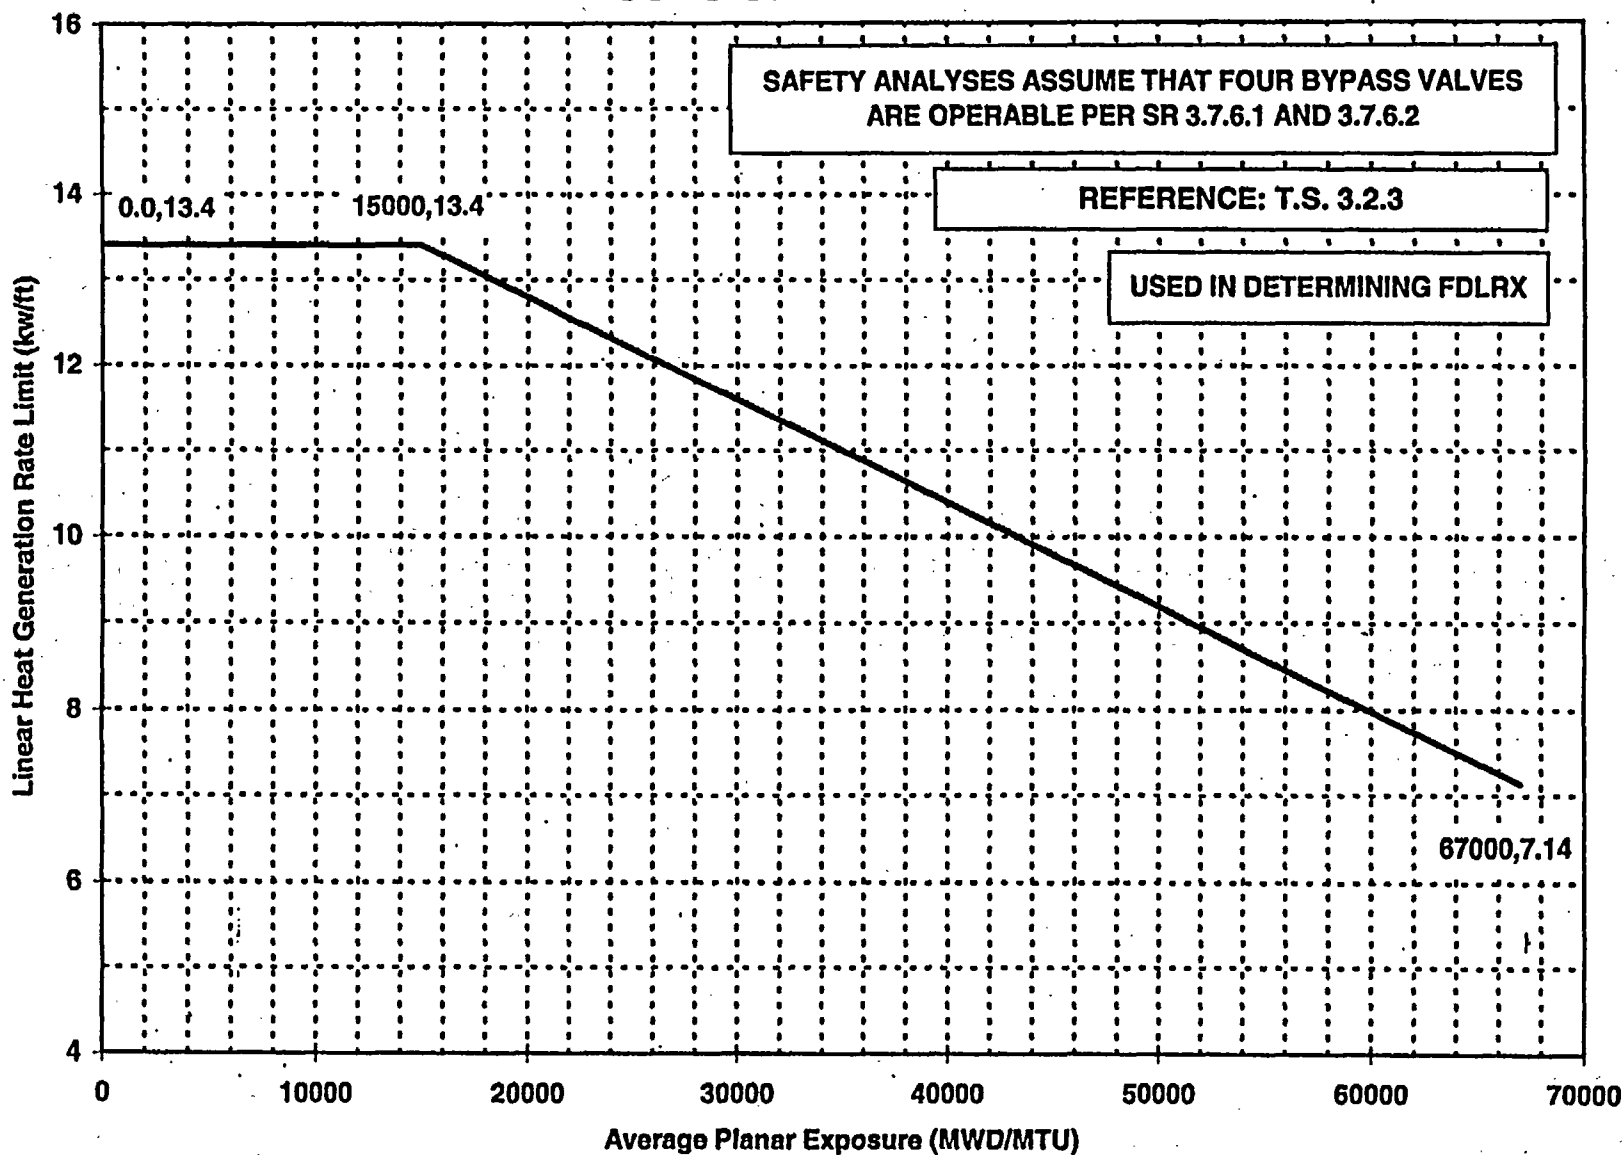

LINEAR HEAT GENERATION RATE LIMIT VERSUS AVERAGE PLANAR EXPOSURE
MAIN TURBINE BYPASS OPERABLE
ATRIUM™-10 FUEL
FIGURE 6.2-1

SSES UNIT 2 CYCLE 12

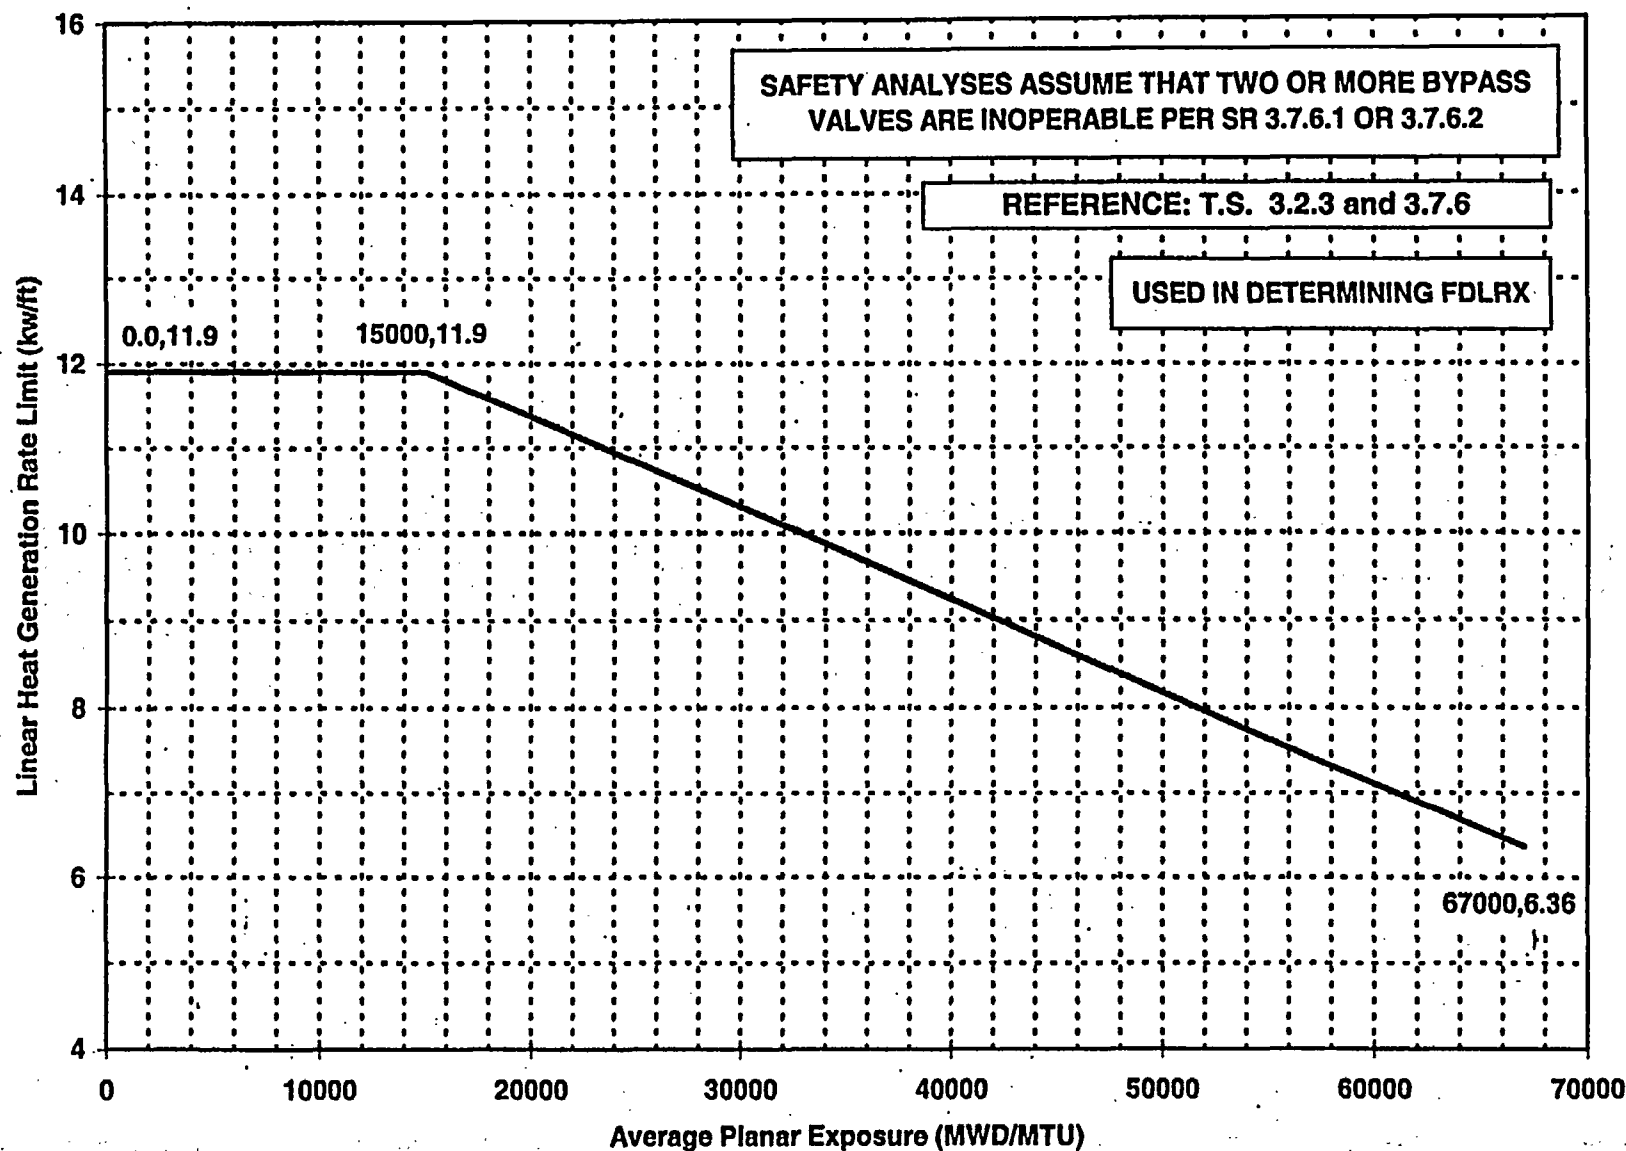

LINEAR HEAT GENERATION RATE LIMIT VERSUS AVERAGE PLANAR EXPOSURE
MAIN TURBINE BYPASS INOPERABLE
ATRIUM™-10 FUEL
FIGURE 6.2-2

7.0 AVERAGE POWER RANGE MONITOR (APRM) GAIN AND SETPOINTS

7.1 Technical Specification Reference

Technical Specification 3.2.4 and 3.3.1.1

7.2 Description

The APRM flow biased simulated thermal power-upscale scram trip setpoint (S) and flow biased neutron flux-upscale control rod block trip setpoint (S_{RB}) shall be established as specified in Table 7.2-1 and Table 7.2-2, including any adjustments per Technical Specification LCO 3.2.4.

Technical Specification LCO 3.2.4 provides an option to adjust the APRM setpoints when MFLPD is greater than FRACTION OF RATED THERMAL POWER (FRTP). The adjustment applies to both the APRM flow biased simulated thermal power-upscale scram trip setpoint and flow biased neutron flux-upscale control rod block trip setpoint for Two Loop and Single Loop operation. The APRM setpoints for Specification 3.2.4 are established in Tables 7.2-1 and 7.2-2.

Table 7.2-1
APRM Setpoint for
Two Loop Operation

Trip Setpoint	Allowable Value
$S \leq (0.58W + 59\%) T$	$S \leq (0.58W + 62\%) T^1$
$S_{RB} \leq (0.58W + 50\%) T$	$S_{RB} \leq (0.58W + 53\%) T$

Table 7.2-2
APRM Setpoint for
Single Loop Operation

Trip Setpoint	Allowable Value
$S \leq (0.58W + 54\%) T$	$S \leq (0.58W + 57\%) T^1$
$S_{RB} \leq (0.58W + 45\%) T$	$S_{RB} \leq (0.58W + 48\%) T$

where: S and S_{RB} are in percent of RATED THERMAL POWER

W = Loop recirculation flow as a percentage of the loop recirculation flow which produces a core flow of 100 million lbs/hr

T = Lowest value of the ratio of FRTP divided by the MFLPD.² The FLPD is the actual LHGR divided by the applicable LHGR limit for APRM Setpoints. The LHGR limit for APRM setpoints for ATRIUM™-10 fuel shall be taken from Figure 7.2-1.


The LHGR for APRM setpoint limits in Figure 7.2-1 are valid for Main Turbine Bypass Operable and Inoperable and EOC-RPT Operable and Inoperable for both Two and Single Loop operation.

For calculated T-values greater than 1.0, a ratio of 1.0 is used in the above equations.

¹ APRM flow biased simulated thermal power-upscale scram allowable value in this table is equal to the value established in Technical Specification 3.3.1.1.

² For the calculation of T, the value of MFLPD shall be the maximum value of FDLRC.

SSES UNIT 2 CYCLE 12

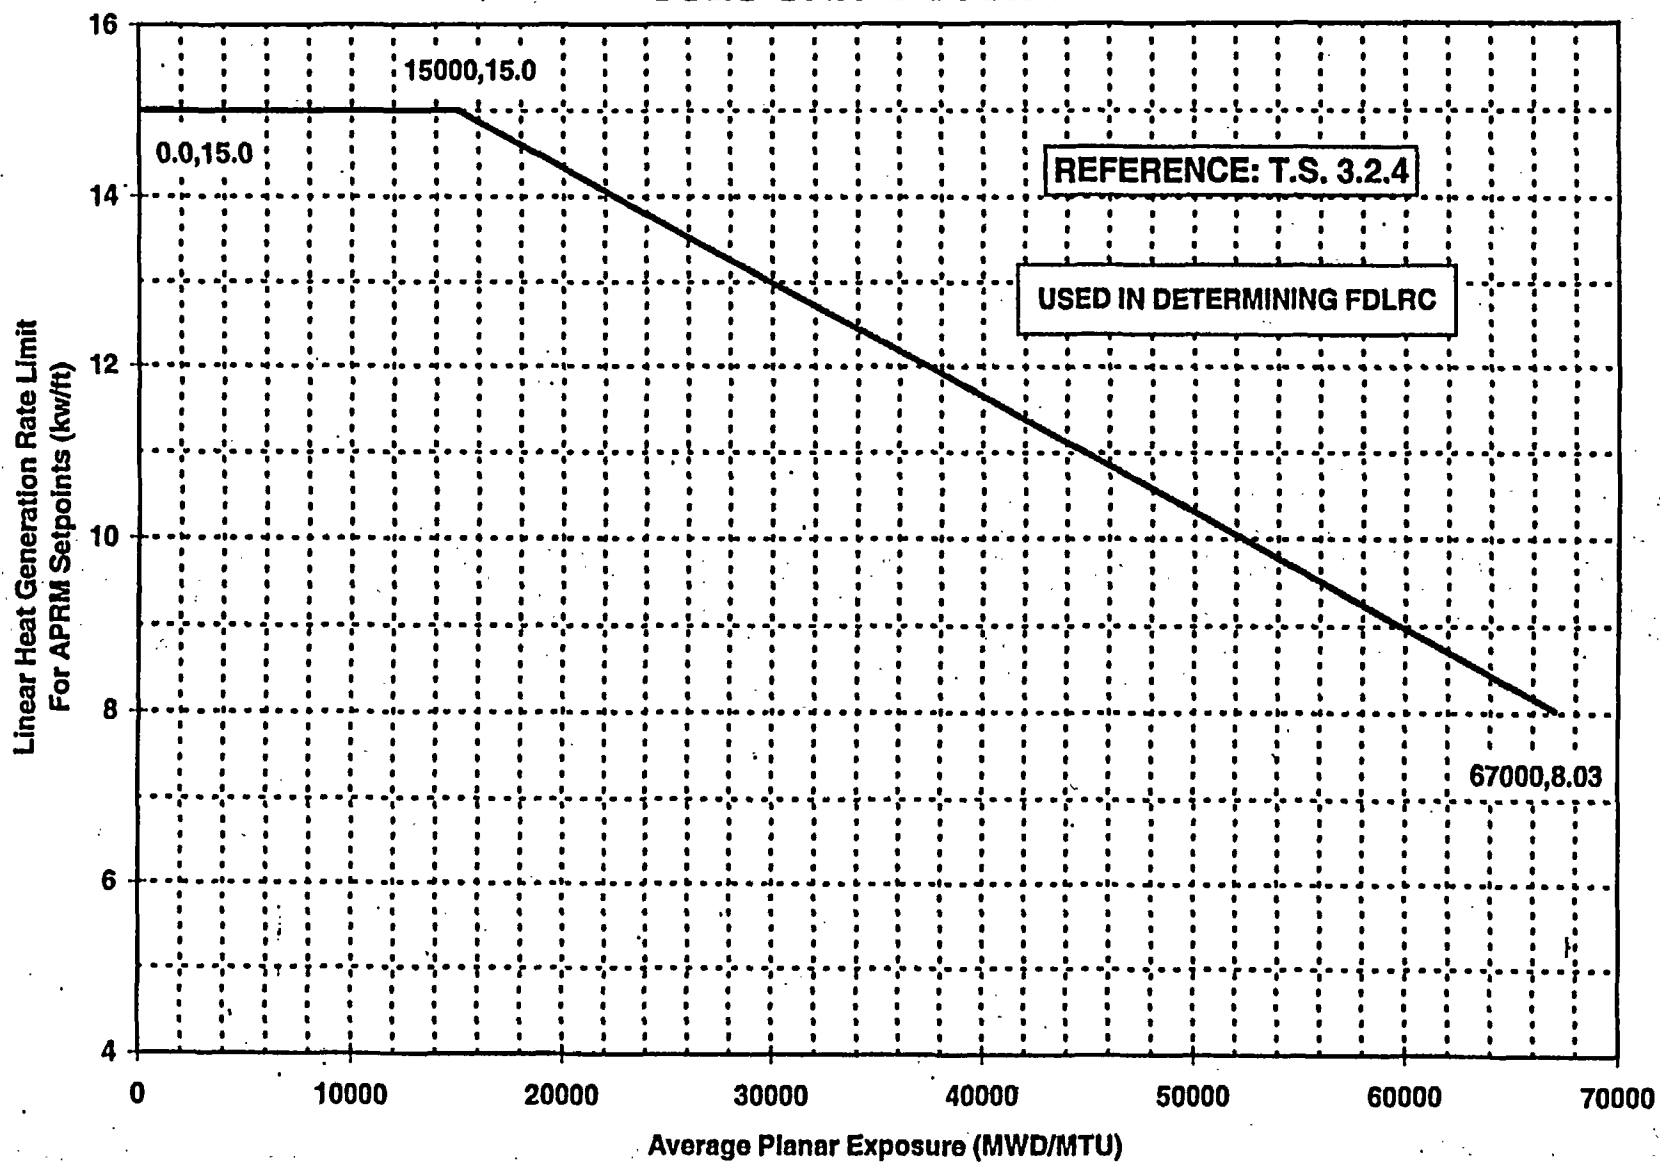

LINEAR HEAT GENERATION RATE LIMIT FOR APRM SETPOINTS VERSUS AVERAGE PLANAR EXPOSURE
ATRIUM™-10 FUEL
FIGURE 7.2-1

8.0 RECIRCULATION LOOPS - SINGLE LOOP OPERATION

8.1 Technical Specification Reference

- Technical Specification 3.2.1, 3.2.2, 3.2.3, 3.2.4, 3.3.4.1, 3.4.1, and 3.7.6

8.2 Description

APLHGR

The APLHGR limit for ATRIUM™-10 fuel shall be equal to the APLHGR Limit from Figure 8.2-1.

The APLHGR limits in Figure 8.2-1 are valid for Main Turbine Bypass Operable and Inoperable and EOC-RPT Operable and Inoperable in Single Loop operation.

Minimum Critical Power Ratio Limit

The MCPR limit is specified as a function of core power, core flow, and plant equipment operability status. The MCPR limit for all fuel types (ATRIUM™-10) shall be the greater of:

- a) Flow-Dependent MCPR value determined from Figure 8.2-2

OR

- b) The Power-Dependent MCPR value determined from one of the following figures, as appropriate:

Figure 8.2-3 : EOC-RPT and Main Turbine Bypass Operable from BOC to EOC

Figure 8.2-4 : Main Turbine Bypass Inoperable / EOC-RPT Operable from BOC to EOC

Figure 8.2-5 : EOC-RPT Inoperable / Main Turbine Bypass Operable from BOC to EOC

The MCPR limits in Figures 8.2-2 through 8.2-5 are valid only for Single Loop operation.


Linear Heat Generation Rate Limit

The LHGR limits for Single Loop Operation are defined in Section 6.0.

Average Power Range Monitor (APRM) Gain And Setpoints

APRM setpoints and the LHGR limit for APRM setpoints for Single Loop operation are defined in Section 7.0.

SSES UNIT 2 CYCLE 12

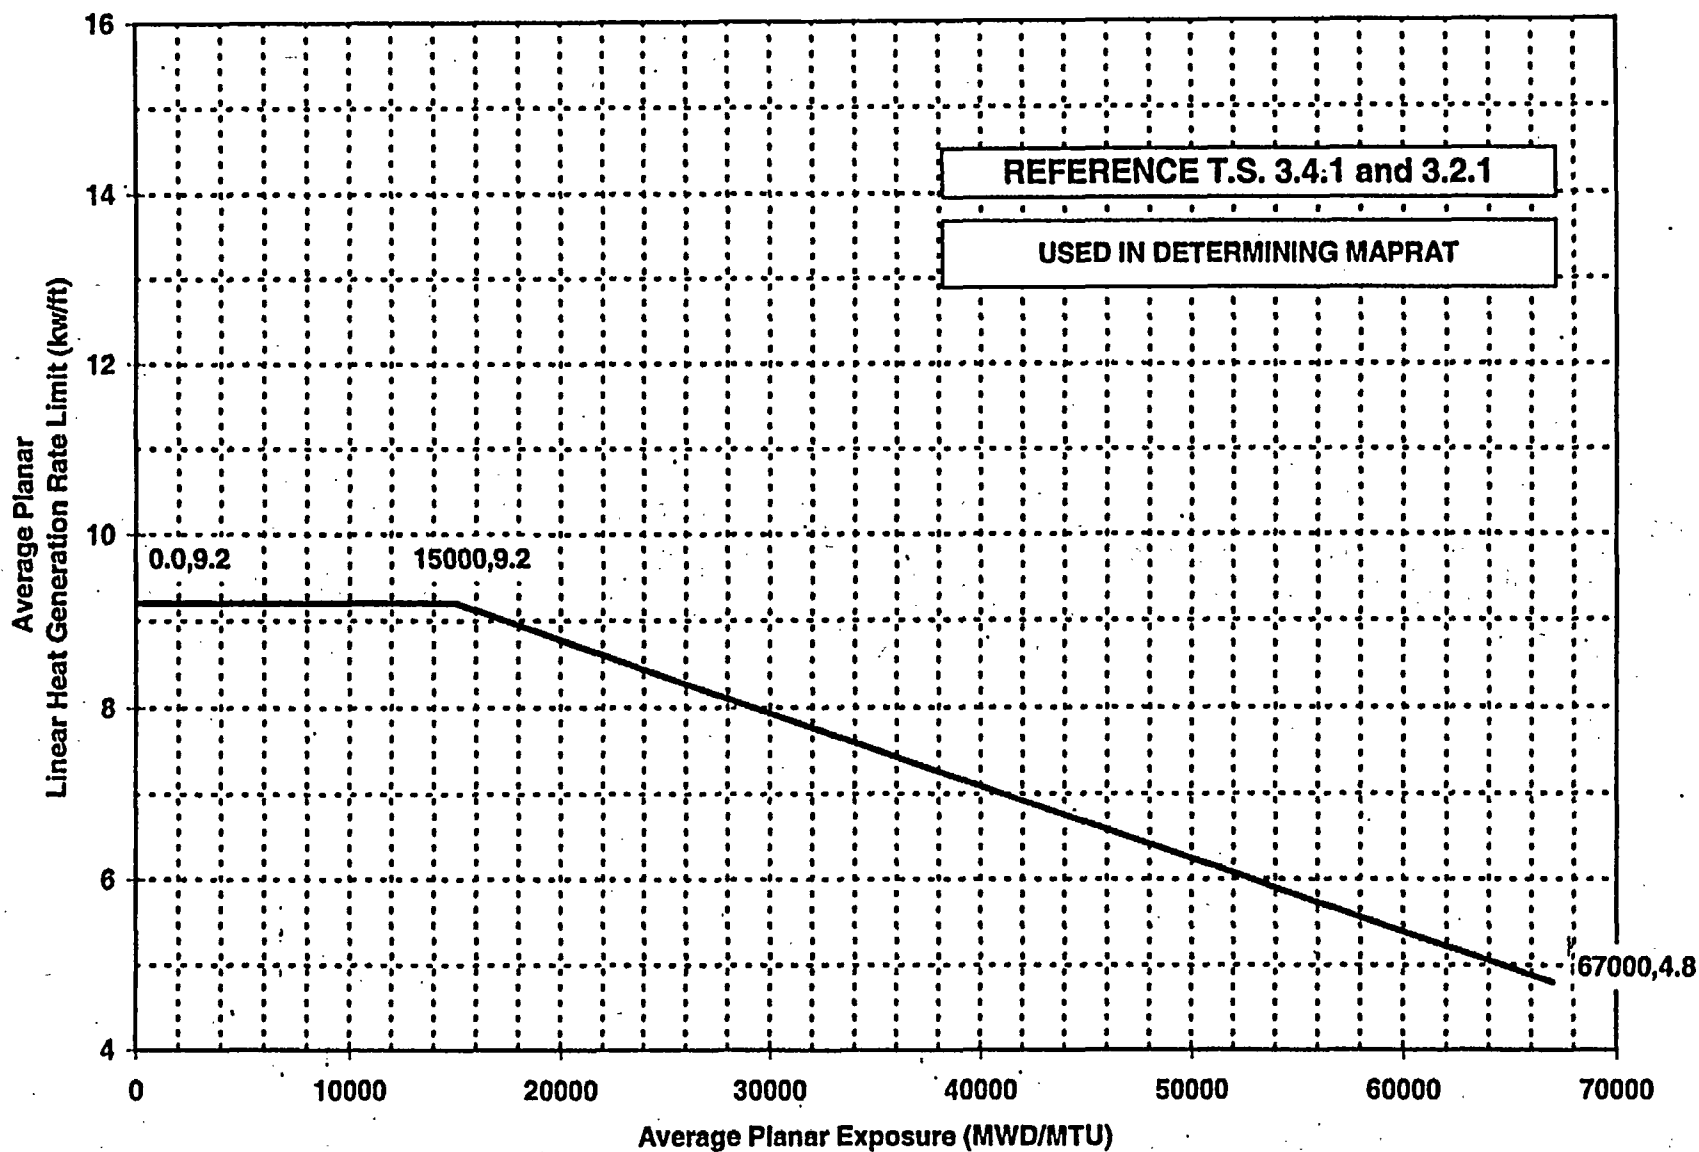


AVERAGE PLANAR LINEAR HEAT GENERATION RATE LIMIT VERSUS AVERAGE PLANAR EXPOSURE
SINGLE LOOP OPERATION

ATRIUM™-10 FUEL


FIGURE 8.2-1

SSS UNIT 2 CYCLE 12

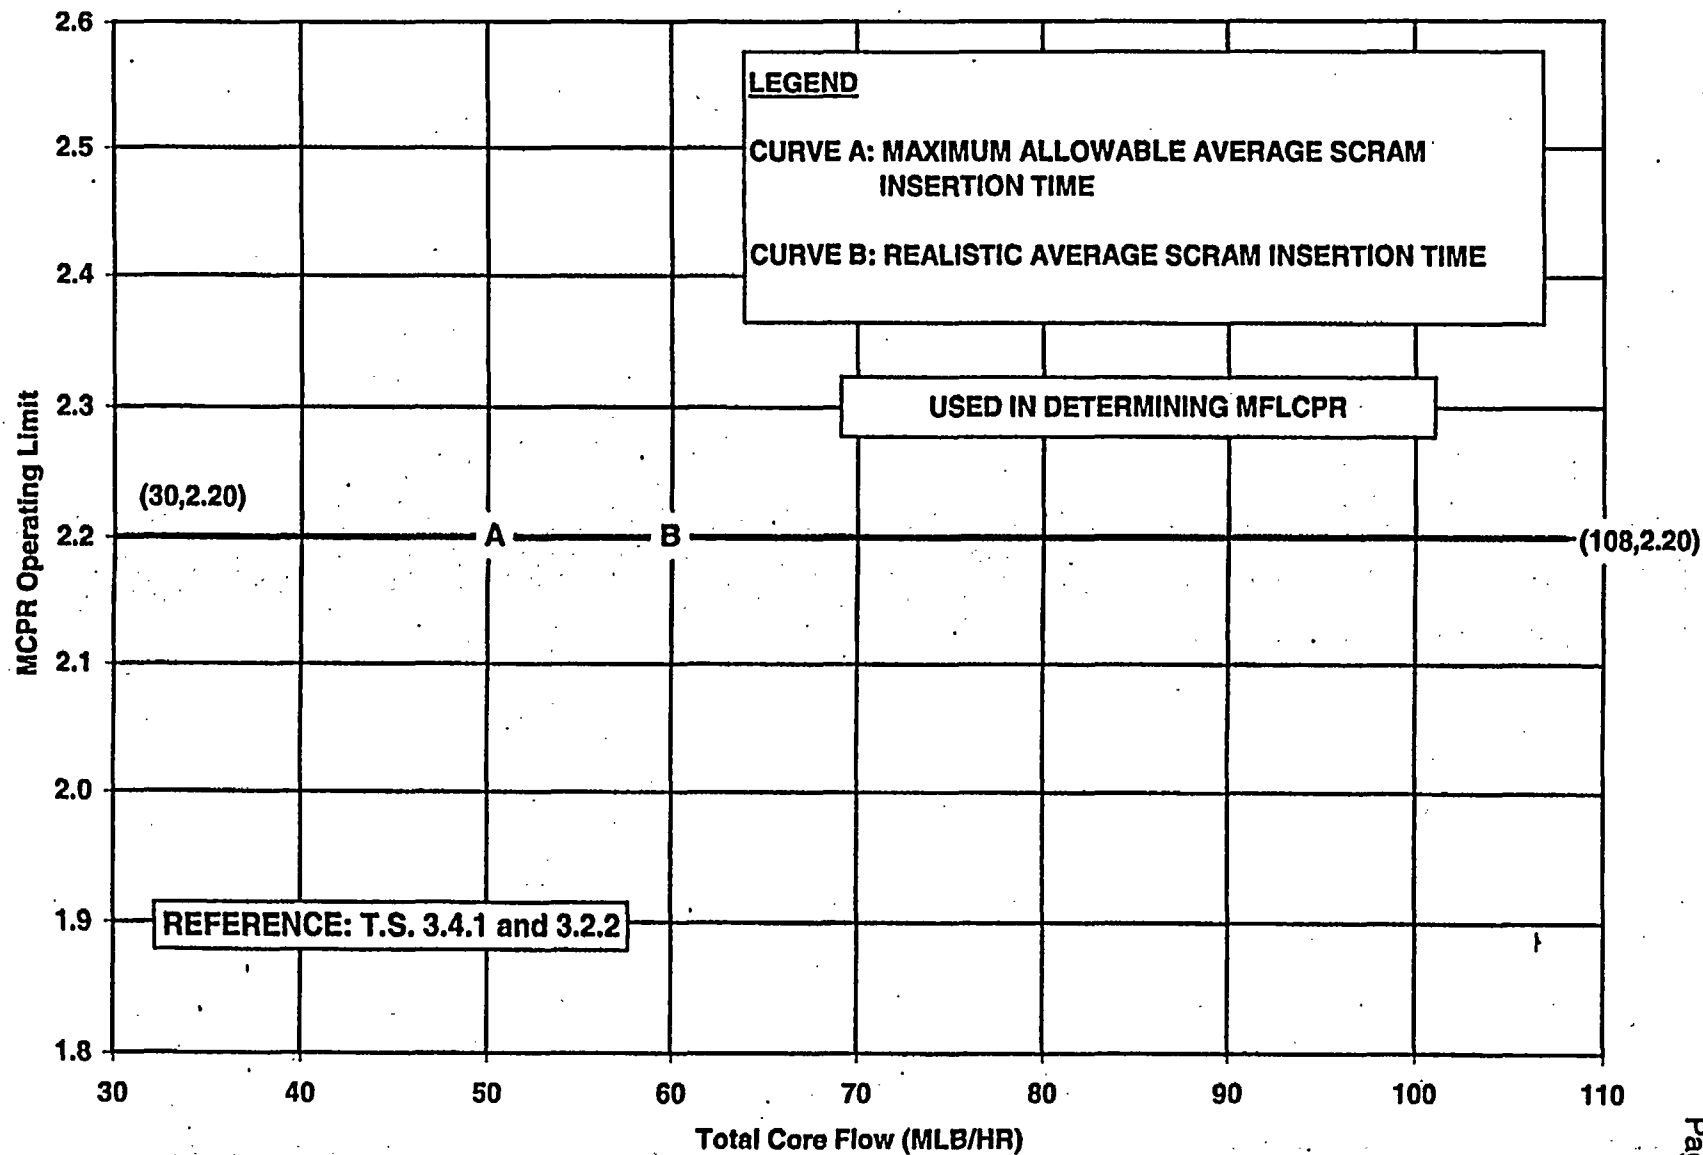


MCPR OPERATING LIMIT VERSUS TOTAL CORE FLOW
SINGLE LOOP OPERATION (BOC to EOC)
FIGURE 8.2-2

SSES UNIT 2 CYCLE 12

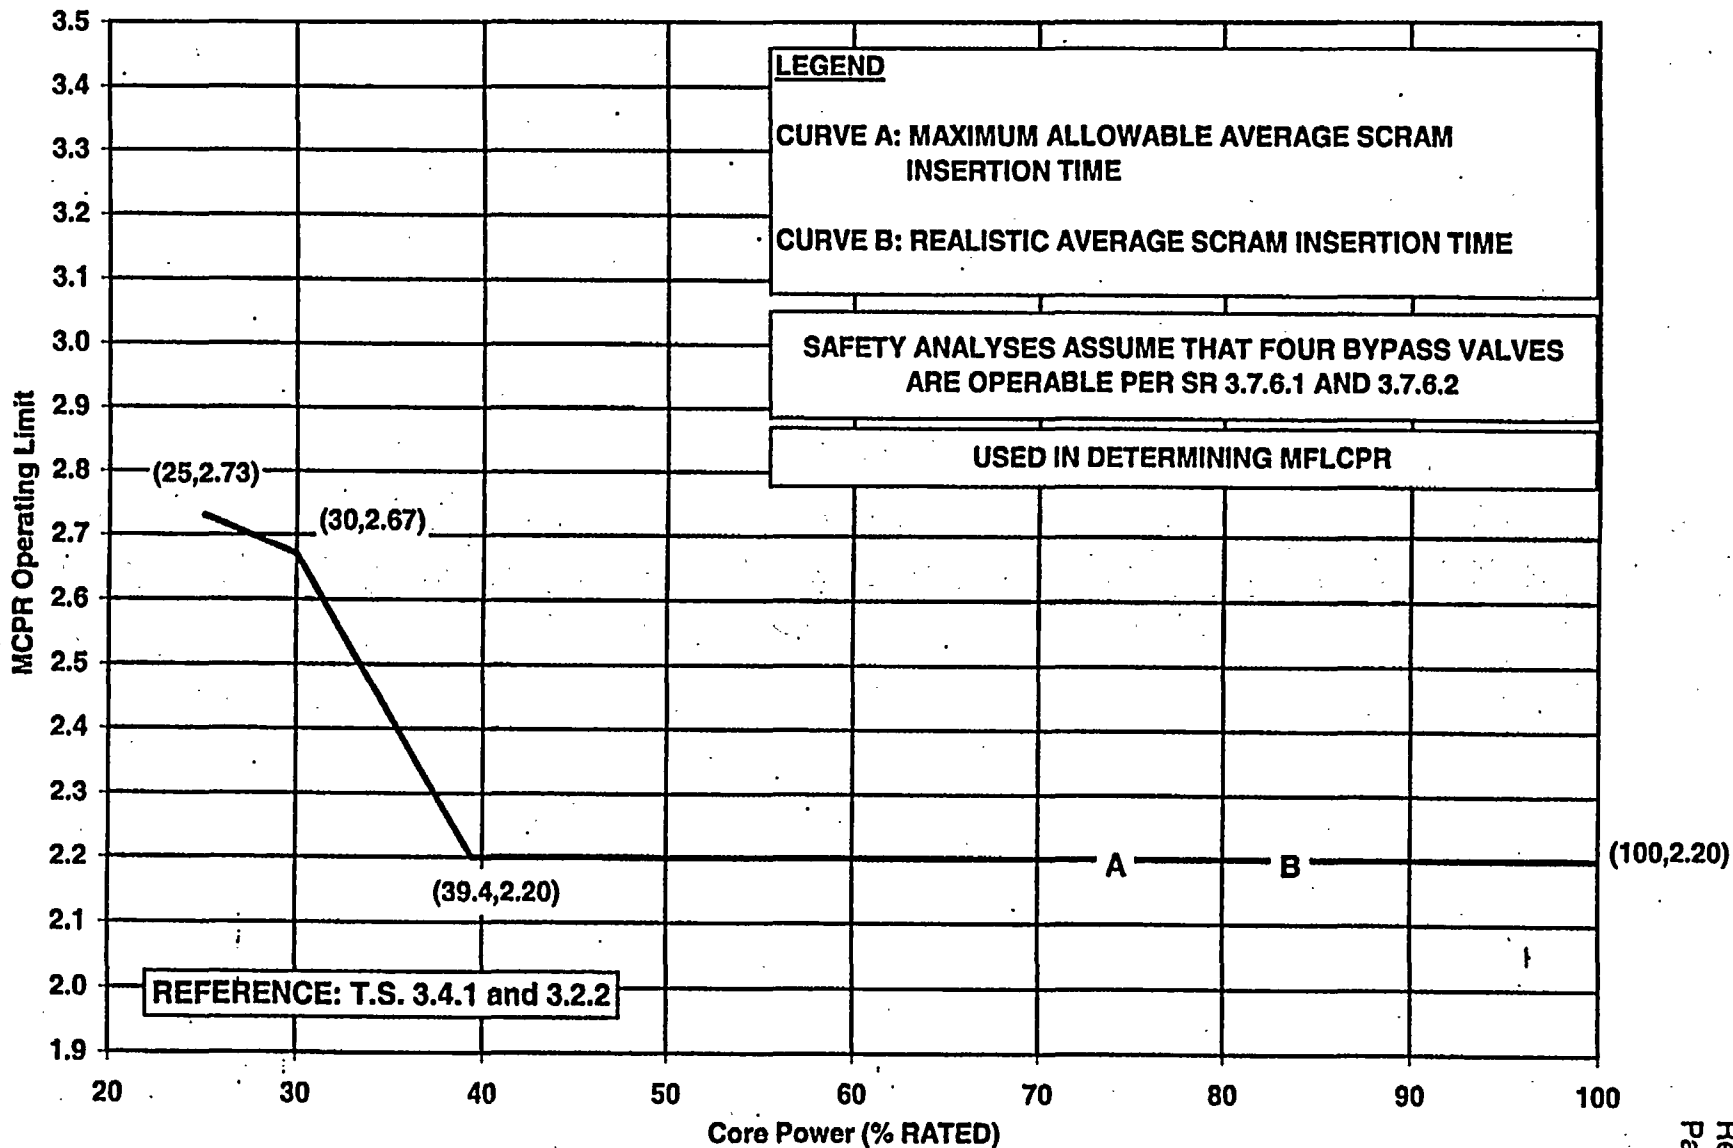


MCPR OPERATING LIMIT VERSUS CORE POWER
EOC-RPT AND MAIN TURBINE BYPASS OPERABLE
SINGLE LOOP OPERATION (BOC to EOC)
FIGURE 8.2-3

SSES UNIT 2 CYCLE 12

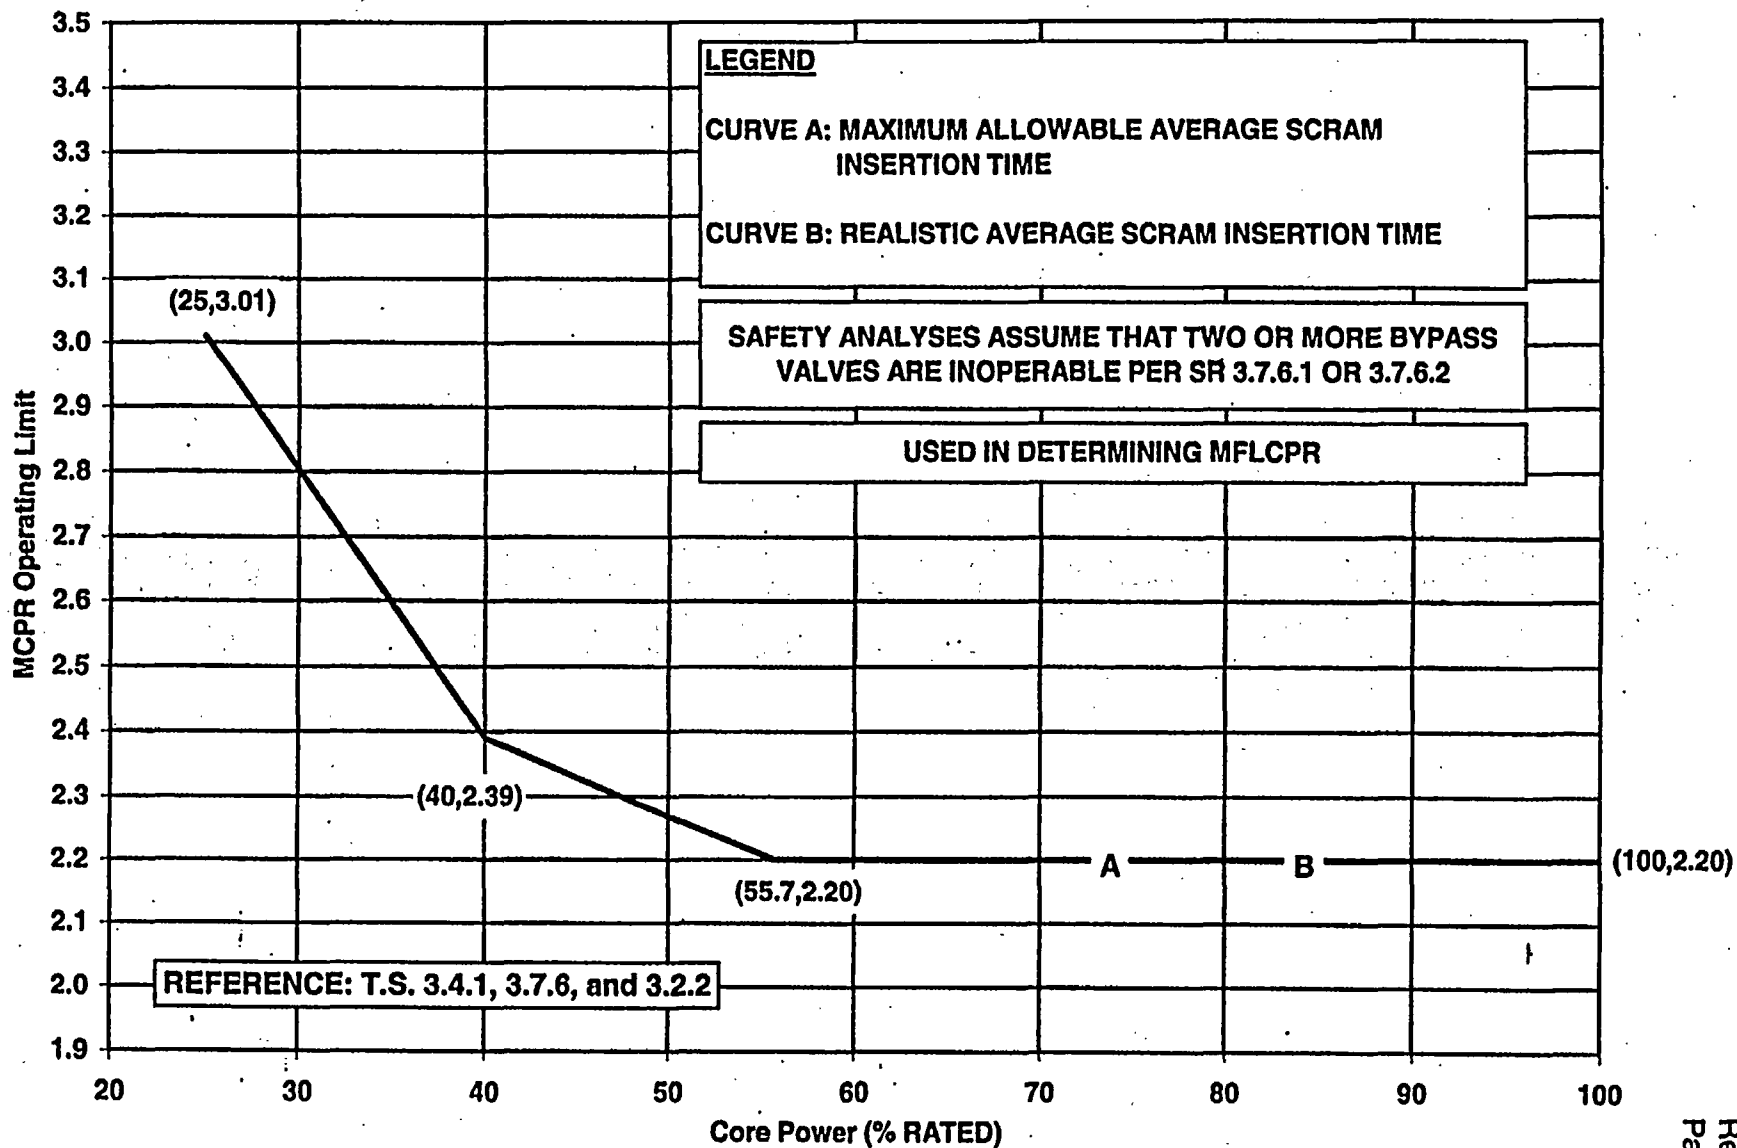

MCPR OPERATING LIMIT VERSUS CORE POWER
MAIN TURBINE BYPASS INOPERABLE / EOC-RPT OPERABLE
SINGLE LOOP OPERATION (BOC to EOC)
FIGURE 8.2-4

SSES UNIT 2 CYCLE 12

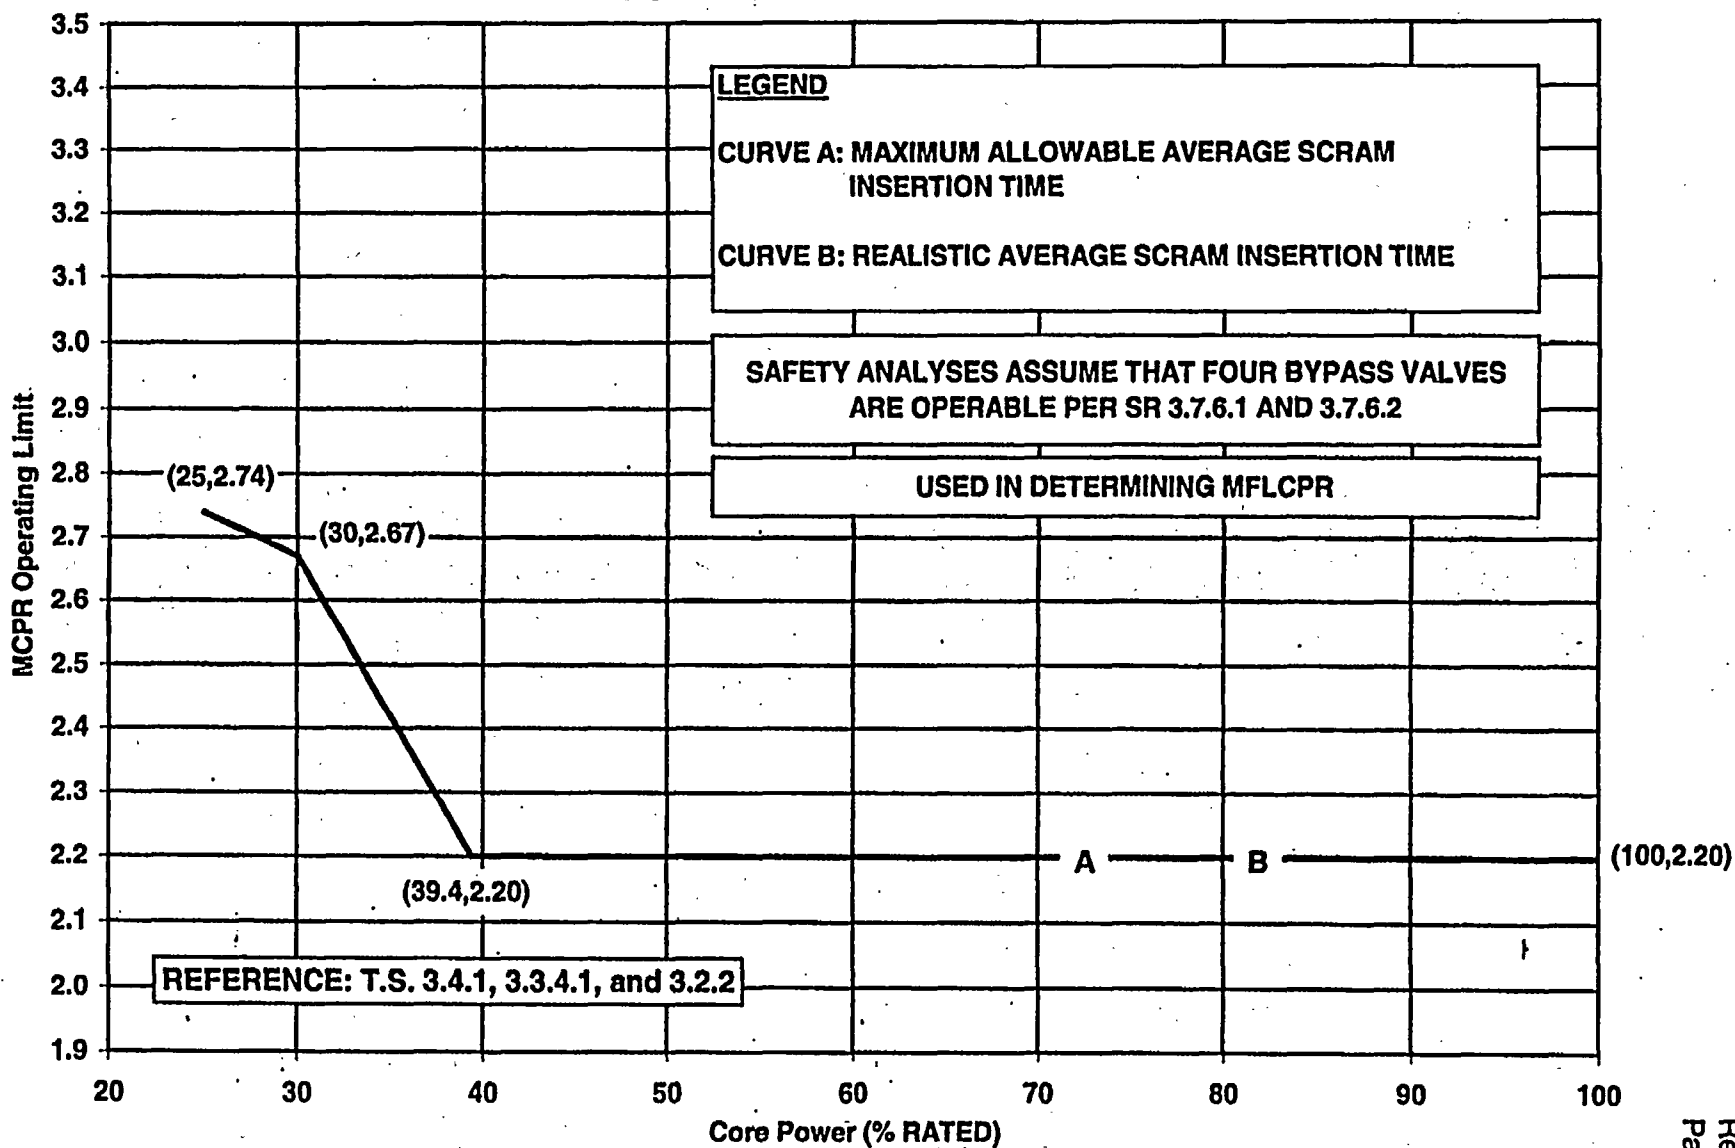

MCPR OPERATING LIMIT VERSUS CORE POWER
EOC-RPT INOPERABLE / MAIN TURBINE BYPASS OPERABLE
SINGLE LOOP OPERATION (BOC to EOC)
FIGURE 8.2-5

9.0 POWER / FLOW MAP

9.1 Technical Specification Reference

Technical Specification 3.3.1.3

9.2 Description

Monitor reactor conditions to maintain THERMAL POWER / core flow outside of Stability Regions I and II of the Power / Flow map, Figure 9.1.

If the OPRM Instrumentation is OPERABLE per TS 3.3.1.3, Region I of the Power / Flow map is considered an immediate exit region.

If the OPRM Instrumentation is inoperable per TS 3.3.1.3, Region I of the Power / Flow map is considered an immediate scram region.

Region II of the Power / Flow map is considered an immediate exit region regardless of the operability of the OPRM Instrumentation.

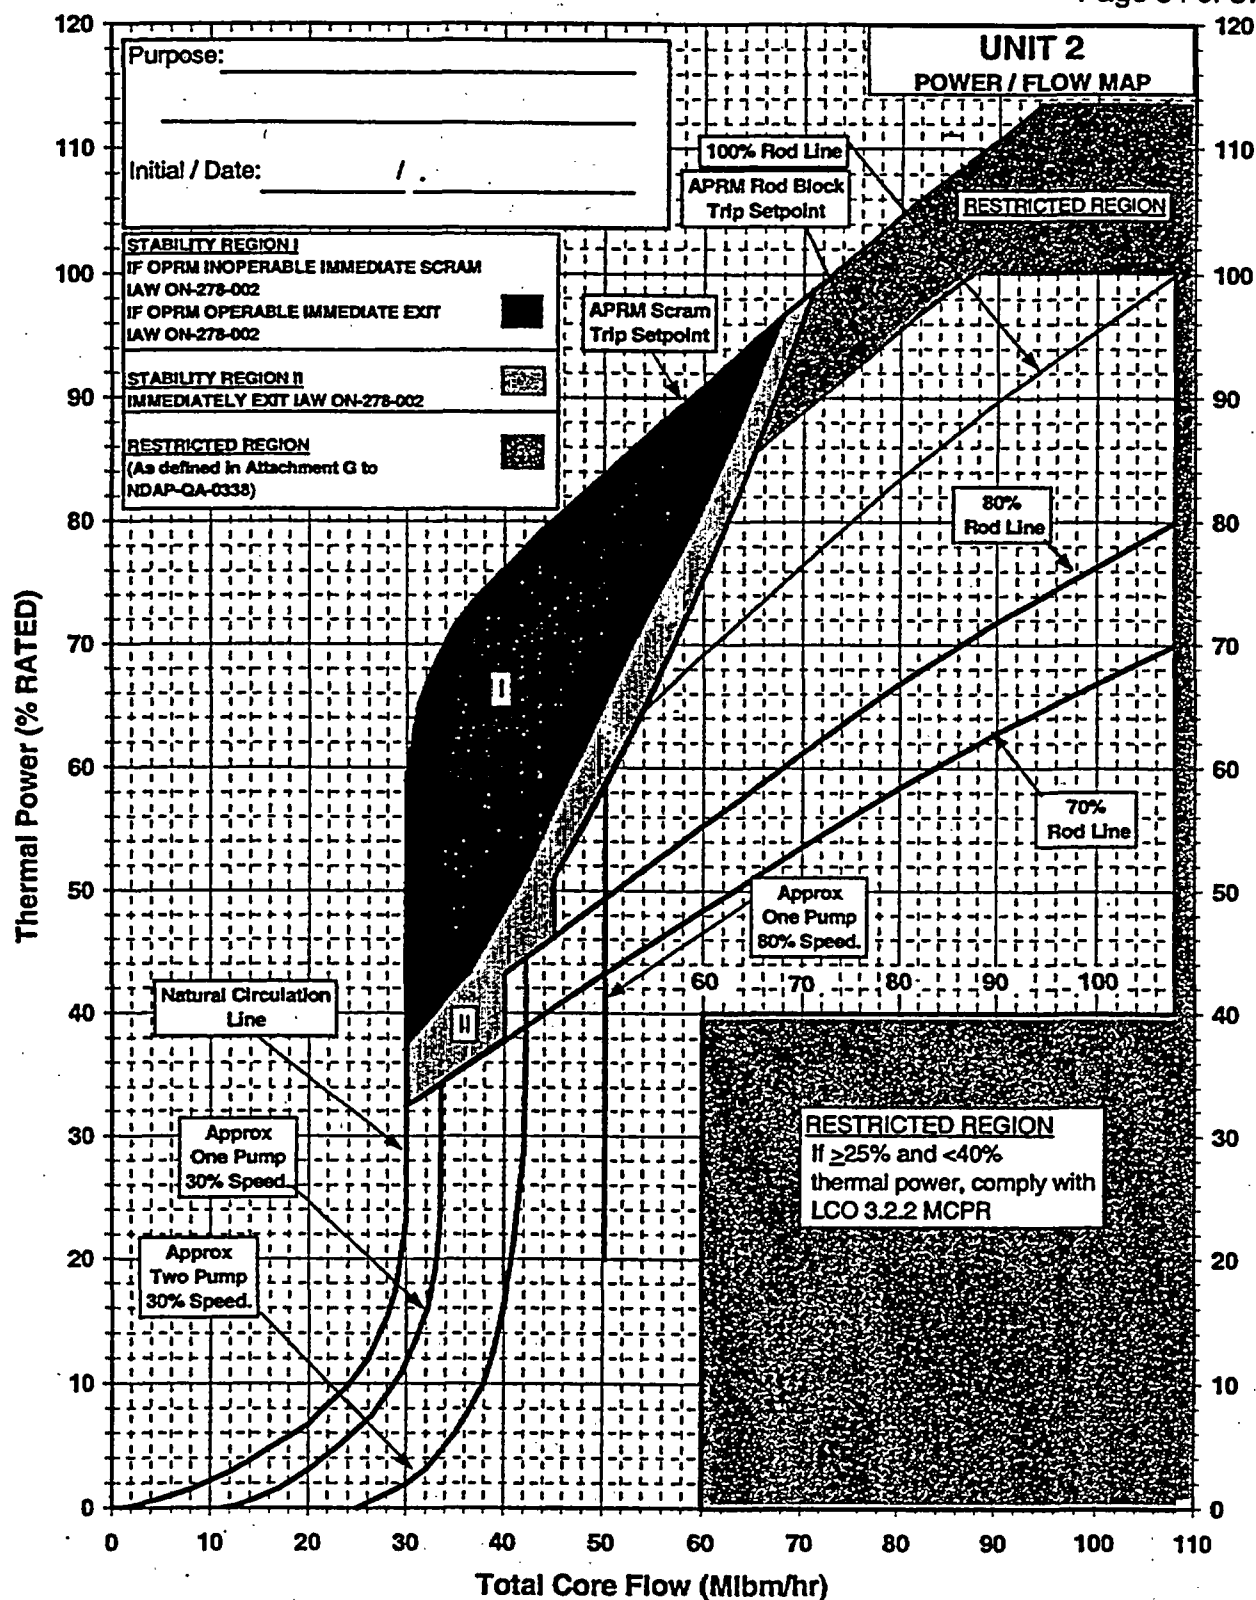


Figure 9.1
Power / Flow Map

10.0 OPRM SETPOINTS

10.1 Technical Specification Reference

Technical Specification 3.3.1.3

10.2 Description

Setpoints for the OPRM Instrumentation are established that will reliably detect and suppress anticipated stability related power oscillations while providing a high degree of confidence that the MCPR Safety limit is not violated. The setpoints are described in Section 1.0 and are listed below:

$$S_P = 1.11$$

$$N_P = 14$$

$$F_P = 65 \text{ Mlbm / hr}$$

11.0 REFERENCES

- 11.1 The analytical methods used to determine the core operating limits shall be those previously reviewed and approved by the NRC, specifically those described in the following documents:
1. PL-NF-90-001-A, "Application of Reactor Analysis Methods for BWR Design and Analysis," July 1992.
 2. PL-NF-90-001, Supplement 1-A, "Application of Reactor Analysis Methods for BWR Design and Analysis: Loss of Feedwater Heating Changes and Use of RETRAN MOD 5.1," August 1995.
 3. PL-NF-90-001, Supplement 2-A, "Application of Reactor Analysis Methods for BWR Design and Analysis: CASMO-3G Code and ANFB Critical Power Correlation," July 1996.
 4. PL-NF-90-001, Supplement 3-A, "Application of Reactor Analysis Methods for BWR Design and Analysis: Application Enhancements," March 2001.
 5. XN-NF-80-19(A), Volume 1, and Volume 1 Supplements 1 and 2 (March 1983), and Volume 1 Supplement 3 (November 1990), "Exxon Nuclear Methodology for Boiling Water Reactors: Neutronic Methods for Design and Analysis," Exxon Nuclear Company, Inc.
 6. XN-NF-80-19(P)(A), Volumes 2, 2A, 2B, and 2C "Exxon Nuclear Methodology for Boiling Water Reactors: EXEM BWR ECCS Evaluation Model," September 1982.
 7. XN-NF-80-19(P)(A), Volume 3 Revision 2 "Exxon Nuclear Methodology for Boiling Water Reactors Thermex: Thermal Limits Methodology Summary Description," January 1987.
 8. XN-NF-80-19(P)(A), Volume 4, Revision 1, "Exxon Nuclear Methodology for Boiling Water Reactors: Application of the ENC Methodology to BWR Reloads," Exxon Nuclear Company, Inc. June 1986.
 9. XN-NF-85-67(P)(A), Revision 1, "Generic Mechanical Design for Exxon Nuclear Jet Pump BWR Reload Fuel," Exxon Nuclear Company, Inc., September 1986.
 10. ANF-524(P)(A), Revision 2 and Supplement 1, Revision 2, "Advanced Nuclear Fuels Corporation Critical Power Methodology for Boiling Water Reactors," November 1990.
 11. NE-092-001A, Revision 1, "Licensing Topical Report for Power Uprate With Increased Core Flow," Pennsylvania Power & Light Company, December 1992 and NRC SER (November 30, 1993).

12. ANF-89-98(P)(A) Revision 1 and Revision 1 Supplement 1, "Generic Mechanical Design Criteria for BWR Fuel Designs," Advanced Nuclear Fuels Corporation, May 1995.
13. ANF-91-048(P)(A), "Advanced Nuclear Fuels Corporation Methodology for Boiling Water Reactors EXEM BWR Evaluation Model," January 1993.
14. XN-NF-79-71(P)(A) Revision 2, Supplements 1, 2, and 3, "Exxon Nuclear Plant Transient Methodology for Boiling Water Reactors," March 1986.
15. EMF-1997(P)(A) Revision 0, "ANFB-10 Critical Power Correlation," July 1998, and EMF-1997(P)(A) Supplement 1 Revision 0, "ANFB-10 Critical Power Correlation : High Local Peaking Results," July 1998.
16. Caldon, Inc., "TOPICAL REPORT: Improving Thermal Power Accuracy and Plant Safety While Increasing Operating Power Level Using the LEFMTM System," Engineering Report - 80P, March 1997.
17. Caldon, Inc., "Supplement to Topical Report ER-80P: Basis for a Power Uprate with the LEFMTM or LEFM CheckPlusTM System," Revision 0, Engineering Report ER-160P, May 2000.
18. EMF-85-74(P)(A), "RODEX2A (BWR) Fuel Rod Thermal-Mechanical Evaluation Model," Revision 0, Supplements 1 and 2, February 1998.
19. EMF-2158(P)(A), Revision 0, "Siemens Power Corporation Methodology for Boiling Water Reactors: Evaluation and Validation of CASMO-4/Microburn-B2," Siemens Power Corporation, October 1999.
20. EMF-CC-074(P)(A), Volume 4, Revision 0, "BWR Stability Analysis: Assessment of STAIF with Input from MICROBURN-B2," November 1999.
21. NEDO-32465-A, "BWROG Reactor Core Stability Detect and Suppress Solutions Licensing Basis Methodology for Reload Applications," August 1996.

3.3 Instrumentation

3.3.9 OPRM Instrumentation Configuration

TRO 3.3.9 Oscillation Power Range Monitor (OPRM) supporting setpoints and settings shall be within the specified limits.

APPLICABILITY: Thermal POWER $\geq 25\%$ RTP

ACTIONS

NOTE

1. Separate Condition entry is allowed for each channel

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. OPRM Setpoints and Settings not in accordance with Table 3.3.9-1	A.1 Enter the condition referenced in Table 3.3.9-1 for the parameter	Immediately
B. As required by Required Action A.1 and referenced in Table 3.3.9.1	B.1 Declare affected OPRM module inoperable.	Immediately
C. As required by Required Action A.1 and referenced in Table 3.3.9-1	C.1 Restore the OPRM Setpoints and Settings to within the specified limits.	120 days
D. Alternate method to detect and suppress thermal hydraulic instability oscillations required by LCO 3.3.1.3 Required Action A.3 or Required Action B.1	D.1 Initiate Action in accordance with Conditions E, F, or G	Immediately

(continued)

ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
<p>E. NOTE</p> <p>Only applicable as required by Required Action D.1</p> <hr/> <p>Total core flow as a function of THERMAL POWER within Region I of the Power Flow map as specified in the COLR.</p> <p><u>OR</u></p> <p>Total core flow as a function of THERMAL POWER within Region II of the Power Flow map as specified in the COLR and less than 50% of required LPRM upscale alarms OPERABLE</p>	<p>E.1 Place reactor mode switch in the shutdown position.</p>	<p>Immediately</p>
<p>F. NOTE</p> <p>Only applicable as required by Required Action D.1 and when in Region II of the Power Flow map as specified in the COLR.</p> <hr/> <p>Two or more APRM readings oscillating with one or more oscillating $\geq 10\%$ of RTP peak-to-peak</p> <p><u>OR</u></p>	<p>F.1 Place the reactor mode switch in the shutdown position.</p>	<p>Immediately</p>

(continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
<p>F. (continued)</p> <p>Two or more LPRM upscale alarms activating and deactivating with a period ≥ 1 second and ≤ 5 seconds.</p> <p><u>OR</u></p> <p>Sustained LPRM oscillations $> 10 \text{ W/cm}^2$ peak-to-peak with a period ≥ 1 second and ≤ 5 seconds.</p>		
<p>G. ———NOTE————</p> <p>Only applicable as required by Required Action D.1.</p> <p>—————</p> <p>Total core flow as a function of THERMAL POWER within Region II of the Power Flow map as specified in the COLR.</p>	<p>G.1 Initiate action to restore total core flow as a function of THERMAL POWER outside of Region II.</p>	<p>Immediately</p>
<p>H. Less than 50% of the required LPRM Upscale Alarms are OPERABLE</p>	<p>H.1 Post sign on the reactor control panel that less than 50% of the LPRM Upscale Alarms are OPERABLE.</p>	<p>1 hour</p>

TECHNICAL REQUIREMENT SURVEILLANCE

SURVEILLANCE		FREQUENCY
TRS 3.3.9.1	<p>—————NOTE—————</p> <p>Only required to be met when an alternate method to detect and suppress thermal hydraulic instability oscillations is required by LCO 3.3.1.3 Required Action A.3 or Required Action B.1.</p> <p>Verify total core flow as a function of THERMAL POWER is outside of Region I and II of the Power Flow map as specified in the COLR.</p>	24 hours
TRS 3.3.9.2	Perform CHANNEL CALIBRATION on each LPRM Upscale alarm	24 months
TRS 3.3.9.3	Verify OPRM parameter setpoints and settings are within limits	24 months

Table 3.3.9-1
OPRM SETPOINTS AND SETTINGS

OPRM PARAMETER	DESCRIPTION	CONDITIONS REFERENCE D FROM REQUIRED ACTION A.1	VALUE
1. TOL	Period Confirmation Tolerance	B	≥ 0.10 and ≤ 0.30 sec
2. Ta	Averaging Filter	B	5 sec
3. Fc	Conditioning Filter Cutoff Frequency	B	1.5 Hz
4. Tmin	Minimum Oscillation Period	B	≥ 1.0 and ≤ 1.2 sec
5. Tmax	Maximum Oscillation Period	B	≥ 3.0 and ≤ 3.5 sec
6. Noise Floor	Peak Discrimination Threshold	B	1
7. Minimum LPRM/Cell	Cell Operability Requirement	B	≥ 2
8. S1	Peak Threshold Setpoint	C ^(a)	≥ 1.10 and ≤ 1.20
9. S2	Valley Threshold Setpoint	C ^(a)	≥ 0.85 and ≤ 0.95
10. Smax	Max. Amplitude Trip Setpoint	C ^(a)	≥ 1.30 and ≤ 1.50
11. DR3	Growth Rate Factor Setpoint	C ^(a)	≥ 1.30 and ≤ 1.60
12. T1 lo	S1 to S2 Timer Range	C ^(a)	≥ 0.3 sec
13. T1 hi	S1 to S2 Timer Range	C ^(a)	≤ 2.5 sec
14. T2 lo	S2 to (S3 or Smax) Timer Range	C ^(a)	≥ 0.3 sec
15. T2 hi	S2 to (S3 or Smax) Timer Range	C ^(a)	≤ 2.5 sec

(a) Applicable only when two channels in the same trip system not in accordance with Table

B 3.3.9 OPRM Instrumentation

BASES

TRO

The OPRM system configuration governs its operation in accordance with the licensing analysis. Several configuration parameters are intrinsic to the trip function safety setpoint bases or provide settings for defense-in-depth algorithm features that are not assumed in the basis for the protection system safety analysis (Reference 2, Reference 3).

Each of the setting values may be used as the process setpoint or device setting without further adjustment for uncertainties.

Setpoints and Settings BasesTOL Period Confirmation Tolerance

The specified range of values for the period tolerance has been demonstrated to provide continuous confirmations upon transition from stable reactor operation to a growing reactor instability. A range of values is provided to allow system tuning to avoid spurious alarms on period confirmations. Limiting the setpoint adjustment range provides assurance that the Period Based Detection Algorithm will provide sufficient confirmations for a growing instability.

Ta Averaging Filter

The averaging filter is used to provide a normalization of the input signal such that the average signal value is 1.0. The filter time constant is chosen to approximate the fuel thermal time constant. Setting optimizes system response during fast power transients.

Fc Conditioning Filter Cutoff Frequency

The specified value for the Conditioning Filter Cutoff Frequency has been demonstrated to provide continuous confirmations upon transition from stable reactor operation to a growing reactor instability. Setting minimizes impact on signal amplitude and provides assurance that the Period Based Detection Algorithm will provide sufficient confirmations for a growing instability.

Tmin Minimum Oscillation PeriodTmax Maximum Oscillation Period

The Minimum and Maximum Oscillation Period parameters establish the range of detectable oscillation periods of OPRM cell signals for signal oscillations associated with reactor core thermal-hydraulic instability.

(continued)

B 3.3.9 OPRM Instrumentation

BASESTRO
(continued)Noise Floor

The period based algorithm uses a peak detection algorithm to determine the peaks and valleys of an OPRM cell signal. The Noise Floor setting assures that peaks and valleys are effectively detected for low amplitude cell signal resonances.

Minimum LPRM/Cell

This value determines the availability and resulting sensitivity of cells in the reactor core in the event of LPRM channel failures. The minimum LPRM/cell is an assumption of the OPRM trip setpoint (Sp) basis calculation.

Amplitude and Growth Rate Algorithm Parameters

<u>S1</u>	<u>Peak Threshold Setpoint</u>
<u>S2</u>	<u>Valley Threshold Setpoint</u>
<u>Smax</u>	<u>Max. Amplitude Trip Setpoint</u>
<u>DR3</u>	<u>Growth Rate Factor Setpoint</u>
<u>T1 lo</u>	<u>S1 to S2 Timer Range</u>
<u>T1 hi</u>	<u>S1 to S2 Timer Range</u>
<u>T2 lo</u>	<u>S2 to (S3 or Smax) Timer Range</u>
<u>T2 hi</u>	<u>S2 to (S3 or Smax) Timer Range</u>

These parameters calibrate the Amplitude and Growth Rate Algorithm, described in References 2 and 3, which provides an OPRM trip output to the Reactor Protection System. The OPRM design and licensing basis takes no credit for the Amplitude and Growth Rate Algorithm. The algorithm is provided as a defense-in-depth feature in the event of unanticipated power oscillations. These Amplitude and Growth Rate Algorithm Parameters are considered sufficient to provide backup protection and to avoid spurious trips by maximizing margin to expected operating conditions and transients.

ACTIONS

The required actions assure that the system settings that support the Period Based Algorithm setpoint analysis, and those parameters that define the Amplitude and Growth Rate Algorithm are returned in a timely manner to the values assumed in the analysis (Reference 2, Reference 3) or that the affected channel module is declared inoperable and the applicable Required Action of LCO 3.3.1.3 is then entered, or an alternate method to detect and suppress thermal hydraulic instability oscillations is employed.

(continued)

B 3.3.9 OPRM Instrumentation

BASES**ACTIONS**
(continued)

Note 1 has been provided to modify the ACTIONS related to affected OPRM channels. Technical Specification Section 1.3, Completion Times, specifies that once a Condition has been entered, subsequent divisions, subsystems, components, or variables expressed in the Condition discovered to be inoperable or not within limits will not result in separate entry into the Condition. Technical Specification Section 1.3 also specifies that Required Actions of the Condition continue to apply for each additional failure, with Completion Times based on initial entry into the Condition. However, the Required Actions for affected OPRM modules and channels provide appropriate compensatory measures for separate modules and channels. As such, a Note has been provided that allows separate Condition entry for each affected OPRM channel.

B.1

Several parameter settings are essential for the proper operation of the OPRM period-based trip algorithm. The permissible values of Period Confirmation Tolerance, Averaging Filter time constant, Conditioning Filter Cutoff Frequency, and minimum operable LPRM per cell parameters are limited by the setpoint basis calculations and system transient response analysis. The Minimum and Maximum Oscillation Period settings limit the algorithm window to the cell signal resonances that can be associated with unstable thermal-hydraulic conditions. The Noise Floor setting assures that the cell signal peak detection algorithm is sufficiently responsive to low frequency and low amplitude cell signal resonances.

Because the ability of the OPRM module to perform its safety function is affected by these parameter settings, the affected module must be considered inoperable when these conditions are not met. The cell signal processing parameters within each module affects the response and operability of only that module.

Channel operability is evaluated for each inoperable module and Required Actions taken in accordance with LCO 3.3.1.3.

C.1

The design objective for the growth rate and amplitude algorithms is to provide automatic action to limit the size of these unanticipated oscillations, thereby preventing fuel cladding damage. Several parameter settings define the function of the Amplitude and Growth Rate Algorithm. The OPRM design and licensing basis takes no credit for the Amplitude and Growth Rate Algorithm, which is provided as a defense-in-depth feature in the event of unanticipated oscillations.

(continued)

B 3.3.9 OPRM Instrumentation

BASES

ACTIONS

C.1 (continued)

Because the ability of the OPRM module to perform its safety function is not affected by these parameter settings, the affected module need not be immediately considered inoperable when these conditions are not met. These parameters are to be maintained for conformance with the licensing requirement of a defense-in-depth feature in addition to the licensed OPRM trip function. This is corrected by returning the parameters to conformance within 120 days of identification.

Since the Amplitude and Growth Rate parameters within each module affect only the defense-in-depth response within each channel module, failure to maintain the proper parameters in either module in the channel affects only the operability of that module. The trip channel requires only one operable module function, and the trip system requires only one channel for this backup function to be operable.

D.1

This Action is to be taken if the Period Based Detection Algorithm trip function is not available in accordance with LCO 3.3.1.3, and initiation of an alternate method to Detect and Suppress thermal hydraulic instability oscillations is required by the referenced LCO Required Actions. The applicable Conditions are entered as required.

E.1

As directed from Required Action D.1, this Action provides preemptive protection through Power/Flow Map operating restrictions.

When operating in Region I of the Power / Flow map specified in the COLR, or when operating in Region II of the Power / Flow map specified in the COLR with less than 50% of the required LPRM upscale alarms are OPERABLE, the potential for thermal-hydraulic oscillations is greatly increased and sufficient margin may not be available for operator response to suppress potential thermal-hydraulic oscillations. Therefore, the reactor mode switch must be immediately placed in the shutdown position. Action is taken immediately to place the plant in a condition where any potential for thermal-hydraulic instabilities will be terminated.

(continued)

B 3.3.9 OPRM Instrumentation

BASES**ACTIONS**
(continued)F.1

As directed from Required Action D.1, this Action provides guidance for Operator action in response to thermal-hydraulic instability oscillations.

When operating in Region II of the Power/Flow map specified in the COLR immediate response is necessary when there are indications that thermal hydraulic oscillations are occurring as defined in the CONDITION.

LPRM upscale alarms are required to detect reactor core thermal-hydraulic instability events. The criteria for determining which LPRM upscale alarms are required is based on assignment of these alarms to designated core zones. These core zones consist of the level A, B, and C alarms in 4 or 5 adjacent LPRM strings. The number and location of LPRM strings in each zone assure that with 50% or more of the associated LPRM upscale alarms OPERABLE sufficient monitoring capability is available to detect core wide and regional oscillations. Operating plant instability data is used to determine the specific LPRM strings assigned to each zone.

G.1

As directed from Required Action D.1, this Action provides guidance for Operator action in response to operation in conditions that may lead to thermal-hydraulic instability oscillations.

When operating in Region II of the Power/Flow map specified in the COLR, the potential for thermal-hydraulic oscillations is increased and sufficient margin may not be available for operator response to suppress potential thermal-hydraulic oscillations. Therefore, action must be initiated immediately to restore operation outside of Regions II of the Power/Flow map specified in the COLR. This can be accomplished by either decreasing THERMAL POWER with control rod insertion or increasing core flow by increasing recirculation pump speed. The starting of a recirculation pump will not be used as a means to exit the excluded Regions because the starting of a recirculation pump with the plant operating above the 80% rod line is prohibited due to potential instability problems.

(continued)

B 3.3.9 OPRM Instrumentation

BASES

ACTIONS
(continued)H.1

The LPRMs provide a capability to monitor power in selected locations of the reactor core. The LPRM Upscale Alarm Instrumentation provides information concerning local power oscillations. Condition G requires a reactor scram when operating in Region II of the Power/Flow map specified in the COLR with indications that thermal hydraulic oscillations are occurring. The number and location of LPRM strings in each zone assures that with 50% or more of the associated LPRM upscale alarms OPERABLE any power oscillations which could occur would be detected and proper actions can be taken.

A sign is posted in the Control Room to ensure that plant operators are aware of the system condition if a plant transient results in the plant entering into the instability region.

TRS

TRS 3.3.9.1

Required only when the OPRM trip function is not available, this TRS ensures the combination of core flow and THERMAL POWER are within required limits to prevent uncontrolled thermal hydraulic oscillations by ensuring the recirculation loops are within the limits established by the Power / Flow map specified in the COLR. At low recirculation flows and high reactor power, the reactor exhibits increased susceptibility to thermal-hydraulic instability. The Power / Flow map specified in the COLR is based on guidance provided in References 7, 8, and 9 which also provided the guidance on how to respond to operation in these conditions. The 24 hour Frequency is based on operating experience and the operator's inherent knowledge of the current reactor status, including significant changes in THERMAL POWER and core flow to ensure the requirements are constantly met.

TRS 3.3.9.2

This TRS is to be performed at the specified Frequency to ensure that the LPRM Upscale Alarm Instrumentation are maintained OPERABLE.

(continued)

B 3.3.9 OPRM Instrumentation

BASES

TRS
(continued)TRS 3.3.9.3

The parameter setpoint verification surveillance compares the desired settings and setpoints to the values contained in the processor memory. This surveillance is required to assure that the settings are maintained in accordance with the setpoint analysis. The frequency is based on the OPRM CALIBRATION frequency per SR 3.3.1.3.3.

REFERENCES

1. NEDO-31960-A, BWROG Long Term Solution Licensing Methodology
 2. NEDO-31960-A, Supp. 1, BWROG Long Term Solution Licensing Methodology
 3. NEDO-32465-A, BWROG Reactor Stability Detect and Suppress Solutions Licensing Basis Methodology and Reload Applications
 4. CENPD-400-P-A, Generic Topical Report for the ABB Option III OPRM
 5. Generic Letter 94-02, Long-Term Solutions and Upgrade Of Interim Operating Recommendations for Thermal-Hydraulic Instabilities in Boiling Water Reactors
 6. LCO 3.3.1.3, OPRM Instrumentation
 7. GE Service Information Letter No. 380, "BWR Core Thermal Hydraulic Stability," Revision 1, February 10, 1984.
 8. Letter, L. A. England to M. J. Virgilio, "BWR Owner's Group Guidelines for Stability Interim Corrective Action," June 6, 1994.
 9. EMF-CC-074(P)(A), Volume 4, Revision 0, "BWR Stability Analysis: Assessment of STAIF with Input from MICROBURN-B2," November 1999.
-