




UPPER HEAD INJECTION ROOMS

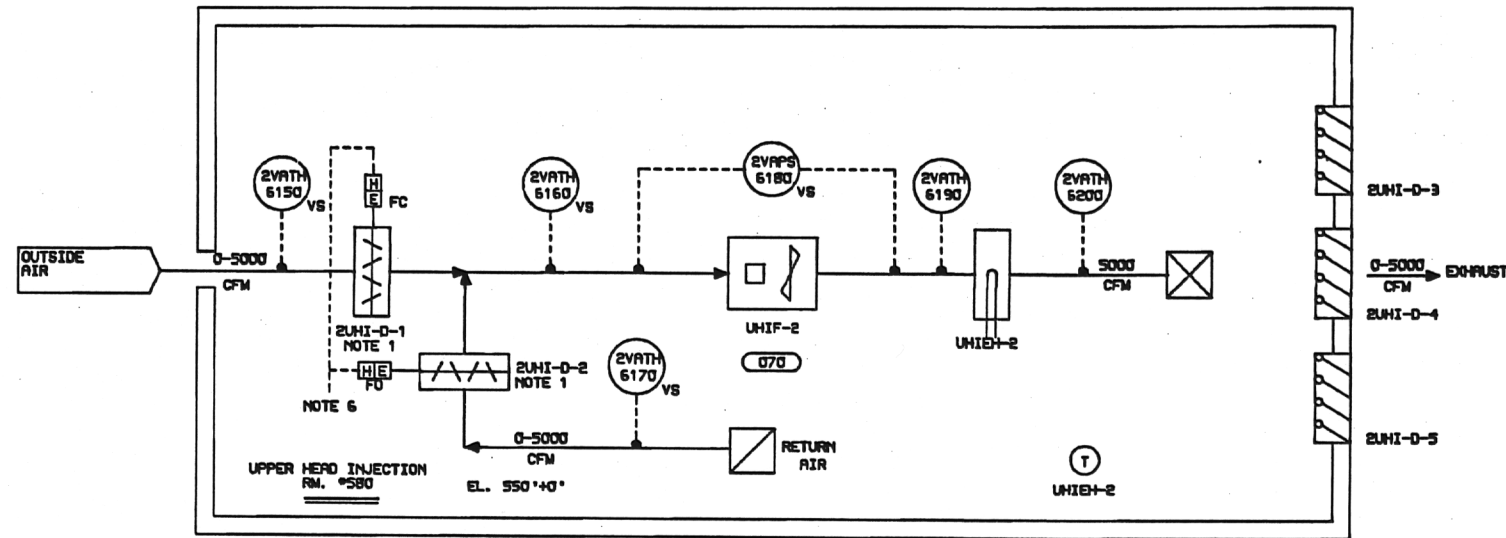


UPPER HEAD INJECTION ROOMS

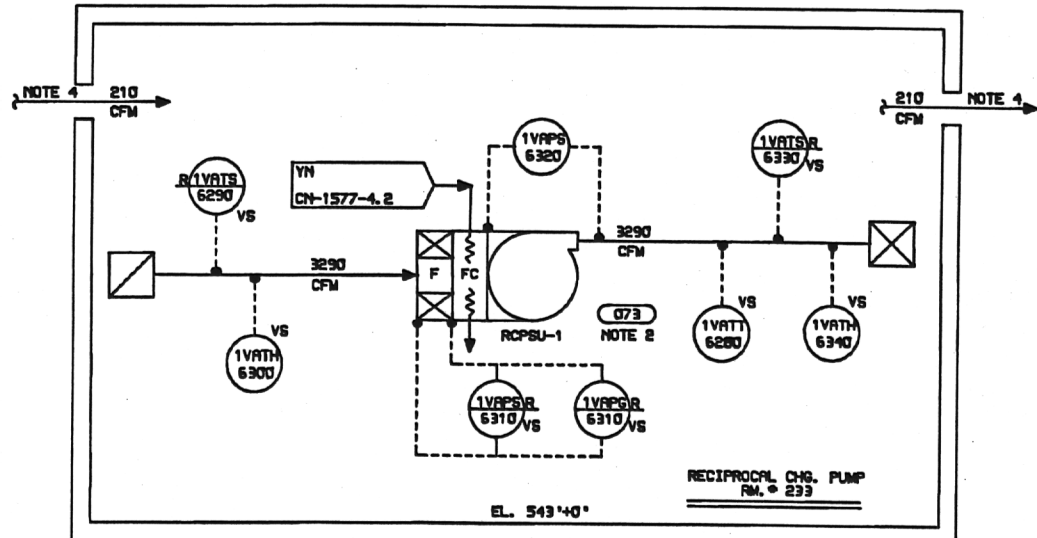


RECIPROCAL CHARGING PUMP ROOMS

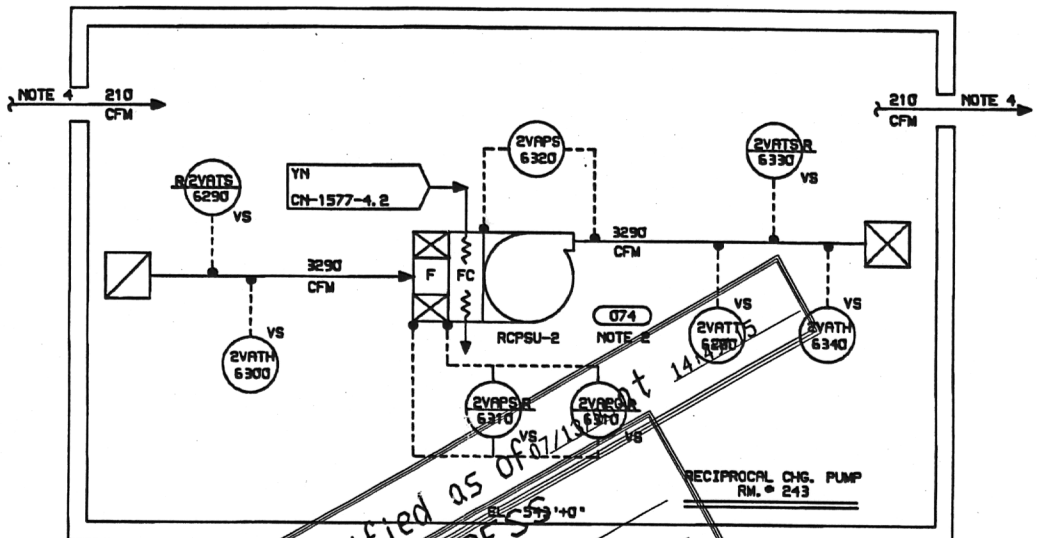


RECIPROCAL CHARGING PUMP ROOMS

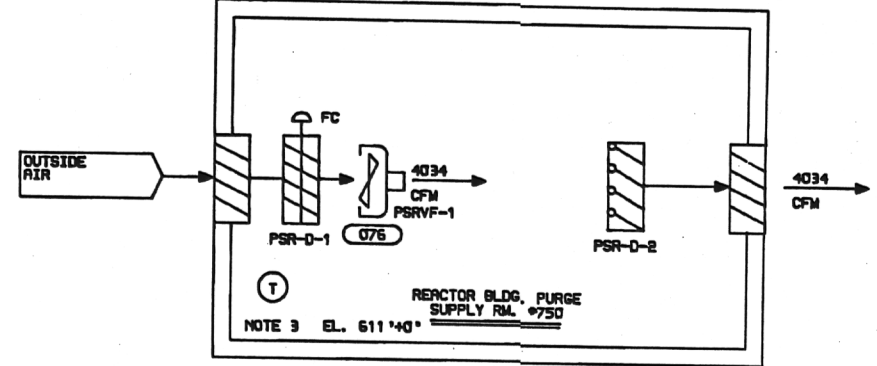


REACTOR BLDG. PURGE SUPPLY ROOMS

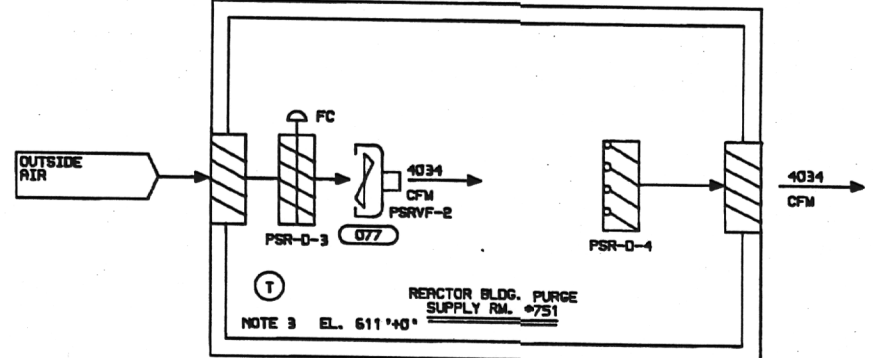


REACTOR BLDG. PURGE SUPPLY ROOMS

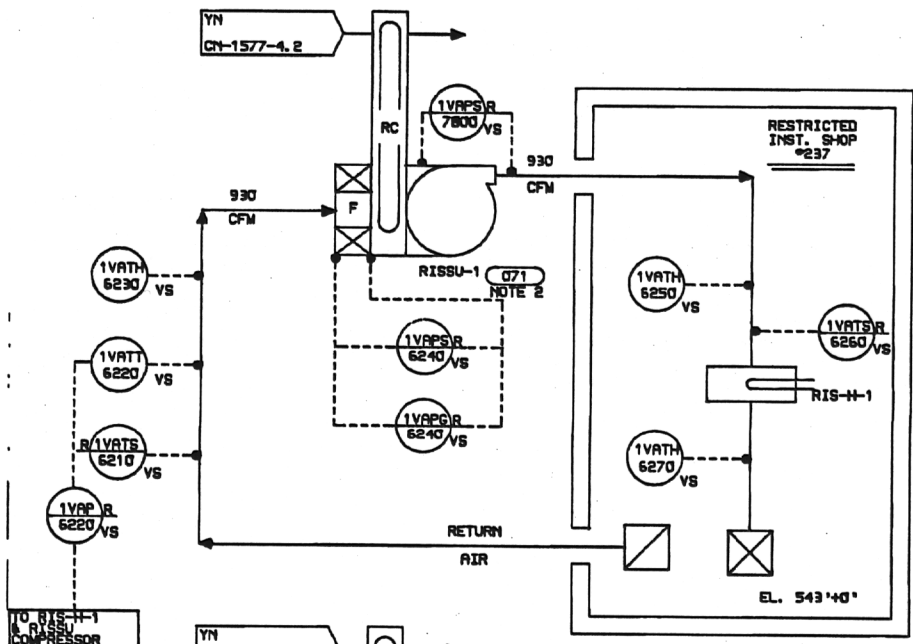


RESTRICTED INST. SHOPS

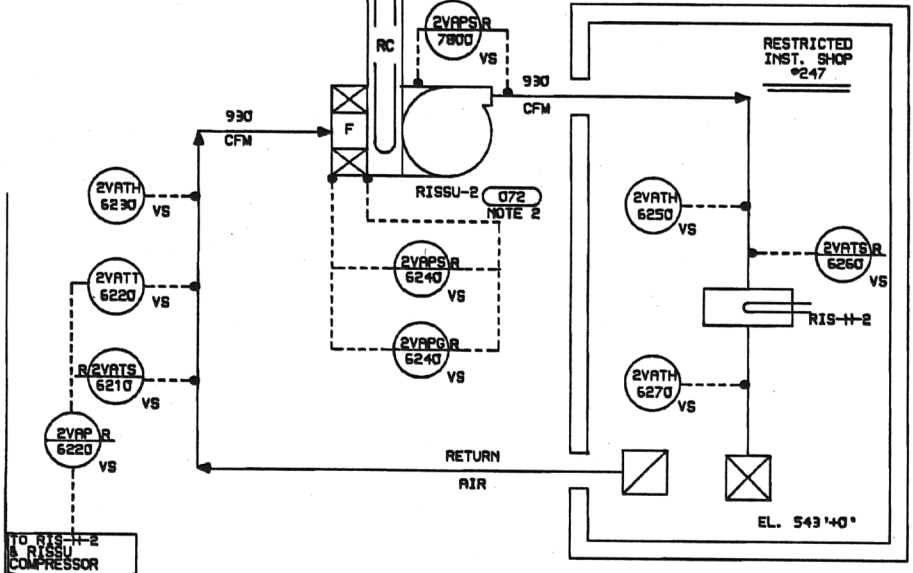


RESTRICTED INST. SHOPS

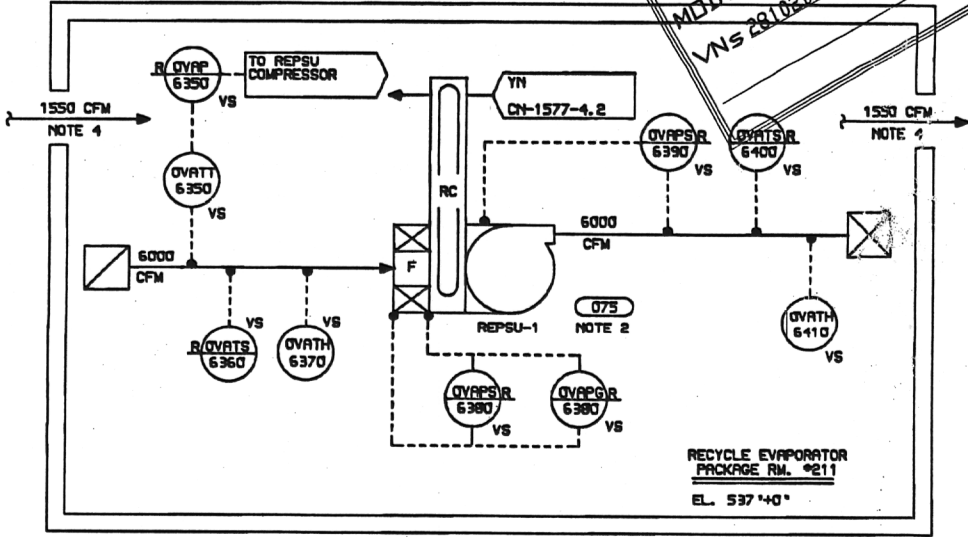

RECYCLE EVAPORATOR PACKAGE ROOM

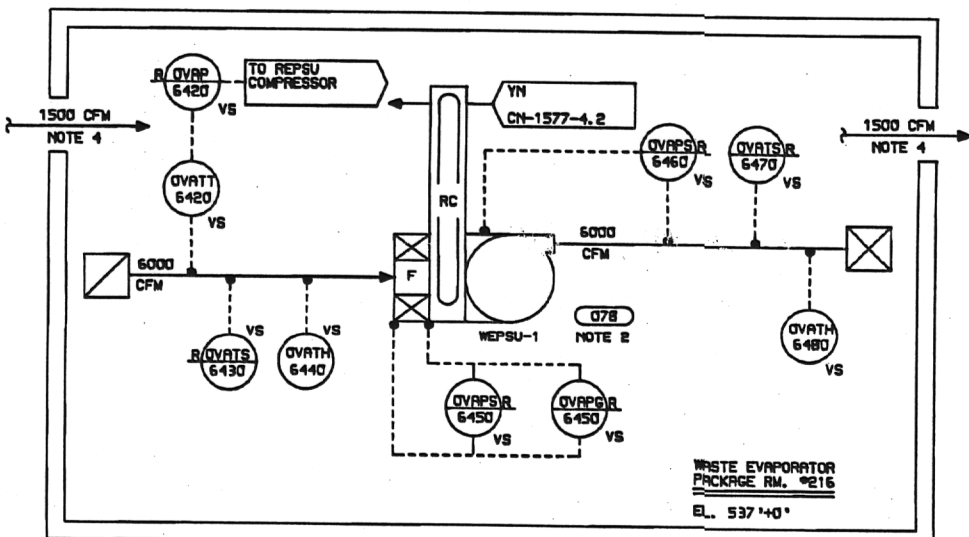

WASTE EVAPORATOR PACKAGE ROOM

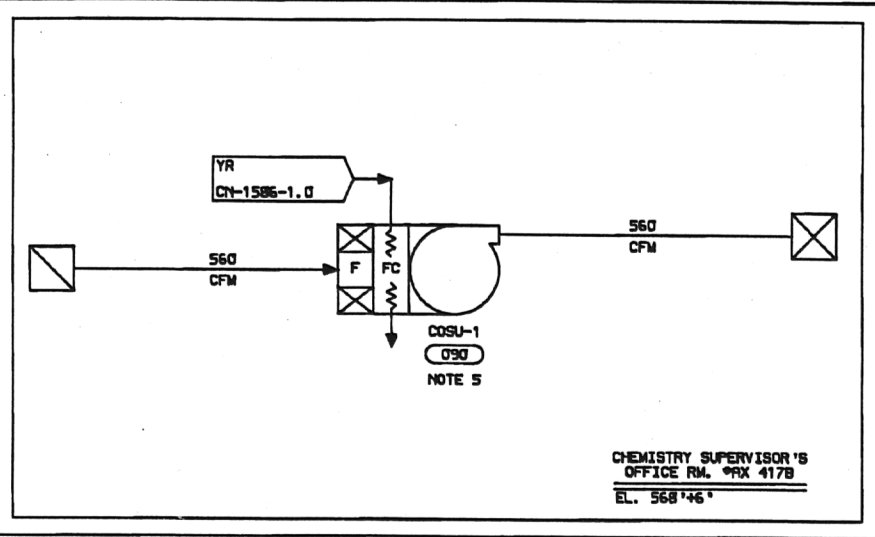

CHEMISTRY SUPERVISOR'S OFFICE

- NOTES:
1. ROOM TEMP. CONTROLLER MODULATES OUTSIDE & RETURN AIR DAMPERS.
 2. FOR CONDENSATE DRAINING SEE DWG. CH-1565-1.7.
 3. ROOM T-STAT CONTROLS FAN.
 4. SEE DWG. CH-1577-1.1.
 5. FOR CONDENSATE DRAINING SEE DWG. CH-1565-1.0.
 6. DAMPERS CONTROLLED FROM ROOM RTD.

ERN: CN000495

2 REV. PER CH-1577-1.7 CO. 02 & 03
1 REV. PER CO 101-1577-1.7-C001
APPROVED & RELEASED

CH-1577-1.7
FLOW DIAGRAMS OF
AUXILIARY BUILDING VENTILATION
SYSTEM (VAV)
MISC. ROOMS

D-08