

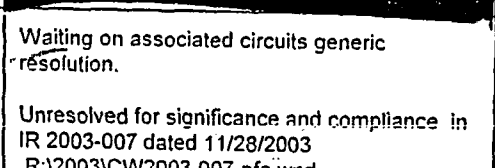


05/02/2005 Plant Engineering Branch Open Items							
SITE	ORG	LEAD	Item	Type	Issue	Planned Closure Quarter Interim Safety Basis	Disposition/Status/URI for Significance
CWY	NRR PEB	NFO Greg	LER 200200 6-00 and 01		Potential for draining the RWST to containment sumps due to hot short.	CY 2004 Quarter 2  Licensee has changed fire pre-plans to include the identified components as being subject to possible fire-induced mal-operation. Also, fire watches have been implemented.	Licensee did not initially concur with violation, but comp measures were taken.   
CWY	NRR	NFO Greg	URI 200300 7-01	Associated Circuits	Failure to protect associated circuits from fire damage or provide diverse means to achieve safe shutdown	CY 2005 Quarter 4 Licensee has changed fire pre-plans to include the identified components as being subject to possible fire-induced mal-operation.	Waiting on associated circuits generic resolution.  Unresolved for significance and compliance in IR 2003-007 dated 11/28/2003 <u>R:\2003\CW2003-007-nfo.wpd</u>  7/6/05 Licensee mailed closure package - NFO.

information: in this record was deleted  
in accordance with the Freedom of Information  
Act, exemptions 5  
FOIA- 2006-0095