

INDEX

LIMITING CONDITIONS FOR OPERATION AND SURVEILLANCE REQUIREMENTS

<u>SECTION</u>	<u>PAGE</u>
<u>3/4.0 APPLICABILITY</u>	3/4 0-1
<u>3/4.1 REACTIVITY CONTROL SYSTEMS</u>	
3/4.1.1 REACTIVITY CONTROL.....	3/4 1-1
Shutdown Margin (SDM)	3/4 1-1
DELETED.....	3/4 1-2
Reactivity Balance	3/4 1-3
Boron Dilution	3/4 1-4
Moderator Temperature Coefficient (MTC)	3/4 1-5
Minimum Temperature for Criticality.....	3/4 1-7
3/4.1.2 BORATION SYSTEMS	3/4 1-8
DELETED.....	3/4 1-8
DELETED.....	3/4 1-9
DELETED.....	3/4 1-11
DELETED.....	3/4 1-13
DELETED.....	3/4 1-14
DELETED.....	3/4 1-15
DELETED.....	3/4 1-16
DELETED.....	3/4 1-18
3/4.1.3 MOVABLE CONTROL ASSEMBLIES	3/4 1-20
CEA Group Position	3/4 1-20
Position Indicator Channels	3/4 1-24
CEA Drop Time	3/4 1-26
Shutdown CEA Insertion Limit	3/4 1-27
Regulating CEA Insertion Limits	3/4 1-28
Control Rod Drive Mechanisms.....	3/4 1-31

INDEX

LIMITING CONDITIONS FOR OPERATION AND SURVEILLANCE REQUIREMENTS

<u>SECTION</u>	<u>PAGE</u>
<u>3/4.2 POWER DISTRIBUTION LIMITS</u>	
3/4.2.1	LINEAR HEAT RATE 3/4 2-1
3/4.2.2	Deleted
3/4.2.3	TOTAL INTEGRATED RADIAL PEAKING FACTOR - F_r^T 3/4 2-9
3/4.2.4	AZIMUTHAL POWER TILT 3/4 2-10
3/4.2.5	Deleted
3/4.2.6	DNB MARGIN 3/4 2-13
<u>3/4.3 INSTRUMENTATION</u>	
3/4.3.1	REACTOR PROTECTIVE INSTRUMENTATION 3/4 3-1
3/4.3.2	ENGINEERED SAFETY FEATURE ACTUATION SYSTEM INSTRUMENTATION 3/4 3-9
3/4.3.3	MONITORING INSTRUMENTATION 3/4 3-24
	Radiation Monitoring 3/4 3-24
	Remote Shutdown Instrumentation 3/4 3-28
	Accident Monitoring 3/4 3-31
3/4.3.4	CONTAINMENT PURGE VALVE ISOLATION SIGNAL 3/4 3-36
<u>3/4.4 REACTOR COOLANT SYSTEM</u>	
3/4.4.1	COOLANT LOOPS AND COOLANT CIRCULATION 3/4 4-1
	Startup and Power Operation 3/4 4-1
	HOT STANDBY 3/4 4-1a
	HOT SHUTDOWN 3/4 4-1b
	COLD SHUTDOWN - Reactor Coolant System Loops Filled 3/4 4-1d
	COLD SHUTDOWN - Reactor Coolant System Loops Not Filled 3/4 4-1f
	Reactor Coolant Pumps - COLD SHUTDOWN 3/4 4-1h

INDEX

BASES

<u>SECTION</u>	<u>PAGE</u>
<u>3/4.0 APPLICABILITY</u>	B 3/4 0-1
<u>3/4.1 REACTIVITY CONTROL SYSTEMS</u>	
3/4.1.1 BORATION CONTROL.....	B 3/4 1-1
3/4.1.2 Deleted	
3/4.1.3 MOVABLE CONTROL ASSEMBLIES	B 3/4 1-2
 <u>3/4.2 POWER DISTRIBUTION LIMITS</u>	
3/4.2.1 LINEAR HEAT RATE	B 3/4 2-1
3/4.2.2 Deleted	
3/4.2.3 TOTAL INTEGRATED RADIAL PEAKING FACTOR - F_r^T	B 3/4 2-1
3/4.2.4 AZIMUTHAL POWER TILT	B 3/4 2-1
3/4.2.5 Deleted	
3/4.2.6 DNB MARGIN	B 3/4 2-2
 <u>3/4.3 INSTRUMENTATION</u>	
3/4.3.1 PROTECTIVE INSTRUMENTATION	B 3/4 3-1
3/4.3.2 ENGINEERED SAFETY FEATURE INSTRUMENTATION	B 3/4 3-1
3/4.3.3 MONITORING INSTRUMENTATION.....	B 3/4 3-2a
3/4.3.4 CONTAINMENT PURGE VALVE ISOLATION SIGNAL	B 3/4 3-6

INDEX

BASES

<u>SECTION</u>	<u>PAGE</u>
<u>3/4.4 REACTOR COOLANT SYSTEM</u>	
3/4.4.1 COOLANT LOOPS AND COOLANT CIRCULATION.....	B 3/4 4-1
3/4.4.2 SAFETY VALVES	B 3/4 4-1d
3/4.4.3 RELIEF VALVES	B 3/4 4-2
3/4.4.4 PRESSURIZER	B 3/4 4-2a
3/4.4.5 STEAM GENERATORS	B 3/4 4-2a
3/4.4.6 REACTOR COOLANT SYSTEM LEAKAGE	B 3/4 4-3
3/4.4.7 DELETED	B 3/4 4-4
3/4.4.8 SPECIFIC ACTIVITY.....	B 3/4 4-4
3/4.4.9 PRESSURE/TEMPERATURE LIMITS.....	B 3/4 4-5
3/4.4.10 DELETED	B 3/4 4-7
3/4.4.11 DELETED.....	B 3/4 4-8
<u>3/4.5 EMERGENCY CORE COOLING SYSTEMS (ECCS)</u>	
3/4.5.1 SAFETY INJECTION TANKS	B 3/4 5-1
3/4.5.2 and 3/4.5.3 ECCS SUBSYSTEMS.....	B 3/4 5-2
3/4.5.4 REFUELING WATER STORAGE TANK (RWST)	B 3/4 5-2d
3/4.5.5 TRISODIUM PHOSPHATE (TSP)	B 3/4 5-3
<u>3/4.6 CONTAINMENT SYSTEMS</u>	
3/4.6.1 PRIMARY CONTAINMENT.....	B 3/4 6-1
3/4.6.2 DEPRESSURIZATION AND COOLING SYSTEMS.....	B 3/4 6-3
3/4.6.3 CONTAINMENT ISOLATION VALVES	B 3/4 6-3a
3/4.6.4 COMBUSTIBLE GAS CONTROL.....	B 3/4 6-4
3/4.6.5 SECONDARY CONTAINMENT	B 3/4 6-5

INDEX

BASES

<u>SECTION</u>	<u>PAGE</u>
<u>3/4.7 PLANT SYSTEMS</u>	
3/4.7.1	TURBINE CYCLE B 3/4 7-1
3/4.7.2	DELETED..... B 3/4 7-3
3/4.7.3	REACTOR BUILDING CLOSED COOLING WATER SYSTEM B 3/4 7-3a
3/4.7.4	SERVICE WATER SYSTEM B 3/4 7-3c
3/4.7.5	DELETED..... B 3/4 7-4
3/4.7.6	CONTROL ROOM EMERGENCY VENTILATION SYSTEM B 3/4 7-4
3/4.7.7	DELETED..... B 3/4 7-5
3/4.7.8	SNUBBERS B 3/4 7-5
3/4.7.9	DELETED..... B 3/4 7-6
3/4.7.10	DELETED..... B 3/4 7-7
3/4.7.11	ULTIMATE HEAT SINK B 3/4 7-7
<u>3/4.8 ELECTRICAL POWER SYSTEMS</u> B 3/4 8-1	
<u>3/4.9 REFUELING OPERATIONS</u>	
3/4.9.1	BORON CONCENTRATION B 3/4 9-1
3/4.9.2	INSTRUMENTATION B 3/4 9-1
3/4.9.3	DECAY TIME..... B 3/4 9-1a
3/4.9.4	CONTAINMENT PENETRATIONS B 3/4 9-1a
3/4.9.5	DELETED..... B 3/4 9-1a
3/4.9.6	DELETED..... B 3/4 9-2
3/4.9.7	DELETED..... B 3/4 9-2
3/4.9.8	SHUTDOWN COOLING AND COOLING RECIRCULATION B 3/4 9-2

INDEX

BASES

<u>SECTION</u>	<u>PAGE</u>
3/4.9.9 and 3/4.9.10 DELETED.....	B 3/4 9-2
3/4.9.11 and 3/4.9.12 WATER LEVEL - REACTOR VESSEL AND STORAGE POOL WATER LEVEL.....	B 3/4 9-2b
3/4.9.13 DELETED.....	B 3/4 9-3
3/4.9.14 DELETED.....	B 3/4 9-3
3/4.9.15 STORAGE POOL AREA VENTILATION SYSTEM.....	B 3/4 9-3
3/4.9.16 SHIELDED CASK.....	B 3/4 9-3b
3/4.9.17 SPENT FUEL POOL BORON CONCENTRATION.....	B 3/4 9-3b
3/4.9.18 SPENT FUEL POOL - STORAGE	B 3/4 9-4
3/4.9.19 SPENT FUEL POOL - STORAGE PATTERN	B 3/4 9-4
3/4.9.20 SPENT FUEL POOL - CONSOLIDATION.....	B 3/4 9-4

3/4.10 SPECIAL TEST EXCEPTIONS

3/4.10.1 SHUTDOWN MARGIN.....	B 3/4 10-1
3/4.10.2 GROUP HEIGHT AND INSERTION LIMITS	B 3/4 10-1
3/4.10.3 DELETED.....	B 3/4 10-1
3/4.10.4 DELETED	B 3/4 10-1
3/4.10.5 DELETED.....	B 3/4 10-1

3/4.11 DELETED

3/4.11.1 DELETED.....	B 3/4 11-1
3/4.11.2 DELETED.....	B 3/4 11-1
3/4.11.3 DELETED	B 3/4 11-1

INDEX

DESIGN FEATURES

<u>SECTION</u>	<u>PAGE</u>
<u>5.1 SITE LOCATION</u>	5-1
<u>5.2 DELETED</u>	
<u>5.3 REACTOR CORE</u>	
Fuel Assemblies	5-4
Control Element Assemblies.....	5-4
<u>5.4 DELETED</u>	
<u>5.5 DELETED</u>	
<u>5.6 FUEL STORAGE</u>	
Criticality	5-5
Drainage	5-5a
Capacity.....	5-5a
<u>5.7 DELETED</u>	
<u>5.8 DELETED</u>	
<u>5.9 DELETED</u>	

INDEX

ADMINISTRATIVE CONTROLS

<u>SECTION</u>	<u>PAGE</u>
<u>6.9 REPORTING REQUIREMENTS</u>	
6.9.1 ROUTINE REPORTS.....	6-16
STARTUP REPORTS	6-16
ANNUAL REPORTS.....	6-17
ANNUAL RADIOLOGICAL REPORT.....	6-18
CORE OPERATING LIMITS REPORT	6-18a
6.9.2 SPECIAL REPORTS	6-19
<u>6.10 DELETED</u>	
<u>6.11 RADIATION PROTECTION PROGRAM</u>	<u>6-20</u>
<u>6.12 HIGH RADIATION AREA</u>	<u>6-20</u>
<u>6.13 SYSTEMS INTEGRITY</u>	<u>6-23</u>
<u>6.14 IODINE MONITORING</u>	<u>6-23</u>
<u>6.15 RADIOLOGICAL EFFLUENT MONITORING AND OFFSITE DOSE</u> <u>CALCULATION MANUAL (REMDCM).....</u>	<u>6-24</u>
<u>6.16 RADIOACTIVE WASTE TREATMENT</u>	<u>6-24</u>
<u>6.17 SECONDARY WATER CHEMISTRY</u>	<u>6-25</u>
<u>6.18 DELETED</u>	
<u>6.19 CONTAINMENT LEAKAGE RATE TESTING PROGRAM</u>	<u>6-26</u>
<u>6.20 RADIOACTIVE EFFULENT CONTROLS PROGRAM</u>	<u>6-26</u>
<u>6.21 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM</u>	<u>6-28</u>
<u>6.22 REACTOR COOLANT PUMP FLYWHEEL INSPECTION PROGRAM</u>	<u>6-28</u>
<u>6.23 TECHNICAL SPECIFICATION (TS) BASES CONTROL PROGRAM</u>	<u>6-28</u>
<u>6.24 DIESEL FUEL OIL TEST PROGRAM</u>	<u>6-29</u>

DEFINITIONS

VENTING

1.35 VENTING is the controlled process of discharging air or gas from a confinement to maintain temperature, pressure, humidity, concentration or other operating condition, in such a manner that replacement air or gas is not provided or required during VENTING. Vent, used in system names, does not imply a VENTING process.

MEMBER(S) OF THE PUBLIC

1.36 MEMBER(S) OF THE PUBLIC shall include all persons who are not occupationally associated with the plant. This category does not include employees of the utility, its contractors or its vendors. Also excluded from this category are persons who enter the site to service equipment or to make deliveries. This category does include persons who use portions of the site for recreational, occupational or other purposes not associated with the plant.

The term "REAL MEMBER OF THE PUBLIC" means an individual who is exposed to existing dose pathways at one particular location.

SITE BOUNDARY

1.37 The SITE BOUNDARY shall be that line beyond which the land is not owned, leased or otherwise controlled by the licensee.

UNRESTRICTED AREA

1.38 An UNRESTRICTED AREA shall be any area at or beyond the SITE BOUNDARY to which access is not controlled by the licensee for purposes of protection of individuals from exposure to radiation and radioactive materials or any area within the SITE BOUNDARY used for residential quarters or industrial, commercial institutional and/or recreational purposes.

STORAGE PATTERN

1.39 The Region B spent fuel racks contain a cell blocking device in every 4th rack location for administrative control. This 4th location will be referred to as the blocked location. A STORAGE PATTERN refers to a blocked location and all adjacent and diagonal cell locations surrounding the blocked location within the respective region.

REACTIVITY CONTROL SYSTEMS

3/4.1.3 MOVABLE CONTROL ASSEMBLIES

CEA POSITION

LIMITING CONDITION FOR OPERATION

3.1.3.1 All CEAs shall be OPERABLE with each CEA of a given group positioned within 10 steps (indicated position) of all other CEAs in its group, and the CEA Motion Inhibit and the CEA Deviation Circuit shall be OPERABLE.

APPLICABILITY: MODES 1⁽¹⁾ and 2⁽¹⁾.

ACTION:

INOPERABLE EQUIPMENT	REQUIRED ACTION
A. One or more CEAs trippable and misaligned from all other CEAs in its group by > 10 steps and < 20 steps. <u>OR</u> One CEA trippable and misaligned from all other CEAs in its group by ≥ 20 steps.	A.1 Reduce THERMAL POWER to < 70% of the maximum allowable THERMAL POWER within 1 hour and restore CEA(s) misalignment within 2 hours or otherwise be in MODE 3 within the next 6 hours.
B. CEA Motion Inhibit inoperable.	B.1 Verify the indicated position of each CEA to be within 10 steps of all other CEAs in its group within 1 hour and every 4 hours thereafter, and restore CEA Motion Inhibit to OPERABLE status within 6 hours or otherwise be in MODE 3 within the next 6 hours. <u>OR</u> B.2 ⁽²⁾ Place and maintain the CEA drive system mode switch in either the "off" or "manual" position, and withdraw all CEAs in group 7 to ≥ 172 steps within 6 hours or otherwise be in MODE 3 within the next 6 hours.

(1) See Special Test Exception 3.10.2

(2) Performance of ACTION B.2 is allowed only when not in conflict with either Required Action A.1 or C.1. |

REACTIVITY CONTROL SYSTEMS

CONTROL ROD DRIVE MECHANISMS

LIMITING CONDITION FOR OPERATION

3.1.3.7 The control rod drive mechanisms shall be de-energized.

APPLICABILITY: MODES 3*, 4, 5 and 6, whenever the RCS boron concentration is less than refueling concentration of Specification 3.9.1.

ACTION:

With any of the control rod drive mechanisms energized, restore the mechanisms to their de-energized state within 2 hours or immediately open the reactor trip circuit breakers:

SURVEILLANCE REQUIREMENTS

4.1.3.7 The control rod drive mechanisms shall be verified to be de-energized at least once per 24 hours.

* The control rod drive mechanisms may be energized for MODE 3 as long as 4 reactor coolant pumps are OPERATING, the reactor coolant system temperature is greater than 500° F, the pressurizer pressure is greater than 2000 psia and the high power trip is OPERABLE. |

POWER DISTRIBUTION LIMITS

TOTAL UNRODDED INTEGRATED RADIAL PEAKING FACTOR - F_r^T

LIMITING CONDITION FOR OPERATION

3.2.3 The calculated value of F_r^T shall be within the 100% power limit specified in the CORE OPERATING LIMITS REPORT. The F_r^T value shall include the effect of AZIMUTHAL POWER TILT.

APPLICABILITY: MODE 1 with THERMAL POWER >20% RTP*.

ACTION:

With F_r^T exceeding the 100% power limit within 6 hours either:

- a. Reduce THERMAL POWER to bring the combination of THERMAL POWER and F_r^T to within the power dependent limit specified in the CORE OPERATING LIMITS REPORT and withdraw the CEAs to or beyond the Long Term Steady State Insertion Limits of Specification 3.1.3.6; or
- b. Be in at least HOT STANDBY.

SURVEILLANCE REQUIREMENTS

4.2.3.1 The provisions of Specification 4.0.4 are not applicable.

4.2.3.2 F_r^T shall be determined to be within the 100% power limit at the following intervals:

- a. Prior to operation above 70 percent of RATED THERMAL POWER after each fuel loading,
- b. At least once per 31 days of accumulated operation in MODE 1, and
- c. Within four hours if the AZIMUTHAL POWER TILT (T_q) is > 0.020.

4.2.3.3 F_r^T shall be determined by using the incore detectors to obtain a power distribution map with all CEAs at or above the Long Term Steady State Insertion Limit for the existing Reactor Coolant Pump Combination.

* See Special Test Exception 3.10.2.

POWER DISTRIBUTION LIMITS

AZIMUTHAL POWER TILT - T_q

LIMITING CONDITION FOR OPERATION

3.2.4 The AZIMUTHAL POWER TILT (T_q) shall be ≤ 0.02 .

APPLICABILITY: MODE 1 with THERMAL POWER $> 50\%$ of RATED THERMAL POWER⁽¹⁾.

ACTION:

- a. With the indicated $T_q > 0.02$ but ≤ 0.10 , either restore T_q to ≤ 0.02 within 2 hours or verify the TOTAL UNRODDED INTEGRATED RADIAL PEAKING FACTOR (F_r^T) is within the limit of Specification 3.2.3 within 2 hours and once per 8 hours thereafter. Or otherwise, reduce THERMAL POWER to $\leq 50\%$ of RATED THERMAL POWER within the next 4 hours.
- b. With the indicated $T_q > 0.10$, perform the following actions: ⁽²⁾
 1. Verify the TOTAL UNRODDED INTEGRATED RADIAL PEAKING FACTOR (F_r^T) is within the limit of Specification 3.2.3 within 2 hours; and
 2. Reduce THERMAL POWER to $\leq 50\%$ of RATED THERMAL POWER within 2 hours; and
 3. Restore $T_q \leq 0.02$ prior to increasing THERMAL POWER. Correct the cause of the out of limit condition prior to increasing THERMAL POWER. Subsequent power operation above 50% of RATED THERMAL POWER may proceed provided that the measured T_q is verified ≤ 0.02 at least once per hour for 12 hours, or until verified at 95% of RATED THERMAL POWER.

SURVEILLANCE REQUIREMENTS

4.2.4.1 Verify T_q is within limit at least once every 12 hours. The provisions of Specification 4.0.4 are not applicable for entering into MODE 1 with THERMAL POWER $> 50\%$ of RATED THERMAL POWER from MODE 1.

⁽¹⁾ See Special Test Exception 3.10.2.

⁽²⁾ All subsequent Required ACTIONS must be completed if power reduction commences prior to restoring $T_q \leq 0.10$.

3/4.3 INSTRUMENTATION

3/4.3.1 REACTOR PROTECTIVE INSTRUMENTATION

LIMITING CONDITION FOR OPERATION

3.3.1.1 As a minimum, the reactor protective instrumentation channels and bypasses of Table 3.3-1 shall be OPERABLE.

APPLICABILITY: As shown in Table 3.3-1.

ACTION:

As shown in Table 3.3-1.

SURVEILLANCE REQUIREMENTS

4.3.1.1.1 Each reactor protective instrumentation channel shall be demonstrated OPERABLE by the performance of the CHANNEL CHECK, CHANNEL CALIBRATION and CHANNEL FUNCTIONAL TEST operations during the MODES and at the frequencies shown in Table 4.3-1.

4.3.1.1.2 The logic for the bypasses shall be demonstrated OPERABLE during the at power CHANNEL FUNCTIONAL TEST of channels affected by bypass operation. The total bypass function shall be demonstrated OPERABLE at least once per 18 months during CHANNEL CALIBRATION testing of each channel affected by bypass operation.

4.3.1.1.3 The REACTOR TRIP SYSTEM RESPONSE TIME of each reactor trip function shall be demonstrated to be within its limit at least once per 18 months. Neutron detectors are exempt from response time testing. Each test shall include at least one channel per function such that all channels are tested at least once every N times 18 months where N is the total number of redundant channels in a specific reactor trip function as shown in the "Total No. of Channels" column of Table 3.3-1.

TABLE 3.3-1 (Continued)

TABLE NOTATION

- * With the protective system trip breakers in the closed position and the CEA drive system capable of CEA withdrawal.
- (a) Trip may be bypassed below 5% of RATED THERMAL POWER; bypass shall be automatically removed when THERMAL POWER is \geq 5% of RATED THERMAL POWER.
 - (b) Trip may be manually bypassed when steam generator pressure is < 800 psia and all CEAs are fully inserted; bypass shall be automatically removed when steam generator pressure is ≥ 800 psia.
 - (c) Trip may be bypassed below 15% of RATED THERMAL POWER; bypass shall be automatically removed when THERMAL POWER is $\geq 15\%$ of RATED THERMAL POWER.
 - (d) Trip does not need to be OPERABLE if all the control rod drive mechanisms are de-energized or if the RCS boron concentration is greater than or equal to the refueling concentration of Specification 3.9.1.
 - (e) DELETED
 - (f) ΔT Power input to trip may be bypassed below 5% of RATED THERMAL POWER; bypass shall be automatically removed when THERMAL POWER is $\geq 5\%$ of RATED THERMAL POWER.

ACTION STATEMENTS

- ACTION 1 - With the number of channels OPERABLE one less than required by the Minimum Channels OPERABLE requirement, restore the inoperable channel to OPERABLE status within 48 hours or be in HOT STANDBY within the next 4 hours and/or open the protective system trip breakers.
- ACTION 2 - With the number of OPERABLE channels one less than the Total Number of Channels, operation may continue provided the following conditions are satisfied:
- a. The inoperable channel is placed in either the bypassed or tripped condition within 1 hour. The inoperable channel shall either be restored to OPERABLE status, or placed in the tripped condition, within 48 hours.
 - a. Within 1 hour, all functional units receiving an input from the inoperable channel are also declared inoperable, and the appropriate actions are taken for the affected functional units.
 - b. The Minimum Channels OPERABLE requirement is met; however, one additional channel may be removed from service for up to 48 hours, provided one of the inoperable channels is placed in the tripped condition.

TABLE 3.3-1 (Continued)

ACTION STATEMENTS

ACTION 3 - NOT USED

ACTION 4 - With the number of channels OPERABLE one less than required by the Minimum Channels OPERABLE requirement, immediately verify compliance with the SHUTDOWN MARGIN requirements of Specification 3.1.1.1, and at least once per 4 hours thereafter. |

ACTION 5 - With the number of channels OPERABLE one less than required by the Minimum Channels OPERABLE requirement, restore the inoperable channel to OPERABLE status within 48 hours or be in at least HOT STANDBY within the next 6 hours.

ACTION 6 - With the number of channels OPERABLE one less than required by the Minimum Channels OPERABLE requirement, be in at least HOT STANDBY within 6 hours.

INSTRUMENTATION

3/4.3.2 ENGINEERED SAFETY FEATURE ACTUATION SYSTEM INSTRUMENTATION

LIMITING CONDITION FOR OPERATION

3.3.2.1 The engineered safety feature actuation system instrumentation channels and bypasses shown in Table 3.3-3 shall be OPERABLE with their trip setpoints set consistent with the values shown in the Trip Setpoint column of Table 3.3-4.

APPLICABILITY: As shown in Table 3.3-3.

ACTION:

- a. With an engineered safety feature actuation system instrumentation channel trip setpoint less conservative than the value shown in the Allowable Values column of Table 3.3-4, either adjust the trip setpoint to be consistent with the value specified in the Trip Setpoint column of Table 3.3-4 within 2 hours or declare the channel inoperable and take the ACTION shown in Table 3.3-3.
- b. With an engineered safety feature actuation system instrumentation channel inoperable, take the ACTION shown in Table 3.3-3.

SURVEILLANCE REQUIREMENTS

4.3.2.1.1 Each engineered safety feature acutation system instrumentation channel shall be demonstrated OPERABLE by the performance of the CHANNEL CHECK, CHANNEL CALIBRATION and CHANNEL FUNCTIONAL TEST operations during the MODES and at the frequencies shown in Table 4.3-2. |

4.3.2.1.2 The logic for the bypasses shall be demonstrated OPERABLE during the at power CHANNEL FUNCTIONAL TEST of channels affected by bypass operation. The total bypass function shall be demonstrated OPERABLE at least once per 18 months during CHANNEL CALIBRATION testing of each channel affected by bypass operation. |

INSTRUMENTATION

ENGINEERED SAFETY FEATURE ACTUATION SYSTEM SENSOR CABINET POWER SUPPLY DRAWERS

LIMITING CONDITION FOR OPERATION

3.3.2.2 The engineered safety feature actuation system Sensor Cabinets (RC02A1, RC02B2, RC02C3 & RC02D4) Power Supply Drawers shall be OPERABLE and energized from the normal power source with the backup power source available. The normal and backup power sources for each sensor cabinet is detailed in Table 3.3-5a:

CABINET	NORMAL POWER	BACKUP POWER
RC02A1	VA-10	VA-40
RC02B2	VA-20	VA-30
RC02C3	VA-30	VA-20
RC02D4	VA-40	VA-10

Table 3.3-5a

APPLICABILITY: MODES 1, 2, 3 and 4

ACTION:

With any of the Sensor Cabinet Power Supply Drawers inoperable, or either the normal or backup power source not available as delineated in Table 3.3-5a, restore the inoperable Sensor Cabinet Power Supply Drawer to OPERABLE status within 48 hours or be in COLD SHUTDOWN within the next 36 hours.

SURVEILLANCE REQUIREMENTS

4.3.2.2.1 The engineered safety feature actuation system Sensor Cabinet Power Supply Drawers shall be determined OPERABLE once per shift by visual inspection of the power supply drawer indicating lamps.

4.3.2.2.2 Verify the OPERABILITY of the Sensor Cabinet Power Supply auctioneering circuit at least once per 18 months.

INSTRUMENTATION

3/4.3.3 MONITORING INSTRUMENTATION

RADIATION MONITORING

LIMITING CONDITION FOR OPERATION

3.3.3.1 The radiation monitoring instrumentation channels shown in Table 3.3-6 shall be OPERABLE with their alarm/trip setpoints within the specified limits.

APPLICABILITY: As shown in Table 3.3-6.

ACTION:

- a. With a radiation monitoring channel alarm/trip setpoint exceeding the value shown in Table 3.3-6, adjust the setpoint to within the limit within 2 hours or declare the channel inoperable.
- b. With one or more radiation monitoring channels inoperable, take the ACTION shown in Table 3.3-6. The provisions of Specification 3.0.3 are not applicable.

SURVEILLANCE REQUIREMENTS

4.3.3.1.1 Each radiation monitoring instrumentation channel shall be demonstrated OPERABLE by the performance of the CHANNEL CHECK, CHANNEL CALIBRATION and CHANNEL FUNCTIONAL TEST operations during the MODES and at the frequencies shown in Table 4.3-3.

4.3.3.1.2 DELETED

4.3.3.1.3 Verify the response time of the control room isolation channel at least once per 18 months.

INSTRUMENTATION

ACCIDENT MONITORING

LIMITING CONDITION FOR OPERATION

3.3.3.8 The accident monitoring instrumentation channels shown in Table 3.3-11 shall be OPERABLE.

APPLICABILITY: MODES 1, 2, and 3.

ACTION:

- a. ACTIONS per Table 3.3-11.

SURVEILLANCE REQUIREMENTS

4.3.3.8 Each accident monitoring instrumentation channel shall be demonstrated OPERABLE by performance of the CHANNEL CHECK and CHANNEL CALIBRATION operations at the frequencies shown in Table 4.3-7.

TABLE 3.3-11
ACCIDENT MONITORING INSTRUMENTATION

<u>Instrument</u>	<u>Total No. of Channels</u>	<u>Minimum Channels OPERABLE</u>	<u>ACTION</u>
1. Pressurizer Water Level	2	1	1
2. Auxiliary Feedwater Flow Rate	2/S.G.	1/S.G.	1
3. RCS Subcooled/Superheat Monitor	2	1	2
4. PORV Position Indicator Acoustic Monitor	1/valve	1/valve	3
5. PORV Block Valve Position Indicator	1/valve	1/valve	3
6. Safety Valve Position Indicator Acoustic Monitor	1/valve	1/valve	3
7. Containment Pressure (Wide Range)	2	1	4
8. Containment Water Level (Narrow Range)	1	1	7##
9. Containment Water Level (Wide Range)	2	1	4
10. Core Exit Thermocouples	4 CETs/core quadrant	2 CETs in any of 2 core quadrants	5
11. Main Steam Line Radiation Monitor	3	3	6
12. Reactor Vessel Coolant Level	2*	1*	8

* A channel is eight (8) sensors in a probe. A channel is OPERABLE if four (4) or more sensors, two (2) or more in the upper four and two (2) or more in the lower four, are OPERABLE.

Refer to ACTION statement in Technical Specification 3.4.6.1.

TABLE 3.3-11 (Continued)

ACTION STATEMENTS

- ACTION 1 - With the number of OPERABLE channels less than the MINIMUM CHANNELS OPERABLE requirements of Table 3.3-11, either restore the inoperable channel(s) to OPERABLE status within 30 days or be in HOT STANDBY within the next 12 hours.
- ACTION 2 - With the number of channels OPERABLE less than the MINIMUM CHANNELS OPERABLE, determine the subcooling margin once per 12 hours.
- ACTION 3 - With any individual valve position indicator inoperable, obtain quench tank temperature, level and pressure information, and monitor discharge pipe temperature once per shift to determine valve position. This ACTION is not required if the PORV block valve is closed with power removed in accordance with Specification 3.4.3.a or 3.4.3.b. |
- ACTION 4 - a. With the number of OPERABLE accident monitoring instrumentation channels less than the total number of channels shown in Table 3.3-11, restore the inoperable channel(s) to OPERABLE status within 7 days, or submit a special report to the Commission pursuant to Specification 6.9.2 within the next 10 days outlining the cause of the malfunction, the plans for restoring the channel(s) to OPERABLE status, and any alternate methods in affect for estimating the applicable parameter during the interim.
- b. With the number of OPERABLE accident monitoring instrumentation channels less than the MINIMUM CHANNELS OPERABLE requirements of Table 3.3-11, restore the inoperable channel(s) to OPERABLE status within 48 hours, or submit a special report to the Commission pursuant to Specification 6.9.2 within the next 10 days outlining the cause of the malfunction, the plans for restoring the channel(s) to OPERABLE status, and any alternate methods in affect for estimating the applicable parameter during the interim.

REACTOR COOLANT SYSTEM

COOLANT LOOPS AND COOLANT CIRCULATION

STARTUP AND POWER OPERATION

LIMITING CONDITION FOR OPERATION

3.4.4.1 Two reactor coolant loops shall be OPERABLE and in operation.

APPLICABILITY: MODES 1 and 2. |

ACTION:

With the requirements of the above specification not met, be in at least HOT STANDBY within 6 hours.

SURVEILLANCE REQUIREMENTS

4.4.1.1 The above required reactor coolant loops shall be verified to be in operation at least once per 12 hours.

REACTOR COOLANT SYSTEM

SURVEILLANCE REQUIREMENTS (Continued)

4.4.5.1.5 Reports

- a. Following each inservice inspection of steam generator tubes, the number of tubes plugged and sleeved in each steam generator shall be reported to the Commission within 15 days.
- b. The complete results of the steam generator tube inservice inspection shall be included in the Annual Operating Report for the period in which this inspection was completed. This report shall include:
 - 1. Number and extent of tubes inspected.
 - 2. Location and percent of wall-thickness penetration for each indication of an imperfection.
 - 3. Identification of tubes plugged or sleeved.
- c. Results of steam generator tube inspections which fall into Category C-3 shall be reported pursuant to 10 CFR 50.72. A Special Report pursuant to Specification 6.9.2 shall be submitted prior to resumption of plant operation and shall provide a description of investigations conducted to determine the cause of the tube degradation and corrective measures taken to prevent recurrence.

**TABLE 4.4-6
STEAM GENERATOR TUBE INSPECTION**

1ST SAMPLE INSPECTION			2ND SAMPLE INSPECTION		3RD SAMPLE INSPECTION	
Sample Size	Result	ACTION Required	Result	ACTION Required	Result	ACTION Required
A minimum of S tubes per S.G.	C-1	None	N/A	N/A	N/A	N/A
	C-2	Repair defective tubes and inspect additional 25 tubes in this S.G.*	C-1	None	N/A	N/A
			C-2	Repair defective tubes and inspect additional 45 tubes in this S.G.*	C-1	None
					C-2	Repair defective tubes*
			C-3	Perform ACTION for C-3 result of first sample	C-3	Perform ACTION for C-3 result of first sample
					N/A	N/A
	C-3	Inspection all tubes in this S.G., repair defective tubes and inspect 25 tubes in each other S.G.* Prompt notification to NRC pursuant to 10 CFR 50.72	All other S.G.s are C- 1	None	N/A	N/A
			Some S.G.s C-2 but no additional S.G. are C-3	Perform ACTION for C-2 result of second sample	N/A	N/A
			Additional S.G. is C-3	Inspect all tubes in each S.G. and repair defective tubes.* Prompt notification to NRC pursuant to 10 CFR 50.72	N/A	N/A

$S = 3 \frac{N}{n} \%$ Where N is the number of steam generators in the unit, and n is the number of steam generators inspected during an inspection

* Repair of defective tubes shall be limited to plugging with the exception of those tubes which may be sleeved. Tubes with defective sleeves shall be plugged.

MILLSTONE - UNIT 2

3/4 4-7f

Amendment No. 22, 37, 52, 73, 89,

44, 291

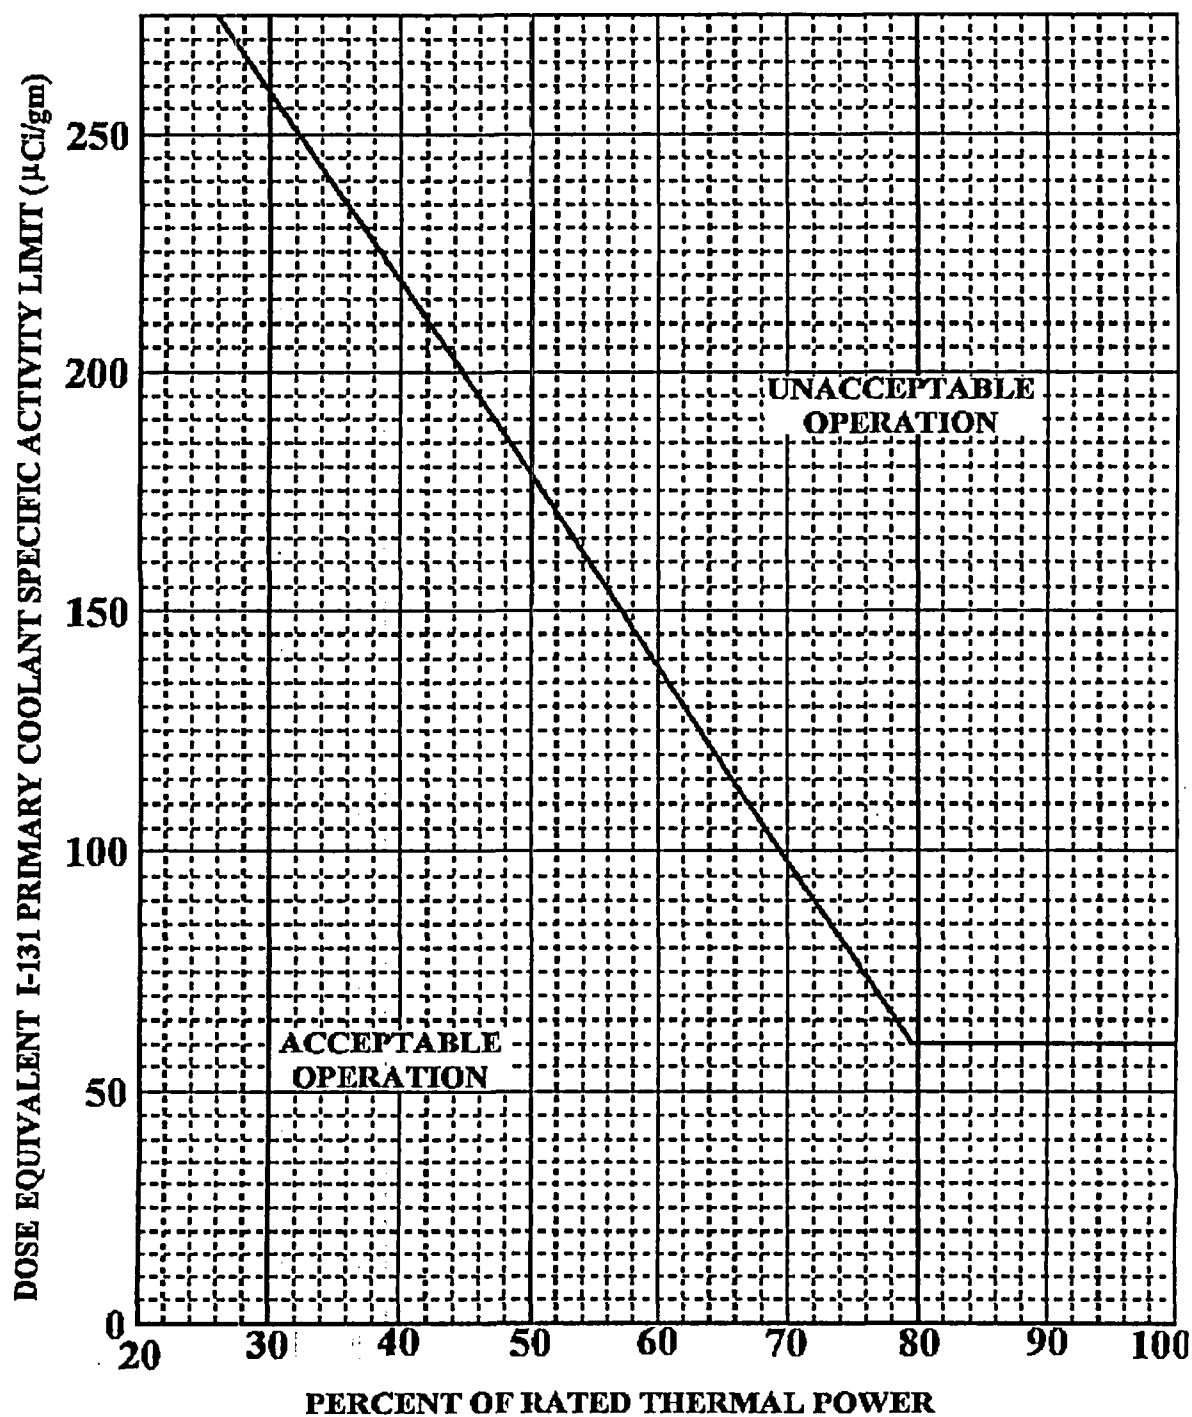


FIGURE 3.4-1

DOSE EQUIVALENT I-131 Primary Coolant Specific Activity Limit Versus Percent of RATED THERMAL POWER with the Primary Coolant Specific Activity $> 1.0 \mu\text{Ci/gram}$ DOSE EQUIVALENT I-131

3/4.6 CONTAINMENT SYSTEMS

3/4.6.1 PRIMARY CONTAINMENT

CONTAINMENT INTEGRITY

LIMITING CONDITION FOR OPERATION

3.6.1.1 Primary CONTAINMENT INTEGRITY shall be maintained.

APPLICABILITY: MODES 1, 2, 3 and 4.

ACTION:

Without primary CONTAINMENT INTEGRITY, restore CONTAINMENT INTEGRITY within one hour or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the next 30 hours.

SURVEILLANCE REQUIREMENTS

4.6.1.1 Primary CONTAINMENT INTEGRITY shall be demonstrated:

- a. At least once per 31 days by verifying that all penetrations⁽¹⁾ not capable of being closed by OPERABLE containment automatic isolation valves⁽²⁾ and required to be closed during accident conditions are closed by valves, blind flanges, or deactivated automatic valves secured in their positions,⁽³⁾ except for valves that are open under administrative control as permitted by Specification 3.6.3.1.
- b. At least once per 31 days by verifying the equipment hatch is closed and sealed.
- c. By verifying the containment air lock is in compliance with the requirements of Specification 3.6.1.3.
- d. After each closing of a penetration subject to type B testing (except the containment air lock), if opened following a Type A or B test, by leak rate testing in accordance with the Containment Leakage Rate Testing Program.
- e. By verifying Containment structural integrity in accordance with the Containment Tendon Surveillance Program.

(1) Except valves, blind flanges, and deactivated automatic valves which are located inside the containment and are locked, sealed, or otherwise secured in the closed position. These penetrations shall be verified closed prior to entering MODE 4 from MODE 5, if not performed within the previous 92 days.

(2) In MODE 4, the requirement for an OPERABLE containment automatic isolation valve system is satisfied by use of the containment isolation trip pushbuttons

(3) Isolation devices in high radiation areas may be verified by use of administrative means.

CONTAINMENT SYSTEMS

3/4.6.2 DEPRESSURIZATION AND COOLING SYSTEMS

CONTAINMENT SPRAY AND COOLING SYSTEMS

LIMITING CONDITION FOR OPERATION

3.6.2.1 Two containment spray trains and two containment cooling trains, with each cooling train consisting of two containment air recirculation and cooling units, shall be OPERABLE.

APPLICABILITY: MODES 1, 2 and 3*.

ACTION:

Inoperable Equipment	Required ACTION
a. One containment spray train	a.1 Restore the inoperable containment spray train to OPERABLE status within 72 hours or be in HOT STANDBY within the next 6 hours and reduce pressurizer pressure to less than 1750 psia within the following 6 hours.
b. One containment cooling train	b.1 Restore the inoperable containment cooling train to OPERABLE status within 7 days or be in HOT SHUTDOWN within the next 12 hours.
c. One containment spray train AND One containment cooling train	c.1 Restore the inoperable containment spray train or the inoperable containment cooling train to OPERABLE status within 48 hours or be in HOT SHUTDOWN within the next 12 hours.
d. Two containment cooling trains	d.1 Restore at least one inoperable containment cooling train to OPERABLE status within 48 hours or be in HOT SHUTDOWN within the next 12 hours.
e. All other combinations	e.1 Enter LCO 3.0.3 immediately.

SURVEILLANCE REQUIREMENTS

4.6.2.1.1 Each containment spray train shall be demonstrated OPERABLE:

- a. At least once per 31 days by verifying each containment spray manual, power operated, and automatic valve in the spray train flow path, that is not locked, sealed, or otherwise secured in position, is in the correct position.

* The Containment Spray System is not required to be OPERABLE in MODE 3 if pressurizer pressure is < 1750 psia.

PLANT SYSTEMS

MAIN FEEDWATER ISOLATION COMPONENTS (MFICs)

LIMITING CONDITION FOR OPERATION (Continued)

- a. With two or more of the feedwater isolation components inoperable in the same flow path, either:
 - 1. Restore the inoperable component(s) to OPERABLE status within 8 hours until ACTION 'a' applies, or
 - 2. Isolate the affected flow path within 8 hours, and verify that the inoperable feedwater isolation components are closed or isolated/secured once per 7 days, or
 - 3. Be in HOT SHUTDOWN within the next 12 hours.

SURVEILLANCE REQUIREMENTS

4.7.1.6 Each feedwater isolation valve/feedwater pump trip circuitry shall be demonstrated OPERABLE at least once per 18 months by:

- a. Verifying that on 'A' main steam isolation test signal, each isolation valve actuates to its isolation position, and
- b. Verifying that on 'B' main steam isolation test signal, each isolation valve actuates to its isolation position, and
- c. Verifying that on 'A' main steam isolation test signal, each feedwater pump trip circuit actuates, and
- d. Verifying that on 'B' main steam isolation test signal, each feedwater pump trip circuit actuates.

3/4.8 ELECTRICAL POWER SYSTEMS

3/4.8.1 A.C. SOURCES

OPERATING

LIMITING CONDITION FOR OPERATION

3.8.1.1 As a minimum, the following A.C. electrical power sources shall be OPERABLE:

- a. Two physically independent circuits between the offsite transmission network and the onsite Class 1E distribution system, and
- b. Two separate and independent diesel generators each with a separate fuel oil supply tank containing a minimum of 12,000 gallons of fuel.

APPLICABILITY: MODES 1, 2, 3 and 4.

ACTION:

Inoperable Equipment	Required ACTION
a. One offsite circuit	a.1 Perform Surveillance Requirement 4.8.1.1.1 for remaining offsite circuit within 1 hour prior to or after entering this condition, and at least once per 8 hours thereafter.
	AND
	a.2 Restore the inoperable offsite circuit to OPERABLE status within 72 hours or be in HOT STANDBY within the next 6 hours and COLD SHUTDOWN within the following 30 hours.

ELECTRICAL POWER SYSTEMS

ACTION (Continued)

Inoperable Equipment	Required ACTION
b. One diesel generator	b.1 Perform Surveillance Requirement 4.8.1.1.1 for the offsite circuit within 1 hour prior to or after entering this condition, and at least once per 8 hours thereafter.
	AND
	b.2 Demonstrate OPERABLE diesel generator is not inoperable due to common cause failure within 24 hours or perform Surveillance Requirement 4.8.1.1.2.a.2 for the OPERABLE diesel generator within 24 hours.
	AND
	b.3 Verify the steam-driven auxiliary feedwater pump is OPERABLE (MODES 1, 2, and 3 only). If this condition is not satisfied within 2 hours, be in at least HOT STANDBY within the next 6 hours and HOT SHUTDOWN within the following 6 hours.
	AND
	b.4 (Applicable only if the 14 day allowed outage time specified in ACTION Statement b.5 is to be used.) Verify the required Millstone Unit No. 3 diesel generator(s) is/are OPERABLE and the Millstone Unit No. 3 SBO diesel generator is available within 1 hour prior to or after entering this condition, and at least once per 24 hours thereafter. Restore any inoperable required Millstone Unit No. 3 diesel generator to OPERABLE status and/or Millstone Unit No. 3 SBO diesel generator to available status within 72 hours or be in HOT STANDBY within the next 6 hours and COLD SHUTDOWN within the following 30 hours.
	AND
	b.5 Restore the inoperable diesel generator to OPERABLE status within 72 hours (within 14 days if ACTION Statement b.4 is met) or be in HOT STANDBY within the next 6 hours and COLD SHUTDOWN within the following 30 hours.

ELECTRICAL POWER SYSTEMS

ACTION (Continued)

Inoperable Equipment	Required ACTION
<p>c. One offsite circuit</p> <p>AND</p> <p>One diesel generator</p>	<p>c.1 Perform Surveillance Requirement 4.8.1.1.1 for remaining offsite circuit within 1 hour and at least once per 8 hours thereafter.</p> <p>AND</p> <p>c.2 Demonstrate OPERABLE diesel generator is not inoperable due to common cause failure within 8 hours or perform Surveillance Requirement 4.8.1.1.2.a.2 for the OPERABLE diesel generator within 8 hours.</p> <p>AND</p> <p>c.3 Verify the steam-driven auxiliary feedwater pump is OPERABLE (MODES 1, 2, and 3 only). If this condition is not satisfied within 2 hours, be in at least HOT STANDBY within the next 6 hours and HOT SHUTDOWN within the following 6 hours.</p> <p>AND</p> <p>c.4 Restore one inoperable A.C. source to OPERABLE status within 12 hours or be in HOT STANDBY within the next 6 hours and COLD SHUTDOWN within the following 30 hours.</p> <p>AND</p> <p>c.5 Restore remaining inoperable A.C. source to OPERABLE status following the time requirements of ACTION Statements a or b above based on the initial loss of the remaining inoperable A.C. source.</p>
<p>d. Two offsite circuits</p>	<p>d.1 Restore one of the inoperable offsite sources to OPERABLE status within 24 hours or be in HOT STANDBY within the next 6 hours.</p> <p>AND</p> <p>d.2 Following restoration of one offsite source restore remaining inoperable offsite source to OPERABLE status following the time requirements of ACTION Statement a above based on the initial loss of the remaining inoperable offsite source.</p>

ELECTRICAL POWER SYSTEMS

ACTION (Continued)

Inoperable Equipment	Required ACTION
e. Two diesel generators	e.1 Perform Surveillance Requirement 4.8.1.1.1 for the offsite circuits within 1 hour and at least once per 8 hours thereafter.
	AND
	e.2 Restore one of the inoperable diesel generators to OPERABLE status within 2 hours or be in HOT STANDBY within the next 6 hours and COLD SHUTDOWN within the following 30 hours.
	AND
	e.3 Following restoration of one diesel generator restore remaining inoperable diesel generator to OPERABLE status following the time requirements of ACTION Statement b above based on the initial loss of the remaining inoperable diesel generator.

SURVEILLANCE REQUIREMENTS

4.8.1.1.1 Verify correct breaker alignment and indicated power available for each required offsite circuit at least once per 24 hours.

5.0 DESIGN FEATURES

5.1 SITE LOCATION

The Unit 2 Containment Building is located on the site at Millstone Point in Waterford, Connecticut. The nearest SITE BOUNDARY on land is 2034 feet northeast of the containment building wall (1627 feet northeast of the elevated stack), which is the minimum distance to the boundary of the exclusion area as described in 10 CFR 100.3. No part of the site that is closer than these distances shall be sold or leased except to Dominion Nuclear Connecticut, Inc. or its corporate affiliates for use in conjunction with normal utility operations.

5.2 DELETED

TABLE 6.2-1⁽³⁾

MINIMUM SHIFT-CREW COMPOSITION⁽²⁾

LICENSE CATEGORY	<u>APPLICABLE MODES</u>	
	1, 2, 3 & 4	5 & 6
Senior Reactor Operator	2	1 ⁽¹⁾
Reactor Operator	2	1
Non-Licensed Operator	2	1
Shift Technical Advisor	1 ⁽⁴⁾	None Required

- (1) Does not include the licensed Senior Reactor Operator or Senior Reactor Operator Limited to Fuel Handling individual supervising CORE ALTERATIONS after the initial fuel loading.
- (2) The above shift crew composition and the qualified radiation protection technician of Section 6.2.2 may be less than the minimum requirements for a period of time not to exceed 2 hours in order to accommodate unexpected absence provided expeditious actions are taken to fill the required position.
- (3) Requirements for minimum number of licensed operators on shift during operation in MODES other than COLD SHUTDOWN or REFUELING are contained in 10CFR50.54(m).
- (4) The Shift Technical Advisor position can be filled by either of the two Senior Reactor Operators (a dual-role individual), if he meets the Shift Technical Advisor qualifications of the Commission Policy Statement on Engineering Expertise on Shift.

ADMINISTRATIVE CONTROLS

CORE OPERATING LIMITS REPORT (CONT.)

8. XN-NF-621(P)(A), "Exxon Nuclear DNB Correlation for PWR Fuel Designs," Exxon Nuclear Company.
 9. XN-NF-82-06(P)(A), and Supplements 2, 4 and 5, "Qualification of Exxon Nuclear Fuel for Extended Burnup," Exxon Nuclear Company.
 10. ANF-88-133(P)(A) and Supplement 1, "Qualification of Advanced Nuclear Fuels PWR Design Methodology for Rod Burnups of 62 GWd/MTU," Advanced Nuclear Fuels Corporation.
 11. XN-NF-85-92(P)(A), "Exxon Nuclear Uranium Dioxide/Gadolinia Irradiation Examination and Thermal Conductivity Results," Exxon Nuclear Company.
 12. ANF-89-151(P)(A), "ANF-RELAP Methodology for Pressurized Water Reactors: Analysis of Non-LOCA Chapter 15 Events," Advanced Nuclear Fuels Corporation.
 13. EMF-1961 (P)(A), "Statistical Setpoint/Transient Methodology for Combustion Engineering Type Reactors," Siemens Power Corporation.
 14. EMF-2130(P)(A), "SRP Chapter 15 Non-LOCA Methodology for Pressurized Water Reactors," Framatome ANP.
 15. EMF-92-153(P)(A) and Supplement 1, "HTP: Departure from Nucleate Boiling Correlation for High Thermal Performance Fuel," Siemens Power Corporation.
- c. The core operating limits shall be determined so that all applicable limits (e.g., fuel thermal-mechanical limits, core thermal-hydraulic limits, ECCS limits, nuclear limits such as SHUTDOWN MARGIN, and transient and accident analysis limits) of the safety analysis are met.
- d. The CORE OPERATING LIMITS REPORT, including any mid-cycle revisions or supplements thereto, shall be provided upon issuance, for each reload cycle, to the NRC Document Control Desk with copies to the Regional Administrator and Resident Inspector.

SPECIAL REPORTS

6.9.2 Special reports shall be submitted to the U.S. Nuclear Regulatory Commission, Document Control Desk, Washington, D.C. 20555, one copy to the Regional Administrator, Region I, and one copy to the NRC Resident Inspector within the time period specified for each report. These reports shall be submitted covering the activities identified below pursuant to the requirements of the applicable reference specification:

- a. Deleted

ADMINISTRATIVE CONTROLS

6.19 CONTAINMENT LEAKAGE RATE TESTING PROGRAM

A program shall be established to implement the leakage rate testing of the primary containment as required by 10CFR50.54(o) and 10CFR50, Appendix J, Option B as modified by approved exemptions. This program shall be in accordance with the guidelines contained in Regulatory Guide 1.163, "Performance-Based Containment Leak-Test Program," dated September 1995, as modified by the following exception to NEI 94-01, Rev. 0, "Industry Performance-Based Option of 10 CFR Part 50, Appendix J": The first Type A test performed after the June 10, 1995 Type A test shall be performed no later than June 10, 2010.

The peak calculated primary Containment internal pressure for the design basis loss of coolant accident is P_a .

The maximum allowable primary containment leakage rate, L_a , at P_a , is 0.5% of primary containment air weight per day.

Leakage rate acceptance criteria are:

- a. Primary containment overall leakage rate acceptance criterion is $< 1.0 L_a$. During the first unit startup following testing in accordance with this program, the leakage rate acceptance criteria are $< 0.60 L_a$ for the combined Type B and Type C tests, and $< 0.75 L_a$ for Type A tests;
- b. Air lock testing acceptance criteria are:
 1. Overall air lock leakage rate is $\leq 0.05 L_a$ when tested at $\geq P_a$.
 2. For each door, pressure decay is ≤ 0.1 psig when pressurized to ≥ 25 psig for at least 15 minutes.

The provisions of SR 4.0.2 do not apply for test frequencies specified in the Primary Containment Leakage Rate Testing Program.

The provisions of SR 4.0.3 are applicable to the Primary Containment Leakage Rate Testing Program.

6.20 RADIOACTIVE EFFLUENT CONTROLS PROGRAM

This program conforms to 10 CFR 50.36a for the control of radioactive effluents and for maintaining the doses to members of the public from radioactive effluents as low as reasonably achievable. The program shall be contained in the REMODCM, shall be implemented by procedures, and shall include remedial actions to be taken whenever the program limits are exceeded. The program shall include the following elements:

- a. Limitations on the functional capability of radioactive liquid and gaseous monitoring instrumentation including surveillance tests and setpoint determination in accordance with the methodology in the REMODCM;
- b. Limitations on the concentrations of radioactive material released in liquid effluents to UNRESTRICTED AREAS, conforming to ten times the concentration values in Appendix B, Table 2, Column 2 to 10CFR 20.1001-20.2402;

ADMINISTRATIVE CONTROLS

6.20 RADIOACTIVE EFFLUENT CONTROLS PROGRAM

- c. Monitoring, sampling, and analysis of radioactive liquid and gaseous effluents in accordance with 10 CFR 20.1302 and with the methodology and parameters in the REMODCM;
- d. Limitations on the annual and quarterly doses or dose commitment to a member of the public from radioactive materials in liquid effluents released from each unit to UNRESTRICTED AREAS, conforming to 10 CFR 50, Appendix I;
- e. Determination of cumulative dose contributions from radioactive effluents for the current calendar quarter and current calendar year in accordance with the methodology and parameters in the REMODCM at least every 31 days. Determination of projected dose contributions from radioactive effluents in accordance with the methodology in the REMODCM at least every 31 days;
- f. Limitations on the functional capability and use of the liquid and gaseous effluent treatment systems to ensure that appropriate portions of these systems are used to reduce releases of radioactivity when the projected doses in a period of 31 days would exceed 2% of the guidelines for the annual dose or dose commitment, conforming to 10 CFR 50, Appendix I;
- g. Limitations on the dose rate resulting from radioactive material released in gaseous effluents from the site to areas at or beyond the SITE BOUNDARY shall be in accordance with the following:
 - 1. For noble gases: a dose rate ≤ 500 mrem/yr to the whole body and a dose rate ≤ 3000 mrem/yr to the skin, and
 - 2. For iodine-131, iodine 133, tritium, and all radionuclides in particulate form with half-lives greater than 8 days: a dose rate < 1500 mrem/yr to any organ;
- h. Limitations on the annual and quarterly air doses resulting from noble gases released in gaseous effluents from each unit to areas beyond the SITE BOUNDARY, conforming to 10 CFR 50, Appendix I;
- i. Limitations on the annual and quarterly doses to a member of the public from iodine-131, iodine-133, tritium, and all radionuclides in particulate form with half lives > 8 days in gaseous effluents released from each unit to areas beyond the SITE BOUNDARY, conforming to 10 CFR 50, Appendix I; and
- j. Limitations on the annual dose or dose commitment to any member of the public, beyond the SITE BOUNDARY, due to releases of radioactivity and to radiation from uranium fuel cycle sources, conforming to 40 CFR 190.

The provisions of Specification 4.0.2 and Specification 4.0.3 are applicable to the Radioactive Effluent Controls Program surveillance frequency.

INDEX

LIMITING CONDITIONS FOR OPERATION AND SURVEILLANCE REQUIREMENTS

<u>SECTION</u>	<u>PAGE</u>
3/4.0 <u>APPLICABILITY</u>	3/4 0-1
3/4.1 <u>REACTIVITY CONTROL SYSTEMS</u>	
3/4.1.1 BORATION CONTROL	
SHUTDOWN MARGIN - MODES 1 AND 2	3/4 1-1
SHUTDOWN MARGIN - MODES 3, 4, AND 5 LOOPS FILLED.....	3/4 1-3
FIGURE 3.1-1 DELETED	3/4 1-4
FIGURE 3.1-2 DELETED	3/4 1-5
FIGURE 3.1-3 DELETED	3/4 1-6
FIGURE 3.1-4 DELETED	3/4 1-7
SHUTDOWN MARGIN - COLD SHUTDOWN - Loops Not Filled.....	3/4 1-8
FIGURE 3.1-5 DELETED	3/4 1-9
Moderator Temperature Coefficient	3/4 1-10
Minimum Temperature for Criticality	3/4 1-12
3/4.1.2 BORATION SYSTEMS	
DELETED	3/4 1-13
DELETED	3/4 1-14
DELETED	3/4 1-15
DELETED	3/4 1-16
DELETED	3/4 1-17
DELETED	3/4 1-18
3/4.1.3 MOVABLE CONTROL ASSEMBLIES	
Group Height	3/4 1-20
TABLE 3.1-1 ACCIDENT ANALYSES REQUIRING REEVALUATION IN THE EVENT OF AN INOPERABLE FULL-LENGTH ROD	3/4 1-22
Position Indication Systems - Operating	3/4 1-23
MILLSTONE - UNIT 3	iv
	Amendment No. 50, 60, 99, 197, 217, 218, 229

INDEX

LIMITING CONDITIONS FOR OPERATION AND SURVEILLANCE REQUIREMENTS

<u>SECTION</u>	<u>PAGE</u>
TABLE 3.3-13 DELETED	
TABLE 4.3-9 DELETED	
3/4.3.4 DELETED	
3/4.3.5 SHUTDOWN MARGIN MONITOR.....	3/4 3-82
<u>3/4.4 REACTOR COOLANT SYSTEM</u>	
3/4.4.1 REACTOR COOLANT LOOPS AND COOLANT CIRCULATION	
Startup and Power Operation.....	3/4 4-1
HOT STANDBY.....	3/4 4-2
HOT SHUTDOWN.....	3/4 4-3
COLD SHUTDOWN - Loops Filled.....	3/4 4-5
COLD SHUTDOWN - Loops Not Filled.....	3/4 4-6
Loop Stop Valves.....	3/4 4-7
Isolated Loop Startup.....	3/4 4-8
3/4.4.2 SAFETY VALVES.....	3/4 4-9
DELETED.....	3/4 4-10
3/4.4.3 PRESSURIZER	
Startup and Power Operation.....	3/4 4-11
FIGURE 3.4-5 PRESSURIZER LEVEL CONTROL.....	3/4 4-11a
Hot Standby.....	3/4 4-11b
3/4.4.4 RELIEF VALVES.....	3/4 4-12
3/4.4.5 STEAM GENERATORS.....	3/4 4-14
TABLE 4.4-1 MINIMUM NUMBER OF STEAM GENERATORS TO BE INSPECTED DURING INSERVICE INSPECTION.....	3/4 4-19
TABLE 4.4-2 STEAM GENERATOR TUBE INSPECTION.....	3/4 4-20
3/4.4.6 REACTOR COOLANT SYSTEM LEAKAGE	
Leakage Detection Systems.....	3/4 4-21
Operational Leakage.....	3/4 4-22
TABLE 3.4-1 REACTOR COOLANT SYSTEM PRESSURE ISOLATION VALVES ..	3/4 4-24
3/4.4.7 DELETED.....	3/4 4-25
TABLE 3.4-2 DELETED.....	3/4 4-26
TABLE 4.4-3 DELETED.....	3/4 4-27
3/4.4.8 SPECIFIC ACTIVITY.....	3/4 4-28

INDEX

LIMITING CONDITIONS FOR OPERATION AND SURVEILLANCE REQUIREMENTS

<u>SECTION</u>	<u>PAGE</u>
FIGURE 3.4-1 DOSE EQUIVALENT I-131 REACTOR COOLANT SPECIFIC ACTIVITY LIMIT VERSUS PERCENT OF RATED THERMAL POWER WITH THE REACTOR COOLANT SPECIFIC ACTIVITY >1 μ Ci/gram DOSE EQUIVALENT I-131	3/4 4-30
TABLE 4.4-4 REACTOR COOLANT SPECIFIC ACTIVITY SAMPLE AND ANALYSIS PROGRAM	3/4 4-31
3/4.4.9 PRESSURE/TEMPERATURE LIMITS	3/4 4-33
FIGURE 3.4-2 REACTOR COOLANT SYSTEM HEATUP LIMITATIONS - APPLICABLE UP TO 10 EFY	3/4 4-34
FIGURE 3.4-3 REACTOR COOLANT SYSTEM COOLDOWN LIMITATIONS - APPLICABLE UP TO 10 EFY	3/4 4-35
TABLE 4.4-5 DELETED	3/4 4-36
DELETED	3/4 4-37
Overpressure Protection Systems	3/4 4-38
FIGURE 3.4-4a High Setpoint PORV Curve For the Cold Overpressure Protection System.....	3/4 4-40
FIGURE 3.4-4b Low Setpoint PORV Curve For the Cold Overpressure Protection System.....	3/4 4-41
3/4.4.10 DELETED	3/4 4-42
3/4.4.11 DELETED	3/4 4-43
<u>3/4.5 EMERGENCY CORE COOLING SYSTEMS</u>	
3/4.5.1 ACCUMULATORS	3/4 5-1
3/4.5.2 ECCS SUBSYSTEMS - T _{avg} GREATER THAN OR EQUAL TO 350°F	3/4 5-3
3/4.5.3 ECCS SUBSYSTEMS - T _{avg} LESS THAN 350°F	3/4 5-7
3/4.5.4 REFUELING WATER STORAGE TANK.....	3/4 5-9
3/4.5.5 pH TRISODIUM PHOSPHATE STORAGE BASKETS	3/4 5-10
<u>3/4.6 CONTAINMENT SYSTEMS</u>	
3/4.6.1 PRIMARY CONTAINMENT	
Containment Integrity	3/4 6-1
Containment Leakage	3/4 6-2
Containment Air Locks.....	3/4 6-5
Containment Pressure	3/4 6-7

INDEX

ADMINISTRATIVE CONTROLS

<u>SECTION</u>	<u>PAGE</u>
<u>6.8 PROCEDURES AND PROGRAMS</u>	6-14
<u>6.9 REPORTING REQUIREMENTS</u>	6-17
6.9.1 ROUTINE REPORTS	6-17
Startup Report	6-17
Annual Reports	6-18
Annual Radiological Environmental Operating Report	6-19
Annual Radioactive Effluent Release Report	6-19
CORE OPERATING LIMITS REPORT	6-19a
6.9.2 SPECIAL REPORTS	6-21
<u>6.10 DELETED</u>	
<u>6.11 RADIATION PROTECTION PROGRAM</u>	6-21
<u>6.12 HIGH RADIATION AREA</u>	6-21
<u>6.13 RADIOLOGICAL EFFLUENT MONITORING AND OFFSITE DOSE CALCULATION MANUAL (REMDCM)</u>	6-24
<u>6.14 RADIOACTIVE WASTE TREATMENT</u>	6-24
<u>6.15 RADIOACTIVE EFFLUENT CONTROLS PROGRAM</u>	6-25
<u>6.16 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM</u>	6-26
<u>6.17 REACTOR COOLANT PUMP FLYWHEEL INSPECTION PROGRAM</u>	6-26
<u>6.18 TECHNICAL SPECIFICATIONS (TS) BASES CONTROL PROGRAM</u>	6-26
<u>6.19 COMPONENT CYCLIC OR TRANSIENT LIMIT</u>	6-27

3/4.1 REACTIVITY CONTROL SYSTEMS

3/4.1.1.1 BORATION CONTROL

SHUTDOWN MARGIN - MODES 1 AND 2

LIMITING CONDITION FOR OPERATION

3.1.1.1.1 The SHUTDOWN MARGIN shall be within the limits specified in the CORE OPERATING LIMITS REPORT (COLR).

APPLICABILITY: MODES 1 and 2*.

ACTION:

With the SHUTDOWN MARGIN not within the limits specified in the COLR, immediately initiate and continue boration at greater than or equal to 33 gpm of a solution containing greater than or equal to 6600 ppm boron or equivalent until the required SHUTDOWN MARGIN is restored.

SURVEILLANCE REQUIREMENTS

4.1.1.1.1 The SHUTDOWN MARGIN shall be determined to be within the limits specified in the COLR:

- a. Within 1 hour after detection of an inoperable control rod(s) and at least once per 12 hours thereafter while the rod(s) is inoperable. If the inoperable control rod is immovable or untrippable, the above required SHUTDOWN MARGIN shall be verified acceptable with an increased allowance for the withdrawn worth of the immovable or untrippable control rod(s);
- b. When in MODE 1 or MODE 2 with K_{eff} greater than or equal to 1 at least once per 12 hours by verifying that control bank withdrawal is within the limits of Specification 3.1.3.6;
- c. When in MODE 2 with K_{eff} less than 1, within 4 hours prior to achieving reactor criticality by verifying that the predicted critical control rod position is within the limits of Specification 3.1.3.6;
- d. Prior to initial operation above 5% RATED THERMAL POWER after each fuel loading, by consideration of the factors of Specification 4.1.1.1.2, with the control banks at the maximum insertion limit of Specification 3.1.3.6; and

* See Special Test Exceptions Specification 3.10.1.

3/4.1 REACTIVITY CONTROL SYSTEMS

3/4.1.1 BORATION CONTROL

SHUTDOWN MARGIN - MODES 3, 4 AND 5 LOOPS FILLED

LIMITING CONDITION FOR OPERATION

3.1.1.1.2 The SHUTDOWN MARGIN shall be within the limits specified in the CORE OPERATING LIMITS REPORT (COLR).*

APPLICABILITY: MODES 3, 4 and 5

ACTION:

With the SHUTDOWN MARGIN less than the required value, immediately initiate and continue boration at greater than or equal to 33 gpm of a solution containing greater than or equal to 6600 ppm boron or equivalent until the required SHUTDOWN MARGIN is restored.

SURVEILLANCE REQUIREMENTS

4.1.1.1.2.1 The SHUTDOWN MARGIN shall be determined to be within the limits specified in the COLR:

- a. Within 1 hour after detection of an inoperable control rod(s) and at least once per 12 hours thereafter while the rod(s) is inoperable. If the inoperable control rod is immovable or untrippable, the above required SHUTDOWN MARGIN shall be verified acceptable with an increased allowance for the withdrawn worth of the immovable or untrippable control rod(s); and
- b. At least once per 24 hours by consideration of the following factors:
 1. Reactor Coolant System boron concentration,
 2. Control rod position,
 3. Reactor Coolant System average temperature,
 4. Fuel burnup based on gross thermal energy generation,
 5. Xenon concentration, and
 6. Samarium concentration.

4.1.1.1.2.2 Valve 3CHS*V305 shall be verified closed and locked at least once per 31 days.

* Additional SHUTDOWN MARGIN requirements, if required, are given in Specification 3.3.5.

REACTIVITY CONTROL SYSTEMS

POSITION INDICATION SYSTEMS - OPERATING

LIMITING CONDITION FOR OPERATION

3.1.3.2 The Digital Rod Position Indication System and the Demand Position Indication System shall be OPERABLE and capable of determining the control rod positions within ± 12 steps.

APPLICABILITY: MODES 1 and 2.

ACTION:

- a. With a maximum of one digital rod position indicator per bank inoperable:
 1. Determine the position of the nonindicating rod(s) indirectly by the movable incore detectors at least once per 8 hours and immediately after any motion of the nonindicating rod which exceeds 24 steps in one direction since the last determination of the rod's position, or
 2. Reduce THERMAL POWER to less than 50% of RATED THERMAL POWER within 8 hours.
- b. With a maximum of one demand position indicator per bank inoperable:
 1. Verify that all digital rod position indicators for the affected bank are OPERABLE and that the most withdrawn rod and the least withdrawn rod of the bank are within a maximum of 12 steps of each other at least once per 8 hours, or
 2. Reduce THERMAL POWER to less than 50% of RATED THERMAL POWER within 8 hours.

SURVEILLANCE REQUIREMENTS

4.1.3.2.1 Each digital rod position indicator shall be determined to be OPERABLE by verifying that the Demand Position Indication System and the Digital Rod Position Indication System agree within 12 steps at least once per 12 hours except during time intervals when the rod position deviation monitor is inoperable, then compare the Demand Position Indication System and the Digital Rod Position Indication System at least once per 4 hours.

4.1.3.2.2 Each of the above required digital rod position indicator(s) shall be determined to be OPERABLE by verifying that the digital rod position indicators agree with the demand position indicators within 12 steps when exercised over the full-range of rod travel at least once per 24 months.

REACTIVITY CONTROL SYSTEMS

SHUTDOWN ROD INSERTION LIMITS

LIMITING CONDITION FOR OPERATION

3.1.3.5 All shutdown rods shall be limited in physical insertion as specified in the CORE OPERATING LIMITS REPORT (COLR).

APPLICABILITY: MODES 1* and 2* **.

ACTION:

With a maximum of one shutdown rod inserted beyond the insertion limits specified in the COLR except for surveillance testing pursuant to Specification 4.1.3.1.2, within 1 hour either:

- a. Restore the rod to within the limit specified in the COLR, or
- b. Declare the rod to be inoperable and apply Specification 3.1.3.1.

SURVEILLANCE REQUIREMENTS

4.1.3.5 Each shutdown rod shall be determined to be within the insertion limits specified in the COLR:

- a. Within 15 minutes prior to withdrawal of any rods in Control Bank A, B, C, or D during an approach to reactor criticality, and
- b. At least once per 12 hours thereafter.

* See Special Test Exceptions Specifications 3.10.2 and 3.10.3.

** With K_{eff} greater than or equal to 1.

REACTIVITY CONTROL SYSTEMS

CONTROL ROD INSERTION LIMITS

LIMITING CONDITION FOR OPERATION

3.1.3.6 The control banks shall be limited in physical insertion as specified in the CORE OPERATING LIMITS REPORT (COLR).

APPLICABILITY: MODES 1* and 2* **.

ACTION:

With the control banks inserted beyond the insertion limits specified in the COLR, except for surveillance testing pursuant to Specification 4.1.3.1.2:

- a. Restore the control banks to within the limits within 2 hours, or
- b. Reduce THERMAL POWER within 2 hours to less than or equal to that fraction of RATED THERMAL POWER which is allowed by the bank position using the insertion limits specified in the COLR, or
- c. Be in at least HOT STANDBY within the next 6 hours.

SURVEILLANCE REQUIREMENTS

4.1.3.6 The position of each control bank shall be determined to be within the insertion limits at least once per 12 hours except during time intervals when the rod insertion limit monitor is inoperable, then verify the individual rod positions at least once per 4 hours.

* See Special Test Exceptions Specifications 3.10.2 and 3.10.3.

** With K_{eff} greater than or equal to 1.

POWER DISTRIBUTION LIMITS

3/4.2.2 HEAT FLUX HOT CHANNEL FACTOR - $F_Q(Z)$

LIMITING CONDITION FOR OPERATION

3.2.2.1 $F_Q(Z)$ shall be limited by the following relationships:

$$F_Q(Z) \leq \frac{F_Q^{RTP}}{P} K(Z) \text{ for } P > 0.5$$

$$F_Q(Z) \leq \frac{F_Q^{RTP}}{0.5} K(Z) \text{ for } P \leq 0.5$$

F_Q^{RTP} = the F_Q limit at RATED THERMAL POWER (RTP) provided in the CORE OPERATING LIMITS REPORT (COLR).

Where: $P = \frac{\text{THERMAL POWER}}{\text{RATED THERMAL POWER}}$, and

$K(Z)$ = the normalized $F_Q(Z)$ as a function of core height specified in the COLR.

APPLICABILITY: MODE 1.

ACTION:

With $F_Q(Z)$ exceeding its limit:

- a. For RAOC operation with Specification 4.2.2.1.2.b not being satisfied or for base load operation with Specification 4.2.2.1.4.b not being satisfied:
 - (1) Reduce THERMAL POWER at least 1% for each 1% $F_Q(Z)$ exceeds the limit within 15 minutes and similarly reduce the Power Range Neutron Flux-High Trip Setpoints within the next 4 hours; POWER OPERATION may proceed for up to a total of 72 hours; subsequent POWER OPERATION may proceed provided the Overpower ΔT Trip setpoints have been reduced at least 1% for each 1% $F_Q(Z)$ exceeds the limit, and

POWER DISTRIBUTION LIMITS

LIMITING CONDITION FOR OPERATION (Continued)

- (2) Identify and correct the cause of the out-of-limit condition prior to increasing THERMAL POWER above the reduced limit required by item (1) above; THERMAL POWER may then be increased provided $F_Q(Z)$ is demonstrated through incore mapping to be within its limits.
- b. For RAOC operation with Specification 4.2.2.1.2.c not being satisfied, one of the following ACTIONS shall be taken:
- (1) Within 15 minutes, control the AFD to within new AFD limits which are determined by reducing the AFD limits specified in the CORE OPERATING LIMITS REPORT by at least 1% AFD for each percent $F_Q(Z)$ exceeds its limits. Within 8 hours, reset the AFD alarm setpoints to these modified limits, or
- (2) Verify that the requirements of Specification 4.2.2.1.3 for base load operation are satisfied and enter base load operation.

Where it is necessary to calculate the percent that $F_Q(Z)$ exceeds the limits for item (1) above, it shall be calculated as the maximum percent over the core height (Z), consistent with Specification 4.2.2.1.2.f, that $F_Q(Z)$ exceeds its limit by the following expression:

$$\left[\frac{\frac{F_Q^M(Z) \times W(Z)}{F_Q^{RTP}}}{\frac{F_Q}{P} \times K(Z)} - 1 \right] \times 100 \text{ for } P > 0.5$$

$$\left[\frac{\frac{F_Q^M(Z) \times W(Z)}{F_Q^{RTP}}}{\frac{F_Q}{0.5} \times K(Z)} - 1 \right] \times 100 \text{ for } P \leq 0.5$$

- c. For base load operation with Specification 4.2.2.1.4.c not being satisfied, one of the following ACTIONS shall be taken:
- (1) Place the core in an equilibrium condition where the limit in 4.2.2.1.4.c is satisfied, and remeasure $F_Q^M(Z)$, or

POWER DISTRIBUTION LIMITS

SURVEILLANCE REQUIREMENTS (Continued)

- c. Satisfying the following relationship:

$$F_Q^M(Z) \leq \frac{F_Q^{RTP} \times K(Z)}{P \times W(Z)} \text{ for } P > 0.5$$

$$F_Q^M(Z) \leq \frac{F_Q^{RTP} \times K(Z)}{W(Z) \times 0.5} \text{ for } P \leq 0.5$$

where $F_Q^M(Z)$ is the measured $F_Q(Z)$ increased by the allowances for manufacturing tolerances and measurement uncertainty, F_Q^{RTP} is the F_Q limit, $K(Z)$ is the normalized $F_Q(Z)$ as a function of core height, P is the relative THERMAL POWER, and $W(Z)$ is the cycle-dependent function that accounts for power distribution transients encountered during normal operation. F_Q^{RTP} , $K(Z)$, and $W(Z)$ are specified in the CORE OPERATING LIMITS REPORT as per Specification 6.9.1.6.

- d. Measuring $F_Q^M(Z)$ according to the following schedule:
- (1) Upon achieving equilibrium conditions after exceeding by 10% or more of RATED THERMAL POWER, the THERMAL POWER at which $F_Q(Z)$ was last determined,*** or
 - (2) At least once per 31 Effective Full Power Days, whichever occurs first.
- e. With the maximum value of

$$\frac{F_Q^M(Z)}{K(Z)}$$

over the core height (Z) increasing since the previous determination of $F_Q^M(Z)$, either of the following ACTIONS shall be taken:

- (1) Increase $F_Q^M(Z)$ by an appropriate factor specified in the COLR and verify that this value satisfies the relationship in Specification 4.2.2.1.2.c, or

*** During power escalation at the beginning of each cycle, power level may be increased until a power level for extended operation has been achieved and power distribution map outlined.

POWER DISTRIBUTION LIMITS

SURVEILLANCE REQUIREMENTS (Continued)

- b. During base load operation, if the THERMAL POWER is decreased below APL^{ND} then the conditions of 4.2.2.1.3.a shall be satisfied before reentering base load operation.

4.2.2.1.4 During base load operation $F_Q(Z)$ shall be evaluated to determine if $F_Q(Z)$ is within its limit by:

- a. Using the movable incore detectors to obtain a power distribution map at any THERMAL POWER above APL^{ND} .
- b. Evaluate the computed heat flux hot channel factor by performing both of the following:
 - (1) Determine the computed heat flux hot channel factor, $F_Q^M(Z)$, by increasing the measured $F_Q^M(Z)$ component of the power distribution map by 3% to account for manufacturing tolerances and further increase the value by 5% to account for measurement uncertainties, and
 - (2) Verify that $F_Q^M(Z)$ satisfies the requirements of Specification 3.2.2.1 for all core plane regions, i.e., 0 - 100% inclusive.
- c. Satisfying the following relationship:

$$F_Q^M(Z) \leq \frac{F_Q^{RTP} \times K(Z)}{P \times W(Z)_{BL}} \text{ for } P > APL^{ND}$$

where: $F_Q^M(Z)$ is the measured $F_Q(Z)$ increased by the allowances for manufacturing tolerances and measurement uncertainty, F_Q^{RTP} is the F_Q limit, $K(Z)$ is the normalized $F_Q(Z)$ as a function of core height, P is the relative THERMAL POWER, and $W(Z)_{BL}$ is the cycle-dependent function that accounts for limited power distribution transients encountered during base load operation. F_Q^{RTP} , $K(Z)$, and $W(Z)_{BL}$ are specified in the COLR as per Specification 6.9.1.6.

- d. Measuring $F_Q^M(Z)$ in conjunction with target flux difference determination according to the following schedule:
 - (1) Prior to entering base load operation after satisfying Section 4.2.2.1.3 unless a full core flux map has been taken in the previous 31 EFPD with the relative THERMAL POWER having been maintained above APL^{ND} for the 24 hours prior to mapping, and
 - (2) At least once per 31 Effective Full Power Days.

POWER DISTRIBUTION LIMITS

SURVEILLANCE REQUIREMENTS (Continued)

- e. With the maximum value of

$$\frac{F_Q^M(Z)}{K(Z)}$$

over the core height (Z) increasing since the previous determination of $F_Q^M(Z)$, either of the following ACTIONS shall be taken:

- 1) Increase $F_Q^M(Z)$ by appropriate factor specified in the COLR and verify that this value satisfies the relationship in Specification 4.2.2.1.4.c, or
- 2) $F_Q^M(Z)$ shall be measured at least once per 7 Effective Full Power Days until 2 successive maps indicate that the maximum value of

$$\frac{F_Q^M(Z)}{K(Z)}$$

over the core height (Z) is not increasing.

- f. The limits specified in 4.2.2.1.4.c and 4.2.2.1.4.e are not applicable in the following core plane regions:

- 1) Lower core region 0% to 15%, inclusive.
- 2) Upper core region 85% to 100%, inclusive.

4.2.2.1.5 When $F_Q(Z)$ is measured for reasons other than meeting the requirements of Specifications 4.2.2.1.2 or 4.2.2.1.4, an overall measured $F_Q(Z)$ shall be obtained from a power distribution map and increased by 3% to account for manufacturing tolerances and further increased by 5% to account for measurement uncertainty.

TABLE 3.3-1
REACTOR TRIP SYSTEM INSTRUMENTATION

MILLSTONE - UNIT 3	FUNCTIONAL UNIT	TOTAL NO. OF CHANNELS	CHANNELS TO TRIP	MINIMUM CHANNELS OPERABLE	APPLICABLE MODES	ACTION	
3/4 3-2	1. Manual Reactor Trip	2	1	2	1, 2	1	
		2	1	2	3*, 4*, 5*	11	
	2. Power Range, Neutron Flux						
	a. High Setpoint	4	2	3	1, 2	2	
	b. Low Setpoint	4	2	3	1###, 2	2	
	3. Power Range, Neutron Flux High Positive Rate	4	2	3	1, 2	2	
	4. Deleted						
	5. Intermediate Range, Neutron Flux	2	1	2	1###, 2	3	
	6. Source Range, Neutron Flux						
	a. STARTUP	2	1	2	2##	4	
	b. Shutdown	2	1	2	3*, 4*, 5*	11	
Amendment No. 57, 60, 116, 217, 229	7. Overtemperature ΔT	4	2	3	1, 2	6	
	8. Overpower ΔT	4	2	3	1, 2	6	
	9. Pressurizer Pressure--Low	4	2	3	1**	6 (1)	
	10. Pressurizer Pressure--High	4	2	3	1, 2	6 (1)	
	11. Pressurizer Water Level--High	3	2	2	1**	6	

TABLE 3.3-1 (Continued)

ACTION STATEMENTS (Continued)

- ACTION 9- (Not used)
- ACTION 10- With the number of OPERABLE channels one less than the Minimum Channels OPERABLE requirement, be in at least HOT STANDBY within 6 hours; however, one channel may be bypassed for up to 2 hours for surveillance testing per Specification 4.3.1.1, provided the other channel is OPERABLE.
- ACTION 11- With the number of OPERABLE channels one less than the Minimum Channels OPERABLE requirement, restore the inoperable channel to OPERABLE status within 48 hours or open the Reactor Trip System breakers within the next hour.
- ACTION 12- With the number of OPERABLE channels one less than the Total Number of Channels, STARTUP and/or POWER OPERATION may proceed provided the following conditions are satisfied:
- a. The inoperable channel is placed in the tripped condition within 6 hours, and
 - b. When the Minimum Channels OPERABLE requirement is met, the inoperable channel may be bypassed for up to 4 hours for surveillance testing of the Turbine Control Valves.
- ACTION 13- With one of the diverse trip features (undervoltage or shunt trip attachments) inoperable, restore it to OPERABLE status within 48 hours or declare the breaker inoperable and apply ACTION 10. The breaker shall not be bypassed while one of the diverse trip features is inoperable except for the time required for performing maintenance to restore the breaker to OPERABLE status.
- ACTION 13A- With the number of OPERABLE channels one less than the Minimum Channels OPERABLE requirement, restore the inoperable Channel to OPERABLE status within 6 hours or be in at least HOT STANDBY within the next 6 hours; however, one channel may be bypassed for up to 4 hours for surveillance testing per Specification 4.3.1.1, provided the other channel is OPERABLE.

TABLE 4.3-2 (Continued)

TABLE NOTATION

1. Each train shall be tested at least every 62 days on a STAGGERED TEST BASIS.
 2. This surveillance may be performed continuously by the emergency generator load sequencer auto test system as long as the EGLS auto test system is demonstrated OPERABLE by the performance of an ACTUATION LOGIC TEST at least once per 92 days.
 3. On a monthly basis, a loss of voltage condition will be initiated at each undervoltage monitoring relay to verify individual relay operation. Setpoint verification and actuation of the associated logic and alarm relays will be performed as part of the CHANNEL CALIBRATION required once per 18 months.
 4. For Engineered Safety Features Actuation System functional units with only Potter & Brumfield MDR series relays used in a clean, environmentally controlled cabinet, as discussed in Westinghouse Owners Group Report WCAP- 13900, the surveillance interval for slave relay testing is R.
- * MODES 1, 2, 3, 4, 5 and 6.
During fuel movement within containment or the spent fuel pool.

TABLE 3.3-6 (Continued)

TABLE NOTATIONS

- * With fuel in the fuel storage pool areas.

ACTION STATEMENTS

ACTION 28 - With less than the Minimum Channels OPERABLE requirement, fuel movement may continue for up to 30 days provided an appropriate portable continuous monitor with the same Alarm Setpoint is provided in the fuel storage pool area. Restore the inoperable monitors to OPERABLE status within 30 days or suspend all operations involving fuel movement in the fuel storage pool areas.

ACTION 29 - With the number of OPERABLE Channels less than the Minimum Channels OPERABLE requirement, comply with the ACTION requirements of Specification 3.4.6.1.

TABLE 3.3-10 (Continued)
ACCIDENT MONITORING INSTRUMENTATION

<u>INSTRUMENT</u>	<u>TOTAL NO. OF CHANNELS</u>	<u>MINIMUM CHANNELS OPERABLE</u>
16. Containment Area - High Range Radiation Monitor	2	1
17. Reactor Vessel Water Level	2*	1*
18. Deleted		
19. Neutron Flux	2	1

* A channel consists of eight sensors in a probe. A channel is OPERABLE if four or more sensors, half or more in the upper head region and half or more in the upper plenum region, are OPERABLE.

INSTRUMENTATION

3/4.3.5 SHUTDOWN MARGIN MONITOR

LIMITING CONDITION FOR OPERATION

- 3.3.5 Two channels of Shutdown Margin Monitors shall be OPERABLE
- a. With a minimum count rate as designated in the CORE OPERATING LIMITS REPORT (COLR), or
 - b. If the minimum count rate in Specification 3.3.5.a cannot be met, then the Shutdown Margin Monitors may be made OPERABLE with a lower minimum count rate, as specified in the COLR, by borating the Reactor Coolant System above the requirements of Specification 3.1.1.1.2 or 3.1.1.2. The additional boration shall be:
 1. A minimum of 150 ppm above the SHUTDOWN MARGIN requirements specified in the COLR for MODE 3, or
 2. A minimum of 350 ppm above the SHUTDOWN MARGIN requirements specified in the COLR for MODE 4, MODE 5 with RCS loops filled, and MODE 5 with RCS loops not filled.

APPLICABILITY: MODES 3*, 4, and 5.

ACTION:

- a. With one Shutdown Margin Monitor inoperable, restore the inoperable channel to OPERABLE status within 48 hours.
- b. With both Shutdown Margin Monitors inoperable or one Shutdown Margin Monitor inoperable for greater than 48 hours, immediately suspend all operations involving positive reactivity changes via dilution and rod withdrawal. Verify the valves listed in Specification 4.1.1.2.2 are closed and secured in position within the next 4 hours and at least once per 14 days thereafter.** Verify compliance with the SHUTDOWN MARGIN requirements of Specification 3.1.1.1.2 or 3.1.1.2, as applicable, within 1 hour and at least once per 12 hours thereafter.

* The shutdown margin monitors may be blocked during reactor startup in accordance with approved plant procedures.

** The valves may be opened on an intermittent basis under administrative controls as noted in Surveillance 4.1.1.2.2.

INSTRUMENTATION

3/4.3.5 SHUTDOWN MARGIN MONITOR (continued)

SURVEILLANCE REQUIREMENTS

- 4.3.5 a. Each of the above required shutdown margin monitoring instruments shall be demonstrated OPERABLE by an ANALOG CHANNEL OPERATIONAL TEST at least once per 92 days that shall include verification that the Shutdown Margin Monitor is set per the CORE OPERATING LIMITS REPORT (COLR).
- b. At least once per 24 hours VERIFY the minimum count rate (counts/sec) as defined within the COLR.

REACTOR COOLANT SYSTEM

LOOP STOP VALVES

LIMITING CONDITION FOR OPERATION

3.4.1.5 Each RCS loop stop valve shall be open and the power removed from the valve operator.

APPLICABILITY: MODES 1, 2, 3 and 4.

ACTION:

- a. With power available to one or more loop stop valve operators, remove power from the loop stop valve operators within 30 minutes or be in HOT STANDBY within the next 6 hours and COLD SHUTDOWN within the following 30 hours.
- b.⁽¹⁾ With one or more RCS loop stop valves closed, maintain the valve(s) closed and be in HOT STANDBY within 6 hours and COLD SHUTDOWN within the next 30 hours.

SURVEILLANCE REQUIREMENTS

4.4.1.5 Verify each RCS loop stop valve is open and the power removed from the valve operator at least once per 31 days.

⁽¹⁾ All required ACTIONS of ACTION Statement 3.4.1.5.b shall be completed whenever this action is entered.

REACTOR COOLANT SYSTEM

ISOLATED LOOP STARTUP

LIMITING CONDITION FOR OPERATION

3.4.1.6 A reactor coolant loop shall remain isolated with power removed from the associated RCS loop stop valve operators until:

- a. The temperature at the cold leg of the isolated loop is within 20°F of the highest cold leg temperature of the operating loops, and
- b. The boron concentration of the isolated loop is greater than or equal to the boron concentration required by Specifications 3.1.1.1.2 or 3.1.1.2 for MODE 5 or Specification 3.9.1.1 for MODE 6.

APPLICABILITY: MODES 5 and 6.

ACTION:

- a. With the requirements of the above specification not satisfied, do not open the isolated loop stop valves.

SURVEILLANCE REQUIREMENTS

4.4.1.6.1 The isolated loop cold leg temperature shall be determined to be within 20°F of the highest cold leg temperature of the operating loops within 30 minutes prior to opening the cold leg stop valve.

4.4.1.6.2 The isolated loop boron concentration shall be determined to be greater than or equal to the boron concentration required by Specifications 3.1.1.1.2 or 3.1.1.2 for MODE 5 or Specification 3.9.1.1 for MODE 6 within 2 hours prior to opening the hot or cold leg stop valve.

REACTOR COOLANT SYSTEM

3/4.4.4 RELIEF VALVES

LIMITING CONDITION FOR OPERATION

3.4.4. Both power-operated relief valves (PORVs) and their associated block valves shall be OPERABLE.

APPLICABILITY: MODES 1, 2, and 3.

ACTION:

- a. With one or both PORV(s) inoperable because of excessive seat leakage, within 1 hour either restore the PORV(s) to OPERABLE status or close the associated block valve(s) with power maintained to the block valve(s); otherwise, be in at least HOT STANDBY within the next 6 hours and in HOT SHUTDOWN within the following 6 hours.
- b. With one PORV inoperable due to causes other than excessive seat leakage, within 1 hour either restore the PORV to OPERABLE status or close the associated block valve and remove power from the block valve; restore the PORV to OPERABLE status within the following 72 hours or be in HOT STANDBY within the next 6 hours and in HOT SHUTDOWN within the following 6 hours.
- c. With both PORVs inoperable due to causes other than excessive seat leakage, within 1 hour either restore at least one PORV to OPERABLE status or close its associated block valve and remove power from the block valve and be in HOT STANDBY within the next 6 hours and in HOT SHUTDOWN within the following 6 hours.
- d. With one or both block valve(s) inoperable, within 1 hour restore the block valve(s) to OPERABLE status, or place its associated PORV(s) control switch to "CLOSE." Restore at least one block valve to OPERABLE status within the next hour if both block valves are inoperable; restore any remaining inoperable block valve to OPERABLE status within 72 hours; otherwise, be in at least HOT STANDBY within the next 6 hours and in HOT SHUTDOWN within the following 6 hours.
- e. Entry into an OPERATIONAL MODE is permitted while subject to these ACTION requirements.

TABLE 4.4-2
STEAM GENERATOR TUBE INSPECTION

1ST SAMPLE INSPECTION			2ND SAMPLE INSPECTION		3RD SAMPLE INSPECTION	
Sample Size	Result	ACTION Required	Result	ACTION Required	Result	ACTION Required
A minimum of S Tubes per S.G.	C-1	None	N.A.	N.A.	N.A.	N.A.
	C-2	Plug defective tubes and inspect additional 2S tubes in this S.G.	C-1	None	N.A.	N.A.
			C-2	Plug defective tubes and inspect additional 4S tubes in this S.G.	C-1	None
					C-2	Plug defective tubes
					C-3	Perform ACTION for C-3 result of first sample
			C-3	Perform ACTION for C-3 result of first sample	N.A.	N.A.
	C-3	Inspect all tubes in this S.G., plug de- fective tubes and inspect 2S tubes in each other S.G. Notification to NRC pursuant to §50.72 (b)(2) of 10 CFR Part 50	All other S.G.s are C-1	None	N.A.	N.A.
			Some S.G.s C-2 but no additional S.G. are C-3	Perform ACTION for C-2 result of second sample	N.A.	N.A.
			Additional S.G. is C-3	Inspect all tubes in each S.G. and plug defective tubes. Notification to NRC pursuant to §50.72 (b)(2) of 10 CFR Part 50	N.A.	N.A.

$S = 3 \frac{N}{n} \%$ Where N is the number of steam generators in the unit, and n is the number of steam generators inspected during an inspection

REACTOR COOLANT SYSTEM

3/4.4.6 REACTOR COOLANT SYSTEM LEAKAGE

LEAKAGE DETECTION SYSTEMS

LIMITING CONDITION FOR OPERATION

3.4.6.1 The following Reactor Coolant System Leakage Detection Systems shall be OPERABLE:

- a. Either the Containment Atmosphere Gaseous or Particulate Radioactivity Monitoring System, and
- b. The Containment Drain Sump Level or Pumped Capacity Monitoring System

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

- a. With both the Containment Atmosphere Gaseous and Particulate Radioactivity Monitors inoperable, operation may continue for up to 30 days provided the Containment Drain Sump Level or Pumped Capacity Monitoring System is OPERABLE and gaseous grab samples of the containment atmosphere are obtained at least once per 12 hours and analyzed for gross noble gas activity within the subsequent 2 hours; otherwise, be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
- b. With the Containment Drain Sump Level or Pumped Capacity Monitoring System inoperable, operation may continue for up to 30 days provided either the Containment Atmosphere Gaseous or Particulate Radioactivity Monitoring System is OPERABLE; otherwise, be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

SURVEILLANCE REQUIREMENTS

4.4.6.1 The Leakage Detection Systems shall be demonstrated OPERABLE by:

- a. Containment Atmosphere Gaseous and Particulate Radioactivity Monitoring Systems-performance of CHANNEL CHECK, CHANNEL CALIBRATION, and ANALOG CHANNEL OPERATIONAL TEST at the frequencies specified in Table 4.3-3, and
- b. Containment Drain Sump Level and Pumped Capacity Monitoring System-performance of CHANNEL CALIBRATION at least once per 24 months.

3/4.8 ELECTRICAL POWER SYSTEMS

3/4.8.1 A.C. SOURCES

OPERATING

LIMITING CONDITION FOR OPERATION

3.8.1.1 As a minimum, the following A.C. electrical power sources shall be OPERABLE:

- a. Two physically independent circuits between the offsite transmission network and the onsite Class 1E Distribution System, and
- b. Two separate and independent diesel generators, each with:
 - 1) A separate day tank containing a minimum volume of 278 gallons of fuel,
 - 2) A separate Fuel Storage System containing a minimum volume of 32,760 gallons of fuel,
 - 3) A separate fuel transfer pump,
 - 4) Lubricating oil storage containing a minimum total volume of 280 gallons of lubricating oil, and
 - 5) Capability to transfer lubricating oil from storage to the diesel generator unit.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION: :

Inoperable Equipment	Required ACTION
a. One offsite circuit	<p>a.1 Perform Surveillance Requirement 4.8.1.1.1.a for remaining offsite circuit within 1 hour prior to or after entering this condition, and at least once per 8 hours thereafter.</p> <p>AND</p> <p>a.2 Restore the inoperable offsite circuit to OPERABLE status within 72 hours or be in at least HOT STANDBY within the next 6 hours and COLD SHUTDOWN within the following 30 hours.</p>
b. One diesel generator	<p>b.1 Perform Surveillance Requirement 4.8.1.1.1.a for the offsite circuits within 1 hour prior to or after entering this condition, and at least once per 8 hours thereafter.</p> <p>AND</p> <p>b.2 Demonstrate OPERABLE diesel generator is not inoperable due to common cause failure within 24 hours or perform Surveillance Requirement 4.8.1.1.2.a.5 for the OPERABLE diesel generator within 24 hours.</p> <p>AND</p>

ELECTRICAL POWER SYSTEMS

LIMITING CONDITION FOR OPERATION

ACTION (continued)

Inoperable Equipment	Required ACTION
b. One diesel generator	<p>b.3 Verify all required systems, subsystems, trains, components, and devices that depend on the remaining OPERABLE diesel generator as a source of emergency power are OPERABLE, and the steam-driven auxiliary feedwater pump is OPERABLE (MODES 1, 2, and 3 only). If these conditions are not satisfied within 2 hours, be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.</p> <p>AND</p> <p>b.4 (Applicable only if the 14 day allowed outage time specified in ACTION Statement b.5 is to be used). Verify the required Millstone Unit No. 2 diesel generator(s) is/are OPERABLE and the Millstone Unit No. 3 SBO diesel generator is available within 1 hour prior to or after entering this condition, and at least once per 24 hours thereafter. Restore any inoperable required Millstone Unit No. 2 diesel generator to OPERABLE status and/or Millstone Unit No. 3 SBO diesel generator to available status within 72 hours or be in at least HOT STANDBY within the next 6 hours and COLD SHUTDOWN within the following 30 hours.</p> <p>AND</p> <p>b.5 Restore the inoperable diesel generator to OPERABLE status within 72 hours (within 14 days if ACTION Statement b.4 is met) or be in at least HOT STANDBY within the next 6 hours and COLD SHUTDOWN within the following 30 hours.</p>
c. One offsite circuit AND One diesel generator	<p>c.1 Perform Surveillance Requirement 4.8.1.1.1.a for remaining offsite circuit within 1 hour and at least once per 8 hours thereafter.</p> <p>AND</p> <p>c.2 Demonstrate OPERABLE diesel generator is not inoperable due to common cause failure within 8 hours or perform Surveillance Requirement 4.8.1.1.2.a.5 for the OPERABLE diesel generator within 8 hours.</p> <p>AND</p>

ELECTRICAL POWER SYSTEMS

LIMITING CONDITION FOR OPERATION

ACTION (continued)

Inoperable Equipment	Required ACTION
c. One offsite circuit AND One diesel generator	c.3 Verify all required systems, subsystems, trains, components, and devices that depend on the remaining OPERABLE diesel generator as a source of emergency power are OPERABLE, and the steam-driven auxiliary feedwater pump is OPERABLE (MODES 1, 2, and 3 only). If these conditions are not satisfied within 2 hours, be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours. AND c.4 Restore one inoperable A.C. source to OPERABLE status within 12 hours or be in at least HOT STANDBY within the next 6 hours and COLD SHUTDOWN within the following 30 hours. AND c.5 Restore remaining inoperable A.C. source to OPERABLE status following the time requirements of ACTION Statements a. or b. above based on the initial loss of the remaining inoperable A.C. source.
d. Two offsite circuits	d.1 Restore one of the inoperable offsite sources to OPERABLE status within 24 hours or be in at least HOT STANDBY within the next 6 hours. AND d.2 Following restoration of one offsite source, restore remaining inoperable offsite source to OPERABLE status following the time requirements of ACTION Statement a. above based on the initial loss of the remaining inoperable offsite source.
e. Two diesel generators	e.1 Perform Surveillance Requirement 4.8.1.1.a for the offsite circuits within 1 hour and at least once per 8 hours thereafter. AND

ELECTRICAL POWER SYSTEMS

LIMITING CONDITION FOR OPERATION

ACTION (continued)

Inoperable Equipment	Required ACTION
e. Two diesel generators	e.2 Restore one of the inoperable diesel generators to OPERABLE status within 2 hours or be in at least HOT STANDBY within the next 6 hours and COLD SHUTDOWN within the following 30 hours. AND e.3 Following restoration of one diesel generator, restore remaining inoperable diesel generator to OPERABLE status following the time requirements of ACTION Statement b. above based on the initial loss of the remaining inoperable diesel generator.

SURVEILLANCE REQUIREMENTS

4.8.1.1.1 Each of the above required independent circuits between the offsite transmission network and the Onsite Class 1E Distribution System shall be:

- a. Determined OPERABLE at least once per 7 days by verifying correct breaker alignments, indicated power availability, and
- b. Demonstrated OPERABLE at least once per 18 months during shutdown by transferring (manually and automatically) unit power supply from the normal circuit to the alternate circuit.

4.8.1.1.2 Each diesel generator shall be demonstrated OPERABLE:*

- a. At least once per 31 days on a STAGGERED TEST BASIS by:
 - 1) Verifying the fuel level in the day tank,
 - 2) Verifying the fuel level in the fuel storage tank,
 - 3) Verifying the fuel transfer pump starts and transfers fuel from the storage system to the day tank,
 - 4) Verifying the lubricating oil inventory in storage,
 - 5) Verifying the diesel starts from standby conditions and achieves generator voltage and frequency at 4160 ± 420 volts and 60 ± 0.8 Hz. The diesel generator shall be started for this test by using one of the following signals:
 - a) Manual, or

* All planned starts for the purpose of these surveillances may be preceded by an engine prelube period.

5.0 DESIGN FEATURES

5.1 SITE LOCATION

The Unit 3 Containment Building is located on the site at Millstone Point in Waterford, Connecticut. The nearest SITE BOUNDARY on land is 1719 feet northeast of the containment building wall (1627 feet northeast of the elevated stack), which is the minimum distance to the boundary of the exclusion area as described in 10 CFR 100.3. No part of the site that is closer than these distances shall be sold or leased except to Dominion Nuclear Connecticut, Inc. or its corporate affiliates for use in conjunction with normal utility operations.

5.2 DELETED

ADMINISTRATIVE CONTROLS

MONTHLY OPERATING REPORTS

6.9.1.5 Deleted

CORE OPERATING LIMITS REPORT

6.9.1.6 a Core operating limits shall be established and documented in the CORE OPERATING LIMITS REPORT before each reload cycle or any remaining part of a reload cycle for the following:

1. Overtemperature ΔT and Overpower ΔT setpoint parameters for Specification 2.2.1,
2. SHUTDOWN MARGIN for Specifications 3/4.1.1.1.1, 3/4.1.1.1.2, and 3/4.1.1.2,
3. Moderator Temperature Coefficient BOL and EOL limits and 300 ppm surveillance limit for Specification 3/4.1.1.3.

ADMINISTRATIVE CONTROLS

CORE OPERATING LIMITS REPORT (Cont.)

4. Shutdown Rod Insertion Limit for Specification 3/4.1.3.5,
5. Control Rod Insertion Limits for Specification 3/4.1.3.6,
6. AXIAL FLUX DIFFERENCE Limits, target band, and APL^{ND} for Specification 3/4.2.1.1,
7. Heat Flux Hot Channel Factor, $K(z)$, $W(z)$, APL^{ND} , and $W(z)_{BL}$ for Specification 3/4.2.2.1.
8. Nuclear Enthalpy Rise Hot Channel Factor, Power Factor Multiplier for Specification 3/4.2.3.
9. DNB Parameters for Specification 3/4.2.5.
10. Shutdown Margin Monitor minimum count rate for Specification 3/4.3.5.
11. Boron Concentration for Specification 3/4.9.1.1.

6.9.1.6.b The analytical methods used to determine the core operating limits shall be those previously reviewed and approved by the NRC in:

1. WCAP-9272-P-A, "WESTINGHOUSE RELOAD SAFETY EVALUATION METHODOLOGY," (W Proprietary). (Methodology for Specifications 3.1.1.3--Moderator Temperature Coefficient, 3.1.3.5--Shutdown Bank Insertion Limit, 3.1.3.6--Control Bank Insertion Limits, 3.2.1--AXIAL FLUX DIFFERENCE, 3.2.2--Heat Flux Hot Channel Factor, 3.2.3--Nuclear Enthalpy Rise Hot Channel Factor, 3.1.1.1.1, 3.1.1.1.2, 3.1.1.2 -- SHUTDOWN MARGIN, 3.9.1.1 -- Boron Concentration.)
2. T. M. Anderson to K. Kniel (Chief of Core Performance Branch, NRC), January 31, 1980--Attachment: Operation and Safety-Analysis Aspects of an Improved Load Follow Package.
3. NUREG-800, Standard Review Plan, U.S. Nuclear Regulatory Commission, Section 4.3, Nuclear Design, July 1981 Branch Technical Position CPB 4.3-1, Westinghouse Constant Axial Offset Control (CAOC), Revision 2, July 1981.
4. WCAP-10216-P-A-R1A, "RELAXATION OF CONSTANT AXIAL OFFSET CONTROL FQ SURVEILLANCE TECHNICAL SPECIFICATION," (W Proprietary). (Methodology for Specifications 3.2.1--AXIAL FLUX DIFFERENCE [Relaxed Axial Offset Control] and 3.2.2--Heat Flux Hot Channel Factor [W(z) surveillance requirements for FQ Methodology].)
5. WCAP-9561-P-A, ADD. 3, "BART A-1: A COMPUTER CODE FOR THE BEST ESTIMATE ANALYSIS OF REFLOOD TRANSIENTS--SPECIAL REPORT: THIMBLE MODELING W ECCS EVALUATION MODEL," (W Proprietary). (Methodology for Specification 3.2.2--Heat Flux Hot Channel Factor.)
6. WCAP-10266-P-A, Addendum 1, "THE 1981 VERSION OF THE WESTINGHOUSE ECCS EVALUATION MODEL USING THE BASH CODE," (W Proprietary). (Methodology for Specification 3.2.2--Heat Flux Hot Channel Factor.)

ADMINISTRATIVE CONTROLS

CORE OPERATING LIMITS REPORT (Cont.)

7. WCAP-11946, "Safety Evaluation Supporting a More Negative EOL Moderator Temperature Coefficient Technical Specification for the Millstone Nuclear Power Station Unit 3," (W Proprietary).
8. WCAP-10054-P-A, "WESTINGHOUSE SMALL BREAK ECCS EVALUATION MODEL.17 USING THE NOTRUMP CODE," (W Proprietary). (Methodology for Specification 3.2.2 - Heat Flux Hot Channel Factor.)
9. WCAP-10079-P-A, "NOTRUMP - A NODAL TRANSIENT SMALL BREAK AND GENERAL NETWORK CODE," (W Proprietary). (Methodology for Specification 3.2.2 - Heat Flux Hot Channel Factor.)
10. WCAP-12610, "VANTAGE+ Fuel Assembly Report," (W Proprietary). (Methodology for Specification 3.2.2 - Heat Flux Hot Channel Factor.)
11. Letter from V. L. Rooney (USNRC) to J. F. Opeka, "Safety Evaluation for Topical Report, NUSCO-152, Addendum 4, 'Physics Methodology for PWR Reload Design,' TAC No. M91815," July 18, 1995.
12. Letter from E. J. Mroczka to the USNRC, "Proposed Changes to Technical Specifications, Cycle 4 Reload Submittal - Boron Dilution Analysis," B13678, December 4, 1990.
13. Letter from D. H. Jaffe (USNRC) to E. J. Mroczka, "Issuance of Amendment (TAC No. 77924)," March 11, 1991.
14. Letter from M. H. Brothers to the USNRC, "Proposed Revision to Technical Specification, SHUTDOWN MARGIN Requirements and Shutdown Margin Monitor OPERABILITY for MODES 3, 4, and 5 (PTSCR 3-16-97), B16447, May 9, 1997.
15. Letter from J. W. Anderson (USNRC) to M. L. Bowling (NNECO), "Issuance of Amendment - Millstone Nuclear Power Station, Unit No. 3 (TAC No. M98699)," October 21, 1998.
16. WCAP-8301, "LOCTA-IV Program: Loss-of-Coolant Transient Analysis."
17. WCAP-10054-P-A, Addendum 2, "Addendum to the Westinghouse Small Break ECCS Evaluation Model Using the NOTRUMP Code: Safety Injection into the Broken Loop and COSI Condensation Model."
18. WCAP-8745-P-A, "Design Bases for the Thermal Overpower ΔT and Thermal Overtemperature ΔT Trip Functions," (Westinghouse Proprietary Class 2). (Methodology for Specification 2.2.1.)

ADMINISTRATIVE CONTROLS

6.9.1.6.c The core operating limits shall be determined so that all applicable limits (e.g. fuel thermal-mechanical limits, core thermal-hydraulic limits, ECCS limits, nuclear limits such as SHUTDOWN MARGIN, and transient and accident analysis limits) of the safety analysis are met.

6.9.1.6.d The CORE OPERATING LIMITS REPORT, including any mid-cycle revisions or supplements thereto, shall be provided upon issuance, for each reload cycle, to the NRC Document Control Desk with copies to the Regional Administrator and Resident Inspector.

SPECIAL REPORTS

6.9.2 Special reports shall be submitted to the U.S. Nuclear Regulatory Commission, Document Control Desk, Washington, D.C. 20555, one copy to the Regional Administrator Region I, and one copy to the NRC Resident Inspector, within the time period specified for each report.

6.10 Deleted.

6.11 RADIATION PROTECTION PROGRAM

6.11.1 Procedures for personnel radiation protection shall be prepared consistent with the requirements of 10 CFR Part 20 and shall be approved, maintained, and adhered to for all operations involving personnel radiation exposure.

6.12 HIGH RADIATION AREA

As provided in paragraph 20.1601(c) of 10 CFR Part 20, the following controls shall be applied to high radiation areas in place of the controls required by paragraph 20.1601 (a) and (b) of 10 CFR Part 20:

6.12.1 High Radiation Areas with Dose Not Exceeding 1.0 rem/hour at 30 Centimeters from the Radiation Source or from any Surface Penetrated by the Radiation

- a. Each entryway to such an area shall be barricaded and conspicuously posted as a high radiation area. Such barricades may be opened as necessary to permit entry or exit of personnel or equipment.
- b. Access to, and activities in, each such area shall be controlled by means of a Radiation Work Permit (RWP) or equivalent; that includes specification of radiation dose rates in the immediate work area(s) and other appropriate radiation protection equipment and measures.
- c. Individuals qualified in radiation protection procedures and personnel continuously escorted by such individuals may be exempted from the requirement for an RWP or equivalent while performing their assigned duties provided that they are otherwise following plant radiation protection procedures for entry to, exit from, and work in such areas.
- d. Each individual or group entering such an area shall possess:
 1. A radiation monitoring device that continuously displays radiation dose rates in the area, or

ADMINISTRATIVE CONTROLS

6.15 RADIOACTIVE EFFLUENT CONTROLS PROGRAM

This program conforms to 10 CFR 50.36a for the control of radioactive effluents and for maintaining the doses to members of the public from radioactive effluents as low as reasonably achievable. The program shall be contained in the REMODCM, shall be implemented by procedures, and shall include remedial actions to be taken whenever the program limits are exceeded. The program shall include the following elements:

- a. Limitations on the functional capability of radioactive liquid and gaseous monitoring instrumentation including surveillance tests and setpoint determination in accordance with the methodology in the REMODCM;
- b. Limitations on the concentrations of radioactive material released in liquid effluents to UNRESTRICTED AREAS, conforming to ten times the concentration values in Appendix B, Table 2, Column 2 to 10 CFR 20.1001-20.2402;
- c. Monitoring, sampling, and analysis of radioactive liquid and gaseous effluents in accordance with 10 CFR 20.1302 and with the methodology and parameters in the REMODCM;
- d. Limitations on the annual and quarterly doses or dose commitment to a member of the public from radioactive materials in liquid effluents released from each unit to UNRESTRICTED AREAS, conforming to 10 CFR 50, Appendix I;
- e. Determination of cumulative dose contributions from radioactive effluents for the current calendar quarter and current calendar year in accordance with the methodology and parameters in the REMODCM at least every 31 days. Determination of projected dose contributions from radioactive effluents in accordance with the methodology in the REMODCM at least every 31 days;
- f. Limitations on the functional capability and use of the liquid and gaseous effluent treatment systems to ensure that appropriate portions of these systems are used to reduce releases of radioactivity when the projected doses in a period of 31 days would exceed 2% of the guidelines for the annual dose or dose commitment, conforming to 10 CFR 50, Appendix I;
- g. Limitations on the dose rate resulting from radioactive material released in gaseous effluents from the site to areas at or beyond the SITE BOUNDARY shall be in accordance with the following:
 1. For noble gases: a dose rate ≤ 500 mrem/yr to the whole body and a dose rate ≤ 3000 mrem/yr to the skin, and
 2. For iodine-131, iodine-133, tritium, and all radionuclides in particulate form with half-lives greater than 8 days: a dose rate ≤ 1500 mrem/yr to any organ;
- h. Limitations on the annual and quarterly air doses resulting from noble gases released in gaseous effluents from each unit to areas beyond the SITE BOUNDARY, conforming to 10 CFR 50, Appendix I;
- i. Limitations on the annual and quarterly doses to a member of the public from iodine-131, iodine-133, tritium, and all radionuclides in particulate form with half lives > 8 days in gaseous effluents released from each unit to areas beyond the SITE BOUNDARY, conforming to 10 CFR 50, Appendix I; and

ADMINISTRATIVE CONTROLS

- j. Limitations on the annual dose or dose commitment to any member of the public, beyond the SITE BOUNDARY, due to releases of radioactivity and to radiation from uranium fuel cycle sources, conforming to 40 CFR 190.

The provisions of Specification 4.0.2 and Specification 4.0.3 are applicable to the Radioactive Effluent Controls Program surveillance frequency.

6.16 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

A program shall be provided to monitor the radiation and radionuclides in the environs of the plant. The program shall provide (1) representative measurements of radioactivity in the highest potential exposure pathways, and (2) verification of the accuracy of the effluent monitoring program and modeling of environmental exposure pathways. The program shall (1) be contained in the REMODCM, (2) conform to the guidance of Appendix I to 10 CFR Part 50, and (3) include the following:

- a. Monitoring, sampling, analysis, and reporting of radiation and radionuclides in the environment in accordance with the methodology and parameters in the REMODCM.
- b. A Land Use Census to ensure that changes in the use of areas at and beyond the SITE BOUNDARY are identified and that modifications to the monitoring program are made if required by the results of this census, and
- c. Participation in a Interlaboratory Comparison Program to ensure that independent checks on the precision and accuracy of the measurements of radioactive materials in environmental sample matrices are performed as part of the quality assurance program for environmental monitoring.

6.17 REACTOR COOLANT PUMP FLYWHEEL INSPECTION PROGRAM

This program shall provide for the inspection of each reactor coolant pump flywheel by either qualified in-place UT examination over the volume from the inner bore of the flywheel to the circle of one-half the outer radius or a surface examination (magnetic particle testing and/or penetrant testing) of exposed surfaces defined by the volume of the disassembled flywheels at least once every 10 years.

6.18 TECHNICAL SPECIFICATIONS (TS) BASES CONTROL PROGRAM

This program provides a means for processing changes to the Bases of these Technical Specifications:

- a. Changes to the Bases of the TS shall be made under appropriate administrative controls and reviews.
- b. Licensees may make changes to Bases without prior NRC approval provided the changes do not require either of the following:
 - 1. A change in the TS incorporated in the license or
 - 2. A change to updated FSAR or Bases that requires NRC approval pursuant to 10 CFR 50.59.

APPENDIX B
TO FACILITY OPERATING LICENSE NO. NPF-49
MILLSTONE POWER STATION, UNIT 3
DOMINION NUCLEAR CONNECTICUT, INC.
DOCKET NO. 50-423
ENVIRONMENTAL PROTECTION PLAN
(NONRADIOLOGICAL)

MILLSTONE POWER STATION, UNIT NO. 3

ENVIRONMENTAL PROTECTION PLAN

(NONRADIOLOGICAL)

TABLE OF CONTENTS

<u>Section</u>	<u>Page</u>
1.0 Objectives of the Environmental Protection Plan.....	1-1
2.0 Environmental Protection Issues	2-1
3.0 Consistency Requirements.....	3-1
3.1 Plant Design and Operation	3-2
3.2 Reporting Related to the NPDES Permit and State Certifications	3-3
3.3 Changes Required for Compliance with Other Environmental Regulations	3-3
4.0 Environmental Conditions	4-1
4.1 Unusual or Important Environmental Events	4-1
4.2 Environmental Monitoring	4-1
5.0 Administrative Procedures.....	5-1
5.1 Review	5-1
5.2 Records Retention.....	5-1
5.3 Changes in Environmental Protection Plan	5-2
5.4 Plant Reporting Requirements	5-2

2.0 Environmental Protection Issues

In the FES-OL dated December, 1984, the staff considered the environmental impacts associated with the operation of Millstone Power Station, Unit No. 3. No environmental issues were identified which required study or license conditions to resolve environmental concerns and to assure adequate protection of the environment. |

written evaluation of such activity and obtain prior NRC approval. When such activity involves a change in the EPP, such activity and change to the EPP may be implemented only in accordance with an appropriate license amendment as set forth in Section 5.3 of this EPP.

A proposed change, test or experiment shall be deemed to involve an unreviewed environmental question if it concerns: (1) a matter which may result in a significant increase in any adverse environmental impact previously evaluated in the FES-OL, environmental impact appraisals, or in any decisions of the Atomic Safety and Licensing Board; or (2) a significant change in effluents or power level; or (3) a matter, not previously reviewed and evaluated in the documents specified in (1) of this Subsection, which may have a significant adverse environmental impact.

The licensee shall maintain records of changes in facility design or operation and of tests and experiments carried out pursuant to this Subsection. These records shall include written evaluations which provide bases for the determination that the change, test, or experiment does not involve an unreviewed environmental question or constitute a decrease in the effectiveness of this EPP to meet the objectives specified in Section 1.0. The licensee shall include as part of the Annual Environmental Operating Report (per Subsection 5.4.1) brief descriptions, analyses, interpretations, and evaluations of such changes, tests and experiments.