

JUL 19 2006



LR-E06-0311

CERTIFIED MAIL
RETURN RECEIPT REQUESTED
ARTICLE NUMBER: 7004 1350 0001 9593 4818

Department of Environmental Protection
Division of Water Quality
Bureau of Permit Management
P.O. Box 029
Trenton, N.J. 08625-0029

**NEW JERSEY POLLUTANT DISCHARGE ELIMINATION SYSTEM
DISCHARGE MONITORING REPORT
SALEM GENERATING STATION
NJPDES PERMIT NJ0005622**

Dear Sir:

Attached is the Discharge Monitoring Report for the Salem Generating Station for the month of June 2006.

This report is required by and prepared specifically for the New Jersey Department of Environmental Protection (NJDEP). It presents only the observed results of measurements and analyses required to be performed by the above agencies. The choice of the measurement devices and analytical methods are controlled by the EPA and the NJDEP, not by the company, and there are limitations on the accuracy of such measurement devices and analytical techniques even when used and maintained as required. Accordingly, this report is not intended as an assertion that any instrument has measured, or that any reading or analytical result represents the true value with absolute accuracy, nor is it an endorsement of the suitability of any analytical or measurement procedure.

If you have any questions concerning this report, please feel free to contact Brendan Daly at (856) 339-1169.

Sincerely,

A handwritten signature in black ink, appearing to read "Thomas P. Joyce", written over a horizontal line.

Thomas P. Joyce
Site Vice President – Salem

Attachments

IE25

LR-E06-0311
NJPDES DMR

2

JUL 19 2006

C Executive Director, DRBC
 USNRC - Docket numbers 50-272 & 50-311

JUL 19 2006

LR-E06-0311
NJPDES DMR

3

EXPLANATION OF CONDITIONS

June 2006

The following explanations are included to clarify possible deviation from permit conditions.

General - The columns labeled "No. Ex" on the enclosed DMR tabulate the number of daily discharge values outside the indicated limits.

Data reporting and accuracy reflect the working environment, the design capabilities and reliability of the monitoring instruments and operating equipment.

Deviations from required sampling, analysis monitoring and reporting methods and periodicities are noted on the respective transmittal sheet.

Results reported on the Discharge Monitoring Report forms are consistent with permit limits, data supplied from contract laboratories, the December 1993 revision of the NJDEP DMR Instruction Manual and specific guidance from DEP personnel.

JUL 19 2006

LR-E06-0311
NJPDES DMR

4

EXPLANATION OF EXCEEDANCES

June 2006

The following exceedances are included in the attached report and explained below.

DSN No.	EXPLANATION
---------	-------------

No specific permitted limits were exceeded, but a non-permitted discharges did occur. See the attached five day report.

JUL 19 2006


LR-E06-0311
NJPDES DMR

5

COUNTY OF SALEM
STATE OF NEW JERSEY


I, Thomas P. Joyce, of full age, being duly sworn according to law, upon my oath depose and say:

1. I am the Site Vice President-Salem for PSEG Nuclear, and as such am authorized to sign Salem's Discharge Monitoring Reports submitted to the New Jersey Department of Environmental Protection pursuant to the Station's New Jersey Pollutant Discharge Elimination System permit.
2. I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe the submitted information is true, accurate and complete. I am aware that there are significant penalties for submitting false information including the possibility of fine and imprisonment.
3. The signature on the attached Discharge Monitoring Reports is my signature and I am submitting this affidavit in satisfaction of the requirement that my signature be notarized.

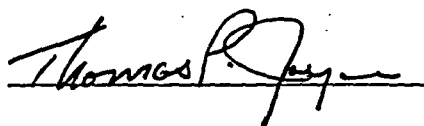

Thomas P. Joyce
Site Vice President – Salem

Sworn and subscribed before me
this 19 day of July 2006.



SHERI L. HUSTON
NOTARY PUBLIC OF NEW JERSEY
My Commission Expires 1-15-09

JUN 26 2006
LR-E06-0289



Certified Mail
Return Receipt Requested
Article Number: 7005 1160 0003 4381 5264

Administrator of Water Compliance and Enforcement
New Jersey Department of Environmental Protection
401 East State Street, 4th Floor East
PO Box 422
Trenton, New Jersey 08625-0422

**RE: PSEG Nuclear LLC - Salem Generating Station
NJPDES Permit No. NJ0005622
NJDEP Case No. 06-06-21-1736-25
Five Day Report**

Dear Sir/Madam:

In accordance with N.J.A.C. 7:14A-6.10 Noncompliance Reporting, PSEG Nuclear LLC is submitting this report concerning a discharge of water containing sodium hypochlorite to the Delaware River through lettered outfall A. The discharge was reported to the New Jersey Department of Environmental Protection (NJDEP) hotline and assigned case number 06-06-21-1736-25. This discharge was also reported to the Nuclear Regulatory Commission and assigned event number 42659. This report contains the following information as known at the time of this report. In accordance with the regulations, additional information regarding this discharge will be provided as it becomes available.

1. A description of the discharge, including the time of the discharge, the location of discharge, the volume of the discharge, the concentration of pollutants discharged, and the receiving water of the discharge;

On June 21st, 2006 at 15:40 Salem Chemistry personnel were restoring the Service Water Chlorination System back to service after maintenance. During the restoration the inlet filter required cleaning. As per Chemistry procedure SC.CH-SO.CL-0831 the strainer was drained (approximately 5 gallons of 15% sodium hypochlorite) into the Chlorination Pump House sump. Due to 13 B Circulating Water Pump being out-of- service for maintenance, a plug was installed in the sump discharge pipe. At 17:10 the Operations Shift Manager was notified by impingement sampling personnel of a strong smell of chlorine and impacted fish in the north fish sampling collection pool (used to sample traveling

JUN 26 2006

screen impinged material). When notified of the chlorine smell, Chemistry personnel investigated and discovered that the end of the fresh water flush hose had dropped in the building sump and dislodged the sump plug. When the plug was dislodged, the sump contents drained by gravity to the out-of-service 13 B Circulating Water Pump intake. The intake at this time was supplying a temporary traveling screen wash pump. Although the 13 B Circulating Water Pump was not operating, a temporary pump was supplied water from the 13 B intake bay as spray wash for the traveling screens. Screen spray wash water was partially diverted to the fish pool for the impingement study and remaining flush water returned to the Delaware River through lettered outfall A. Sampling personnel reported twelve dead croaker were found in the fish collection pool. No dead or damaged fish were observed in the Delaware River.

2. Steps being taken to determine the cause of the permit noncompliance;

PSEG is conducting an investigation in accordance with our problem identification and resolution process. The results of this investigation that would provide additional information will follow this letter as they become available.

3. Steps being taken to reduce, remediate, and eliminate the noncomplying discharge and any damage to the environment, and the anticipated time frame to initiate and complete the steps to be taken;

After discovery, the temporary pump was stopped. Samples were taken to confirm the sodium hypochlorite was dissipating. No visible impact to the environment was noted. There is not expected to be a discernable impact to the environment.

4. The duration of the discharge, including the dates and times of the commencement and, for an unanticipated bypass, the dates and times of the end or anticipated end of the discharge, and if the discharge has not been corrected, the anticipated time when the permittee will correct the situation and return the discharge to compliance;

The approximate time of the discharge is believed to be 15:45 on 06/21/2006. The discharge would have lasted approximately 1 minute. It is believed no more than 5 gallons of 15% sodium hypochlorite reached the Delaware River.

5. The cause of the noncompliance;

The cause of the noncompliance is the accidental and inadvertent dislodging the sump plug in the Chlorination Pump House allowing sodium hypochlorite to flow into the 13 B Circulating Water Pump intake bay.

JUN 26 2006

6. Steps being taken to reduce, eliminate, and prevent reoccurrence of the noncomplying discharge;

The noncomplying discharge has been eliminated. Steps to prevent reoccurrence are dependant upon the results from the cause investigation and in accordance with the regulations will be transmitted to the NJDEP within ten days after they become available.

7. An estimate of the threat to human health or the environment posed by the discharge; and


Based upon visual observation and in light of a maximum volume of 5 gallons of 15% sodium hypochlorite being discharged, it is estimated there was little to no threat to human health or the environment.

8. The measures the permittee has taken or is taking to remediate the problem and any damage or injury to human health or the environment, and to avoid a repetition of the problem.

To date the permittee has eliminated the discharge, and is currently investigating the cause of the noncomplying discharge. Steps to prevent reoccurrence are dependant on the results of the investigation.

If you have any questions regarding this information, please contact Brendan Daly of my staff at (856) 339-1169.

Sincerely,



Carl J. Fricker
Salem Plant Manager

C NJDEP
Southern Enforcement Office
One Port Center
2 Riverside Drive, Suite 201
Camden, NJ 08102
Attn: Mr. Steven Mathis



TO: William G. Biggs
 Technical Analyst
 Salem Chemistry - PSEG Power

May 30, 2006
 Report No. TP06023

**SUBJECT: DETERMINATION OF CIRCULATING WATER FLOW AT
 SALEM GENERATING STATION**

CONDUCTED BY: Victor Simpson
 Sr. Test Engineer, Maplewood Testing Services

SUMMARY

The Mechanical Division of Maplewood Testing Services conducted a series of test runs at Salem Unit No. 2 to determine the capacities of the circulating water pumps shown in the table below.

Work was performed under SAP work orders:
 30125879, 30125837, 30125838, 30125946, 30125880, 30125881

Final results are as follows:

SUMMARY OF TEST RESULTS

Pump No.	CMS Pump Desig.	Test Date	Measured Pump Capacity (gpm)	Pump Suction Head (ft h ₂ o)	Pump Discharge Head (ft h ₂ o)	Total Static Head (ft h ₂ o)
21A	G	05/23/06	136002	-8.6	20.3	28.9
21B	D	05/23/06	157950	-9.5	11.1	20.6
22A	K	05/23/06	154224	-10.2	11.1	21.3
22B	N	05/23/06	143500	-12.7	7.6	20.3
23A	A	05/23/06	130296	-13.0	14.1	27.1
23B	F	05/23/06	134445	-13.4	7.3	20.7

Note: Pump suction heads and discharge heads corrected to elevation 100'

William G. Biggs
Technical Analyst
Salem Chemistry - PSEG Power

May 30, 2006
Report No. TP06023

SUMMARY (Cont'd)

For reporting purposes, shown below is the data pertinent to the injection of Rhodamine WT dye released to the river during testing. Testing is complete at this station.

RECORD OF RHODAMINE WT DYE INJECTION

Test Date	Pump No.	Injection Time		Pure Dye Injected (ml)	Number of Pumps in Service	Total System Flow (1000 gpm)	Effluent Concentration (ppb)
		(start)	(stop)				
05/23/06	21A	938	1000	32.75	12	2220.0	0.18
05/23/06	21B	1014	1034	28.84	12	2220.0	0.17
05/23/06	22A	1044	1105	30.30	12	2220.0	0.17
05/23/06	22B	1313	1338	36.01	12	2220.0	0.17
05/23/06	23A	1350	1411	30.19	12	2220.0	0.17
05/23/06	23B	1442	1504	31.87	12	2220.0	0.17

TEST METHOD

The circulating water flow rate was determined by fluorometry using MTS Mechanical Division Work Instruction TPG-19 Rev. 7 "Water Flow Using The Turner Fluorometer". Rhodamine WT dye was injected into the bell mouth of each pump using 1/2 inc PVC pipe with a carrier flow of screen wash water at 3 gallons per minute.

The dye was injected at a known rate using a peristaltic pump and a class A burette to measure rate. The diluted sample was retrieved and monitored by taking a sample from the inlet water box piping. The ratio of the injected concentration to the sample concentration multiplied by the injection flow rate yielded the circulator flow rate.

The total static head was obtained by measuring the pump suction head in feet from elevation

William G. Biggs
Technical Analyst
Salem Chemistry - PSEG Power

May 30, 2006
Report No. TP06023

TEST METHOD (Cont'd)


100' and the pump discharge head in feet of water at the water box inlet. After correcting for elevation, the total pump head was calculated as the pump discharge head minus the pump suction head.



Senior Supervising Test Engineer
MTS Mechanical Division

C R. Swartzwelder

Salem Generating Station - Unit No.2 Total Pump Head vs. Pump Flow

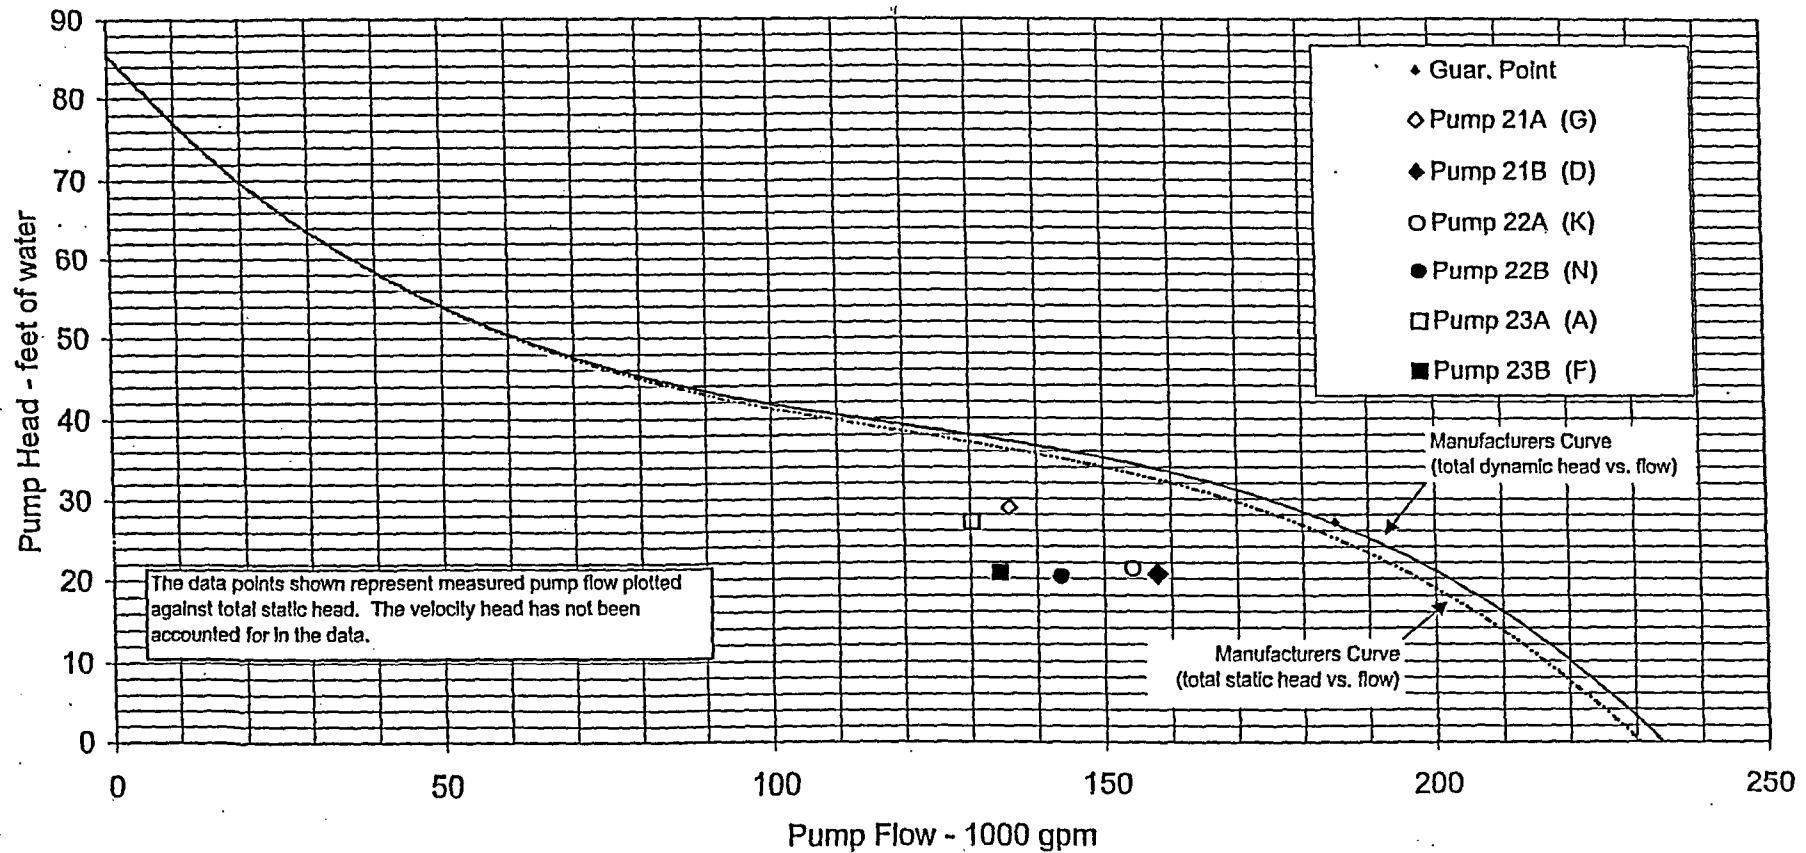

Maplewood Testing Services

Report No. TP06023

5/ 2006

New Jersey Department of Environmental Protection
Division of Water Quality

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT	MONITORING PERIOD				MONITORED LOCATION:			
NJ0005622	Month	Day	Year	To	Month	Day	Year	FACA – SW Outfall FACA
	6	1	2006		6	30	2006	

PERMITTEE:

PSE&G NUCLEAR LLC
ALLOWAY CREEK NEAK RD - PO BOX
236/N21
HANCOCKS BRIDGE, NJ 08038

LOCATION OF ACTIVITY:

PSE&G NUCLEAR LLC
ALLOWAY CREEK NECK RD
LOWER ALLOWAYS CREEK, NJ 08038-0000

REPORT RECIPIENT:

PSE&G NUCLEAR LLC
PO BOX 236/N21
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPICABLE:

☐

No Discharge this Monitoring Period

☐

Monitoring Report Comments Attached

WHO MUST SIGN The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey water Pollution Control Act provides for penalties up to \$50,000 per violation.

Thomas P. Joyce, Site Vice President - Salem

N/A

NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR

GRADE AND REGISTRY NUMBER (IF APPLICABLE)

SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR

DATE

AREA CODE/PHONE NUMBER

**For a local agency where the highest-ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have reviewed the attached discharge monitoring reports.

N/A

N/A

N/A

N/A

NAME AND TITLE

SIGNATURE

DATE

AREA CODE/PHONE NUMBER

Surface Water Discharge Monitoring Report

FI 40014

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:

FACILITY NAME:

NJ0005622

FACA SW Outfall FACA

6/1/2006 TO 6/30/2006

PSEG NUCLEAR LLC SALEM GENERATIN

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Temperature, oC 00010 G Raw Sew/Influent	SAMPLE MEASUREMENT	*****	*****		*****	23.9	26.5		0	Continuous	CONTIN
	PERMIT REQUIREMENT	*****	*****	*****	*****	REPORT 01MOAV	REPORT 01DAMX	DEG.C		Continuous	CONTIN
	QL	*****	*****		*****	*****	*****				
Temperature, oC 00010 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****		*****	32.3	35.0		0	Continuous	CONTIN
	PERMIT REQUIREMENT	*****	*****	*****	*****	REPORT 01MOAV	46.1 01DAMX	DEG.C		Continuous	CONTIN
	QL	*****	*****		*****	*****	*****				
Temperature, oC 00010 2 Effluent Net Value	SAMPLE MEASUREMENT	*****	*****		*****	8.4	9.5		0	1/DAY	CALCTD
	PERMIT REQUIREMENT	*****	*****	*****	*****	REPORT 01MOAV	15.3 01DAMX	DEG.C		1/Day	CALGTD
	QL	*****	*****		*****	*****	*****				
Lab Certification # 99999 99 Lab	SAMPLE MEASUREMENT	17327	06431		17451						
	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #			Not Applicable	NOT/AP
	QL	*****	*****		*****	*****	*****				

Comments: If there are any questions in regards to the monitoring report form, please contact Susan Rosenwinkel of the BPSP - Region 2 at (609)292-4860 or via email at "srosenwl@dep.state.nj.us".

New Jersey Department of Environmental Protection
Division of Water Quality

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT	MONITORING PERIOD	MONITORED LOCATION:												
NJ0005622	<table border="1"><tr><th>Month</th><th>Day</th><th>Year</th></tr><tr><td>6</td><td>1</td><td>2006</td></tr></table> To <table border="1"><tr><th>Month</th><th>Day</th><th>Year</th></tr><tr><td>6</td><td>30</td><td>2006</td></tr></table>	Month	Day	Year	6	1	2006	Month	Day	Year	6	30	2006	FACB – SW Outfall FACB
Month	Day	Year												
6	1	2006												
Month	Day	Year												
6	30	2006												

PERMITTEE:

PSE&G NUCLEAR LLC
ALLOWAY CREEK NEAK RD - PO BOX
236/N21
HANCOCKS BRIDGE, NJ 08038

LOCATION OF ACTIVITY:

PSE&G NUCLEAR LLC
ALLOWAY CREEK NECK RD
LOWER ALLOWAYS CREEK, NJ 08038-0000

REPORT RECIPIENT:

PSE&G NUCLEAR LLC
PO BOX 236/N21
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE:

☐

No Discharge this Monitoring Period

☐

Monitoring Report Comments Attached

WHO MUST SIGN The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.


I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey water Pollution Control Act provides for penalties up to \$50,000 per violation.

Thomas P. Joyce, Site Vice President - Salem

N/A

NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR

GRADE AND REGISTRY NUMBER (IF APPLICABLE)



07/19/2006

856-339-2086

SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR

DATE

AREA CODE/PHONE NUMBER

**For a local agency where the highest-ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have reviewed the attached discharge monitoring reports.

N/A

N/A

N/A

N/A

NAME AND TITLE

SIGNATURE

DATE

AREA CODE/PHONE NUMBER

Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:

FACILITY NAME:

NJ0005622

FACB SW Outfall FACB

6/1/2006 TO 6/30/2006

PSEG NUCLEAR LLC SALEM GENERATION

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Temperature, °C	SAMPLE MEASUREMENT	*****	*****		*****	23.9	26.5		0	Continuous	CONTIN
00010 G Raw Sew/Influent	PERMIT REQUIREMENT	*****	*****	*****	*****	REPORT 01MOAV	REPORT 01DAMX	DEG.C		Continuous	CONTIN
	QL	*****	*****		*****	*****	*****				
Temperature, °C	SAMPLE MEASUREMENT	*****	*****		*****	32.0	34.7		0	Continuous	CONTIN
00010 1 Effluent Gross Value	PERMIT REQUIREMENT	*****	*****	*****	*****	REPORT 01MOAV	46.1 01DAMX	DEG.C		Continuous	CONTIN
	QL	*****	*****		*****	*****	*****				
Temperature, °C	SAMPLE MEASUREMENT	*****	*****		*****	8.1	8.6		0	1/DAY	CALCTD
00010 2 Effluent Net Value	PERMIT REQUIREMENT	*****	*****	*****	*****	REPORT 01MOAV	15.3 01DAMX	DEG.C		1/Day	CALCTD
	QL	*****	*****		*****	*****	*****				
Lab Certification #	SAMPLE MEASUREMENT	17327	06431		17451						
99999 99 Lab	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #			Not Applic	NOT AP
	QL	*****	*****		*****	*****	*****				

Comments: If there are any questions in regards to the monitoring report form, please contact Susan Rosenwinkel of the BPSP - Region 2 at (609)292-4860 or via email at "srosenwi@dep.state.nj.us".

New Jersey Department of Environmental Protection
Division of Water Quality

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT	MONITORING PERIOD						MONITORED LOCATION:	
NJ0005622	Month	Day	Year	To	Month	Day	Year	FACC - SW Outfall FACC
	6	1	2006		6	30	2006	

PERMITTEE:

PSE&G NUCLEAR LLC
ALLOWAY CREEK NEAK RD - PO BOX
236/N21
HANCOCKS BRIDGE, NJ 08038

LOCATION OF ACTIVITY:

PSE&G NUCLEAR LLC
ALLOWAY CREEK NECK RD
LOWER ALLOWAYS CREEK, NJ 08038-0000

REPORT RECIPIENT:

PSE&G NUCLEAR LLC
PO BOX 236/N21
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE:

☐

No Discharge this Monitoring Period

☐

Monitoring Report Comments Attached

WHO MUST SIGN The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey water Pollution Control Act provides for penalties up to \$50,000 per violation.

Thomas P. Joyce, Site Vice President - Salem

N/A

NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR

GRADE AND REGISTRY NUMBER (IF APPLICABLE)

SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR

DATE

AREA CODE/PHONE NUMBER

**For a local agency where the highest-ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have reviewed the attached discharge monitoring reports.

N/A

N/A

N/A

N/A

NAME AND TITLE

SIGNATURE

DATE

AREA CODE/PHONE NUMBER

Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER: NJ0005622
 MONITORED LOCATION: FACC SW Outfall FACC
 MONITORING PERIOD: 6/1/2006 TO 6/30/2006
 FACILITY NAME: PSEG NUCLEAR LLC SALEM GENERATING

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Flow, In Conduit or Thru Treatment Plant 50050 G Raw Sew/Influent	SAMPLE MEASUREMENT	2475	2553	MGD	*****	*****	*****	*****	0	1/DAY	CALCTD
	PERMIT REQUIREMENT	3024 01MOAV	REPORT 01DAMX		*****	*****	*****				
	QL	*****	*****		*****	*****	*****				
Thermal Discharge Million BTUs per Hr 00015 2 Effluent Net Value	SAMPLE MEASUREMENT	13207	13448	MBTU/HR	*****	*****	*****	*****	0	1/DAY	CALCTD
	PERMIT REQUIREMENT	REPORT 01MOAV	30600 01DAMX		*****	*****	*****				
	QL	*****	*****		*****	*****	*****				
Lab Certification # 99999 99 Lab	SAMPLE MEASUREMENT	17327	06431		17451						
	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #				
	QL	*****	*****		*****	*****	*****				

Comments: If there are any questions in regards to the monitoring report form, please contact Susan Rosenwinkel of the BPSP - Region 2 at (609)292-4860 or via email at "srosenwi@dep.state.nj.us".

New Jersey Department of Environmental Protection
Division of Water Quality

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT	MONITORING PERIOD						MONITORED LOCATION:	
NJ0005622	Month	Day	Year	To	Month	Day	Year	048C – SW Outfall 48C
	6	1	2006		6	30	2006	

PERMITTEE:

PSE&G NUCLEAR LLC
ALLOWAY CREEK NEAK RD - PO BOX
236/N21
HANCOCKS BRIDGE, NJ 08038

LOCATION OF ACTIVITY:

PSE&G NUCLEAR LLC
ALLOWAY CREEK NECK RD
LOWER ALLOWAYS CREEK, NJ 08038-0000

REPORT RECIPIENT:

PSE&G NUCLEAR LLC
PO BOX 236/N21
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE:

☐

No Discharge this Monitoring Period

☐

Monitoring Report Comments Attached

WHO MUST SIGN The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey water Pollution Control Act provides for penalties up to \$50,000 per violation.

Thomas P. Joyce, Site Vice President - Salem

N/A

NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR

GRADE AND REGISTRY NUMBER (IF APPLICABLE)

SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR

DATE

AREA CODE/PHONE NUMBER

**For a local agency where the highest-ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have reviewed the attached discharge monitoring reports.

N/A

N/A

N/A

N/A

NAME AND TITLE

SIGNATURE

DATE

AREA CODE/PHONE NUMBER

Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER: NJ0005622 MONITORED LOCATION: 048C SW Outfall 48C MONITORING PERIOD: 6/1/2006 TO 6/30/2006 FACILITY NAME: PSEG NUCLEAR LLC SALEM GENERATING

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Flow, In Conduit or Thru Treatment Plant 50050 1 Effluent Gross Value	SAMPLE MEASUREMENT	0.3166	0.6196	MGD	*****	*****	*****	*****	0	1/DAY	CALCTD
	PERMIT REQUIREMENT	REPORT 01MOAV	REPORT 01DAMX		*****	*****	*****			1/Day	CALCTD
	QL	*****	*****		*****	*****	*****				
Solids, Total Suspended 00530 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	7	8	MG/L	0	2/MONTH	Compos
	PERMIT REQUIREMENT	*****	*****		*****	30 01MOAV	100 01DAMX			2/Month	COMPOS
	QL	*****	*****		*****	*****	*****				
Nitrogen, Ammonia Total (as N) 00610 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	5	8	MG/L	0	2/MONTH	Compos
	PERMIT REQUIREMENT	*****	*****		*****	35 01MOAV	70 01DAMX			2/Month	COMPOS
	QL	*****	*****		*****	*****	*****				
Petroleum Hydrocarbons 00551 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	<0.5	<0.5	MG/L	0	2/MONTH	GRAB
	PERMIT REQUIREMENT	*****	*****		*****	10 01MOAV	15 01DAMX			2/Month	GRAB
	QL	*****	*****		*****	*****	*****				
Carbon, Tot Organic (TOC) 00680 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	9	9	MG/L	0	2/MONTH	Compos
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	50 01DAMX			2/Month	COMPOS
	QL	*****	*****		*****	*****	*****				
Lab Certification # 99999 99 Lab	SAMPLE MEASUREMENT	17327	06431		17451				0		
	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #			Not Applic	NOT AP
	QL	*****	*****		*****	*****	*****				

Comments: If there are any questions in regards to the monitoring report form, please contact Susan Rosenwinkel of the BPSP - Region 2 at (609)292-4680 or via email at "srosenw@dep.state.nj.us".

New Jersey Department of Environmental Protection
Division of Water Quality

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT	MONITORING PERIOD	MONITORED LOCATION:												
NJ0005622	<table border="1"><tr><th>Month</th><th>Day</th><th>Year</th></tr><tr><td>6</td><td>1</td><td>2006</td></tr></table> To <table border="1"><tr><th>Month</th><th>Day</th><th>Year</th></tr><tr><td>6</td><td>30</td><td>2006</td></tr></table>	Month	Day	Year	6	1	2006	Month	Day	Year	6	30	2006	481A - SW Outfall 481A
Month	Day	Year												
6	1	2006												
Month	Day	Year												
6	30	2006												

PERMITTEE:

PSE&G NUCLEAR LLC
ALLOWAY CREEK NEAK RD - PO BOX
236/N21
HANCOCKS BRIDGE, NJ 08038

LOCATION OF ACTIVITY:

PSE&G NUCLEAR LLC
ALLOWAY CREEK NECK RD
LOWER ALLOWAYS CREEK, NJ 08038-0000

REPORT RECIPIENT:

PSE&G NUCLEAR LLC
PO BOX 236/N21
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE:

☐

No Discharge this Monitoring Period

☐

Monitoring Report Comments Attached

WHO MUST SIGN The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey water Pollution Control Act provides for penalties up to \$50,000 per violation.

Thomas P. Joyce, Site Vice President - Salem

N/A

NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR

GRADE AND REGISTRY NUMBER (IF APPLICABLE)

SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR

DATE

AREA CODE/PHONE NUMBER

**For a local agency where the highest-ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have reviewed the attached discharge monitoring reports.

N/A

N/A

N/A

N/A

NAME AND TITLE

SIGNATURE

DATE

AREA CODE/PHONE NUMBER

Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:

FACILITY NAME:

NJ0005622

481A SW Outfall 481A

6/1/2006 TO 6/30/2006

PSEG NUCLEAR LLC SALEM GENERATION

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Flow, In Conduit or Thru Treatment Plant	SAMPLE MEASUREMENT	450	484	MGD	*****	*****	*****	*****	0	1/DAY	CALCTD
50050 1	PERMIT REQUIREMENT	REPORT 01MOAV	REPORT 01DAMX		*****	*****	*****				
Effluent Gross Value	QL	*****	*****		*****	*****	*****				
pH	SAMPLE MEASUREMENT	*****	*****	*****	7.2	*****	7.4	SU	0	1/Week	GRAB
00400 1	PERMIT REQUIREMENT	*****	*****		6.0 01DAMN	*****	9.0 01DAMX				
Effluent Gross Value	QL	*****	*****		*****	*****	*****				
pH	SAMPLE MEASUREMENT	*****	*****	*****	7.6	*****	7.8	SU	0	1/Week	GRAB
00400 7	PERMIT REQUIREMENT	*****	*****		REPORT 01DAMN	*****	REPORT 01DAMX				
Intake From Stream	QL	*****	*****		*****	*****	*****				
LC50 Statre 96hr Acu Cyprinodon	SAMPLE MEASUREMENT	*****	*****	*****	CODE = N	*****	*****	%EFFL	0	Code = N	Code = N
TAN6A 1	PERMIT REQUIREMENT	*****	*****		50 01DAMN	*****	*****				
Effluent Gross Value	QL	*****	*****		*****	*****	*****				
Chlorine Produced Oxidants	SAMPLE MEASUREMENT	*****	*****	*****	*****	Code = N	Code = N	MG/L	0	Code = N	Code = N
*CPOX 1	PERMIT REQUIREMENT	*****	*****		*****	0.3 01MOAV	0.5 01DAMX				
Effluent Gross Value Option 1	QL	*****	*****		*****	*****	*****				
Chlorine Produced Oxidants	SAMPLE MEASUREMENT	*****	*****	*****	*****	<0.1	<0.1	MG/L	0	3/Week	GRAB
*CPOX 1	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	0.2 01DAMX				
Effluent Gross Value Option 2	QL	*****	*****		*****	*****	*****				

Comments: The permittee is required to perform acute toxicity testing on a minimum of one representative CWS outfall while DSN 48C is being routed to that outfall.

Surface water Discharge Monitoring Report

PI 46814

PERMIT NUMBER: NJ0005622
 MONITORED LOCATION: 481A SW Outfall 481A
 MONITORING PERIOD: 6/1/2006 TO 6/30/2006
 FACILITY NAME: PSEG NUCLEAR LLC, SALEM GENERATING

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Temperature, °C 00010 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****		*****	32.5	37.8		1	1/DAY	CONTIN
	PERMIT REQUIREMENT	*****	*****	*****	*****	REPORT 01MOAV	REPORT 01DAMX	DEG.C		1/Day	CONTIN
	QL	*****	*****		*****	*****	*****				
Lab Certification # 99999 99 Lab	SAMPLE MEASUREMENT	17327	06431		17451						
	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #			Not Applicable	NOT AP
	QL	*****	*****		*****	*****	*****				

Comments: The permittee is required to perform acute toxicity testing on a minimum of one representative CWS outfall while DSN 48C is being routed to that outfall.

New Jersey Department of Environmental Protection
Division of Water Quality

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT	MONITORING PERIOD						MONITORED LOCATION:	
NJ0005622	Month	Day	Year	To	Month	Day	Year	482A - SW Outfall 482A
	6	1	2006		6	30	2006	

PERMITTEE:

PSE&G NUCLEAR LLC
ALLOWAY CREEK NEAK RD - PO BOX
236/N21
HANCOCKS BRIDGE, NJ 08038

LOCATION OF ACTIVITY:

PSE&G NUCLEAR LLC
ALLOWAY CREEK NECK RD
LOWER ALLOWAYS CREEK, NJ 08038-0000

REPORT RECIPIENT:

PSE&G NUCLEAR LLC
PO BOX 236/N21
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE:

☐

No Discharge this Monitoring Period

☐

Monitoring Report Comments Attached

WHO MUST SIGN The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey water Pollution Control Act provides for penalties up to \$50,000 per violation.

Thomas P. Joyce, Site Vice President - Salem

N/A

NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR

GRADE AND REGISTRY NUMBER (IF APPLICABLE)



07/19/2006

856-339-2086

SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR

DATE

AREA CODE/PHONE NUMBER

**For a local agency where the highest-ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have reviewed the attached discharge monitoring reports.

N/A

N/A

N/A

N/A

NAME AND TITLE

SIGNATURE

DATE

AREA CODE/PHONE NUMBER

Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:

FACILITY NAME:

NJ0005622

482A SW Outfall 482A

6/1/2006 TO 6/30/2006

PSEG NUCLEAR LLC SALEM GENERATING

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Flow, In Conduit or Thru Treatment Plant 50050 1 Effluent Gross Value	SAMPLE MEASUREMENT	425	444		*****	*****	*****		Q	1/DAY	CALCTD
	PERMIT REQUIREMENT	REPORT 01MOAV	REPORT 01DAMX	MGD	*****	*****	*****	*****		1/Day	CALCTD
	QL	*****	*****		*****	*****	*****				
pH 00400 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****		7.3	*****	7.5		Q	1/WEEK	GRAB
	PERMIT REQUIREMENT	*****	*****	*****	6.0 01DAMN	*****	9.0 01DAMX	SU		1/Week	GRAB
	QL	*****	*****		*****	*****	*****				
pH 00400 7 Intake From Stream	SAMPLE MEASUREMENT	*****	*****		7.6	*****	7.8		Q	1/week	GRAB
	PERMIT REQUIREMENT	*****	*****	*****	REPORT 01DAMN	*****	REPORT 01DAMX	SU		1/Week	GRAB
	QL	*****	*****		*****	*****	*****				
LC50 Statre 96hr Acu Cyprinodon TAN6A 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****		Code=N	*****	*****		Q	Code=N	Code=N
	PERMIT REQUIREMENT	*****	*****	*****	50 01DAMN	*****	*****	%EFFL		2/Year	COMPOS
	QL	*****	*****		*****	*****	*****				
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 1	SAMPLE MEASUREMENT	*****	*****		*****	Code=N	Code=N		Q	Code=N	Code=N
	PERMIT REQUIREMENT	*****	*****	*****	*****	0.3 01MOAV	0.5 01DAMX	MG/L		3/Week	GRAB
	QL	*****	*****		*****	*****	*****				
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 2	SAMPLE MEASUREMENT	*****	*****		*****	<0.1	<0.1		Q	3/week	GRAB
	PERMIT REQUIREMENT	*****	*****	*****	*****	REPORT 01MOAV	0.2 01DAMX	MG/L		3/Week	GRAB
	QL	*****	*****		*****	*****	*****				

Comments: The permittee is required to perform acute toxicity testing on a minimum of one representative CWS outfall while DSN 48C is being routed to that outfall.

Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER: NJ0005622
MONITORED LOCATION: 482A SW Outfall 482A
MONITORING PERIOD: 6/1/2006 TO 6/30/2006
FACILITY NAME: PSEG NUCLEAR LLC SALEM GENERATION

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Temperature, oC 00010 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****		*****	32.2	35.7		Q	1/DAY	CONTIN
	PERMIT REQUIREMENT	*****	*****	*****	*****	REPORT 01MOAV	REPORT 01DAMX	DEG.C		1/Day	CONTIN
	QL	*****	*****		*****	*****	*****				
Lab Certification # 99999 99 Lab	SAMPLE MEASUREMENT	17327	06431		17451						
	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #			Not Applic	NOT AP
	QL	*****	*****		*****	*****	*****				

Comments: The permittee is required to perform acute toxicity testing on a minimum of one representative CWS outfall while DSN 48C is being routed to that outfall.

New Jersey Department of Environmental Protection
Division of Water Quality

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT	MONITORING PERIOD						MONITORED LOCATION:	
NJ0005622	Month	Day	Year	To	Month	Day	Year	483A – SW Outfall 483A
	6	1	2006		6	30	2006	

PERMITTEE:

PSE&G NUCLEAR LLC
ALLOWAY CREEK NEAK RD - PO BOX
236/N21
HANCOCKS BRIDGE, NJ 08038

LOCATION OF ACTIVITY:

PSE&G NUCLEAR LLC
ALLOWAY CREEK NECK RD
LOWER ALLOWAYS CREEK, NJ 08038-0000

REPORT RECIPIENT:

PSE&G NUCLEAR LLC
PO BOX 236/N21
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE:

☐

No Discharge this Monitoring Period

☐

Monitoring Report Comments Attached

WHO MUST SIGN The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey water Pollution Control Act provides for penalties up to \$50,000 per violation.

Thomas P. Joyce, Site Vice President - Salem

N/A

NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR

GRADE AND REGISTRY NUMBER (IF APPLICABLE)



07/19/2006

856-339-2086

SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR

DATE

AREA CODE/PHONE NUMBER

**For a local agency where the highest-ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have reviewed the attached discharge monitoring reports.

N/A

N/A

N/A

N/A

NAME AND TITLE

SIGNATURE

DATE

AREA CODE/PHONE NUMBER

Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:

FACILITY NAME:

NJ0005622

483A SW Outfall 483A

6/1/2006 TO 6/30/2006

PSEG NUCLEAR LLC SALEM GENERATION


PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Flow, In Conduit or Thru Treatment Plant 50050 1 Effluent Gross Value	SAMPLE MEASUREMENT	416	441	MGD	*****	*****	*****	*****	0	1/DAY	CALCTD
	PERMIT REQUIREMENT	REPORT 01MOAV	REPORT 01DAMX		*****	*****	*****				
	QL	*****	*****		*****	*****	*****				
pH 00400 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	7.2	*****	7.5	SU	0	1/WEEK	GRAB
	PERMIT REQUIREMENT	*****	*****		6.0 01DAMN	*****	9.0 01DAMX				
	QL	*****	*****		*****	*****	*****				
pH 00400 7 Intake From Stream	SAMPLE MEASUREMENT	*****	*****	*****	7.6	*****	7.8	SU	0	1/week	GRAB
	PERMIT REQUIREMENT	*****	*****		REPORT 01DAMN	*****	REPORT 01DAMX				
	QL	*****	*****		*****	*****	*****				
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 1	SAMPLE MEASUREMENT	*****	*****	*****	*****	Code=N	Code=N	MG/L	0	Code=N	Code=N
	PERMIT REQUIREMENT	*****	*****		*****	0.3 01MOAV	0.5 01DAMX				
	QL	*****	*****		*****	*****	*****				
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 2	SAMPLE MEASUREMENT	*****	*****	*****	*****	<0.1	<0.1	MG/L	0	3/week	GRAB
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	0.2 01DAMX				
	QL	*****	*****		*****	*****	*****				
Temperature, oC 00010 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	32.3	36.7	DEG.C	0	1/DAY	CONTIN
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	REPORT 01DAMX				
	QL	*****	*****		*****	*****	*****				

Comments: Any questions in regards to the monitoring report form can be directed to S. Rosenwinkel of the BPSP - Region 2 at (609)292-4860.

Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER: NJ0005622
 MONITORED LOCATION: 483A SW Outfall 483A
 MONITORING PERIOD: 6/1/2006 TO 6/30/2006
 FACILITY NAME: PSEG NUCLEAR LLC SALEM GENERATING

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Lab Certification #	SAMPLE MEASUREMENT	17327	06431		17451	-					
99999 99	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #			Not Applicable	NOT APPLICABLE
Lab	QL	*****	*****		*****	*****	*****				

Comments: Any questions in regards to the monitoring report form can be directed to S. Rosenwinkel of the BPSP - Region 2 at (609)292-4860.

New Jersey Department of Environmental Protection
Division of Water Quality

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT	MONITORING PERIOD						MONITORED LOCATION:	
NJ0005622	Month	Day	Year	To	Month	Day	Year	484A - SW Outfall 484A
	6	1	2006		6	30	2006	

PERMITTEE:

PSE&G NUCLEAR LLC
ALLOWAY CREEK NEAK RD - PO BOX
236/N21
HANCOCKS BRIDGE, NJ 08038

LOCATION OF ACTIVITY:

PSE&G NUCLEAR LLC
ALLOWAY CREEK NECK RD
LOWER ALLOWAYS CREEK, NJ 08038-0000

REPORT RECIPIENT:

PSE&G NUCLEAR LLC
PO BOX 236/N21
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE:

☐

No Discharge this Monitoring Period

☐

Monitoring Report Comments Attached

WHO MUST SIGN The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey water Pollution Control Act provides for penalties up to \$50,000 per violation.

Thomas P. Joyce, Site Vice President - Salem

N/A

NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR

GRADE AND REGISTRY NUMBER (IF APPLICABLE)

SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR

DATE

AREA CODE/PHONE NUMBER

**For a local agency where the highest-ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have reviewed the attached discharge monitoring reports.

N/A

N/A

N/A

N/A

NAME AND TITLE

SIGNATURE

DATE

AREA CODE/PHONE NUMBER

Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:

FACILITY NAME:

NJ0005622

484A SW Outfall 484A

6/1/2006 TO 6/30/2006

PSEG NUCLEAR LLC SALEM GENERATION

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Flow, In Conduit or Thru Treatment Plant 50050 1 Effluent Gross Value	SAMPLE MEASUREMENT	449	457	MGD	*****	*****	*****	*****	Q	1/Day	CALCTD
	PERMIT REQUIREMENT	REPORT 01MOAV	REPORT 01DAMX		*****	*****	*****			1/Day	CALCTD
	QL	*****	*****		*****	*****	*****				
pH 00400 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	7.3	*****	7.4	SU	Q	1/week	GRAB
	PERMIT REQUIREMENT	*****	*****		6.0 01DAMN	*****	9.0 01DAMX			1/Week	GRAB
	QL	*****	*****		*****	*****	*****				
pH 00400 7 Intake From Stream	SAMPLE MEASUREMENT	*****	*****	*****	7.6	*****	7.8	SU	Q	1/week	GRAB
	PERMIT REQUIREMENT	*****	*****		REPORT 01DAMN	*****	REPORT 01DAMX			1/Week	GRAB
	QL	*****	*****		*****	*****	*****				
LC50 Statre 96hr Acu Cyprinodon TAN6A 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	Code=N	*****	*****	%EFFL	Q	Code=N	Code=N
	PERMIT REQUIREMENT	*****	*****		50 01DAMN	*****	*****			2/Year	COMPOS
	QL	*****	*****		*****	*****	*****				
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 1	SAMPLE MEASUREMENT	*****	*****	*****	*****	Code=N	Code=N	MG/L	Q	Code=N	Code=N
	PERMIT REQUIREMENT	*****	*****		*****	0.3 01MOAV	0.5 01DAMX			3/Week	GRAB
	QL	*****	*****		*****	*****	*****				
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 2	SAMPLE MEASUREMENT	*****	*****	*****	*****	<0.1	<0.1	MG/L	Q	3/week	GRAB
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	0.2 01DAMX			3/Week	GRAB
	QL	*****	*****		*****	*****	*****				

Comments: The permittee is required to perform acute toxicity testing on a minimum of one representative CWS outfall while DSN 48C is being routed to that outfall.

Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER: NJ0005622 MONITORED LOCATION: 484A SW Outfall 484A MONITORING PERIOD: 6/1/2006 TO 6/30/2006 FACILITY NAME: PSEG NUCLEAR LLC SALEM GENERATING

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Temperature, °C	SAMPLE MEASUREMENT	*****	*****		*****	32.3	36.2		0	1/DAY	CONTIN
00010 1 Effluent Gross Value	PERMIT REQUIREMENT	*****	*****	*****	*****	REPORT 01MOAV	REPORT 01DAMX	DEG.C		1/Day	CONTIN
	QL	*****	*****		*****	*****	*****				
Lab Certification #	SAMPLE MEASUREMENT	17327	06431		17451						
99999 99 Lab	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #			Not Applic	NOT AP
	QL	*****	*****		*****	*****	*****				

Comments: The permittee is required to perform acute toxicity testing on a minimum of one representative CWS outfall while DSN 48C is being routed to that outfall.

New Jersey Department of Environmental Protection
Division of Water Quality

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT	MONITORING PERIOD	MONITORED LOCATION:												
NJ0005622	<table border="1"><tr><th>Month</th><th>Day</th><th>Year</th></tr><tr><td>6</td><td>1</td><td>2006</td></tr></table> To <table border="1"><tr><th>Month</th><th>Day</th><th>Year</th></tr><tr><td>6</td><td>30</td><td>2006</td></tr></table>	Month	Day	Year	6	1	2006	Month	Day	Year	6	30	2006	485A – SW Outfall 485A
Month	Day	Year												
6	1	2006												
Month	Day	Year												
6	30	2006												

PERMITTEE:

PSE&G NUCLEAR LLC
ALLOWAY CREEK NEAK RD - PO BOX
236/N21
HANCOCKS BRIDGE, NJ 08038

LOCATION OF ACTIVITY:

PSE&G NUCLEAR LLC
ALLOWAY CREEK NECK RD
LOWER ALLOWAYS CREEK, NJ 08038-0000

REPORT RECIPIENT:

PSE&G NUCLEAR LLC
PO BOX 236/N21
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE:

☐

No Discharge this Monitoring Period

☐

Monitoring Report Comments Attached

WHO MUST SIGN The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.


I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey water Pollution Control Act provides for penalties up to \$50,000 per violation.

Thomas P. Joyce, Site Vice President - Salem

N/A

NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR

GRADE AND REGISTRY NUMBER (IF APPLICABLE)



07/19/2006

856-339-2086

SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR

DATE

AREA CODE/PHONE NUMBER

**For a local agency where the highest-ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have reviewed the attached discharge monitoring reports.

N/A

N/A

N/A

N/A

NAME AND TITLE

SIGNATURE

DATE

AREA CODE/PHONE NUMBER

Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:

FACILITY NAME:

NJ0005622

485A SW Outfall 485A

6/1/2006 TO 6/30/2006

PSEG NUCLEAR LLC SALEM GENERATIN

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Flow, In Conduit or Thru Treatment Plant 50050 1 Effluent Gross Value	SAMPLE MEASUREMENT	433	434	MGD	*****	*****	*****	*****	Q	1/DAY	CALCTD
	PERMIT REQUIREMENT	REPORT 01MOAV	REPORT 01DAMX		*****	*****	*****				
	QL	*****	*****		*****	*****	*****				
pH 00400 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	7.2	*****	7.5	SU	Q	1/Week	GRAB
	PERMIT REQUIREMENT	*****	*****		6.0 01DAMN	*****	9.0 01DAMX				
	QL	*****	*****		*****	*****	*****				
pH 00400 7 Intake From Stream	SAMPLE MEASUREMENT	*****	*****	*****	7.6	*****	7.8	SU	Q	1/Week	GRAB
	PERMIT REQUIREMENT	*****	*****		REPORT 01DAMN	*****	REPORT 01DAMX				
	QL	*****	*****		*****	*****	*****				
LC50 Statre 96hr Acu Cyprinodon TAN6A 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	Code = N	*****	*****	%EFFL	Q	2/Year	COMPOS
	PERMIT REQUIREMENT	*****	*****		50 01DAMN	*****	*****				
	QL	*****	*****		*****	*****	*****				
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 1	SAMPLE MEASUREMENT	*****	*****	*****	*****	Code = N	Code = N	MG/L	Q	3/Week	GRAB
	PERMIT REQUIREMENT	*****	*****		*****	0.3 01MOAV	0.5 01DAMX				
	QL	*****	*****		*****	*****	*****				
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 2	SAMPLE MEASUREMENT	*****	*****	*****	*****	<0.1	<0.1	MG/L	Q	3/Week	GRAB
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	0.2 01DAMX				
	QL	*****	*****		*****	*****	*****				

Comments: The permittee is required to perform acute toxicity testing on a minimum of one representative CWS outfall while DSN 48C is being routed to that outfall.

Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER: NJ0005622
 MONITORED LOCATION: 485A SW Outfall 485A
 MONITORING PERIOD: 6/1/2006 TO 6/30/2006
 FACILITY NAME: PSEG NUCLEAR LLC SALEM GENERATING

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Temperature, °C 00010 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****		*****	32.0	35.9		0	1/DAY	CONTIN
	PERMIT REQUIREMENT	*****	*****	*****	*****	REPORT 01MOAV	REPORT 01DAMX	DEG.C		1/Day	CONTIN
	QL	*****	*****		*****	*****	*****				
Lab Certification # 99999 99 Lab	SAMPLE MEASUREMENT	17327	06431		17451						
	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #			Not Applic	NOT AP
	QL	*****	*****		*****	*****	*****				

Comments: The permittee is required to perform acute toxicity testing on a minimum of one representative CWS outfall while DSN 48C is being routed to that outfall.

New Jersey Department of Environmental Protection
Division of Water Quality

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT	MONITORING PERIOD	MONITORED LOCATION:												
NJ0005622	<table border="1"><tr><th>Month</th><th>Day</th><th>Year</th></tr><tr><td>6</td><td>1</td><td>2006</td></tr></table> To <table border="1"><tr><th>Month</th><th>Day</th><th>Year</th></tr><tr><td>6</td><td>30</td><td>2006</td></tr></table>	Month	Day	Year	6	1	2006	Month	Day	Year	6	30	2006	486A - SW Outfall 486A
Month	Day	Year												
6	1	2006												
Month	Day	Year												
6	30	2006												

PERMITTEE:

PSE&G NUCLEAR LLC
ALLOWAY CREEK NEAK RD - PO BOX
236/N21
HANCOCKS BRIDGE, NJ 08038

LOCATION OF ACTIVITY:

PSE&G NUCLEAR LLC
ALLOWAY CREEK NECK RD
LOWER ALLOWAYS CREEK, NJ 08038-0000

REPORT RECIPIENT:

PSE&G NUCLEAR LLC
PO BOX 236/N21
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE:

☐

No Discharge this Monitoring Period

☐

Monitoring Report Comments Attached

WHO MUST SIGN The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.


I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey water Pollution Control Act provides for penalties up to \$50,000 per violation.

Thomas P. Joyce, Site Vice President - Salem

N/A

NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR

GRADE AND REGISTRY NUMBER (IF APPLICABLE)



07/19/2006

856-339-2086

SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR

DATE

AREA CODE/PHONE NUMBER

**For a local agency where the highest-ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have reviewed the attached discharge monitoring reports.

N/A

N/A

N/A

N/A

NAME AND TITLE

SIGNATURE

DATE

AREA CODE/PHONE NUMBER

Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:


FACILITY NAME:

NJ0005622

486A SW Outfall 486A

6/1/2006 TO 6/30/2006

PSEG NUCLEAR LLC SALEM GENERATIN


PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Flow, In Conduit or Thru Treatment Plant	SAMPLE MEASUREMENT	398	406	MGD	*****	*****	*****	*****	0	1/DAY	CALCTD
50050 1	PERMIT REQUIREMENT	REPORT 01MOAV	REPORT 01DAMX		*****	*****	*****			1/Day	CALCTD
Effluent Gross Value	QL	*****	*****		*****	*****	*****				
pH	SAMPLE MEASUREMENT	*****	*****	*****	7.4	*****	7.5	SU	0	1/week	GRAB
00400 1	PERMIT REQUIREMENT	*****	*****		6.0 01DAMN	*****	9.0 01DAMX			1/Week	GRAB
Effluent Gross Value	QL	*****	*****		*****	*****	*****				
pH	SAMPLE MEASUREMENT	*****	*****	*****	7.6	*****	7.8	SU	0	1/week	GRAB
00400 7	PERMIT REQUIREMENT	*****	*****		REPORT 01DAMN	*****	REPORT 01DAMX			1/Week	GRAB
Intake From Stream	QL	*****	*****		*****	*****	*****				
Chlorine Produced	SAMPLE MEASUREMENT	*****	*****	*****	*****	Code=N	Code=N	MGL	0	Code=N	Code=N
Oxidants	PERMIT REQUIREMENT	*****	*****		*****	0.3 01MOAV	0.5 01DAMX			3/Week	GRAB
*CPOX 1	QL	*****	*****		*****	*****	*****				
Effluent Gross Value											
Option 1											
Chlorine Produced	SAMPLE MEASUREMENT	*****	*****	*****	*****	<0.1	<0.1	MGL	0	3/week	GRAB
Oxidants	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	0.2 01DAMX			3/Week	GRAB
*CPOX 1	QL	*****	*****		*****	*****	*****				
Effluent Gross Value											
Option 2											
Temperature,	SAMPLE MEASUREMENT	*****	*****	*****	*****	31.6	35.6	DEG.C	0	1/DAY	CONTIN
oC	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	REPORT 01DAMX			1/Day	CONTIN
00010 1	QL	*****	*****		*****	*****	*****				
Effluent Gross Value											

Comments: Any questions in regards to the monitoring report form can be directed to S. Rosenwinkel of the BPSP - Region 2 at (609)292-4860.

Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER: NJ0005622
 MONITORED LOCATION: 486A SW Outfall 486A
 MONITORING PERIOD: 6/1/2006 TO 6/30/2006
 FACILITY NAME: PSEG NUCLEAR LLC, SALEM GENERATING STATION

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Lab Certification #											
99999 99	SAMPLE MEASUREMENT	17327	06431		17451	-					
Lab	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #			Not Applic	NOT AP
	QI	*****	*****		*****	*****	*****				

Comments: Any questions in regards to the monitoring report form can be directed to S. Rosenwinkel of the BPSP - Region 2 at (609)292-4860.

New Jersey Department of Environmental Protection
Division of Water Quality

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT	MONITORING PERIOD				MONITORED LOCATION:			
NJ0005622	Month 6	Day 1	Year 2006	To	Month 6	Day 30	Year 2006	487B - SW Outfall 487B

PERMITTEE:

PSE&G NUCLEAR LLC
ALLOWAY CREEK NEAK RD - PO BOX
236/N21
HANCOCKS BRIDGE, NJ 08038

LOCATION OF ACTIVITY:

PSE&G NUCLEAR LLC
ALLOWAY CREEK NECK RD
LOWER ALLOWAYS CREEK, NJ 08038-0000

REPORT RECIPIENT:

PSE&G NUCLEAR LLC
PO BOX 236/N21
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE:




No Discharge this Monitoring Period



Monitoring Report Comments Attached

WHO MUST SIGN The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey water Pollution Control Act provides for penalties up to \$50,000 per violation.

Thomas P. Joyce, Site Vice President - Salem	N/A
NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR	GRADE AND REGISTRY NUMBER (IF APPLICABLE)
	07/19/2006
SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR	DATE
	856-339-2086
	AREA CODE/PHONE NUMBER

**For a local agency where the highest-ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have reviewed the attached discharge monitoring reports.

N/A	N/A	N/A	N/A
NAME AND TITLE	SIGNATURE	DATE	AREA CODE/PHONE NUMBER

New Jersey Department of Environmental Protection
Division of Water Quality

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT	MONITORING PERIOD						MONITORED LOCATION:	
NJ0005622	Month	Day	Year	To	Month	Day	Year	489A - SW Outfall 489A
	6	1	2006		6	30	2006	

PERMITTEE:

PSE&G NUCLEAR LLC
ALLOWAY CREEK NEAK RD - PO BOX
236/N21
HANCOCKS BRIDGE, NJ 08038

LOCATION OF ACTIVITY:

PSE&G NUCLEAR LLC
ALLOWAY CREEK NECK RD
LOWER ALLOWAYS CREEK, NJ 08038-0000

REPORT RECIPIENT:

PSE&G NUCLEAR LLC
PO BOX 236/N21
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE:

☐

No Discharge this Monitoring Period

☐

Monitoring Report Comments Attached

WHO MUST SIGN The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey water Pollution Control Act provides for penalties up to \$50,000 per violation.

Thomas P. Joyce, Site Vice President - Salem

N/A

NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR

GRADE AND REGISTRY NUMBER (IF APPLICABLE)

Thomas P. Joyce

07/19/2006

856-339-2086

SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR

DATE

AREA CODE/PHONE NUMBER

**For a local agency where the highest-ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have reviewed the attached discharge monitoring reports.

N/A

N/A

N/A

N/A

NAME AND TITLE

SIGNATURE

DATE

AREA CODE/PHONE NUMBER

Surface Water Discharge Monitoring Report

PI 46814

PERMIT NUMBER: NJ0005622 MONITORED LOCATION: 489A SW Outfall 489A MONITORING PERIOD: 6/1/2006 TO 6/30/2006 FACILITY NAME: PSEG NUCLEAR LLC SALEM GENERATION

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Flow, In Conduit or Thru Treatment Plant 50050 1 Effluent Gross Value	SAMPLE MEASUREMENT	0.1472	0.1472	MGD	*****	*****	*****	*****	0	1/ month	CALCTD
	PERMIT REQUIREMENT	REPORT 01MOAV	REPORT 01DAMX		*****	*****	*****			1/Month	CALCTD
	QL	*****	*****		*****	*****	*****				
pH 00400 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	7.4	*****	7.4	SU	0	1/ month	GRAB
	PERMIT REQUIREMENT	*****	*****		6.0 01DAMN	*****	9.0 01DAMX			1/Month	GRAB
	QL	*****	*****		*****	*****	*****				
Solids, Total Suspended 00530 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	7	7	*****	MG/L	0	1/ month	GRAB
	PERMIT REQUIREMENT	*****	*****		100 01DAMX	30 01MOAV	*****			1/Month	GRAB
	QL	*****	*****		*****	*****	*****				
Petroleum Hydrocarbons 00551 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	<0.5	<0.5	MG/L	0	1/ month	GRAB
	PERMIT REQUIREMENT	*****	*****		*****	10 01MOAV	15 01DAMX			1/Month	GRAB
	QL	*****	*****		*****	*****	*****				
Carbon, Tot Organic (TOC) 00680 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	6	6	MG/L	0	1/ month	GRAB
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	50 01DAMX			1/Month	GRAB
	QL	*****	*****		*****	*****	*****				
Lab Certification # 99999 99 Lab	SAMPLE MEASUREMENT	17327	06431		17451	---					
	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #			Not Applic	NOT AP
	QL	*****	*****		*****	*****	*****				

Comments: If there are any questions in regards to the monitoring report form, please contact Susan Rosenwinkel of the the BPSP - Region 2 at (609)292-4860 or via email at "srosenw@dep.state.nj.us".