

FAX TRANSMITTAL


of pages 3

Phil Timmons Collins
 155310
 551-5569
 NSN 7540-01-317-7368 5009-101 GENERAL SERVICES ADMINISTRATION

FIGURE 5.7
 WELL LOCATIONS
 (TYPICAL)

10-23-87
 EPA Drinking H₂O Standard
 for TCE = 5PPB

R2/E23

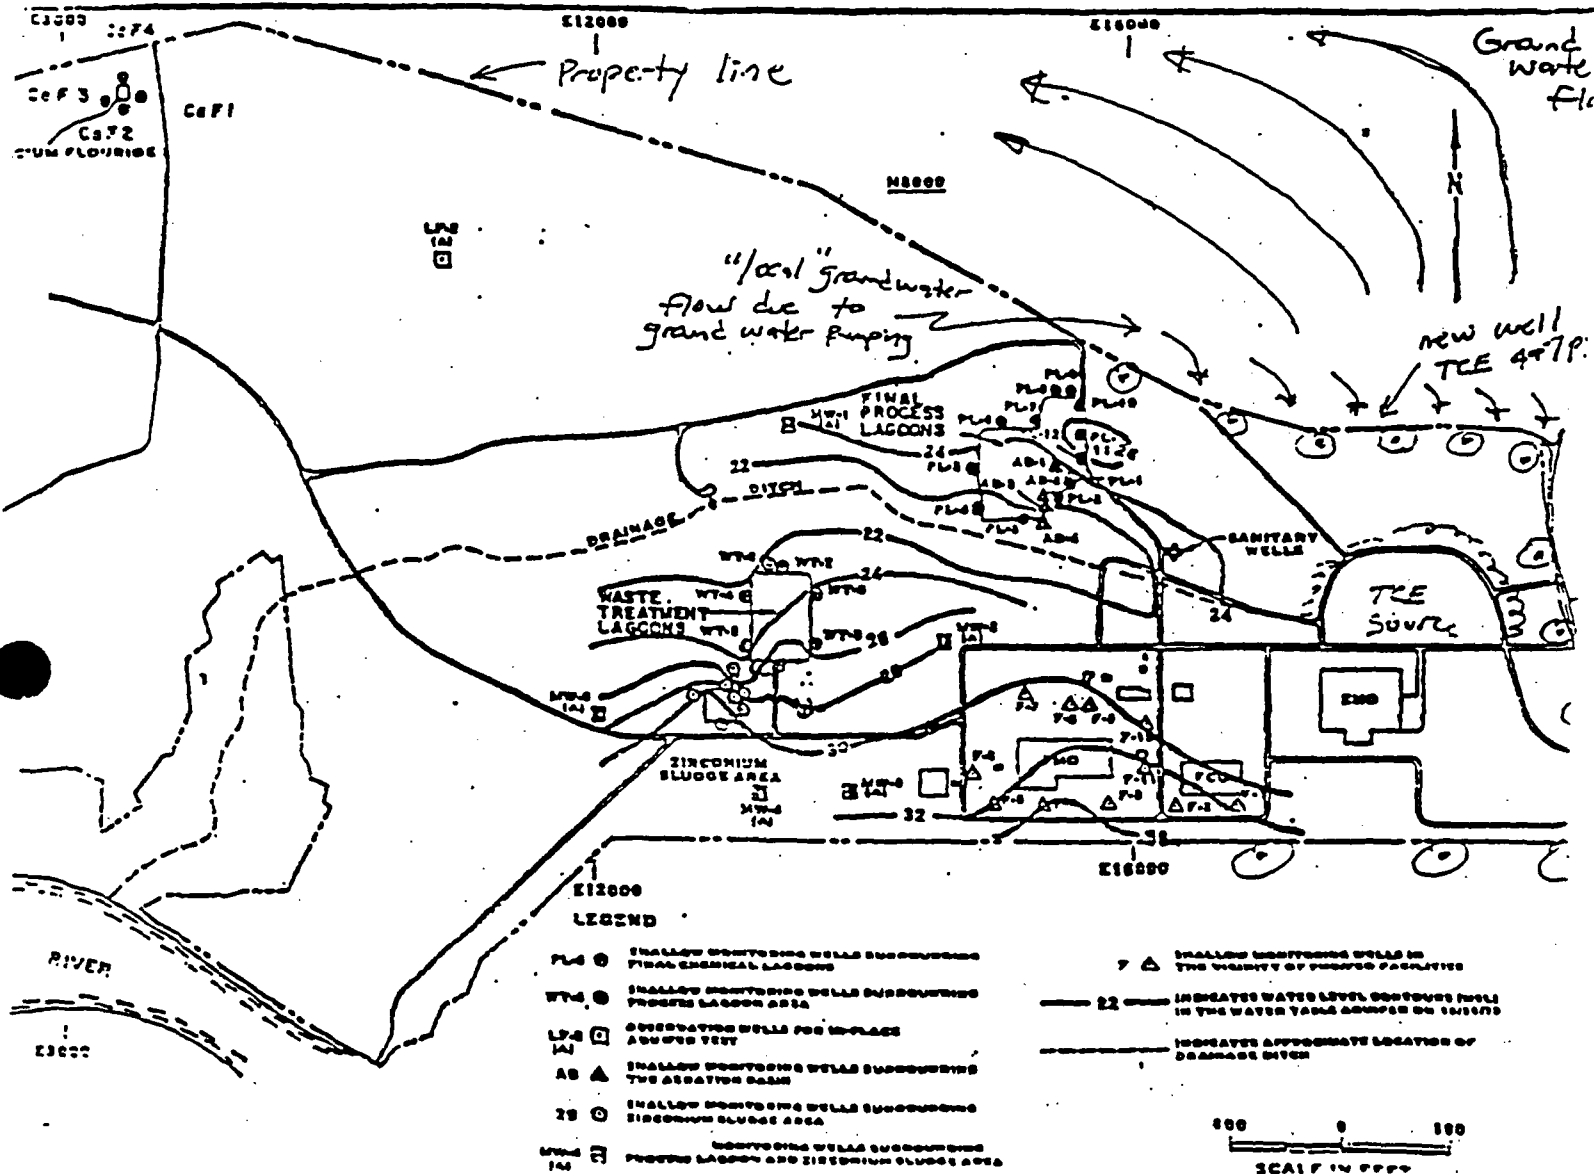

7-1