




**GE Energy Nuclear**

**26A6642BH  
Revision 3  
February 2007**

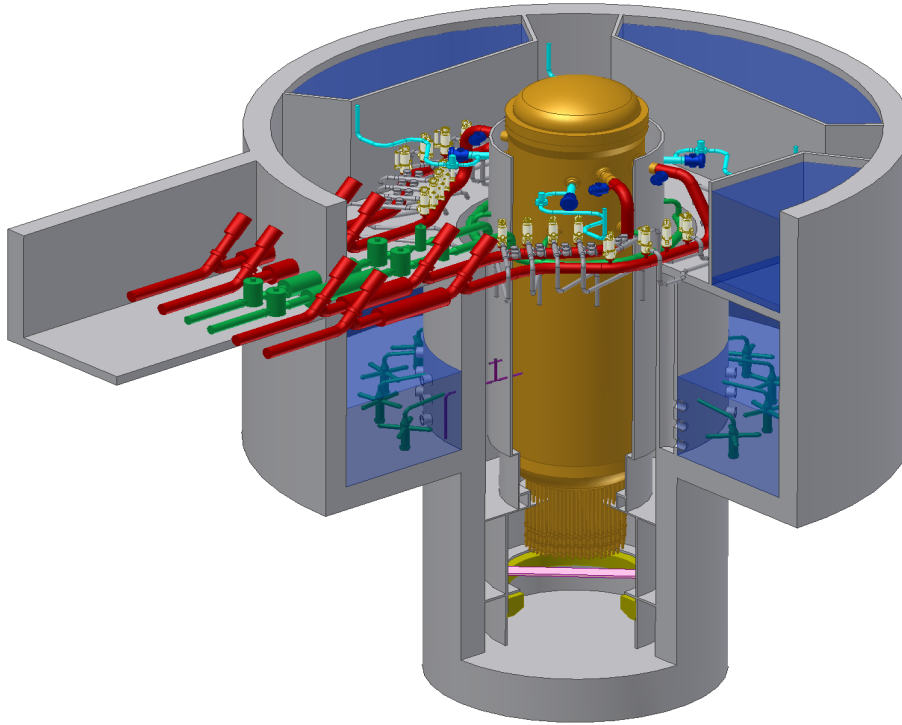

# **ESBWR Design Control Document**

## **Tier 2**

### **Chapter 11**

#### ***Radioactive Waste Management***



## Contents

11. Radioactive Waste Management	11.1-1
11.1 SOURCE TERMS	11.1-1
11.1.1 Fission Products	11.1-1
11.1.2 Activation Products	11.1-3
11.1.3 Radionuclide Concentration Adjustment	11.1-4
11.1.4 Fuel Fission Production Inventory	11.1-5
11.1.5 Process Leakage Sources	11.1-5
11.1.6 References	11.1-6
11.2 LIQUID WASTE MANAGEMENT SYSTEM	11.2-1
11.2.1 Design Bases	11.2-1
11.2.2 System Description	11.2-3
11.2.2.1 Summary Description	11.2-3
11.2.2.2 System Operation	11.2-3
11.2.2.3 Detailed System Component Description	11.2-5
11.2.3 Safety Evaluation - Radioactive Releases	11.2-7
11.2.4 Testing and Inspection Requirements	11.2-8
11.2.5 Instrumentation Requirements	11.2-8
11.2.6 COL Information	11.2-9
11.2.7 References	11.2-9
11.3 GASEOUS WASTE MANAGEMENT SYSTEM	11.3-1
11.3.1 Design Bases	11.3-1
11.3.2 Offgas System Description	11.3-2
11.3.2.1 Process Design	11.3-4
11.3.2.2 Component Design	11.3-8
11.3.2.3 Seismic Design	11.3-11
11.3.3 Ventilation System	11.3-11
11.3.4 Radioactive Releases	11.3-11
11.3.5 Testing and Inspection Requirements	11.3-11
11.3.6 Instrumentation Requirements	11.3-12
11.3.7 Radioactive OffGas System Leak or Failure	11.3-12
11.3.7.1 Basis and Assumptions	11.3-12
11.3.7.2 Results	11.3-13
11.3.8 COL Information	11.3-13
11.3.9 References	11.3-13
11.4 SOLID WASTE MANAGEMENT SYSTEM	11.4-1
11.4.1 Design Bases	11.4-1
11.4.2 System Description	11.4-3
11.4.2.1 Summary Description	11.4-3
11.4.2.2 System Operation	11.4-3
11.4.2.3 Detailed System Component Description	11.4-6
11.4.3 Safety Evaluation	11.4-8
11.4.4 Testing and Inspection Requirements	11.4-8
11.4.5 Instrumentation Requirements	11.4-8

11.4.6 COL Information	11.4-9
11.4.7 References	11.4-10
11.5 PROCESS RADIATION MONITORING SYSTEM	11.5-1
11.5.1 Design Bases	11.5-1
11.5.1.1 Design Objectives	11.5-1
11.5.2 System Design Bases and Criteria	11.5-2
11.5.2.1 Radiation Monitors Required for Safety	11.5-3
11.5.2.2 Radiation Monitors Required for Plant Operation	11.5-4
11.5.3 Subsystem Description	11.5-4
11.5.3.1 Radiation Monitors Required for Safety	11.5-4
11.5.3.2 Radiation Monitors Required for Plant Operation	11.5-9
11.5.4 Regulatory Evaluation	11.5-16
11.5.4.1 Basis for Monitor Location Selection	11.5-16
11.5.4.2 Expected Radiation Levels	11.5-16
11.5.4.3 Instrumentation	11.5-16
11.5.4.4 Setpoints	11.5-16
11.5.4.5 Offsite Dose Calculation Manual	11.5-16
11.5.4.6 Process and Effluent Monitoring Program	11.5-17
11.5.4.7 Site Specific Offsite Dose Calculation	11.5-17
11.5.4.8 Instrument Sensitivities	11.5-17
11.5.5 Process Monitoring and Sampling	11.5-17
11.5.5.1 Implementation of General Design Criterion 19	11.5-17
11.5.5.2 Implementation of General Design Criterion 60	11.5-17
11.5.5.3 Implementation of General Design Criterion 63	11.5-18
11.5.5.4 Implementation of General Design Criterion 64	11.5-18
11.5.5.5 Basis for Monitor Location Selection	11.5-19
11.5.5.6 Expected Radiation Levels	11.5-19
11.5.5.7 Instrumentation	11.5-19
11.5.5.8 Setpoints	11.5-19
11.5.5.9 Process and Post-Accident Sampling Programs – Regulatory Compliance	11.5-19
11.5.6 Calibration and Maintenance	11.5-20
11.5.6.1 Inspection and Tests	11.5-20
11.5.6.2 Calibration	11.5-21
11.5.6.3 Maintenance	11.5-21
11.5.7 COL Information	11.5-21
11.5.7.2 Offsite Dose Calculation Manual	11.5-21
11.5.7.3 Process and Effluent Monitoring Program	11.5-22
11.5.7.4 Site Specific Offsite Dose Calculation	11.5-22
11.5.7.5 Instrument Sensitivities	11.5-22
11.5.8 References	11.5-22

### List of Tables

Table 11.1-1	Source Term Design Basis Parameters
Table 11.1-2a	Design Basis Noble Radiogas Source Terms in Steam
Table 11.1-2b	Normal Operational Noble Radiogas Source Terms in Steam
Table 11.1-3	Calculational Parameters For Source Term Adjustment
Table 11.1-4a	Design Basis Iodine Radioisotopes in Reactor Water and Steam
Table 11.1-4b	Normal Operational Iodine Radioisotopes in Reactor Water and Steam
Table 11.1-5a	Design Basis Non-volatile Fission Products In Reactor Water
Table 11.1-5b	Normal Operational Non-volatile Fission Products In Reactor Water
Table 11.1-6	Design Basis*** N <sup>16</sup> Concentrations in Reactor Water and Steam
Table 11.1-7a	Design Basis Non-coolant Activation Products in Reactor Water
Table 11.1-7b	Normal Operational Non-coolant Activation Products in Reactor Water
Table 11.2-1	Equipment Codes (from Table 1, RG 1.143)
Table 11.2-2a	LWMS Component Capacity (Tanks)*
Table 11.2-2b	LWMS Component Capacity (Pumps)*
Table 11.2-2c	LWMS Component Capacity (Mobile Systems)
Table 11.2-3	Decontamination Factors
Table 11.2-4	Probable Inputs to LWMS from Operational Occurrences
Table 11.3-1	Offgas System Design Parameters*
Table 11.3-2	Offgas System Major Equipment Items
Table 11.3-3	Equipment Malfunction Analysis
Table 11.3-4	Offgas System Failure Accident Parameters
Table 11.3-5	Isotopic Source Rates for Design Basis*
Table 11.3-6	Releases to the Environment
Table 11.3-7	Offgas System Failure Meteorology and Dose Results
Table 11.4-1	SWMS Component Capacities
Table 11.4-2	Annual Shipped Waste Volumes*
Table 11.5-1	Process and Effluent Radiation Monitoring Systems
Table 11.5-2	Process Radiation Monitoring System (Gaseous and Airborne Monitors)
Table 11.5-3	Key to Radiation Monitors Shown on Figure 11.5-1
Table 11.5-4	Process Radiation Monitoring System (Liquid Monitors)
Table 11.5-5	Provisions for Sampling Liquid Streams
Table 11.5-6	Provisions for Sampling Gaseous Streams
Table 11.5-7	Radiological Analysis Summary of Liquid Effluent Samples
Table 11.5-8	Radiological Analysis Summary of Gaseous Effluent Samples
Table 11.5-9	Process Radiation Monitoring System Estimated Dynamic Ranges

**List of Illustrations**

- Figure 11.2-1. Liquid Waste Management System Process Diagram\*
- Figure 11.2-2. Liquid Waste Management System Process Stream Information Directory
- Figure 11.3-1. Offgas System
- Figure 11.4-1. Solid Waste Management System Process Diagram\*
- Figure 11.5-1. Location of Radiation Monitors
- Figure 11.5-2. PRMS Channel Block Diagram

## Abbreviations And Acronyms

<b><u>Term</u></b>	<b><u>Definition</u></b>
10 CFR	Title 10, Code of Federal Regulations
AEC	Atomic Energy Commission
AHU	Air Handling Unit
AISC	American Institute of Steel Construction
ALARA	As Low As Reasonably Achievable
ANS	American Nuclear Society
ANSI	American National Standards Institute
API	American Petroleum Institute
ASME	American Society of Mechanical Engineers
BTP	Branch Technical Position
BWR	Boiling Water Reactor
CFR	Code of Federal Regulations
COL	Combined Operating License
CONAVS	Reactor Building Contaminated Area HVAC Subsystem
DAW	Dry Active Waste
DBA	Design Basis Accident
DCD	Design Control Document
DF	Decontamination Factor
DOT	Department of Transportation
ETSB	Effluent Treatment Systems Branch
FAPCS	Fuel and Auxiliary Pools Cooling System
FB	Fuel Building
FBHV	Fuel Building HVAC
FUHA	Fuel Handling Accident
GDC	General Design Criteria
GE	General Electric Company
GE-NE	GE Nuclear Energy
HCW	High Conductivity Waste
HEPA	High Efficiency Particulate Air/Absolute
HIC	High Integrity Container
HVAC	Heating, Ventilation and Air Conditioning
HWC	Hydrogen Water Chemistry
IE	Inspection and Enforcement
IEB	Inspection and Enforcement Bulletin
IEEE	Institute of Electrical and Electronic Engineers
LCW	Low Conductivity Waste
LWMS	Liquid Waste Management System
MCR	Main Control Room
MSL	Main Steamline

<b><u>Term</u></b>	<b><u>Definition</u></b>
MVP	Mechanical Vacuum Pump
N-DCIS	Nonsafety-Related Distributed Control and Information System
NPDES	National Pollutant Discharge Elimination System
NRC	Nuclear Regulatory Commission
NS	Non-seismic
ODCM	Offsite Dose Calculation Manual
OGS	Offgas System
ORNL	Oak Ridge National Laboratory
PFD	Process Flow Diagram
PM	Preventive Maintenance
PRMS	Process Radiation Monitoring System
Q-DCIS	Safety-Related Distributed Control and Information System
RB	Reactor Building
RCCWS	Reactor Component Cooling Water System
REMP	Radiological Effluent Monitoring Program
REPAVS	Reactor Building Refueling and Pool Area HVAC Subsystem
RETS	Radiological Effluent Technical Specifications
RG	Regulatory Guide
RMS	Root Mean Square
RMS	Radiation Monitoring Subsystem
RO	Reverse Osmosis
RW	Radwaste Building
RWBCR	Radwaste Building Control Room
RWBGA	Radwaste Building General Area
RWCU/SDC	Reactor Water Cleanup/Shutdown Cooling
SCU	Signal Conditioning Units
SDS	System Design Specification
SJAE	Steam Jet Air Ejector
SRP	Standard Review Plan
SWMS	Solid Waste Management System
TB	Turbine Building
TBHV	Turbine Building HVAC
TS	Technical Specification(s)
TSC	Technical Support Center
USNRC	United States Nuclear Regulatory Commission
USS	United States Standard
VDU	Video Display Unit

## 11. RADIOACTIVE WASTE MANAGEMENT

### 11.1 SOURCE TERMS

The information provided in this section defines the radioactive source terms in the reactor water and steam which serve as design bases for the gaseous, liquid and solid radioactive waste management systems.

Radioactive source term data for boiling water reactors has been incorporated in American National Standard Institute (ANSI)/American Nuclear Society (ANS) 18.1 (Reference 11.1-1). This standard provides bases for estimating typical concentrations of the principal radionuclides that may be anticipated over the lifetime of a BWR plant. The source term data is based on the cumulative industry experience at operating BWR plants, including measurements at several stations. It therefore reflects the influence of a number of observations made during the transition period from operation with fuel of older designs to operation with fuel of current improved designs. The source terms specified in this section were obtained by applying the procedures of Reference 11.1-1 for estimation of typical source terms and adjusting the results upward, as appropriate, to assure conservative bases for design.

The various radionuclides included in the design basis term have been categorized as fission products or activation products and tabulated in the subsections that follow. The lists do not necessarily include all radionuclides that may be detectable or theoretically predicted to be present.

Those that have been included are considered to be potentially significant with respect to one or more of the following criteria:

- Plant equipment design,
- Shielding design,
- Understanding system operation and performance,
- Measurement practicability.

The values provided in this section are not valid for calculation of environmental releases. Ratio factors are given in Table 11.1-1 and are discussed in Subsection 12.2.2.

#### 11.1.1 Fission Products

##### *Noble Radiogas Fission Products*

Typical concentrations of the 13 principle noble gas fission products as observed in steam flowing from the reactor vessel are provided in the Source Term Standard ANSI/ANS-18.1 (Reference 11.1-1). Concentrations in the reactor water are considered negligible, under normal power operation because all of the gases released to the coolant are assumed to be rapidly transported out of the vessel with the steam and removed from the system with the other non-condensables in the main condenser. As a result of the rapid removal of the gases, the expected relative mix of gases does not depend on the reactor design.

The design basis noble gas source term mixture is from Reference 11.1-1, and is the release rates for the 13 principle noble gases from the vessel. The noble radiogas source term rate after 30-minute decay has been used as a conventional measure of the fuel leakage rate, because it is



conveniently measurable and was consistent with the nominal 30-minute offgas holdup system used on a number of early plants. A design basis noble gas release rate of 3,700 MBq/sec (100,000  $\mu\text{Ci/sec}$ ) at 30 minutes decay has historically been used for the design of the gaseous waste treatment systems in BWR plants (Reference 11.1-2) with satisfactory results. It was selected on the basis of operating experience with consideration given to several judgmental factors, including the implications to environmental releases, system contamination, and building air contamination. The design basis principle noble radiogas source terms are presented in Table 11.1-2a.

### ***Radioiodine Fission Products***

For many years, design basis radioiodine source terms for BWRs have been specified to be consistent with an  $\text{I}^{131}$  leak rate of 26 MBq/sec (700  $\mu\text{Ci/sec}$ ) from the fuel (Reference 11.1-2). Experience indicated that  $\text{I}^{131}$  leakage rates this high would be approached only during operation with substantial fuel cladding defects.

The design basis reactor water radioiodine concentrations are based on the relative mix of radioiodines in reactor water predicted by the data of Reference 11.1-1 with magnitudes increased such that the  $\text{I}^{131}$  concentration is consistent with the Table 11.1-1 release rate from the fuel. This provides a margin relative to the expected  $\text{I}^{131}$  release rate shown in Table 11.1-1. Reference 11.1-1 specifies expected concentrations of the 5 principal radioiodines in reactor water for a reference BWR design and provides bases for adjusting the concentrations for plants with relevant plant parameters that do not match those of the reference plant. The concentration adjustment factors were calculated as described in Subsection 12.2.2 using the plant parameters in Table 11.1-3. The scale factor required to increase the concentration of  $\text{I}^{131}$  from the concentration calculated using Reference 11.1-1 to the design basis value is shown in Table 11.1-1. The design basis concentrations are presented in Table 11.1-4a.

The ratio of concentration in reactor steam to concentration in reactor water (carryover ratio) is taken to be 0.02 for radioiodines (Reference 11.1-1). Consequently, the design basis concentrations of radioiodines in steam are defined by multiplying the values of Table 11.1-4a by the factor 0.02.

### ***Other Fission Products***

This category includes fission products other than noble gases and iodines and also includes transuranic nuclides. Some of the fission products are noble gas daughter products that are produced in the steam and condensate system. The only transuranic which is detectable in significant concentrations is  $\text{Np}^{239}$ . Concentrations of those radionuclides that are typically observable in the coolant are provided in Reference 11.1-1 for a Reference BWR plant. The Reference plant concentrations are adjusted to obtain estimates for the ESBWR plant by using the procedure described in Subsection 11.1.3 and appropriate data from Table 11.1-3. In order to assure conservative design basis concentrations for the ESBWR, the results were increased by the factor used to obtain design basis radioiodine concentrations. The design basis reactor water concentrations are presented in Table 11.1-5a. The ratio of concentration in steam to concentration in water (carryover) for these nuclides is expected to be less than 0.001 (Reference 11.1-1). The design basis concentrations in steam are obtained by multiplying the values in Table 11.1-5a by 0.001 (Reference 11.1-1).

### 11.1.2 Activation Products

#### *Coolant Activation Products*

The coolant activation product of primary importance in BWRs is  $N^{16}$ . ANSI/ANS-18.1 (Reference 11.1-1) specifies a concentration of 1.85 MBq/gm (50  $\mu$ Ci/gm) in steam leaving the reactor vessel for plants without Hydrogen Water Chemistry (HWC). Plants with HWC are specified at 9.25 MBq/gm (250  $\mu$ Ci/gm). This HWC concentration is used as the design basis  $N^{16}$  concentration in steam for ESBWR. This is treated as essentially independent of reactor design because both the production rate of  $N^{16}$  and the steam flow rate from the vessel are assumed to vary in direct proportion to reactor thermal power. It should be noted that a portion of the source term traditionally identified as " $N^{16}$ " actually represents  $C^{15}$ . To the extent that  $C^{15}$  is present, it is generally about  $\sim 0.55$  MBq/gm (15  $\mu$ Ci/gm) or less. Historically, gross gamma dose rate measurements made to confirm the magnitude of the  $N^{16}$  concentration have included responses to gamma rays from  $C^{15}$ . Use of the combined " $N^{16}$ " source term in shielding design introduces additional conservatism because the  $C^{15}$  component has a 2.45 second half-life, and therefore decays more rapidly with transport time through the system than  $N^{16}$ , which has a 7.1 second half-life.

The design basis  $N^{16}$  concentrations in steam and reactor water are shown in Table 11.1-6. Reference 11.1-1 gives the reactor water concentration at the recirculation system. Because the ESBWR does not have an external recirculation loop, the reactor water concentration has been decay-corrected to the reactor core exit to obtain an estimated value shown in Table 11.1-1.

#### *Noncoolant Activation Products*

Radionuclides are produced in the coolant by neutron activation of circulating impurities and by corrosion of irradiated system materials. Typical reactor water concentrations for the principal activation products are contained in Reference 11.1-1. The values of Reference 11.1-1 were adjusted to ESBWR conditions by using the procedure described in Subsection 11.1.3 and appropriate data from Table 11.1-3. These results were increased by the same factor used for the design basis radioiodine concentrations to obtain the conservative design basis reactor water concentrations shown in Table 11.1-7a. The steam carryover ratio for these isotopes is estimated to be less than 0.001 (Reference 11.1-1). A factor of 0.001 is applied to the Table 11.1-7a values to obtain the design basis concentrations in steam.

#### *Tritium*

Tritium is produced by activation of naturally occurring deuterium in the primary coolant and, to a lesser extent, as a fission product in the fuel (Reference 11.1-2). The tritium is primarily present as tritiated oxide, T-O-H. Because tritium has a long half-life (12 years) and is not affected by cleanup processes in the system, the concentration is controlled by the rate of loss of water from the system by evaporation or leakage (Reference 11.1-1). Plant process water and steam have a common tritium concentration. The concentration reached depends on the actual water loss rate; however, References 11.1-1 and 11.1-3 both specify a typical concentration of 370 Bq/gm (0.01  $\mu$ Ci/gm) that is stated in Reference 11.1-3 to be based on BWR experience adjusted to account for liquid recycle. This value is taken to be applicable for the ESBWR.

***Argon-41***

Argon-41 is produced in the reactor coolant as a consequence of neutron activation of naturally occurring Argon-40 in air that is entrained in the feedwater. The Argon-41 gas is carried out of the vessel with the steam and stripped from the system with the non-condensables in the main condenser. Observed Argon-41 levels are highly variable due to the variability in air in-leakage rates into the system. Reference 11.1-3 specifies an Argon-41 release rate from the vessel of 1.5 MBq/sec (40  $\mu$ Ci/sec) for a 3400 MW Reference BWR. This value bounded the available experimental database. Based on adjusting to the ESBWR thermal power (4,500 MW), a design basis Argon-41 release rate specified for the ESBWR is shown in Table 11.1-1.

**11.1.3 Radionuclide Concentration Adjustment**

In order to determine the estimated concentrations of radionuclides in the groups classified as iodines, other non-volatile fission products, and non-coolant activation products using the ANSI/ANS-18.1 Source Term Standard (Reference 11.1-1), it is necessary to apply appropriate adjustment factors to the Reference Plant concentrations provided in the Standard.

Equilibrium concentrations in reactor water are assumed to satisfy the relationship:

$$C = \frac{S}{M(\lambda + R)} \quad (11.1-1)$$

where:

C = radionuclide concentration

S = radionuclide input rate to coolant

M = reactor water mass

$\lambda$  = radionuclide decay constant

R = sum of removal rates of the radionuclide from the system.

Consequently, if the radionuclide input rate is taken to depend primarily on the reactor thermal power, the adjustment factors to be applied to the Reference Plant reactor water concentrations are given by:

$$\text{Adjustment Factor} = \frac{P M_r (\lambda + R_r)}{P_r M (\lambda + R)} \quad (11.1-2)$$

where the subscript "r" refers to the Reference Plant, P is the reactor thermal power and M,  $\lambda$ , and R are as defined above.

The removal rate from the system is the sum of the removal rates due to the Reactor Water Cleanup System and the condensate demineralizer and is given by:

$$R = \frac{F_c E_c + F_s A B E_s}{M} \quad (11.1-3)$$

where:

$F_c$  = cleanup system flow rate

$E_c$  = fraction of radionuclide removed in cleanup demineralizer

$F_s$  = steam flow rate

$A$  = ratio of radionuclide concentration in steam to concentration in water (carryover ratio)

$B$  = fraction of radionuclide in steam which is circulated through the condensate demineralizer

$E_s$  = fraction of radionuclide removed in condensate demineralizer.

The Reference Plant and ESBWR plant parameters and the nuclide-dependent removal rate parameters used for the ESBWR are shown in Table 11.1-3. The nuclide-dependent parameters are the same as those used for the Reference Plant except for the fraction circulated through the condensate demineralizer.

#### 11.1.4 Fuel Fission Production Inventory

Fuel fission product inventory information is used in establishing fission product source terms for accident analysis and is discussed in Chapter 15.

#### 11.1.5 Process Leakage Sources

Process leakage results in potential release of noble gases and other volatile fission products via ventilation systems. Liquid from process leaks is collected and routed to the liquid-solid radwaste system. With the effective process offgas treatment systems now in use, the ventilation releases are relatively insignificant contributions to total plant releases.

Leakage of fluids from the process system results in the release of radionuclides into plant buildings. In general, the noble radiogases remain airborne and are released to the atmosphere with little delay via the building ventilation exhaust ducts. Other radionuclides partition between air and water and may plate-out on metal surfaces, concrete, and paint. Radioiodines are found in ventilation air as methyl iodide and as inorganic iodine (particulate, elemental, and hypoiodous acid forms).

As a consequence of normal steam and water leakage into the drywell, equilibrium drywell concentrations exist during normal operation. Purging of this activity from the drywell to the environment occurs via the Reactor Building Contaminate Area HVAC Subsystem (CONAVS) as described in Subsection 9.4.6.2.

Subsection 1.2.2.3 delineates the models, parameters, and sources required to evaluate the airborne concentrations of radionuclides during plant operations in various plant radiation areas due to process leakage.

Airborne release data from BWR building ventilation systems and the main condenser Mechanical Vacuum Pump (MVP) have been compiled and evaluated in Reference 11.1-4, which contains data obtained by utility personnel and from special in-plant studies of operating BWR plants by independent organizations and by General Electric Nuclear Energy (GE-NE).

Releases due to process leakage are reflected in the airborne release estimates discussed in Subsection 12.2.2.

#### 11.1.6 References

- 11.1-1 ANSI/ANS, "American National Standard Radioactive Source Term for Normal Operation of Light Water Reactors," ANSI/ANS-18.1-1999.
- 11.1-2 General Electric Company, "Technical Derivation of BWR 1971 Design Basis Radioactive Material Source Terms," NEDO-10871, March 1973.
- 11.1-3 United States Nuclear Regulatory Commission (USNRC), "Calculation of Releases of Radioactive Materials in Gaseous and Liquid Effluents from Boiling Water Reactors (BWR)," NUREG-0016, Revision 1, January 1979.
- 11.1-4 General Electric Company, "Airborne Releases From BWRs for Environmental Impact Evaluations," NEDO-21159, March 1976.

**Table 11.1-1**  
**Source Term Design Basis Parameters**

Parameter	Value
Total of the design basis release rates of the 13 noble gases (30 minute decay reference, t30)	3700 MBq/sec ( 100,000 $\mu$ Ci/sec)
Normal operational noble gas release rate (t30)	740 MBq/sec (20,000 $\mu$ Ci/sec)
Design basis I-131 radioiodine core release rate	26 MBq/sec ( 700 $\mu$ Ci/sec)
Expected I-131 radioiodine core release rate	3.7 MBq/sec ( 100 $\mu$ Ci/sec)
I <sup>131</sup> concentration scale factor	5
Reactor core exit N <sup>16</sup> concentration (design basis same as normal operation)	1.85 MBq/gm ( 50 $\mu$ Ci/gm) w/o HWC 9.25 MBq/gm ( 250 $\mu$ Ci/gm) w/HWC
Design basis Argon <sup>41</sup> release rate	2.0 MBq/sec (54 $\mu$ Ci/sec)
Normal operational Argon <sup>41</sup> release rate	0.4 MBq/sec (11 $\mu$ Ci/sec)

**Table 11.1-2a**  
**Design Basis Noble Radiogas Source Terms in Steam**

<b>Isotope</b>	<b>Decay Constant</b>	<b>Steam Concentration</b>		<b>Source Term at t=30min</b>	
	(per hour)	(MBq/gm)	( $\mu$ Ci/gm)	(MBq/sec)	( $\mu$ Ci/sec)
Kr-83m	3.73E-1	5.4E-05	1.5E-03	1.1E+02	2.9E+03
Kr-85m	1.55E-1	9.1E-05	2.5E-03	2.0E+02	5.5E+03
Kr-85	7.37E-6	3.6E-07	9.8E-06	8.9E-01	2.4E+01
Kr-87	5.47E-1	3.0E-04	8.1E-03	5.6E+02	1.5E+04
Kr-88	2.48E-1	3.0E-04	8.1E-03	6.5E+02	1.7E+04
Kr-89	1.32E+1	1.9E-03	5.2E-02	6.4E+00	1.7E+02
Xe-131m	2.41E-3	3.0E-07	8.1E-06	7.3E-01	2.0E+01
Xe-133m	1.30E-2	4.5E-06	1.2E-04	1.1E+01	2.9E+02
Xe-133	5.46E-3	1.3E-04	3.4E-03	3.1E+02	8.4E+03
Xe-135m	2.72E+0	4.0E-04	1.1E-02	2.5E+02	6.8E+03
Xe-135	7.56E-2	3.5E-04	9.4E-03	8.1E+02	2.2E+04
Xe-137	1.08E+1	2.4E-03	6.4E-02	2.6E+01	6.9E+02
Xe-138	2.93E+0	1.4E-03	3.7E-02	7.7E+02	2.1E+04
Totals		7.3E-03	2.0E-01	3.7E+03	1.0E+05

**Table 11.1-2b**  
**Normal Operational Noble Radiogas Source Terms in Steam**

<b>Isotope</b>	<b>Decay Constant</b>	<b>Steam Concentration</b>		<b>Source Term at t=30min</b>	
	(per hour)	(MBq/gm)	( $\mu$ Ci/gm)	(MBq/sec)	( $\mu$ Ci/sec)
Kr-83m	3.73E-1	1.1E-05	2.9E-04	2.2E+01	5.9E+02
Kr-85m	1.55E-1	1.8E-05	4.9E-04	4.1E+01	1.1E+03
Kr-85	7.37E-6	7.3E-08	2.0E-06	1.8E-01	4.8E+00
Kr-87	5.47E-1	6.0E-05	1.6E-03	1.1E+02	3.0E+03
Kr-88	2.48E-1	6.0E-05	1.6E-03	1.3E+02	3.5E+03
Kr-89	1.32E+1	3.8E-04	1.0E-02	1.3E+00	3.5E+01
Xe-131m	2.41E-3	6.0E-08	1.6E-06	1.5E-01	3.9E+00
Xe-133m	1.30E-2	8.9E-07	2.4E-05	2.2E+00	5.8E+01
Xe-133	5.46E-3	2.6E-05	6.9E-04	6.2E+01	1.7E+03
Xe-135m	2.72E+0	8.0E-05	2.2E-03	5.0E+01	1.4E+03
Xe-135	7.56E-2	6.9E-05	1.9E-03	1.6E+02	4.4E+03
Xe-137	1.08E+1	4.7E-04	1.3E-02	5.1E+00	1.4E+02
Xe-138	2.93E+0	2.7E-04	7.4E-03	1.5E+02	4.2E+03
Totals		1.5E-03	3.9E-02	7.4E+02	2.0E+04



**Table 11.1-3**  
**Calculational Parameters For Source Term Adjustment**

A. Plant Parameters for Source Term Adjustment			
Parameter	Reference Plant	ESBWR	
Thermal Power, MWt	3400	4500	
Reactor Water Mass, kg	1.7E+5	3.06E+5	
Cleanup System Flow Rate, kg/hr	5.8E+4	8.76E+4	
Steam Flow Rate, kg/hr	6.8E+6	8.76E+6	
Ratio of Condensate Demineralizer Flow Rate to Steam Flow Rate.	1	1	
B. Removal Parameters for Source Term Adjustment			
Parameter	Iodines	Rb, Cs	All Others
Fraction removed by cleanup system	0.9	0.5	0.9
Fraction removed by condensate demineralizers	0.9	0.5	0.9
Ratio of concentration in steam and reactor water	0.02	0.001	0.001
Fraction of radionuclides in steam treated by condensate demineralizer.	1	1	1

**Table 11.1-4a**  
**Design Basis Iodine Radioisotopes in Reactor Water and Steam**

<b>Decay Constant</b>		<b>Water Concentration</b>		<b>Steam Concentration</b>	
<b>Isotope</b>	(per hour)	(MBq/gm)	( $\mu$ Ci/gm)	(MBq/gm)	( $\mu$ Ci/gm)
I-131	3.59E-3	3.9E-04	1.1E-02	7.9E-06	2.1E-04
I-132	3.03E-1	3.7E-03	9.9E-02	7.4E-05	2.0E-03
I-133	3.33E-2	2.7E-03	7.2E-02	5.3E-05	1.4E-03
I-134	7.91E-1	6.8E-03	1.8E-01	1.4E-04	3.7E-03
I-135	1.05E-1	3.8E-03	1.0E-01	7.6E-05	2.1E-03

**Table 11.1-4b**  
**Normal Operational Iodine Radioisotopes in Reactor Water and Steam**

<b>Decay Constant</b>		<b>Water Concentration</b>		<b>Steam Concentration</b>	
<b>Isotope</b>	(per hour)	(MBq/gm)	( $\mu$ Ci/gm)	(MBq/gm)	( $\mu$ Ci/gm)
I-131	3.59E-3	5.6E-05	1.5E-03	1.1E-06	3.0E-05
I-132	3.03E-1	5.3E-04	1.4E-02	1.1E-05	2.8E-04
I-133	3.33E-2	3.8E-04	1.0E-02	7.6E-06	2.0E-04
I-134	7.91E-1	9.7E-04	2.6E-02	1.9E-05	5.2E-04
I-135	1.05E-1	5.5E-04	1.5E-02	1.1E-05	3.0E-04

**Table 11.1-5a**  
**Design Basis Non-volatile Fission Products In Reactor Water**

<b>Isotope*</b>	<b>Decay Constant</b>	<b>Concentration</b>	
	(per hour)	(MBq/gm)	(μCi/gm)
Rb-89	2.74E+0	6.9E-04	1.9E-02
Sr-89	5.55E-4	1.7E-05	4.5E-04
Sr-90	2.81E-6	1.2E-06	3.1E-05
Y-90	2.81E-6	1.2E-06	3.1E-05
Sr-91	7.31E-2	6.4E-04	1.7E-02
Sr-92	2.56E-1	1.5E-03	4.1E-02
Y-91	4.93E-4	6.6E-06	1.8E-04
Y-92	1.96E-1	9.3E-04	2.5E-02
Y-93	6.80E-2	6.4E-04	1.7E-02
Zr-95/Nb-95	4.41E-4	1.3E-06	3.6E-05
Mo-99/Tc-99m	1.05E-2	3.3E-04	8.9E-03
Ru-103/Rh-103m	7.29E-4	3.3E-06	8.9E-05
Ru-106/Rh-106	7.83E-5	5.0E-07	1.3E-05
Te -129m	8.65E-4	6.6E-06	1.8E-04
Te-131m	2.31E-2	1.6E-05	4.4E-04
Te-132	8.89E-3	1.6E-06	4.5E-05
Cs-134	3.84E-5	4.5E-06	1.2E-04
Cs-136	2.22E-3	3.0E-06	8.0E-05
Cs-137/Ba-137m	2.63E-6	1.2E-05	3.2E-04
Cs-138	1.29E+0	1.4E-03	3.8E-02
Ba-140/La-140	2.26E-3	6.6E-05	1.8E-03
Ce-141	8.88E-4	5.0E-06	1.3E-04
Ce-144/Pr-144	1.02E-4	5.0E-07	1.3E-05
Np-239	1.24E-2	1.3E-03	3.6E-02

\* Nuclides shown as pairs are assumed to be in secular equilibrium. The parent decay constant and concentration are shown.

**Table 11.1-5b**  
**Normal Operational Non-volatile Fission Products In Reactor Water**

Isotope*	Decay Constant	Concentration	
	(per hour)	(MBq/gm)	(μCi/gm)
Rb-89	2.74E+0	9.9E-05	2.7E-03
Sr-89	5.55E-4	2.4E-06	6.4E-05
Sr-90	2.81E-6	1.7E-07	4.5E-06
Y-90	2.81E-6	1.7E-07	4.5E-06
Sr-91	7.31E-2	9.1E-05	2.5E-03
Sr-92	2.56E-1	2.2E-04	5.9E-03
Y-91	4.93E-4	9.5E-07	2.6E-05
Y-92	1.96E-1	1.3E-04	3.6E-03
Y-93	6.80E-2	9.2E-05	2.5E-03
Zr-95/Nb-95	4.41E-4	1.9E-07	5.1E-06
Mo-99/Tc-99m	1.05E-2	4.7E-05	1.3E-03
Ru-103/Rh-103m	7.29E-4	4.7E-07	1.3E-05
Ru-106/Rh-106	7.83E-5	7.1E-08	1.9E-06
Te -129m	8.65E-4	9.5E-07	2.6E-05
Te-131m	2.31E-2	2.3E-06	6.3E-05
Te-132	8.89E-3	2.4E-07	6.4E-06
Cs-134	3.84E-5	6.4E-07	1.7E-05
Cs-136	2.22E-3	4.3E-07	1.1E-05
Cs-137/Ba-137m	2.63E-6	1.7E-06	4.6E-05
Cs-138	1.29E+0	2.0E-04	5.4E-03
Ba-140/La-140	2.26E-3	9.4E-06	2.6E-04
Ce-141	8.88E-4	7.1E-07	1.9E-05
Ce-144/Pr-144	1.02E-4	7.1E-08	1.9E-06
Np-239	1.24E-2	1.9E-04	5.1E-03

\* Nuclides shown as pairs are assumed to be in secular equilibrium. The parent decay constant and concentration are shown.

**Table 11.1-6**  
**Design Basis\*\*\* N<sup>16</sup> Concentrations in Reactor Water and Steam**

<b>Isotope</b>	<b>Half-Life</b>	<b>Steam Concentration*</b>		<b>Reactor Water Concentration**</b>	
		(MBq/gm)	(μCi/gm)	(MBq/gm)	(μCi/gm)
N-16	7.13 sec	1.85	50	2.2	60

\* During operation with hydrogen water chemistry, increase this value by a factor of five.

\*\* Valid at core exit.

\*\*\* Normal operational concentrations are the same as design basis concentrations.

**Table 11.1-7a**  
**Design Basis Non-coolant Activation Products in Reactor Water**

<b>Isotope</b>	<b>Decay Constant</b>	<b>Concentration</b>	
	(per hour)	(MBq/gm)	(μCi/gm)
Na-24	4.63E-2	3.2E-04	8.7E-03
P-32	2.02E-3	6.6E-06	1.8E-04
Cr-51	1.04E-3	5.0E-04	1.3E-02
Mn-54	9.53E-5	5.8E-06	1.6E-04
Mn-56	2.69E-1	3.8E-03	1.0E-01
Fe-55	3.04E-5	1.7E-04	4.5E-03
Fe-59	6.33E-4	5.0E-06	1.3E-04
Co-58	4.05E-4	1.7E-05	4.5E-04
Co-60	1.50E-5	3.3E-05	8.9E-04
Ni-63	7.90E-7	1.7E-07	4.5E-06
Cu-64	5.42E-2	4.8E-04	1.3E-02
Zn-65	1.18E-4	1.7E-04	4.5E-03
Ag-110M	1.16E-4	1.7E-07	4.5E-06
W-187	2.90E-2	4.9E-05	1.3E-03

**Table 11.1-7b****Normal Operational Non-coolant Activation Products in Reactor Water**

<b>Decay Constant</b>		<b>Concentration</b>	
<b>Isotope</b>	(per hour)	(MBq/gm)	( $\mu$ Ci/gm)
Na-24	4.63E-2	4.6E-05	1.2E-03
P-32	2.02E-3	9.4E-07	2.6E-05
Cr-51	1.04E-3	7.1E-05	1.9E-03
Mn-54	9.53E-5	8.3E-07	2.2E-05
Mn-56	2.69E-1	5.4E-04	1.5E-02
Fe-55	3.04E-5	2.4E-05	6.4E-04
Fe-59	6.33E-4	7.1E-07	1.9E-05
Co-58	4.05E-4	2.4E-06	6.4E-05
Co-60	1.50E-5	4.7E-06	1.3E-04
Ni-63	7.90E-7	2.4E-08	6.4E-07
Cu-64	5.42E-2	6.9E-05	1.9E-03
Zn-65	1.18E-4	2.4E-05	6.4E-04
Ag-110M	1.16E-4	2.4E-08	6.4E-07
W-187	2.90E-2	7.0E-06	1.9E-04



## 11.2 LIQUID WASTE MANAGEMENT SYSTEM

The ESBWR Liquid Waste Management System (LWMS) is designed to control, collect, process, handle, store, and dispose of liquid radioactive waste generated as the result of normal operation, including anticipated operational occurrences.

The LWMS is housed in the radwaste building and consists of the following four subsystems:

- Equipment (low conductivity) drain subsystem;
- Floor (high conductivity) drain subsystem;
- Chemical drain subsystem;
- Detergent drain subsystem;

A LWMS Process Diagram depicting all four subsystems is provided in Figure 11.2-1. A LWMS Process Stream Information Directory and simplified flow diagram are provided in Figure 11.2-2. A conceptual radwaste building general arrangement is provided in Figures 1.2-21 thru 1.2-25. The LWMS equipment codes and component capacities are provided in Tables 11.2-1, 11.2-2a, 11.2-2b, and 11.2-2c, respectively. The process decontamination factors and normal and maximum daily inputs for the LWMS subsystems are provided in Tables 11.2-3 and 11.2-4, respectively.

The equipment and floor drainage collection system, a major input source to the LWMS, is described in Subsection 9.3.3.

Process and effluent radiological monitoring and sampling systems are described in Section 11.5.

The LWMS complies with Regulatory Guide 1.143 (Reference 11.2-1) guidance regarding liquid radwaste treatment systems.

### 11.2.1 Design Bases

#### *Safety Design Bases*

The LWMS has no safety-related function.

#### *Power Generation Design Bases*

- The LWMS has the capability to process the maximum anticipated quantities of liquid waste without impairing the operation or availability of the plant during both normal and anticipated operational occurrence conditions, satisfying the requirements of 10 Code of Federal Regulations (CFR) 20 (Reference 11.2-2), 10 CFR 50 and 50.34a (Reference 11.2-3) (see Table 11.2-4 for time to process maximum inputs).
- Alternate process subsystem cross-ties and adequate storage volumes are included in the LWMS design to provide for operational and anticipated surge waste volumes.
- The LWMS is designed so that no potentially radioactive liquids can be discharged to the environment unless they have first been monitored and diluted as required. Off-site radiation exposures on an annual average basis are within the limits of 10 CFR 20 (Reference 11.2-2) and 10 CFR 50 (Reference 11.2-3).

- The LWMS is designed to meet the requirements of General Design Criteria (GDC) 60 (Reference 11.2-4) and Regulatory Guide (RG) 1.143 (Reference 11.2-1). Regulatory Guide 1.143 provides radioactive waste management systems; structures and components design guidance; and quality group clarification and quality assurance provisions so that liquid waste as result of natural phenomena hazards and external man-induced hazards can be successfully processed. Further, it describes provisions for mitigating Design Basis Accidents (DBA) and controlling releases of liquids containing radioactive materials, e.g., spills or tank overflows, from all plant systems outside reactor containment.
- The LWMS is designed to keep the exposure to plant personnel “As Low As Reasonably Achievable” (ALARA) during normal operation and plant maintenance, in accordance with Regulatory Guide 8.8 (Reference 11.2-5).
- The seismic category, quality group classification, and corresponding codes and standards that apply to the design of the LWMS are discussed in Section 3.2.
- All atmospheric liquid radwaste tanks are provided with an overflow connection at least the size of the largest inlet connection. The overflow is connected below the tank vent and above the high-level alarm setpoint. Each collection tank room is designed to contain the maximum liquid inventory in the event that the tank ruptures.
- An evaluation is included in Chapter 12 to show that the proposed systems are capable of controlling releases of radioactive materials within the numerical design objectives of Appendix I to 10 CFR 50 (Reference 11.2-6).
- An evaluation is included in Chapter 12 to show that the proposed systems have sufficient capacity, redundancy, and flexibility to meet the concentration limits of 10 CFR 20 (Reference 11.2-2) during periods of equipment downtime and during operation at design basis fuel leakage.

Process and effluent radiological monitoring systems are described in Section 11.5.

The Combined Operating License (COL) holder is responsible, for identifying initial and subsequent, mobile/portable LWMS connections that are considered non-radioactive, but later become radioactive through interfaces with radioactive systems; i.e., a non-radioactive system becomes contaminated due to leakage, valving errors or other operating conditions in radioactive systems using the guidance and information in Inspection and Enforcement (IE) Bulletin 80-10 (May 6, 1980) (Reference 11.2-10).

The COL holder will include site-specific information in Section 11.2.1 describing how the implementation of operating procedures and design features for installation and operation of the mobile/portable LWMS will address the requirements of Part 20.1406 (Reference 11.2-9). Specifically the operational procedures and design of the mobile/portable LWMS should minimize, to the extent practicable, contamination of the facility and the environment, facilitate decommissioning, and minimize the generation of radioactive wastes. This information may be placed into Section 12.6 provided applicable referencing is included in Subsection 11.2.1.

## 11.2.2 System Description

### 11.2.2.1 Summary Description

The LWMS collects, monitors, processes, stores, and disposes of potentially radioactive liquid waste collected throughout the plant.

The equipment and floor drainage systems are described in Section 9.3.

Potentially radioactive liquid wastes are collected in tanks located in the radwaste building. System components are designed and arranged in shielded enclosures to minimize exposure to plant personnel during operation, inspection, and maintenance. Tanks, processing equipment, pumps, valves, and instruments that may contain radioactivity are located in controlled access areas.

The LWMS normally operates on a batch basis. Provisions for sampling at important process points are included. Protection against accidental discharge is provided by detection and alarm of abnormal conditions and by administrative controls.

The LWMS is divided into several subsystems, so that the liquid wastes from various sources can be segregated and processed separately, based on the most economical and efficient process for each specific type of impurity and chemical content. Cross-connections between subsystems provide additional flexibility in processing the wastes by alternate methods and provide redundancy if one subsystem is inoperative.

### 11.2.2.2 System Operation

The LWMS consists of the following four process subsystems:

#### ***Equipment (Low Conductivity) Drain Subsystem***

The equipment drain collection tanks receive low conductivity inputs from various sources within the plant. These waste inputs have a high chemical purity and are processed on a batch basis. The equipment drain subsystem consists of three collection tanks and collection pumps, a mobile based processing system (typically consisting of a collection of unit operations, reaction systems and their support equipment, such as filtration systems, Deep-Bed Ion Exchanger systems, organic material pre-treatment equipment, possibly an intermediate tank/pump and the associated plumbing, instrumentation and electrical systems as required), and two sample tanks and sample pumps. One collection tank is normally used as a surge tank that can collect waste from the low conductivity waste and/or High Conductivity Waste (HCW). Cross-connections with the floor drain subsystem allow processing through the mobile system for floor drain treatment.

A strainer or filter is typically provided downstream of the last ion exchanger in series to collect any crud and resin fines that may be present.

The process effluents are collected in one of the two sample tanks for chemical and radioactivity analysis. If acceptable, the tank contents are returned to the condensate storage tank for plant reuse. A recycle line from the sample tanks allows the sampled effluents that do not meet water quality requirements to be pumped back to an Equipment (Low Conductivity) Drain Collection Tank or Floor (High Conductivity) Drain Collection Tank for additional processing. If the plant condensate inventory is high, the sampled process effluent may be discharged.

Some unit operations such as filters are backwashed periodically to maintain capacity. Backwash waste is discharged to a phase separator. Spent deep-bed ion exchanger resin is either discharged to a low activity spent resin holdup tank as a slurry or sent directly to a cask.

### ***Floor (High Conductivity) Drain Subsystem***

The floor drain collection tanks receive HCW inputs from various floor drain sumps in the Reactor Building (RB), Turbine Building (TB), and radwaste building. The floor drain collection tanks also receive waste input from the chemical drain collection tank.

The floor drain subsystem consists of two floor drain collection tanks and collection pumps, a mobile based processing system (typically consisting of a collection of unit operations, reaction systems and their support equipment, such as filtration systems, Deep-Bed Ion Exchanger Systems, suspended solid pre-treatment equipment, possibly an intermediate tank/pump and the associated plumbing, instrumentation and electrical systems as required), and two sample tanks and sample pumps. The waste collected in the floor drain collection tanks is processed on a batch basis. Cross-connections with the equipment drain subsystem also allow for processing through that subsystem.

Additional collection capacity is also provided by one additional equipment drain collection tank that is shared with the equipment drain subsystem.

A strainer or filter is typically provided downstream of the last ion exchanger in series to collect crud and resin fines that may be present.

The floor drain sample tanks collect the process effluent, so that a sample may be taken for chemical and radioactivity analysis before discharging or recycling. The discharge path depends on the water quality, dilution stream availability and plant water inventory. Off-standard quality effluent can be recycled to floor drain collection tanks or equipment drain collection tanks. If the treatment effluent meets water quality standards and if the water inventory permits it to be recycled, the processed floor drain effluent can be recycled to the condensate storage tank or discharged off-site.

The liquid waste is typically concentrated and periodically discharged to a concentrated waste tank. Spent deep-bed ion exchanger resin is discharged to a low activity spent resin holdup tank as slurry.

The capability exists to accept used condensate polishing resin in a condensate resin receiver tank. The used condensate polishing resin from Condensate Purification System is transferred to the condensate resin receiver tank, as described in subsection 10.4.6.2.3, prior to use in the pre-treatment deep-bed ion exchanger in the floor drain subsystem.

### ***Chemical Drain Subsystem***

The chemical waste collected in the chemical drain collection tank consists of laboratory wastes and decontamination solutions. After accumulating in the chemical drain collection tank, chemical agents may be added to the chemical drain by mobile-based chemical pre-treatment equipment if necessary and the pre-treated chemical drain is transferred to floor drain collection tanks for further processing. Chemical pre-treatment operation is typically a neutralization process. A sample is then taken and if discharge standards are met, then the waste may be discharged off-site. A cross-connection with the detergent drain subsystem is also provided.

### ***Detergent Drain Subsystem***

Waste water containing detergent from the controlled laundry and personnel decontamination facilities and decontamination waste water from the RB or TB throughout the plant is collected in the detergent drain collection tanks. The detergent drain subsystem consists of two detergent drain collection tanks and collection pumps, a mobile-based processing system (typically consisting of a collection of unit operations, reaction systems and their support equipment, such as filtration systems, charcoal based adsorption systems, organic material pre-treatment equipment, possibly an intermediate tank/pump, and the associated plumbing, instrumentation and electrical systems as required), and two sample tanks and sample pumps. The detergent waste treatment may include suspended solid removal processing and organic material removal processing, as necessary. The treated waste is collected in sample tanks. A sample is taken and if discharge standards are met, then the waste is discharged off-site. Off-standard quality water can either be recycled for further processing to the detergent collection tank or to the floor drain collection tank. A cross-connection with the chemical drain collection subsystem is also provided.

#### ***11.2.2.3 Detailed System Component Description***

The LWMS consists of permanently installed tanks, pumps, pipes, valves, and instruments, and mobile systems for waste processing. Mobile systems provide an operational flexibility and maintainability to support plant operation. The major components of the LWMS are as follows:

##### ***Pumps***

The LWMS process pumps are constructed of materials suitable for their intended service.

Neutralization chemicals in the LWMS are added with centrifugal or positive displacement pumps (or functionally similar pumps). These pumps are constructed of materials suitable for their intended service.

##### ***Tanks***

Tanks are sized to accommodate the expected volumes of waste generated in the upstream systems that feed waste into the LWMS for processing. The tanks are constructed of stainless steel to provide a low corrosion rate during normal operation. They are provided with mixing eductors and/or air spargers. The capability exists to sample all LWMS collection and sample tanks. All LWMS tanks are vented through a filtration unit and eventually discharged into the plant vent. The LWMS tanks are designed in accordance with the equipment codes listed in Table 11.2-1.

All atmospheric liquid radwaste tanks are provided with an overflow connection at least the size of the largest inlet connection. The overflow is connected below the tank vent and above the high-level alarm setpoint. Each collection tank room is designed to contain the maximum liquid inventory in the event that the tank ruptures.

##### ***Mobile Systems***

The mobile system is of a skid-mounted design and configured for relatively easy installation and process reconfiguration. In-plant supply and return connections from permanently installed equipment to the mobile system are provided to ensure operational flexibility.

The LWMS mobile systems are located in the Liquid Waste Treatment System bay to allow truck access and mobile system skid loading and unloading. Modular shield walls are provided in the Radwaste Building (RW) to allow shield walls to be constructed to minimize exposure to personnel during operation and routine maintenance.

### ***Mobile Systems for equipment drain processing***

The equipment drain mobile system utilizes unit operations such as filters for removing suspended solid and radioactive particulate material, and charcoal adsorption for organic material removal. Backwash operation for depth filtration units is performed when the differential pressure across the filter exceeds a preset limit. Depth filtration backwash waste is discharged to a low activity phase separator. Spent organic removal media, if used, is packaged directly into the container when the differential pressure exceeds a preset limit or waste quality of the effluent from the unit exceeds a preset value.

The equipment drain pretreatment unit operations, such as filtration, feeds the chemical reaction equipment, such as mixed-bed ion exchangers. Exhausted resins from a mixed bed ion exchange unit are sluiced to the low activity spent resin holdup tank when some chosen effluent purity parameter (such as conductivity) exceeds a preset limit or upon high differential pressure across the unit. Fine mesh strainers with backwashing connections are provided in the ion exchange vessel discharge and in the downstream piping to prevent resin fines from being carried over to the sampling tanks.

The mobile system is skid-mounted and is designed and configured for relatively easy installation and process reconfiguration. In-plant supply and return connections from permanently installed equipment to the mobile system are provided to keep operational flexibility.

### ***Mobile Systems for floor drain and chemical drain processing***

Floor drain and chemical drain wastes are more complex to process than equipment drains. The floor drain mobile system utilizes unit operations such as pre-filtration equipment for removing suspended solids and organic impurities, filtration equipment that may include units such as a Reverse Osmosis System (RO) for removing ionic impurities, and chemical reactors, such as deep-bed ion exchangers for polishing.

If used, the pre-filtration equipment liquid effluent may either be directly fed to the filtration equipment or collected into a feed tank of the filtration equipment. The feed tank, if used, may serve as a supply surge tank to the process. If a surge tank is used, the liquid is transferred to the filtration unit via a pump. If a surge tank is not used, the direct piped liquid leaving the pre-filtration equipment may not need a pressure increase, therefore the addition of a booster pump may be optional. If used as one of the unit operations, an RO unit uses membranes that are made of a semi-permeable material. When pressure is applied to the feed side of the membrane, the solution passes through the membrane (permeates) and the solids and other impermeable wastes are rejected. Should an RO unit be used, the rejected solids and ionic impurities may be returned to the feed tank and the final permeate may be polished by deep-bed ion exchangers. Typically, if used, ion exchangers following an RO are of the mixed-bed type. Exhausted ion exchange resins may be sluiced to the spent resin tank or directed to a cask when some chosen effluent purity parameter (such as conductivity) exceeds a preset limit or upon high differential pressure. Fine mesh strainers with backwashing connections are provided in the ion exchange vessel

discharge and in the downstream piping to prevent resin fines from being carried over to the sampling tanks, should ion exchangers be used.

The chemical drain pre-treatment unit performs a pre-conditioning of chemical waste, such as pH adjustment, prior to processing.

The mobile system is of a skid-mounted design and configured for relatively easy installation and process reconfiguration. In-plant supply and return connections from permanently installed equipment to the mobile system are provided to ensure operational flexibility.

#### ***Mobile Systems for detergent drain processing***

The detergent drain mobile system typically utilizes unit operations such as a charcoal adsorber to remove organics and a filter to remove suspended solids. When the differential pressure of the filter exceeds a preset value, the filter performance is rejuvenated in accordance with the design of the filter. Discarded spent filter media, if used, are packaged as active solid waste.

#### ***Mobile Systems for chemical agent addition***

Mobile based chemical addition equipment may be provided as necessary to add chemical agent(s) for maintaining the performance in or recovering the performance of mobile system unit operations such as filtration system(s) and reaction system(s) such as pH control. Depending on the processing equipment and the mechanism causing a reduction in performance, individual equipment-specific chemical treatment may be necessary. Should the equipment drain subsystem processes, operations and potential means for a reduction in performance be substantially similar to that of the floor drain subsystem, the equipment drain subsystem mobile based chemical addition equipment may provide for the addition of chemical agent(s) to the floor drain subsystem. Should the equipment drain subsystem processes, operations and potential means for a reduction in performance not be substantially similar to that of the floor drain subsystem, each subsystem may include individual mobile based chemical addition equipment as necessary to add chemical agent(s) to maintain or recover system performance. Mobile based chemical addition equipment may be provided as necessary to add agents for maintaining the performance in, or recovering the performance of, the processes and operations in each, the chemical drain subsystem and the detergent drain subsystem.

### **11.2.3 Safety Evaluation - Radioactive Releases**

#### ***Safety Evaluation***

The LWMS has no safety-related function. Failure of the system does not compromise any safety-related system or component nor does it prevent shutdown of the plant. No interface with the Class IE electrical system exists.

#### ***Radioactive Releases***

During liquid processing by the LWMS, radioactive contaminants are removed and the bulk of the liquid is purified and either returned to the condensate storage tank or discharged to the environment. The radioactivity removed from the liquid waste is concentrated in unit operation and chemical reactor active components, such as filter media, ion exchange resins and concentrated waste. The decontamination factors (DFs) that are listed in Table 11.2-3 are in accordance with NUREG-0016 (Reference 11.2-7), but are considered conservative values. The filter sludge, ion exchange resins and concentrated waste are sent to the SWMS for further

processing. If the liquid meets the purity requirements it is returned to the plant for condensate makeup. If the liquid is discharged, the activity concentration is consistent with the discharge criteria of 10 CFR 20 (Reference 11.2-2) and dose commitment in 10 CFR 50, Appendix I (Reference 11.2-6).

The parameters and assumptions used to calculate releases of radioactive materials in liquid effluents and their bases are provided in Chapter 12. The LWMS design ensures that calculated individual doses from the release of radioactive liquid effluents during normal operation and anticipated operational occurrence is less than 0.03 mSv (3mrem) to the whole body and 0.1 mSv (10mrem) to any organ.

Expected releases of radioactive materials by radionuclides in liquid effluents resulting from normal operation, including anticipated operational occurrences, and from design basis fuel leakage are provided in Chapter 12.

A tabulation of the releases by radionuclides can be found in Chapter 12. The tabulation is for the total system and for each subsystem and includes indication of the effluent concentrations. The calculated concentrations in the effluents are within the concentration limits of 10 CFR 20 (Reference 11.2-2); the doses resulting from the effluents are within the numerical design objectives of Appendix I to 10 CFR 50 (Reference 11.2-6) and the dose limits of 10 CFR 20 (Reference 11.2-2) as set forth in Chapter 12.

### ***Dilution Factors***

Refer to Section 12.2 for dilution factors used in evaluating the release of liquid effluents.

### **11.2.4 Testing and Inspection Requirements**

The LWMS is given a pre-operational test as discussed in Chapter 14. Thereafter, portions of the systems are tested as needed.

During initial testing of the system, the pumps and mobile systems are performance tested to demonstrate conformance with design flows and process capabilities. An integrity test is performed on the system upon completion.

Provisions are made for periodic inspection of major components to ensure capability and integrity of the systems. Display devices are provided to indicate vital parameters required in routine testing and inspection.

### **11.2.5 Instrumentation Requirements**

The LWMS is operated and monitored from the Radwaste Building Control Room (RWBCR). Major system parameters, i.e., tank levels, process flow rates, filter and ion exchanger differential pressure, ion exchanger effluent conductivity, etc., are indicated and alarmed as required to provide operational information and performance assessment. A continuous radiation detector, as described in Subsection 11.5.3.2.6, is provided to monitor the discharge of radioactivity to the environs. Key system alarms are repeated in the main control room.

Requirements for sampling are set forth in Subsection 9.3.2.



### 11.2.6 COL Information

- 11.2.6.1 The COL holder is responsible, initially and subsequently, for the identification of mobile/portable LWMS connections that are considered non-radioactive, but later become radioactive through interfaces with radioactive systems; i.e., a non-radioactive system becomes contaminated due to leakage, valving errors or other operating conditions in radioactive systems using the guidance and information in IE Bulletin 80-10 (May 6, 1980) (Reference 11.2-10).
- 11.2.6.2 The COL holder will include site-specific information in Section 11.2.1 describing how the implementation of operating procedures and design features for installation and operation of the mobile/portable LWMS will address the requirements of Part 20.1406 (Reference 11.2-9).

### 11.2.7 References

- 11.2-1 Nuclear Regulatory Commission (NRC), Regulatory Guide 1.143, "Design Guidance for Radioactive Waste Management Systems, Structures, and Components Installed in Light-Water-Cooled Nuclear Power Plants", Revision 2, November 2001
- 11.2-2 Title 10 Code of Federal Regulations Part 20, "Standards for Protection Against Radiation"
- 11.2-3 Title 10 Code of Federal Regulations Part 50, "Domestic Licensing of Production and Utilization Facilities" and 50.34a "Design Objectives for Equipment to Control Releases of Radioactive Material in Effluents – Nuclear Power Reactors"
- 11.2-4 Title 10 Code of Federal Regulations Part 50, Appendix A, General Design Criterion 60, "Control of Releases of Radioactive Materials to the Environment."
- 11.2-5 Nuclear Regulatory Commission (NRC), Regulatory Guide 8.8, "Information Relevant to Ensuring that Occupational Radiation Exposures at Nuclear Power Stations Will Be as Low as Is Reasonably Achievable", Revision 3, June 1978
- 11.2-6 Title 10 Code of Federal Regulations Part 50, Appendix I, "Numerical Guides for Design Objectives and Limiting Conditions for Operation to Meet the Criterion "As Low as is Reasonably Achievable" for Radioactive Material in Light-Water-Cooled Nuclear Power Reactor Effluents"
- 11.2-7 Draft Guide DG-1145: Combined License Applications for Nuclear Power Plants (LWR Edition), 1.11 Radioactive Waste Management
- 11.2-8 Generic Letter 89-01, January 31, 1989, specifically, Enclosure 3, Section 6.13 Process Control Program, PCP
- 11.2-9 Title 10 Code of Federal Regulations, Part 20.1406
- 11.2-10 IE Bulletin 80-10, May 6, 1980

**Table 11.2-1**  
**Equipment Codes (from Table 1, RG 1.143)**

<b>Component</b>	<b>Design and Construction</b>	<b>Materials<sup>1</sup></b>	<b>Welding</b>	<b>Inspection and Testing</b>
Pressure Vessels and Tanks (>15 psig)	ASME Code BPVC Div. 1 or Div.2	ASME Code Section II	ASME Code Section IX	ASME Code Section VIII, Div. 1 or Div.2
Atmospheric Tanks	API 650	ASME Code <sup>3</sup> Section II	ASME Code Section IX	API 650
0-15 psig Tanks	API 620	ASME Code <sup>3</sup> Section II	ASME Code Section IX	API 620
Heat Exchangers	TEMA STD, 8th Edition ; ASME Code BPVC Section VIII, Div. 1 or Div. 2	ASTM B359-98 or ASME Code Section II	ASME Code Section IX	ASME Code Section VIII, Div. 1 or Div. 2
Piping and Valves	ANSI/ASME B31.3 <sup>5,6</sup>	ASME Code Section II <sup>7</sup>	ASME Code Section IX	ANSI/ASME B31.3
Pumps	API 610; API 674; API 675; ASME BPVC Section VIII, Div.1 or Div.2	ASTM A571-84 (1997) or ASME Code Section II	ASME Code Section IX	ASME BPVC Code <sup>2</sup> Section III, Class 3
Flexible Hoses and Hose Connections for MRWP <sup>4</sup>	ANSI/ANS-40.37	ANSI/ANS-40.37	ANSI/ANS-40.37	ANSI/ANS-40.37

Notes for Table 11.2-1:

1. Manufacturer's material certificates of compliance with material specifications may be provided in lieu of certified material test reports as discussed in Regulatory Position 1.1.2 of Regulatory Guide 1.143
2. ASME Code stamp, material traceability, and the quality assurance criteria of ASME BPVC, Section III, Div.1, Article NCA are not required. Therefore, these components are not classified as ASME Code Section III, Class 3.
3. Fiberglass-reinforced plastic tanks may be used in accordance with appropriate articles of Section 10 of the ASME Boiler and Pressure Vessel Code for applications at ambient temperature.
4. Flexible Hoses should only be used in conjunction with Mobile Radwaste Processing Systems (MRWP).
5. Class RW-IIa and RW-IIb Piping Systems are to be designed as category "M" systems.
6. Classes RW-IIa, RW-IIb and RW-IIc are discussed in Regulatory Position 5 of Regulatory Guide 1.143.
7. ASME BPVC Section II required for Pressure Retaining Components.

**Table 11.2-2a****LWMS Component Capacity (Tanks)\***

<b>Component</b>	<b>Type**</b>	<b>Quantity</b>	<b>Nominal Capacity*** Liter (Gal) per Tank</b>
Equipment Drain Collection Tanks	Vertical, Cylindrical	3	140,000 (36,988)
Equipment Drain Sample Tanks	Vertical, Cylindrical	2	140,000 (36,988)
Floor Drain Collection Tanks	Vertical, Cylindrical	2	130,000 (34,346)
Floor Drain Sample Tanks	Vertical, Cylindrical	2	130,000 (34,346)
Chemical Drain Collection Tank	Vertical, Cylindrical	1	4,000 (1,057)
Detergent Drain Collection Tanks	Vertical, Cylindrical	2	15,000 (3,963)
Detergent Drain Sample Tanks	Vertical, Cylindrical	2	15,000 (3,963)

\* Per RG 1.143, all materials are in accordance of ASME Section II.

\*\* Per RG 1.143, tank design and fabrication are in accordance with ASME Section III, Class 3; API 620; API 650 or AWWA D-100, depending on design requirements.

\*\*\* Nominal capacity refers to the total tank capacity.

**Table 11.2-2b**  
**LWMS Component Capacity (Pumps)\***

<b>Component</b>	<b>Type</b>	<b>Quantity</b>	<b>Nominal Capacity* Liters/Hour (gpm)</b>
Equipment Drain Collection Pumps	Horizontal, Centrifugal	3	60,000 (264)
Equipment Drain Sample Pumps	Horizontal, Centrifugal	2	60,000 (264)
Floor Drain Collection Pumps	Horizontal, Centrifugal	2	55,000 (242)
Floor Drain Sample Pumps	Horizontal, Centrifugal	2	55,000 (242)
Chemical Drain Collection Pumps	Horizontal, Centrifugal	2	6,000 (26.4)
Detergent Drain Collection Pumps	Horizontal, Centrifugal	2	12,000 (52.8)
Detergent Drain Sample Pumps	Horizontal, Centrifugal	2	12,000 (52.8)

\* Pump capacity refers to the minimum required capacity.

**Table 11.2-2c**  
**LWMS Component Capacity (Mobile Systems)**

<b>Component*</b>	<b>Type</b>	<b>Quantity**</b>	<b>Nominal Cap.</b>
Mobile Systems for Equipment Drain Processing Equipment Drain Pre-Filter Equipment Drain Filter Equipment Drain Ion Exchangers Equipment Drain Chemical Injection Unit Equipment Drain Intermediate Tank Equipment Drain Intermediate Pump	Charcoal Filter or others Hollow Fiber Filter Mixed Bed Type - Vertical, Cylindrical Horizontal, Centrifugal	1	20,000L/h (88gpm)
Mobile Systems for Floor Drain Processing Floor Drain Pre-Filters Floor Drain Reverse Osmosis (RO) unit Floor Drain Ion Exchangers Floor Drain Intermediate Tank Floor Drain Intermediate Pump	Cartridge Type Reverse Osmosis (RO) Mixed Bed Type Vertical, Cylindrical Horizontal, Centrifugal	1	15,000L/h (66gpm)
Mobile Systems for Chemical Drain Processing Chemical Drain Neutralization Unit	-	1	-
Mobile Systems for Detergent Drain Processing Detergent Drain Organic Pre-Treatment Detergent Drain Pre-Filter Detergent Drain Charcoal Filter	Charcoal or others Cartridge Type Charcoal Filter	1	2,000L/h (8.8gpm)

\* Typical components are shown for each mobile system.

\*\* This column shows mobile system quantity for each subsystem, not each component quantity.

**Table 11.2-3**  
**Decontamination Factors**

<b>Subsystems*</b>	<b>Filter</b>	<b>Reverse Osmosis</b>	<b>Ion-Exchanger</b>	<b>Total DF</b>
Equipment (low conductivity)				
Drain Subsystem:				
Halogens	1	-	100 (10)**	1,000
Cs, Rb	1	-	10 (10)**	100
Other nuclides	1	-	100 (10)**	1,000
Floor (high conductivity)				
Drain Subsystem:				
Halogens	1	10	100 (10)**	10,000
Cs, Rb	1	10	2 (10)**	200
Other nuclides	1	10	100 (10)**	10,000
A DF of 1 is used for tritium.				
Chemical Drain Subsystem:				
Chemical drain is processed in Floor Drain Subsystem.				
Detergent Drain Subsystem:				
A DF of 1 is used for the detergent drain filter for all radionuclides.				


\* From NUREG-0016 Revision 1, Table 1-5.

\*\* Per RG1.143, tank design and fabrication are in accordance with ASME Section III, Class 3; API 620; API 650 or AWWA D-100, depending on design requirements.


**Table 11.2-4**  
**Probable Inputs to LWMS from Operational Occurrences**

<b>Subsystem</b>	<b>Normal Liters/Day (Gal/Day)</b>	<b>Maximum Liters/Day (Gal/Day)</b>	<b>Time Needed to Process Maximum Input (Hr)</b>
Equipment (low conductivity) Drain Subsystem	65,000 (17,173)	125,000 (33,025)	6.3
Floor (high conductivity) Drain Subsystem	11,000 (2,906)	100,000 (26,420)	6.7
Chemical Drain Subsystem	3,000 (793)	3,000 (793)	0.2
Detergent Drain Subsystem	4,000 (1,057)	12,000 (3,170)	6.0


Equipment (Low Conductivity) Drain Subsystem

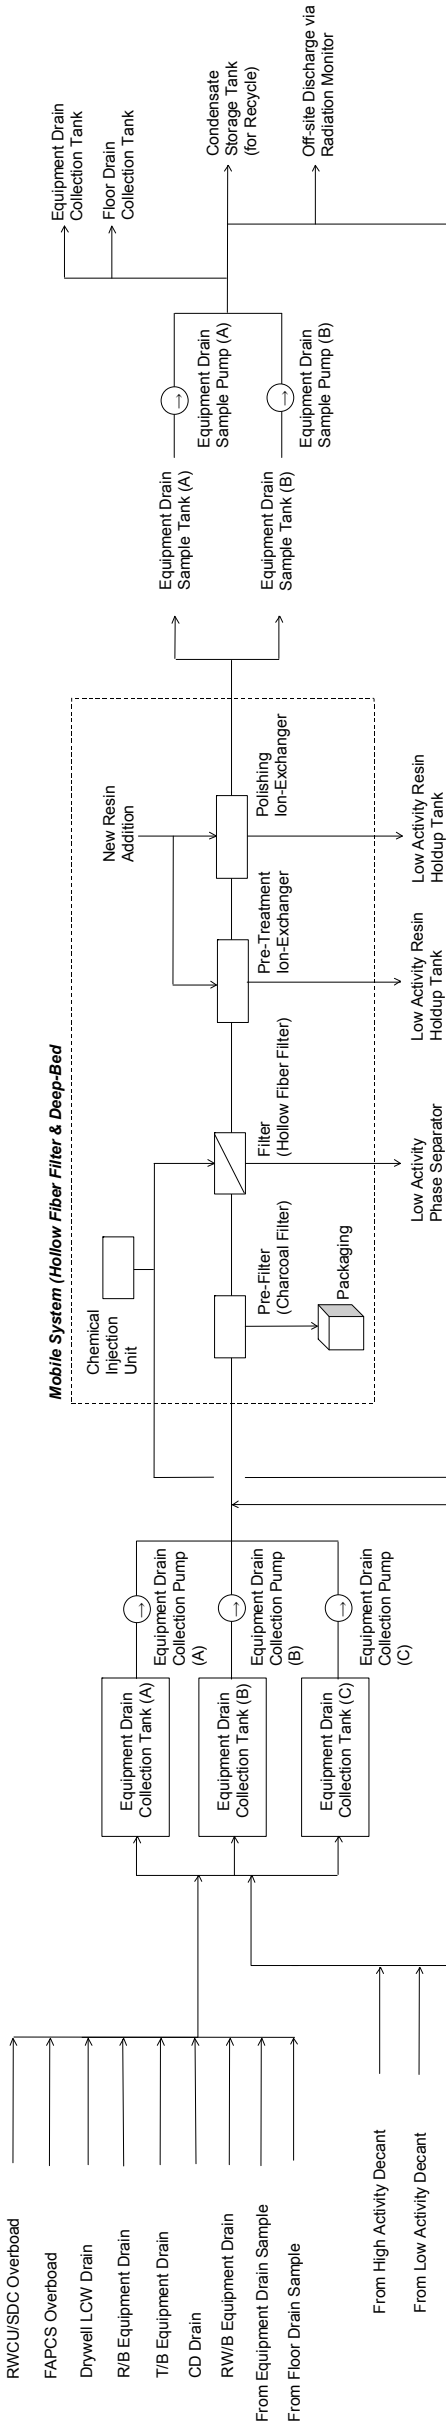


Floor (High Conductivity) Drain Subsystem

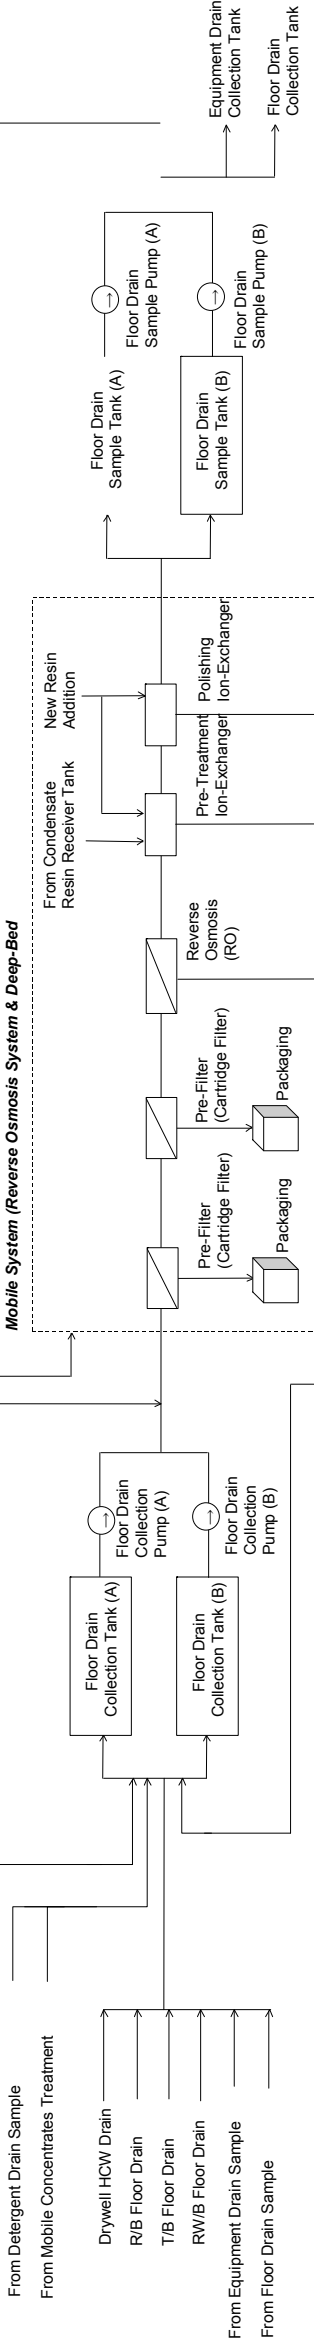

Chemical Drain Subsystem

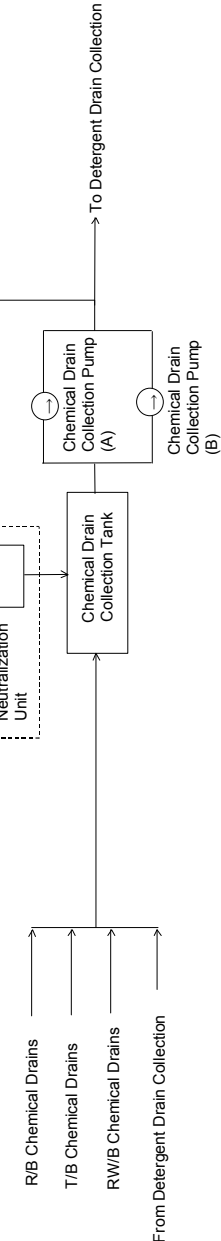

Detergent Drain Subsystem

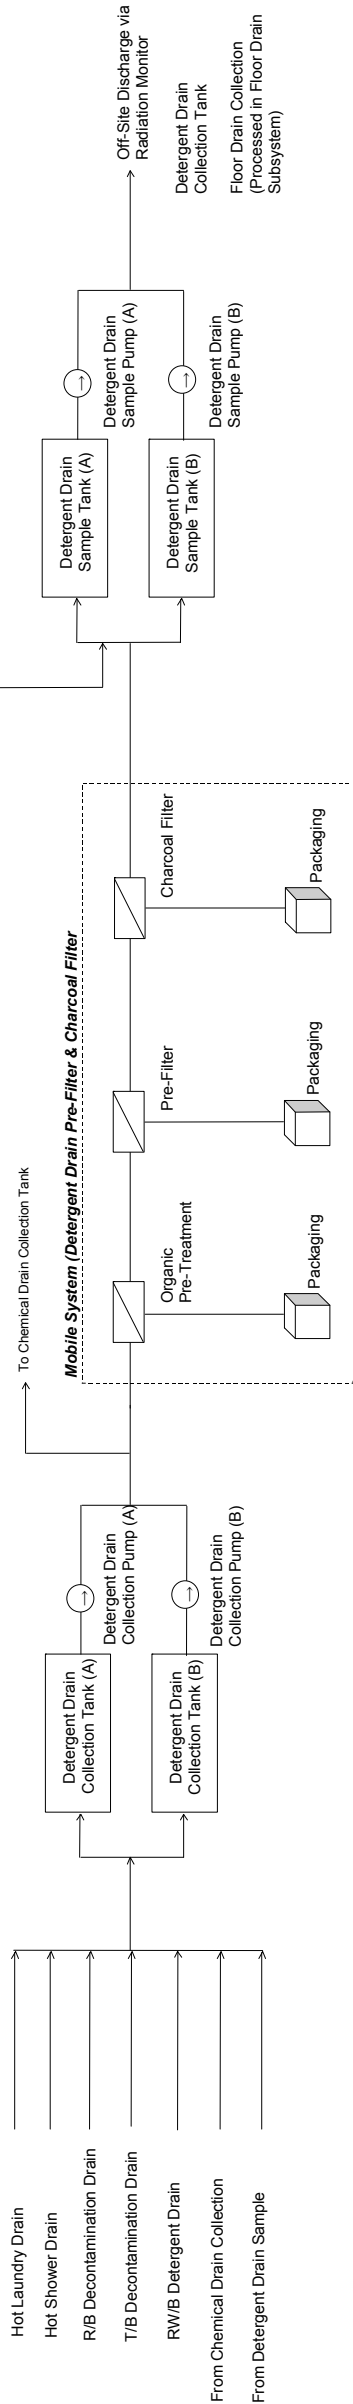

Abbreviations:  
RWCU/SDC - Reactor Water Cleanup/Shutdown Cooling  
FAPCS - Fuel and Auxiliary Pools Cooling  
LCW - Low Conductivity  
HCW - High Conductivity  
CD - Condensate Demineralizer

Figure 11.2-1. Liquid Waste Management System Process Diagram\*  
\*Similar to or Similar



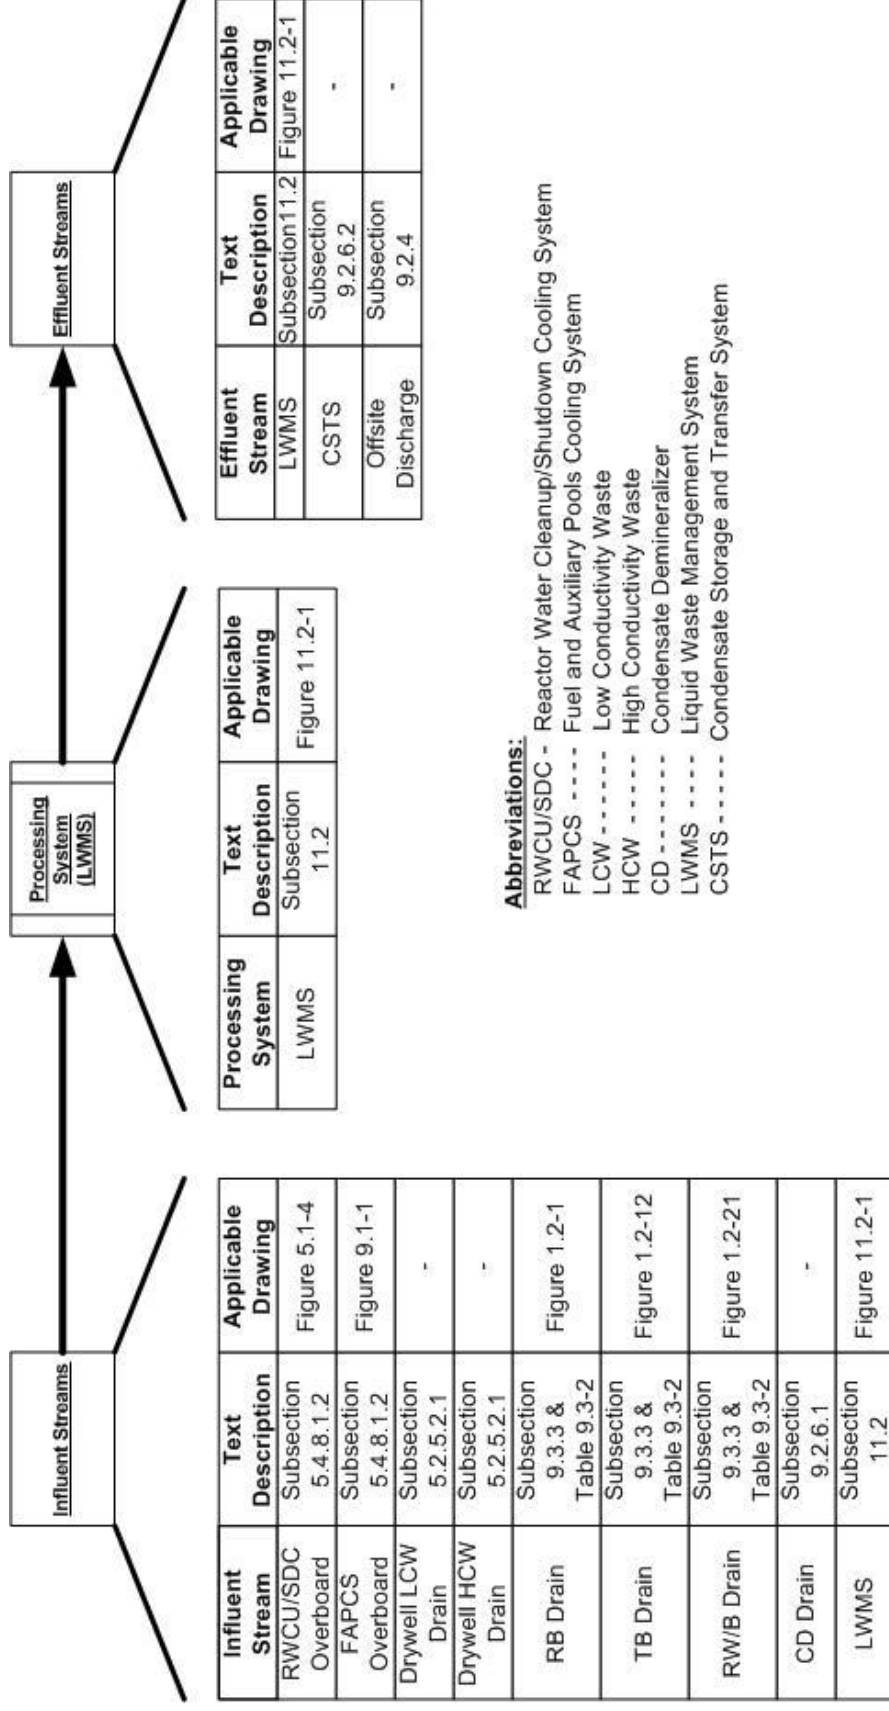


Figure 11.2-2. Liquid Waste Management System Process Stream Information Directory

## 11.3 GASEOUS WASTE MANAGEMENT SYSTEM

### 11.3.1 Design Bases

The objective of the gaseous waste management system is to process and control the release of gaseous radioactive effluents to the site environs so as to maintain the exposure of persons in unrestricted areas to radioactive gaseous effluents as low as reasonably achievable according to 10 CFR 50, Appendix I (Reference 11.3-1) and 10 CFR 50.34a (Reference 11.3-1). This is accomplished while maintaining occupational exposure as low as reasonably achievable without limiting plant operation or availability.

The two main sources of plant gaseous radioactive effluents are the building ventilation systems, which are discussed in Section 9.4, and the power cycle Offgas System (OGS) that is described and reviewed in this section.

The OGS provides for holdup, and thereby, decay of radioactive gases in the offgas from the main condenser air removal system (Subsection 10.4.2) and consists of process equipment along with monitoring instrumentation and control components.

The OGS minimizes and controls the release of radioactive material into the atmosphere by delaying release of the offgas process stream initially containing radioactive isotopes of krypton, xenon, iodine, nitrogen, and oxygen. This delay, using activated charcoal absorber beds, is sufficient to achieve adequate decay before the process offgas stream becomes discharged from the plant.

The OGS design minimizes the explosion potential in the OGS through recombination of radiolytic hydrogen and oxygen under controlled conditions as required by GDC 3 (Reference 11.3-19). Additional GDC 3 requirements are addressed in subsection 9.5.1 Appendix 9A and Appendix 9B.

The gaseous effluent treatment systems are designed to limit the dose to off-site persons from routine station releases to significantly less than the limits specified in 10 CFR 20 (Reference 11.3-2) and to operate within the relevant limits specified in the plant-specific Technical Specifications (TS).

As a conservative design basis for the OGS, an average annual noble radiogas source term (based on 30 minute decay) is assumed. The OGS System Design Parameters are shown in Table 11.3-1. The system is mechanically capable of processing three times the source term without affecting delay time of the noble gases. Table 11.3-5 lists the isotopic distribution at  $t = 0$ . Table 11.3-1 shows the xenon time delays with an assumed air in-leakage.

Design guidelines and future assumptions described in Branch Technical Position (BTP) - Effluent Treatment Systems Branch (ETSB) 11-5 (Reference 11.3-18) to minimize radiation and radiological consequences due to a single failure of an active component were considered in the design of the OGS.

Using the isotopic activities at the discharge of the OGS, the DF for each noble gas isotope can be determined. Section 11.1 presents source terms for normal operational and anticipated occurrence releases to the primary coolant. Tables in this section, if not designated otherwise, are based upon a design basis annual average offgas release rate (measured after 30 minutes

decay from the core) of noble gases and as shown in Table 11.3-1. For normal expected conditions, the leak rates and doses are expected to be less than one-fifth of the design basis numbers.

The average annual exposure at the site boundary during normal operation from all gaseous sources is not expected to exceed the dose objectives of 10 CFR 50, Appendix I (Reference 11.3-1), to individuals in unrestricted areas (Refer to Section 12.2). The radiation dose design basis for the treated offgas is to provide sufficient holdup until the required fraction of the radionuclides has decayed with the daughter products retained by the charcoal.

The gaseous waste management system equipment is selected, arranged, and shielded to maintain occupational exposure as low as reasonably achievable in accordance with NRC Regulatory Guide 8.8 (Reference 11.3-14).

The gaseous waste management system is designed to the requirements of the GDC 60 (Reference 11.3-15) and 64 (Reference 11.3-16).

A list of the OGS major equipment items, including materials, rates, process conditions, number of units supplied, and relevant design codes, is provided in Table 11.3-2.

The OGS is also designed to the requirements indicated in DCD section 3.2.

The OGS interconnections between plant systems are designed to minimize the contamination of non-radioactive systems and uncontrolled releases of radioactivity in the environment (Reference 11.3-13).

A discussion of OGS compliance with 10 CFR 20.1406 (Reference 11.3-17) is located in section 12.6.

### **11.3.2 Offgas System Description**

#### ***Process Functions***

Major process functions of the OGS include the following:

- Recombination of radiolytic hydrogen and oxygen into water to reduce the gas volume to be treated and the explosion potential in downstream process components;
- Two-stage condensation of bulk water vapor first using condensate and then chilled water as the coolant reducing the gaseous waste stream temperature to the value shown in Table 11.3-1;
- Dynamic adsorption of krypton and xenon isotopes on charcoal at the approximate temperature shown in Table 11.3-1;
- Monitoring of offgas radioactivity levels and hydrogen gas content;
- Release of processed offgas to the atmosphere; and
- Discharge of liquids to the condenser and/or LWMS.

#### ***Process Equipment***

Major process equipment of the OGS consists of the following:

- Recombiners, including a preheater section, a catalyst section, and a condenser section;

- Cooler-condensers;
- Dryers
- Activated charcoal adsorbers;
- Monitoring instrumentation; and
- Process instrumentation and controls.

### ***Process Facility***

The OGS process equipment is housed in a reinforced-concrete structure to provide adequate shielding. Charcoal adsorbers are installed in a temperature monitored and controlled vault. The facility is located in the TB to minimize piping.

Power cycle condensate is used as the coolant for the offgas condensers. The pressure of condensate supplied to the offgas condenser should not exceed the design pressure of the condenser, and power cycle condensate isolation valves should be normally open to both recombiner condensers.

The gaseous waste stream is then cooled in the cooler condenser. Chilled water is provided at the temperature shown in Table 11.3-1. The cooler condenser is located immediately above the offgas condenser and is designed to allow the condensed moisture from the gaseous waste stream to drain back into the offgas condenser, from which it is sent to the main turbine condenser.

The gaseous waste stream is heated to the value shown in Table 11.3-1 by ambient heating in the charcoal vault.

Chapter 12 provides the radioactivity inventories of the major OGS components during normal plant operation. The radiation shielding design provides adequate protection of instrumentation and plant personnel required to monitor and operate the system.

### ***Releases***

The significant gaseous wastes discharged to the OGS during normal plant operation are radiolytic hydrogen and oxygen, power cycle injected gasses and air in-leakage, and radioactive isotopes of krypton, xenon, iodine, nitrogen, and oxygen. The radiation dose from gaseous discharge is primarily external rather than ingestion or inhalation. When releasing gases from the plant, the plume or cloud is the source of radiation to the ground. The maximum radiation corresponds to the zone of maximum ground concentration. This, in turn, is a function of wind velocity and direction, the presence of building obstructions in the wake and other meteorological conditions in the area. From the foregoing considerations, a release rate from the plant stack or vent can be established such that the maximum radiation dose to any area in the environs is not exceeded.

Radioactive particles are present as a result of radioactive decay from the noble gas parents. These particulates are removed from the offgas stream by the condensation and adsorption equipment. Therefore, effectively no radioactive particulates are released from the OGS to the plant stack.

Radioiodines (notably  $I^{131}$ ) may be present in significant quantities in the reactor steam and to some extent carried over through the condensation stages of the OGS. Adsorption of iodine |

takes place in the passage of process gas through the activated charcoal adsorbers, so that essentially no iodine is released from the OGS to the plant stack.

The criterion for release of gaseous wastes to the atmosphere, excluding accident sequences, is that maximum external radiation dosage to the environment be maintained below the maximum dose objectives of Appendix I to 10 CFR 50 (Reference 11.3-1) in terms for doses to individuals in un-restricted areas. An instantaneous release rate, established by 10 CFR 20 (Reference 11.3-2), of several times the annual average permissible release rate limit is permitted as long as the annual average is not exceeded. Every reasonable effort has been made to keep radiation exposures and release of radioactive materials "as low as reasonably achievable" (ALARA). The OGS discharge is routed to the plant stack.

### ***11.3.2.1 Process Design***

Primary design features are shown on the simplified offgas diagram (Figure 11.3-1).

The Steam Jet Air Ejectors (SJAE) are described in Design Control Document (DCD) Subsection 10.4.2

### ***Preheating***

Recombiner preheaters preheat gases to provide for efficient catalytic recombiner operation and to ensure the absence of liquid water that suppresses the activity of the recombiner catalyst. Maximum preheater temperature does not exceed the value shown in Table 11.3-1 should gas flow be reduced or stopped. This is accomplished by using extraction steam. During startup, steam at this pressure, is available before the process offgas is routed through the preheater section to the recombiner catalyst section. Electrical preheaters are not exposed directly to the offgas. Each preheater section connects to an independent final stage air ejector to permit separate steam heating of both recombiners during startup or drying one recombiner while the other is in operation. For reliability, preheater steam is nuclear steam. The preheater is sized to handle a dilution steam load of 115% of rated flow in addition to allowing for 5% plugged tubes.

### ***Hydrogen/Oxygen Recombination***

Minimum performance criteria for the catalytic recombiners are as follows:

- In normal full power operation the hydrogen in the recombiner effluent does not exceed 0.1% by volume on a moisture-free basis, at the defined minimum air flow shown in Table 11.3-1.
- During startup or other reduced power operations (between 1 and 50% of reactor rated power), the hydrogen in the recombiner effluent does not exceed 1.0% by volume on a moisture free basis at the defined minimum air flow.
- An intentional air bleed equal to minimum air flow is introduced into the system upstream of the operating recombiner when the turbine condenser air in-leakage falls below the defined minimum air flow. The out-of-service recombiner catalysts is heated to the value shown in Table 11.3-1 by dilution steam injection and preheat steam before admitting process gas (containing hydrogen) to the recombiner. Three temperature-sensing elements are provided in each catalyst bed and are located to measure the temperature profile from inlet to outlet.

### ***Condensing***

The offgas condensers cool the recombiner effluent gas to the maximum temperatures for normal operation and startup operation shown in Table 11.3-1. The condenser includes baffles to reduce moisture entrainment in the offgas. The unit is sized to handle a dilution steam load of 115% of rated flow, in addition to allowing for 5% plugged tubes. The drain line is capable of draining the entire process condensate, including the 15% excess plus 2.5 l/s (40 gpm), from the unit at both startup and normal operating conditions, taking into account the possibility of condensate flashing in the return line to the main condenser. The drain line also incorporates a flow element so that higher flows caused by tube leakage can be easily identified, and a passive loop seal with a block valve operable from the main control room. A gas sample tap is provided downstream of and near the offgas condensers to permit gas sampling.

The gaseous waste stream is then cooled in the cooler condenser. The cooler condenser is designed to remove condensed moisture by draining it to the offgas condenser.

### ***Drying***

The offgas from the cooler-condenser is further demoistured to less than 7°C (45°F) dew point condition to enhance the adsorption performance of the charcoal in one of two redundant parallel dryers.

### ***Adsorption***

The activated charcoal uses general adsorption coefficient  $K_{ar}$  values for krypton and xenon. Separate  $K_{ar}$  laboratory determinations of krypton and xenon are made for each manufacturer's lot unless the manufacturer can supply convincing proof to the purchaser that other lots of the same production run immediately adjacent to the lot tested are equivalent to the lot tested with respect to krypton and xenon adsorption. Other adsorption tests (e.g., dynamic coefficients) may be acceptable, provided their equivalence to  $K_{ar}$  tests for this purpose can be demonstrated. Charcoal particle size, moisture content and minimum charcoal ignition temperature in air are shown in Table 11.3-1.

Properties of activated charcoal used in the adsorber vessels are an optimization of the following:

- High adsorption for krypton and xenon;
- High physical stability;
- High surface area;
- Low pressure drop;
- Low moisture absorption;
- High ignition temperature; and
- Dust-free structure.

The Kr and Xe holdup time is closely approximated by the following equation:

$$t = \frac{K_d M}{V} \quad (11.3-1)$$

where

- $t$  = holdup time of a given gas
- $K_d$  = dynamic adsorption coefficient for the given gas
- $M$  = weight of charcoal
- $V$  = flow rate of the carrier gas

in consistent units.

Dynamic adsorption coefficient values for xenon and krypton were reported by Browning (Reference 11.3-7). GE Nuclear Energy has performed pilot plant tests at the Vallecitos Laboratory and the results were reported at the 12th Atomic Energy Commission (AEC) Air Cleaning Conference (Reference 11.3-8).

### ***Noble Gas Mixture***

The fission product noble gas composition used as the nominal design basis is defined in Section 11.1. During normal operation with no fuel leaks, release rate of noble gases (after 30 minute decay) may occur because of minute quantities of uranium contamination. The system is also capable of safe operation at release rates that may occur in the event of gross fuel failures.

### ***Air Supply***

Carrier gas is the air leakage from the main condenser after the recombiner removes the radiolytic hydrogen and oxygen. The air in-leakage design basis is conservatively assumed to be the total value shown in Table 11.3-1.

An air bleed supply is provided for dilution of residual hydrogen at air in-leakages below the minimum value shown in Table 11.3-1, for valve stem sealing, for recombiner startup, for blocking during maintenance, for instrument operation, for providing an air flow through the standby recombiner when processing offgas, and for purging gas mixtures from process and instrument lines prior to maintenance. These normal air purge flow rates are not used while the system processes reactor offgas. The air is supplied from a compressor that does not use oil for lubrication of the compressor cylinder, as oil compromises the performance of the catalytic recombiners and charcoal adsorbers. During both startup and normal operation, air is bled to the standby recombiner train just downstream of the final SJAЕ suction valve for train purging after switchover. Flow indicators are provided on all air bleed lines to assure that proper air flow is being delivered to the process line or equipment. The air supply is protected from back flow of process gas by two check valves in series or by a check valve and a pressure control valve in series.

### ***Range-ability***

The process can accommodate reactor operation from 0 to 100% of full power. In normal operation, radiolytic gas production varies linearly with thermal power. The process can accommodate the airflow range shown in Table 11.3-1 for the full range of reactor power operation.

In addition, the process can mechanically accommodate a higher startup airflow upon initiation of the SJAEs. This startup airflow results from evacuation of the turbine condensing equipment while the reactor is in the range of about 3% to 7% of rated power.

### ***Redundancy***

Active equipment (e.g., recombiners, dryers and valves) whose operation is necessary to maintain operability of the OGS is redundant. Passive equipment (e.g., charcoal adsorber) is not redundant. Instrumentation that performs an information function, and is backed up by design considerations or other instrumentation, is not redundant. Instrumentation used to record hydrogen concentration or activity release (e.g., flow measurement and hydrogen analyzers) is redundant.

Design provisions are incorporated which preclude the uncontrolled release of radioactivity to the environment as a result of a single equipment failure short of the equipment failure accident described in Subsection 11.3.7. An analysis of single equipment piece malfunctions is provided in Table 11.3-3.

Design precautions taken to prevent uncontrolled releases of activity include the following:

- The system design minimizes ignition sources so that a hydrogen detonation is highly unlikely even in the event of a recombiner failure.
- The system pressure boundary is detonation-resistant as described in subsection 11.3.2.2, in addition to the measure taken to avoid a possible detonation.
- All discharge paths to the environment are monitored. The Process Radiation Monitoring System (PRMS) monitors the normal effluent path and the Area Radiation Monitoring System monitors the equipment areas.
- Dilution steam flow to the SJAЕ is monitored and alarmed, and the valving is required to be such that loss of dilution steam cannot occur without coincident closure of the process gas suction valve(s) so that the process gas is sufficiently diluted if it is flowing at all.

### ***Charcoal Adsorber Bypass***

A piping and valving arrangement is provided, which allows isolation and bypass of the charcoal adsorber vessel most likely to catch fire or become wetted with water, while continuing to process the offgas flow through the remaining adsorber vessels. A nitrogen purge can be injected upstream of the vault entrance so that further combustion is prevented and the charcoal is cooled below its ignition temperature. Capability is provided to employ all or a portion of the charcoal adsorber vessels (either guard bed or charcoal beds) to treat the offgas flow during normal or off-standard process operating conditions. Capability is also provided to bypass all charcoal adsorber vessels during plant startup and/or when fuel performance allows.

The main purpose of this bypass is to protect the charcoal during preoperational and startup testing when gas activity is zero or very low and when moisture is most likely to enter the charcoal beds. The bypass valve arrangement is such that no single valve failure or valve misoperation would allow total charcoal bypass. The bypass mode of charcoal operation is not normal for power operation. However, it may be used if the resulting activity release is acceptable.



### ***Valves***

All valves with operators located on the gas process stream are operable from the main control room. Where radiation levels permit, valves handling process fluids are installed in service areas where maintenance can be performed if needed during operation.

### ***Nitrogen and Air Purge***

A nitrogen purge and air supply line is connected to the offgas process just upstream of the first in-line charcoal adsorber vessel (guard bed). This arrangement is to allow the vessel to be nitrogen purged after a possible fire is detected or dried with heated air if the charcoal is wetted, while the offgas flow is bypassed around it and through the remaining charcoal vessels. Another nitrogen purge line is also provided just upstream of the remaining charcoal adsorber vessels that allow them to be purged, if required, without interrupting the processing of offgas through the guard bed. The isolation valves in the nitrogen and air purge lines and the connection for the gas supply are accessible from outside the charcoal vault.

#### ***11.3.2.2 Component Design***

For portions of the system that may contain an explosive mixture, the design provides for ignition sources to be minimized and the system to be able to sustain an explosion without loss of integrity. This analysis is covered in proprietary report NEDE-11146 (Reference 11.3-11).

Calculation methods for translation of detonation pressures into wall thickness are summarized in the ANSI-55.4 (Reference 11.3-6). Equipment are designed and constructed in accordance with the requirements of Table 11.3-2.

### ***Materials***

Per Regulatory Guide 1.143 (Reference 11.3-3), Regulatory Position 2.2, materials for pressure-retaining components of process systems<sup>1</sup> are selected from those covered by the material specifications listed in Section II, Part A of the ASME Boiler and Pressure Vessel Code, except that malleable, wrought or cast-iron materials, and plastic pipe are not allowed in this application. The components satisfy the mandatory requirements of the material specifications with regard to manufacture, examination, repair, testing, identification, and certification.

### ***Pressure Relief***

Adequate pressure relief is provided at all locations where it is possible to isolate a portion of the system containing a potential heat source that could cause excessive pressure. Adequate pressure relief is also provided downstream of pressure reducing valves to protect equipment from overpressure.

### ***Equipment Room Ventilation Control***

The equipment rooms are under negative ventilation control. The equipment in the equipment rooms is qualified for the environmental conditions it is expected to see.

Differential pressure between general areas and equipment cells is sufficient to maintain a flow of air from clean areas into potentially contaminated areas. In addition, the Turbine Building HVAC (TBHV) is capable of removing sufficient heat from the process piping, equipment,

---

<sup>1</sup> "Process System" refers to that portion of the OGS that normally processes SJAE Offgas.

motors, and instrumentation so as to maintain the environmental temperatures as established. All equipment cell and charcoal vault ventilation air is discharged without passing through occupied areas to the TB compartment exhaust system and the plant vent stack, where effluent radiation monitoring is performed.

### ***Leakage***

The leakage criteria apply from the SJAE through the OGS, including all process equipment and piping in between as shown on Figure 11.3-1. Leakage from the process through purge or tap lines to external atmospheric pressure is sufficiently low so it is undetectable by “soap bubble” test. This requirement does not apply to in-line process valves.

Instrument panels (e.g., hydrogen analyzers) connected to process gas are enclosed, the enclosure maintained under a negative pressure, and vented to an equipment vault or to building ventilation. To reduce instrument line leakage, welded or swaged, rather than threaded, connections are used wherever possible.

### ***Vents and Drains***

OGS drains, depending on source, are routed to either the condenser hotwell or to the radwaste system. All piping is provided with high point vents and low point drains to permit system drainage following the hydrostatic test. A water drain is provided on the process lines just upstream of the charcoal tanks. The process line to and from the charcoal adsorbers is sloped so that there are no intervening low spots to act as water traps.

### ***Valves***

No valves controlling the flow of process gas are located in the charcoal adsorber vault. For all valves exposed to process offgas, valve seats are designed to avoid sparks.

All valves exposed to process gas have bellows stem seals, double stem seals or equivalent.

### ***Recombiners***

The recombiners are mounted with the gas inlet at the bottom. The inlet piping has sufficient drains and moisture separators to prevent liquid water from entering the recombiner vessel during startup. The recombiners are catalytic type with non-dusting catalyst supported on a metallic base. The catalyst is replaceable without requiring replacement or removal of the external pressure vessel.

Each recombiner is part of an integrated preheater-recombiner-condenser pressure vessel assembly. The preheater section uses nuclear quality steam to heat the offgas process stream gases to at least the minimum values shown in Table 11.3-1 before it reaches the catalyst in the recombiner section. The recombined hydrogen and oxygen, in the form of super-heated steam, which leaves the recombiner section, is then condensed (by power cycle condensate) to liquid water in the condenser section of the assembly, while the noncondensable gases are cooled to temperatures below the maximum value shown in Table 11.3-1. The condensed water in the condenser section is drained to a loop seal that is connected to the main condenser hotwell. Condensed preheater section steam is drained to the above loop seal that is connected to the hotwell.

No flow paths above low power operation exist whereby unrecombined offgas can bypass the recombiners .

***Charcoal Adsorber Vessels***

The charcoal adsorber vessels are to be cylindrical tanks installed vertically.

Channeling in the charcoal adsorbers is prevented by supplying an effective flow distributor on the inlet and by a high bed-to-particle diameter ratio. Temperature elements are installed along the charcoal adsorber vessels in sufficient quantity to monitor the temperature profile along the flow path during operation.

***Charcoal Adsorber Vault***

The temperature within the charcoal adsorber vault is maintained and controlled by appropriate connection(s) to the TBHV System. The decay heat is sufficiently small that, even in the no-flow condition, there is no significant loss of adsorbed noble gases because of temperature rise in the adsorbers.

The charcoal adsorber vault itself is designed for the temperature range shown in Table 11.3-1 because it may be necessary to heat a vessel or the vault to the maximum temperature (by the use of portable heaters) to facilitate drying the charcoal. A smoke detector is installed in the exhaust ventilation duct from the charcoal adsorber vault to detect and provide alarm to the operator as a charcoal fire within the vessel(s) usually results in the burning of the exterior paint surface.

***Construction of Process Systems***

Pressure-retaining components of process systems employ welded construction to the maximum practicable extent. Process piping systems include the first root valve on sample and instrument lines.

***Moisture Separator***

A moisture separator is incorporated into the cooler-condenser heat exchanger.

***Maintenance Access***

The system equipment is generally not accessible for maintenance during system operation. Therefore, equipment is intended to be accessible during the plant outages. The following are exceptions:

- The redundant offgas recombiner trains are located in separate rooms to allow maintenance access to the standby train when processing offgas in the operable train.
- Control valving and hydrogen analyzers are accessible for maintenance during the out of service portion of their cycle.
- Charcoal vault air conditioning and ventilation equipment are accessible for maintenance during plant operation.

The OGS is designed, constructed, and tested to be as leak tight as practicable.

Design features which reduce or ease required maintenance or which reduce personnel exposure during maintenance include the following:

- Redundant components for all active, in-process equipment pieces located in separate shielded cells;
- No rotating equipment in the radioactive process stream;

- Block valves with air bleed pressurization for maintenance which may be required during plant operation; and
- Shielding of non-radioactive auxiliary subsystems from the radioactive process stream.

Design features that reduce leakage and releases of radioactive material include the following:

- Extremely stringent leak rate requirements placed upon all equipment, piping and instruments and enforced by requiring helium leak tests of the entire process system as described in section 11.3.5;
- Use of welded joints wherever practicable;
- Specification of valve types with extremely low leak rate characteristics (i.e., bellows seal, double stem seal, or equal);
- Routing of most drains through loop seals to the main condenser; and
- Specification of stringent seat-leak characteristics for valves and lines discharging to the environment through other systems.

#### ***11.3.2.3 Seismic Design***

OGS equipment and piping are classified Seismic Category Non-seismic (NS).

#### **11.3.3 Ventilation System**

Radioactive gases are present in the power plant buildings as a result of process leakage and steam discharges. The process leakage is the source of the radioactive gases in the air discharged through the ventilation system. The design of the ventilation system is described in Section 9.4. The radiation activity levels from the ventilation systems are treated in Section 12.2. The ventilation flow rates are shown in Section 9.4.

#### **11.3.4 Radioactive Releases**

Refer to Section 12.2 for radioactive release information from the OGS.

#### **11.3.5 Testing and Inspection Requirements**

Because the gaseous radioactive waste system has no safety-related function, no inservice inspection of the components is required.

Preoperational and startup testing, which includes hydrostatic testing of system components and piping; helium leak testing; and verification of air ejector pressure and flow, preheater operation (recombiner inlet temperature), catalyst temperature, and offgas condenser operation; is accomplished as described within Section 14.2.

During normal operation, the hydrogen analyzers, process components, and monitoring instrument channels are periodically tested and calibrated to ensure that the explosive gas mixture is below the flammability limit and projected doses from gaseous effluent releases are kept as low as reasonably achievable and below regulatory limits.

### 11.3.6 Instrumentation Requirements

Control and monitoring of the OGS process equipment is performed locally or remotely from the main control room. Generally, system control is from the main control room. Instrument components are installed wherever possible in accessible areas to facilitate operation and maintenance. Only instrument sensing elements are permitted behind shield walls.

The temperature of the gaseous waste stream is measured in the preheater and at various locations in the recombiner to assure that recombination is occurring. The gaseous waste stream temperature is also measured after both the offgas condenser and the cooler condenser to assure the stream is cooled sufficiently to remove undesired moisture. These temperatures are alarmed in the main control room.

The flow rate of the offgases is continuously monitored. The offgas flow rate, in conjunction with activity concentrations as measured by the monitor downstream of the recombiners and the monitor downstream of the charcoal adsorbers, permits monitoring fission gases from the reactor, calculation of offgas discharge to the vent, and calculation of the charcoal adsorber system performance.

### 11.3.7 Radioactive OffGas System Leak or Failure

#### 11.3.7.1 Basis and Assumptions

The radiological consequences for an OGS accident as specified in Standard Review Plan 11.3 (Reference 11.3-18), BTP - ETSB 11-5 are presented. The BTP assumptions were used except as detailed below to evaluate this accident. The accident parameters are shown in Table 11.3-4. The results are presented in Tables 11.3-6 and 11.3-7 and show the ESBWR design to be compliant with the requirements of the BTP.

The system is designed to be detonation resistant and seismic per Table 3.2-1 and meets all criteria of Regulatory Guide 1.143 (Reference 11.3-3). As such, the failure of a single active component leading to a direct release of radioactive gases to the environment is highly unlikely. Therefore, inadvertent operator action with bypass of the delay charcoal beds is analyzed for compliance to ESTB 11-5. A top-level diagram of the ESBWR OGS can be found in Figure 11.3-1 that shows the ESBWR charcoal beds consist of ten charcoal tanks. The first and second, or guard tanks contain charcoal followed by a flow split into two lines, each line of which leads through four massive tanks, each containing charcoal. Bypass valves exist to direct flow around (1) one active and one standby guard tank, (2) two parallel streams of follow-on tanks, or (3) one guard bed and the two parallel streams of follow-on tanks. To bypass either pathway (1) or (2) above requires the operator to enter a computer command with a required permissive. To bypass all tanks requires the operator to key in the command with two separate permissives. Because the bypass of all tanks would require both inadvertent operation upon the operator (keying in the wrong command) plus getting two specific permissives for the incorrect decisions, it is assumed not likely to occur. Downstream of the charcoal beds shown on Figure 11.3-1 are a series of two redundant radiation monitoring instruments and an air-operated isolation valve. Upon receiving a Hi signal, the system alarms the control room, where a Hi-Hi signal automatically initiates a "treat" mode, causing flow to process through the charcoal tanks, and override switch settings. Therefore, bypass of the charcoal beds during periods with

significant radioactive flow through the OGS are limited and/or automatically terminated by actuation of the downstream sensors.

To evaluate the potential radiological consequences of an inadvertent bypass of the charcoal beds, it was assumed that operator error or computer error has led to the bypass of the eight follow-on beds in addition to the failure of the automated air-operated downstream isolation valve. It is also assumed that during this period, the plant is running at, and continues to run at, the maximum permissible offgas release rate based upon the assumption of 100  $\mu\text{Ci/sec/MWt}$  as stipulated in Standard Review Plan 11.3 (Reference 11.3-18) evaluated to a decay time of 30 minutes from the vessel exit nozzle. Even with the failure of the downstream isolation valve, it is not anticipated or assumed that the isolation instrumentation would fail, but would instead alarm the control room with a high radiation alarm, causing the operator to manually isolate the OGS (i.e., close suction valves) within 1 hour of the alarm.

Therefore, this analysis differs from the BTP on the following points:

- There is no motive force to remove any significant inventory from the eight follow-on charcoal tanks while in bypass and, therefore, no activity from these tanks is included in the final release calculations.
- With redundant instrumentation, it is expected that operator intervention to either shut off the bypass or isolate the OGS is predicted to occur within 1 hour. Therefore, the total flow from the system is evaluated for 1-hour and not the 2-hour period stipulated in BTP - ESTB 11-5 (Reference 11.3-18).

#### **11.3.7.2 Results**

The DBA evaluation assumptions are given in Table 11.3-4, the isotopic flows and releases in Table 11.3-5 and Table 11.3-6, and the meteorology and dose results in Table 11.3-7.

The dose results are given in Table 11.3-7 and are within the limiting 25 mSv (2.5 Rem) whole body dose for an infrequent event or the 5 mSv (0.5 Rem) frequent event limitation of BTP - ESTB 11-5 (Reference 11.3-18).

#### **11.3.8 COL Information**

None.

#### **11.3.9 References**

- 11.3-1 Title 10 Code of Federal Regulations Part 50, Appendix I, "Numerical Guides for Design Objectives and Limiting Conditions to Meet the 'As Low As Is Reasonably Achievable' for Radioactive Material in Light-Water Cooled Nuclear Power Reactors."
- 11.3-2 Title 10 Code of Federal Regulations Part 20, "Standards for Protection Against Radiation."
- 11.3-3 Nuclear Regulatory Commission (NRC), Regulatory Guide 1.143, "Design Guidance for Radioactive Waste Management Systems, Structures, and Components Installed in Light-Water-Cooled Nuclear Power Plants."
- 11.3-4 American Society of Mechanical Engineers (ASME) Boiler and Pressure Vessel Code, Section VIII - Division 1.

- 11.3-5 American Institute of Steel Construction (AISC), Manual of Steel Construction
- 11.3-6 American National Standards Institute, "Gaseous Radioactive Waste Processing Systems for Light Water Reactor Plants," ANSI/ANS-55.4.
- 11.3-7 W.E. Browning, et al., "Removal of Fission Product Gases from Reactor Offgas Streams by Absorption," June 11, 1959, Oak Ridge National Laboratory (ORNL) CF59-6-47.
- 11.3-8 D.P. Seigwarth, "Measurement of Dynamic Absorption Coefficients for Noble Gases on Activated Carbon," Proceedings of the 12th AEC Air Cleaning Conference.
- 11.3-9 Dwight Underhill, et al., "Design of Fission Gas Holdup Systems, Proceedings of the Eleventh AEC Air Cleaning Conference," 1970, p. 217.
- 11.3-10 General Electric Co., "Radiological Accident Evaluation - The CONAC03 Code," NEDO-21143-1, December 1981.
- 11.3-11 General Electric Co., "Pressure Integrity Design Basis for New Off-Gas Systems," NEDE-11146, July 1971 (Proprietary).
- 11.3-12 Draft Guide DG-1145: Combined License Applications for Nuclear Power Plants (LWR Edition), 1.11 Radioactive Waste Management
- 11.3-13 Bulletin 80-10, May 6, 1980
- 11.3-14 Regulatory Guide 8.8, "Information Relevant to Ensuring that Occupational Radiation Exposures at Nuclear Power Stations Will Be as Low as Is Reasonably Achievable", Revision 3, June 1978
- 11.3-15 Title 10 Code of Federal Regulations, Part 50 Appendix A GDC 60
- 11.3-16 Title 10 Code of Federal Regulations, Part 50 Appendix A GDC 64
- 11.3-17 Title 10 Code of Federal Regulations, Part 20.1406
- 11.3-18 NUREG-0800, Standard Review Plan, 11.3 Gaseous Waste Management System, DRAFT Rev. 3 – April 1996 and BTP - ETSP 11-5 "Postulated Radioactive Releases Due to a Waste Gas System Leak or Failure"
- 11.3-19 Title 10 Code of Federal Regulations, Part 50 Appendix A GDC 3
- 11.3-20 Title 10 Code of Federal Regulations, Part 50.34a "Design Objectives for Equipment to Control Releases of Radioactive Material in Effluents – Nuclear Power Reactors"

**Table 11.3-1**  
**Offgas System Design Parameters\***

<b>Design Parameter</b>	<b>Design Value</b>
Design basis noble radiogas release rate	3700 MBq/s (100,000 $\mu$ Ci/s)
Assumed air in-leakage	51 m <sup>3</sup> /h standard (30 scfm)
Xenon delay	60- day
Maximum gaseous waste stream temperature	67 °C (153 °F)
Charcoal temperature (approximate)	35 °C (95 °F)
Maximum cooler condenser temperature	18 °C (65 °F)
Chilled water temperature	7°C (45°F)
Gaseous waste stream temperature	35 °C (95 °F)
Nominal recombiner preheater temperature	177 °C (351 °F)
Maximum recombiner preheater temperature	210 °C (410 °F)
Out-of-service hydrogen/oxygen catalytic recombiner minimum temperature	121 °C (250°F)
Minimum activated charcoal ignition temperature	156 °C (313 °F)
Minimum air bleed supply rate	0.17 m <sup>3</sup> /min (6 scfm)
Air bleed to standby recombiner train at startup and normal operation	0.17 m <sup>3</sup> /min (6 scfm)
Radiolytic gas flow range	0 to 8.6 m <sup>3</sup> /min (302 scfm)
Charcoal adsorber vault temperature range	29 °C (84 °F) to 40 °C (104 °F)
Charcoal particle size	8 – 16 mesh United States Standard (USS) with less than 0.5% under 20 mesh
Charcoal moisture content	< 5% by weight
Maximum offgas activity input concentration	5.9E+6 Bq/cm <sup>3</sup>

\* For additional information on radioactive releases, refer to Subsection 11.1 or 12.2.



**Table 11.3-2**  
**Offgas System Major Equipment Items**

<b>Recombiner</b> (2 required, contains preheater, catalyst, and condenser sections)	
Carbon steel shell	
Design pressure:	2.41 MPa gauge (350 psig)
Design temperature:	232 °C (450 °F)
Code of construction:	ASME Section VIII, Division 1
Preheater Section	Shell and tube heat exchanger
Tubes:	stainless steel
Tube-side design temperature:	302 °C (575 °F)
Tube-side design pressure:	8.6 MPa gauge (1250 psig)
Design temperature:	232 °C (450 °F)
Catalyst section	
Catalyst support:	stainless steel
Design temperature:	482 °C (900 °F)
Catalyst:	precious metal on metal base
Offgas condenser section	Shell and tube heat exchanger
Tubes:	stainless steel
Tube-side design pressure:	2.41 MPa gauge (350 psig)
Design temperature:	482 °C (900 °F)
<b>Cooler Condenser</b> (2 required)	
Shell and tube heat exchanger, carbon steel vessel	
Shell-side design pressure:	2.41 MPa gauge (350 psig)
Shell-side design temperature:	121 °C (250 °F)
Tubes:	stainless steel
Tube-side design pressure:	1 MPa gauge (145 psig)
Code of construction:	TEMA Class C
<b>Dryer</b> (2 required)	
Design pressure	2.41 Mpa gauge (350 psig)
Design temperature	121°C (250°)
Dew point temperature	7°C (45°F)
Code of construction	ASME Section VIII, Division 1

**Table 11.3-2**  
**Offgas System Major Equipment Items**

<b>Charcoal Adsorbers (10 required )</b>	
Carbon steel vessels filled with activated charcoal	
Design pressure:	2.41 MPa gauge (350 psig)
Design temperature:	121 °C (250 °F)
Code of construction:	ASME Section VIII, Division 1

**Table 11.3-3**  
**Equipment Malfunction Analysis**

<b>Equipment Item</b>	<b>Malfunction</b>	<b>Result(s)</b>	<b>Design Precautions</b>
Steam jet air ejectors	Low flow of motive high pressure steam	If the hydrogen and oxygen concentrations exceed 4 vol %, the recombiner's temperature rise is excessive.	Automatic system isolation on low steam flow.
		Inadequate steam flow causes overheating and may result in exceeding the design temperature of the recombiner vessel.	Steam flow to be held at constant maximum flow regardless of plant power level.
	Wear of steam supply nozzle of ejector	Increased steam flow to recombiner could reduce degree of recombination at low power levels. High discharge temperature from recombiner condenser could result because of inadequate condenser capacity.	Temperature alarms on preheater exit (catalyst inlet). Downstream H <sub>2</sub> analyzer alarms. High temperature alarms on exit from recombiner.
Recombiner preheater	Steam leak	Steam consumption would increase.	Spare recombiner train.
	Low-pressure steam supply	Recombiner performance could fall off at low-power level, and hydrogen content of recombiner gas discharge could increase eventually to a combustible mixture.	Low temperature alarms on preheater exit (catalyst inlet). Downstream H <sub>2</sub> analyzer alarm.
Recombiner catalyst	Catalyst gradually deactivates	Temperature profile changes through catalyst. Eventually excess H <sub>2</sub> would be detected by H <sub>2</sub> analyzer or by offgas flowmeter. Eventually the gas could become combustible.	Temperature probes in catalyst bed and H <sub>2</sub> analyzer provided. Spare recombiner train.
	Catalyst gets wet at start	H <sub>2</sub> -O <sub>2</sub> recombination fails. Eventually the gas downstream of the recombiner could become combustible.	Condensate drains, temperature probes in recombiner. Air bleed system at startup. Spare recombiner. Hydrogen analyzer.

**Table 11.3-3**  
**Equipment Malfunction Analysis**

<b>Equipment Item</b>	<b>Malfunction</b>	<b>Result(s)</b>	<b>Design Precautions</b>
Recombiner condenser	Cooling water leak	The coolant (reactor condensate) would leak to the process gas (shell) side. This would be detected by drain flow increase. Moderate leakage would be of no concern from a process standpoint. (The process condensate drains to the hotwell.)	Drain high flow alarm. Redundant recombiner.
Cooler condenser	Corrosion of tubes	Water would leak into process (shell) side and be sent to main condenser hotwell.	Stainless-steel tubes specified. Conductivity cell in condenser drain.
Moisture separator in cooler condenser	Corrosion of wire mesh element	Increased moisture would be retained in process gas routed to charcoal over a long period.	Stainless steel mesh specified. Spare cooler condenser provided. Levels in pre-charcoal drain.
Charcoal adsorbers	Charcoal gets wet	Charcoal performance deteriorates gradually as moisture deposits. Holdup times for krypton and xenon would decrease, and plant emissions would increase. Provisions made for drying charcoal as required during annual outage.	High instrumented, mechanically simple gas dehumidification system.
System	Internal detonation	Release of radioactivity if pressure boundary fails	Main process equipment and piping are designed to contain a detonation.
		Internal damage to the recombiner and its heat exchanger	Redundant recombiner, damaged internals can be repaired.
		Damage to instrumentation sensors	Redundant, damaged sensors can be replaced.
System	Earthquake damage	Release of radioactivity	System is designed in accordance with Regulatory Guide 1.143 to withstand the effects of earthquakes (see subsection 11.3.7)

**Table 11.3-4**  
**Offgas System Failure Accident Parameters**

I. Data and Assumptions Used to Estimate Source Terms	
a. Power Level	4,500 MWt
b. Offgas Release Rate	1.67E+4 MBq/s <sup>1</sup> (4.5E+5 $\mu$ Ci/s)
c. Duration of Release	1h
II. Dispersion and Dose Data	
a. Meteorology	Table 11.3-7
b. Dose Methodology	Reference 11.3-10
c. Dose Conversion Assumptions	Reference 11.3-10, RG 1.109
d. Activity Releases	Table 11.3-6
e. Dose Evaluations	Table 11.3-7

1 Isotopic rates refer to a 30-minute decay time.

**Table 11.3-5**  
**Isotopic Source Rates for Design Basis\***

Isotope	t=0		t=30 min	
	MBq/s	Ci/s	MBq/s	Ci/s
Kr-83m	1.30E+2	3.53E-3	1.08E+2	2.93E-3
Kr-85m	2.22E+2	5.99E-3	2.05E+2	5.54E-3
Kr-85	8.88E-1	2.40E-5	8.88E-1	2.40E-5
Kr-87	7.30E+2	1.97E-2	5.55E+2	1.50E-2
Kr-88	7.33E+2	1.98E-2	6.48E+2	1.75E-2
Kr-89	4.43E+3	1.20E-1	6.44E+0	1.74E-4
Total Kr				4.12E-2
Xe-131m	7.30E-1	1.97E-5	7.29E-1	1.97E-5
Xe-133m	1.09E+1	2.94E-4	1.08E+1	2.92E-4
Xe-133	3.10E+2	8.38E-3	3.09E+2	8.36E-3
Xe-135m	9.42E+2	2.55E-2	2.50E+2	6.77E-3
Xe-135	8.42E+2	2.27E-2	8.10E+2	2.19E-2
Xe-137	5.89E+3	1.59E-1	2.56E+1	6.93E-4
Xe-138	3.33E+3	8.99E-2	7.70E+2	2.08E-2
Total Xe				5.88E-2
Kr+Xe				1.00E-1

\* Only the major isotopic constituents are identified.

**Table 11.3-6**  
**Releases to the Environment**

Isotope	Release Rate		Releases	
	MBq/s	Ci/s	MBq	Ci
Kr-83m	4.88E+2	1.32E-2	1.76E+6	4.74E+1
Kr-85m	9.22E+2	2.49E-2	3.32E+6	8.98E+1
Kr-85	4.00E 0	1.08E-4	1.44E+4	3.88E-1
Kr-87	2.50E+3	6.75E-2	9.60E+6	2.42E+2
Kr-88	2.91E+3	7.87E-2	1.05E+7	2.84E+2
Kr-89	2.90E+1	7.83E-4	1.04E+5	2.82E 0
Total Kr	6.85E+3	1.85E-1	2.46E+7	6.66E+2
Xe-131m	3.28E 0	8.86E-5	1.18E+4	3.20E-1
Xe-133m	4.86E+1	1.31E-3	1.75E+5	4.74E 0
Xe-133	1.39E+3	3.76E-2	5.02E+6	1.35E+1
Xe-135m	1.13E+3	3.05E-2	4.06E+6	1.10E+2
Xe-135	3.65E+3	9.85E-2	1.31E+7	3.54E+2
Xe-137	1.15E+2	3.12E-3	4.16E+5	1.12E+1
Xe-138	3.46E+3	9.36E-2	1.25E+7	3.36E+2
Total Xe	9.80E+3	2.65E-1	3.52E+7	9.54E+2
Kr+Xe	1.67E+4	4.50E-1	6.00E+7	1.62E+3

**Table 11.3-7****Offgas System Failure Meteorology and Dose Results**

<b>Meteorology</b>	<b>Whole Body Dose</b>
1.0 E-3 s/m <sup>3</sup>	3.1 E-3 Sv



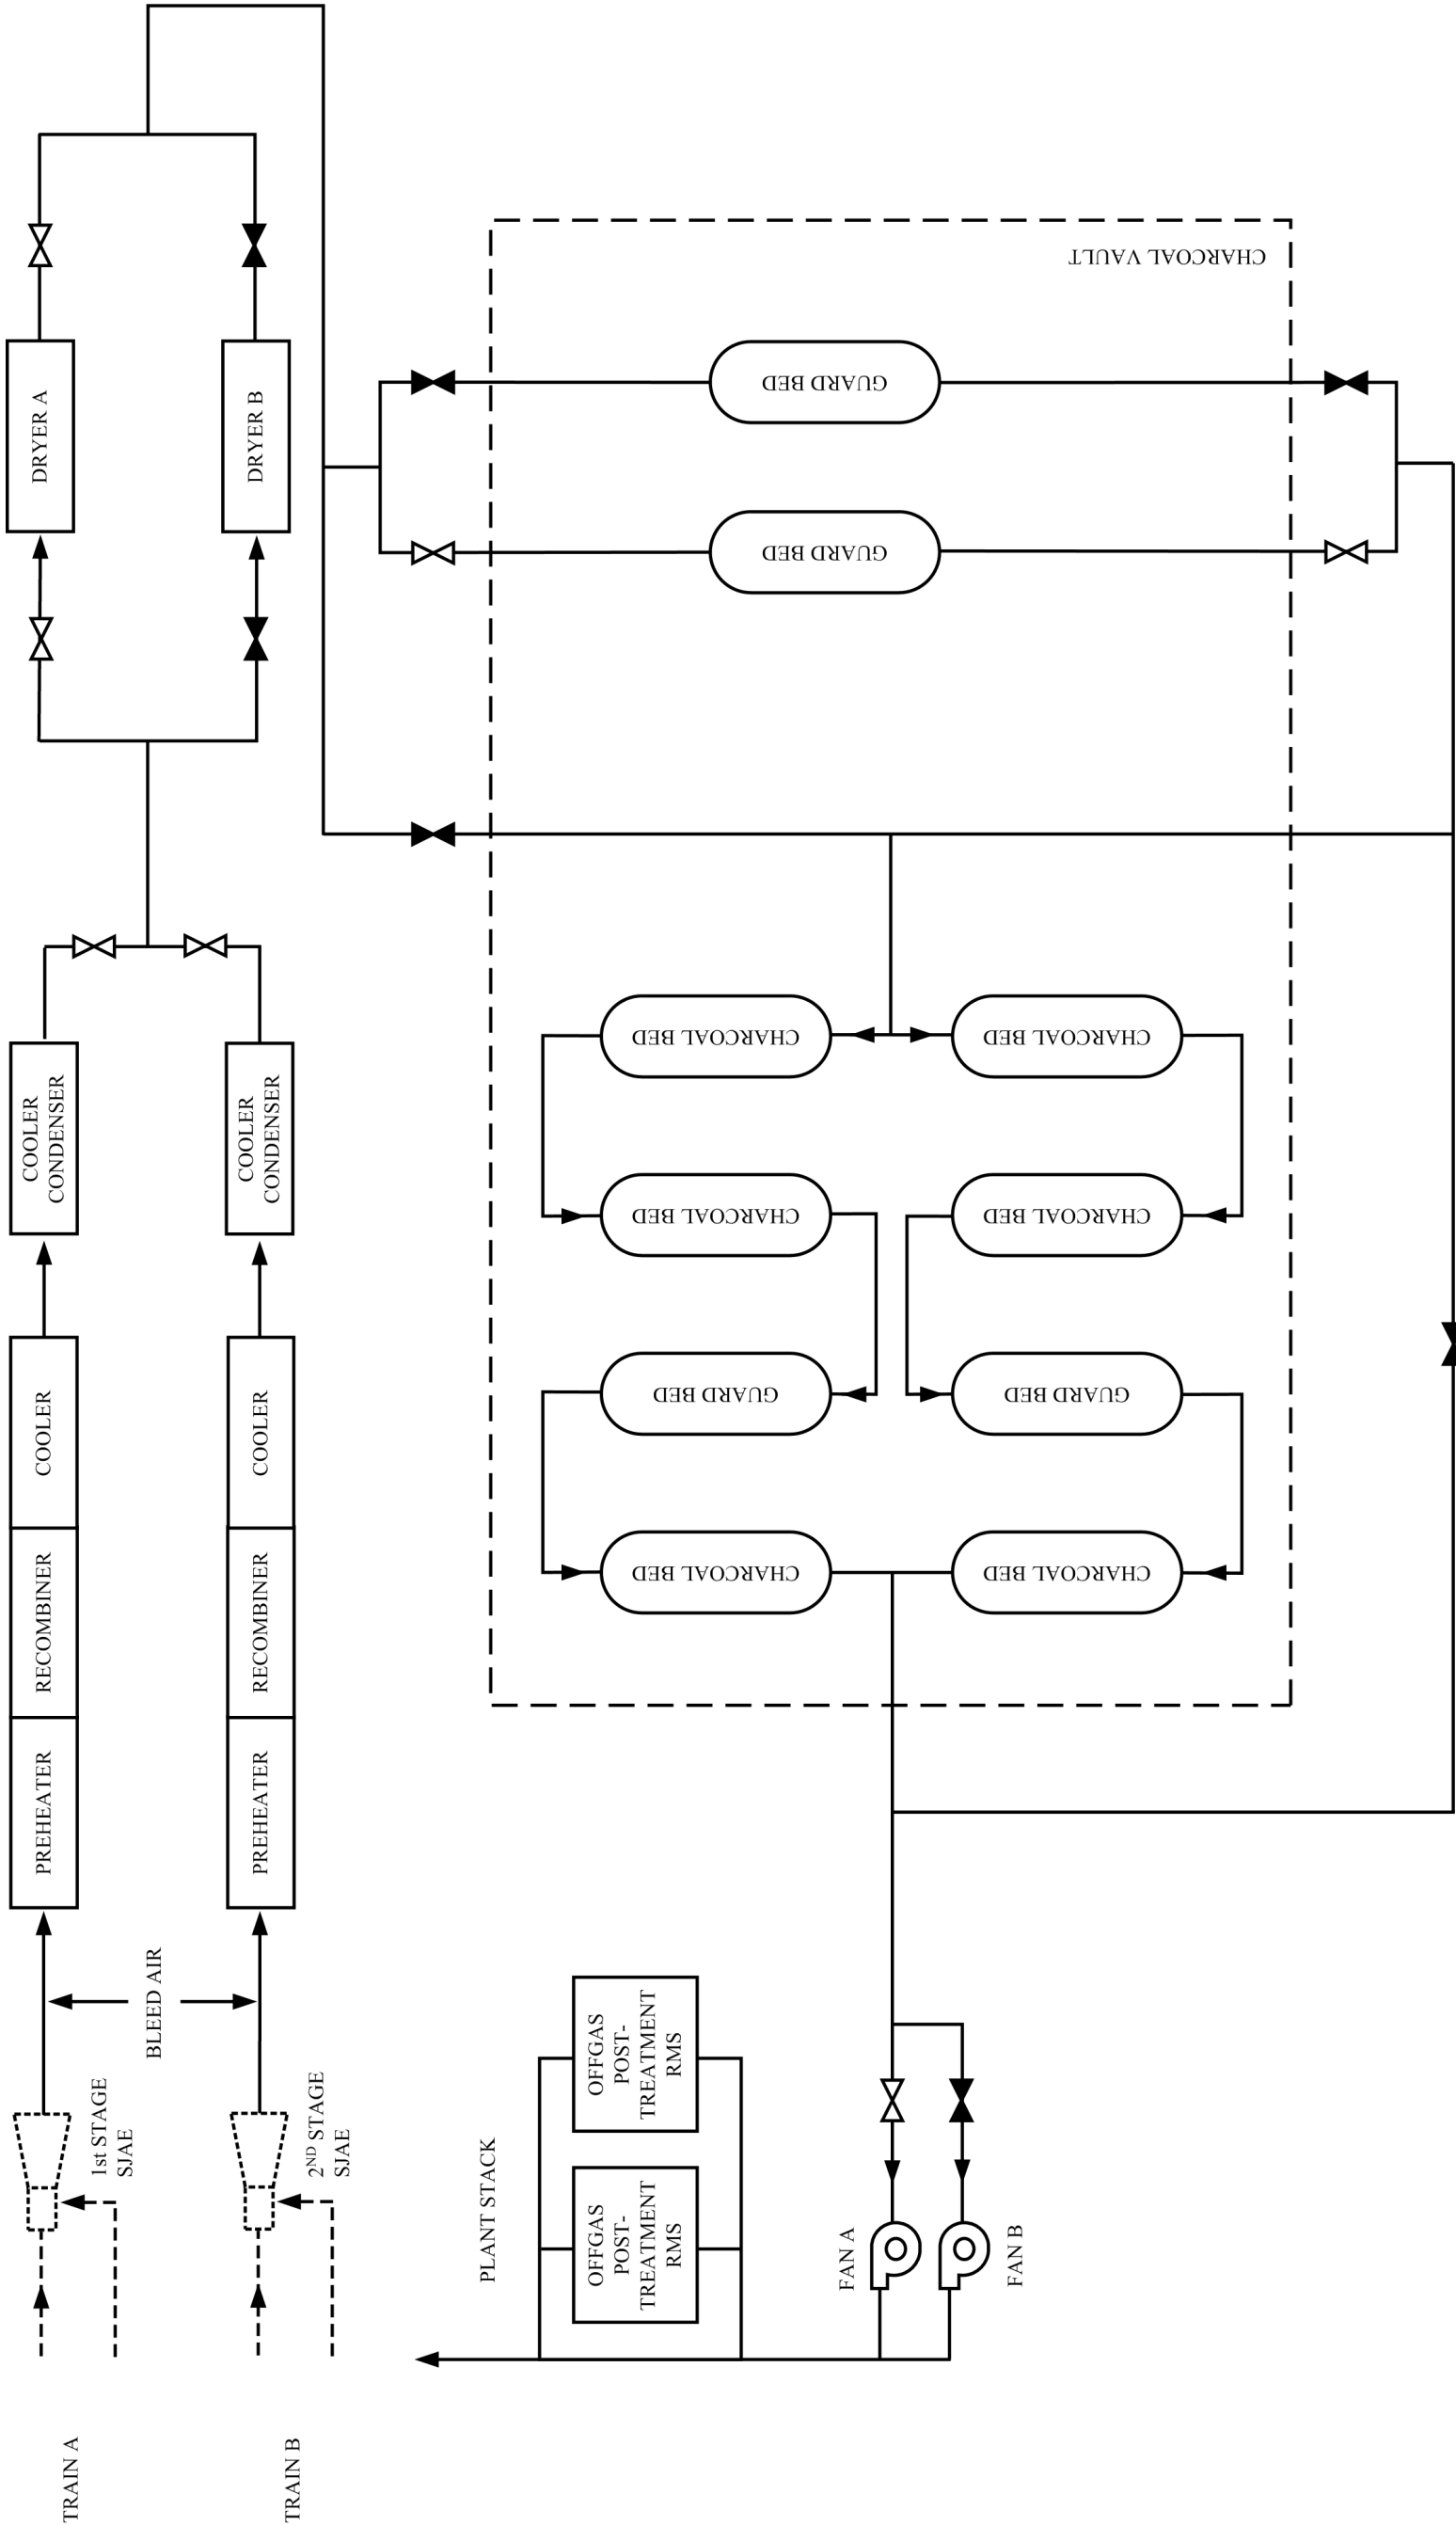


Figure 11.3-1. Offgas System

## 11.4 SOLID WASTE MANAGEMENT SYSTEM

The Solid Waste Management System (SWMS) is designed to control, collect, handle, process, package, and temporarily store wet and dry solid radioactive waste prior to shipment. This waste is generated as a result of normal operation and anticipated operational occurrences.

The SWMS is located in the radwaste building. It consists of the following four subsystems:

- Wet solid waste collection subsystem;
- Mobile wet solid waste processing subsystem;
- Dry solid waste accumulation and conditioning subsystem; and
- Container storage subsystem.

The SWMS Process Diagram depicting all four subsystems is provided in Figure 11.4-1. A conceptual radwaste building general arrangement drawing is provided in Figures 1.2-21 thru 1.2-25. The SWMS component capacities are provided in Table 11.4-1. The estimated annual shipped waste volumes generated from the SWMS subsystems are provided in Table 11.4-2. The SWMS has the capability to process wastes at rates higher than shown in Table 11.4-2. The isotopic inventory of the as-shipped waste is provided by waste type in Chapter 12.

Process and effluent radiological monitoring systems are described in Section 11.5.

### 11.4.1 Design Bases

#### *Safety Design Bases*

The SWMS has no safety-related function.

#### *Power Generation Design Bases*

The SWMS is designed to provide collection, processing, packaging, and storage of bead resin, filter backwash, and dry solid waste resulting from normal operations.

- The SWMS is designed to meet the guidance of Regulatory Guide 1.143 (Reference 11.4-1).
- The SWMS is designed to keep the exposure to plant personnel “as low as reasonably achievable” (ALARA) during normal operation and plant maintenance, in accordance with Regulatory Guide 8.8 (Reference 11.4-1).
- The SWMS is designed to package solid waste in Department of Transportation (DOT)-approved containers for off-site shipment and burial.
- The SWMS is designed to prevent the release of significant quantities of radioactive materials to the environment so as to keep the overall exposure to the public well within 10 CFR 20 limits and in accordance with the limits specified in 10 CFR 50 (Reference 11.4-21).
- The SWMS is designed to package the wet and dry types of radioactive solid waste for off-site shipment and burial, in accordance with the requirements of applicable NRC and DOT regulations, including 10 CFR 61 (Reference 11.4-13), 10 CFR 71 (Reference 11.4-22) and 49 CFR 171 (Reference 11.4-24) through 180 (Reference 11.4-25), as applicable.

This results in radiation exposures to individuals and the general population well within the limits of 10 CFR 20 and 10 CFR 50.

- The seismic and quality group classification and corresponding codes and standards that apply to the design of the SWMS components and piping, and the structures housing the SWMS are discussed in Section 3.2.
- On-site storage space for 6-month's volume of packaged waste is provided in the radwaste building. Depending on the availability and accessibility of adequate waste repositories in the future, NUREG-0800, Standard Review Plan, 11.4 and BTP - ETSB 11-3 (Reference 11.4-1) Solid Waste Management System, DRAFT Rev. 3 – April 1996, Appendix 11.4-A, Design Guidance for Temporary Storage of Low Level Radioactive Waste provides guidance for construction and management of a temporary storage facility including up to five years waste storage. This temporary storage facility and an associated overall site waste management plan is intended to allow the station to operate while considerations for further waste minimization and volume reduction are adopted, such as the design and construction of additional volume reduction facilities, as necessary, and then the processing of the wastes that may have been stored during the construction of those facilities. Additionally, the five-year duration is to allow time for the regional state compacts to create additional low-level waste disposal sites. The inclusion of a temporary storage facility and an overall site management plan per NUREG-0800 Standard Review Plan 11.4 and BTP - ETSB 11-3 (Reference 11.4-1), Draft Rev 3-April 1996, Appendix 11.4-A may be required.
- All atmospheric collection and storage tanks are provided with an overflow connection at least the size of the largest inlet connection. The overflow is connected below the tank vent and above the high-level alarm setpoint. Each tank room is designed to contain the maximum liquid inventory in the event that the tank ruptures.

Radionuclides influent to the SWMS are presented in Section 12.2, including Table 12.2-14a and Table 12.2-14b. Any resultant gaseous and liquid wastes are routed to other plant sections. Gaseous radionuclides from the SWMS are processed by the monitored radwaste building ventilation system. The monitored ventilation system is described in Section 9.4 and Subsection 12.3.3.2.4. Liquid waste is processed by the monitored LWMS system as described in Section 11.2. Process and effluent radiological monitoring systems are described in Section 11.5.

Section 12.3 describes systems to detect conditions that may result in excessive radiation levels per Title 10 Code of Federal Regulations Part 50, Appendix A, GDC 63 (Reference 11.4-14). Section 11.5 describes systems to monitor the effluent discharge paths for radioactive material per Title 10 Code of Federal Regulations Part 50, Appendix A, GDC 64 (Reference 11.4-15).

A description of the SWMS design features addressing Part 20.1406 (Reference 11.4-7) requirements for permanently installed systems is in Section 12.6. The COL holder is responsible for including site-specific information in Section 11.4.1 describing how the implementation of operating procedures and design features for installation and operation of the mobile/portable SWMS will address the requirements of Part 20.1406 (Reference 11.4-7). Specifically the operational procedures and design of the mobile/portable SWMS should minimize, to the extent practicable, contamination of the facility and the environment, facilitate

decommissioning, and minimize the generation of radioactive wastes. This information may be placed into Section 12.6 provided applicable referencing is included in Subsection 11.4.1.

The Area Radiation Monitors for the Radwaste Building Wet Solid Radioactive Waste Treatment Area, the Radwaste Building Dry Solid Waste Treatment Area and the Radwaste Building Packaged Waste Staging Area are depicted on Figure 12.3-41 and discussed in Subsection 12.3.4. The radwaste building seismic capability is described in Section 3.8.

The portable/mobile SWMS equipment is located within the permanently installed SWMS systems, and further located within the radwaste building as previously referenced and described. The location of the SWMS equipment within the radwaste building with monitored process effluents ensures compliance with 10 CFR 20.1302 (Reference 11.4-6), Part 20 Appendix B (Reference 11.4-8) effluent concentrations, Part 50.34a (Reference 11.4-10), Part 50, Appendix A, GDC 60 (Reference 11.4-12) and GDC 61 (Reference 11.4-13) as they relate to radioactive materials released in gaseous and liquid effluents to unrestricted areas.

## **11.4.2 System Description**

### ***11.4.2.1 Summary Description***

The SWMS controls, collects, handles, processes, packages, and temporarily stores solid waste generated by the plant prior to shipping the waste offsite. The SWMS processes the filter backwash sludges and bead resins generated by the Liquid Waste Management System (LWMS), Reactor Water Cleanup/Shutdown Cooling System (RWCU/SDC), Fuel and Auxiliary Pools Cooling System (FAPCS) and the Condensate Purification System. Contaminated solids such as High Efficiency Particulate Air (HEPA) and cartridge filters, rags, plastic, paper, clothing, tools, and equipment are also disposed of in the SWMS.

The SWMS is capable of receiving, processing, dewatering the solid radioactive waste inputs for permanent off-site disposal. Liquids from SWMS operations are sent to the appropriate LWMS section for processing as depicted in Figure 11.4-1 and described in Section 11.2.

### ***11.4.2.2 System Operation***

The COL holder is responsible for developing and maintaining programs identified in the administrative controls section of the TS per the requirements of Title 10 Code of Federal Regulations Part 50.36a (Reference 11.4-11), as described in the Standard Review Plan 11.4 (Reference 11.4-1), Draft Rev 3 – April 1996, Section III.9.

Waste will be classified as A, B, or C and meet the requirements of the waste treatment facility or repository per 10 CFR 61.55 (Reference 11.4-16) and 61.56 (Reference 11.4-17).

The SWMS complies with Regulatory Guide 1.143 (Reference 11.4-3), Revision 2, November 2001, as noted in Subsection 11.4.1. Construction of the radwaste building to meet the guidance of Regulatory Guide 1.143 (Reference 11.4-3) regarding safety-related classification is located in Subsection 3.8.4 and Subsection 3.8.4.1.5. Regulatory Guide 1.143 (Reference 11.4-3), Section 4.1, instructs that the design of radioactive waste management systems, structures and components should follow the direction in Regulatory Guide 8.8 (Reference 11.4-4). Compliance with Regulatory Guide 8.8 (Reference 11.4-4), Revision 3, June 1978 is located in

Subsection 12.1.1.3 and Subsection 12.3.1. The COL holder is responsible to ensure that mobile systems comply with the guidance of Regulatory Guide 1.143 (Reference 11.4-3) Revision 2, November 2001.

The SWMS consists of four process subsystems:

***Wet Solid Waste Collection Subsystem***

The wet solid waste collection subsystem collects the spent bead resin slurry, filter and tank sludge slurry and concentrated waste into the one of the five tanks in accordance with the waste characteristics.

Spent bead resin sluiced from the RWCU, FAPCS, Condensate Purification System and LWMS are transferred to three spent resin tanks or directly to liners for radioactive decay and storage. Spent resin tanks are categorized as follows:

- High Activity Resin Holdup Tank for receiving RWCU and FAPCS spent bead resin;
- Low Activity Resin Holdup Tank for receiving LWMS spent bead resin; and
- Condensate Resin Holdup Tank for receiving Condensate Purification System spent bead resin.

The capability exists to keep the higher activity resins, the lower activity resins and condensate resins in separate tanks. Excess water from a holdup tank is sent to the equipment drain collection tank or floor drain collection tank by a pump.

When sufficient bead resins have been collected in the high/low activity resin holdup tank, they are mixed via the high/low activity resin circulation pump and sent to the mobile wet solid waste processing subsystem via the high/low activity resin transfer pump. When sufficient bead resins have been collected in the condensate resin holdup tank, they are mixed via the condensate resin circulation pump and sent to the LWMS pre-treatment ion-exchanger for reuse or the mobile wet solid waste processing subsystem via the condensate resin transfer pump.

Two Low Activity Phase Separators receive suspended solid slurries from the Condensate Purification System, mobile filtration system of the LWMS and High Integrity Containers (HIC) effluent. The suspended solids are allowed to settle and the residual water is transferred by the low activity decant pump to the equipment drain collection tanks or floor drain collection tanks for further processing. When sufficient sludges have been collected in the tank, the sludges are mixed by the low activity resin circulation pump and sent to the mobile wet solid waste processing subsystem by the low activity resin transfer pump.

During transfer operations of the spent bead resins and the sludges, the suspended solids are kept suspended by a circulation pump to prevent them from agglomerating and possibly clogging lines.

One Concentrated Waste Tank receives concentrated waste from such streams as the mobile reverse osmosis system of the LWMS. When sufficient concentrated waste has been collected in the tank, the concentrated waste is sent to the mobile wet waste processing subsystem by a mixing/transfer pump.

***Mobile Wet Solid Waste Processing Subsystem***

The mobile wet solid waste processing subsystem consists of a dewatering station for high activity spent resin, a dewatering station for low activity spent resin and sludge and a dewatering station (or dryer) for concentrated waste. An empty HIC is lifted off of a transport trailer and placed in each empty dewatering station. The tractor/trailer may then be released. The HIC closure lid is removed and placed in a laydown area. Spent cartridge filters may be placed in the HIC at this point, if not shipped in separate containers.

Next, the fill head is positioned over the HIC manually or with a crane. The fill head includes a closed circuit television camera for remote viewing of the fill operation. The HIC is then filled with each kind of wet solid waste. The capability to obtain samples during the fill operation is provided.

Excess water is removed from the HIC and sent by a pump to the high activity resin holdup tank or a low activity phase separator that is in the receiving mode. Sufficient water is removed to ensure there is very little or no free standing water left in the HIC. Drying of the HIC contents may also be performed with heated air or pressure reduction.

The fill head is then removed and placed in a laydown area. The closure head is then placed on the HIC. The HIC is vented just prior to being shipped off-site for disposal to ensure that pressure is not building up. Radiation shielding is provided around the HIC stations.

The estimated annual shipped waste volumes from processing wet solid wastes are presented in Table 11.4-2.

***Dry Solid Waste Accumulation and Conditioning Subsystem***

Dry solid wastes consist of air filters, miscellaneous paper, rags, etc., from contaminated areas; contaminated clothing, tools, and equipment parts that cannot be effectively decontaminated; and solid laboratory wastes. The off gas system activated carbon is rejuvenated by the off gas system and does not normally generate dry solid waste. Project specific actions will be developed regarding the removal, replacement, and processing of off gas activated carbon in the unlikely event that significant quantity of off gas system activated carbon requires replacement during the life of the plant. The activity of much of the dry solid wastes is low enough to permit handling by contact. These wastes are collected in containers located in appropriate areas throughout the plant, as dictated by the volume of wastes generated during operation and maintenance. The filled containers are sealed and moved to controlled-access enclosed areas for temporary storage.

Most dry waste is expected to be sufficiently low in activity to permit temporary storage in unshielded, cordoned-off areas. Dry Active Waste (DAW) will be sorted and packaged in a suitably sized container that meets DOT requirements for shipment to either an off-site processor or for ultimate disposal. The DAW is separated into three categories: non-contaminated wastes (clean), contaminated metal wastes, and the other wastes, i.e., clothing, plastics, HEPA filters, components, etc.

In some cases, large pieces of miscellaneous waste are packed into larger boxes. Because of its low activity, this waste can be stored until enough is accumulated to permit economical transportation to an off-site burial ground for final disposal.

The capability exists to bring a shipping container into the truck bay during periods of peak waste generation. Bagged DAW can be directly loaded into the shipping container for burial or

processing in off-site facilities. A weight scale is provided to ensure optimum shipping/disposal weight of the shipping container.

Cartridge filters that are not placed in HICs are placed in suitability-sized containers meeting DOT requirements.

The estimated shipped waste volumes from processing DAWs are presented in Table 11.4-2.

### ***Container Storage Subsystem***

On-site storage space for 6-months volume of packaged waste is provided. Packaged waste includes HICs, shielded filter containers and 55-gallon (200-liter) drums as necessary. The container storage schemes and sequencing is shown in Figure 11.4-1.

### ***Mixed Waste Processing***

Mixed waste volumes generated at ESBWR facilities are anticipated to be less than or equal to the volumes provided in Table 11.4-2. Mixed waste will be collected primarily in 55-gallon collection drums and sent offsite to an appropriately permitted vendor processor. However, should circumstances dictate the storage or disposal of larger quantities of mixed waste, other approved containers, such as HICs, or use of multiple approved containers can be used. Storage and disposal of mixed waste will be in accordance with the facility's NRC license, DOT transportation regulations, EPA mixed waste regulations, state and local regulations and associated permits.

Some states allow (in accordance with NRC and EPA regulations) for the treatment of mixed waste on site such that the waste can be re-classified as solid radioactive waste, allowing for the waste to be stored and disposed of in accordance with NRC and DOT regulations, and any applicable state and local regulations. For example, a waste volume with a pH of less than 2 is generally considered hazardous, and, if radioactive, would be characterized as mixed waste. However, plant procedures that are developed in accordance with appropriate regulations could allow for treating the waste with sufficient base to raise the acidity to a level where the waste would no longer be hazardous, but remain radioactive, thus allowing for the waste to be processed as radioactive solid waste, typically reducing cost and generally reducing volume.

#### ***11.4.2.3 Detailed System Component Description***

The major components of the SWMS are as follows:

##### ***Pumps***

Typically two types of pumps are utilized in the SWMS.

The SWMS process pumps are usually centrifugal pumps constructed of materials suitable for the intended service.

Air-operated diaphragm type pumps are generally utilized in dewatering stations.

Pump codes are per the noted requirements of Table 3.2-1 for K20 Solid Waste Management Systems.

##### ***Tanks***

Tanks are sized to accommodate a sufficient volume of waste sludges or bead resin to fill a HIC. The SWMS tanks are sized for normal plant waste volumes with sufficient excess capacity to

accommodate equipment downtime and expected maximum volumes that may occur. The tanks are constructed of stainless steel to provide a low corrosion rate during normal operation. They are provided with mixing eductors and/or air spargers. The capability exists to sample all SWMS tanks. All SWMS tanks are vented through a filtration unit and the exhausted air is eventually discharged into the plant vent. The SWMS tanks are designed in accordance with ASME Section III, Class 3; API 620; API 650 or AWWA D-100.

The vent and overflow nozzles of the spent resin tank are equipped with fine mesh screens to minimize spread of particulate contamination to the radwaste tank vent system.

Tank codes are per the noted requirements of Table 3.2-1 for K20 Solid Waste Management Systems.

### ***Piping***

Piping used for hydraulic transport of slurries such as ion exchange resins, filter backwash (sludge), and waste tank sludge are specifically designed to assure trouble-free operation. Pipe flow velocities are sufficient to maintain a flow regime appropriate to the slurry being transported (ion exchange resins, filter backwash, or tank sludge). An adequate water/solids ratio is maintained throughout the transfer. Slurry piping is provided with manual and automatic flushing with a sufficient water volume to flush the pipe clean after each use, e.g., at least two pipe volumes.

Piping codes are per the noted requirements of Table 3.2-1 for K20 Solid Waste Management Systems.

### ***Venting***

Makeup and exhaust ventilation is described in Section 9.4.

### ***Mobile Systems***

The ESBWR is designed for sixty years of operation. The radwaste section includes modular mobile system skids that are designed to be readily replaced. This section includes requirements to be included in the replacement of the mobile systems throughout the life of the ESBWR. Solid radwaste processing is performed using mobile systems. These mobile systems are typically comprised of unit operations and chemical reactors intended to enhance the versatility, efficiency and yield in radwaste processing and waste minimization. State of the art processing equipment for the first mobile systems is depicted on Figure 11.4-1 and could include pumps, tanks, dewatering equipment, dryers, packaging equipment, sorting equipment, and ancillary equipment. The mobile processing equipment is anticipated to be modernized as more effective technologies are discovered and proved throughout the life of plant operation. To effect this modernization, the various systems, structures and components associated with the mobile systems may be grouped or associated on or in skids or assemblies, perhaps with process, instrumentation, electrical, support system, and/or mounting connections, or be stand alone pieces of equipment. The mobile systems work in conjunction with permanent radwaste equipment and should be sized accordingly, both physically and as per processing capability. Solid waste system permanent equipment is described throughout Section 11.4. Liquid waste processing is described in Section 11.2. Ventilation is described in Section 9.4. The radwaste building structure is described in Section 3.8. Instrumentation requirements are described in Section 11.4.5. The COL holder is responsible for ensuring initial and future mobile system,



structure, component operations comply with the requirements of NUREG-0800, Section 11.4 (Reference 11.4-1) Solid Waste Management Systems, Draft Rev. 3 – April 1996, including BTP - ETSB 11-3, Regulatory Guide 1.143 (Reference 11.4-3), Regulatory Guide 8.8 (Reference 11.4-4) and Regulatory Guide 8.10 (Reference 11.4-5). The COL holder is responsible for evaluating the initial, and then subsequently updated future, mobile systems per the guidance and information in IE Bulletin 80-10 (Reference 11.4-19), May 6, 1980 for the express purpose of identifying and rectifying connections that are considered as non-radioactive, but could become radioactive through interfaces with radioactive systems, i.e., a non-radioactive system that could become contaminated due to leakage, valving errors or other operating conditions in radioactive systems. The COL holder will have a Process Control Program (PCP), and it will include classifying waste as A, B, C per 10 CFR 61.55 (Reference 11.4-16).

### **11.4.3 Safety Evaluation**

The SWMS has no safety-related function. There is no liquid plant discharge from the SWMS. Failure of the subsystem does not compromise any safety-related system or component nor does it prevent shutdown of the plant. No interface with the Class 1E electrical system exists.

As mobile waste processes are selected for use, during the design stage before installation of final hook-up and connection with the permanent plant SWMS systems, the issues of IE Bulletin No. 80-10 (Reference 11.4-19), dated May 6, 1980, will be evaluated by the COL holder for the express purpose of ensuring that systems considered as non-radioactive, but could become radioactive through interfaces with radioactive systems, remain non-radioactive.

### **11.4.4 Testing and Inspection Requirements**

The SWMS is given a pre-operational test as discussed in Chapter 14. Thereafter, portions of the subsystems are tested as needed.

The COL holder is responsible for testing new and subsequent mobile systems. These tests should include provisions of Regulatory Guide 8.8 (Reference 11.4-4), as applicable.

During initial testing of the system, the pumps and the other equipment will be performance tested to demonstrate conformance with design flows and process capabilities. An integrity test is performed on the system upon completion.

Provisions are made for periodic inspection of major components to ensure capability and integrity of the subsystems.

### **11.4.5 Instrumentation Requirements**

The SWMS is operated and monitored from the radwaste control room or local operating stations within the facility. Major system parameters, i.e., tank levels, process flow rates, etc., are indicated (recorded and alarmed as required) to provide operational information and performance assessment. Key system alarms are repeated in the main control room. Instruments, including back flushing provisions, are located in low radiation areas when possible, as described in Subsection 12.3.1.1.2. These back flushing provisions are designed within the direction of IE Bulletin 80-10 (Reference 11.4-19).

### 11.4.6 COL Information

#### Mobile Systems

The ESBWR is designed for sixty years of operation. The radwaste section includes modular mobile system skids that are designed to be readily replaced. This section includes requirements to be included in the replacement of the mobile systems throughout the life of the ESBWR. The solid radwaste processing is performed using mobile systems. These mobile systems are typically comprised of unit operations sections and chemical reactors intended to enhance the versatility, efficiency and yield in radwaste processing and waste minimization. State of the art processing equipment for the first mobile systems is depicted on Figure 11.4-1 and could include pumps, tanks, dewatering equipment, dryers, packaging equipment, sorting equipment, and ancillary equipment. The mobile processing equipment is anticipated to be modernized as more effective technologies are discovered and proved throughout the life of plant operation. To effect this modernization, the various systems, structures and components associated with the mobile systems may be grouped or associated on or in skids or assemblies, perhaps with process, instrumentation, electrical, support system, and/or mounting connections, or be stand alone pieces of equipment. The mobile systems work in conjunction with permanent radwaste equipment and should be sized accordingly, both physically and as per processing capability. Solid waste system permanently installed equipment is described throughout Section 11.4. Liquid waste processing is described in Section 11.2. Ventilation is described in Section 9.4. The radwaste building structure is described in Section 3.8. Instrumentation requirements are described in Subsection 11.4.5.

- 11.4.6.1 The COL holder is responsible for ensuring initial and future mobile system, structure and component operations comply with the requirements of NUREG-0800, Section 11.4 (Reference 11.4-1) Solid Waste Management Systems, Draft Rev. 3 – April 1996, including BTP - ETSB 11-3, Regulatory Guide 1.143 (Reference 11.4-3), Regulatory Guide 8.8 (Reference 11.4-4) and Regulatory Guide 8.10 (Reference 11.4-5).
- 11.4.6.2 The COL holder is responsible for evaluating initial, and future, mobile systems per the guidance and information in IE Bulletin 80-10, May 6, 1980 for the express purpose of identifying and rectifying connections that are considered as non-radioactive, but could become radioactive through interfaces with radioactive systems, i.e., a non-radioactive system that could become contaminated due to leakage, valving errors or other operating conditions in radioactive systems.
- 11.4.6.3 The COL holder will have a Process Control Program and it will include classifying waste as A, B, C per 10 CFR 61.55 (Reference 11.4-16).
- 11.4.6.4 The COL holder is responsible for developing and maintaining programs identified in the administrative controls section of the TS per the requirements of Title 10 Code of Federal Regulations Part 50.36a (Reference 11.4-11), as described in the Standard Review Plan 11.4 (Reference 11.4-1), Draft Rev 3 – April 1996, Section III.9.
- 11.4.6.5 The COL holder is responsible for testing new and subsequent mobile systems. These tests should include provisions of Regulatory Guide 8.8 (Reference 11.4-4), as applicable.

- 11.4.6.6 The inclusion of a temporary storage facility and an overall site management plan per NUREG-0800 Standard Review Plan 11.4 (Reference 11.4-1), Draft Rev 3-April 1996, Appendix 11.4-A may be required.
- 11.4.6.7 The COL holder is responsible to include site-specific information in Section 11.4.1 describing how the implementation of operating procedures and design features for installation and operation of the mobile/portable SWMS will address the requirements of Part 20.1406 (Reference 11.4-7). Specifically the operational procedures and design of the mobile/portable SWMS should minimize, to the extent practicable, contamination of the facility and the environment, facilitate decommissioning, and minimize the generation of radioactive wastes. This information may be placed into Section 12.6 provided applicable referencing is included in Subsection 11.4.1.
- 11.4.6.8 Should a COL holder compact waste using a third party service, the estimated annual shipped waste volume provided in Table 11.4-2 will be considered for waste volume reduction depending on the type and level of waste and the waste compacting equipment and resulting compaction performance.
- 11.4.6.9 Waste will be classified as A, B, or C and meet the requirements of the waste treatment facility or repository per 10 CFR 61.55 (Reference 11.4-16) and 61.56 (Reference 11.4-17).
- 11.4.6.10 The COL holder is responsible to ensure that mobile systems comply with the guidance of Regulatory Guide 1.143 (Reference 11.4-3) Revision 2, November 2001.
- 11.4.6.11 The COL holder is responsible for the mobile transport of radwaste, including compliance with 10 CFR 20 Appendix G (Reference 11.4-9) and 40 CFR 190 (Reference 11.4-18).
- 11.4.6.12 As mobile waste processes are selected for use, during the design stage before installation of final hook-up and connection with the permanent plant SWMS systems, the issues of IE Bulletin No. 80-10 (Reference 11.4-5), dated May 6, 1980, will be evaluated by the COL holder for the express purpose of ensuring that systems considered as non-radioactive, but could become radioactive through interfaces with radioactive systems, remain non-radioactive.

#### 11.4.7 References

- 11.4-1 NUREG-0800, Standard Review Plan, 11.4 Solid Waste Management System, DRAFT Rev. 3 – April 1996 and BTP - ETSB 11-3 “Design Guidance for Solid Radioactive Waste Management Systems Installed in Light-Water-Cooled Nuclear Power Reactor Plants”
- 11.4-2 Draft Guide DG-1145: Combined License Applications for Nuclear Power Plants (LWR Edition), 1.11 Radioactive Waste Management
- 11.4-3 Regulatory Guide 1.143, “Design Guidance for Radioactive Waste Management Systems, Structures, and Components Installed in Light-Water-Cooled Nuclear Power Plants”, Revision 2, November 2001

11.4-4	Regulatory Guide 8.8, "Information Relevant to Ensuring that Occupational Radiation Exposures at Nuclear Power Stations Will Be as Low as Is Reasonably Achievable" Revision 3, June 1978
11.4-5	Regulatory Guide 8.10, "Operating Philosophy for Maintaining Occupational Radiation Exposures as Low as Is Reasonably Achievable", Revision 1-R, September 1975
11.4-6	Title 10 Code of Federal Regulations, Part 20.1302
11.4-7	Title 10 Code of Federal Regulations, Part 20.1406
11.4-8	Title 10 Code of Federal Regulations, Part 20 Appendix B
11.4-9	Title 10 Code of Federal Regulations, Part 20 Appendix G
11.4-10	Title 10 Code of Federal Regulations, Part 50.34a
11.4-11	Title 10 Code of Federal Regulations, Part 50.36a
11.4-12	Title 10 Code of Federal Regulations, Part 50 Appendix A GDC 60
11.4-13	Title 10 Code of Federal Regulations, Part 50 Appendix A GDC 61
11.4-14	Title 10 Code of Federal Regulations, Part 50 Appendix A GDC 63
11.4-15	Title 10 Code of Federal Regulations, Part 50 Appendix A GDC 64
11.4-16	Title 10 Code of Federal Regulations, Part 61.55
11.4-17	Title 10 Code of Federal Regulations, Part 61.56
11.4-18	Title 40 Code of Federal Regulations, Part 190
11.4-19	IE Bulletin 80-10, May 6, 1980
11.4-20	Generic Letter 89-01, January 31, 1989, specifically, Enclosure 3, Section 6.13 Process Control Program, PCP
11.4-21	Title 10 Code of Federal Regulations, Part 50
11.4-22	Title 10 Code of Federal Regulations, Part 71, Packaging and Transportation of Radioactive Material
11.4-23	Title 10 Code of Federal Regulations, Part 20
11.4-24	Title 49 Code of Federal Regulations, Part 171
11.4-25	Title 49 Code of Federal Regulations, Part 180

**Table 11.4-1**  
**SWMS Component Capacities**

Equipment Description	Type	Quantity	Nominal Capacity* Liter (Gal)
Tanks			
High Activity Resin Holdup Tank	Vertical, Cylindrical	1	70,000 (18,494)
Low Activity Resin Holdup Tank	Vertical, Cylindrical	1	70,000 (18,494)
Condensate Resin Holdup Tank	Vertical, Cylindrical	1	70,000 (18,494)
Low Activity Phase Separator	Vertical, Cylindrical	2	55,000 (14,531)
Concentrated Waste Tank	Vertical, Cylindrical	1	60,000 (15,852)
Pumps			
High Activity Decant Pump	Horizontal, Centrifugal	2	333L/min (88gpm)
Low Activity Decant Pump	Horizontal, Centrifugal	2	333L/min (88gpm)
High Activity Resin Circulation Pump	Horizontal, Centrifugal	2	3,330L/min (881gpm)
Low Activity Resin Circulation Pump	Horizontal, Centrifugal	1	3,330L/min (881gpm)
Condensate Resin Circulation Pump	Horizontal, Centrifugal	1	3,330L/min (881gpm)
High Activity Resin Transfer Pump	Horizontal, Centrifugal	2	379L/min (100gpm)
Low Activity Resin Transfer Pump	Horizontal, Centrifugal	1	379L/min (100gpm)
Condensate Resin Transfer Pump	Horizontal, Centrifugal	1	379L/min (100gpm)
Concentrated Waste Pump	Horizontal, Centrifugal	2	1,333L/min (352gpm)
Mobile Process Equipment			
Dewatering Equipment Fill Head	N/A	3	-
HIC Return Pump	Diaphragm	3	379L/min (100gpm)
Dryer (optional)	Drum Dryer	1	
Sorting Table	N/A	1	N/A

\* For tanks, nominal capacity refers to the total tank capacity. Nominal capacity for pumps is in liters/min (gallons/min).

**Table 11.4-2**  
**Annual Shipped Waste Volumes<sup>♦</sup>**

Waste Type	Estimated Annual Waste Generation m <sup>3</sup> /yr (ft <sup>3</sup> /yr)	Estimated Shipped Volume* m <sup>3</sup> /yr (ft <sup>3</sup> /yr)
<b>Dry Active Wastes (DAW):</b>		
Combustible waste:	225 (7,951)	225 (7,951)
Compactable waste:	38 (1,343)	38 (1,343)
Other waste:	100 (3,534)	100 (3,534)
DAW Total	363 (12,827)	363 (12,827)
<b>Wet Solid Wastes:</b>		
RWCU Spent Bead Resin:	7.6 (269)	7.6 (269)
FAPCS Spent Bead Resin:	32.4 (1,144)	32.4 (1,144)
Condensate Purification System Spent Bead Resin:	33.8 (1,194)	33.8 (1,194)
LWMS Spent Bead Resin:	5.4 (191)	5.4 (191)
Condensate Purification System Filter Sludge:	5.2 (184)	5.2 (184)
LWMS Filter Sludge:	0.8 (28.3)	0.8 (28.3)
LWMS Concentrated Waste <sup>◇</sup> :	50 (1,767)	25 (883)
Wet Solid Waste Total	111 (3,922)	85.8 (3,032)
Mixed Waste:	0.416 (14.71)	0.416 (14.71)

♦ Should a COL holder compact waste using a third party service, the waste volume reduction will be considered depending on the type and level of waste and the waste compacting equipment and resulting compaction performance.

\* Note the goal value is a long term average of resins and sludges in the dewatered condition and all other wastes packaged for shipment. The values for resins and sludges in the above table are volumes packaged for shipment.

◇ The volume reduction is based on LWMS Concentrated Waste moisture removal. An estimate of 50% volume reduction is thought to be conservative based on current moisture removal technologies, such as evaporation and membrane-based operations.



## 11.5 PROCESS RADIATION MONITORING SYSTEM

The Process Radiation Monitoring System (PRMS) is provided to allow determination of the content of radioactive material in various gaseous and liquid process and effluent streams. The design objective and criteria are based on the following requirements:

- Radiation instrumentation required for safety and protection; and
- Radiation instrumentation required for monitoring and plant operation.

All radioactive release points/paths within the plant are identified and monitored by this system. All other release points/paths of the plant are located in clean areas where radiological monitoring is not required.

This system provides continuous monitoring and display of the radiation measurements during normal, abnormal, and accident conditions.

### 11.5.1 Design Bases

#### 11.5.1.1 Design Objectives

##### 11.5.1.1.1 Radiation Monitors Required for Safety and Protection

The main purpose of these radiation monitoring subsystems is to initiate appropriate protective action to limit the potential release of radioactive materials to the environment if predetermined radiation levels are exceeded in major process/effluent streams. Another objective is to provide plant personnel with indication and alarm of the radiation levels in the major process/effluent streams.

The following PRMS subsystems provide signals that initiate automatic safety-related functions:

- Reactor Building HVAC exhaust Radiation Monitoring Subsystem (RMS)
- Refuel Handling Area HVAC exhaust RMS
- Control Building air intake HVAC RMS
- Drywell sumps Low Conductivity Waste (LCW)/HCW Discharge RMS
- Isolation Condenser Vent Exhaust RMS
- Fuel Building (FB) General Area HVAC RMS
- Fuel Building Fuel Pool HVAC RMS
- Containment Purge Exhaust RMS

##### 11.5.1.1.2 Radiation Monitors Required for Plant Operation

The main purpose of these radiation monitoring subsystems is to provide plant personnel with measurements of the content of radioactive material in important gaseous and liquid effluent and process streams. Additional objectives are to initiate discharge valve isolation on the offgas or liquid radwaste systems if predetermined release rates are exceeded, and to provide for sampling at certain radiation monitor locations to allow determination of specific radionuclide content.



The following PRMS subsystems are provided to meet the above design objectives:

- Monitoring Gaseous Effluent Streams
  - Plant Stack RMS
  - TB Normal Ventilation Air HVAC RMS
  - TB Compartment Area Air HVAC RMS
  - Radwaste Building Ventilation Exhaust RMS
  - Main Turbine Gland Seal Steam Condenser Exhaust RMS
  - FB Combined Ventilation Exhaust RMS
  - TB Combined Ventilation Exhaust RMS
- Monitoring Liquid Effluent Streams
  - Liquid Radwaste Discharge RMS
- Monitoring Gaseous Process Streams
  - MSL RMS
  - Offgas Pre-treatment RMS
  - Offgas Post-treatment RMS
  - Charcoal vault ventilation RMS
  - Drywell Fission Product RMS
- Monitoring Liquid Process Streams
  - Reactor Component Cooling Water Intersystem Leakage RMS
- Monitoring Gaseous Intake Streams
  - TSC HVAC Air Intake RMS

### 11.5.2 System Design Bases and Criteria

The instrumentation used in the subsystems of the PRMS is designed to be in conformance with the relevant requirements and guidelines of:

- 10 CFR 20.1302 (Reference 11.5-1), 10 CFR 20 Appendix B (Reference 11.5-16), 10 CFR 50.34a (Reference 11.5-2), 10 CFR 50.36a (Reference 11.5-4)
- 10 CFR 50, Appendix A, GDC 19 (Reference 11.5-17), 60 (Reference 11.5-5), 63 (Reference 11.5-6), and 64 (Reference 11.5-7)
- 10 CFR 50 Appendix I (Reference 11.5-8)
- Regulatory Guides (RG) 1.21 (Reference 11.5-9), 1.45 (Reference 11.5-10), 1.97 (Reference 11.5-11), 4.15 (Reference 11.5-12)
- Standard Review Plan 11.5.II (Reference 11.5-18)(Draft Rev. 4) of NUREG-0800.

- NUREG-0737 (Reference 11.5-15), Item II.F.1, Attachments 1 and 2.
- ANSI/HPS N13.1-1999 (Reference 11.5-13)
- ANSI/Institute of Electrical and Electronic Engineers (IEEE) N42.18-1980 (Reference 11.5-19)

The system design provides radiation monitoring during normal reactor operations, anticipated operational occurrences, and post-accident conditions.

The safety-related process radiation monitoring subsystems are classified Safety Class 2, Seismic Category I. These subsystems conform to the quality assurance requirements of 10 CFR 50 Appendix B (Reference 11.5-20).

#### ***11.5.2.1 Radiation Monitors Required for Safety***

The design criteria for the safety-related functions as defined in Subsection 11.5.1.1 include the following functional requirements:

- Withstand the effect of natural phenomena (e.g., earthquakes) without loss of capability to perform their functions;
- Perform the intended safety-related functions in the environment resulting from normal and abnormal conditions (e.g., loss of HVAC and isolation events);
- Meet the reliability, testability, independence, and failure mode requirements of engineered safety-related features;
- Provide continuous output of radiation levels to the main control room;
- Permit checking of the operational availability of each channel during reactor operation with provisions for calibration function and instrument checks;
- Ensure an extremely high probability of accomplishing safety-related functions in the event of anticipated operational occurrences;
- Initiate protective action when operational limits are exceeded;
- Annunciate the high radiation levels in the main control room to alert operating personnel of abnormal conditions;
- Insofar as practical, provide self-monitoring of the radiation monitors to the extent that power failure or equipment failure causes annunciation in the main control room and initiation of the required protective action;
- 
- Use instrumentation compatible with anticipated radiation levels and ranges expected under normal, abnormal and accident conditions, per Regulatory Guide (RG) 1.97 (Reference 11.5-11). Provide expanded ranges to take into consideration additional source term resulting from damaged core. Provide overlapping sensor/instrument ranges where the desired accuracy is not achieved with a single sensor/instrument.
- Use redundant divisional channels that satisfy the separation and single failure criteria, for the initiation of safety-related functions.

### ***11.5.2.2 Radiation Monitors Required for Plant Operation***

The design criteria for operational radiation monitoring will include the following functional requirements:

- Provide continuous indication of radiation levels in the main control room;
- Annunciate the high radiation levels in the main control room to alert operating personnel to the abnormal conditions;
- Insofar as practical, provide self-diagnosis of the radiation monitors to the extent that power failure or equipment failure causes annunciation in the main control room and isolation of the effluents paths as required;
- Monitor a representative sample of the bulk stream or volume;
- Incorporate provisions for calibration and functional checks;
- Use instrumentation compatible with anticipated radiation levels and ranges expected under normal, abnormal and accident conditions (Regulatory Guide 1.97). Provide expanded ranges to take into consideration additional source term from damaged core. Provide overlapping sensor/instrument ranges where the desired accuracy is not achieved with a single sensor/instrument.
- 
- Monitor selected non-radioactive systems for intrusion of radioactivity into the system

## **11.5.3 Subsystem Description**

### ***11.5.3.1 Radiation Monitors Required for Safety***

The design description of each PRMS subsystem's radiological monitoring and sampling function as identified in Subsection 11.5.1.1.1 is provided in this section under its designated name. The types of instrumentation, together with pertinent parameters for each subsystem, are presented in Tables 11.5-1, 11.5-2, and 11.5-4. Figure 11.5-1 in conjunction with Table 11.5-3 provides radiation detector location diagrams.

Figure 11.5-2 shows the block diagram of a Safety-Related PRMS channel. Signal Conditioning Units (SCUs) are located in the MCR back panel area. Displays for alarm and radiation level are provided at the SCUs, and also at the MCR console VDUs. The Safety-Related Distributed Control and Information System (Q-DCIS) receives signals from the SCUs, performs control functions, and also feeds the signals to the Nonsafety-Related Distributed Control and Information System (N-DCIS) for display, alarm, and data recording functions.

#### **11.5.3.1.1 Reactor Building HVAC Exhaust Radiation Monitoring Subsystem (RMS)**

This subsystem monitors the gross radiation level in the exhaust duct of the RB. The principal path that this subsystem monitors is exhaust from the contaminated area, which is served by Reactor Building Contaminated Area HVAC Subsystem (CONAVS). A high activity level in the ductwork could be due to fission gases from a leak or an accident.

The subsystem consists of four redundant instrument channels. Each channel consists of a gamma-sensitive detector and a Main Control Room (MCR) radiation monitor.

The detectors are located adjacent to the exhaust ducting upstream of the ventilating system isolation valves and monitor the Reactor Building HVAC exhausts. The detectors are physically located upstream of the ventilation exhaust duct isolation dampers such that closure of the dampers can be accomplished prior to exceeding radioactive effluent limits imposed by 10 CFR 50, Appendix I.

Leak Detection and Isolation System receives the individual channel signals and compares the signal level to the setpoint trips.

Any two-out-of-four channel trips result in the closure of the RB ventilating exhaust ventilation dampers and stoppage of the Reactor Building HVAC exhaust fans.

Trip circuits initiate their respective alarms in the MCR.

A single channel may be taken out of service for testing without affecting the protective functionality of the remaining channels. Two out of three channel trips cause protective actions in the test mode.

Each channel has a monitor failure alarm in the MCR.

The range of channel measurement and display is as shown in Table 11.5-1 and Table 11.5-2. The range is selected to provide sufficient coverage for radioactivity released during normal operation up to the amount associated with an accident and the subsequent ventilation flow into the RB Ventilation.

#### **11.5.3.1.2 Refuel Handling Area HVAC Exhaust RMS**

This subsystem monitors the gross radiation level in the refuel handling area and pool area HVAC ventilation exhaust duct that is part of the Reactor Building Refueling and Pool Area HVAC Subsystem (REPAVS).

The subsystem consists of four redundant instrument channels. Each channel consists of a gamma-sensitive detector and a MCR radiation monitor.

The detectors are located around the refuel area and are physically and electrically separated from one another.

Leak Detection and Isolation System receives the individual channel signals and compares the signal level to the setpoint trips.

Any two-out-of-four channel trips result in the closure of the RB ventilating exhaust ventilation dampers and stoppage of the Reactor Building HVAC exhaust fans.

Trip circuits initiate their respective alarms in the MCR.

A single channel may be taken out of service for testing without affecting the protective functionality of the remaining channels. Two out of three channel trips cause protective actions in the test mode.

Each channel has a monitor failure alarm in the MCR.

The range of channel measurement and display is shown in Table 11.5-1 and Table 11.5-2. The range is selected to provide sufficient coverage for radioactivity released during normal

operation up to the amount associated with a refueling accident and the subsequent flow into the RB Ventilation system.

#### **11.5.3.1.3 Control Building Air Intake HVAC RMS**

The Control Building Air Intake HVAC radiation monitoring subsystem is provided to detect the gross radiation level in the normal outdoor air intake supply and automatically initiates closure of the outdoor air intake and the exhaust dampers, and startup of the emergency air filtration system. The emergency air filtration system fans are started and refuel area exhaust fans stopped on high radiation.

The Control Building Air Intake HVAC consists of two redundant but independent subsystems.

The radiation monitors for each of the Control Building Air Intake HVAC subsystems consist of four redundant channels to monitor the air intake to the building. Each radiation channel consists of a gamma sensitive detector and a radiation monitor that is located in the MCR.

Any two-out-of-four channel trips result in the closure of the Control Building Air Intake and exhaust dampers and starting the Emergency air filtration system fans.

Trip circuits initiate their respective alarms in the MCR.

A single channel may be taken out of service for testing without affecting the protective functionality of the remaining channels. Two out of three channel trips cause protective actions in the test mode.

Each channel has a monitor failure alarm in the MCR.

The monitors meet the requirements for Class 1E components to provide appropriate reliability. The system warns of the presence of significant air contamination in inlet air and provides isolation of the Control Building intake air ducts.

The range of channel measurement and display is shown in Table 11.5-1 and Table 11.5-2. The range is selected to cover normal operation and be sensitive enough to initiate isolation of the MCR prior to exceeding the 10 CFR 50 Appendix A GDC 19 (Reference 11.5-17) guidelines of 0.05 Sieverts whole body or its equivalent to any part of the body.

#### **11.5.3.1.4 Drywell Sumps LCW/HCW Discharge RMS**

This subsystem monitors the gross radiation level in the liquid waste transferred in the drain line from the drywell LCW and HCW sumps to the Radwaste System. One monitoring channel is provided in each sump drain line. Each channel uses a gamma sensitive radiation detector that is located near the drain line from the sump just downstream from the outboard isolation valve. The output from each detector is fed to radiation monitors in the MCR for display and annunciation.

Automatic isolation of the two sump discharge pipes occurs if high radiation levels are detected during liquid waste transfers.

The range of channel measurement and display is shown in Table 11.5-1 and Table 11.5-2. The range is selected to provide sufficient coverage for expected radioactivity concentrations due to

accident source terms in these sumps and address the TMI concern about unmonitored transfer of wastes from the containment to the radwaste facility.

#### **11.5.3.1.5 Isolation Condenser Vent Exhaust RMS**

This subsystem monitors the gross radiation from the exhaust of the air from the atmospheric pool area above each isolation condenser. The subsystem consists of sixteen channels (four per isolation condenser vent) that are physically and electrically independent of each other.

Each subsystem initiates isolation of the affected isolation condenser by closure of isolation valves in the steam line to the condenser and in the condensate return line from the condenser.

The detectors monitor radioactivity in the isolation condenser discharge pool area exhaust that might have resulted from a tubing break or a defective condenser.

The subsystem consists of four redundant instrument channels. Each channel consists of a gamma-sensitive detector and a MCR radiation monitor.

Leak Detection and Isolation System receives the individual channel signals and compares the signal level to the setpoint trips.

Any two-out-of-four channel trips result in the closure of isolation valves in the steam line to the condenser and in the condensate return line from the condenser.

Trip circuits initiate their respective alarms in the MCR.

A single channel may be taken out of service for testing without affecting the protective functionality of the remaining channels. Two out of three channel trips cause protective actions in the test mode.

Each channel has a monitor failure alarm in the MCR.

The range of channel measurement and display is shown in Table 11.5-1 and Table 11.5-2. The range is selected to provide sufficient coverage from normal operation up to, and several decades beyond, for radioactivity released prior to exceeding limits of 10 CFR 20 (Reference 11.5-21). Under normal operation, there is no radioactivity expected to be exhausted from this path since there shouldn't be any leakage into the pool area.

#### **11.5.3.1.6 Fuel Building General Area HVAC RMS**

This subsystem monitors the gross radiation level in the FBHV exhaust duct for the general area. The system consists of four channels that are physically and electrically independent of each other. The subsystem monitors the radiation levels of the air exiting the FB general areas as well as the rooms with the fuel pool cooling and cleanup equipment.

The subsystem consists of four redundant instrument channels. Each channel consists of a gamma-sensitive detector and a MCR radiation monitor.

The individual channel signals are compared to the setpoint trips.

Any two-out-of-four channel trips result in the closing the exhaust damper and tripping of the FB General Area fan.

Trip circuits initiate their respective alarms in the MCR.

A single channel may be taken out of service for testing without affecting the protective functionality of the remaining channels. Two out of three channel trips cause protective actions in the test mode.

Each channel has a monitor failure alarm in the MCR.

The range of channel measurement and display is shown in Table 11.5-1 and Table 11.5-2. The range is selected to provide sufficient coverage for radioactivity released during normal operation up to, and including several decades beyond, the amount associated with a refueling accident and the subsequent air flow into the FBHV.

#### **11.5.3.1.7 Fuel Building Fuel Pool HVAC RMS**

The FB Fuel Pool HVAC RMS consists of a total of four channels that monitor the radiation level of the air exiting the FB Spent Fuel Storage Pool and equipment areas.

The subsystem consists of four redundant instrument channels. Each channel consists of a gamma-sensitive detector and a MCR radiation monitor.

The individual channel signals are compared to the setpoint trips.

Any two-out-of-four channel trips result in the closing the exhaust damper and tripping of the FB Fuel Pool General Area fan.

Trip circuits initiate their respective alarms in the MCR.

A single channel may be taken out of service for testing without affecting the protective functionality of the remaining channels. Two out of three channel trips cause protective actions in the test mode.

Each channel has a monitor failure alarm in the MCR.

The range of channel measurement and display is shown in Table 11.5-1 and 11.5-2. The range is selected to provide sufficient coverage for radioactivity released during normal operation up to, and including several decades beyond, the amount associated with a refueling accident and the subsequent air flow into the FBHV.

#### **11.5.3.1.8 Containment Purge Exhaust (RMS)**

This subsystem monitors the gross radiation level in the exhaust duct leading from the primary containment.

The detectors are located adjacent to the exhaust ducting upstream of the ventilating system isolation valves. The detectors are physically located upstream of the ventilation exhaust duct isolation dampers such that closure of the dampers can be accomplished prior to exceeding radioactive effluent limits.

The subsystem consists of four redundant instrument channels. Each channel consists of a gamma-sensitive detector and a MCR radiation monitor.

The individual channel signals levels are compared to the setpoint trips.

Any two-out-of-four channel trips result in the closure of the Reactor Building HVAC isolation dampers and stoppage of the Reactor Building HVAC exhaust fans.

Trip circuits initiate their respective alarms in the MCR.

A single channel may be taken out of service for testing without affecting the protective functionality of the remaining channels. Two out of three channel trips cause protective actions in the test mode.

Each channel has a monitor failure alarm in the MCR.

Any two-out-of-four channel trips will result in the closure of the Reactor Building HVAC isolation dampers and stoppage of the Reactor Building HVAC exhaust fans.

All trip circuits will initiate their respective alarms in the MCR.

The range of channel measurement and display will be as shown in Table 11.5-1 and Table 11.5-2.

### ***11.5.3.2 Radiation Monitors Required for Plant Operation***

The design description of each PRMS subsystem's radiological monitoring and sampling function identified in Subsection 11.5.1.1.2 is provided in this section. The types of instrumentation, together with pertinent parameters for each subsystem, are presented in Tables 11.5-1, 11.5-2, and 11.5-4. Figure 11.5-1 in conjunction with Table 11.5-3 provides radiation detector location diagrams.

Figure 11.5-2 shows the block diagram of a nonsafety-related PRMS channel. SCUs are mounted locally. Displays for alarm and radiation level are provided at the SCUs, and also at the MCR console VDUs. N-DCIS receives signals from the SCUs and performs control, display, alarm, and data recording functions. Information on these monitors is presented in Table 11.5-2.

#### **11.5.3.2.1 Main Steamline (MSL) RMS**

This subsystem monitors the gross gamma radiation level of the steam transported by the MSLs in the MSL tunnel. The normal radiation level is produced primarily by coolant activation gases plus smaller quantities of fission gases being transported with the steam.

The MSL radiation monitors consist of four instrument channels, one for each steam line. Each channel consists of a local gamma detector and a radiation monitor located in the main control room.

The detectors are physically located near the MSLs just downstream of the outboard MSL isolation valves (MSIVs) in the steam tunnel. These detectors are arranged so that they are capable of detecting significant increases in radiation level with any number of the MSLs in operation.

The subsystem initiates shutdown and isolation of the main turbine condenser MVP upon detection of high radiation. Channel trips are annunciated in the MCR. Although the subsystem is qualified as safety-related, its function is nonsafety-related.



The range of channel measurement and display is shown in Table 11.5-1 and Table 11.5-2. The range is selected to provide detection from normal background radiation at zero percent reactor power up to, and including, gross releases of fission products from reactor fuel into the reactor vessel and its subsequent transport to the MSLs.

#### **11.5.3.2.2 Offgas Pre-treatment RMS**

This subsystem monitors radioactivity in the main turbine condenser Offgas after it has passed through the Offgas condenser and moisture separator/cooler. The single channel monitor detects the gross radiation level that is attributable to the fission gases that are produced in the reactor and then transported with steam through the turbine to the main turbine condenser.

A continuous sample is extracted from the Offgas pipe, then passed through a sample chamber and a sample panel before being returned to the suction side of the SJAE. The sample chamber is a stainless steel pipe that is internally polished to minimize plate-out. It can be purged with room air to check detector response to background radiation. Sample line flow is measured and indicated on the sample panel. A gamma-sensitive detector, positioned on the sample chamber, is connected to a local radiation monitor.

The radiation level reading can be directly correlated to the concentration of the noble gases in the sample chamber by obtaining a grab sample at the sample panel. The sample is then removed and the sample is analyzed with a multi-channel gamma pulse height analyzer to determine the concentration of the various noble gas radionuclides. A correlation between the observed activity and the monitor reading permits calibration of the monitor.

The range of channel measurement and display is shown in Table 11.5-1 and Table 11.5-2. The range is selected to provide indication over an offgas release rate of approximately  $3.7 \times 10^2$  Mega-Bequerels per second (MBq/s) up to approximately  $3.7 \times 10^8$  MBq/s (after a 30 minute decay), referenced to the noble gases listed in Table 11.1-1, Table 11.1-2 and Table 11.1-2b.

#### **11.5.3.2.3 Offgas Post-treatment RMS**

This subsystem monitors radioactivity for halogens, particulates and noble gas releases during normal and accident conditions in the Offgas piping downstream of the OGS charcoal adsorbers and upstream of the OGS discharge valve. A continuous sample is extracted from the OGS piping, passed through two Offgas post-treatment samplers for monitoring and sampling, and returned to the OGS piping. One sampler contains provisions for continuous gaseous, particulate and halogen radioactivity monitoring of the offgas post treatment process. The second sampler contains only provisions for continuous gaseous monitoring. Sampling is done in accordance with ANSI/HPS N13.1-1999 (Reference 11.5-13). Automatic compensation for variation in stack flow is provided to maintain the sample panel flow proportional to the main flow. Two local radiation monitors, connected to gamma-beta sensitive radiation detectors, analyze and visually display the measured radiation level.

The sample panel shielded chambers can be purged with room air to check detector response to background radiation. Sample line flow is measured and indicated on the sample panel. A remotely- operated check source for each detector assembly is used to check operability of the channel.

Each radiation monitor has trip circuits that actuate corresponding main control room annunciators.

The trip outputs are used to initiate closure of the OGS discharge and Charcoal Bed bypass valves. The trip setpoint is set so that valve closure is initiated prior to exceeding 10 CFR 20.1302 (Reference 11.5-1) limits. A channel trip is also used to initiate alignment of the OGS flow valves to achieve treatment through the charcoal vault.

Provisions for grab sample collection are provided and can be used for isotopic analysis and monitor calibration.

Tritium sampling is also provided by the subsystem.

Abnormal flow, measured at the sample panel, is annunciated in the MCR.

The ranges of channel display are shown in Table 11.5-1 and Table 11.5-2. The ranges are selected to cover an Offgas release rate of  $3.7\text{E-1 Bq/s}$  to  $3.7\text{E4 MBq/s}$ . The lower range limit is based on the approximate value of an expected release rate for Kryptons and Xenons in the OGS. The upper range limit is set by the plant release limit, which in turn is set by plant unique factors such as site size, and meteorology.

The subsystem provides data for reports of gaseous releases of radioactive materials in accordance with Regulatory Guide 1.21.

#### **11.5.3.2.4 Charcoal Vault Ventilation RMS**

The ventilation of the charcoal vault is monitored for gross gamma radiation level, in order to look for leakage from the charcoal tanks. A single instrument channel is used. The channel includes a gamma sensitive detector and a radiation monitor. The detector is located outside the charcoal vault on the HVAC exhaust line from the vault. The radiation monitor is located locally.

The range of channel measurement and display is shown in Table 11.5-1 and Table 11.5-2. This range is selected to span normal radiation background to beyond a point where it would have successfully indicated leakage from the charcoal vault into the ventilation/refrigeration duct. Under normal operation, the charcoal vault ventilation air flow should not have radioactivity in it.

#### **11.5.3.2.5 Turbine Building Combined Ventilation Exhaust RMS**

This subsystem monitors the TB Combined Ventilation exhaust for halogens, particulates and noble gas releases during normal and accident conditions.

A representative sample is continuously extracted and passed through the sample panel for monitoring and sampling, and then returned to the TB Combined Ventilation Exhaust stream. Sampling is done in accordance with ANSI/HPS N13.1-1999 (Reference 11.5-13). Automatic compensation for variation in flow is provided to maintain the sample panel flow proportional to the main flow.

The radiation detector assembly consists of shielded gas chambers that house gamma-beta sensitive detectors and check sources. A local radiation monitor analyzes and visually displays the measured radiation level. The subsystem has provisions for purging the sample panel with room air to check detector response to background radiation level reading.

Each sample chamber is equipped with a check source to test detector response, thus checking operability of the radiation channel.

The radiation monitor initiates trips for alarm indications on high radiation. Also, abnormal flow, measured at the sample panel, is annunciated in the MCR.

Provisions for grab sample collection are provided and can be used for isotopic analysis and monitor calibration.

Tritium sampling is also provided by the subsystem.

The ranges of channel display are shown in Table 11.5-1 and Table 11.5-2. These ranges are selected to provide indication of isotopic effluent concentrations provided in 10 CFR 20 (Reference 11.5-21). The subsystem provides data for reports of airborne releases of radioactive materials in accordance with Regulatory Guide 1.21 (Reference 11.5-9).

#### **11.5.3.2.6 Liquid Radwaste Discharge RMS**

This subsystem continuously monitors the radioactivity in the liquid radwaste during its discharge to the environment and stops the discharge on detection of a high radiation level.

Liquid waste can be discharged from the sample tanks containing liquids that have been processed through one or more treatment systems such as filtration, and ion exchange. During the discharge, the liquid is extracted from the liquid radwaste discharge process pipe, passed through a liquid sample panel that contains a detection assembly for radiation monitoring, and returned to the process pipe. The detection assembly consists of a detector mounted in a shielded sample chamber equipped with a check source. A local radiation monitor analyzes and visually displays the measured gross radiation level.

The sample panel chamber can be drained and flushed to allow assessment of background buildup. Sample line flow is measured and indicated on the sample panel. A check source can be used to check operability of the channel.

The radiation monitor has trip circuits that are used to stop the discharge to the environment.

The range of channel display is shown in Table 11.5-1 and Table 11.5-2. The liquid radwaste discharge radiation monitor provides data for reports of liquid releases of radioactive materials in accordance with Regulatory Guide 1.21 (Reference 11.5-9). This monitor is used to demonstrate compliance with the liquid effluent release concentration limits of 10 CFR 20.

#### **11.5.3.2.7 Reactor Component Cooling Water Intersystem Leakage RMS**

This subsystem consists of two channels. Each RCCW heat exchanger train has its own radiation monitor. Each channel monitors for intersystem radiation leakage into the respective RCCWS loop and, as such, addresses the guidelines of RG 1.45 (Reference 11.5-10).

Each channel consists of a detector that is located on the downstream side of each RCCWS heat exchanger exit pipe. Each channel provides individual channel trips on high radiation level and downscale/inoperative indication for annunciation in the MCR.

Each RCCW radiation sampler is provided with a remotely controlled radioactive check source.

The range of channel display is shown in Table 11.5-1 and Table 11.5-2.

#### **11.5.3.2.8 Radwaste Building Ventilation Exhaust RMS**

This subsystem monitors the Radwaste Building ventilation exhaust for halogens, particulates and noble gas during normal and accident conditions. Each instrument channel consists of a local detector and a radiation monitor. The radiation monitor provides upscale and inoperative trips. Also, abnormal flow, measured at the sample panel, is annunciated in the MCR.

A sample, continuously extracted, passes through the panel and returns to the exhaust. Sampling is done in accordance with ANSI/HPS N13.1-1999 (Reference 11.5-13). Automatic compensation for variation in process flow is provided to maintain the sample panel flow proportional to the main flow.

Provisions for grab sample collection are provided and can be used for isotopic analysis and monitor calibration.

The subsystem has provisions for purging the sample panel with room air to check detector response to the background radiation level reading.

Tritium sampling is also provided by the subsystem.

A remotely-operated gamma check source is provided for testing channel operability.

The trip signals are annunciated in the Radwaste Building General Area (RWBGA) and in the MCR. The ranges of channel display are shown in Table 11.5-1 and Table 11.5-2. The subsystem provides data for reports of airborne releases of radioactive materials in accordance with Regulatory Guide 1.21 (Reference 11.5-9).

#### **11.5.3.2.9 Turbine Building Compartment Area Air HVAC RMS**

This subsystem monitors the air in the compartment area HVAC in the TB for gross radiation levels. Two channels provide monitoring. Each channel uses a gamma sensitive detector located internal to the monitored exhaust duct. The outputs from the detectors are fed into radiation monitors for display and annunciation. Each monitor provides alarm trips in the MCR on high radiation and when a monitor is inoperative.

The range of channel display is shown in Table 11.5-1 and Table 11.5-2.

#### **11.5.3.2.10 Turbine Building Normal Ventilation Air HVAC RMS**

This subsystem monitors the normal ventilation air HVAC from the clean area in the TB for gross radiation levels. Two channels provide the monitoring. Each channel uses a gamma sensitive detector located internal to the monitored exhaust duct. The outputs from the detectors are fed into radiation monitors for display and annunciation. Each monitor provides alarm trips in the MCR on high radiation and when a monitor is inoperative.

The range of channel display will be as shown in Table 11.5-1 and Table 11.5-2.

#### **11.5.3.2.11 Main Turbine Gland Seal Steam Condenser Exhaust RMS**

This subsystem monitors the releases to the TB Combined Ventilation exhaust from the main turbine gland seal condenser system. The releases are continuously sampled and monitored for noble gases. The output signal is displayed in the MCR. The channel has an upscale alarm and an inoperative alarm.

A grab sample of the flow path can be extracted for laboratory analysis. Samples of halogens and particulates can be collected on filters for periodic analysis.

The subsystem will have provision for purging the sample panel with room air to check detector response to the background radiation level reading.

Also, abnormal flow, measured at the sample panel, is annunciated in the MCR.

A locally operated gamma check source is provided for testing channel operability.

The range of channel display is shown in Table 11.5-1 and Table 11.5-2.

#### **11.5.3.2.12 Drywell Fission Product RMS**

This subsystem, consisting of two channels, one for noble gases and the other for particulates, continuously monitors noble gases and particulates in the drywell air space under normal operating conditions. The particulate measurement is used to demonstrate compliance with RG 1.45 (Reference 11.5-10) for leak detection.

Each radiation monitor provides upscale and inoperative alarms that are indicated in the MCR. Also, abnormal flow, measured at the sample panel, is annunciated in the MCR.

The range for the particulate of channel display is given in Table 11.5-1 and Table 11.5-2. This lower limit of detectability is sufficient to indicate the equivalent of 3.785 liters per minute (1 gpm) leak rate (normal reactor water) within 60 minutes.

The range for the gaseous of channel display is given in Table 11.5-1 and Table 11.5-2.

A grab sample can be extracted for laboratory analysis. Samples of halogens and particulates can be collected on filters for periodic analysis.

The subsystem has a remotely controlled radioactive check source.

The subsystem will have provision for purging the sample panel with room air to check detector response to the background radiation level reading.

#### **11.5.3.2.13 Technical Support Center HVAC Air Intake RMS**

This subsystem continuously monitors the intake air ventilation duct of the TSC with a single gamma sensitive radiation monitor. Upon detection of radioactivity, the Air Handling Unit (AHU) outdoor air damper for the TSC is closed and the filter train fan is started.

This monitor provides upscale and inoperative alarms that are alarmed in the MCR.

The range of channel measurement and display is given in Table 11.5-1 and Table 11.5-2. The range is selected to cover the normal radiation background up to, and several decades beyond, the dose rate given in 10 CFR 50 Appendix A GDC 19 (Reference 11.5-17). Under normal conditions, only background radioactivity is anticipated at the TSC HVAC intake.

#### **11.5.3.2.14 Plant Stack RMS**

The Plant Stack RMS will be used to monitor particulate, iodine and gaseous concentrations in the main stack effluent for both normal and accident plant conditions. It will be composed of three sampling channels that are designed to meet the requirements of both 10 CFR 20.1302

(Reference 11.5-1) for effluent releases and Regulatory Guide 1.97 (Reference 11.5-11) for accident effluent releases.

The dynamic range is selected to demonstrate compliance with RG 1.21 (Reference 11.5-9) and 1.97 (Reference 11.5-11) normal and post accident releases. In addition, the capability of the subsystem is such that if multiple indications are needed, sufficient decade overlap, via different instruments, is provided for measurement and display.

Provisions for grab sample collection are provided and can be used for isotopic analysis and monitor calibration.

Provisions for monitoring tritium will also be provided.

A sample, continuously extracted from the stack, passes through the panel and returns to the stack exhaust. Sampling is done in accordance with ANSI/HPS N13.1-1999 (Reference 11.5-13). Automatic compensation for variation in stack flow is provided to maintain the sample panel flow proportional to the main flow. The subsystem will have provisions for purging the sample panel with room air to check detector response to the background radiation level reading.

The subsystem has a remotely controlled radioactive check source.

Also, abnormal flow, measured at the sample panel, is annunciated in the MCR.

The Plant Stack RMS is nonsafety-related. The stack is sampled continuously for the full range of concentrations between normal conditions and those postulated in Regulatory Guide 1.97 (Reference 11.5-11). The Plant Stack radiation monitor is a post-accident monitor and meets the guidelines of Regulatory Guide 1.97 (Reference 11.5-11) and NUREG-0737 (Reference 11.5-15). The plant vent radiation monitor also provides data for plant effluent release reports identified in Regulatory Guide 1.21 (Reference 11.5-9).

#### **11.5.3.2.15 Fuel Building Combined Ventilation Exhaust RMS**

The FB Combined Ventilation exhaust RMS will continuously monitor halogens, particulates and noble gas releases transported from the FB to the plant stack under both normal and accident conditions.

A sample, continuously extracted from the FBHV duct, passes through a sample panel and is returned to the main exhaust. Sampling is done in accordance with ANSI/HPS N13.1-1999 (Reference 11.5-13). Automatic compensation for variation in HVAC flow is provided in order to maintain the sample panel flow proportional to the main flow. The subsystem will have provision for purging the sample panel with room air to check detector response to the background radiation level reading.

The subsystem has a remotely controlled radioactive check source.

Also, abnormal flow, measured at the sample panel, is annunciated in the MCR.

Provisions for grab sample collection are provided and can be used for isotopic analysis and monitor calibration.

A tritium monitoring device will be associated with this subsystem.

The displayed range is selected to cover normally expected concentrations of radioactivity in FBHV exhaust air, up to and beyond, radionuclide concentrations indicated in 10 CFR 20 (Reference 11.5-21).

The FB Combined Ventilation Exhaust RMS is nonsafety-related.

#### **11.5.4 Regulatory Evaluation**

The system design for radiation monitoring is in conformance with the relevant requirements and criteria that are stipulated in the codes and standards that are identified in Subsection 11.5.2. Radiation monitoring is provided during reactor operation and under post-accident conditions. Specifically, the following requirements are evaluated for compliance.

##### ***11.5.4.1 Basis for Monitor Location Selection***

The detector locations are selected, per RG 1.21 (Reference 11.5-9) and Standard Review Plan 11.5, to monitor the major and potentially significant paths for release of radioactive material during normal reactor operation including anticipated operational occurrences, and to provide alarms and necessary isolations. The radioactivity levels in liquid and gaseous effluent releases are monitored, measured, displayed and recorded.

##### ***11.5.4.2 Expected Radiation Levels***

Expected radiation levels are provided in Tables 11.5-1 and 11.5-2.

##### ***11.5.4.3 Instrumentation***

Grab samples are analyzed to identify and quantify the specific radionuclides in effluents. The results from the sample analysis are used to establish relationships between the gross gamma monitor readings and concentrations or release rates of radionuclides in continuous effluent releases. Tables 11.5-4 through 11.5-8 provide summary information concerning the frequency, analysis, sensitivity and purpose for both liquid and gaseous process and effluent extracted samples that are analyzed in the health physics laboratory. Table 11.5-9 provides information concerning the selection of dynamic ranges for monitoring.

##### ***11.5.4.4 Setpoints***

The trip setpoints for effluent and discharge safety-related radiation monitors are specified in the Offsite Dose Calculation Manual (ODCM) required by plant TS. Trip setpoints for nonsafety-related radiation monitors are specified in the plant Operating Procedures.

##### ***11.5.4.5 Offsite Dose Calculation Manual***

The COL Holder will also develop an ODCM that contains the methodology and parameters used for calculation of offsite doses resulting from gaseous and liquid effluents. The COL Holder will address operational setpoints for the radiation monitors and address programs for monitoring and controlling the release of radioactive material to the environment, which eliminates the potential for unmonitored and uncontrolled release. The ODCM will include planned discharge flow rates.

#### ***11.5.4.6 Process and Effluent Monitoring Program***

In addition, the COL Holder is responsible for the site-specific programs, (Radiological Effluent Monitoring Program, and associated Radiological Effluent Technical Specifications, and the National Pollutant Discharge Elimination System permit) aspects of the process and effluent monitoring and sampling per ANSI N13.1 (Reference 11.5-13) and Regulatory Guides 1.21 (Reference 11.5-9) and 4.15 (Reference 11.5-12).

#### ***11.5.4.7 Site Specific Offsite Dose Calculation***

The COL Holder is responsible for addressing 10 CFR 50, Appendix I (Reference 11.5-8) guidelines for maximally exposed offsite individual doses and population doses via liquid and gaseous effluents.

#### ***11.5.4.8 Instrument Sensitivities***

The COL Holder is responsible for the sensitivities, frequencies and basis for each gaseous and liquid samples.

### **11.5.5 Process Monitoring and Sampling**

#### ***11.5.5.1 Implementation of General Design Criterion 19***

The Main Control Building is provided with detectors that sense radiation in the intake air supply to the control building and provide warning and initiate actions to protect operating personnel for access and occupancy of the control room under accident conditions.

In addition, the TSC ventilation air intake is provided with radiation detection to initiate actions to protect personnel.

#### ***11.5.5.2 Implementation of General Design Criterion 60***

All potentially significant radioactive discharge paths are equipped with a control system to automatically isolate the effluent on indication of a high radiation level. The subsystems providing these features include:

- Offgas Post-treatment RMS
- Reactor Building HVAC Exhaust RMS
- Refuel Handling Area HVAC Exhaust RMS
- Drywell Sump LCW/HCW Discharge RMS
- Liquid Radwaste Discharge RMS
- FB General Area HVAC RMS
- Isolation Condenser Vent Exhaust RMS
- MSL RMS
- Containment Purge Exhaust RMS
- FB Fuel Pool HVAC RMS



***11.5.5.3 Implementation of General Design Criterion 63***

Fuel storage and radioactive waste systems and their associated handling areas are monitored for excessive radiation levels. The subsystems monitoring these areas include:

- Offgas Pre-treatment RMS
- Offgas Post-treatment RMS
- Radwaste Building Ventilation Exhaust RMS
- FB Fuel Pool HVAC RMS
- FB Combined Ventilation Exhaust RMS
- Charcoal Vault Ventilation RMS
- FB General Area HVAC RMS
- Refuel Handling Area Exhaust RMS
- Reactor Building HVAC Exhaust RMS

***11.5.5.4 Implementation of General Design Criterion 64***

Radiation levels in the reactor containment atmosphere, spaces containing components for the recirculation of loss-of-coolant accident fluids, effluent discharge paths and important process streams are monitored for radioactivity. The subsystems monitoring these paths and areas include:

- Reactor Building HVAC Exhaust RMS
- Refuel Handling Area HVAC Exhaust RMS
- Drywell Sumps LCW/HCW Discharge RMS
- Isolation Condenser Vent Exhaust RMS
- FB General Area HVAC RMS
- MSL RMS
- Offgas Pre-treatment and Offgas Post-treatment RMS
- Charcoal Vault Ventilation RMS
- Reactor Component Cooling Water Intersystem Leakage RMS
- TB Combined Ventilation Exhaust RMS
- Radwaste Building Ventilation Exhaust RMS
- Liquid Radwaste Discharge RMS
- Main Turbine Gland Seal Steam Condenser Exhaust RMS
- Drywell Fission Products RMS
- FB Combined Ventilation Exhaust RMS

- FB Fuel Pool HVAC RMS
- TB Normal Ventilation Air HVAC RMS
- TB Compartment Area Air HVAC RMS
- Plant Stack RMS
- Containment Purge Exhaust RMS

#### ***11.5.5.5 Basis for Monitor Location Selection***

The detector locations are selected to monitor the major and potentially significant paths for release of radioactive material during normal reactor operation including anticipated operational occurrences, thus meeting the intent of RG 1.21 (Reference 11.5-9) and Standard Review Plan (SRP) 11.5 (Reference 11.5-18). Monitoring of each major path provides measurements that are representative of releases to demonstrate compliance with 10 CFR 20 Appendix B (Reference 11.5-20) limits.

#### ***11.5.5.6 Expected Radiation Levels***

Expected radiation levels are listed in Tables 11.5-1 and 11.5-2.

#### ***11.5.5.7 Instrumentation***

Grab samples are analyzed to identify and quantify the specific radionuclides in process streams. The results from the sample analysis are used to establish relationships between the gross gamma monitor readings and concentration and radionuclides in the process streams.

#### ***11.5.5.8 Setpoints***

The trip setpoints for the certain safety-related radiation monitors are specified in the ODCM required by plant TS. Trip setpoints for nonsafety-related radiation monitors are specified in the plant operating procedures.

#### ***11.5.5.9 Process and Post-Accident Sampling Programs – Regulatory Compliance***

The design considerations, acceptance criteria, and sample point locations described in the Standard Review Plan Section 9.3.2 for sampling of radioactive streams and processes via the Process Sampling System were evaluated for the ESBWR design. Post-accident monitoring program uses sample point parameters and key sample locations as described in DCD Tier 2 Subsections 9.3.2 and 7.5.2.

In addition, where practicable, provisions will be made to include the ability to collect samples at central sample stations in order to reduce leakage, spillage and radiation exposures to operating personnel. The Process Radiation Monitoring subsystems will be designed to maintain radiation exposures ALARA in accordance with 10 CFR Part 20.1101(b).

## 11.5.6 Calibration and Maintenance

### 11.5.6.1 Inspection and Tests

During reactor operation, daily checks of system operability are made by observing channel behavior. At periodic intervals during reactor operation, the detector response of each monitor provided with a remotely positioned check source is verified, together with the instrument background count rate, to ensure proper functioning of the monitors. Any detector whose response cannot be verified by observation during normal operation or by using the remotely positioned check source is response checked with a portable radiation source. A record is maintained showing the background radiation level and the detector response.

The system incorporates self-diagnostics and online calibration for its process radiation monitors that operate continuously to assure maximum availability and minimum down time. In addition, a provision for using test signals for checking system operability is included in the design. Also, each radiation channel is tested and calibrated periodically using a standard radiation source to validate channel operability.

The following monitors have alarm trip circuits that can be tested by using test signals or portable gamma sources:

- MSL
- Reactor Building HVAC Exhaust
- Refuel Handling Area HVAC Exhaust
- Control Building Air Intake HVAC
- FB General Area HVAC
- Isolation Condenser Vent Exhaust
- TB Normal Ventilation Air HVAC
- TB Compartment Area Air HVAC
- Charcoal Vault Ventilation
- Drywell Sump LCW/HCW Discharge
- TSC HVAC Air Intake
- Offgas Pre-treatment
- FB Fuel Pool HVAC
- Containment Purge Exhaust HVAC

The following monitors include built-in check sources:

- Offgas Post-treatment
- Liquid Radwaste Discharge
- Radwaste Building Ventilation Exhaust
- Main Turbine Gland Seal Steam Condenser Exhaust

- TB Combined Ventilation Exhaust
- Drywell Fission Product
- Reactor Component Cooling Water Intersystem Leakage
- FB Combined Ventilation Exhaust
- Plant Stack

#### ***11.5.6.2 Calibration***

Calibration of radiation monitors is performed using certified commercial radionuclide sources traceable to the National Institute of Standards and Technology. Each continuous monitor is calibrated during plant operation or during the refueling outage if the detector is not readily accessible. Calibration can also be performed on the applicable instrument by using liquid or gaseous radionuclide standards or by analyzing particulate iodine or gaseous grab samples with laboratory instruments.

#### ***11.5.6.3 Maintenance***

Control and routine maintenance and cleaning operations of the sampling systems is conducted from either the front or the top of the skid or panel. Lifting eyes or other devices are provided for hoisting the units, to facilitate replacement if it is ever required.

Instrument modules are design to facilitate calibration checks and troubleshooting. Accessibility for power supply adjustments is provided.

Sampling racks and electronic modules are serviced and maintained on an annual basis or in accordance with the operational instructions to ensure reliable operation. Such maintenance includes servicing and replacement of defective components and adjustments, as required, after performing a test or calibration check. If any work is performed that would affect the calibration of the instrument, a re-calibration is performed following the maintenance operation.

### **11.5.7 COL Information**

***11.5.7.1*** The derivation of each Subsystem's Lower Limit of Detection is to be determined by the COL Holder based on site specific conditions and operating characteristics of each installed effluent radiation monitoring subsystem.

#### ***11.5.7.2 Offsite Dose Calculation Manual***

The COL Holder will also develop an ODCM that contains the methodology and parameters used for calculation of offsite doses resulting from gaseous and liquid effluents. The COL Holder will address operational setpoints for the radiation monitors and address programs for monitoring and controlling the release of radioactive material to the environment, which eliminates the potential for unmonitored and uncontrolled release. The ODCM will include planned discharge flow rates.

### ***11.5.7.3 Process and Effluent Monitoring Program***

In addition, the COL Holder is responsible for the site-specific program aspects of the process and effluent monitoring and sampling per ANSI N13.1 (Reference 11.5-13) and Regulatory Guides 1.21 (Reference 11.5-9) and 4.15 (Reference 11.5-10).

### ***11.5.7.4 Site Specific Offsite Dose Calculation***

The COL Holder is responsible for addressing 10 CFR 50, Appendix I (Reference 11.5-8) guidelines for maximally exposed offsite individual doses and population doses via liquid and gaseous effluents.

### ***11.5.7.5 Instrument Sensitivities***

The COL Holder is responsible for the sensitivities, frequencies and basis for each gaseous and liquid samples.

## **11.5.8 References**

- 11.5-1 Title 10 Code of Federal Regulations Part 20.1302, "Compliance with Dose Limits for Individual Members of the Public."
- 11.5-2 Title 10 Code of Federal Regulations Part 50.34a, "Design Objectives for Equipment to Control Releases of Radioactive Material in Effluents-Nuclear Power Plants."
- 11.5-3 Title 10 Code of Federal Regulations Part 50.34(f)(2)(xvii) and 10 CFR 50.34(f)(2)(xxvii).
- 11.5-4 Title 10 Code of Federal Regulations Part 50.36a, "Technical Specifications on Effluents from Nuclear Power Reactors."
- 11.5-5 Title 10 Code of Federal Regulations Part 50, Appendix A, General Design Criterion 60, "Control of Releases of Radioactive Materials to the Environment."
- 11.5-6 Title 10 Code of Federal Regulations Part 50, Appendix A, General Design Criterion 63, "Monitoring Fuel and Waste Storage."
- 11.5-7 Title 10 Code of Federal Regulations Part 50, Appendix A, General Design Criterion 64, "Monitoring Radioactivity Releases."
- 11.5-8 Title 10 Code of Federal Regulations Part 50, Appendix I, "Numerical Guides for Design Objectives and Limiting Conditions for Operation to Meet the Criterion "As Low as is Reasonably Achievable" for Radioactive Material in Light-Water-Cooled Nuclear Power Reactor Effluents."
- 11.5-9 Regulatory Guide 1.21, "Measuring and Reporting Radioactivity in Solid Wastes and Releases of Radioactive Materials in Liquid and Gaseous Effluents from Light-Water-Cooled Nuclear Power Plants."
- 11.5-10 Regulatory Guide 1.45, "Reactor Coolant Pressure Boundary Leakage Detection Systems."
- 11.5-11 Regulatory Guides 1.97, "Instrumentation for Light-Water-Cooled Nuclear Power Plants to Assess Plant Conditions During and Following an Accident."

- 11.5-12 Regulatory Guide 4.15, "Quality Assurance for Radiological Monitoring Programs (Normal Operation) - Effluent Streams and the Environment."
- 11.5-13 ANSI/HPS N13.1-1999, "Sampling and Monitoring Releases of Airborne Radioactive Substances from the Stacks and Ducts of Nuclear Facilities."
- 11.5-14 ANSI N13.10-1974, "Specification and Performance of On-Site Instrumentation for Continuously Monitoring Radioactivity in Effluents" (1974).
- 11.5-15 NUREG-0737, "Clarification of TMI Action Plan Requirements" (1980).
- 11.5-16 Title 10 Code of Federal Regulations Part 20 Appendix B, "Annual Limits on Intake (ALI's) and Derived Air Concentrations (DAC's) of Radionuclides for Occupational Exposure; Effluent Concentrations; Concentrations for Release to Sewerage."
- 11.5-17 Title 10 Code of Federal Regulations Part 50 Appendix A, General Design Criterion 19, "Control Room"
- 11.5-18 NUREG-0800, Standard Review Plan, 11.5 Process and Effluent Radiological Monitoring Instrumentation and Sampling Systems, DRAFT Rev.4 – April 1996.
- 11.5-19 ANS/IEEE N42.18 – 1980, "American National Standard Specification and Performance of On-Site Instrumentation for Continuously Monitoring Radioactivity for Effluents – Description."
- 11.5-20 Title 10 Code of Federal Regulations Part 50 Appendix B, "Quality Assurance Criteria for Nuclear Power Plants and Fuel Reprocessing Plants."
- 11.5-21 Title 10 Code of Federal Regulations Part 20.

Table 11.5-1

## Process and Effluent Radiation Monitoring Systems

Monitored Process	No. of Channels	Sample Line or Detector Location	Displayed Channel Range*
<b>A. Safety-Related Monitors</b>			
Reactor Building HVAC Exhaust	4	Exhaust duct upstream of exhaust ventilation isolation valve	1E-4 to 1E0 mSv/h
Refuel Handling Area HVAC Exhaust	4	Exhaust duct upstream of exhaust ventilation isolation valve	1E-4 to 1E0 mSv/h
Control Building Air Intake HVAC	8	Intake duct upstream of intake ventilation isolation valve	1E-4 to 1E0 mSv/h
LCW Drywell Sump Discharge	1	Drain line from LCW sump	1E-2 to 1E4 mSv/h
HCW Drywell Sump Discharge	1	Drain line from HCW sump	1E-2 to 1E4 mSv/h
FB General Area HVAC	4	Exhaust duct upstream of exhaust ventilation isolation valve	1E-4 to 1E0 mSv/h
Isolation Condenser Vent Exhaust	16	Exhaust of air space surrounding isolation condensers	1E-4 to 1E0 mSv/h
Containment Purge Exhaust	4	Exhaust duct upstream of exhaust ventilation isolation valve	1E-4 to 1E0 mSv/h
FB Fuel Pool HVAC	4	On HVAC duct leaving Fuel Pool Area	1E-4 to 1E0 mSv/h
<b>B. Monitors Required for Plant Operation</b>			
MSL	4	Immediately downstream of plant MSL isolation valve	1E-2 to 1E4 mSv/h
Plant Stack	3	On Stack exhaust	1E -3 to 1E 10 MBq/m <sup>3</sup> (gaseous) 1E -6 to 1E 7 MBq/m <sup>3</sup> (particulate & halogen)
TB Normal Ventilation	2	Exhaust duct from TB Normal	1E-4 to 1E0 mSv/h

Table 11.5-1

## Process and Effluent Radiation Monitoring Systems

Monitored Process	No. of Channels	Sample Line or Detector Location	Displayed Channel Range*
Air HVAC		ventilation	
TB Compartment Area Air HVAC	2	Exhaust duct from Compartment area	1E-4 to 1E0 mSv/h
TB Combined Ventilation Exhaust	3	On TB combined exhaust line	1E-3 to 1E3 MBq/m <sup>3</sup> (gaseous) 1E-7 to 1E-1 MBq/m <sup>3</sup> (particulate and iodine)
Radwaste Building Ventilation Exhaust	3	On Radwaste Building exhaust line	1E-3 to 1E3 MBq/m <sup>3</sup> (gaseous) 1E-7 to 1E-1 MBq/m <sup>3</sup> (particulate) 1E-7 to 1E-1 MBq/m <sup>3</sup> (iodine)
Main Turbine Gland Seal Steam Condenser Exhaust	1	Sample line from exhaust from Gland Seal condenser	1E-3 to 1E3 MBq/m <sup>3</sup>
Liquid Radwaste Discharge	1	Sample line from combined liquid Radwaste effluent path	1E-3 to 1E3 MBq/m <sup>3</sup>
Offgas Pre-treatment	1	Sample line after Offgas cooler/condenser	1E-2 to 1E4 mSv/h
Offgas Post-treatment Skid A	3	Sample line after Charcoal treatment beds	1E0 to 1E7 MBq/m <sup>3</sup> (gaseous) 1E-7 to 1E1 MBq/m <sup>3</sup> (particulate) 1E-7 to 1E1 MBq/m <sup>3</sup> (iodine)
Offgas Post-treatment Skid B	1	Sample Line after Charcoal treatment beds	1E0 to 1E7 MBq/m <sup>3</sup> (gaseous)
Charcoal Vault Ventilation	1	On charcoal vault HVAC exhaust line	1E-2 to 1E4 mSv/h



**Table 11.5-1**  
**Process and Effluent Radiation Monitoring Systems**

<b>Monitored Process</b>	<b>No. of Channels</b>	<b>Sample Line or Detector Location</b>	<b>Displayed Channel Range*</b>
Reactor Component Cooling Water Intersystem Leakage	2	Each RCCW heat exchanger line exit	1E-1 to 1E5 MBq/m <sup>3</sup>
TSC HVAC Air Intake	1	Intake HVAC duct	1E4 to 1E0 mSv/h
Drywell Fission Product (Particulate)	1	Sample line from drywell atmosphere	1E-7 to 1E-1 MBq/m <sup>3</sup>
Drywell Fission Product (Gaseous)	1	Sample line from drywell atmosphere	1E-1 to 1E4 MBq/m <sup>3</sup>
FB Combined Ventilation Exhaust	3	Sample Line from HVAC exhaust leaving FB	1E-3 to 1E3 MBq/m <sup>3</sup> (gaseous) 1E-7 to 1E-1 MBq/m <sup>3</sup> (particulate) 1E-7 to 1E-1 MBq/m <sup>3</sup> (iodine)

\* MBq/m<sup>3</sup> = mega-becquerel per cubic meter; mSv/h = milli-Sieverts per hour

**Table 11.5-2**  
**Process Radiation Monitoring System (Gaseous and Airborne Monitors)**

<b>Radiation Monitor</b>	<b>Configuration</b>	<b>Dynamic Detection Range *</b>	<b>Principal Radionuclides Measured</b>	<b>Expected Activity **</b>	<b>Alarms*** and Trips</b>
<b>A. Safety-Related Monitors</b>					
Reactor Building HVAC Exhaust	Inline (adjacent and external to HVAC duct)	$\approx 1.5\text{E } 3 \text{ to } 1.5\text{E } 7 \text{ MBq/m}^3$	Xe-133	**	DNSC/INOP High High-High
Refuel Handling Area HVAC Exhaust	Inline (adjacent and external to HVAC duct)	$\approx 7.3\text{E}2 \text{ to } 7.3\text{E}6 \text{ MBq/m}^3$	Xe-133	**	DNSC/INOP High High-High
Control Building Air Intake HVAC	Inline (adjacent and external to HVAC air intake duct)	$\approx 8\text{E}1 \text{ to } 8\text{E } 5 \text{ MBq/m}^3$	Xe-133	**	DNSC/INOP High High-High
FB General Area HVAC	Inline (adjacent and external to HVAC duct)	$\approx 7.4\text{E } 1 \text{ to } 7.4\text{E } 5 \text{ MBq/m}^3$	Xe-133	**	DNSC/INOP High High-High
Isolation Condenser Vent Exhaust	Inline (adjacent to vent duct)	$\approx 1.5\text{E } 3 \text{ to } 1.5\text{E } 7 \text{ MBq/m}^3$	Xe-133	**	DNSC/INOP High High-High
Containment Purge Exhaust	Inline (adjacent and external to HVAC duct)	$\approx 1.5\text{E } 3 \text{ to } 1.5\text{E } 7 \text{ MBq/m}^3$	Xe-133	**	DNSC/INOP High High-High
FB Fuel Pool HVAC	Inline and internal to HVAC duct	$\approx 5.5\text{E}0 \text{ to } 5.5 \text{ E } 4 \text{ MBq/m}^3$ $\approx 1\text{E } 2 \text{ to } 1\text{E } 6 \text{ MBq/m}^3$	Xe-133 Kr-85	0** 0**	DNSC/INOP High High-High

**Table 11.5-2**  
**Process Radiation Monitoring System (Gaseous and Airborne Monitors)**

Radiation Monitor	Configuration	Dynamic Detection Range *	Principal Radionuclides Measured	Expected Activity **	Alarms*** and Trips
<b>B. Monitors Required for Plant Operation</b>					
MSL	Offline (adjacent to MSLs)	$\approx 1.4\text{E } 2$ to $1.4\text{E } 8$ MBq/m <sup>3</sup>	N-16, O-19 & Coolant activation gases	**	DNSC INOP High High-High
Offgas Post-treatment	Offline	$\approx 8\text{E } 3$ to $8\text{E } 3$ MBq/m <sup>3</sup> $\approx 2.6\text{E } -3$ to $2.6\text{E } 3$ MBq/m <sup>3</sup> $\approx 3.7\text{E } -7$ to $3.7\text{E } -1$ MBq/m <sup>3</sup> $\approx 7.4\text{E } -7$ to $7.4\text{E } -1$ MBq/m <sup>3</sup>	Xe-133 Kr-85  Cs-137 I-131	** **  ** **	Abnormal Flow DNSC/INOP High High-High High-High-High
Offgas Pre-treatment	Offline (adjacent to sample chamber)	$\approx 1.7\text{E } 2$ to $1.7\text{E } 8$ MBq/m <sup>3</sup> $\approx 1.0\text{E } 2$ to $1.0\text{E } 8$ MBq/m <sup>3</sup>	Xe-138  Kr-88	**  **	DNSC/INOP High High-High
Main Turbine Gland Seal Steam Condenser Exhaust	Offline	$\approx 8\text{E } -3$ to $8\text{E } 3$ MBq/m <sup>3</sup> $\approx 2.6\text{E } -3$ to $2.6\text{E } 3$ MBq/m <sup>3</sup>	Xe-133 Kr-85	** **	Abnormal Flow DNSC/INOP High High-High
Charcoal Vault Ventilation	Inline (adjacent and internal to HVAC duct)	$\approx 5.1\text{E } 2$ to $5.1\text{E } 8$ MBq/m <sup>3</sup> $\approx 1\text{E } 2$ to $1\text{E } 8$ MBq/m <sup>3</sup>	Xe-133 Kr-85	** **	DNSC/INOP High
TB Normal Ventilation Air HVAC	Inline (adjacent and internal to HVAC duct)	$\approx 1.7\text{E } 0$ to $1\text{E } 4$ MBq/m <sup>3</sup> $\approx 3.4\text{E } 1$ to $3.4\text{E } 5$ MBq/m <sup>3</sup>	Xe-133 Kr-85	** **	DNSC/INOP High
TB Compartment Area Air HVAC	Inline (adjacent and internal to HVAC duct)	$\approx 2\text{E } 0$ to $2\text{E } 4$ MBq/m <sup>3</sup> $\approx 4.5\text{E } 1$ to $4.5\text{E } 5$ MBq / m <sup>3</sup>	Xe-133 Kr-85	** **	DNSC/INOP High

**Table 11.5-2**  
**Process Radiation Monitoring System (Gaseous and Airborne Monitors)**

Radiation Monitor	Configuration	Dynamic Detection Range *	Principal Radionuclides Measured	Expected Activity **	Alarms*** and Trips
TB Combined Ventilation Exhaust	Offline	$\approx 8 \text{ E } -3 \text{ to } 8 \text{ E } 3 \text{ MBq/m}^3$	Xe-133 Kr-85 Cs-137 I-131	**	Abnormal Flow
		$\approx 2.6 \text{ E } -3 \text{ to } 2.6 \text{ E } 3 \text{ MBq/m}^3$		**	DNOSC/INOP
		$\approx 7.4 \text{ E } -7 \text{ to } 7.4 \text{ E } -1 \text{ MBq/m}^3$		**	High
		$\approx 7.4 \text{ E } -7 \text{ to } 7.4 \text{ E } -1 \text{ MBq/m}^3$		**	High-High
Plant Stack	Offline	$\approx 1 \text{ E } -3 \text{ to } 1 \text{ E } 10 \text{ MBq/m}^3$	Xe-133 Kr-85 Cs-137 I-131	**	Abnormal Flow
		$\approx 1 \text{ E } -3 \text{ to } 1 \text{ E } 10 \text{ MBq/m}^3$		**	DNOSC/INOP
		$\approx 1 \text{ E } -6 \text{ to } 1 \text{ E } 7 \text{ MBq/m}^3$		**	High
		$\approx 1 \text{ E } -6 \text{ to } 1 \text{ E } 7 \text{ MBq/m}^3$		**	High-High
Drywell Fission Product	Offline	$\approx 8.1 \text{ E } -8 \text{ to } 8.1 \text{ E } -2 \text{ MBq/m}^3$	Cs-137	**	Abnormal Flow
		$\approx 2.6 \text{ E } -7 \text{ to } 2.6 \text{ E } -1 \text{ MBq/m}^3$ (particulate)		**	DNOSC/INOP
Drywell Fission Product	Offline	$\approx 8.1 \text{ E } -3 \text{ to } 8.1 \text{ E } 3 \text{ MBq/m}^3$	Xe-133 Kr-85	**	High
		$\approx 2.6 \text{ E } -3 \text{ to } 2.6 \text{ E } 3 \text{ MBq/m}^3$ (gaseous)		**	High-High
Radwaste Building Ventilation Exhaust	Offline	$\approx 8 \text{ E } -3 \text{ to } 8 \text{ E } 3 \text{ MBq/m}^3$	Xe-133 Kr-85 Cs-137 I-131	**	Abnormal Flow
		$\approx 2.6 \text{ E } -3 \text{ to } 2.6 \text{ E } 3 \text{ MBq/m}^3$		**	DNOSC/INOP
		$\approx 7.4 \text{ E } -7 \text{ to } 7.4 \text{ E } -1 \text{ MBq/m}^3$		**	High
		$\approx 7.4 \text{ E } -7 \text{ to } 7.4 \text{ E } -1 \text{ MBq/m}^3$		**	High-High

**Table 11.5-2**  
**Process Radiation Monitoring System (Gaseous and Airborne Monitors)**

Radiation Monitor	Configuration	Dynamic Detection Range *	Principal Radionuclides Measured	Expected Activity **	Alarms*** and Trips
FB Combined Ventilation Exhaust	Offline	$\approx 8 \text{ E } -3 \text{ to } 8 \text{ E } 3 \text{ MBq/m}^3$ $\approx 2.6 \text{ E } -3 \text{ to } 2.6 \text{ E } 3 \text{ MBq/m}^3$ $\approx 7.4 \text{ E } -7 \text{ to } 7.4 \text{ E } -1 \text{ MBq/m}^3$ $\approx 7.4 \text{ E } -7 \text{ to } 7.4 \text{ E } -1 \text{ MBq/m}^3$	Xe-133 Kr-85  Cs-137 I-131	** **  ** **	Abnormal Flow DNSC/INOP High High-High
TSC HVAC Air Intake	Inline and internal to HVAC intake duct	$\approx 8 \text{ E } 0 \text{ to } 8 \text{ E } 4 \text{ MBq/m}^3$ $\approx 1.7 \text{ E } 2 \text{ to } 1.7 \text{ E } 6 \text{ MBq/m}^3$	Xe-133 Kr-85	** **	DNSC/INOP High High-High

\* Dynamic detection ranges are estimated and will be adjusted according to plant unique configurations and radiation background.

\*\* Activity levels are expected to be at the subsystem's lower limit of detection (LLD). The derivation of each LLD is to be determined by the COL Holder based on site-specific conditions and operating characteristics of each installed effluent radiation monitoring subsystem. See Section 12.2 for expected activity of various processes and effluents.

\*\*\* Bq/ m<sup>3</sup> = Becquerels per cubic meter, MB/m<sup>3</sup> = Mega Becquerels per cubic meter; DNSC/INOP = downscale/inoperative; Abnormal Flow = High or Low flow in the sampling system outside system limits

**Table 11.5-3**  
**Key to Radiation Monitors Shown on Figure 11.5-1**

<b>ID on Figure 11.5-1</b>	<b>Description</b>
1	MSL
2	Reactor Building HVAC Exhaust
3	Refuel Handling Area HVAC Exhaust
4A, 4B	Control Building Air Intake HVAC
5	TB Normal Ventilation Air HVAC
6	TB Compartment Area Air HVAC
7	Offgas Pre-treatment
8	Charcoal Vault Ventilation
9A, 9B	Offgas Post-treatment
10	TB Combined Ventilation Exhaust
11	Liquid Radwaste Discharge
12	Drywell Sump LCW/HCW Discharge
13	Plant Stack
14	Main Turbine Gland Seal Steam Condenser Exhaust
15A, 15B	Reactor Component Cooling Water Intersystem Leakage
16	Drywell Fission Product
17	Radwaste Building Ventilation Exhaust
18	FB Combined Ventilation Exhaust
19	Isolation Condenser Vent Exhaust
20	TSC HVAC Air Intake
21	FB General Area HVAC
22	FB Fuel Pool HVAC
23	Containment Purge Exhaust

**Table 11.5-4**  
**Process Radiation Monitoring System (Liquid Monitors)**

<b>Radiation Monitor</b>	<b>Configuration</b>	<b>Dynamic Detection Range *</b>	<b>Principal Radionuclides Measured</b>	<b>Expected Activity **</b>	<b>Alarms &amp; Trips</b>
Liquid Radwaste Discharge	Offline	$\approx 2.1\text{E-}3$ to $2.1\text{E} 3 \text{ MBq/m}^3$ $\approx 1.9\text{E-}2$ to $1.9\text{E} 4 \text{ MBq/m}^3$	Cs-137 Co-60	** **	Abnormal Flow DNSC/INOP High High-High
Reactor Component Cooling Water Intersystem Leakage	Offline (mounted external to RCCW piping)	$\approx 4.3\text{E-}3$ to $4.3\text{E} 3 \text{ MBq/m}^3$ $\approx 3.6\text{E-}3$ to $3.6\text{E} 3 \text{ MBq/m}^3$	Cs-137 Co-60	** **	DNSC/INOP High
Drywell Sump LCW/HCW Discharge	Inline (mounted external to and adjacent to HCW and LCW discharge pipes outside the drywell)	$\approx 4\text{E}4$ to $4\text{E} 10 \text{ MBq/m}^3$ $\approx 8\text{E}0$ to $8\text{E} 6 \text{ MBq/m}^3$	Cs-137 Co-60	** **	DNSC/INOP High High-High

$\text{MBq/m}^3$  = Mega Becquerels per cubic meter; DNSC/INOP = downscale/inoperative

\* Dynamic detection ranges are estimated and will be adjusted according to plant unique configurations and radiation background.

\*\* Activity levels are expected to be at the subsystem's lower limit of detection (LLD). The derivation of each LLD is to be determined by the COL Holder based on site-specific conditions and operating characteristics of each installed effluent radiation monitoring subsystem. See Section 12.2 for expected activity of various processes and effluents.

**Table 11.5–5**  
**Provisions for Sampling Liquid Streams**

No.	Process Systems as listed in NUREG-0800, SRP 11.5 Table 2 (Draft Rev. 4)	ESBWR System (s) that Perform the Equivalent SRP 11.5 Function (Note 1)	In Process		In Effluent	
			Grab	Notes 2 & 7	Grab	Notes 2 & 7
1.	Liquid Radwaste (Batch) Effluent System <sup>Note 3</sup>	Equipment (Low Conductivity Drain Subsystem; Floor (High Conductivity) Drain Subsystem	S&A		S&A, H3	-
2.	Service Water System	Plant Service Water System	-		S&A, H3	(S&A) Notes 6 & 8
3.	Component Cooling Water System	Reactor Component Cooling Water System	S&A		S&A, H3	(S&A) Notes 6 & 8
4.	Spent Fuel Pool Treatment System	Spent Fuel Pool Treatment System	S&A		S&A, H3	(S&A) Notes 6 & 8
5.	Equipment & Floor Drain Collection and Treatment Systems	LCW Drain Subsystem; HCW Drain Subsystem; Detergent Drain Subsystem; Chemical Waste Drain Subsystem; Reactor Component Cooling Water System (RCCWS) Drain Subsystem	-		S&A, H3	(S&A) Notes 6 & 8
6.	Phase Separator Decant & Holding Basin Systems	Equipment (Low Conductivity) Drain Subsystem; Floor (High) drain Subsystem	-		S&A, H3	(S&A) Notes 6 & 8



**Table 11.5–5**  
**Provisions for Sampling Liquid Streams**

No.	Process Systems as listed in NUREG-0800, SRP 11.5 Table 2 (Draft Rev. 4)	ESBWR System (s) that Perform the Equivalent SRP 11.5 Function (Note 1)	In Process		In Effluent	
			Grab	Notes 2 & 7	Grab	Notes 2 & 7 Continuous Notes 6 & 8
7.	Chemical & Regeneration Solution Waste Systems	Chemical Waste Drain Subsystem	-		S&A, H3	(S&A) Notes 6 & 8
8.	Laboratory & Sample System Waste Systems	Chemical Waste Drain Subsystem	-		S&A, H3	(S&A) Notes 6 & 8
9.	Laundry & Decontamination Waste Systems	Detergent Drain Subsystem	-		S&A, H3	(S&A) Notes 6 & 8
10.	Resin Slurry, Solidification & Baling Drain Systems	Equipment (Low Conductivity) Drain Subsystem; Floor (High) Drain Subsystem	-		S&A, H3	(S&A) Notes 6 & 8
11.	Storm & Underdrain Water System	COL Holder Note 4	-		(S&A, H3) Notes 3 & 6	(S&A) Notes 3 & 6
12.	Tanks and Sumps Inside Reactor Building	Equipment (Low Conductivity) Drain Subsystem; Floor (High) Drain Subsystem; Chemical Waste Drain Subsystem; Detergent Drain Subsystem	-		S&A, H3	(S&A) Notes 6 & 8
13.	Ultrasonic Resin Cleanup Waste Systems	Note 5	-		Note 5	Note 5

**Table 11.5–5**  
**Provisions for Sampling Liquid Streams**

No.	Process Systems as listed in NUREG-0800, SRP 11.5 Table 2 (Draft Rev. 4)	ESBWR System (s) that Perform the Equivalent SRP 11.5 Function (Note 1)	In Process		In Effluent	
			Grab	Notes 2 & 7	Grab	Notes 2 & 7
14.	Non-Contaminated Waste Water System	COL Holder Notes 3 & 4	-		(S&A, H3) Notes 3,4 & 6	Continuous (S&A) Note 4

Notes for Table 11.5–5:

- Table 11.5-5 addresses sampling provisions for BWRs as identified in Table 2 of SRP 11.5. For process systems identified for BWRs in Table 2, but not shown in Table 11.5-5, those systems are not applicable to ESBWR. In some cases, there are multiple subsystems that are used to perform the overall equivalent SRP function and are listed as such in the column.
- S&A=Sampling & Analysis of radionuclides, to include gross radioactivity, identification and concentration of principal radionuclides and concentration of alpha emitters; R=Gross radioactivity (beta radiation, or total beta plus gamma); H3=Tritium
- Liquid Radwaste is processed on a batch-wise basis. The Liquid Waste Management System sample tanks can be sampled for analysis of the batch. See Subsection 11.2.2.2 for more information on Liquid Radwaste Management.
- The COL Holder will provide design of wastewater effluent systems that monitor the storm, the cooling system tower blow down and sanitation wastes. See Subsection 9.2.4 for additional information.
- The ESBWR does not include ultrasonic resin cleanup waste system at this time. Should one be installed, the Liquid Waste Management System would provide sampling and monitoring provisions.
- The use of parenthesis indicates that these provisions are required only for the systems not monitored, sampled, or analyzed (as indicated) prior to release by downstream provisions.
- The sensitivity of detection, also defined here as the Lower Limit of Detection (LLD), for each indicated measured variable, will be based on the applicable radionuclide (or collection of radionuclides as applicable) as given in 10 CFR 20 Appendix B and as supplemented by RG 1.21.
- Processed through radwaste Liquid Waste Management System (LWMS) prior to discharge. Therefore, this process system is monitored, sampled, or analyzed prior to release by downstream provisions. See Note 6 above. Depending on Utility's discretion, additional sampling lines may be installed. Continuous Effluent sampling is not required per Standard Review Plan 11.5 Draft Rev. 4, April 1996, Table 2 for this system function.

**Table 11.5–6**  
**Provisions for Sampling Gaseous Streams**

No.	Process System as listed in NUREG-0800, SRP 11.5 Table 1 (Draft Rev 4)	ESBWR System (s) that Perform the Equivalent SRP 11.5 Function (Note 1)	Sample Provisions (Note 2)		
			In Process	In Effluent	
			Grab	Grab	Continuous
1.	Waste Gas Holdup System	OGS (Charcoal Bed portion, i.e., Offgas Post-treatment)	-	NG, H3	I
2.	Condenser Evacuation System	OGS (Cooler Condenser portion, i.e., Offgas Pre-treatment)	I	NG, H3	Note 3
3.	Vent & Stack Release Point System	Plant Stack	I	NG, H3	I
4.	Containment Purge Systems	Containment Inerting System	I	NG, H3	Note 4
5.	Auxiliary Building Ventilation System	Reactor Building HVAC System	I	NG, H3	Note 4
6.	Fuel Storage Area Ventilation System	FBHV System	I	NG, H3	I
7.	Radwaste Area Vent Systems	Radwaste Building HVAC System	I	NG, H3	I
8.	Turbine Gland Seal Condenser Vent System	Main Turbine Gland Seal Steam Condenser Exhaust	I	NG, H3	Note 5

**Table 11.5–6**  
**Provisions for Sampling Gaseous Streams**

No.	Process System as listed in NUREG-0800, SRP 11.5 Table 1 (Draft Rev 4)	ESBWR System (s) that Perform the Equivalent SRP 11.5 Function (Note 1)	Sample Provisions (Note 2)		
			In Process	In Effluent	
			Grab	Grab	Continuous
9.	Mech. Vacuum Pump Exhaust (Hogging System)	Condenser Air Removal System	Note 6	Note 7 <sup>1</sup>	Note 5
10.	Evaporator Vent Systems	Main Turbine Gland Seal Steam Condenser Exhaust	I	NG, H3	Note 5
11.	Pre-treatment Liquid Radwaste Tank Vent Gas Systems	Radwaste Building HVAC System	I	NG, H3	I
12.	TB Vent Systems	TB Combined Ventilation Exhaust	I	NG, H3	I

Notes For Table 11.5–6

1. Table 11.5-6 addresses sampling provisions for BWRs as identified in Table 1 of SRP 11.5. For process systems identified for BWRs in Table 2 of SRP 11.5, but not shown in Table 11.5-6, those systems are not used for ESBWR.
2. NG = Noble Gas; I = Iodine 131; H3 = Tritium
3. Continuous iodine sampling provided by downstream Offgas Post-treatment radiation Monitoring.
4. Continuous iodine sampling provided by downstream Plant Stack radiation Monitoring.
5. Continuous iodine sampling provided by downstream TB Combined Exhaust radiation Monitoring.
6. Grab sampling for iodine provided by the TB Combined Exhaust Monitoring.
7. Grab sampling for Noble Gas and Tritium is provided by the TB Combined Exhaust Monitoring.

**Table 11.5-7**  
**Radiological Analysis Summary of Liquid Effluent Samples**

Sample Description	Sample Frequency	Analysis	Sensitivity (MBq/m3)*****	Purpose
1. Liquid Radwaste Effluent Discharge *	Weekly **	Ba/La-140 and I-131	***	Effluent discharge record
Composite of all discharges *****	Monthly	Gamma Spectrum	***	
		Tritium	***	
		Gross alpha	***	
		Dissolved gas	***	
	Quarterly	Sr-89 and Sr-90	***	

Notes for Table 11.5-7:

- \* ESBWR Radwaste is processed on a batch basis. If a tank is to be discharged, analysis will be performed on each batch.
- \*\* The ESBWR Liquid Waste Management System (LWMS) is designed to recycle 100% of the liquid radwaste (zero liquid release). The LWMS system has provisions for off-site discharge. If liquid radwaste is discharged, the sampling and analysis will be done per the requirements of RG 1.21.
- \*\*\* The sensitivity of detection (also defined here as the Lower Limit of Detection (LLD)) for each indicated radionuclide (or collection of radionuclides as applicable) will be as defined in 10 CFR 20 Appendix B and as supplemented by RG 1.21.
- \*\*\*\* The principal gamma emitters for which the LLD specification applies includes the following radionuclides: MN-54, Fe-59, Co-58, Co-60, Zn-65, Mo-99, Cs-134, Cs-137, and Ce-141. This list does not mean that only these nuclides are to be considered. Other gamma energy peaks that are identifiable, together with those of above radionuclides, shall be analyzed and reported per RG 1.21.
- \*\*\*\*\* A composite sample is one in which the quantity of liquid sampled is proportional to the quantity of liquid waste discharged and in which the method of sampling employed results in a specimen that is representative of the liquids released.

**Table 11.5-8**  
**Radiological Analysis Summary of Gaseous Effluent Samples**

Sample Description	Sample Frequency*	Analysis	Sensitivity (MBq/m3)**	Purpose
1. TB Combined Ventilation Exhaust	Weekly	Gross $\beta$	**	Effluent record
		I-131	**	
		Ba/La-140	**	
	Monthly	Gamma spectrum	**	Effluent record
		I-133 and I-135	**	
2. Plant Stack	Quarterly	Tritium	**	
		Gross alpha	**	
		Sr-89 and Sr-90	**	Effluent record
		As above	**	Effluent record
		As above	**	Effluent record
3. Radwaste Building Ventilation Exhaust	As above	As above	**	Effluent record
4. FB Combined Ventilation Exhaust	As above	As above	**	Effluent record

Notes for Table 11.5-8:

\* All frequencies of sampling will be in accordance with RG 1.21.

\*\* The sensitivity of detection (also defined here as the Lower Limit of Detection (LLD)) for each indicated radionuclide (or collection of radionuclides as applicable) will be as defined in 10 CFR 20 Appendix B and as supplemented by RG 1.21.

\*\*\* The principal gamma emitters for which the LLD specification applies includes the following radionuclides: Kr-85, Kr-88, Xe-133, Xe-133m, Xe-135, and Xe-138 in noble gas releases, and Mn-554, Fe-59, Co-58, Co-60, Zn-65, Mo-99, I-131, Cs-134, Cs-137, Ce-141, and Ce-144 in Iodine and Particulate releases. This list does not mean that only these nuclides are to be considered. Other gamma energy peaks that are identifiable, together with those of the above radionuclides, shall be analyzed and reported per RG 1.21.

**Table 11.5-9**  
**Process Radiation Monitoring System Estimated Dynamic Ranges**

<b>Radiation Monitor</b>	<b>Estimated Dynamic Detection Range</b>	<b>Principal Radionuclides Measured</b>	<b>Basis for Dynamic Range</b>
<b>A. Safety-Related Monitors</b>			
MSL	$\approx 1.4 \text{ E } 2 \text{ to } 1.4 \text{ E } 8 \text{ MBq/m}^3$	N-16, O-19 & Coolant activation gases	The dynamic range has been selected so that sufficient coverage is provided to detect both the radiation dose rates associated with releases of activation gases and fission products from low reactor power and those that would be associated with a major release of fission products from the reactor core.
Reactor Building HVAC Exhaust	$\approx 1.5 \text{ E } 3 \text{ to } 1.5 \text{ E } 7 \text{ MBq/m}^3$	Xe-133	The dynamic range has been selected to provide sufficient coverage to detect both the radiation dose rates associated with normal RB ventilation releases up to the dose rate expected in the ventilation system resulting from a FUHA.
Refuel Handling Area HVAC Exhaust	$\approx 7.3 \text{ E } 2 \text{ to } 7.3 \text{ E } 6 \text{ MBq/m}^3$	Xe-133	The dynamic range has been selected to provide sufficient coverage to detect the radiation dose rates associated with normal RB ventilation releases up to the dose rate expected in the ventilation system resulting from a FUHA.
Control Building Air Intake HVAC	$\approx 8 \text{ E } 1 \text{ to } 8 \text{ E } 5 \text{ MBq/m}^3$	Xe-133	The dynamic range has been selected to provide sufficient coverage to detect a radiation dose rate associated with noble gas concentrations, during a LOCA, estimated for the Main Control Room ventilation intake. Additional decades were utilized to cover the lower range to provide indication prior to exceeding 10 CFR 50 GDC 19 dose limits.

**Table 11.5-9**  
**Process Radiation Monitoring System Estimated Dynamic Ranges**

<b>Radiation Monitor</b>	<b>Estimated Dynamic Detection Range</b>	<b>Principal Radionuclides Measured</b>	<b>Basis for Dynamic Range</b>
FB General Area HVAC	$\approx 7.4 \text{ E } 1 \text{ to } 7.4 \text{ E } 5 \text{ MBq/m}^3$	Xe-133	The dynamic range has been selected to provide sufficient coverage to detect a radiation dose rate associated with normal FB ventilation releases up to the dose rate expected after a FUHA occurring in the FB.
Isolation Condenser Vent Exhaust	$\approx 1.5 \text{ E } 3 \text{ to } 1.5 \text{ E } 7 \text{ MBq/m}^3$	Xe-133	The dynamic range has been selected to provide coverage of the isolation condenser pool exhaust vent releases to the environment prior to exceeding 10 CFR 20 limit airborne concentrations.
Containment Purge Exhaust	$\approx 1.5 \text{ E } 3 \text{ to } 1.5 \text{ E } 7 \text{ MBq/m}^3$	Xe-133	The dynamic range has been selected to provide sufficient coverage to detect a radiation dose rate associated with radionuclide concentrations in the drywell during a purge to the environment and providing isolation prior to exceeding 10 CFR 20 limits.
FB Fuel Pool HVAC	$\approx 5.5 \text{ E } 0 \text{ to } 5.5 \text{ E } 4 \text{ MBq/m}^3$ $\approx 1 \text{ E } 2 \text{ to } 1 \text{ E } 6 \text{ MBq/m}^3$	Xe-133 Kr-85	The dynamic ranges have been selected to provide sufficient coverage to detect a radiation dose rate associated with normal FB ventilation releases up to the dose expected after a FUHA that occurs in the FB.
Drywell Sump LCW/HCW Discharge	$\approx 4 \text{ E } 4 \text{ to } 4 \text{ E } 10 \text{ MBq/m}^3$ $\approx 8 \text{ E } 0 \text{ to } 8 \text{ E } 6 \text{ MBq/m}^3$	Cs-137 Co-60	The dynamic ranges have been selected to provide sufficient coverage to encompass the radiation dose rates, on the outside of the LCW and HCW pipes, using typical reactor water concentrations of various radionuclides. Reactor water concentrations associated with a LOCA were used to estimate the upper limit of the dynamic range.



**Table 11.5-9**  
**Process Radiation Monitoring System Estimated Dynamic Ranges**

<b>Radiation Monitor</b>	<b>Estimated Dynamic Detection Range</b>	<b>Principal Radionuclides Measured</b>	<b>Basis for Dynamic Range</b>
<b>B. Monitors Required for Plant Operation</b>			
Offgas Post-treatment	$\approx 8 \text{ E-3 to } 8 \text{ E } 3 \text{ MBq/m}^3$ $\approx 2.6 \text{ E-3 to } 2.6 \text{ E } 3 \text{ MBq/m}^3$ $\approx 3.7 \text{ E-7 to } 3.7 \text{ E-1 MBq/m}^3$ $\approx 7.4 \text{ E-7 to } 7.4 \text{ E-1 MBq/m}^3$	Xe-133 Kr-85 Cs-137 I-131	The dynamic ranges for the indicated isotopes have been selected in order to provide sufficient coverage for the OGS release rates and parameters found in Chapter 11.3 and to of effluent concentrations based on 10 CFR 20 values for releases to unrestricted areas
Offgas Pre-treatment	$\approx 1.7 \text{ E } 2 \text{ to } 1.7 \text{ E } 8 \text{ MBq/m}^3$ $\approx 1.0 \text{ E } 2 \text{ to } 1.0 \text{ E } 8 \text{ MBq/m}^3$	Xe-138 Kr-88	The dynamic ranges for the offgas pretreatment subsystem were selected based on the values for the offgas releases associated with the OGS. The Pre-treatment RMS channels are estimated to cover a release rate span of $3.7 \text{ E } 2$ to $3.7 \text{ E } 8 \text{ MBq/sec}$ , referenced to the noble gases listed in Table 11.1-1. The offgas release range associated with the radiation monitor is related to the $t=30$ minute value for offgas listed in Table 11.1-1, i.e., $3.7 \text{ E } 3 \text{ MBq/sec}$ , with the exception that only 2 minutes of radioactive decay is considered to occur, and the source terms are adjusted accordingly. The concentrations of the offgas, at the Offgas Pre-treatment radiation monitor, is estimated to produce a radiation dose rate, at 100% reactor power (with a decay time of 2 minutes) of approximately 30 to 40 mSv/hr.

**Table 11.5-9**  
**Process Radiation Monitoring System Estimated Dynamic Ranges**

<b>Radiation Monitor</b>	<b>Estimated Dynamic Detection Range</b>	<b>Principal Radionuclides Measured</b>	<b>Basis for Dynamic Range</b>
Main Turbine Gland Seal Steam Condenser Exhaust	$\approx 8 \text{ E } -3 \text{ to } 8 \text{ E } 3 \text{ MBq/m}^3$ $\approx 2.6 \text{ E } -3 \text{ to } 2.6 \text{ E } 3 \text{ MBq/m}^3$	Xe-133 Kr-85	The dynamic range has been selected to be able to detect 10 CFR 20 concentration limits in the Main Turbine Gland Seal Steam Condenser exhaust prior to its combination with other exhausts of the TB ventilation system.
Charcoal Vault Ventilation	$\approx 5.1 \text{ E } 2 \text{ to } 5.1 \text{ E } 8 \text{ MBq/m}^3$ $\approx 1 \text{ E } 2 \text{ to } 1 \text{ E } 8 \text{ MBq/m}^3$	Xe-133 Kr-85	The dynamic range has been selected so that radionuclide intrusion, from the offgas charcoal beds into charcoal vault ventilation ducting, is detected prior to its combination with other TB ventilation exhausts.
TB Normal Ventilation Air HVAC	$\approx 1.7 \text{ to } 1.7 \text{ E } 4 \text{ MBq/m}^3$ $\approx 3.4 \text{ E } 1 \text{ to } 3.4 \text{ E } 5 \text{ MBq/m}^3$	Xe-133 Kr-85	The dynamic ranges have been selected to provide sufficient coverage to provide indication of 10 CFR 20 effluent limits, accounting for bounding typical site meteorology
TB Compartment Area Air HVAC	$\approx 2 \text{ E } 0 \text{ to } 2 \text{ E } 4 \text{ MBq/m}^3$ $\approx 4.5 \text{ E } 1 \text{ to } 4.5 \text{ E } 5 \text{ MBq/m}^3$	Xe-133 Kr-85	The dynamic ranges have been selected to provide sufficient coverage to provide indication of 10 CFR 20 effluent limits, accounting for bounding typical site meteorology
TB Combined Ventilation Exhaust	$\approx 8 \text{ E } -3 \text{ to } 8 \text{ E } 3 \text{ MBq/m}^3$ $\approx 2.6 \text{ E } -3 \text{ to } 2.6 \text{ E } 3 \text{ MBq/m}^3$ $\approx 7.4 \text{ E } -7 \text{ to } 7.4 \text{ E } -1 \text{ MBq/m}^3$ $\approx 7.4 \text{ E } -7 \text{ to } 7.4 \text{ E } -1 \text{ MBq/m}^3$	Xe-133 Kr-85 Cs-137 I-131	The dynamic ranges for the indicated isotopes have been selected in order to provide coverage of effluent concentrations based on 10 CFR 20 values for releases to unrestricted areas

**Table 11.5-9**  
**Process Radiation Monitoring System Estimated Dynamic Ranges**

<b>Radiation Monitor</b>	<b>Estimated Dynamic Detection Range</b>	<b>Principal Radionuclides Measured</b>	<b>Basis for Dynamic Range</b>
Plant Stack	$\approx 1 \text{ E } -3 \text{ to } 1 \text{ E } 10 \text{ MBq/m}^3$ $\approx 1 \text{ E } -3 \text{ to } 1 \text{ E } 10 \text{ MBq/m}^3$ $\approx 1 \text{ E } -6 \text{ to } 1 \text{ E } 7 \text{ MBq/m}^3$ $\approx 1 \text{ E } -6 \text{ to } 1 \text{ E } 7 \text{ MBq/m}^3$	Xe-133 Kr-85 Cs-137 I-131	The dynamic ranges have been estimated in order to provide coverage of effluent concentrations over a span equivalent to those listed 10 CFR 20 and RG 1.97
Drywell Fission Product	$\approx 8.1 \text{ E } -8 \text{ to } 8.1 \text{ E } -2 \text{ MBq/m}^3$ $\approx 2.6 \text{ E } -7 \text{ to } 2.6 \text{ E } -1 \text{ MBq/m}^3$ (particulate)	Cs-137 Co-60	The dynamic ranges have been selected to meet the sensitivity requirements of RG 1.45 (Section C.5).
Drywell Fission Product	$\approx 8.1 \text{ E } -3 \text{ to } 8.1 \text{ E } 3 \text{ MBq/m}^3$ $\approx 2.6 \text{ E } -3 \text{ to } 2.6 \text{ E } 3 \text{ MBq/m}^3$ (gaseous)	Xe-133 Kr-85	The dynamic ranges have been selected to meet the sensitivity requirements of RG 1.45 (Section C.5).
Radwaste Building Ventilation Exhaust	$\approx 8 \text{ E } -3 \text{ to } 8 \text{ E } 3 \text{ MBq/m}^3$ $\approx 2.6 \text{ E } -3 \text{ to } 2.6 \text{ E } 3 \text{ MBq/m}^3$ $\approx 7.4 \text{ E } -7 \text{ to } 7.4 \text{ E } -1 \text{ MBq/m}^3$ $\approx 7.4 \text{ E } -7 \text{ to } 7.4 \text{ E } -1 \text{ MBq/m}^3$	Xe-133 Kr-85 Cs-137 I-131	The dynamic ranges for the indicated isotopes have been selected in order to provide coverage of effluent concentrations based on 10 CFR 20 values for releases to unrestricted areas
FB Combined Ventilation Exhaust	$\approx 8 \text{ E } -3 \text{ to } 8 \text{ E } 3 \text{ MBq/m}^3$ $\approx 2.6 \text{ E } -3 \text{ to } 2.6 \text{ E } 3 \text{ MBq/m}^3$ $\approx 7.4 \text{ E } -7 \text{ to } 7.4 \text{ E } -1 \text{ MBq/m}^3$ $\approx 7.4 \text{ E } -7 \text{ to } 7.4 \text{ E } -1 \text{ MBq/m}^3$	Xe-133 Kr-85 Cs-137 I-131	The dynamic ranges have been selected in order to provide coverage of effluent concentrations based on 10 CFR 20 values for releases to unrestricted areas and to indicate the presence of a FUHA in the FB.
TSC HVAC Air Intake	$\approx 8 \text{ E } 0 \text{ to } 8 \text{ E } 4 \text{ MBq/m}^3$ $\approx 1.7 \text{ E } 2 \text{ to } 1.7 \text{ E } 6 \text{ MBq/m}^3$	Xe-133 Kr-85	The dynamic range has been established to provide sufficient coverage to be able to automatically secure the TSC ventilation air intake so that the limitation of 10 CFR 50 Appendix A GDC 19 is not exceeded.

**Table 11.5-9**  
**Process Radiation Monitoring System Estimated Dynamic Ranges**

<b>Radiation Monitor</b>	<b>Estimated Dynamic Detection Range</b>	<b>Principal Radionuclides Measured</b>	<b>Basis for Dynamic Range</b>
Liquid Radwaste Discharge	$\approx 2.1 \text{ E-3 to } 2.1 \text{ E3 MBq/m}^3$ $\approx 1.9 \text{ E-2 to } 1.9 \text{ E4 MBq/m}^3$	Cs-137 Co-60	The dynamic range is established so that the channel is capable of spanning the 10 CFR 20 concentrations in liquid waste for the indicated radionuclides.
Reactor Component Cooling Water Intersystem Leakage	$\approx 4.3 \text{ E-3 to } 4.3 \text{ E3 MBq/m}^3$ $\approx 3.6 \text{ E-3 to } 3.6 \text{ E3 MBq/m}^3$	Cs-137 Co-60	The dynamic range is established to provide measurement coverage of radionuclide concentrations from a fraction of the 10 CFR 20 effluent limits in water to the concentrations caused by a 1 gpm leak from reactor water into the RCCW system.

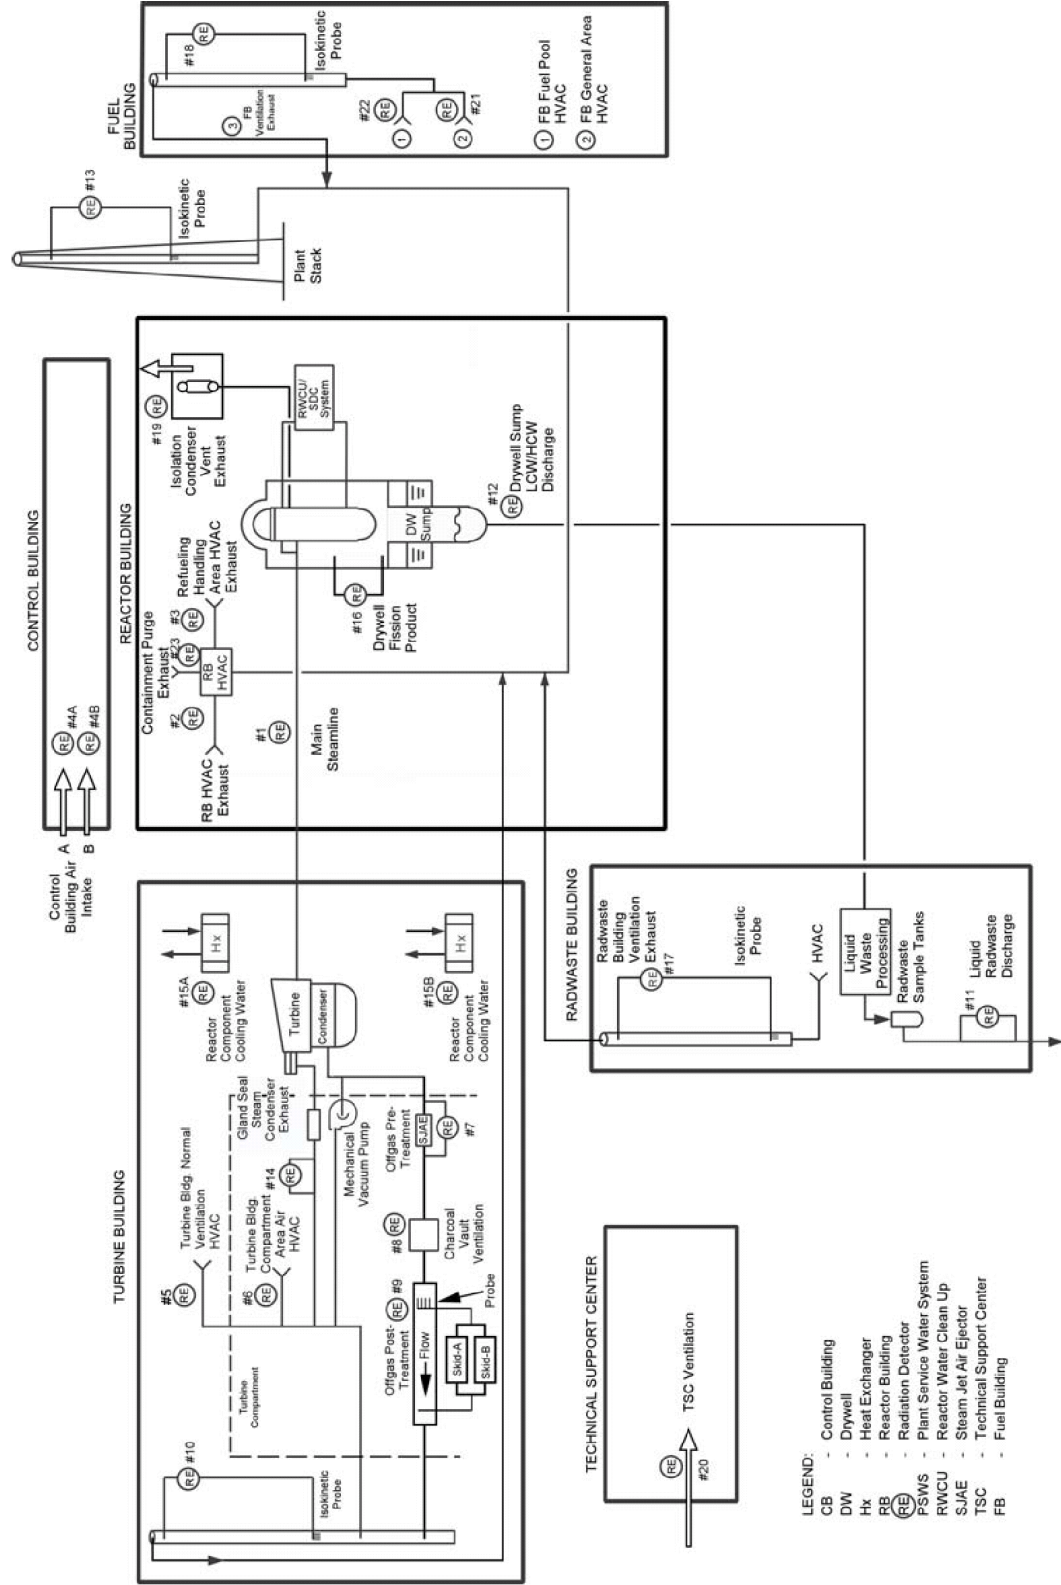
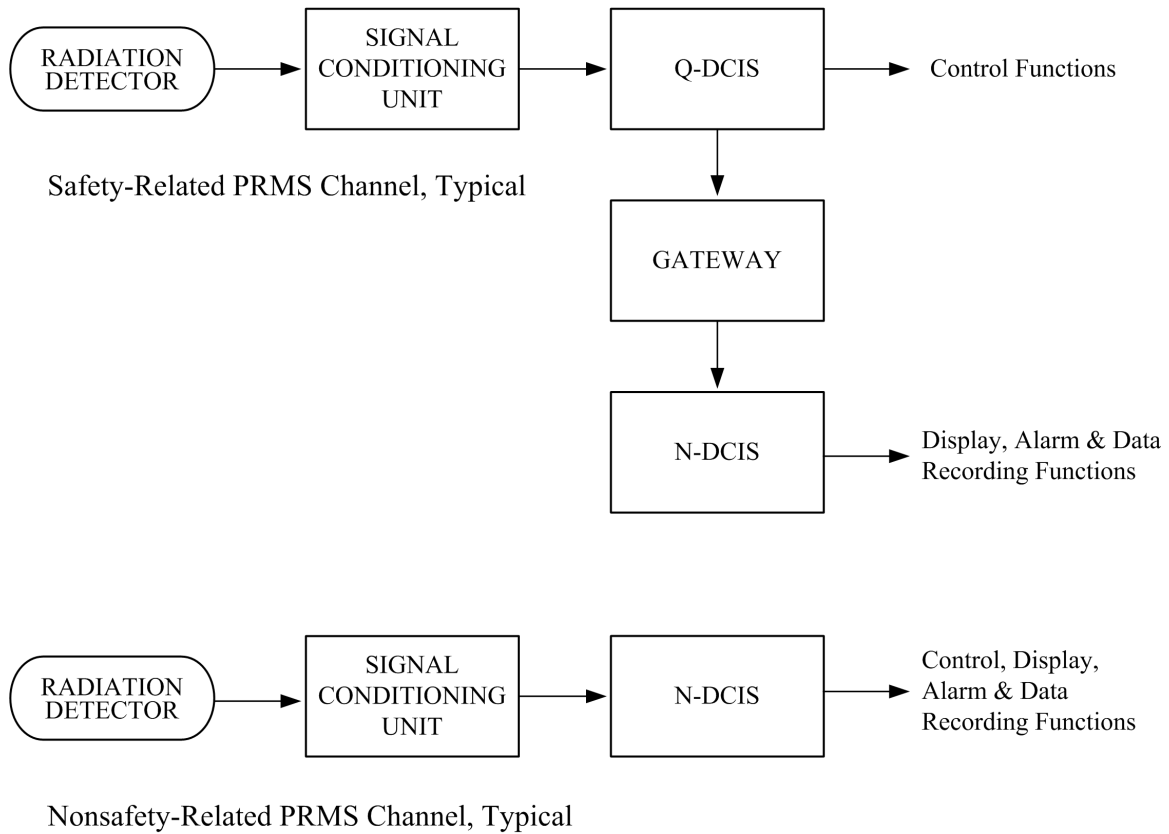


Figure 11.5-1. Location of Radiation Monitors

**Figure 11.5-2. PRMS Channel Block Diagram**