

<b>SEABROOK STATION UFSAR</b>	<p>DESIGN OF STRUCTURES, COMPONENTS EQUIPMENT AND SYSTEMS</p> <p>Pipe Break Analysis Summary</p>	<p>Revision 12 Appendix 3A Page 3A-1</p>
---------------------------------------	--	--

## **APPENDIX 3A      PIPE BREAK ANALYSIS SUMMARY**

### Introduction

This appendix summarizes the results of the failure mode and effects analyses of breaks in high and moderate energy piping systems.

### Summary

#### Main Steam and Feedwater Pipe Chases and Yard

The main steam and feedwater lines are the largest high energy lines located outside Containment, and a rupture in these lines could, therefore, result in more severe environmental conditions locally than any other line outside Containment. The portions of the main steam and feedwater lines in the containment penetration area between the first pipe whip restraint inside Containment and the first pipe whip restraint outside Containment meet all of the requirements of paragraph B.1.b of MEB 3-1, and are excluded from postulation of circumferential ruptures in this area.

In accordance with Branch Technical Position ASB 3-1, paragraph B1.a.(1), longitudinal breaks of the main steam and feedwater lines have been postulated to occur in the penetration areas. A break area of 1.0 square feet has been postulated for this study.

Outside the Containment in the annulus between the containment structure and the containment enclosure, the main steam and feedwater lines are enclosed in guard pipes, composed of the containment penetration sleeves, which prevent pressurization of the Enclosure Building.

The containment penetrations have been designed to withstand without failure the maximum combination of forces and moments that can be transmitted by the attached piping, so that containment boundary integrity would be assured even without the use of pipe rupture restraints. The pipe rupture restraints are designed to prevent pipe rupture forces and moments from being applied to the containment penetrations and the isolation valves and to limit piping stresses to less than the values required by paragraph B.1.b of MEB 3-1, so that pipe ruptures between the inner and outer pipe whip restraints need not be postulated.

<b>SEABROOK STATION UFSAR</b>	<p>DESIGN OF STRUCTURES, COMPONENTS EQUIPMENT AND SYSTEMS</p> <p>Pipe Break Analysis Summary</p>	<p>Revision 12 Appendix 3A Page 3A-2</p>
---------------------------------------	--	--

In the main steam and feedwater pipe chases outside Containment, a maximum temperature of 450°F and pressure of 4.8 psig can be attained as a result of the postulated 1.0 square foot rupture. The P-T effects on essential structures and components have been addressed as follows:

- a. The main steam and feed water valve operators are designed to close the valves in the event of loss of instrument air. In addition, the operators are qualified to operate with the 4.8 psig overpressure.

Direct impingement of steam from a one square foot rupture of the adjacent line would result in mechanical forces and torsion which would not cause failure of the valve body or bonnet, or the attached piping. Possible failure of valve operator solenoids, limit or position switches, or instrument, power, and control cables would not activate the valve because redundant solenoids, switches and instrument, power, and control cables are located on the far side of the valve and are protected by the valve body and operator from direct impingement from the postulated break. A failure of one steam or feedwater line would therefore not result in the loss of function of the other loop.

- b. One emergency feedwater steam supply line is located in each pipe chase, so that a single failure in one chase would not affect the steam supply from the other chase.
- c. A series of seven “blow-out” panels have been incorporated in the design of the upper walls near the roof line of each pipe chase. The panels are designed to blow out at a differential pressure of 0.5 psi to relieve internal pressure following a large high energy line break.
- d. The seismic Category I structure housing the main steam and feedwater pipe chases was analyzed for the temperature and pressure resulting from the 1.0 square foot rupture of the main steam line. It was concluded that the structure can withstand the 450°F and 4.8 psig conditions, concurrent with SSE, without failure.

In the evaluation of temperature response following a Main Steam Line Break outside Containment, a break spectrum initiated from 100% and 70% of maximum analyzed power has been analyzed at the conditions associated with a core power level of 3659 MWt. The break sizes analyzed are 1.0, 0.9, 0.7, 0.6, 0.5, 0.4, 0.3, 0.2, and 0.1 sq. ft. Each main steamline break outside Containment is represented as a non-mechanistic split piping rupture. Prior to steamline isolation, the steam flow is supplied from all four steam generators, through the postulated break area represented by the spectrum noted. After steamline isolation, the steam release through the break is supplied by a single steam generator.

<b>SEABROOK STATION UFSAR</b>	<p>DESIGN OF STRUCTURES, COMPONENTS EQUIPMENT AND SYSTEMS</p> <p>Pipe Break Analysis Summary</p>	<p>Revision 12 Appendix 3A Page 3A-3</p>
---------------------------------------	--	--

UFSAR Section 3.11.2.1 states that, based on a detailed review of the MS&FW pipe chase design, Seabrook Station can achieve a safe shutdown under any postulated superheated temperature profile due to a MSLB. This is achieved principally by the separation criteria conceptually designed into these building areas. Seabrook has two separated MS&FW pipe chase areas exiting the east and west sides of containment. Each pipe chases houses the feedwater and main steam piping for two of the four steam generators. The piping is designed under the concepts of “superpipe” (i.e., low stress allowables and upgraded ISI program). Since the requirement is for a minimum of two steam generators for cooldown, the plant can safely shut down under the postulated MSLB in the MS&FW pipe chase designed with “superpipe,” using the alternate pipe chase.

The MS&FW pipe chase houses the MS&FW containment isolation valves, Main Steam Safety valves, atmospheric dump valves and MS supply valves to the emergency feed pump turbine. This equipment has been Environmentally Qualified to perform its design basis function during a postulated MSLB outside containment.

A flooding study has been performed to establish the maximum water level in the pipe chases. In accordance with BTP ASB 3-1, a one square foot longitudinal break was postulated in the main feedwater line in the east pipe chase which results in the worst case flood with regard to both flood depth and effect on essential equipment. The resulting flood reaches a level 2'-5" above the pipe chase floor. The instrument room in the east chase has been provided with watertight door and cable tray seals to preclude damage to the MSIV panels within. No other essential equipment is affected by this flood. Note that the similar area in the west pipe chase does not contain similar MSIV panels, and flood protection is not required.

Outside Containment and north of the main steam and feedwater pipe chases, pipe whip restraints are located on both the main steam and the feedwater lines. These whip restraints are designed as boundary restraints to prevent any moments or torsion due to a failure in any part of the nonnuclear portions of these lines from being transmitted to the main steam or feedwater isolation valves or to the containment penetrations. The pipe whip restraints are designed to restrain the maximum forces and moments that can be transmitted by the piping without yielding. The load-bearing portions of the piping that pass through these whip restraints consist of heavy-wall forgings with integral lugs to prevent high local stresses and possible pipe wall collapse under pipe rupture loads.

<b>SEABROOK STATION UFSAR</b>	<p>DESIGN OF STRUCTURES, COMPONENTS EQUIPMENT AND SYSTEMS</p> <p>Pipe Break Analysis Summary</p>	<p>Revision 12 Appendix 3A Page 3A-4</p>
---------------------------------------	--	--

Failure of the main steam lines at elevation 40'-2" could result in the impact of the main steam line on the exterior north wall of its respective pipe chase. Impact loading would cause local failure of the wall, generating missiles (spalled concrete) inside the pipe chase, jeopardizing essential main steam and feedwater isolation valves, cable trays and instrumentation. To provide protection for this essential equipment, pipe whip restraints have been provided to protect the building from damage. The whip restraints are equipped with crush pads and are mounted on a concrete beam to distribute rupture loading into nearby perpendicular walls. Postulated failures in the feedwater lines in this area do not result in unacceptable consequences.

On the east side of the Containment, the nonnuclear portions of the main steam and feedwater lines are run on elevated supports, and no other safety-related equipment is located in the area.

On the west side of the Containment, the nonnuclear portions of the main steam and feedwater lines run on elevated supports adjacent to the east wall of the Control Building. It was determined by analysis, that a split in the main steam line which runs nearest to the control building wall could cause jet impingement which might result in failure of the two-foot thick reinforced concrete wall, with formation of missiles inside the Control Building. These missiles could jeopardize the safety-related electrical trays in the southeast corner of the building, as well as the motor generator sets. To avoid this problem, this line is sleeved from the point at which it leaves the pipe whip restraints north to a point beyond which missiles would cause no problem, a distance of about sixteen feet vertically and twenty-two feet horizontally. Analysis has shown that rupture of the other high energy lines in this area would cause no unacceptable effects.

Failure of the main steam or feedwater lines on the west side of the Containment where they run along the Turbine Building could result in impact of the ruptured lines on the northeast corner of the Control Building, with the possible generation of missiles that could damage safety-related electrical trays in the Control Building. In order to prevent this effect, a pipe whip restraint bumper has been provided to prevent damage to the control building wall. This bumper is equipped with energy absorbing crush pads and beams to distribute pipe rupture loads to nearby perpendicular walls to prevent panel fracture of the control building wall in this area in the event of a rupture of any of these high energy lines.

Guillotine ruptures inside the Turbine Building would impose blowdown forces on the manifolds in the south direction which would be resisted by the entire piping system inside the Turbine Building and, thus, no impact on the Emergency Feedwater Pump house is postulated.

<b>SEABROOK STATION UFSAR</b>	<p>DESIGN OF STRUCTURES, COMPONENTS EQUIPMENT AND SYSTEMS</p> <p>Pipe Break Analysis Summary</p>	<p>Revision 12 Appendix 3A Page 3A-5</p>
---------------------------------------	--	--

### Containment Enclosure and Penetration Area

In the containment enclosure and associated buildings (penetration area), a failure of the chemical and volume control system letdown line, CS-360-9-3" would cause the most severe environmental conditions (see Appendix 3I), but all essential equipment in this area is qualified to operate in a more severe environment, and no failures due to temperature, pressure or humidity are anticipated.

A terminal end rupture of lines CS-328-3-2", CS-329-1-2", CS-330-1-2", CS-331-1-2" or CS-335-1-3" could result in a spray of water at 130°F on nearby essential valve operators 2" CS-V-162, 2" CS-V-166, 3" CS-V-142, 3" CS-V-143, 8" RH-V-20, CS-V-167, 2" CS-V-158, or 2" CS-V-154 and on rack MM-1R-12. The impingement force of the water would be insufficient to damage the valve operators or the rack. Wetting due to the water spray would not cause failure of the valve operators, but could cause a short-circuit failure of the rack's electrical connections. Since the rack does not contain any equipment required for safe shutdown of the nuclear reactor, failure of the electrical connections would be acceptable (see Table 3.6(B)-1).

Rupture of the large component cooling water lines would cause flooding of the lower levels, but pressure and flow monitors would alert the operator that a problem existed. The system inventory is limited to the contents of the piping and the head tank, so that flooding to the elevation of the essential equipment in instrument rack MM-1R-13A is not possible, even if no operator action is taken.

Rupture of the small high energy lines in the area can cause flooding, but each system is provided with pressure and flow monitoring instrumentation that would alert the operator in the event of a rupture of a line. The operator would have sufficient time to isolate the leaking line in any case.

### Primary Auxiliary Building and Equipment Vaults

In the Primary Auxiliary Building, the worst environmental conditions would occur from a postulated rupture of the 6" auxiliary steam line break in Zone 33C, which could result in an ambient temperature of 249°F and a pressure of 0.20 psig. All electrical equipment in the PAB which is essential for safe plant shutdown is capable of performing its intended function while exposed to this environment.

Rupture of the large component cooling, reactor makeup water and containment spray lines could result in flooding of the sumps in the equipment vaults. Pressure and flow indicators in each system would alert the operator that a problem existed, so that action to isolate the ruptured line could be taken. The sump high level indicators would also alert the operator that flooding existed.

<b>SEABROOK STATION UFSAR</b>	<p>DESIGN OF STRUCTURES, COMPONENTS EQUIPMENT AND SYSTEMS</p> <p>Pipe Break Analysis Summary</p>	<p>Revision 12 Appendix 3A Page 3A-6</p>
---------------------------------------	--	--

Uncorrected flooding of one equipment vault might result in loss of function of the equipment in the vault. In this case, the redundant equipment in the other vault would be available for safe plant shutdown.

#### Other Buildings

Rupture of the hot water heating lines in the Diesel Generator Building, Emergency Feedwater Pumphouse, Service Water Pumphouse and Control Building, would result in short-term elevations of temperature to a maximum of 127°F for 3 minutes. Relative humidity would approach 100 percent, but no flooding would occur because of the limited hot water inventory in the heating system.

<b>SEABROOK STATION UFSAR</b>	DESIGN OF STRUCTURES, COMPONENTS EQUIPMENT AND SYSTEMS  Deleted	Revision 8 Appendix 3B Page 3B-1
---------------------------------------	--	--

**APPENDIX 3B      (DELETED IN AMENDMENT 57)**

<b>SEABROOK STATION UFSAR</b>	Design of Structures, Components Equipment and Systems Procedure For Evaluating Jet Impingement Loads From High Energy Piping Failures	Revision 8 Appendix 3C Page 3C-1
---------------------------------------	--	--

**APPENDIX 3C      PROCEDURE FOR EVALUATING JET IMPINGEMENT LOADS  
FROM HIGH ENERGY PIPING FAILURES**

The information contained in this appendix was not revised, but has been extracted from the original FSAR and is provided for historical information.

## CONTENTS

1.	INTRODUCTION	1
2.	REQUIRED INPUT INFORMATION	3
3.	JET IMPINGEMENT FORCES	4
3.1	BLOWDOWN FORCE	4
3.2	FULL JET IMPINGEMENT LOAD	5
3.3	JET IMPINGEMENT PRESSURE	6
3.4	JET IMPINGEMENT AREA	7
3.5	JET IMPINGEMENT ENVELOPE	9
4.0	REFERENCES	21

## 1. INTRODUCTION

The scope of this guide is to establish convenient but conservative methods of computing fluid jet impingement loads on structures, components and systems due to postulated ruptures in high energy piping (i.e., piping systems where the maximum normal operating temperature exceeds 200°F, or where the maximum normal operating pressure exceeds 275 psig) (REF. 4), inside as well as outside the reactor containment building in accordance with REF. 5. Only mechanical impingement loads have been considered, thermal shock loads due to high energy fluid jets have not been covered by this guide. The jet impingement loads given in this guide are equivalent static loads, based on the conservative assumption that a target encountering the jet remains elastic.

A list of minimum input data required to assess the consequences of jet impingement on essential components is provided.

Simplified techniques of computing conservative values of jet impingement loads, areas, pressures and envelopes are presented for both circumferential and longitudinal type of pipe failures. For each case, an illustrated example is given.

If the simplicity and, therefore, the inherent conservatism of the jet impingement criteria given in this guide result in

unacceptable and/or uneconomical jet impingement protection designs, it is recommended that rigorous analysis be performed. Such analysis should include elasto-plastic behavior of the target, non-homogeneous nature of jet, interaction between the jet and its environment, and drag effect due to the shape of the target.

## 2. REQUIRED INPUT INFORMATION

To determine jet impingement loads on essential structures, systems and components or on such structures, systems and components as may adversely affect essential items, the following is prerequisite information:

- (a) Composite drawings of high energy piping and safety related target structure, systems and components.
- (b) Locations and types of postulated break points for each high energy piping, and
- (c) State of high energy piping fluid, fluid pressure and pipe data.

### 3. JET IMPINGEMENT FORCES

#### 3.1 BLOWDOWN FORCE

For steady state flow, neglecting fluid friction in pipe, the blowdown force  $F_B$  (see Fig. 1) acting on the discharging pipe segment is given by (REF. 1),

$$F_B = K(p - p_{\infty})A \quad \dots\dots(1)$$

where:

$K$  = thrust factor (1.26 for flashing and partially flashing fluids and 2.0 for sub-cooled fluids)

$p$  = fluid pressure in pipe

$p_{\infty}$  = ambient pressure around the target

$A$  = area of jet opening

Area of jet opening for longitudinal breaks and also for circumferential breaks on unrestrained pipes (Fig. 8) is assumed to be equal to the internal cross sectional area of the pipe. However, if the pipe is axially restrained, then in case of a circumferential break the broken ends of the pipe will separate by circular width  $B$ , effecting a fan jet, and the jet opening area will be given by,

$$A = \pi DB$$

where:

D = inside diameter of pipe

B = distance between broken ends of pipe

Value of B for a given case depends upon the pipe geometry, pipe material and properties, restraint stiffnesses and fluid characteristics; and can be determined by dynamic or static analysis of the system including piping and restraints.

### 3.2 FULL JET IMPINGEMENT LOAD

Whenever a discharging jet encounters a target object in its path, the momentum of some fluid particles is changed and an impingement force is developed. Impingement load characteristics depend upon target shape, projected area, and orientation relative to the jet, as well as jet cross sectional area and flow properties. However, the simple model shown in Fig. 1 is used to estimate jet loads on target(s) encountered in a nuclear power plant.

The jet discharges from an open pipe with jet opening area A and expands to an area  $A_{\infty}$  at some distance L, where it is assumed to be homogeneous. Forward motion of the jet is stopped

by the target shown and the net rightward jet impingement force on the target is therefore

$$R_j = p_i A_\infty \quad \dots\dots(2)$$

where:

$p_i$  = uniform impingement pressure on the target

$A_\infty$  = area of fully expanded jet at the target

If momentum and shear interactions between the jet and its environment are assumed to be negligible then, forward momentum conservation for the jet at any location throughout its travel leads to an equality of blowdown force  $F_B$  and total jet force  $R_j$ . Equivalent static jet impingement force on the target is therefore also given by

$$R_j = 2 K(p-p_\infty)A \quad \dots\dots(3)$$

### 3.3 JET IMPINGEMENT PRESSURE

When a system or component encounters only a part of the jet, it is useful to know the impingement pressure to compute the total jet load acting on such a target. From equations (2) and (3), the impingement pressure,

$$p_i = \frac{2K(p-p_\infty)A}{A_\infty} \quad \dots\dots(4)$$

The jet impingement load on a target with area  $A_t$  which does not encounter full jet (i.e.  $A_t < A_\infty$ ) is given by

$$R_t = \frac{2K(p-p_\infty)A_t}{A_\infty} \quad \dots\dots(5)$$

### 3.4 JET IMPINGEMENT AREA

Full jet impingement area  $A_\infty$  can be determined if distance  $L$  of the target from the jet opening and the shape and size of the jet opening are known. A conservative value of  $10^\circ$  (REF. 3) can be used for jet expansion half-angle  $\theta$ . The shape and size of jet opening are governed by the pipe size and the type of postulated pipe failure.

### CIRCUMFERENTIAL BREAK

UNRESTRAINED PIPES: Circumferential breaks are perpendicular to the longitudinal axis of the pipe. Total separation of the pipe at the postulated break point is assumed. For unrestrained pipes the break area is therefore equal to internal cross sectional area of the pipe (REF. 2).

The following equation gives full jet impingement area (Fig. 2)

$$A_{\infty} = 0.25\pi(D + 2L \tan\phi)^2 \quad \dots\dots(6)$$

where:

D = inside diameter of the pipe

L = distance of the target from the jet opening

$\phi$  = expansion half-angle of the jet (=10°)

56

Graph given in Fig. 5 can be used to determine the impingement area  $A_{\infty}$  for known values of L and D.

RESTRAINED PIPES: Full impingement area of the fan jet due to a postulated circumferential break in a restrained pipe (Fig. 3) is given by

$$A_{\infty} = 2\pi(L + 0.5D)(B + 2L \tan\phi) \quad \dots\dots(7)$$

where:

B = distance between the broken ends of the pipe  
(see sub-section 3.1)

Graph given in Fig. 6 can be used to determine circular impingement area  $A_{\infty}$  for known values of L, D and B.

### LONGITUDINAL BREAK

Longitudinal breaks are parallel to the axis of the pipe and are oriented at any point around the circumference, (REF. 2). The jet axis is therefore perpendicular to pipe axis. The break area is assumed equal to internal cross sectional area of the pipe and the shape of the break is assumed to be rectangular so that the long side of the rectangle is parallel to pipe axis and is equal to twice the inside diameter of the pipe.

Full jet impingement area on a normal target plane (Fig. 4) is given by

$$A_{\infty} = (2D + \Delta_1) \left( \frac{\pi D}{8} + \Delta_1 \right) \quad \dots\dots(8)$$

$$\text{where } \Delta_1 = 2L \tan \phi.$$

Graph given in Fig. 7 can be used to determine full jet impingement area  $A_{\infty}$  for known values of L and D.

If the jet axis is not normal to the target plane, and makes an angle  $\theta$  to the normal direction, then the full jet impingement area on the target plane is given by:

$$A = (2D + \Delta_2) \left( \frac{\pi D}{8} + \Delta_2 \right) / \cos \theta, \quad \dots\dots(9)$$

$$\text{where } \Delta_2 = 2L \tan \phi / \cos \theta$$

### 3.5 JET IMPINGEMENT ENVELOPE

An area of the target structure larger than the full impingement area A may be affected due to the motion of the unrestrained

broken pipe following a circumferential break. Such an area is called jet impingement envelope. It is generally not applicable to longitudinal breaks where pipe displacement is limited.

56

#### CIRCUMFERENTIAL BREAK

In case of a circumferential break due to unrestrained motion of the broken end of the pipe, the impinging jet will traverse a larger area of the target structure. In Fig. 8, first the wall and then the floor will encounter the jet force from point a to point i as the broken pipe swings from position 1 to position n.

Jet impingement envelope then can be developed by determining full jet impingement areas at the wall and floor according to initial position, some selected intermediate positions, and the final position of the broken end of the pipe in motion, (i.e. positions 1,2,3,.....,n). The locations and magnitude of jet impingement loads will vary from points a to i, depending upon the distance between the source of the jet and the target structure, and the inclination of the target structure to the jet axis, at any given instant.

PAGE 11 OF APPENDIX 3C

DELETED

IN AMENDMENT 56

---

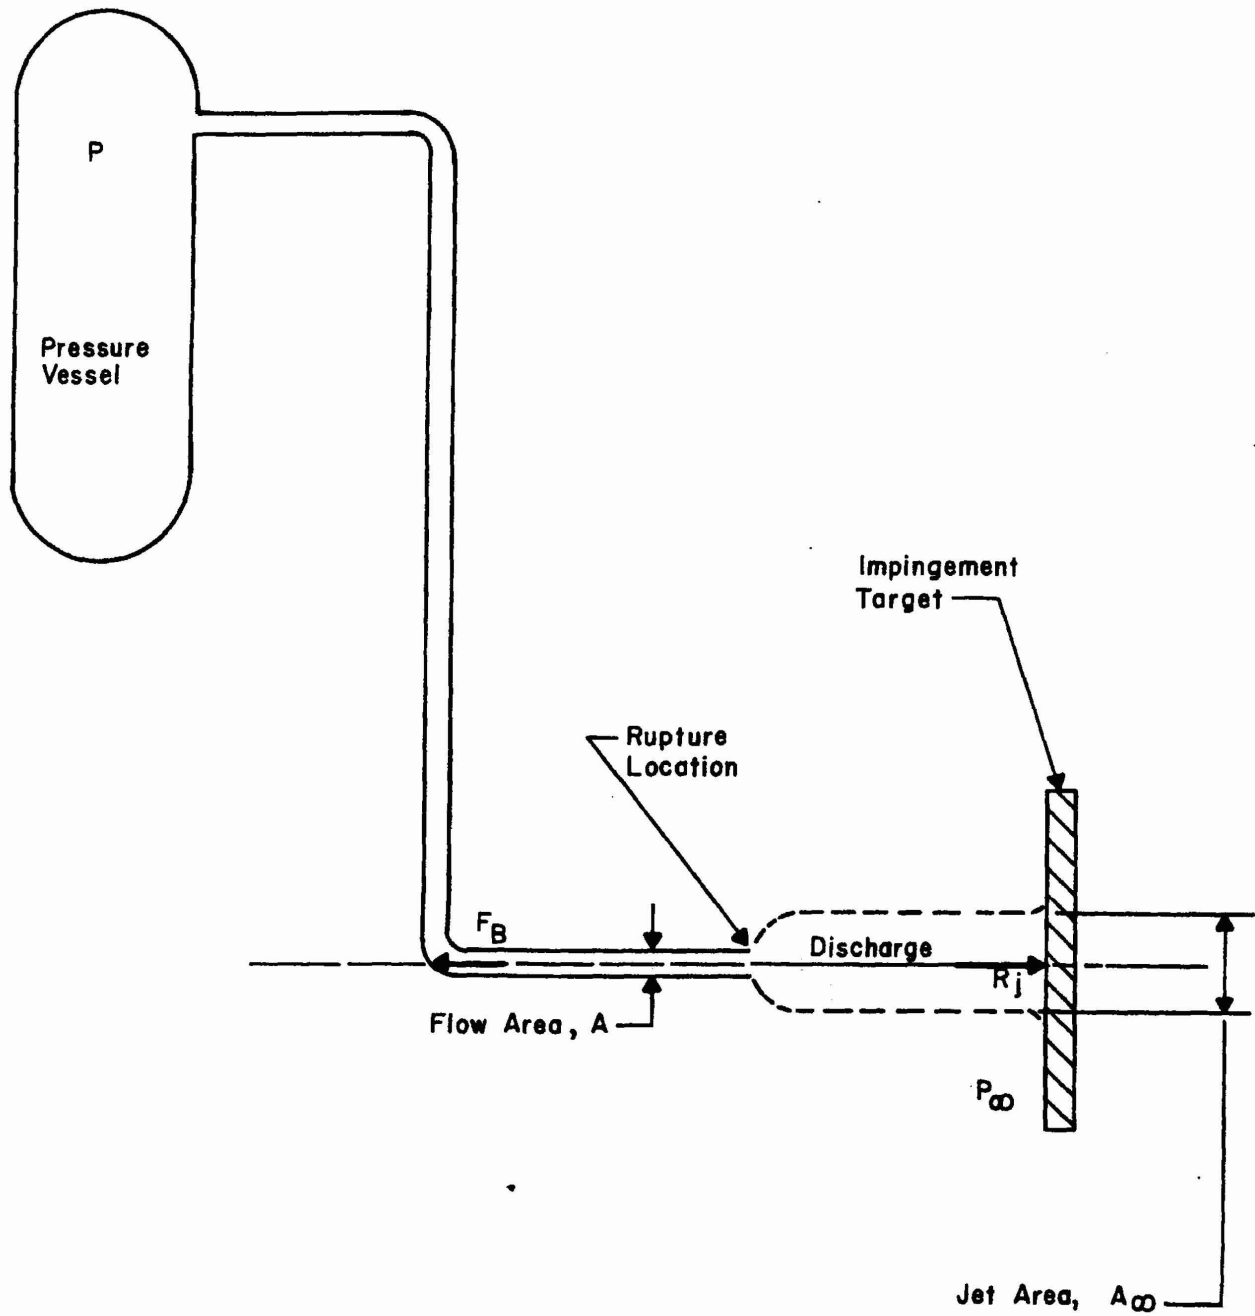


FIGURE 1  
GENERAL MODEL

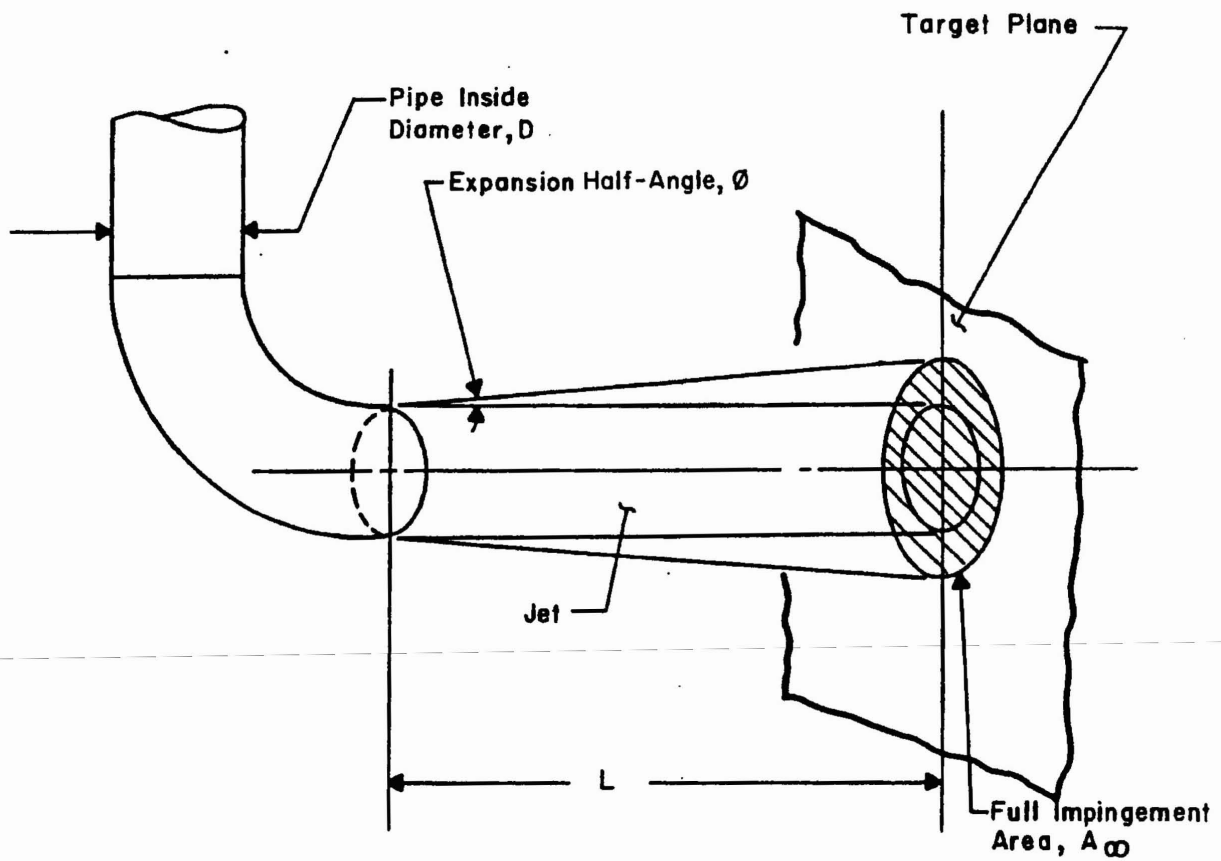


FIGURE 2  
FULL IMPINGEMENT AREA - CIRCUMFERENTIAL BREAK  
UNRESTRAINED PIPE

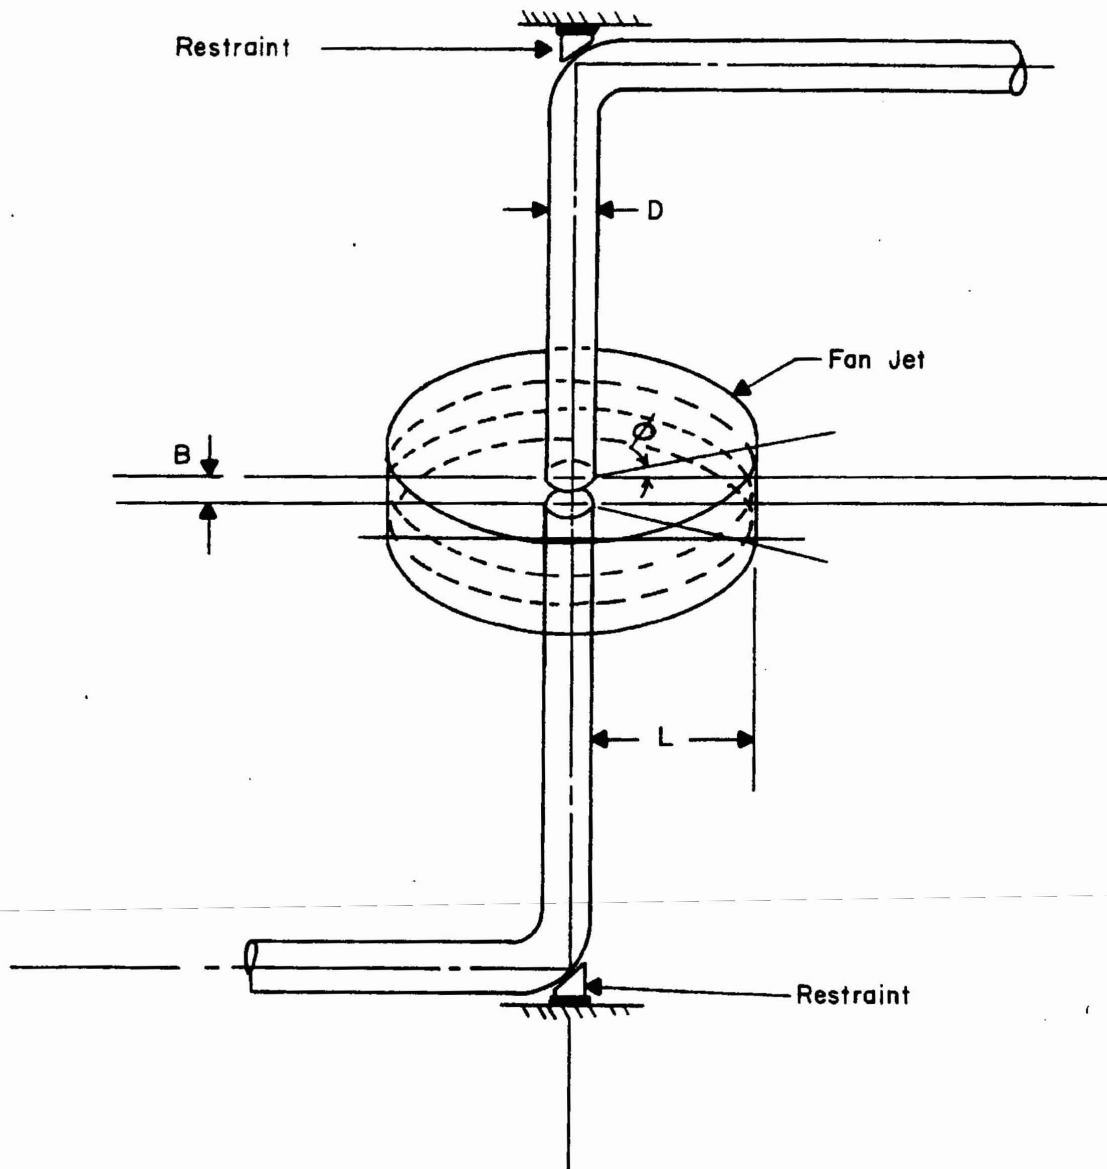


FIGURE 3  
FULL IMPINGEMENT AREA - CIRCUMFERENTIAL BREAK  
RESTRAINED PIPE

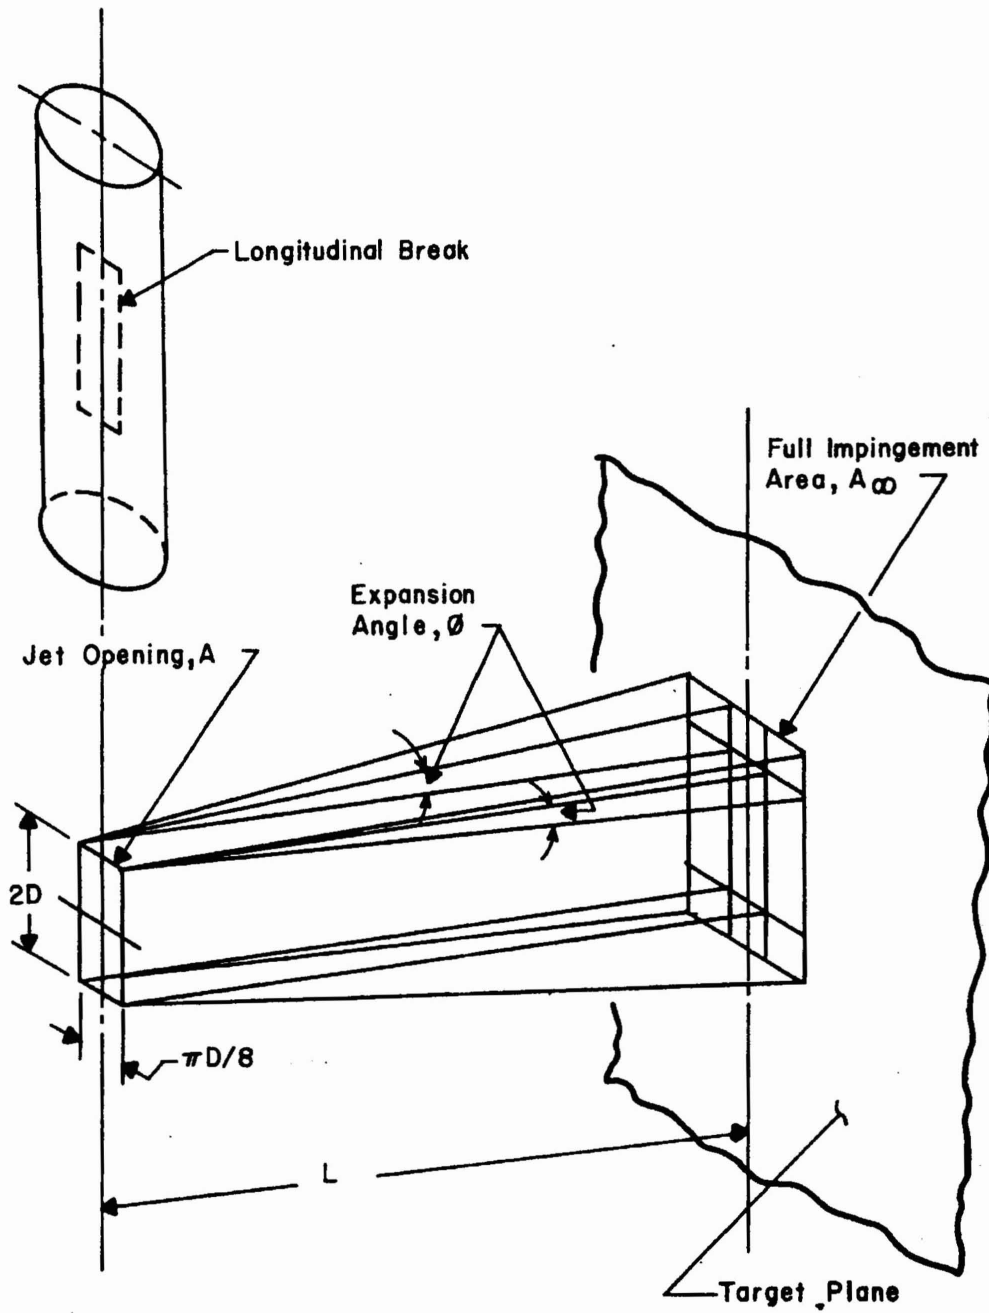


FIGURE 4  
JET IMPINGEMENT AREA- LONGITUDINAL BREAK

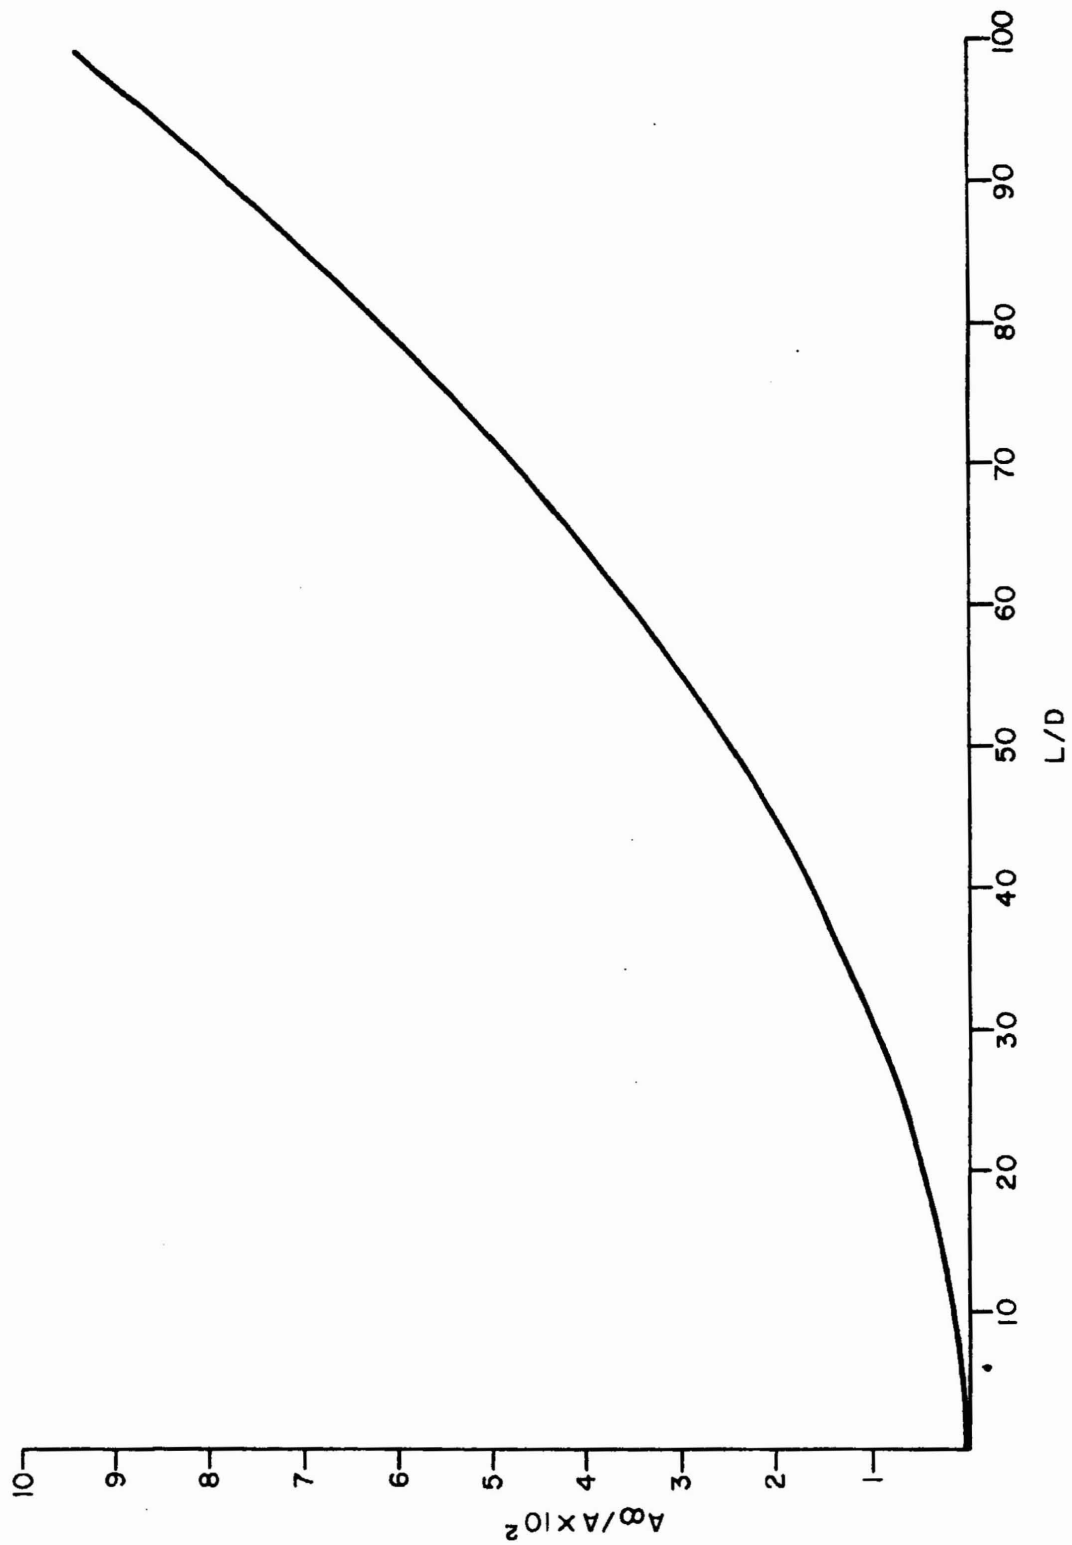


FIGURE 5  
JET IMPINGEMENT AREA - CIRCUMFERENTIAL BREAK  
UNRESTRAINED PIPE

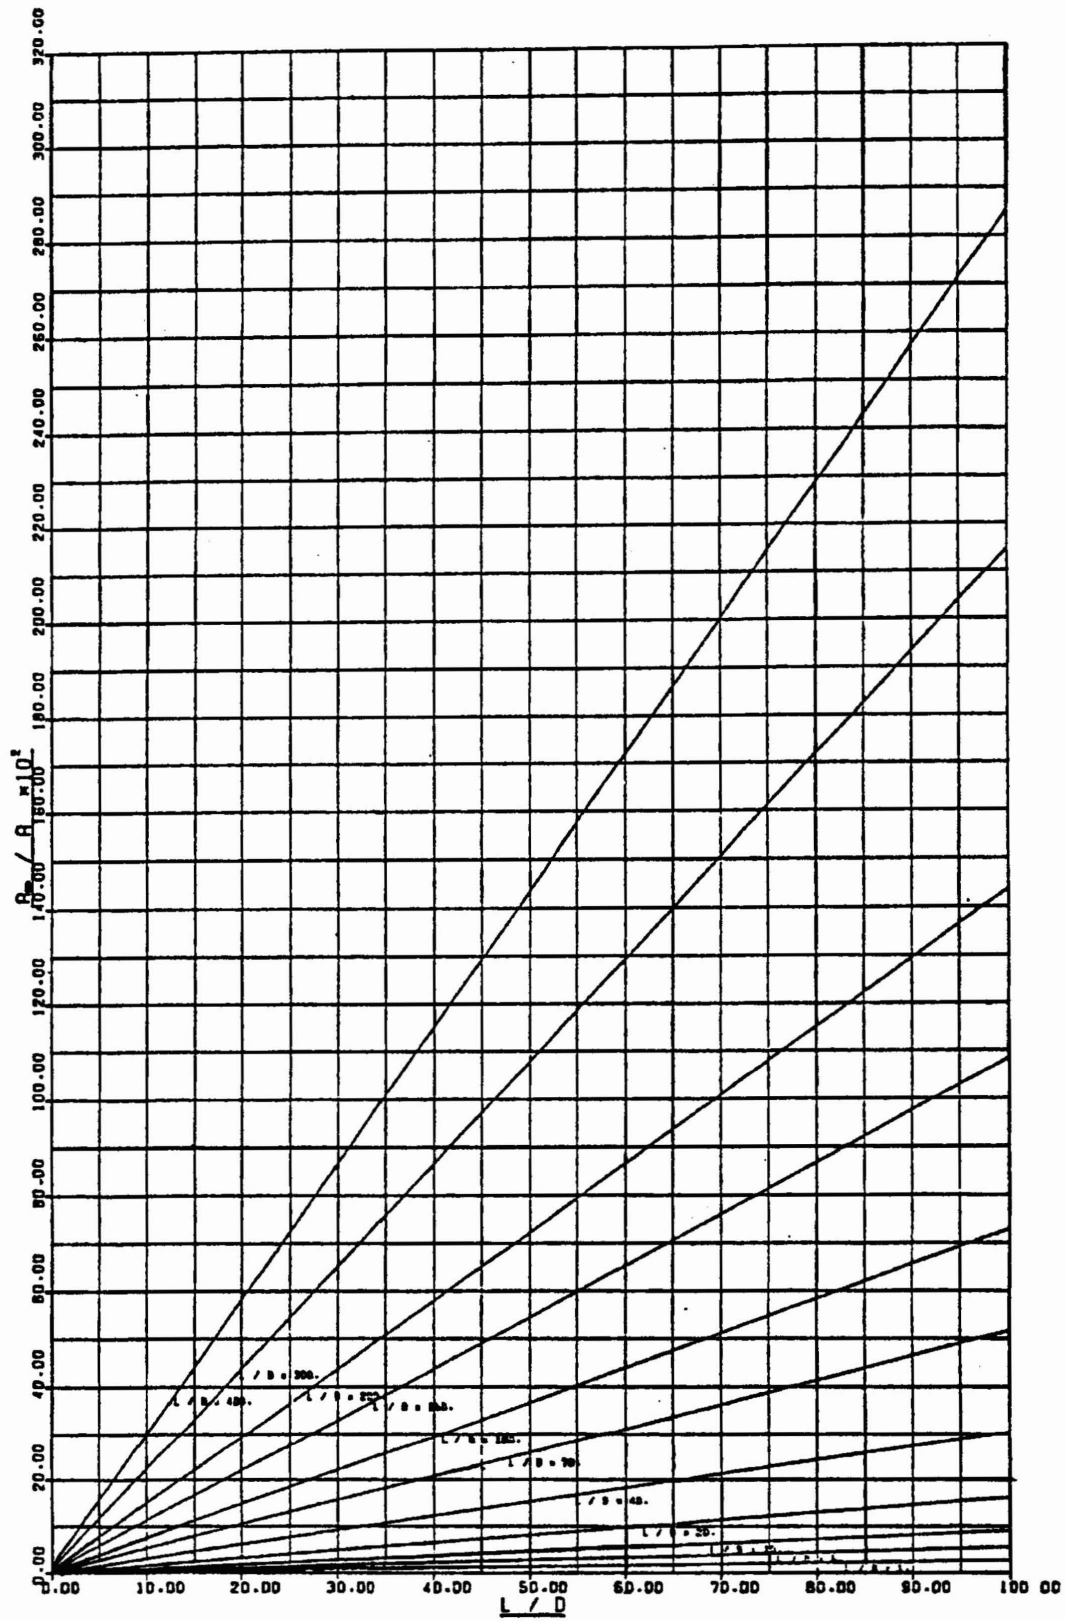


FIGURE 6  
JET IMPINGEMENT AREA - CIRCUMFERENTIAL BREAK  
RESTRAINED PIPE

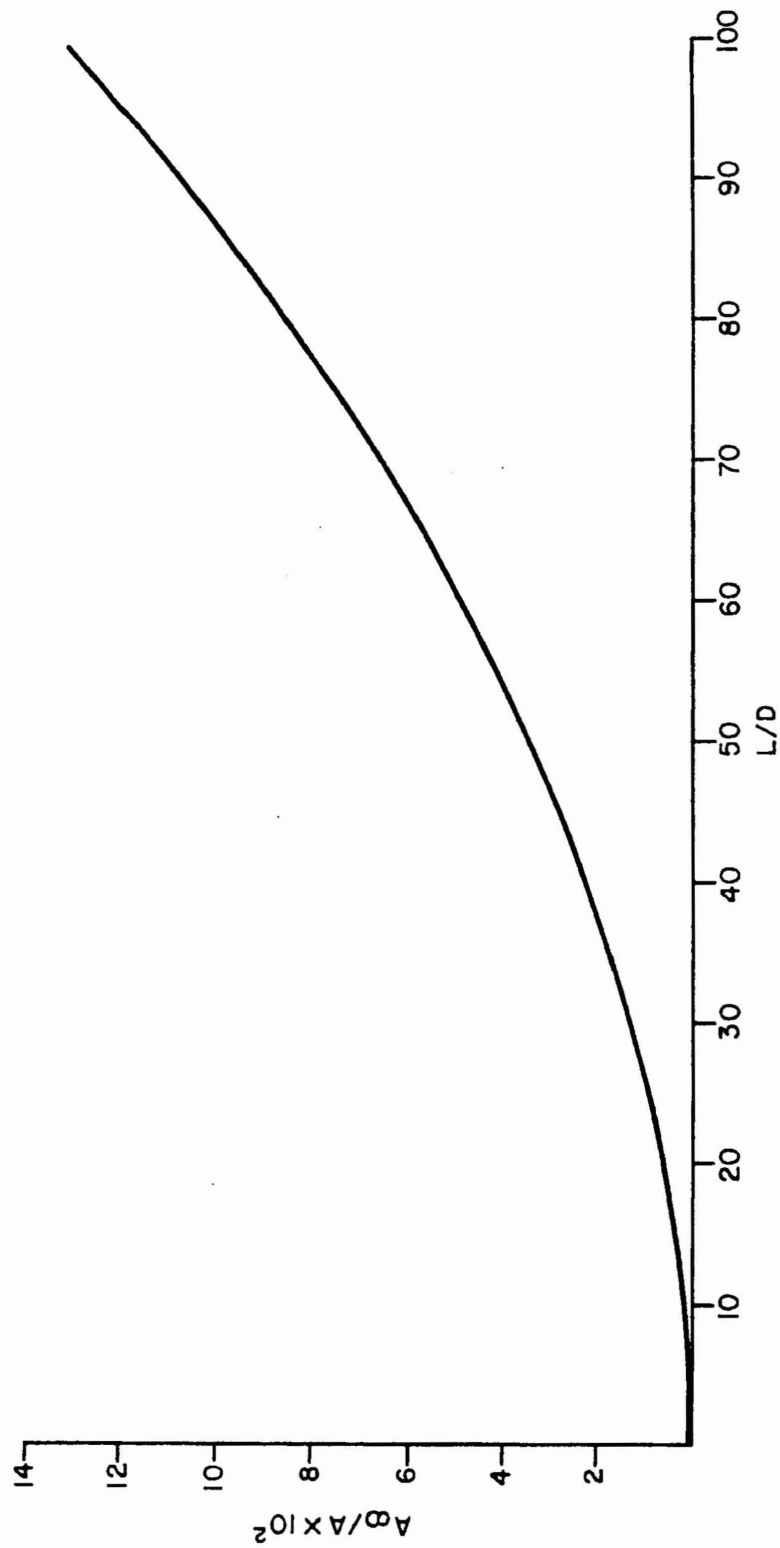


FIGURE 7  
JET IMPINGEMENT AREA- LONGITUDINAL BREAK



PAGE 20 OF APPENDIX 3C

DELETED

IN AMENDMENT 56

---

4. REFERENCES

1. F.J. MOODY, "Prediction of Blowdown Thrust and Jet Forces", ASME Publication No. 69-HT-31, May 1969.
  2. Regulatory Guide 1.46, "Protection Against Pipe Whip Inside Containment", Directorate of Regulatory Standards, U.S. Atomic Energy Commission.
  3. ANSI N176, "Design Basis for Protection of Nuclear Power Plants against Effects of Postulated Pipe Failures", ANS-58.2, American Nuclear Society, May 1975.
-

<b>SEABROOK STATION UFSAR</b>	Design of Structures, Components Equipment and Systems  Procedure For Calculating Elasto-Plastically Designed Pipe Whip Resistant Loads By Energy Balance Method	Revision 8  Appendix 3D  Page 3D-1
---------------------------------------	---	--

**APPENDIX 3D      PROCEDURE FOR CALCULATING ELASTO-PLASTICALLY  
DESIGNED PIPE WHIP RESTRAINT LOADS BY ENERGY  
BALANCE METHOD**

The information contained in this appendix was not revised, but has been extracted from the original FSAR and is provided for historical information.

A simplified mathematical model as shown on the next page can be used for elastic-plastic design of pipe whip restraints. An energy balance approach has been used to formulate the calculations for determining the plastic deformation in the restraints.

In applying the plastic deformation design for restraints, the regulatory guides require that either one of the following upper bound design limits for metallic ductile materials be met.

- (a) 50% of the minimum ultimate uniform strain (the strain at the maximum stress of an engineering stress-strain curve based on actual material tests for the restraint), or
- (b) 50% of the minimum percent elongation as specified in an applicable ASME, ASTM, etc. Code, specification, or standard when demonstrated to be less than 50% of the minimum ultimate uniform strain based on representative test results.

Simplified approach for designing elasto-plastic restraints

If the restraint is allowed to go into the plastic region, then the maximum restraint deflection,  $d_{\max}$ , will consist of an elastic portion and a plastic portion as shown below. (Figure 1.0)

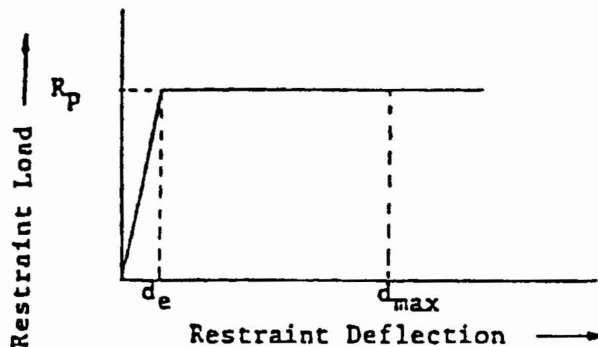


Figure 1.0 - Idealized Restraint Deflection Characteristics.

where,  $d_e$  = Restraint elastic deflection at yield stress  
 $d_{\max}$  = Maximum allowable restraint deflection  
 $R_p$  = Maximum restraint resistance  $R_p = k_e d_e$   
 $k_e$  = Restraint elastic structural stiffness

If 'F' denotes the applied forcing Function (i.e., a blow down load in case of a pipe break) and 'h' denotes the gap between the piping and the restraint, an energy balance relation for this case gives, (see Figure 2.0).

$$\begin{aligned} F(h + d_{\max}) &= \frac{1}{2} R_p d_e + R_p (d_{\max} - d_e) \\ &= R_p (d_{\max} - \frac{d_e}{2}) \end{aligned}$$

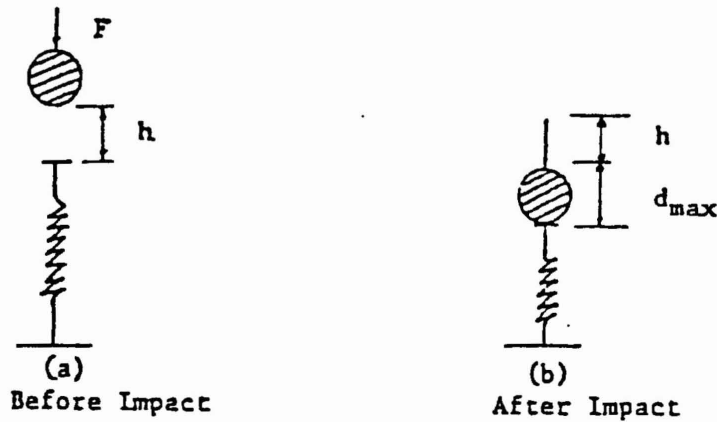


Figure 2.0 Energy balance Analysis Model

Rearranging,  $(R_p - F) d_{\max} = \frac{1}{2} (2Fh + R_p d_e)$

Therefore,  $d_{\max} = \frac{2Fh + R_p d_e}{2 (R_p - F)} \quad - - (1)$

The above formulation can be further simplified in  $2Fh$  is much larger than  $R_p d_e$ .

Therefore, assuming,  $R_p d_e \ll 2Fh$

Equation (1) gives,  $d_{\max} = \frac{Fh}{(R_p - F)} \quad - - - (2)$

After determining  $d_{\max}$ , either by equation (1) or equation (2) above

(as applicable), the resulting strain in the member should be calculated and should be checked against the criteria give in page 1.

For uniaxial members, the strain  $\epsilon$  is taken to be equal to  $\frac{d_{\max}}{L}$ ,

where  $L$  is the original length of the restraint member.

SB 1 & 2  
FSAR

Amendment 56  
November 1985

Pages 4 and 5

Deleted in Amendment 56

---

<b>SEABROOK STATION UFSAR</b>	Design of Structures, Components Equipment and Systems  Procedure For Calculating Elasto-Plastically Designed Pipe Whip Resistant Loads By Equivalent Static Analysis Method	Revision 8  Appendix 3E  Page 3E-1
---------------------------------------	---	--

**APPENDIX 3E      PROCEDURE FOR CALCULATING ELASTO-PLASTICALLY  
DESIGNED PIPE WHIP RESTRAINT LOADS BY EQUIVALENT  
STATIC ANALYSIS METHOD**

The information contained in this appendix was not revised, but has been extracted from the original FSAR and is provided for historical information.

SB 1 & 2  
FSAR

APPENDIX 3E

PROCEDURE FOR CALCULATING  
ELASTICALLY DESIGNED PIPE  
WHIP RESTRAINT LOADS

BY

EQUIVALENT STATIC ANALYSIS METHOD

PREPARED BY:

*Fred Jan* 11/29/77  
F. JAN  
MECHANICAL ANALYSIS GROUP

REVIEWED BY:

*R. F. Perry* 11/29/77  
R. F. PERRY  
MECHANICAL ANALYSIS GROUP

APPROVED BY:

*G. Rigamonti*  
G. RIGAMONTI, ACTING MANAGER  
MECHANICAL ANALYSIS GROUP

In order to evaluate the response of an elastically designed pipe whip restraint to a pipe break load by using the equivalent static analysis approach, the dynamic load factor associated with the applicable forcing function and the clearance (gap) between the pipe and the restraint has to be determined.

A simplified mathematical model as shown on the next page, can be used to determine the dynamic load factor. Since the pipe size effects are already being reflected in the magnitude of the pipe break load, the pipe size alone is not considered again as a model parameter. The dynamic load factor (DLF) thus determined is used to calculate the restraint load (R) as follows:

$$R = (\alpha PA) \times DLF$$

where:  $\alpha = \begin{cases} 1.26 & \text{for steam-saturated water} \\ 2.0 & \text{for subcooled non-flashing water} \end{cases}$  [Ref. U.S. NRC  
Standard Review Plan, 3.6.2 (III) (2) (c) (4)]

P = Operating Pressure

A = Pipe Break Area

A series of parametric curves for determining the restraint loads for steam-saturated water or steam-water mixtures only are given in Pages 3 - 14.

A SIMPLE MODEL FOR COMPUTING DYNAMIC LOAD FACTOR

$$d_{st} = \frac{F}{k} \quad (1)$$

$$F(h + d) = 1/2 k d^2 \quad (2)$$

$$\text{From (1)} \quad k = \frac{F}{d_{st}} \quad (3)$$

By substituting (3) into (2), we have

$$F(h + d) = 1/2 \left( \frac{F}{d_{st}} \right) d^2$$

$$d^2 - 2 d_{st} d - 2 d_{st} h = 0$$

Or,

$$\left( \frac{d}{d_{st}} \right)^2 - 2 \left( \frac{d}{d_{st}} \right) - 2 \left( \frac{h}{d_{st}} \right) = 0$$

$$DLF = \frac{d}{d_{st}} = 1 + \left[ 1 + \frac{2h}{d_{st}} \right]^{1/2} = 1 + \left[ 1 + \frac{2hk}{F} \right]^{1/2}$$

Where,

$F$  = Applied Load = (Pipe Rupture Load)


$d_{st}$  = Restraint deflection for statically applied  $F$


$d$  = Maximum restraint deflection


$h$  = Gap size


$k$  = Restraint stiffness


$DLF$  = Dynamic load factor

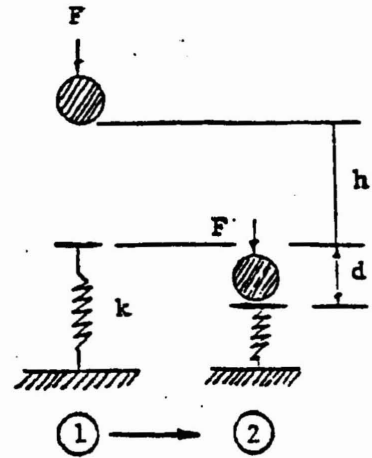


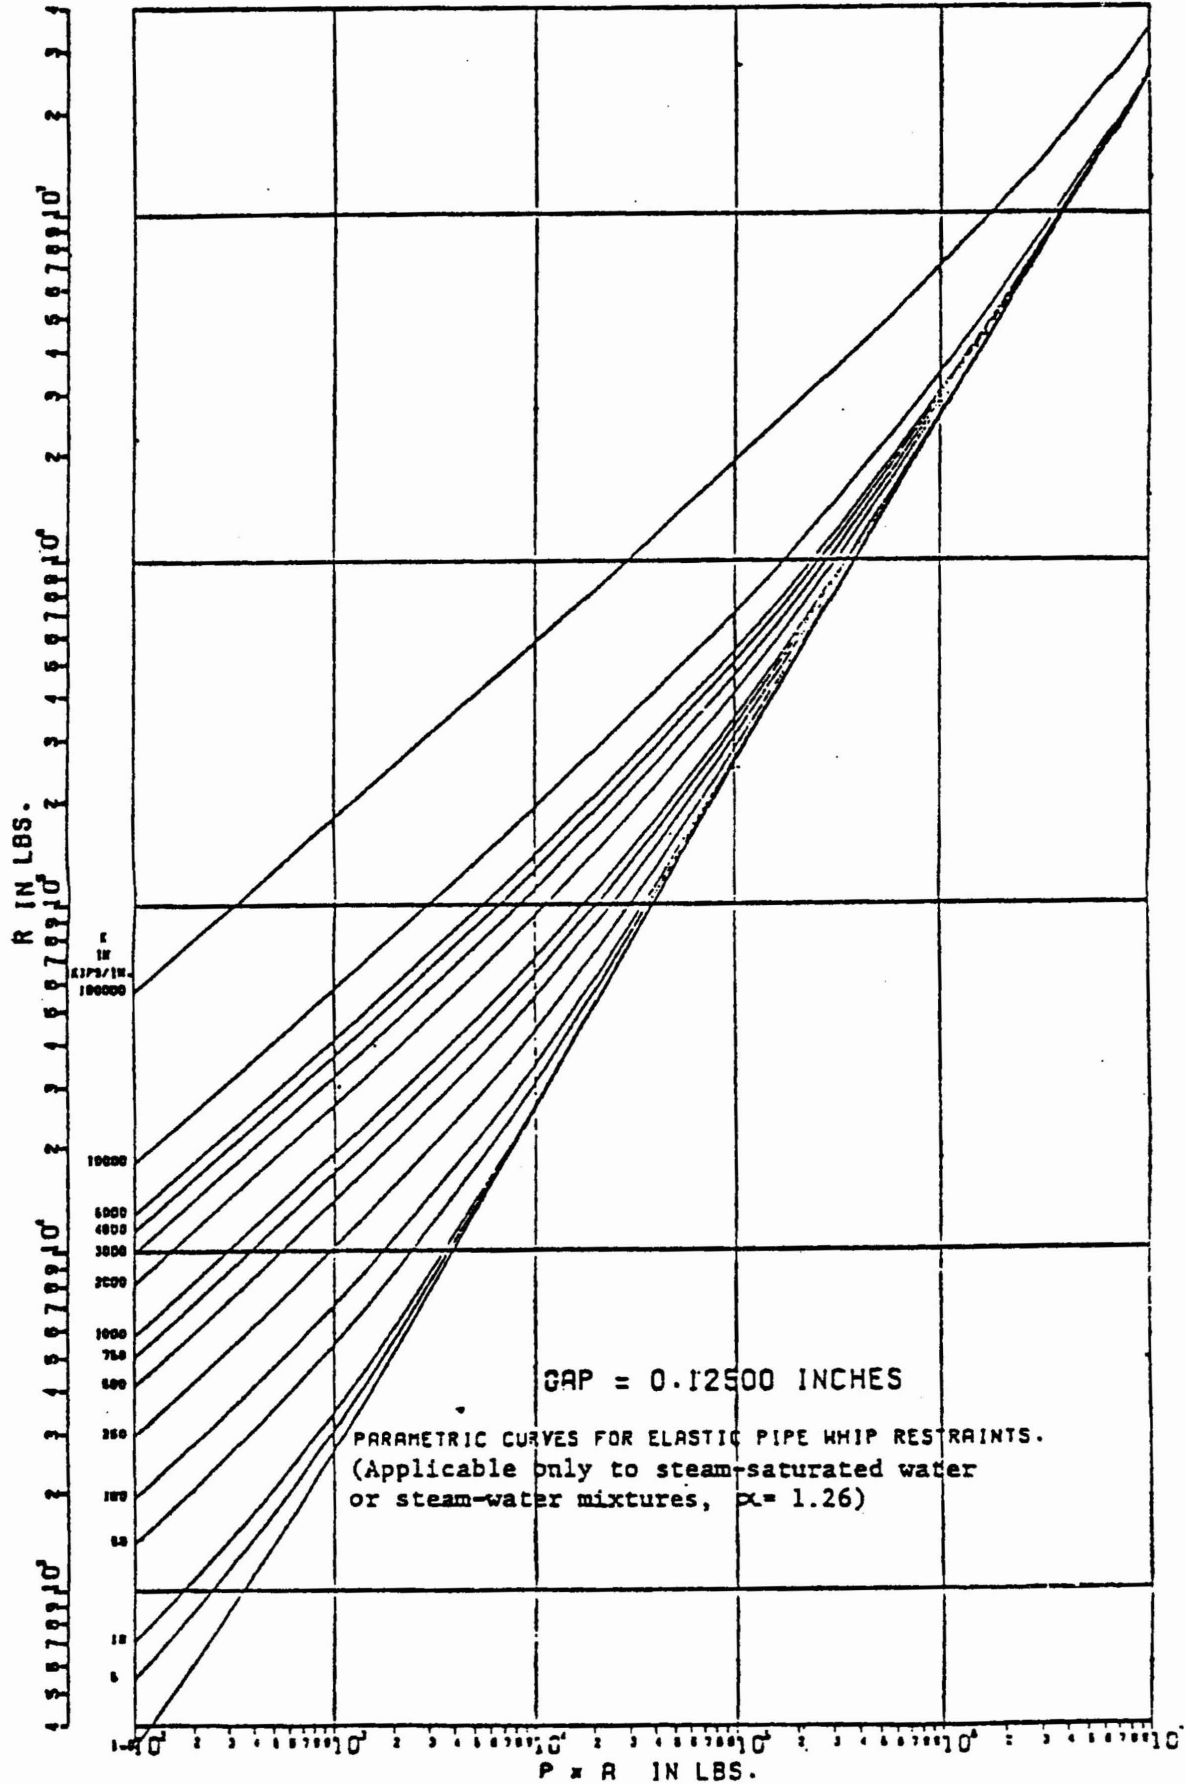


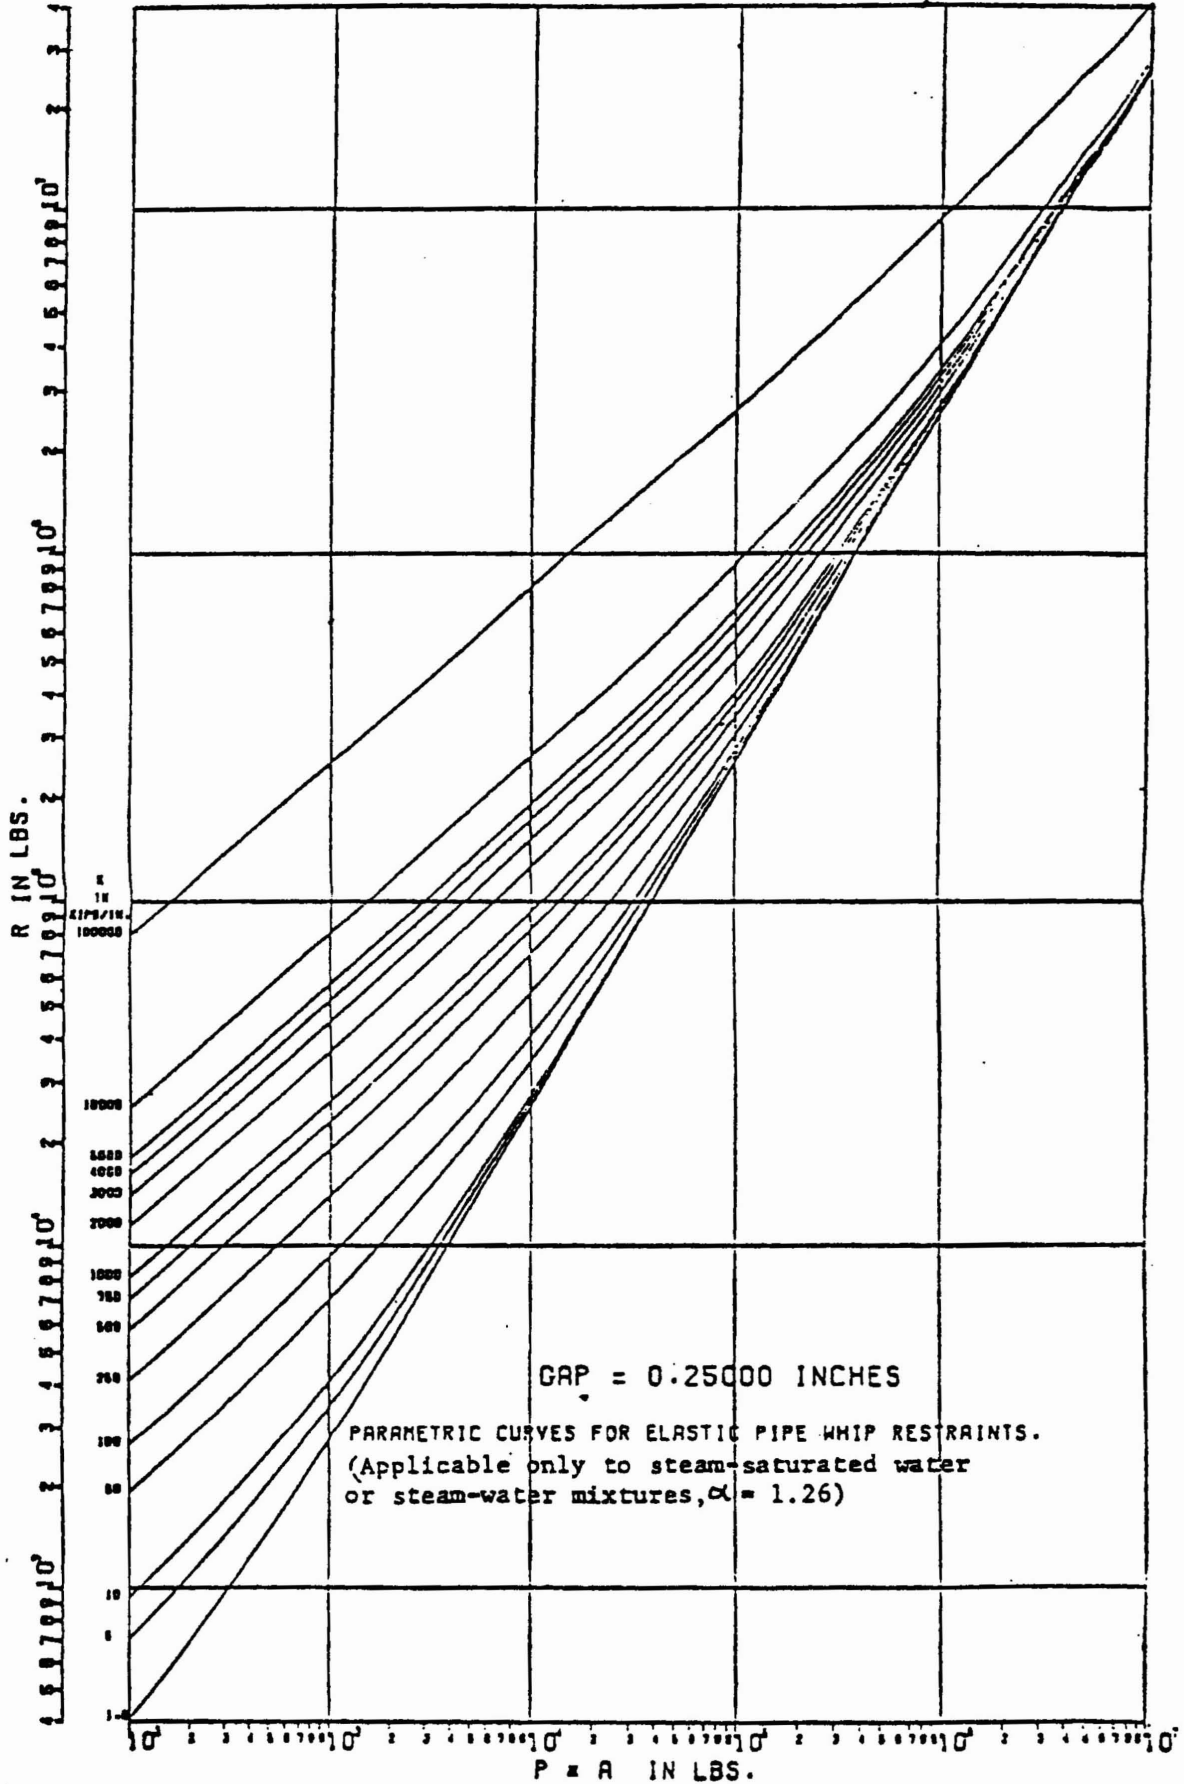


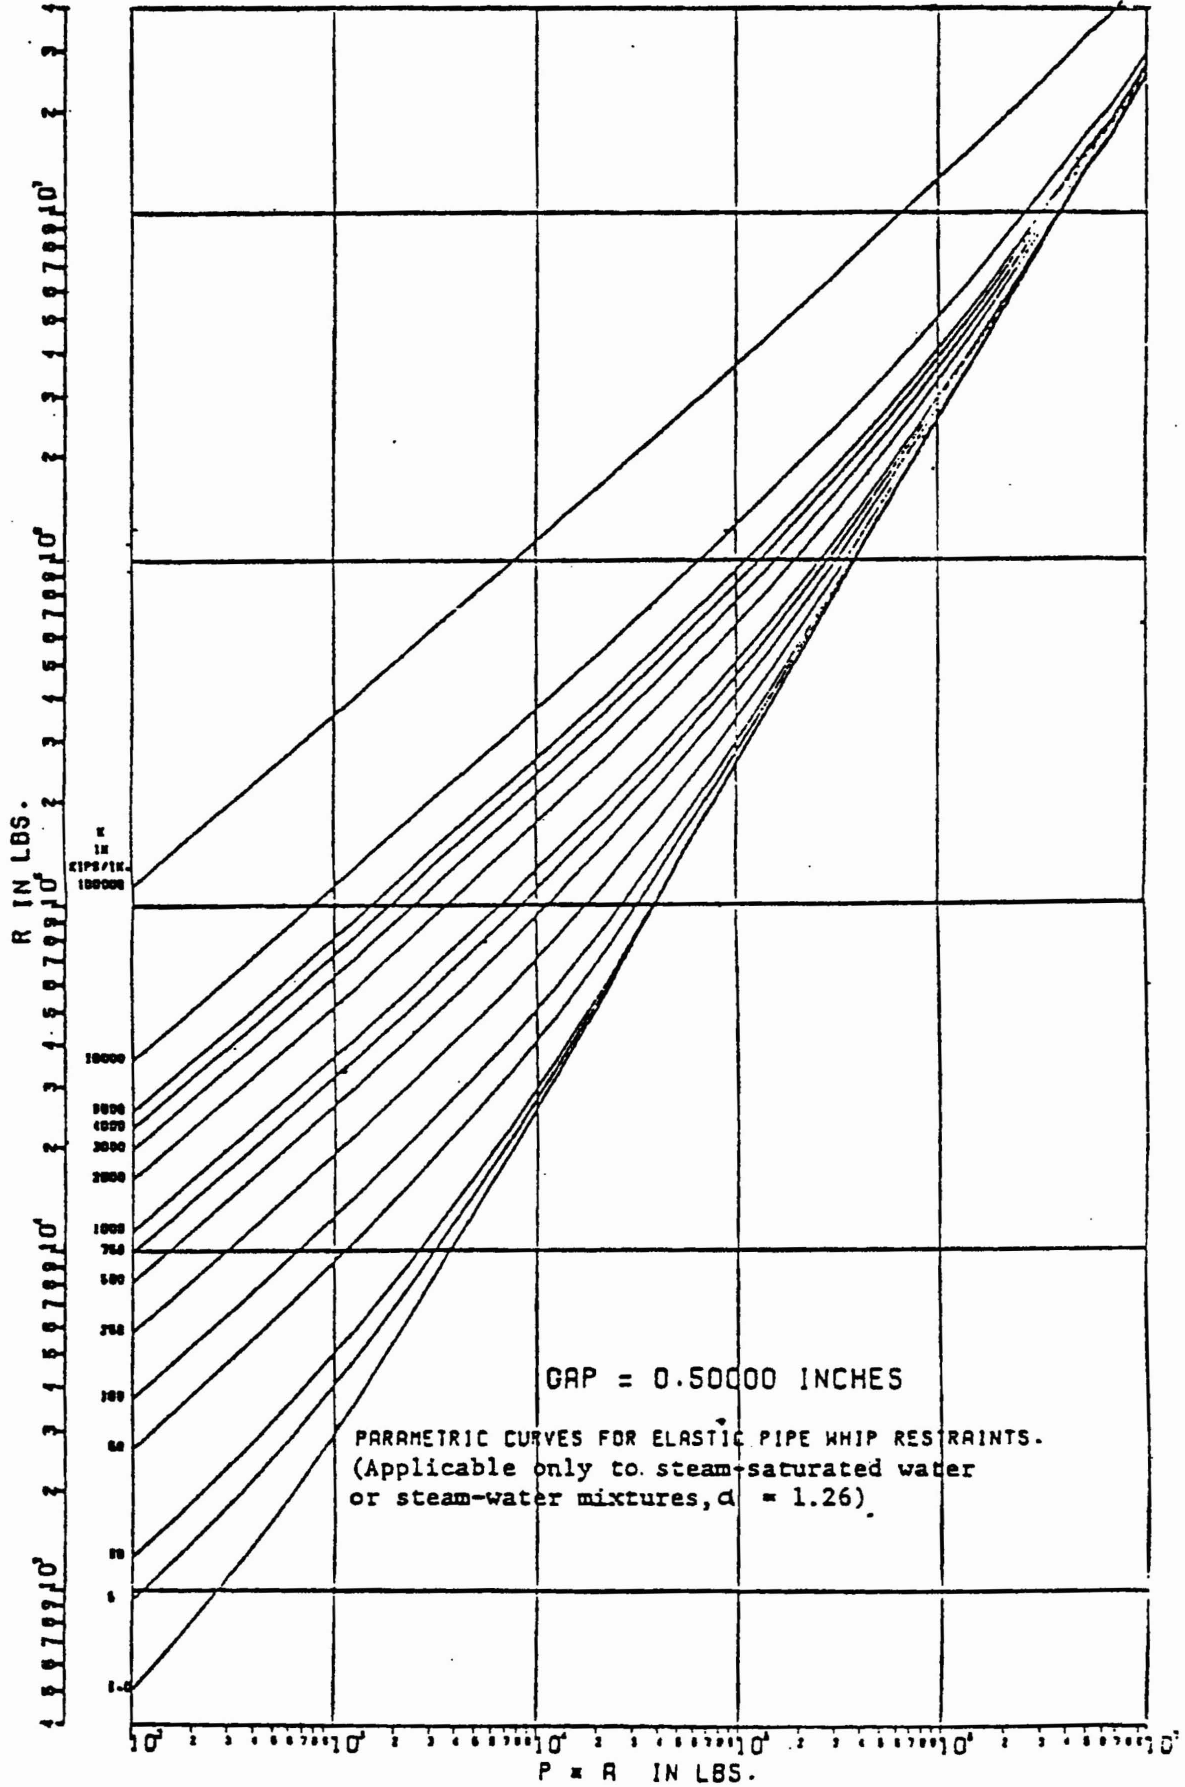


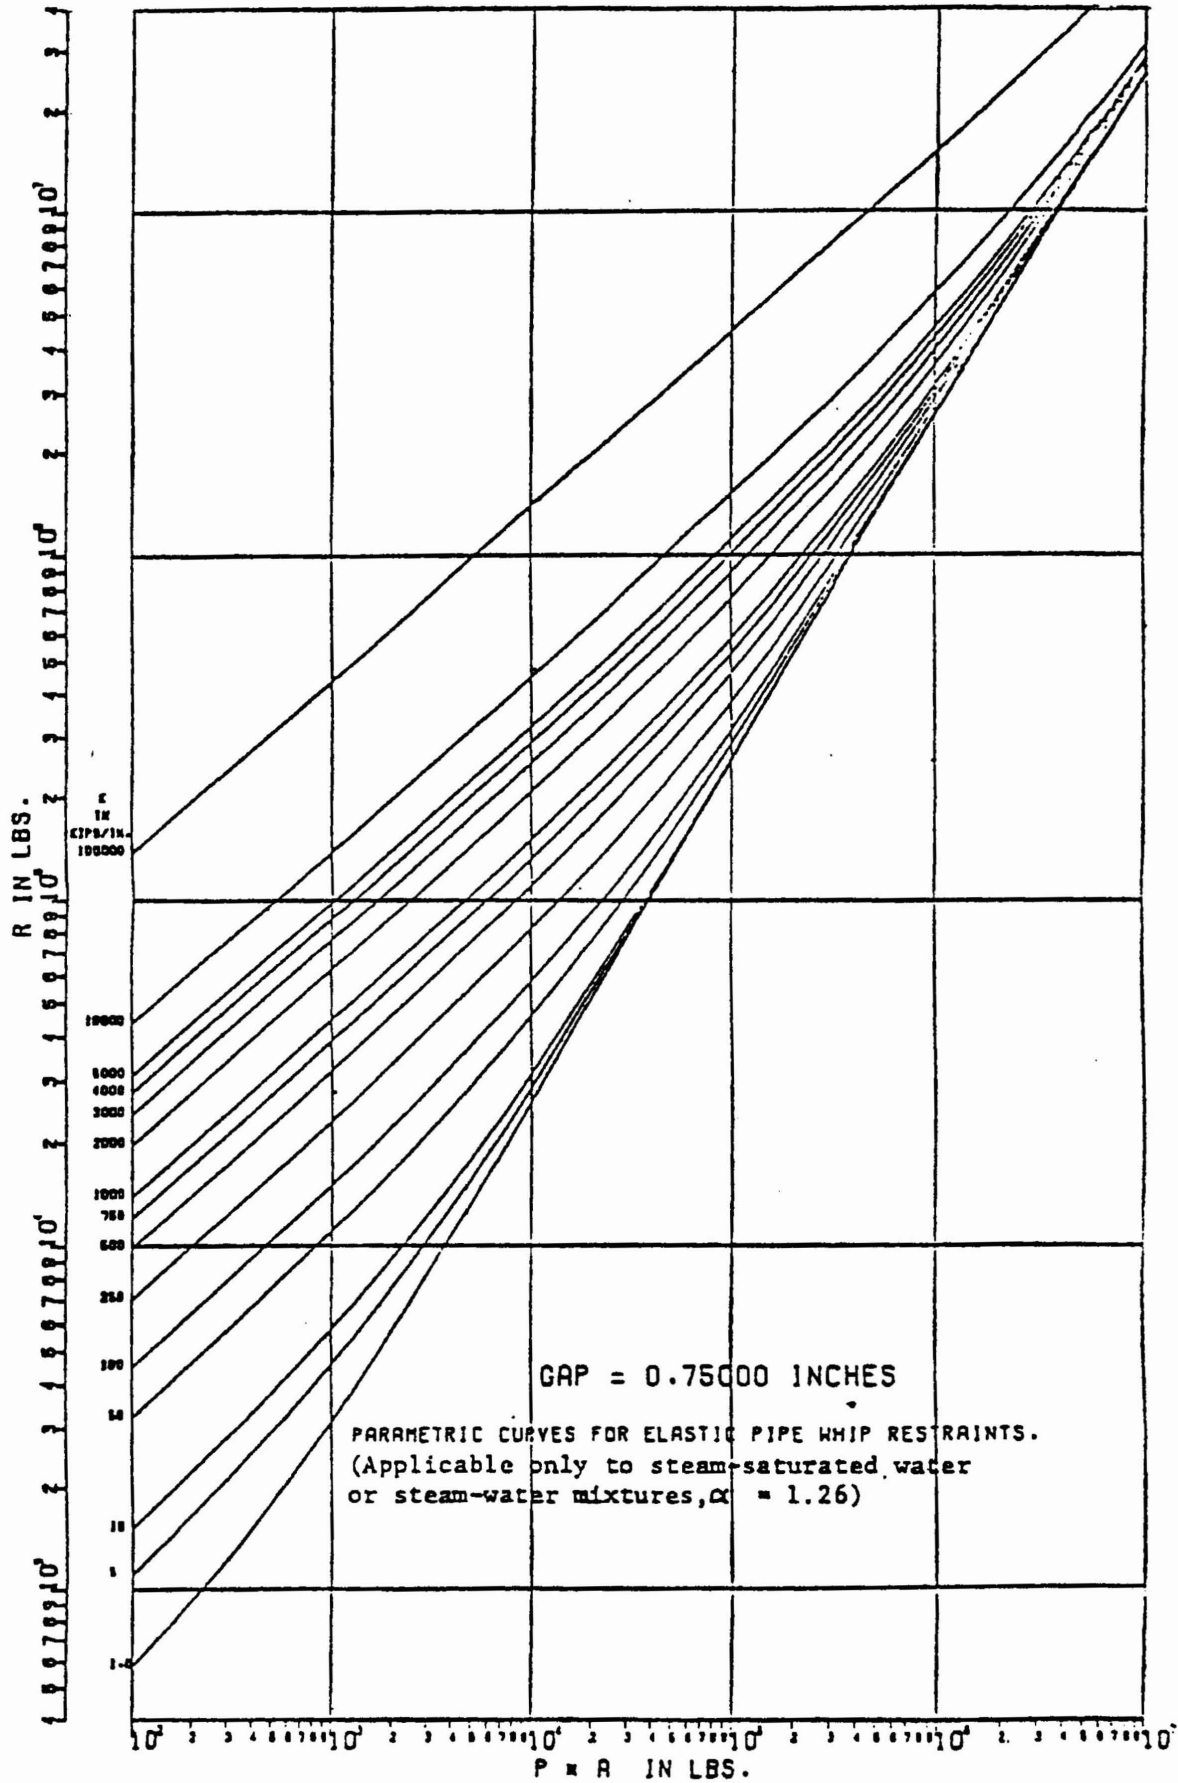


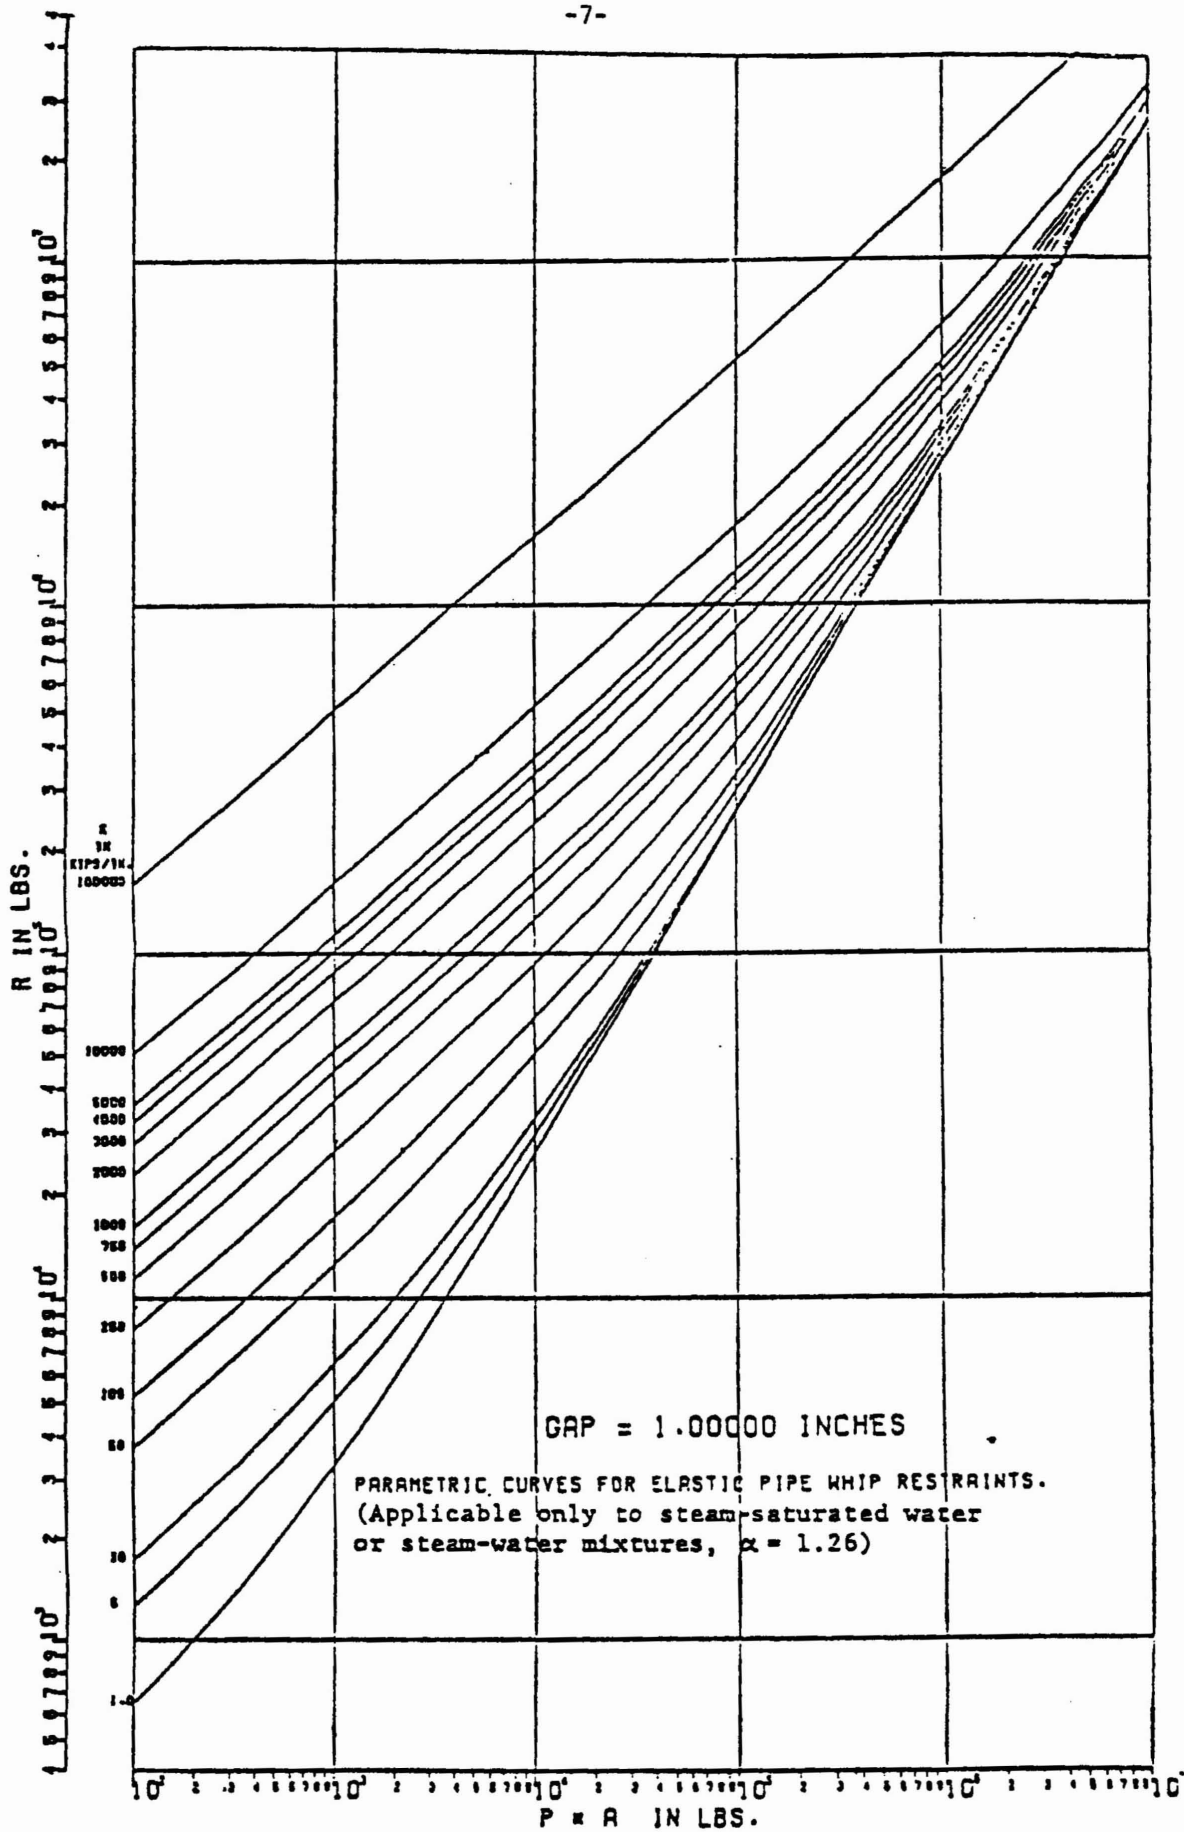


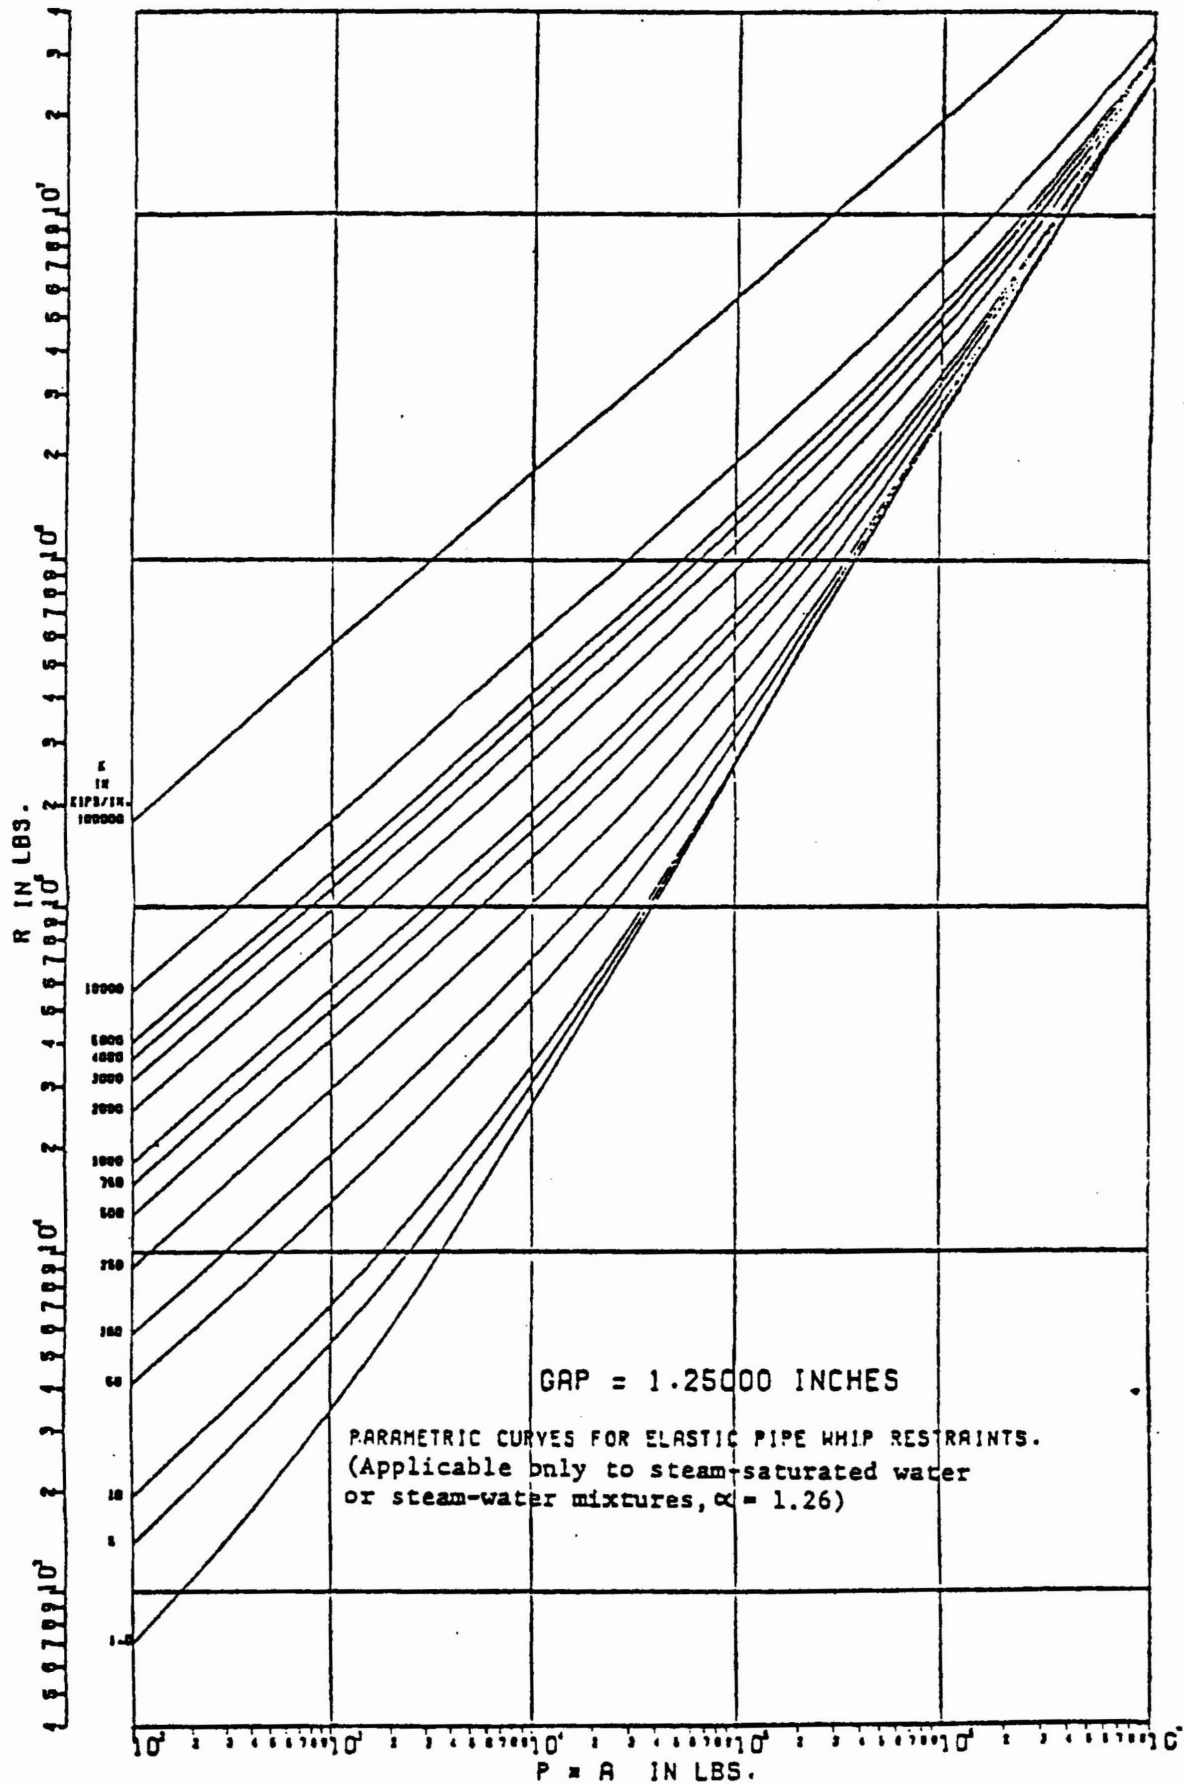


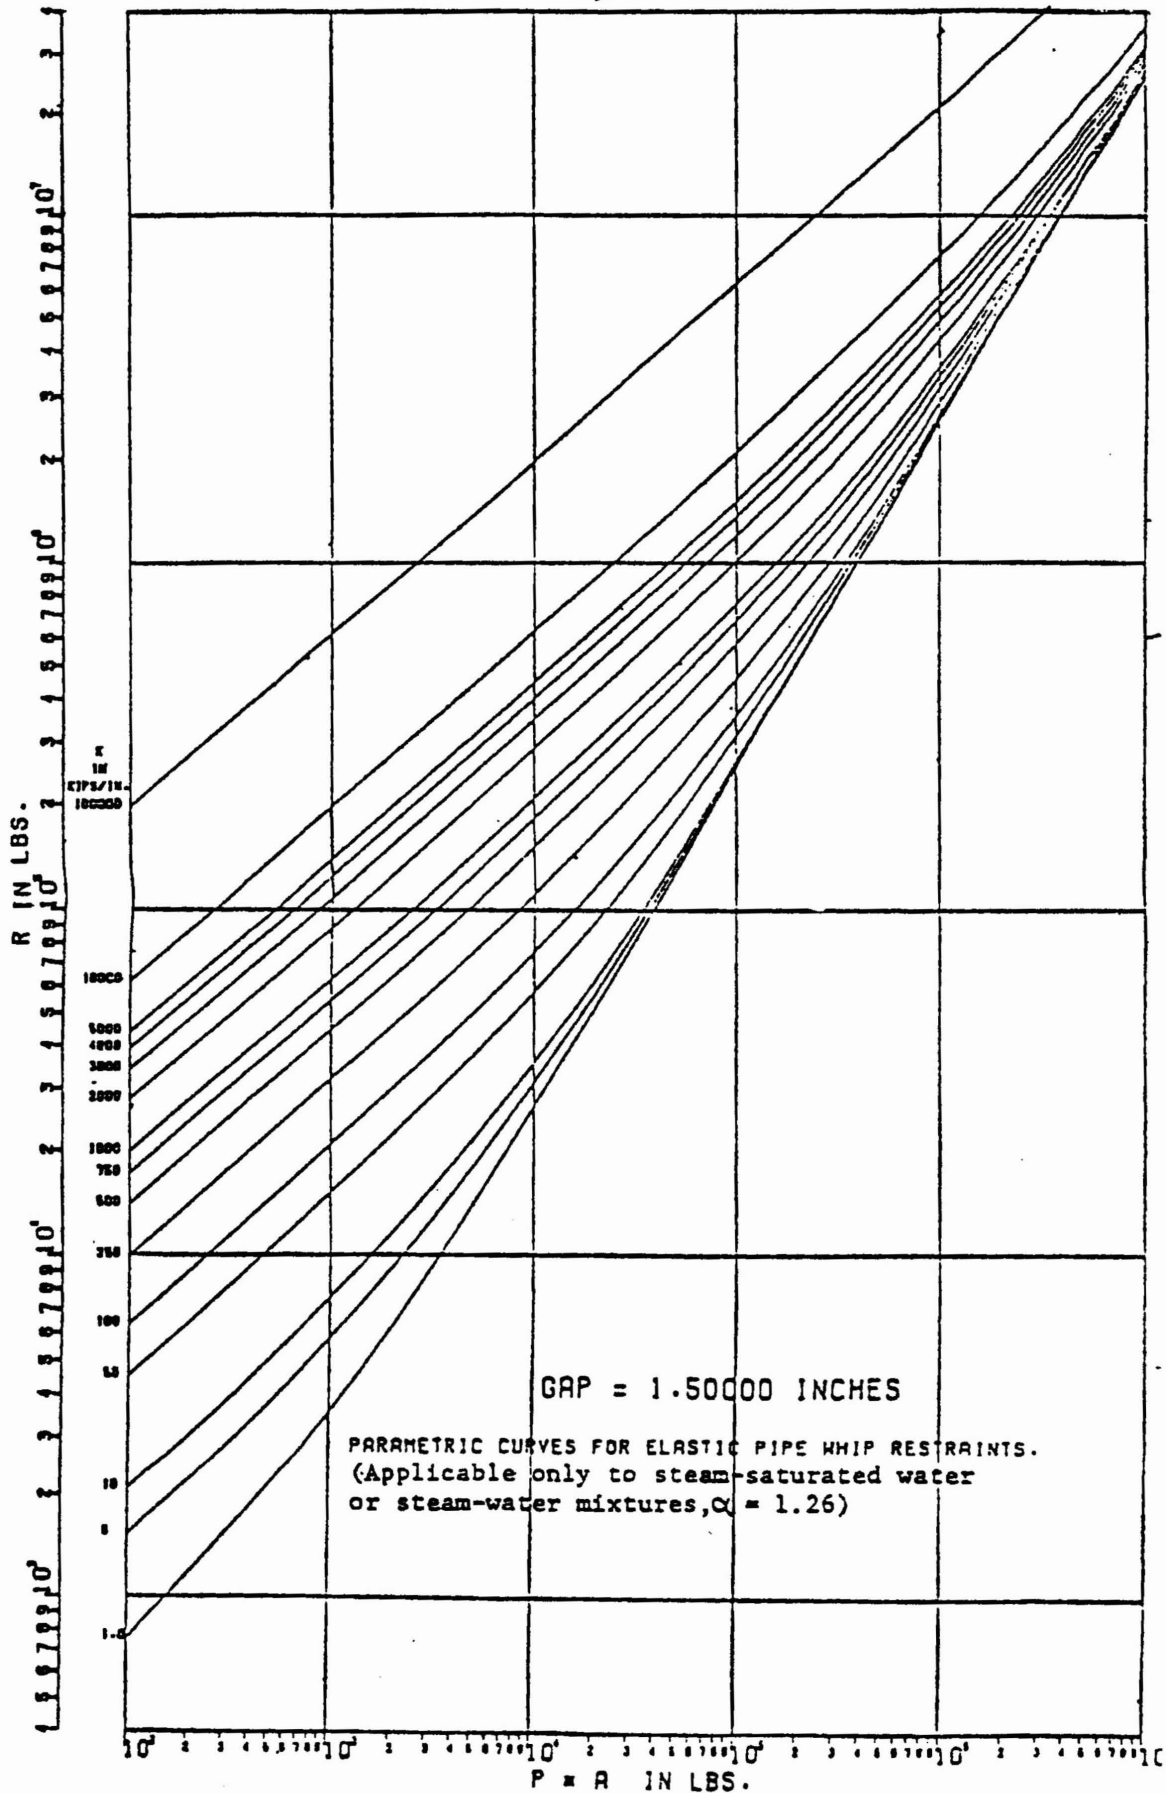


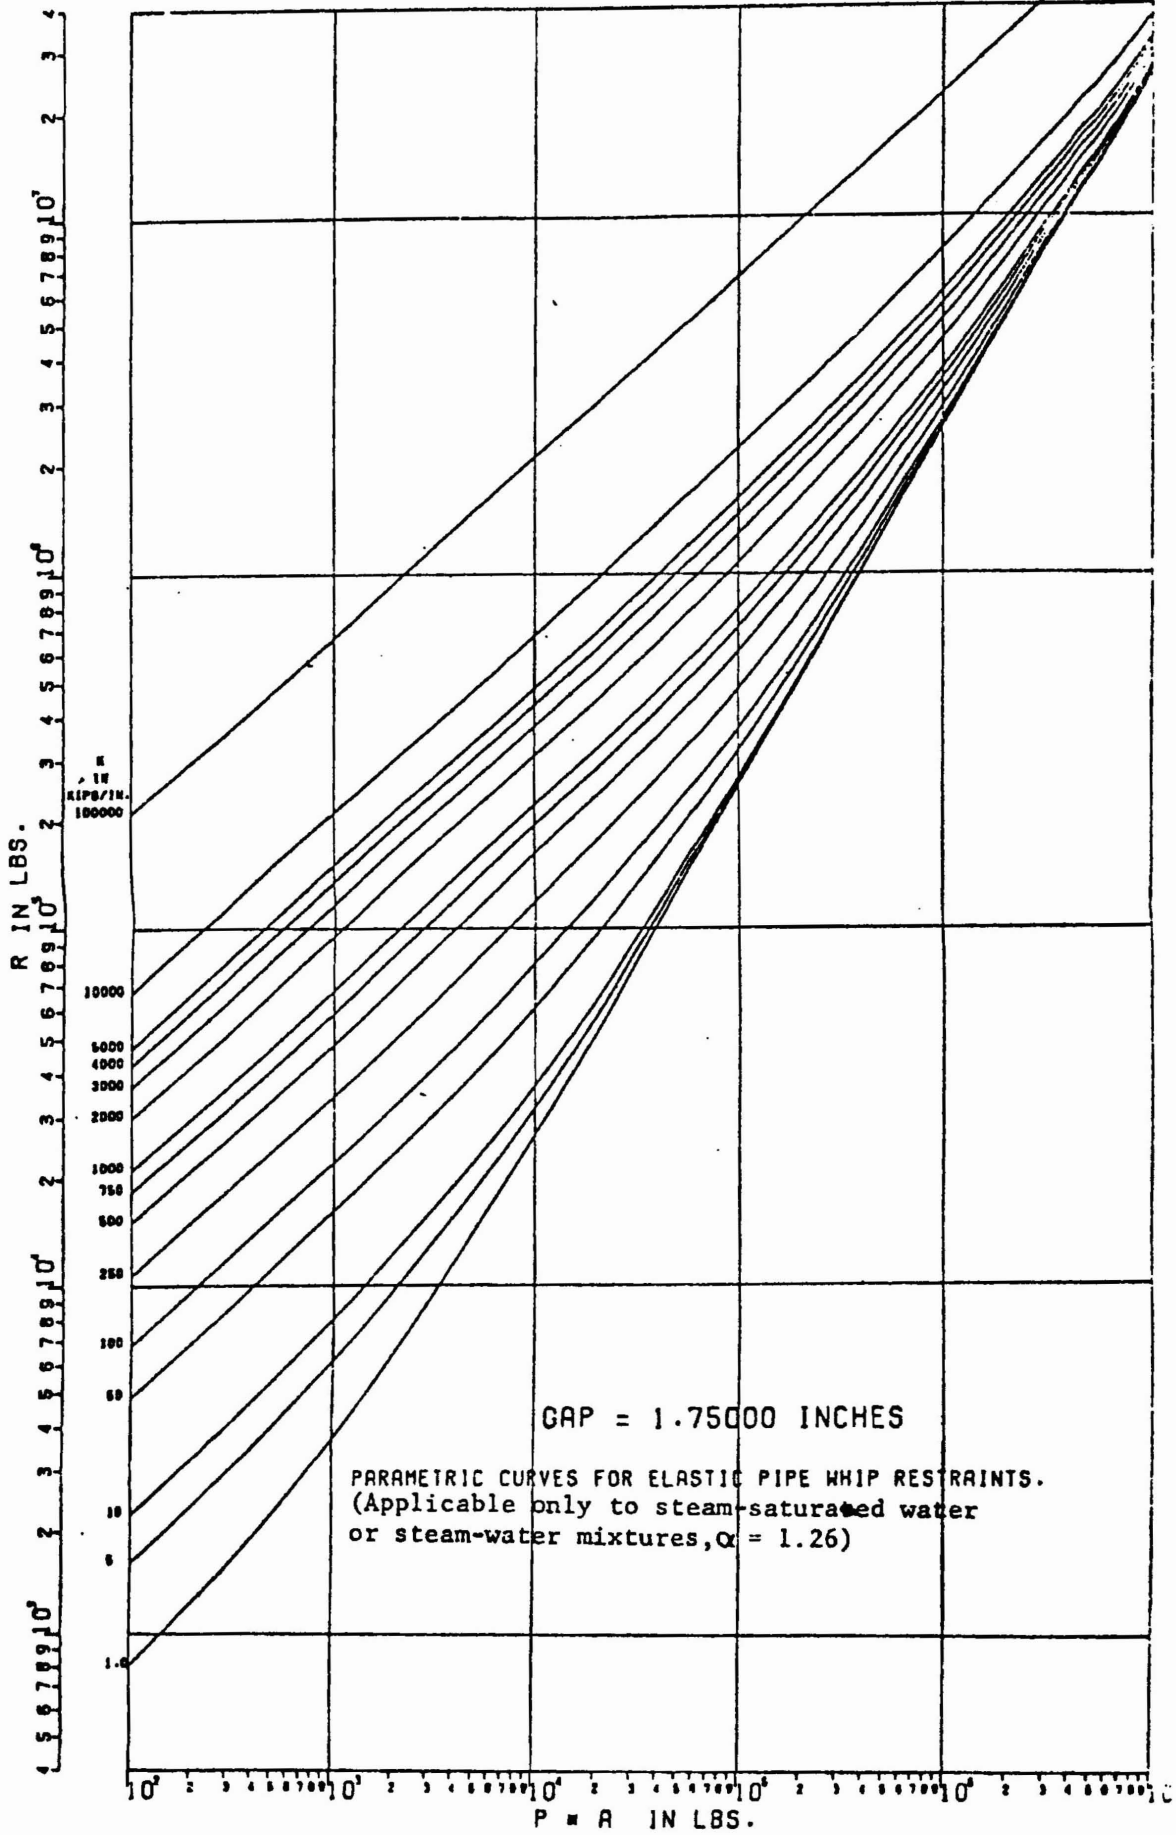

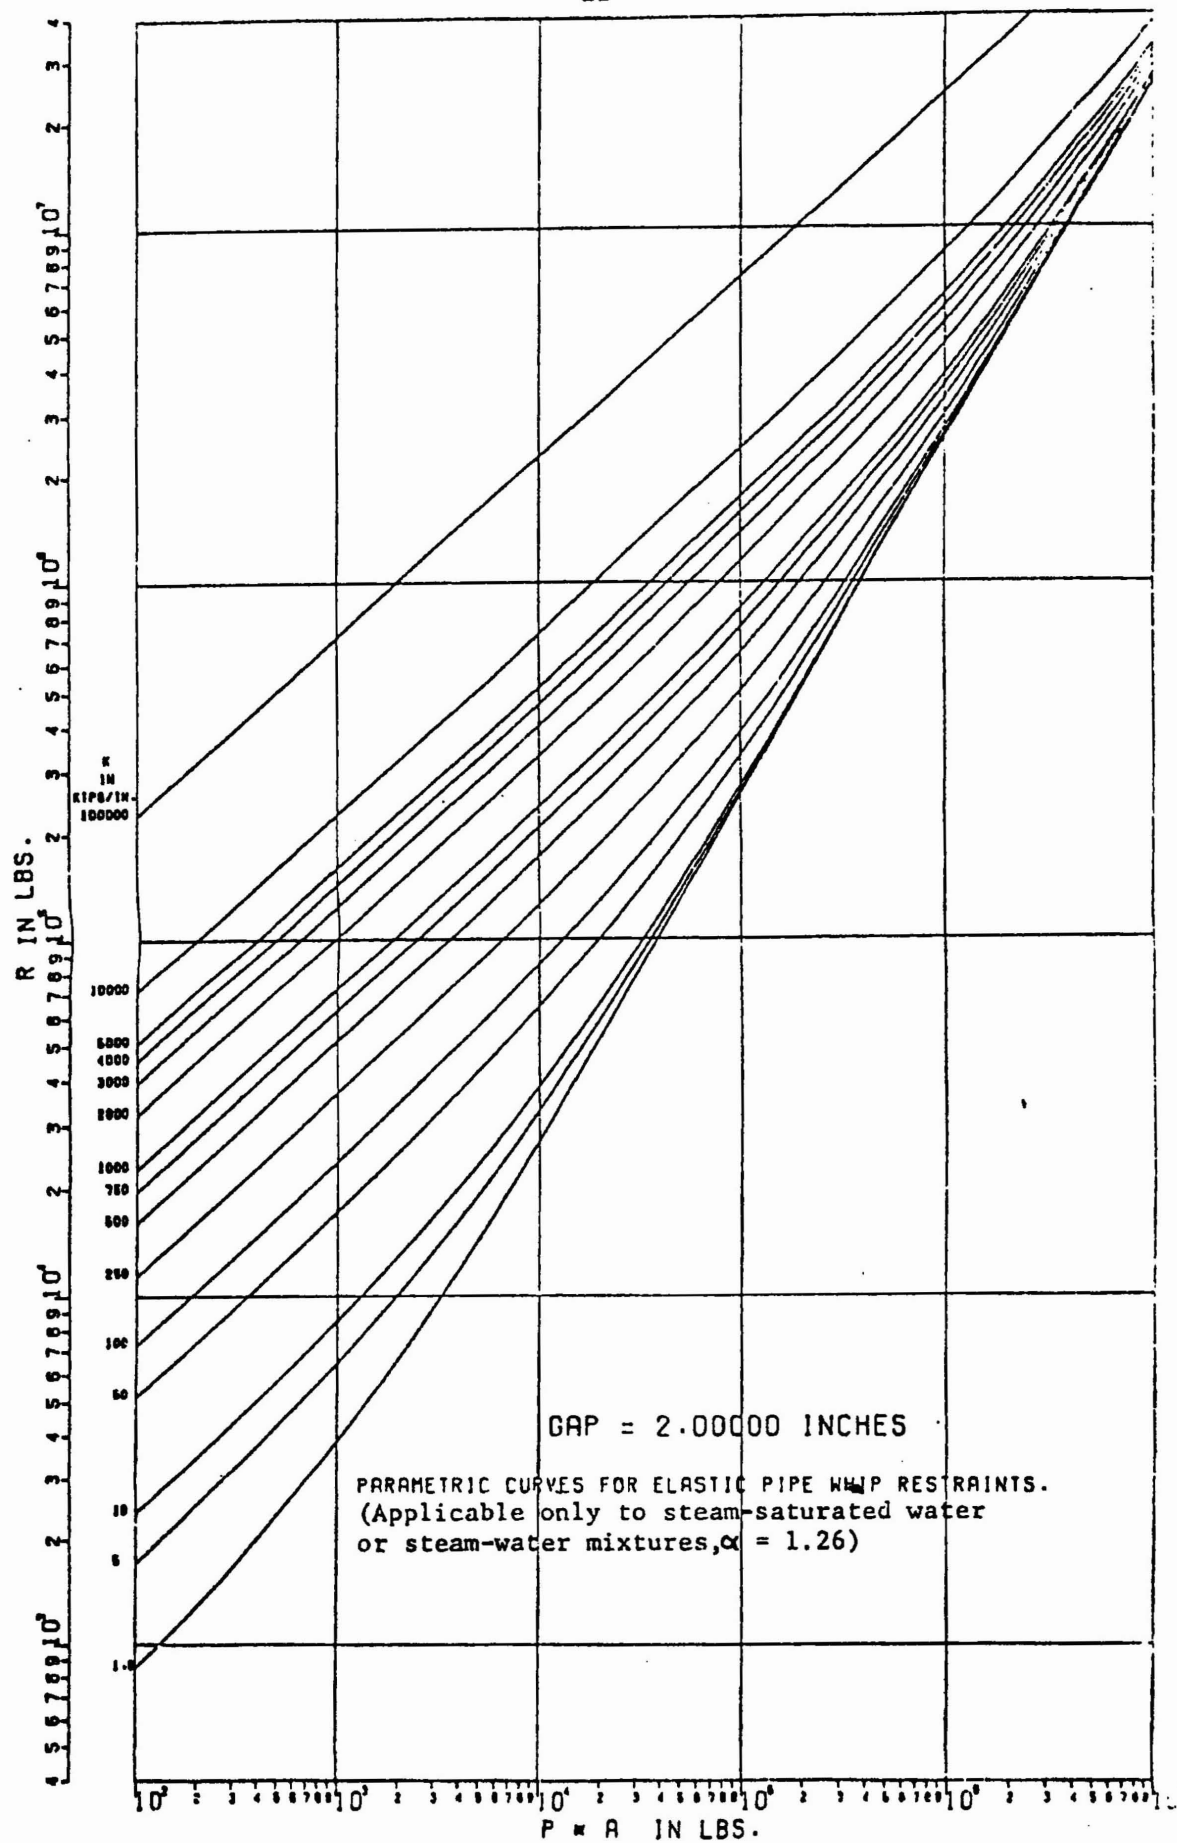

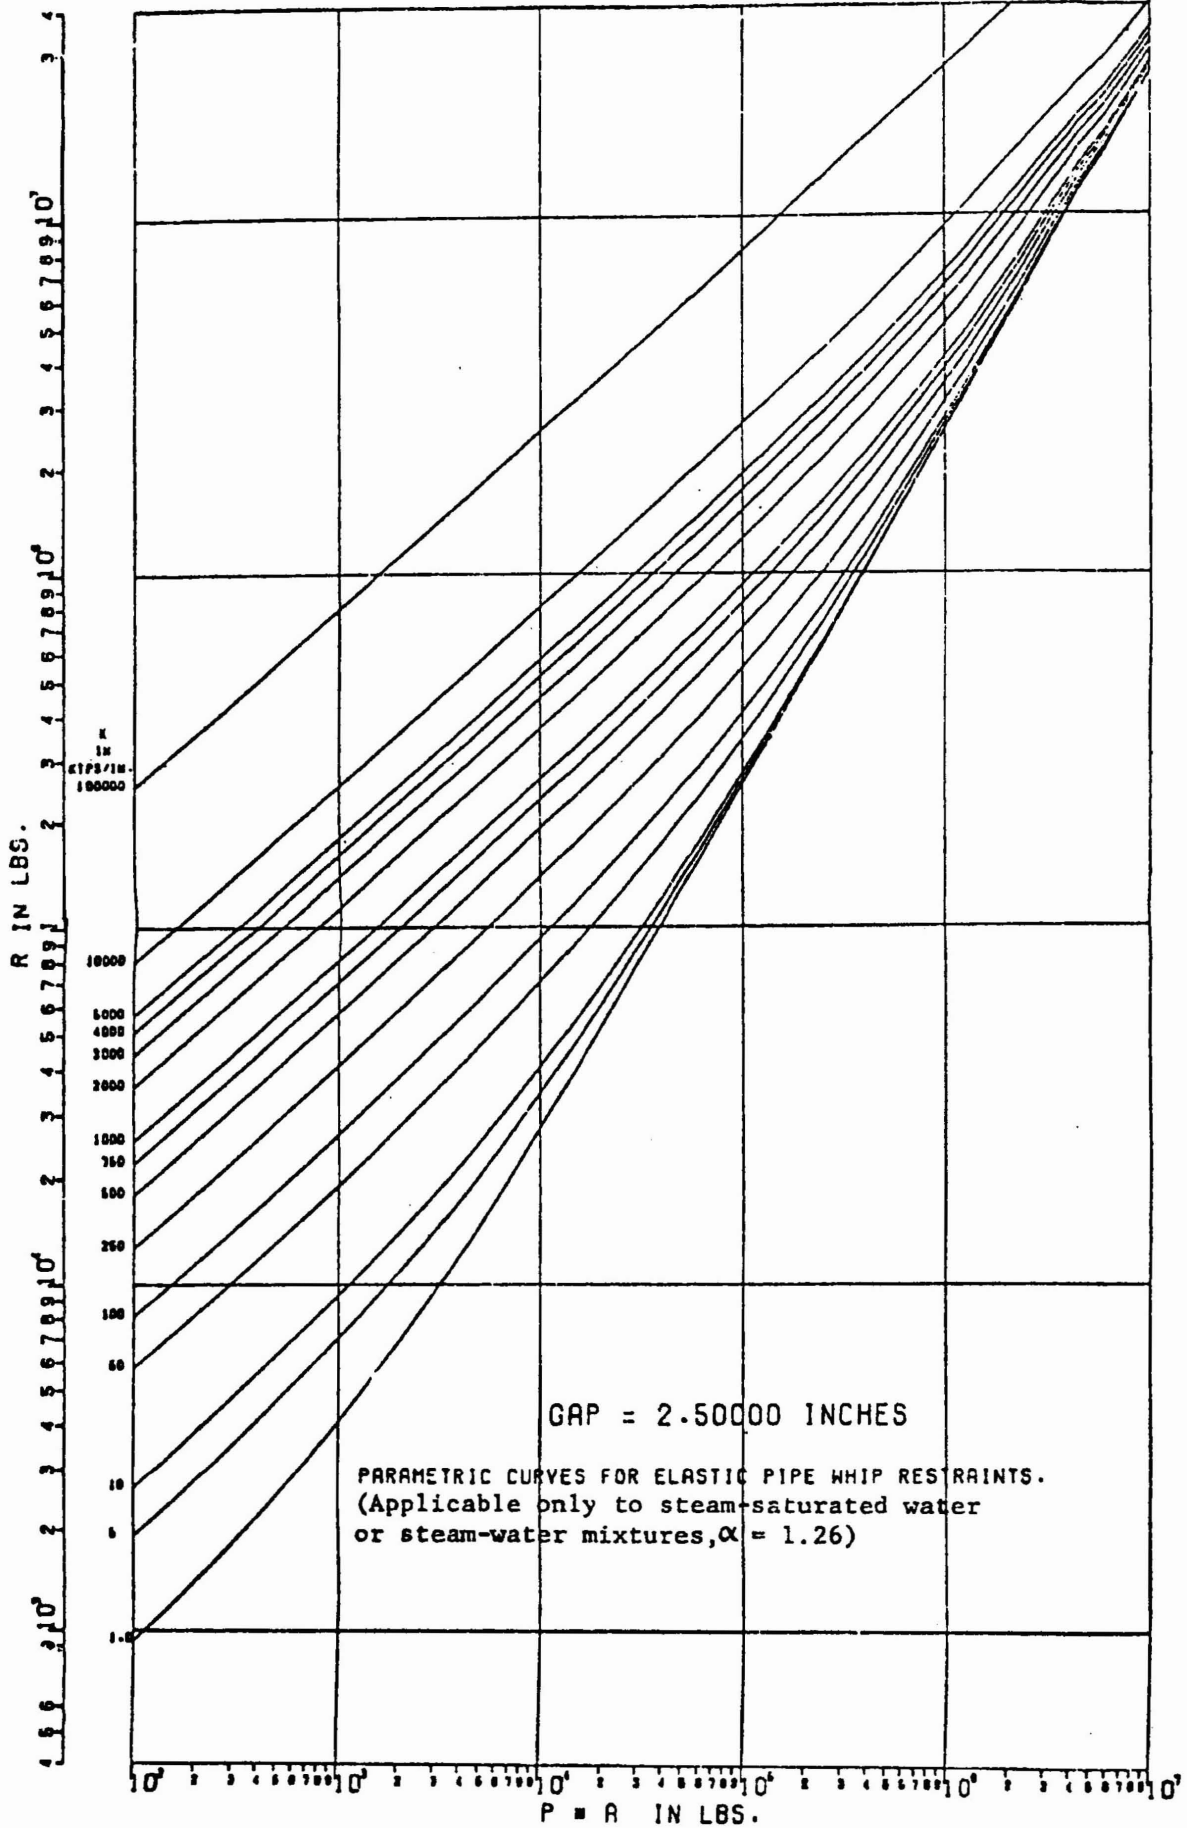

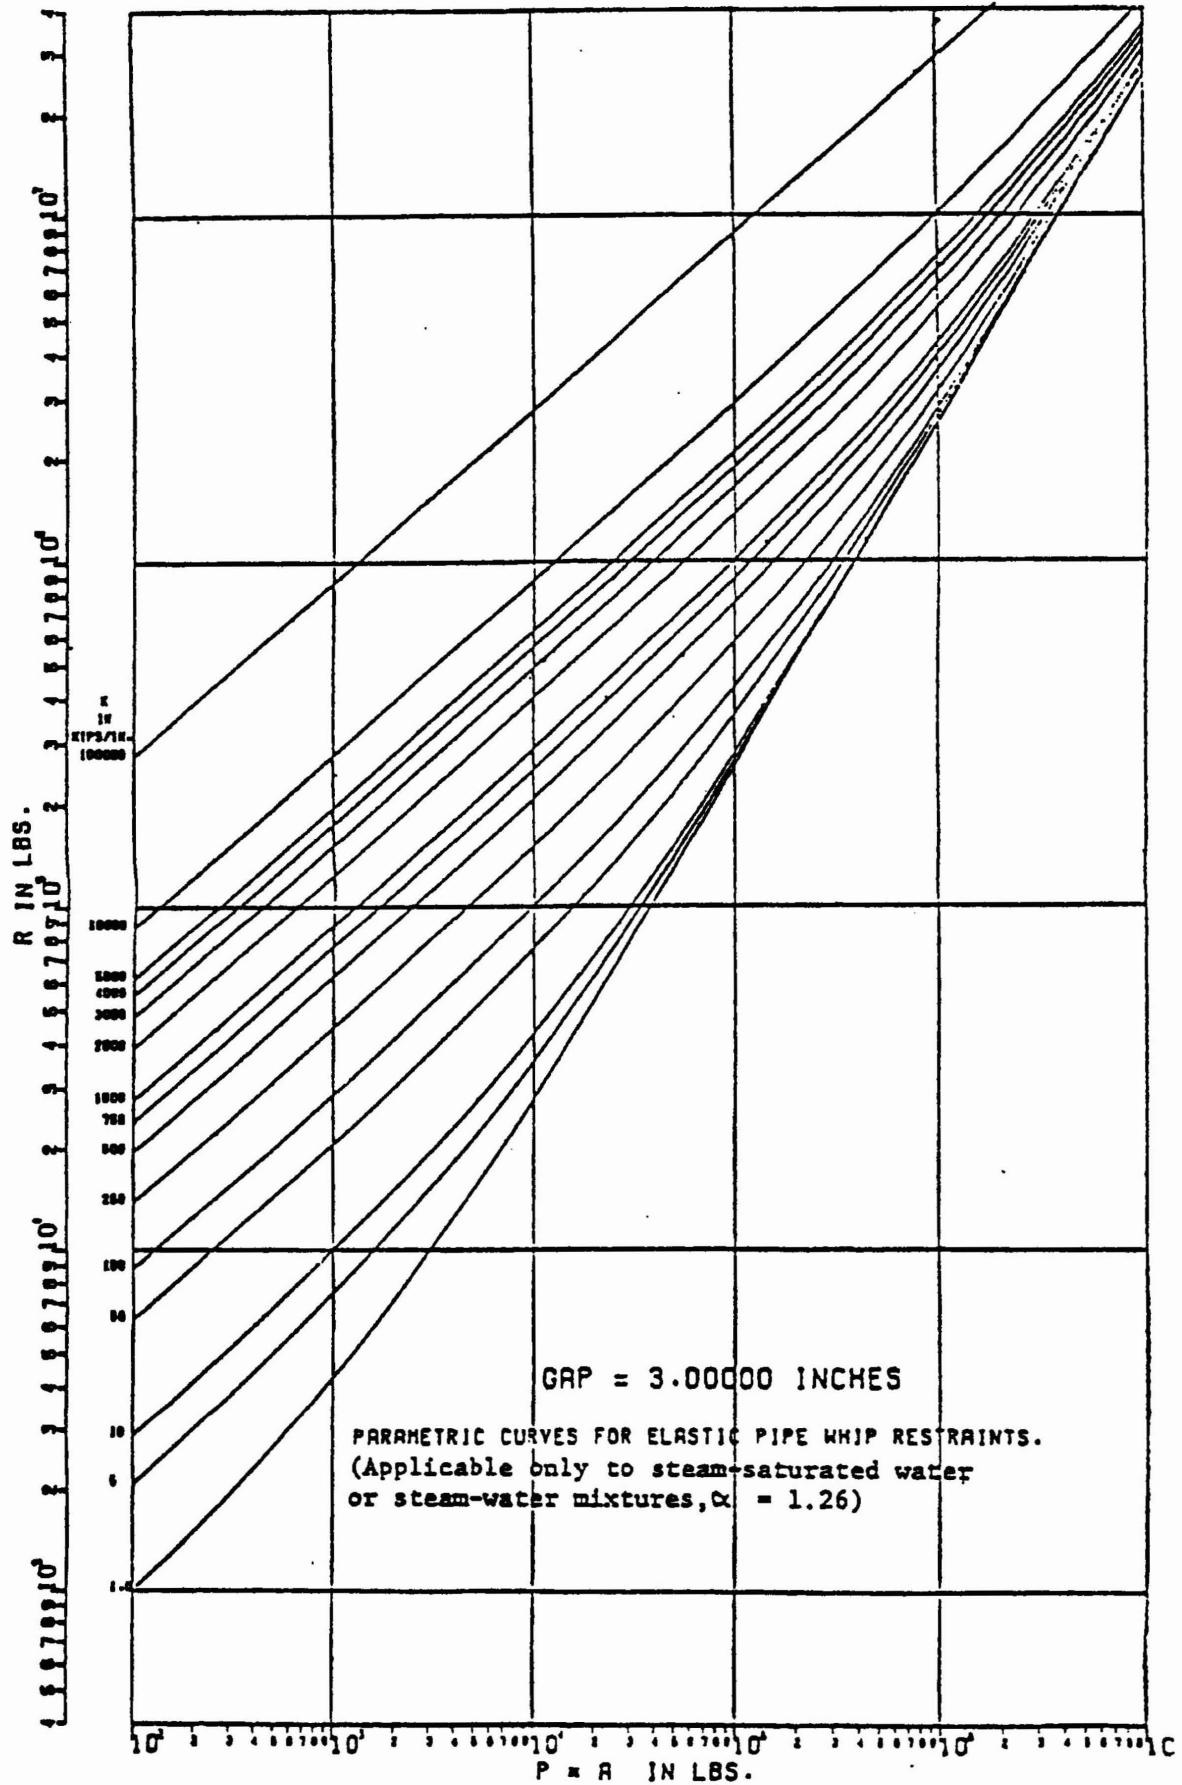

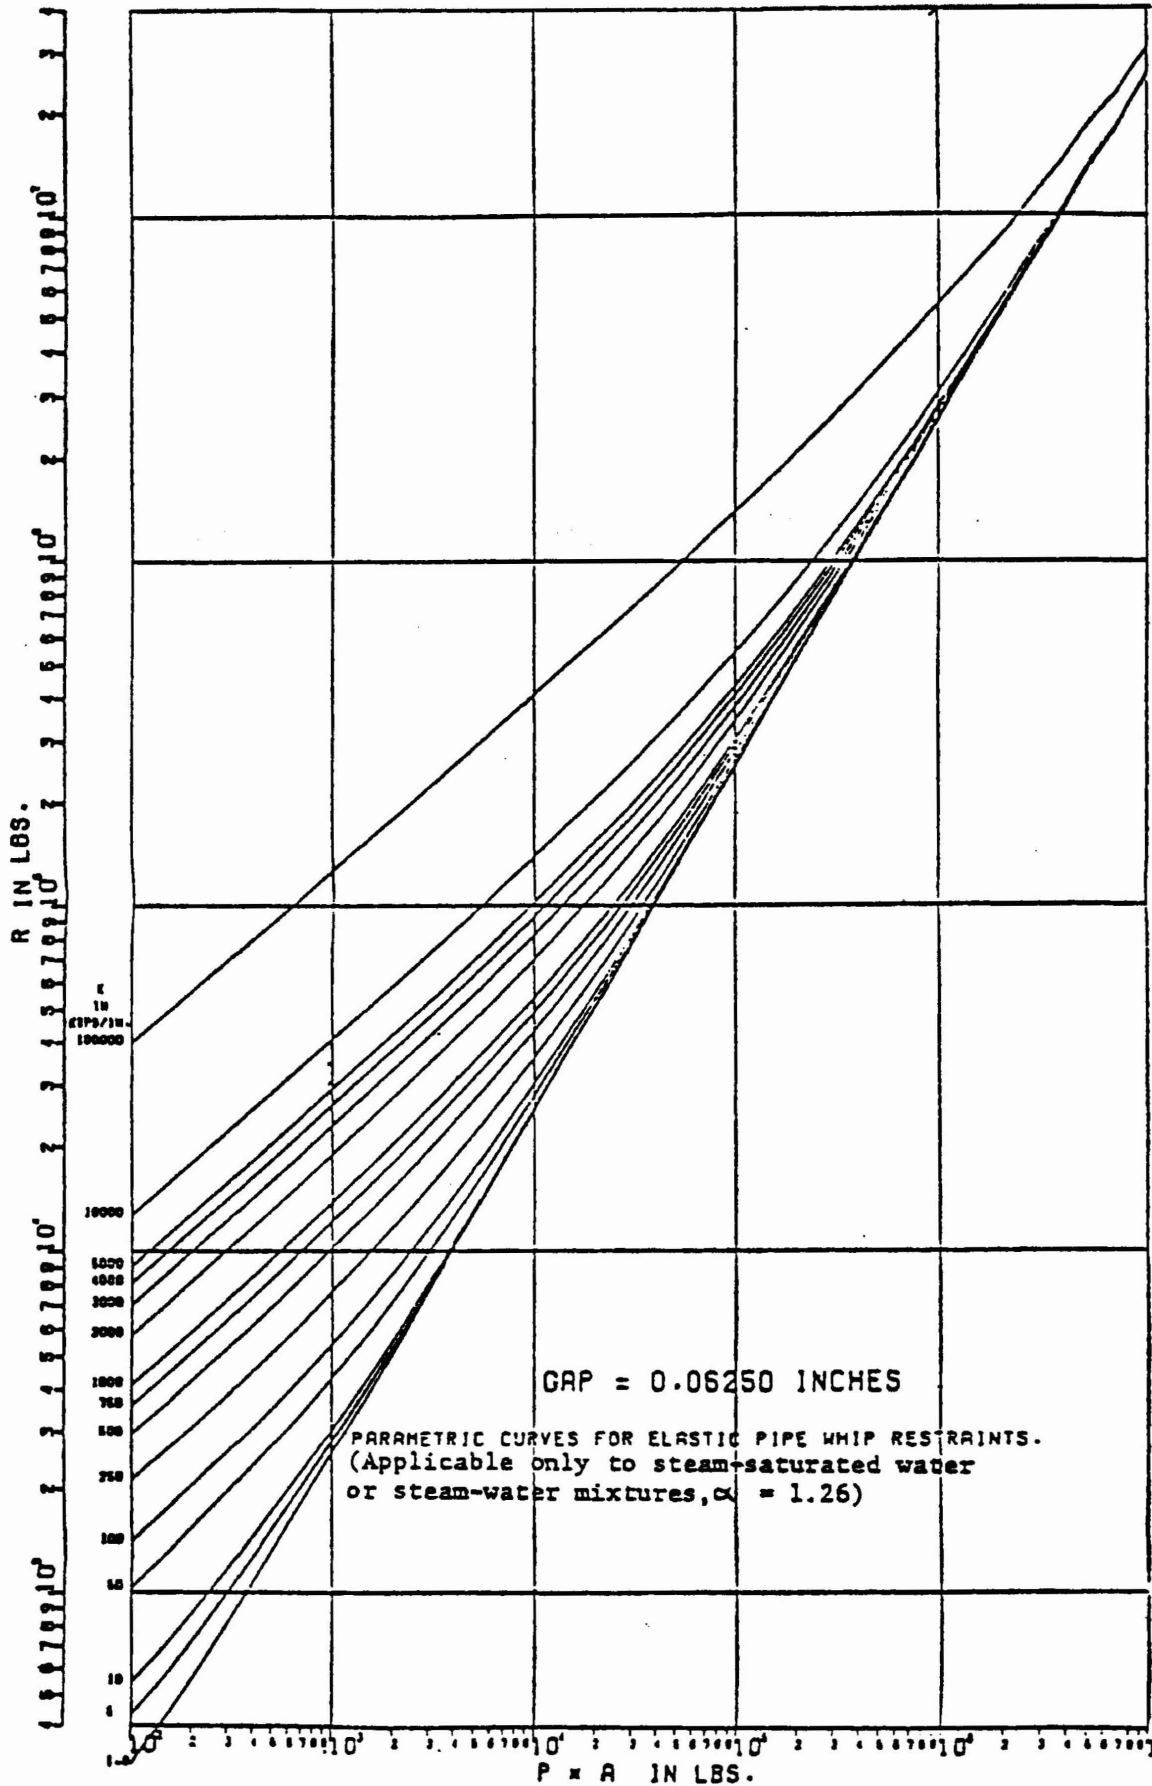

<b>SEABROOK STATION UFSAR</b>	Design of Structures, Components Equipment and Systems  Verification of Computer Programs Used For Structural Analysis and Design	Revision 8  Appendix 3F  Page 3F-1
---------------------------------------	--	--

**APPENDIX 3F      VERIFICATION OF COMPUTER PROGRAMS USED FOR  
STRUCTURAL ANALYSIS AND DESIGN**

The information contained in this appendix was not revised, but has been extracted from the original FSAR and is provided for historical information.

APPENDIX 3F

VERIFICATION OF  
COMPUTER PROGRAMS USED FOR  
STRUCTURAL ANALYSIS AND DESIGN

Computer programs used for structural analysis and design have been verified according to the criteria described in the US NRC Standard Review Plan 3.8.1, Section II-4(e).

- (a) The following computer programs are recognized in the public domain, and have had sufficient history to justify their applicability and validity without further demonstration:

	<u>Hardware</u>	<u>Source</u>
STARDYNE	CDC	CDC(1)
MARC-CDC	CDC	CDC(1)
STRU-PAK	CDC	CDC(1)
System Professional	CDC	CDC(1)
ANSYS	CDC	CDC(1)
STRU DL	UCCEL	PSDI(2)
UEMENU	UCCEL	UCCEL(3)

(1) CDC - Control Data Corporation  
P. O. Box 0, HQWOSH  
Minneapolis, Minnesota 55440

(2) PSDI - Programs for Structural Design, Inc.  
14 Story Street  
Cambridge, Massachusetts 02138

(3) UCCEL - UCCEL Corporation  
P. O. Box 84028  
Dallas, Texas 75284

- (b) The following computer programs have been verified by solving test problems with a similar and independently-written and recognized program in the public domain:

SAG058 (Response Spectra)

A summary of comparison results is shown in Table 3F-1.

AX2 (Axisymmetric Shell Program)

A verification manual comparing AX2 with results obtained from either ANSYS or BOSOR4 (Lockhead Missile and Space Company - Palo Alto, CA) can be obtained from Pittsburgh - Des Moines Corporation, 3400 Grand Avenue, Neville Island, Pittsburgh, PA 15225

- (c) The following computer programs have been verified by comparison with analytical results published in technical literature:

SAG001 (WILSON 1)  
SAG010 (WILSON 2, DYN)

Summaries of comparison results are shown in Tables 3F-2 and 3F-3, respectively.

- (d) The following computer programs have been verified by comparison with hand calculations for test problems which are representative of the type used in actual analyses:

SAG008 (TAPAS)  
SAG017 (FOUREXP)  
SAG024 (MMIC)  
SAG025 (SECTION)  
PM-910 (LESCAL)  
\*PM-906 (STRAP)

A summary of comparison results is shown in Tables 3F-4 through 3F-8.

- (e) The following computer programs are verified by inspection of the graphical output data.

SAG054 (Response Envelope)

A typical verification example is presented in Table 3F-9.

\* Documentation of STRAP is available in the Final Safety Analysis Report for the Carolina Power and Light Co., Brunswick 1 & 2, US NRC Docket Nos. 50-324 and 50-325.

SB 1 & 2  
FSAR

TABLE 3F-1

SAG058 (RESPONSE SPECTRA)

SAG058<sup>(1)</sup> is verified against STARDYNE, sub-routine DYNRE5. The input T/H is of 22 second duration, with a time interval of 0.01 seconds and a maximum acceleration of 1.0g.

Frequency (Hz)	Spectral Acceleration (g)			
	0.5% Damping		2% Damping	
	SAG058	DYNRE5	SAG058	DYNRE5
0.33	0.91	0.98	0.79	0.83
1.00	2.68	2.67	2.03	2.03
2.00	8.23	8.23	4.33	4.32
3.03	6.04	6.02	4.31	4.32
4.00	5.20	5.18	4.40	4.37
5.00	5.25	5.21	3.95	3.94
6.25	7.51	7.42	4.47	4.38
7.14	5.33	5.25	3.94	3.90
8.33	4.87	4.80	3.69	3.68
9.09	7.09	6.93	4.96	4.81
10.00	5.00	4.97	3.37	3.35
20.00	2.61	2.60	1.77	1.77
33.33	1.22	1.22	1.13	1.14

- (1) SAG058 is an in-house computer program run on the Control Data Corporation CYBER-175 and is used as a post-processor to the STARDYNE program.

SB 1 & 2  
FSAR

TABLE 3F-2

SAG001 (WILSON 1)

The following is a comparison of the results from SAG001 with results obtained from published technical literature. SAG001 runs on the Honeywell 66/60 system with the GCOS operating system.

Sample Problem No. 1

Analysis of a thick-walled cylinder subjected to an internal pressure.

Reference - Gallagher, R. H., Finite Element Analysis, Figure 11.5, pg. 317, Prentice-Hall, Inc., 1975.

Comparison of the theoretical solution with the WILSON 1 solution is shown on Figure 3F-1 for the radial stress and the hoop stress.

Sample Problem No. 2

Analysis of a cylindrical shell, fixed at both ends and subjected to an internal pressure.

Reference - Timoshenko, S., Woinowsky-Krieger, S., Theory of Plates and Shells, Second Edition, pg. 475, McGraw-Hill, 1959.

Comparison of the theoretical solution with the WILSON 1 solution is shown on Figures 3F-2 and 3F-3 for the radial shear and meridional moment, respectively.

TABLE 3F-3

SAG010 (WILSON 2, DYN)

The original version of SAG010, "Dynamic Stress Analysis of Axisymmetric Structures Under Arbitrary Loading," written by Ghosh and Wilson was revised by UE&C in September, 1975. The program is distributed in the public domain by the Earthquake Engineering Research Center, University of California, Berkeley, California. The program has been verified against a series of problems whose results are published in technical literature. Documentation of this verification is contained in the report EERC 69-10 which can be obtained from the Earthquake Engineering Research Center. SAG010 is run on the Honeywell 66/60 System.

---

SB 1 & 2  
FSAR

TABLE 3F-4

SAG008 (TAPAS)

The following is a comparison of the results from SAG008, which computes the temperature distribution through plane and axisymmetric solids, with hand calculations. The sample results are for the temperature distribution through the thickness of a hemispherical concrete dome which is 42 inches thick and subject to 120°F inside and (-)100°F outside.

<u>Element No.</u>	<u>SAG008<sup>(1)</sup> (°F)</u>	<u>Hand Calculation (°F @ Mid Pt. of Elem.)</u>
724	110.38	110.7143
848	88.89	89.048
972	65.33	65.833
1096	42.12	42.619
1220	19.26	19.405
1344	(-)1.04	(-)0.7143

SAG008 runs on the Honeywell 66/60 system

References:

- (1) Wilson, E. L., Nickell, R. E., "Application of the Finite Element,"  
Journal of Nuclear Engineering and Design, 4, 1966.

TABLE 3F-5

SAG017 (FOUREXP)

The following is a verification of SAG017 with hand calculations for an arbitrary loading distribution which is an even function and can be expanded using a cosine Fourier Series. The periodic function is,  $f(\theta) = \begin{cases} -\theta & -\pi \leq \theta < 0 \\ \theta & 0 < \theta \leq \pi \end{cases}$

Comparison of Fourier Coefficients:

<u>n</u>	<u>SAG017(1)</u>	<u>Hand Calculations (2)</u>
0	1.5699	1.5708
1	-1.2739	-1.2732
2	-0.0019	0
3	-0.1421	-0.1415
4	-0.0019	0
5	-0.0516	-0.0509
6	-0.0020	0
7	-0.0266	-0.0260
8	-0.0021	0
9	-0.0164	-0.0157
10	-0.0022	0
11	-0.0112	-0.0105
12	-0.0023	0
13	-0.0082	-0.0075
14	-0.0025	0
15	-0.0063	-0.0057
16	-0.0028	0
17	-0.0051	-0.0044
18	-0.0031	0
19	-0.0042	-0.0035
20	-0.0036	0

1  
56

SAG017 runs on the Honeywell 66/60 system.

References:

- (1) The Fourier coefficients are computed for a digitized function by a recursive technique described in Mathematical Methods for Digital Computers, by Rolsten and Wilf, John Wiley and Sons, New York, 1960, Chapter 24. The solution technique is from subroutine FORIT in the IBM Scientific Subroutine package. The program is run on the Honeywell 66/60 system.
- (2) Wylie, C. R., Advanced Engineering Mathematics, 4th Ed., McGraw-Hill, 1975.

SB 1 & 2  
FSAR

TABLE 3F-6

SAG024 (MMIC)

The following is a comparison of the results of hand calculations with SAG024 for the weight of a typical lumped mass point in a dynamic model of a shear building.

<u>Parameter</u>	<u>SAG024 (1)</u>	<u>Hand Calculation</u>
$X_{CM}$ (X-Coordinate of the Center of Mass) - ft.	26.19	26.19
$Y_{CM}$ (Y-Coordinate of the Center of Mass) - ft.	0.08	0.08
$W_T$ (Total Weight of Mass Point) - Kips	1444	1444
$I_{MX}$ (Rotary Weight Moment of Inertia about X-Axis) K-ft <sup>2</sup>	162,323	162,320
$I_{MY}$ (Rotary Weight Moment of Inertia about Y-Axis) K-ft <sup>2</sup>	379,552	379,550
$I_{MZ}$ (Rotary Weight Moment of Inertia about Z-Axis) K-ft <sup>2</sup>	470,152	470,150

SAG024 runs on the Honeywell 66/60 system.

Reference:

- (1) Bear, F. P. and Johnston, R. E., Jr., Vector Mechanics for Engineers: Static and Dynamics, McGraw-Hill, 1962, pps. 343-347.

SB 1 & 2  
FSAR

TABLE 3F-7

SAG025 (SECTION)

The following is a comparison of the results of hand calculations with SAG025 for a system of resisting structural elements between floors in a typical shear building.

	<u>SAG025</u>	<u>Hand Calculations</u>
X <sub>CR</sub> (X-Coordinate of Center of Rigidity) - ft.	26.3	26.257
Y <sub>CR</sub> (Y-Coordinate of Center of Rigidity) - ft.	0.0	0.0
A <sub>T</sub> (Area) - ft	466.0	466.0
S <sub>FX</sub> (Shear Shape Factor about X-Axis)	.456	0.456
S <sub>FY</sub> (Shear Shape Factor about Y-Axis)	.555	0.555
I <sub>XX</sub> (Moment of Inertia about X-Axis) - ft.	11,100	11,079
I <sub>YY</sub> (Moment of Inertia about Y-Axis) - ft.	44,000	43,957
J (Torsional Constant) - ft.	117,000	117,470

SAG025 runs on the Honeywell 66/60 system.

TABLE 3F-8  
(Sheet 1 of 2)

PM-910 (LESCAL)

The following is a comparison of the results from the LESCAL computer program with hand calculations. LESCAL calculates the stresses and strains in rebar and/or concrete in accordance with the criteria set forth in Subarticle CC-3511.1 of ASME Section III, Division II. The section is concrete reinforced with horizontal, vertical and/or diagonal rebars, subjected to axial force and moment on a vertical and horizontal face and in-plane shear. When inplane shear forces are included, a solution is obtained by solving Duchon's equations<sup>(1)</sup>.

<u>Load Condition</u>	<u>Parameter</u>	<u>LESCAL (Ksi)</u>	<u>Hand Calculations</u>	
D + P <sub>a</sub> + E <sub>s</sub> Applied @ c.g. of Concrete Section	f <sub>m</sub> outside	29.39	29.46	56
	f <sub>h</sub> outside	23.08	23.05	56
	f <sub>seis.</sub> (3)	52.26	52.35	56
	f <sub>seis.</sub> (4)	0.21	0.21	
	f <sub>m</sub> inside	26.67	26.75	
	f <sub>h</sub> inside	23.82	23.77	
D+1.25P <sub>a</sub> +1.25E <sub>o</sub> Applied @ c.g. of Concrete Section	f <sub>m</sub> outside	-2.22	-2.99	
	f <sub>h</sub> outside	-0.41	-0.16	56
	f <sub>seis.</sub> (3)	9.70	9.47	
	f <sub>seis.</sub> (4)	-12.34	-12.63	
	f <sub>m</sub> inside	38.37	39.34	
	f <sub>h</sub> inside	1.98	2.12	
D + P <sub>a</sub> + E <sub>s</sub> Applied @ c.g. of Rebar	f <sub>m</sub> outside	37.70	37.70	
	f <sub>h</sub> outside	25.08	25.07	
	f <sub>seis.</sub> (3)	57.41	57.41	
	f <sub>seis.</sub> (4)	5.37	5.37	
	f <sub>m</sub> inside	12.74	12.73	
	f <sub>h</sub> inside	19.01	19.01	

TABLE 3F-8  
(Sheet 2 of 2)

<u>Load Condition</u>	<u>Parameter</u>	<u>LESCAL (Ksi)</u>	<u>Hand Calculations</u>
D+1.25P <sub>g</sub> +1.25E <sub>o</sub> Applied @ c.g. of Rebar	f <sub>m</sub> outside	-2.01	-1.77
	f <sub>h</sub> outside	7.33	7.82
	f <sub>seis.</sub> (3)	16.07	16.08
	f <sub>seis.</sub> (4)	-10.76	-10.02
	f <sub>m</sub> inside	40.94	40.64
	f <sub>h</sub> inside	9.54	10.06

LESCAL runs on the Honeywell 66/60 system.

Notes (3) and (4) indicate directions of seismic rebars.

References:

- (1) Duchon, N. B., "Analysis of Reinforced Concrete Membrane Subject to Tension and Shear," ACI Journal, September 1972, pp. 578-583.


SB 1 & 2  
FSAR

TABLE 3F-9

SAG054 (RESPONSE ENVELOPE)


SAG054 is a post-processing program for STARDYNE which is used in seismic analysis. The program spreads the peaks of the amplified response spectra created by SAG058 (See Table 3F-1) by a predetermined amount and tabulates the ordinates and abscissas of the resulting curve. Verification of this program is accomplished by visual inspection of the graphical output to insure that the raw data has, in fact, been enveloped. SAG054 runs on the CDC CYBER-175 system.

---

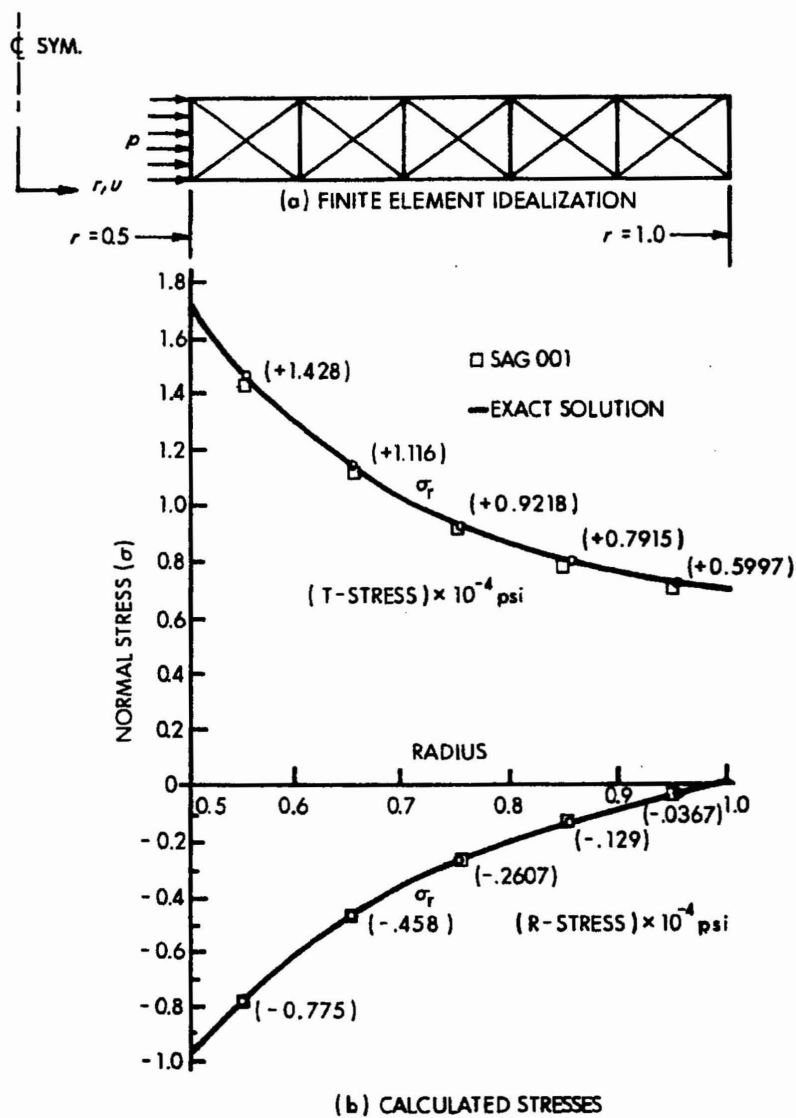

ANALYSIS OF THICK-WALLED CYLINDER UNDER INTERNAL PRESSURE


REFERENCE: GALLAGHER, R.H., FINITE ELEMENT ANALYSIS, PRENTICE-HALL, INC.  
1975. FIGURE 11.5, PG.317

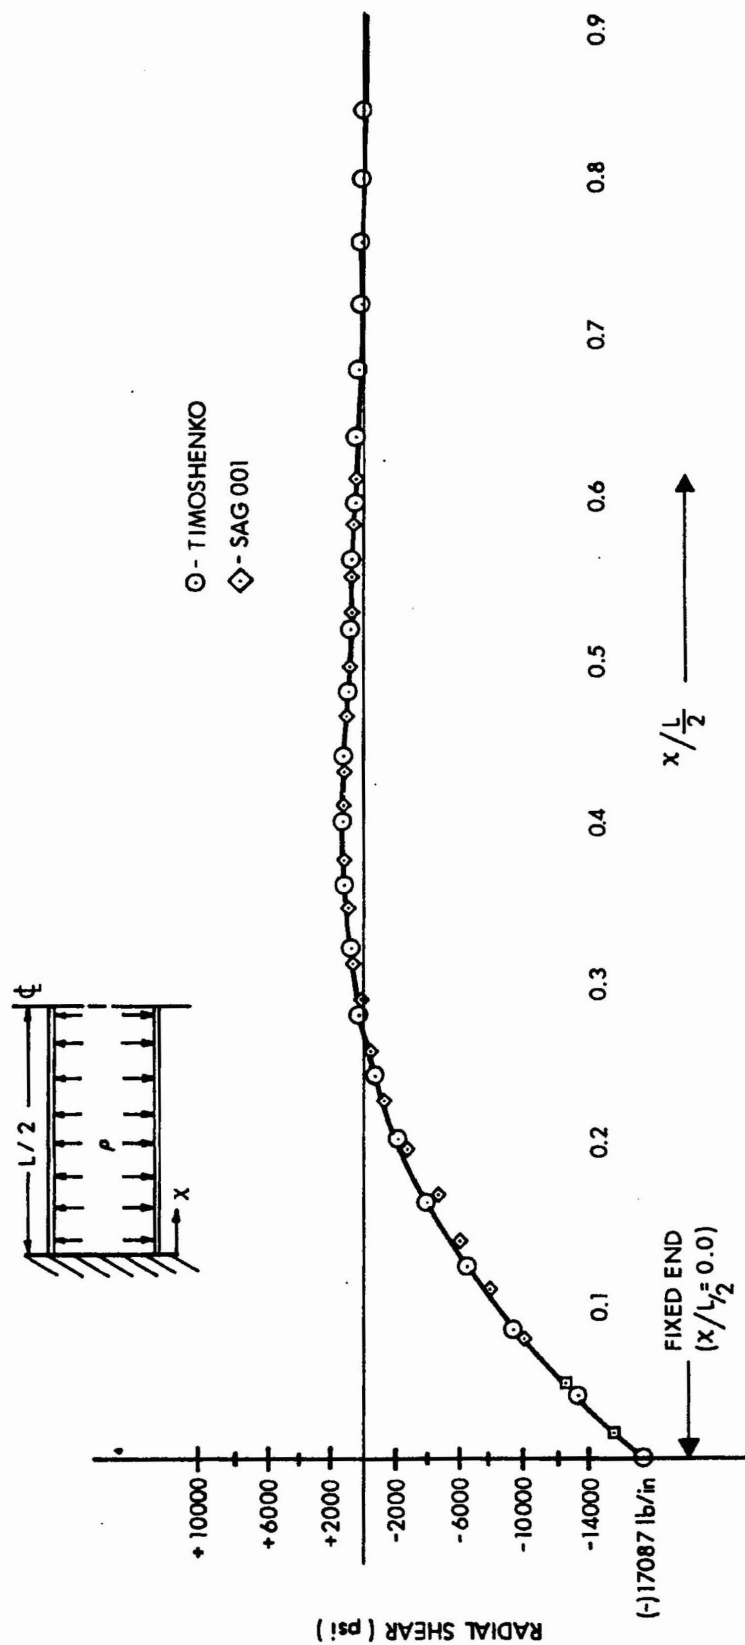

PUBLIC SERVICE COMPANY OF NEW HAMPSHIRE  
SEABROOK STATION - UNITS 1 & 2  
FINAL SAFETY ANALYSIS REPORT

SAG001 SAMPLE PROBLEM NO.2  
RADIAL SHEAR

FIGURE 3F-2

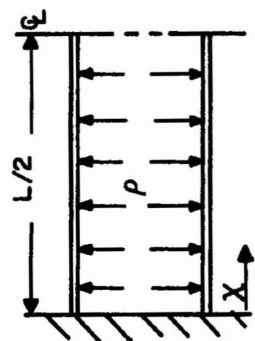

- TIMOSHENKO
- △ SAGOO1(COARSE MESH)
- ◇ SAGOO1(FINE MESH)

