

Comanche Peak Nuclear Power Plant, Units 3 & 4  
COL Application  
Part 2, FSAR

1Hz+2.5Hz,  $10^{-6}$

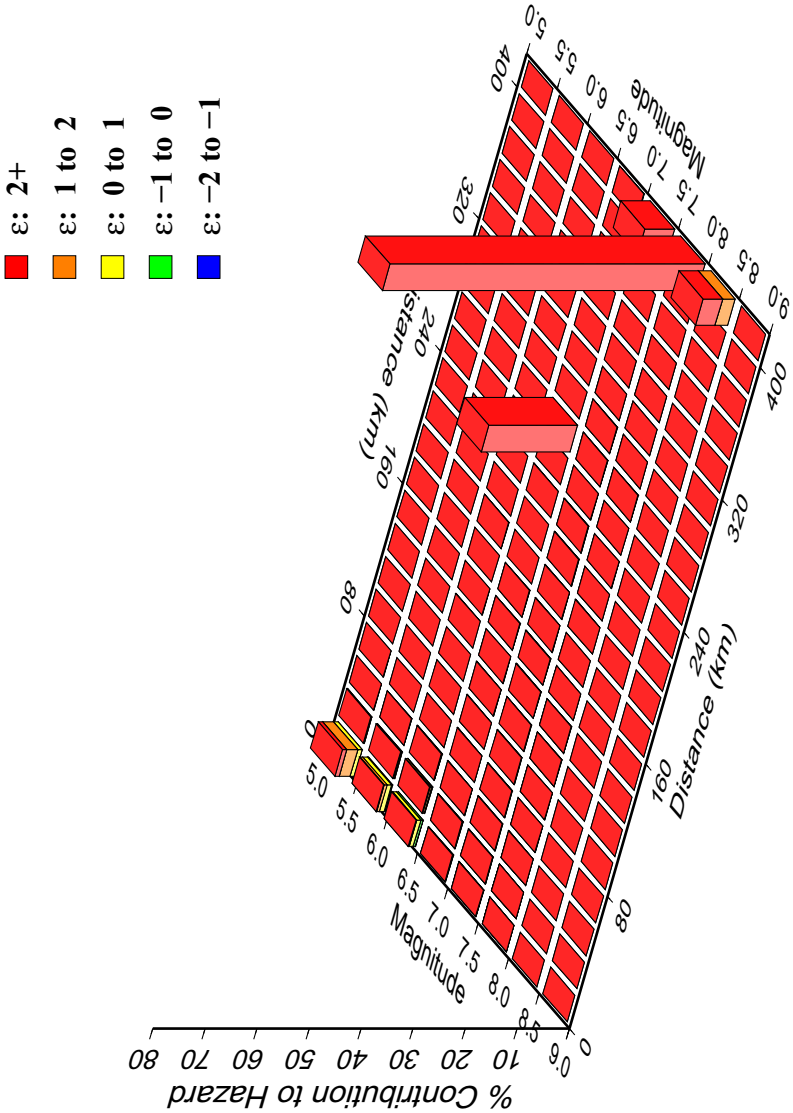


Figure 2.5.2-228 Deaggregation of  $10^{-6}$  Rock Hazard for 1 and 2.5 Hz