


Comanche Peak Nuclear Power Plant, Units 3 & 4
COL Application
Part 2, FSAR

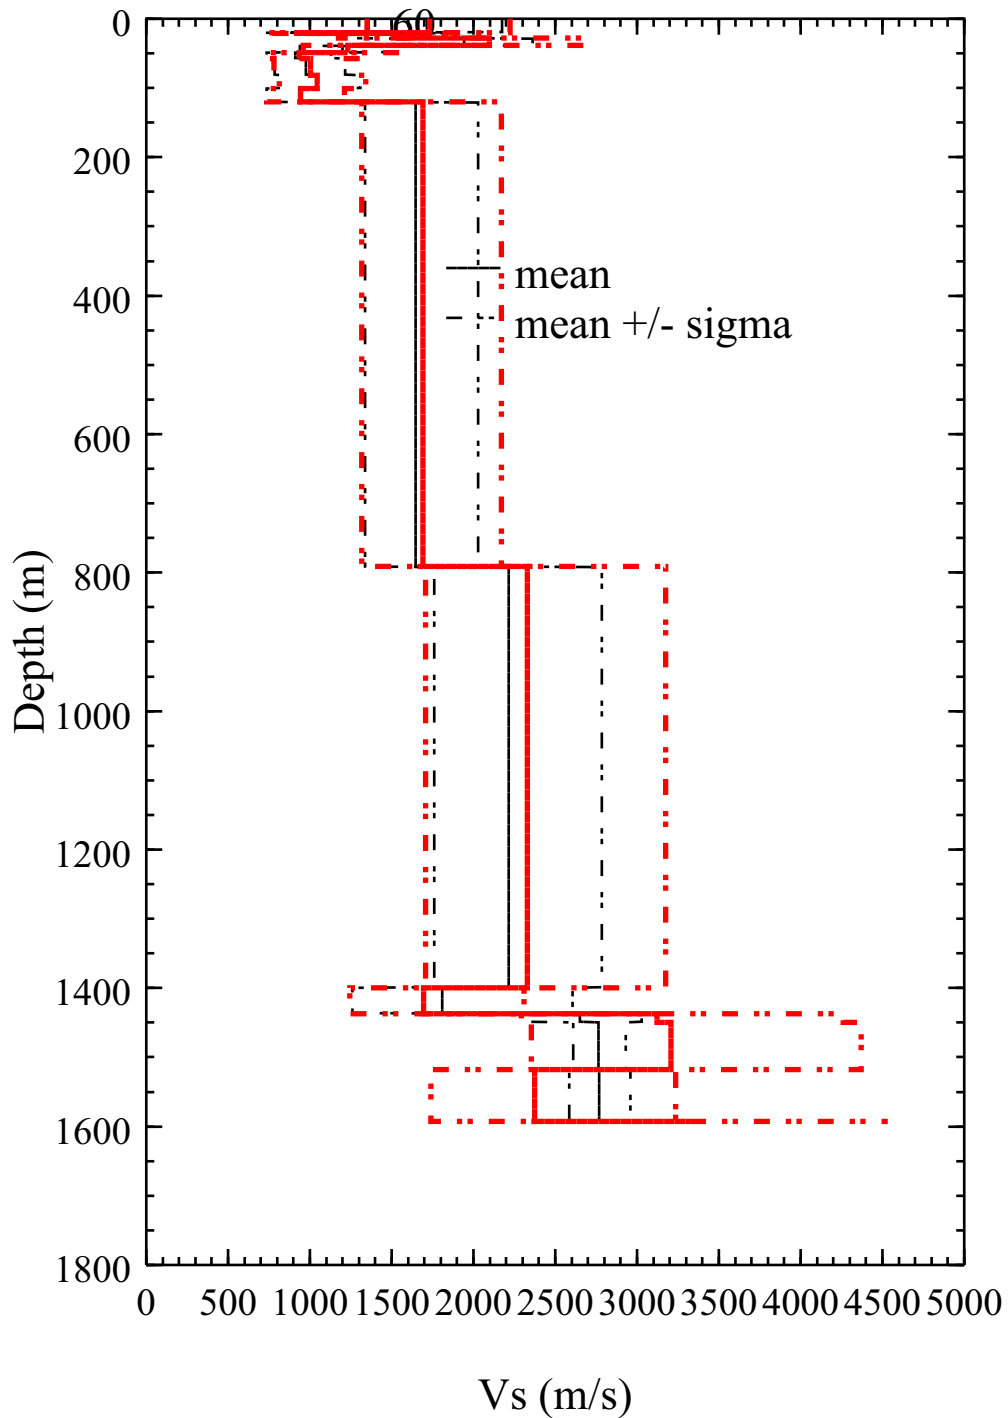

Note: The calculated median+sigma from the artificial profiles (black dashed line) is lower than the target median+sigma at depths greater than 800 m because the distribution of Vs is truncated by the Vs of bedrock (9200 fps or 2,804 m/s) implicit in the EPRI attenuation equations.

**Figure 2.5.2-241 Summary Statistics from Synthetic Profiles for GMRS/FIRS1
Site Column Compared to Values in Table 2.5.2-227**