

Comanche Peak Nuclear Power Plant, Units 3 & 4  
COL Application  
Part 2, FSAR

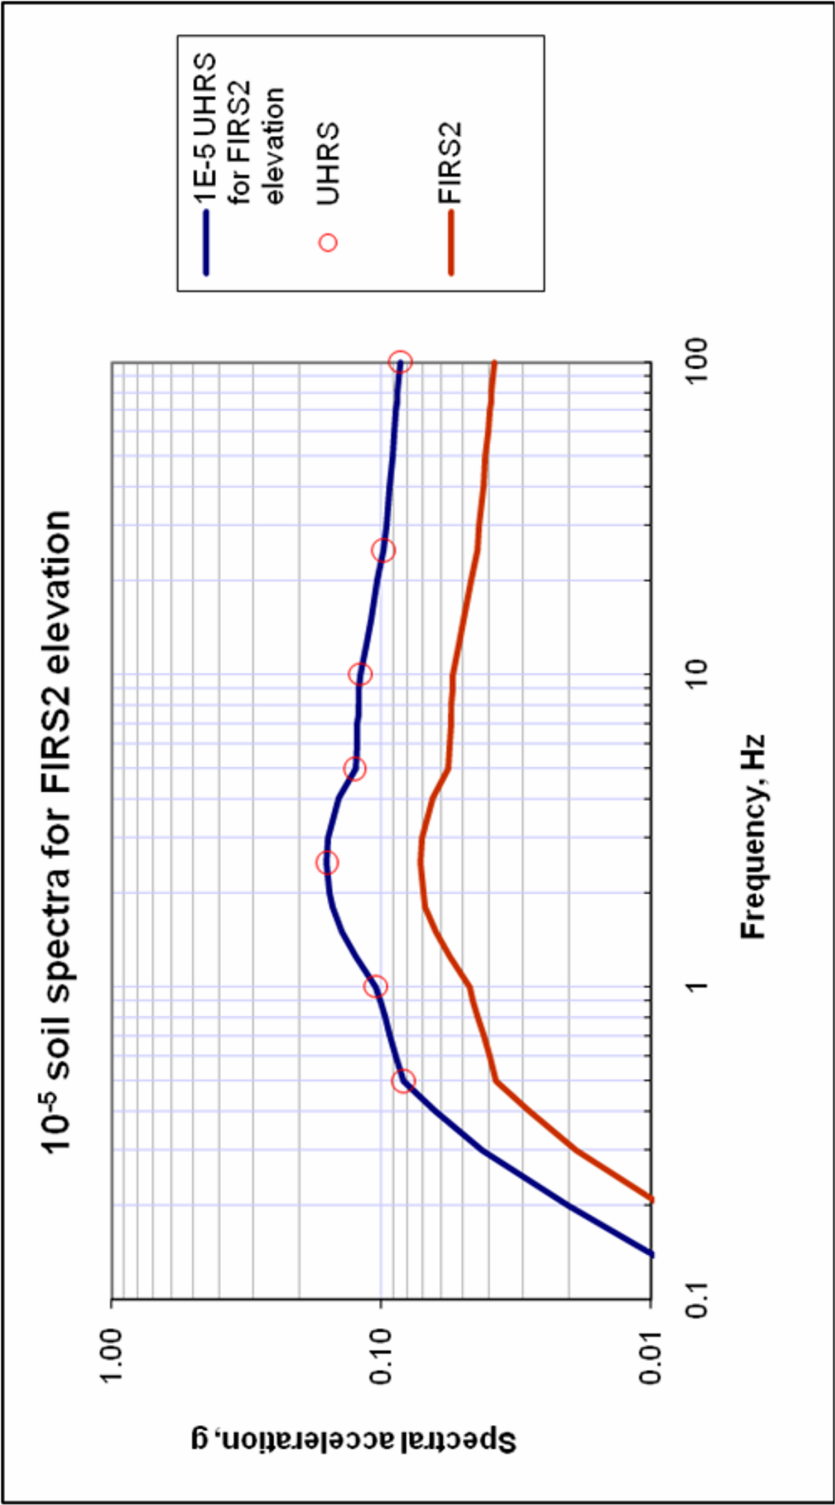


Figure 2.5.2-248 Comanche Peak 1E-5 UHRS (for FIRS2 Conditions) and FIRS2, Horizontal