

Comanche Peak Nuclear Power Plant, Units 3 & 4
COL Application
Part 2, FSAR

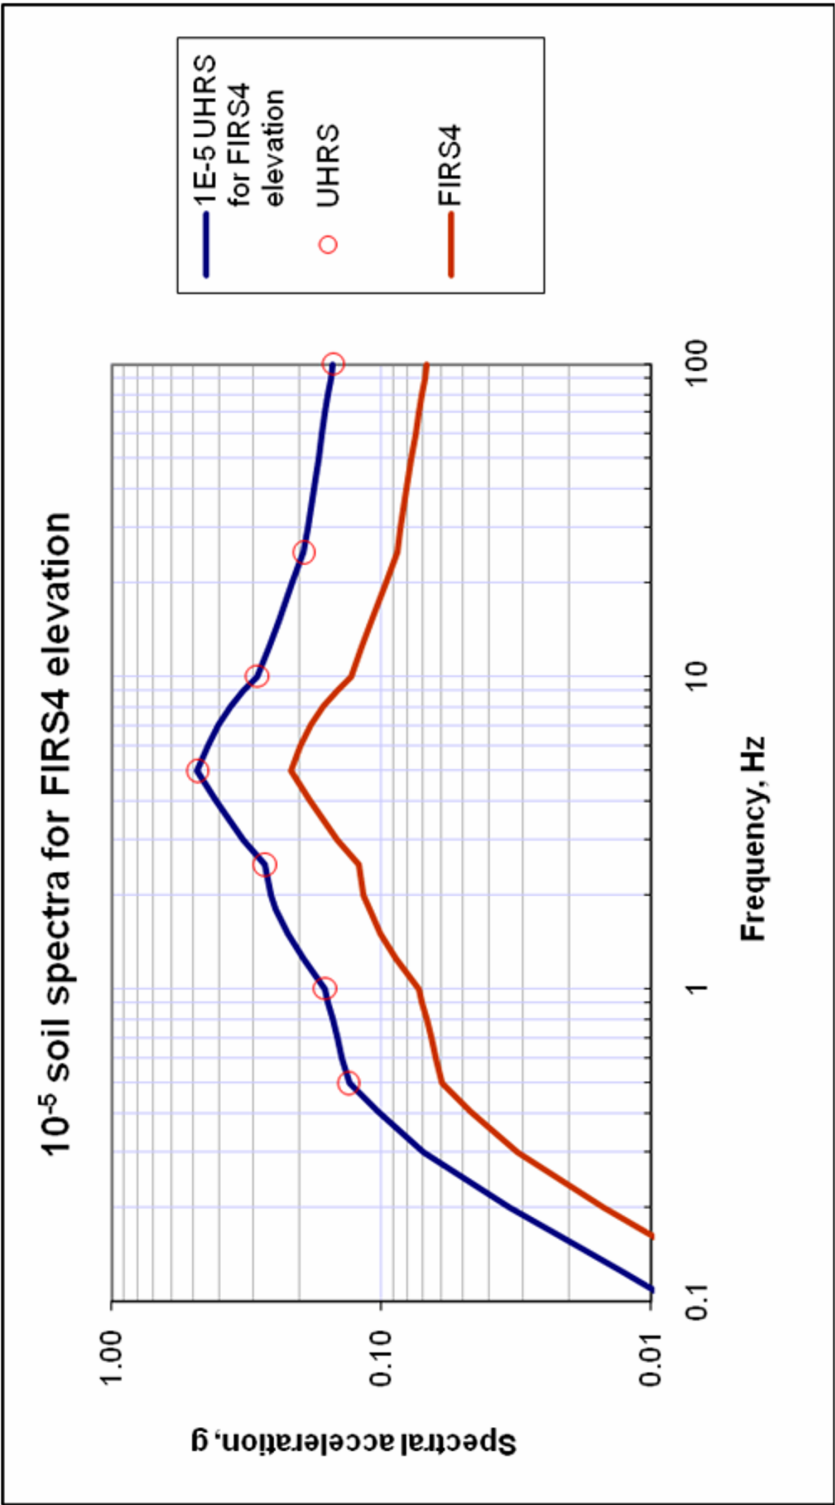


Figure 2.5.2-250 Comanche Peak 1E-5 UHRS (for FIRS4 Conditions) and FIRS4, Horizontal