

Comanche Peak Nuclear Power Plant, Units 3 & 4  
COL Application  
Part 2, FSAR

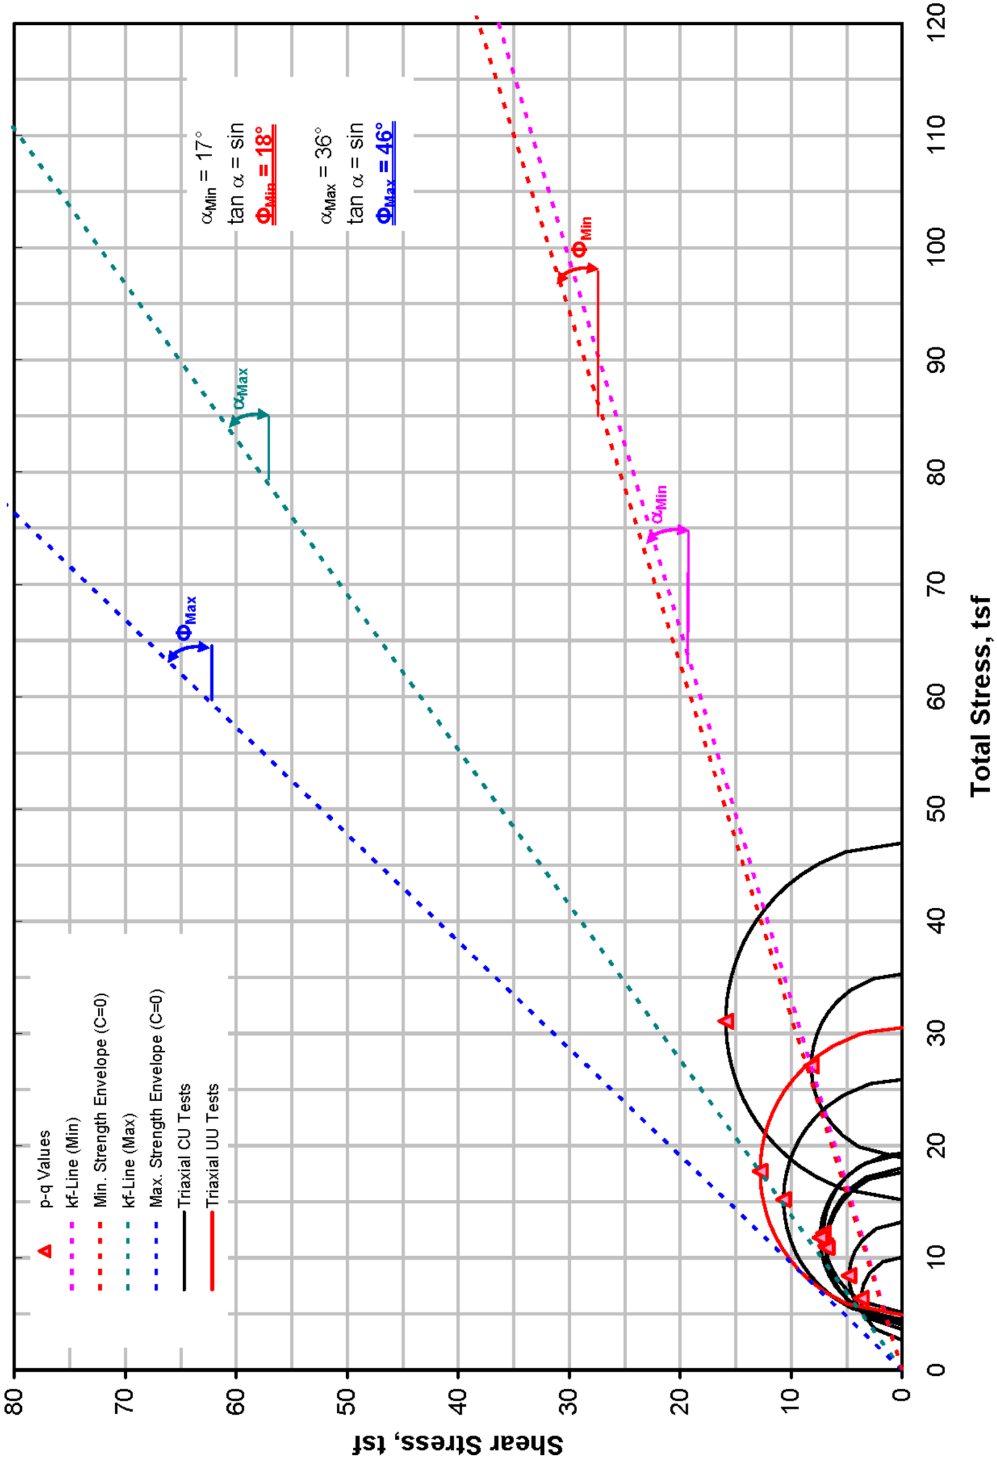


Figure 2.5.4-234 Ultimate Strength of Shale from Consolidated-Undrained and Unconsolidated-Undrained Triaxial Tests