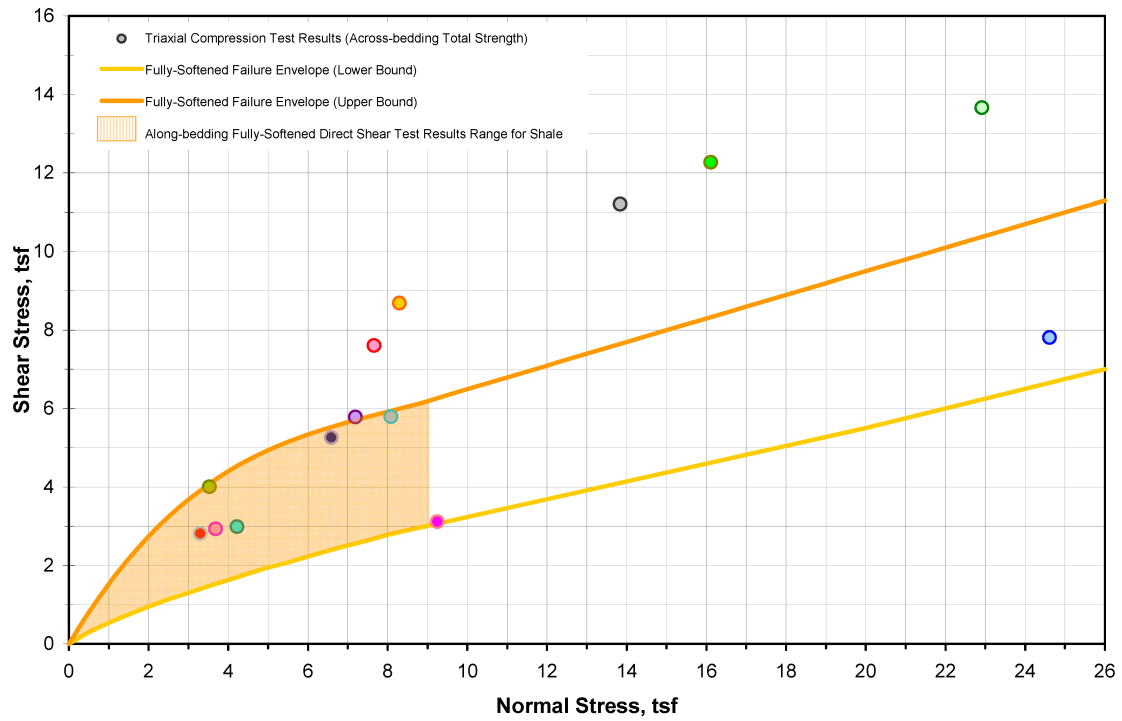


**Comanche Peak Nuclear Power Plant, Units 3 & 4**  
**COL Application**  
**Part 2, FSAR**



**Figure 2.5.4-236 Fully-Softened Direct Shear Test Range with Triaxial Test Data**