



August 5, 2011

NRC 2011-0075
TS 5.6.4

U.S. Nuclear Regulatory Commission
ATTN: Document Control Desk
Washington DC 20555

Point Beach Nuclear Plant Unit 2
Docket No. 50-301
Renewed License No. DPR-27

Unit 2 Cycle 32 (U2C32) Core Operating Limits Report

In accordance with the requirements of Point Beach Nuclear Plant (PBNP) Technical Specification 5.6.4, enclosed is revised TRM 2.1, COLR, Unit 2, Cycle 32.

The enclosure to this letter contains the revised PBNP U2C32 COLR that was issued on August 2, 2011.

This letter contains no new regulatory commitments and no revisions to existing commitments.

Very truly yours,

NextEra Energy Point Beach, LLC


James Costedio
Licensing Manager

Enclosure

cc: Administrator, Region III, USNRC
Project Manager, Point Beach Nuclear Plant, USNRC
Resident Inspector, Point Beach Nuclear Plant, USNRC
PSCW

ENCLOSURE

**NEXTERA ENERGY POINT BEACH, LLC
POINT BEACH NUCLEAR PLANT, UNIT 2**

**CORE OPERATING LIMITS REPORT (COLR)
UNIT 2 CYCLE 32 (U2C32)**

TRM 2.1

CORE OPERATING LIMITS REPORT
(COLR)

UNIT 2 CYCLE 32

REVISION 15

CORE OPERATING LIMITS REPORT (COLR)
UNIT 2 CYCLE 32

1.0 CORE OPERATING LIMITS REPORT

This Core Operating Limits Report (COLR) for Point Beach Nuclear Plant has been prepared in accordance with the requirements of Technical Specification (TS) 5.6.4.

A cross-reference between the COLR sections and the PBNP Technical Specifications affected by this report is given below:

<u>COLR</u> <u>Section</u>	<u>PBNP</u> <u>TS</u>	<u>Description</u>
2.1	2.1.1	Reactor Core Safety Limits
2.2	3.1.1	Shutdown Margin
	3.1.4	Rod Group Alignment Limits
	3.1.5	Shutdown Bank Insertion Limits
	3.1.6	Control Bank Insertion Limits
	3.1.8	Physics Test Exceptions
2.3	3.1.3	Moderator Temperature Coefficient
2.4	3.1.5	Shutdown Bank Insertion Limit
2.5	3.1.6	Control Bank Insertion Limits
2.6	3.2.1	Nuclear Heat Flux Hot Channel Factor ($F_Q(Z)$)
2.7	3.2.2	Nuclear Enthalpy Rise Hot Channel Factor ($F_{\Delta H}^N$)
2.8	3.2.3	Axial Flux Difference (AFD)
2.9	3.3.1	Overtemperature ΔT Setpoint
2.10	3.3.1	Overpower ΔT Setpoint
2.11	3.4.1	RCS Pressure, Temperature, and Flow Departure from Nucleate Boiling (DNB) Limits
2.12	3.9.1	Refueling Boron Concentration
Figure 1	2.1.1	Reactor Core Safety Limits Curve
Figure 2	3.1.1	Required Shutdown Margin
Figure 3	3.1.6	Control Bank Insertion Limits
Figure 4	3.2.1	Hot Channel Factor Normalized Operating Envelope ($K(Z)$) for 422V+ Fuel
Figure 5	3.2.1	Summary of $W(Z)$ as a Function of Core Height
Figure 5A	3.2.1	BOC Part-Power Summary of $W(Z)$ as a Function of Core Height
Figure 6	3.2.3	Flux Difference Operating Envelope

CORE OPERATING LIMITS REPORT (COLR)
UNIT 2 CYCLE 32

2.0 OPERATING LIMITS

The cycle-specific parameter limits for the specifications listed in Section 1.0 are presented in the following subsections. These limits have been developed using the NRC approved methodologies specified in Technical Specification 5.6.4.

2.1 Reactor Core Safety Limits (TS 2.1.1)

The combination of THERMAL POWER, Reactor Coolant System (RCS) highest loop average temperature, and pressurizer pressure shall not exceed the limits specified in Figure 1.

Applicability: MODES 1 and 2

2.2 Shutdown Margin (TS 3.1.1 and referenced in TS 3.1.4, 3.1.5, 3.1.6, and 3.1.8)

2.2.1 SDM shall be $\geq 2.0\% \Delta k/k$ (see Figure 2).

Applicability: MODES 1, 2, and 3

2.2.2 SDM shall be $\geq 1\% \Delta k/k$.

Applicability: MODES 4 and 5

2.3 Moderator Temperature Coefficient (TS 3.1.3)

2.3.1 The upper MTC limits shall be maintained within the limits.

2.3.2 The maximum upper MTC limits shall be:

$\leq 5 \text{ pcm}/^\circ\text{F}$ for power levels $\leq 70\% \text{ RTP}$
 $\leq 0 \text{ pcm}/^\circ\text{F}$ for power levels $> 70\% \text{ RTP}$

Applicability: MODE 1 and MODE 2 with $k_{\text{eff}} \geq 1.0$.

2.4 Shutdown Bank Insertion Limit (TS 3.1.5)

NOTE: This limit is not applicable while performing SR 3.1.4.2.

2.4.1 Each shutdown bank shall be fully withdrawn.

2.4.2 Fully withdrawn is defined as ≥ 225 steps.

Applicability: MODES 1 and 2

CORE OPERATING LIMITS REPORT (COLR)
UNIT 2 CYCLE 32

2.5 Control Bank Insertion Limits (TS 3.1.6)

NOTE: This limit is not applicable while performing SR 3.1.4.2.

The control banks shall be within the insertion, sequence and overlap limits specified in Figure 3.

Applicability: MODE 1 and MODE 2 with $k_{eff} \geq 1.0$

2.6 Nuclear Heat Flux Hot Channel Factor ($F_Q(Z)$) (TS 3.2.1)

The Heat Flux Hot Channel Factor shall be within the following limits:

$$F_Q(Z) \leq CF_Q * K(Z) / P \text{ for } P > 0.5$$

$$F_Q(Z) \leq CF_Q * K(Z) / 0.5 \text{ for } P \leq 0.5$$

Where P is the fraction of Rated Power at which the core is operating.

$F_Q(Z)$ is both:

- Steady State $F_Q^C(Z) = F_Q(Z) * 1.08$
- Transient $F_Q^W(Z) = F_Q^C(Z) * W(Z) / P \text{ for } P > 0.5$
 $F_Q^W(Z) = F_Q^C(Z) * W(Z) / 0.5 \text{ for } P \leq 0.5$

$$CF_Q = 2.60$$

$K(Z)$ is the function in Figure 4

$W(Z)$ is the function in Figures 5 and 5A

The following F_Q penalty factors are applicable to Cycle 32.

Cycle Burnup (MWD/MTU)	$F_Q^W(Z)$ Penalty Factors
150	1.0216
297	1.0221
443	1.0224
590	1.0224
737	1.0217
884 to End-of-Cycle	1.02

Applicability: MODE 1

CORE OPERATING LIMITS REPORT (COLR)
UNIT 2 CYCLE 32

2.7 Nuclear Enthalpy Rise Hot Channel Factor ($F_{\Delta H}^N$) (TS 3.2.2)

The Nuclear Enthalpy Rise Hot Channel Factor shall be within the following limit:

$$2.7.1 \quad F_{\Delta H}^N < 1.68 \times [1 + 0.3(1-P)]$$

where: P is the fraction of Rated Power at which the core is operating.

Applicability: MODE 1

2.8 Axial Flux Difference (AFD) (TS 3.2.3)

The AFD target band is $\pm 5\%$.

The AFD Acceptability Operation Limits are provided in Figure 6.

Applicability: MODE 1 with THERMAL POWER >15% RTP

2.9 Overtemperature ΔT Setpoint (TS 3.3.1, Table 3.3.1-1 note 1)

Overtemperature ΔT setpoint parameter values (for 1800 MWt core power):

ΔT_o	=	indicated ΔT at RTP, °F
T	=	indicated RCS average temperature, °F
T'	≤	576.0°F
P'	=	2235 psig
K ₁	≤	1.175 (NTSP) ¹
K ₁	≤	1.188 (AV) ²
K ₂	=	0.016
K ₃	=	0.000811
τ_1	=	40 sec
τ_2	=	8 sec
τ_3	=	4 sec
τ_4	=	2 sec

$f(\Delta I)$ is an event function of the indicated difference between top and bottom detectors of the power-range nuclear ion chambers; with gains to be selected based on measured instrument response during plant startup tests, where q_t and q_b are the percent power in the top and bottom halves of the core respectively, and $q_t + q_b$ is total core power in percent of RTP, such that:

¹ Nominal Setpoint Value

² Allowable Value

CORE OPERATING LIMITS REPORT (COLR)
UNIT 2 CYCLE 32

- 2.9.1 For $q_t - q_b$ within -12, +6 percent, $f(\Delta I) = 0$.
- 2.9.2 For each percent that the magnitude of $q_t - q_b$ exceeds +6 percent, the ΔT trip setpoint shall be automatically reduced by an equivalent of 2.00 percent of Rated Power.
- 2.9.3 For each percent that the magnitude of $q_t - q_b$ exceeds -12 percent, the ΔT trip setpoint shall be automatically reduced by an equivalent of 2.69 percent of Rated Power.

Applicability: MODES 1 and 2

2.10 Overpower ΔT Setpoint (TS 3.3.1, Table 3.3.1-1 note 2)

Overpower ΔT setpoint parameter values (for 1800 MWt core power):

ΔT_o	=	indicated ΔT at RTP, °F
T	=	indicated RCS average temperature, °F
T'	≤	576.0°F
K ₄	≤	1.098 (NTSP) ¹
K ₄	≤	1.111 (AV) ²
K ₅	=	0.0 for increasing T
K ₅	=	0.0 for decreasing T
K ₆	=	0.00123 for $T \geq T'$
K ₆	=	0.0 for $T < T'$
τ_5	=	0 sec
τ_3	=	4 sec
τ_4	=	2 sec

Applicability: MODES 1 and 2

¹ Nominal Setpoint Value

² Allowable Value

CORE OPERATING LIMITS REPORT (COLR)
UNIT 2 CYCLE 32

2.11 RCS Pressure, Temperature, and Flow Departure from Nucleate Boiling (DNB) Limits (TS 3.4.1)

2.11.1 Tavg shall be $\leq 577^{\circ}\text{F}$.

2.11.2 Pressurizer pressure shall be maintained ≥ 2205 psig during operation.

NOTE: Pressurizer pressure limit does not apply during:

- 1) THERMAL POWER ramp $> 5\%$ RTP per minute; or**
- 2) THERMAL POWER step $> 10\%$ RTP.**

2.11.3 Reactor Coolant System raw measured Total Flow Rate shall be maintained $\geq 186,000$ gpm.

Applicability: MODE 1


2.12 Refueling Boron Concentration (TS 3.9.1)

Boron concentrations of the Reactor Coolant System, the refueling canal, and the refueling cavity shall be maintained ≥ 2300 ppm.

Applicability: MODE 6


CORE OPERATING LIMITS REPORT (COLR)
UNIT 2 CYCLE 32

FIGURE 1
REACTOR CORE SAFETY LIMITS CURVE
(Cores containing 422V+ fuel)

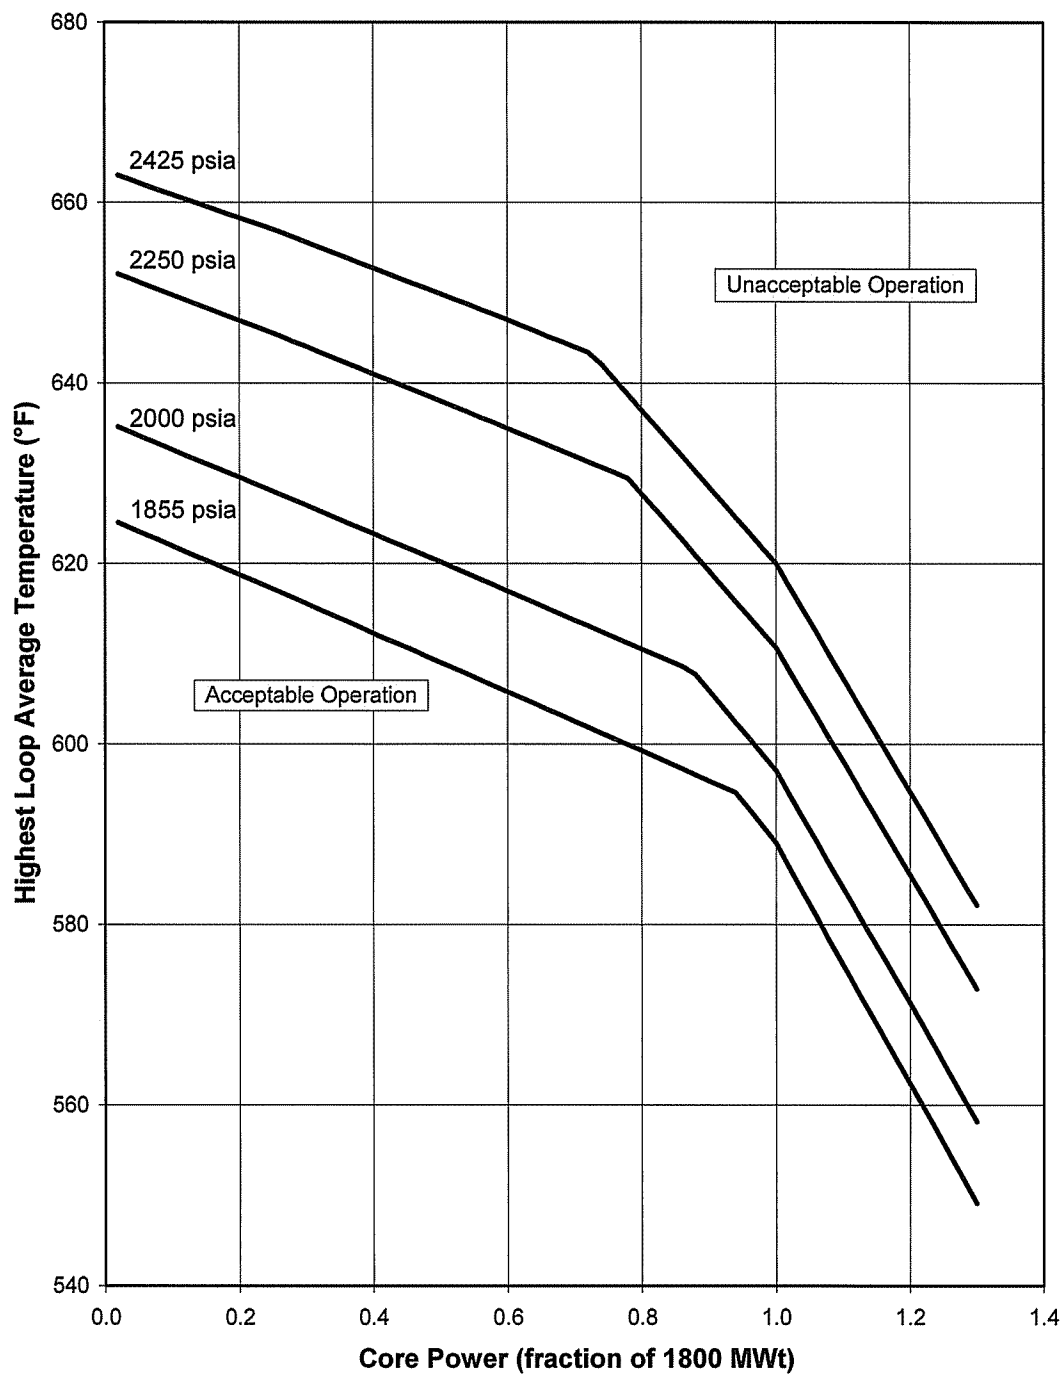


CORE OPERATING LIMITS REPORT (COLR)
UNIT 2 CYCLE 32

FIGURE 2
REQUIRED SHUTDOWN MARGIN

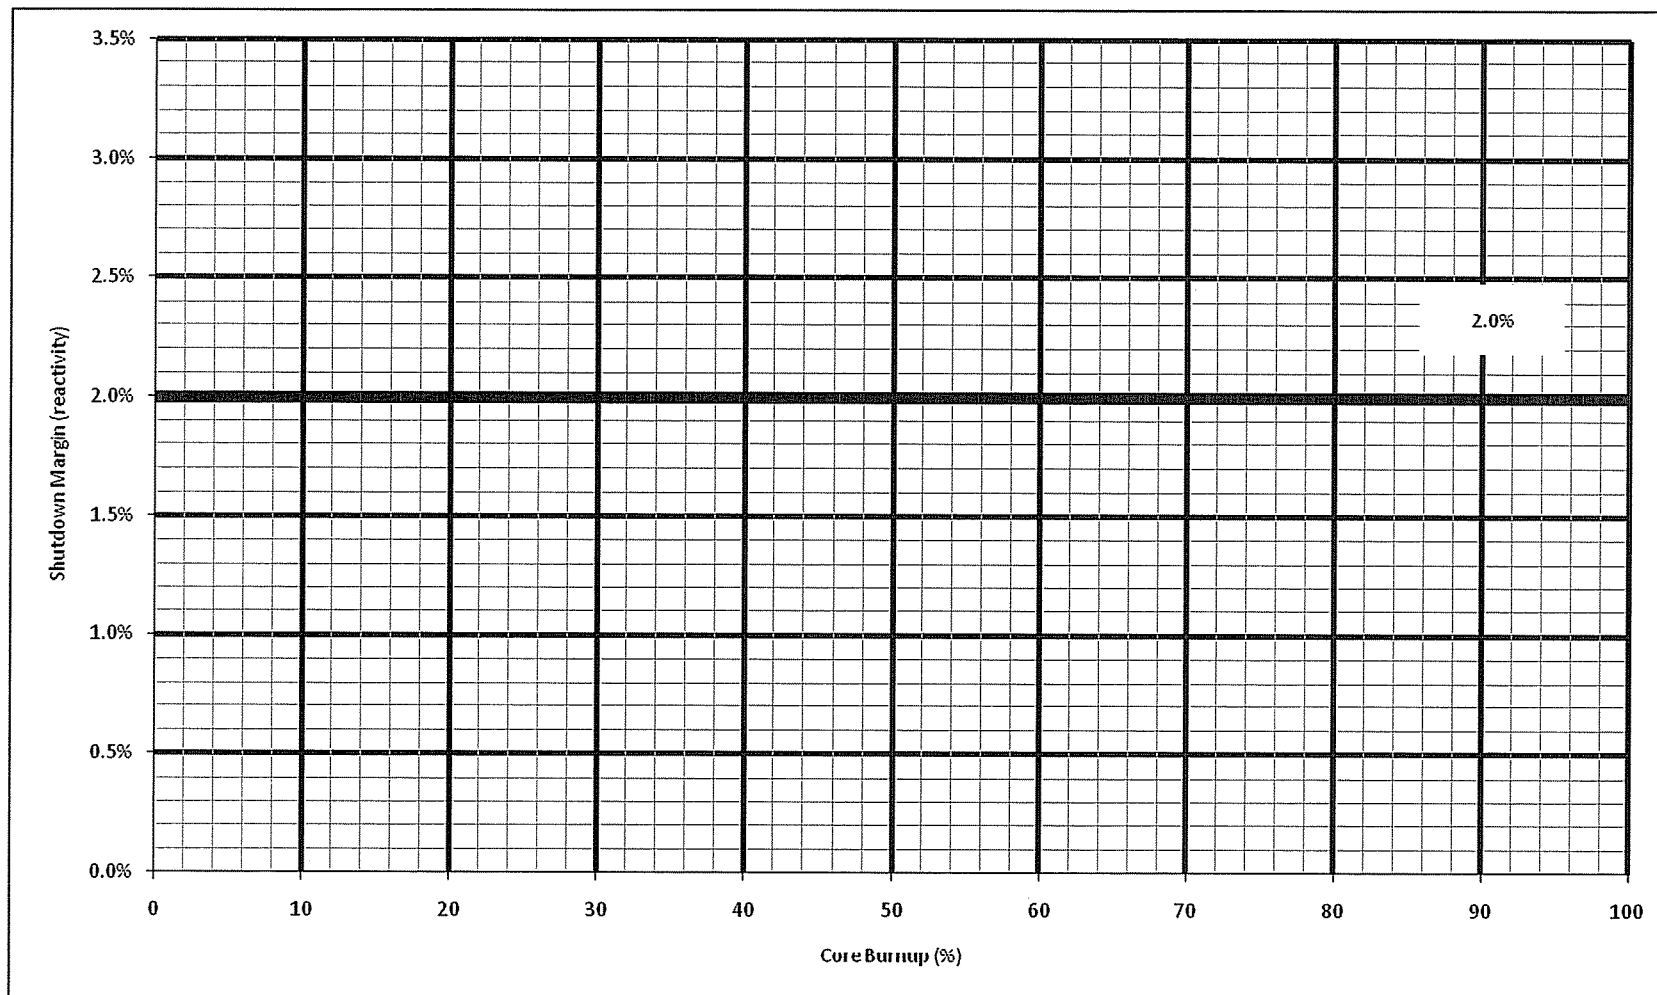

CORE OPERATING LIMITS REPORT (COLR)
UNIT 2 CYCLE 32


FIGURE 3
CONTROL BANK INSERTION LIMITS

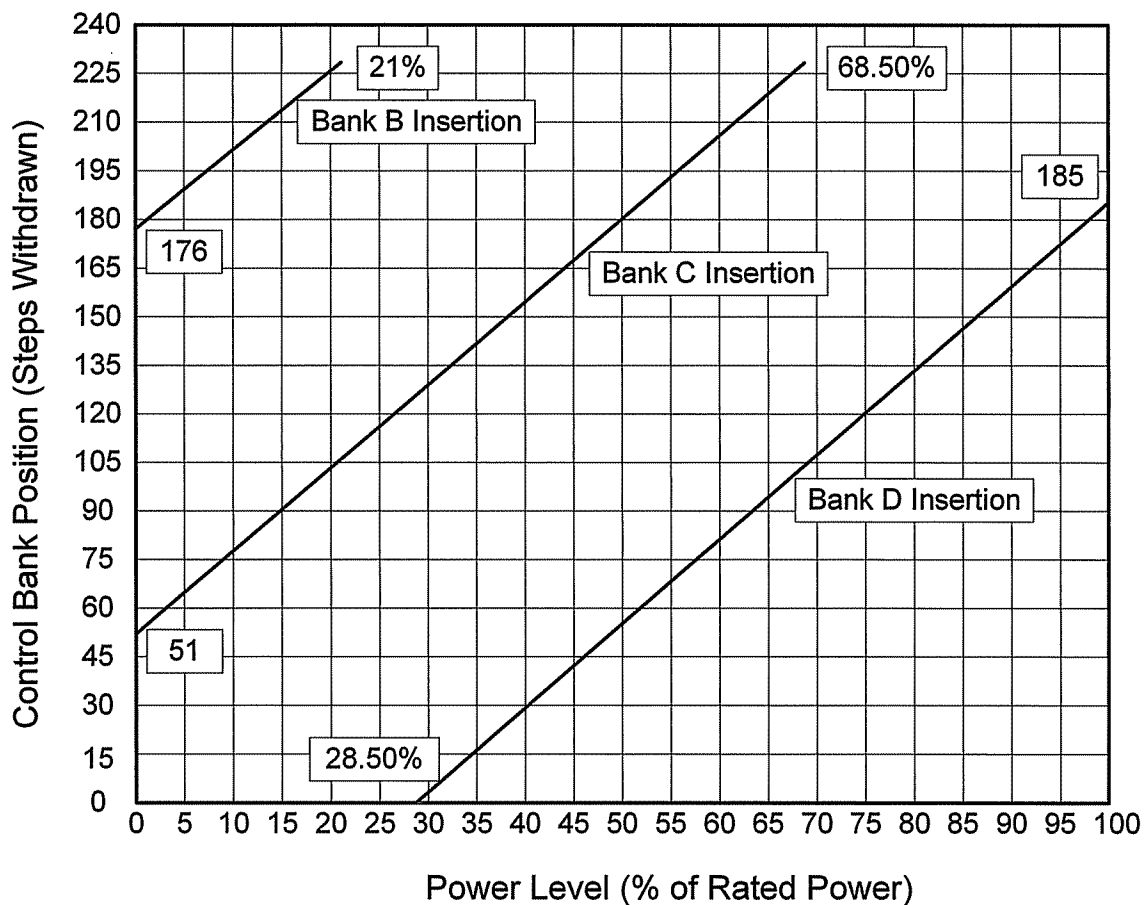

NOTE: The "fully withdrawn" parking position range ≥ 225 steps can be used without violating this Figure.

CORE OPERATING LIMITS REPORT (COLR)
UNIT 2 CYCLE 32

FIGURE 4
HOT CHANNEL FACTOR NORMALIZED OPERATING ENVELOPE (K(Z))
FOR 422V+ FUEL

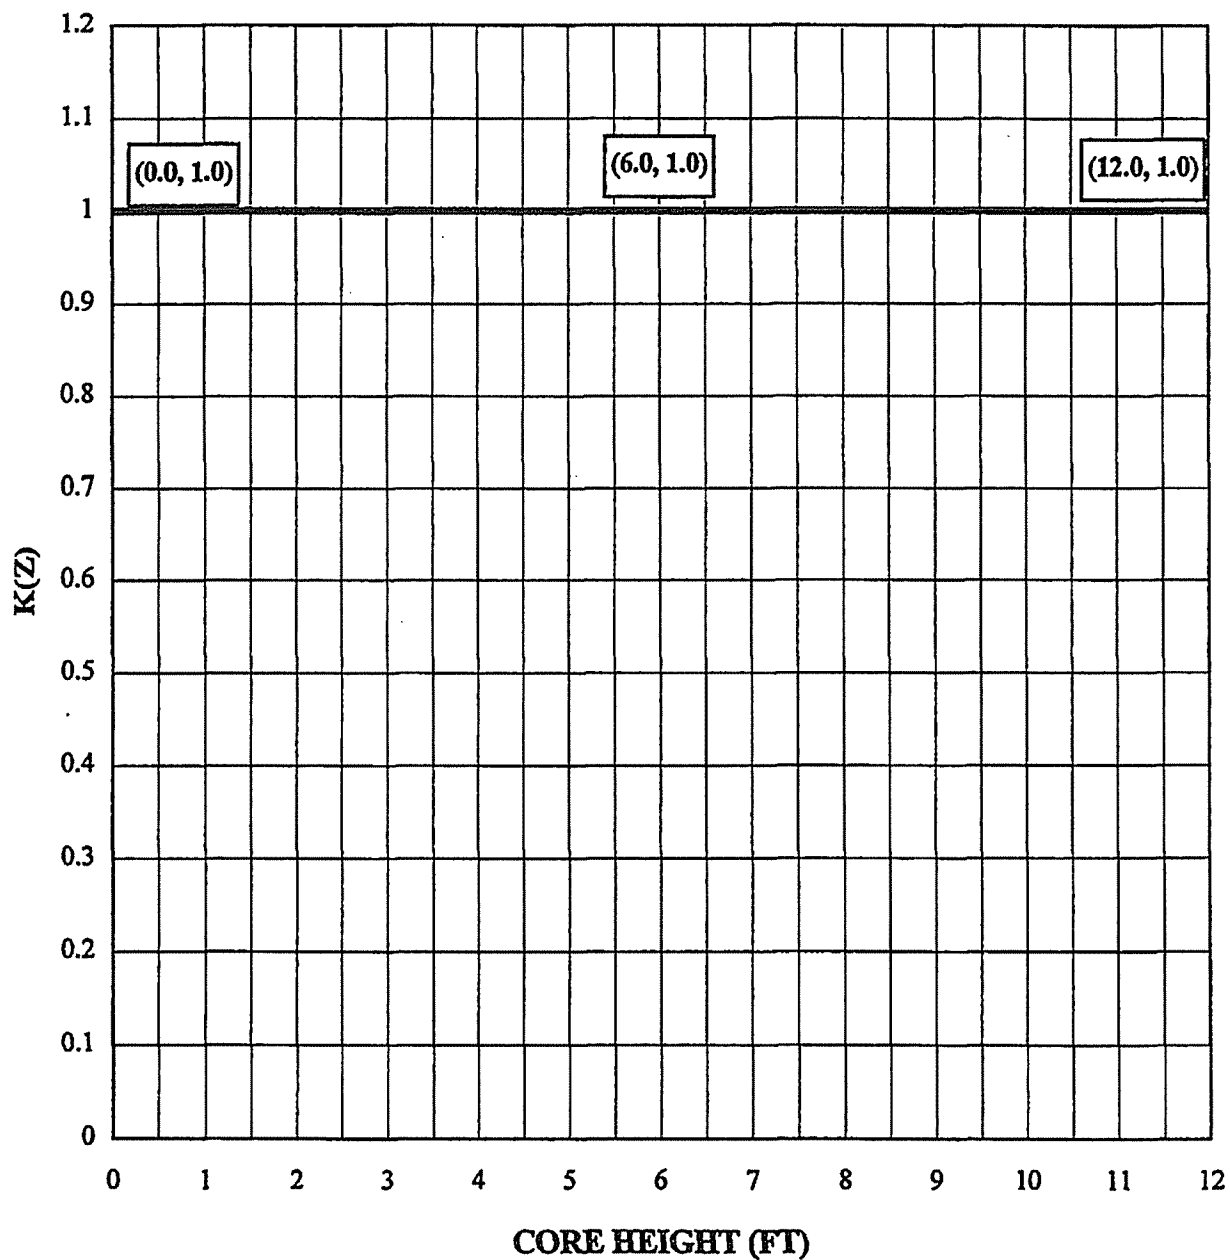

CORE OPERATING LIMITS REPORT (COLR)
UNIT 2 CYCLE 32

FIGURE 5
Summary of W(Z) as a Function of Core Height
(Top 15% and Bottom 12% Excluded)

Height (feet)	W(Z)				
	150 MWD/MTU	2000 MWD/MTU	8000 MWD/MTU	12000 MWD/MTU	16000 MWD/MTU
0.0	1.0000	1.0000	1.0000	1.0000	1.0000
0.2	1.0000	1.0000	1.0000	1.0000	1.0000
0.4	1.0000	1.0000	1.0000	1.0000	1.0000
0.6	1.0000	1.0000	1.0000	1.0000	1.0000
0.8	1.0000	1.0000	1.0000	1.0000	1.0000
1.0	1.0000	1.0000	1.0000	1.0000	1.0000
1.2	1.0000	1.0000	1.0000	1.0000	1.0000
1.4	1.0000	1.0000	1.0000	1.0000	1.0000
1.6	1.0980	1.0977	1.1091	1.1164	1.1225
1.8	1.0978	1.0977	1.1081	1.1145	1.1196
2.0	1.0974	1.0973	1.1066	1.1122	1.1162
2.2	1.0967	1.0966	1.1047	1.1093	1.1122
2.4	1.0957	1.0957	1.1024	1.1060	1.1076
2.6	1.0944	1.0945	1.0998	1.1022	1.1026
2.8	1.0929	1.0931	1.0968	1.0981	1.0973
3.0	1.0911	1.0913	1.0935	1.0935	1.0913
3.2	1.0892	1.0894	1.0896	1.0895	1.0870
3.4	1.0875	1.0876	1.0874	1.0869	1.0847
3.6	1.0864	1.0863	1.0855	1.0844	1.0827
3.8	1.0855	1.0855	1.0835	1.0841	1.0829
4.0	1.0845	1.0847	1.0825	1.0845	1.0839
4.2	1.0834	1.0836	1.0821	1.0852	1.0848
4.4	1.0823	1.0824	1.0816	1.0856	1.0855
4.6	1.0812	1.0809	1.0810	1.0858	1.0861
4.8	1.0800	1.0796	1.0803	1.0858	1.0864
5.0	1.0786	1.0782	1.0793	1.0856	1.0865
5.2	1.0769	1.0766	1.0783	1.0850	1.0862
5.4	1.0751	1.0747	1.0775	1.0841	1.0855
5.6	1.0730	1.0725	1.0764	1.0828	1.0845
5.8	1.0706	1.0702	1.0751	1.0812	1.0830
6.0	1.0684	1.0674	1.0734	1.0790	1.0811

CORE OPERATING LIMITS REPORT (COLR)
UNIT 2 CYCLE 32

FIGURE 5 (con't)
Summary of W(Z) as a Function of Core Height
(Top 15% and Bottom 12% Excluded)

Height (feet)	W(Z)				
	150 MWD/MTU	2000 MWD/MTU	8000 MWD/MTU	12000 MWD/MTU	16000 MWD/MTU
6.2	1.0663	1.0649	1.0714	1.0765	1.0786
6.4	1.0638	1.0625	1.0701	1.0735	1.0757
6.6	1.0618	1.0613	1.0689	1.0703	1.0730
6.8	1.0616	1.0614	1.0664	1.0704	1.0755
7.0	1.0611	1.0609	1.0674	1.0726	1.0795
7.2	1.0610	1.0612	1.0719	1.0765	1.0823
7.4	1.0636	1.0647	1.0759	1.0797	1.0849
7.6	1.0691	1.0702	1.0797	1.0827	1.0871
7.8	1.0746	1.0756	1.0831	1.0853	1.0890
8.0	1.0798	1.0808	1.0863	1.0879	1.0905
8.2	1.0849	1.0858	1.0893	1.0904	1.0916
8.4	1.0897	1.0905	1.0920	1.0924	1.0924
8.6	1.0943	1.0949	1.0943	1.0942	1.0929
8.8	1.0985	1.0991	1.0962	1.0955	1.0931
9.0	1.1024	1.1029	1.0977	1.0965	1.0931
9.2	1.1058	1.1062	1.0989	1.0971	1.0929
9.4	1.1089	1.1092	1.0996	1.0973	1.0927
9.6	1.1122	1.1124	1.1006	1.0972	1.0925
9.8	1.1152	1.1153	1.1014	1.0971	1.0922
10.0	1.1174	1.1175	1.1016	1.0970	1.0914
10.2	1.1196	1.1196	1.1028	1.0975	1.0910
10.4	1.0000	1.0000	1.0000	1.0000	1.0000
10.6	1.0000	1.0000	1.0000	1.0000	1.0000
10.8	1.0000	1.0000	1.0000	1.0000	1.0000
11.0	1.0000	1.0000	1.0000	1.0000	1.0000
11.2	1.0000	1.0000	1.0000	1.0000	1.0000
11.4	1.0000	1.0000	1.0000	1.0000	1.0000
11.6	1.0000	1.0000	1.0000	1.0000	1.0000
11.8	1.0000	1.0000	1.0000	1.0000	1.0000
12.0 (Top)	1.0000	1.0000	1.0000	1.0000	1.0000

CORE OPERATING LIMITS REPORT (COLR)
UNIT 2 CYCLE 32

FIGURE 5A
BOC Part-Power Summary of W(Z) as a Function of Core Height
(Top 15% and Bottom 12% Excluded)

Height (feet)	Hot Full Power	Power W(Z) with Correction Factor (excluding power ratio)						
		30% Power	40% Power	50% Power	60% Power	70% Power	75% Power	80% Power
0.0 (Bottom)	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000
0.2	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000
0.4	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000
0.6	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000
0.8	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000
1.0	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000
1.2	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000
1.4	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000
1.6	1.0980	1.3417	1.2954	1.2573	1.2231	1.1897	1.1717	1.1551
1.8	1.0978	1.3239	1.2818	1.2470	1.2152	1.1838	1.1667	1.1510
2.0	1.0974	1.3071	1.2689	1.2370	1.2076	1.1780	1.1620	1.1471
2.2	1.0967	1.2911	1.2565	1.2274	1.1999	1.1724	1.1575	1.1435
2.4	1.0957	1.2751	1.2438	1.2175	1.1918	1.1664	1.1526	1.1395
2.6	1.0944	1.2587	1.2308	1.2070	1.1834	1.1599	1.1473	1.1349
2.8	1.0929	1.2413	1.2173	1.1954	1.1743	1.1527	1.1413	1.1295
3.0	1.0911	1.2243	1.2034	1.1839	1.1651	1.1455	1.1350	1.1240
3.2	1.0892	1.2079	1.1891	1.1726	1.1556	1.1384	1.1286	1.1187
3.4	1.0875	1.1912	1.1750	1.1612	1.1464	1.1309	1.1221	1.1132
3.6	1.0864	1.1758	1.1625	1.1509	1.1383	1.1241	1.1165	1.1084
3.8	1.0855	1.1640	1.1537	1.1434	1.1320	1.1196	1.1125	1.1051
4.0	1.0845	1.1520	1.1444	1.1354	1.1253	1.1148	1.1082	1.1015
4.2	1.0834	1.1394	1.1339	1.1266	1.1183	1.1093	1.1034	1.0976
4.4	1.0823	1.1261	1.1222	1.1170	1.1108	1.1032	1.0983	1.0934
4.6	1.0812	1.1126	1.1106	1.1073	1.1029	1.0969	1.0930	1.0890
4.8	1.0800	1.0986	1.0987	1.0974	1.0945	1.0903	1.0872	1.0842
5.0	1.0786	1.0843	1.0867	1.0872	1.0857	1.0833	1.0811	1.0791
5.2	1.0769	1.0700	1.0745	1.0767	1.0766	1.0760	1.0748	1.0736
5.4	1.0751	1.0567	1.0628	1.0666	1.0679	1.0685	1.0688	1.0684
5.6	1.0730	1.0423	1.0501	1.0555	1.0585	1.0606	1.0621	1.0626
5.8	1.0706	1.0266	1.0363	1.0436	1.0489	1.0529	1.0551	1.0565
6.0	1.0684	1.0103	1.0221	1.0313	1.0392	1.0453	1.0482	1.0504


CORE OPERATING LIMITS REPORT (COLR)
UNIT 2 CYCLE 32

FIGURE 5A (con't)
BOC Part-Power Summary of W(Z) as a Function of Core Height
(Top 15% and Bottom 12% Excluded)

Height (feet)	Power W(Z) with Correction Factor (excluding power ratio)							
	Hot Full Power	30% Power	40% Power	50% Power	60% Power	70% Power	75% Power	80% Power
6.2	1.0663	0.9939	1.0071	1.0182	1.0278	1.0360	1.0400	1.0434
6.4	1.0638	0.9767	0.9911	1.0039	1.0145	1.0246	1.0302	1.0348
6.6	1.0618	0.9628	0.9790	0.9928	1.0046	1.0165	1.0228	1.0284
6.8	1.0616	0.9517	0.9694	0.9842	0.9974	1.0110	1.0180	1.0245
7.0	1.0611	0.9413	0.9598	0.9759	0.9905	1.0056	1.0136	1.0208
7.2	1.0610	0.9314	0.9509	0.9682	0.9841	1.0006	1.0095	1.0175
7.4	1.0636	0.9241	0.9446	0.9630	0.9804	0.9981	1.0079	1.0168
7.6	1.0691	0.9195	0.9411	0.9605	0.9794	0.9983	1.0089	1.0190
7.8	1.0746	0.9152	0.9378	0.9582	0.9785	0.9987	1.0101	1.0212
8.0	1.0798	0.9106	0.9341	0.9558	0.9771	0.9990	1.0114	1.0235
8.2	1.0849	0.9064	0.9307	0.9537	0.9760	0.9995	1.0128	1.0259
8.4	1.0897	0.9026	0.9276	0.9516	0.9750	1.0001	1.0142	1.0282
8.6	1.0943	0.8990	0.9248	0.9497	0.9741	1.0007	1.0156	1.0304
8.8	1.0985	0.8957	0.9222	0.9479	0.9734	1.0014	1.0171	1.0326
9.0	1.1024	0.8924	0.9194	0.9460	0.9727	1.0019	1.0183	1.0349
9.2	1.1058	0.8895	0.9170	0.9445	0.9723	1.0025	1.0197	1.0373
9.4	1.1089	0.8878	0.9156	0.9438	0.9726	1.0039	1.0217	1.0402
9.6	1.1122	0.8868	0.9148	0.9434	0.9731	1.0059	1.0245	1.0440
9.8	1.1152	0.8880	0.9162	0.9450	0.9756	1.0094	1.0285	1.0488
10.0	1.1174	0.8916	0.9201	0.9494	0.9806	1.0147	1.0340	1.0547
10.2	1.1196	0.8982	0.9270	0.9568	0.9885	1.0223	1.0416	1.0622
10.4	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000
10.6	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000
10.8	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000
11.0	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000
11.2	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000
11.4	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000
11.6	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000
11.8	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000
12.0 (Top)	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000

CORE OPERATING LIMITS REPORT (COLR)
UNIT 2 CYCLE 32

FIGURE 6
FLUX DIFFERENCE OPERATING ENVELOPE

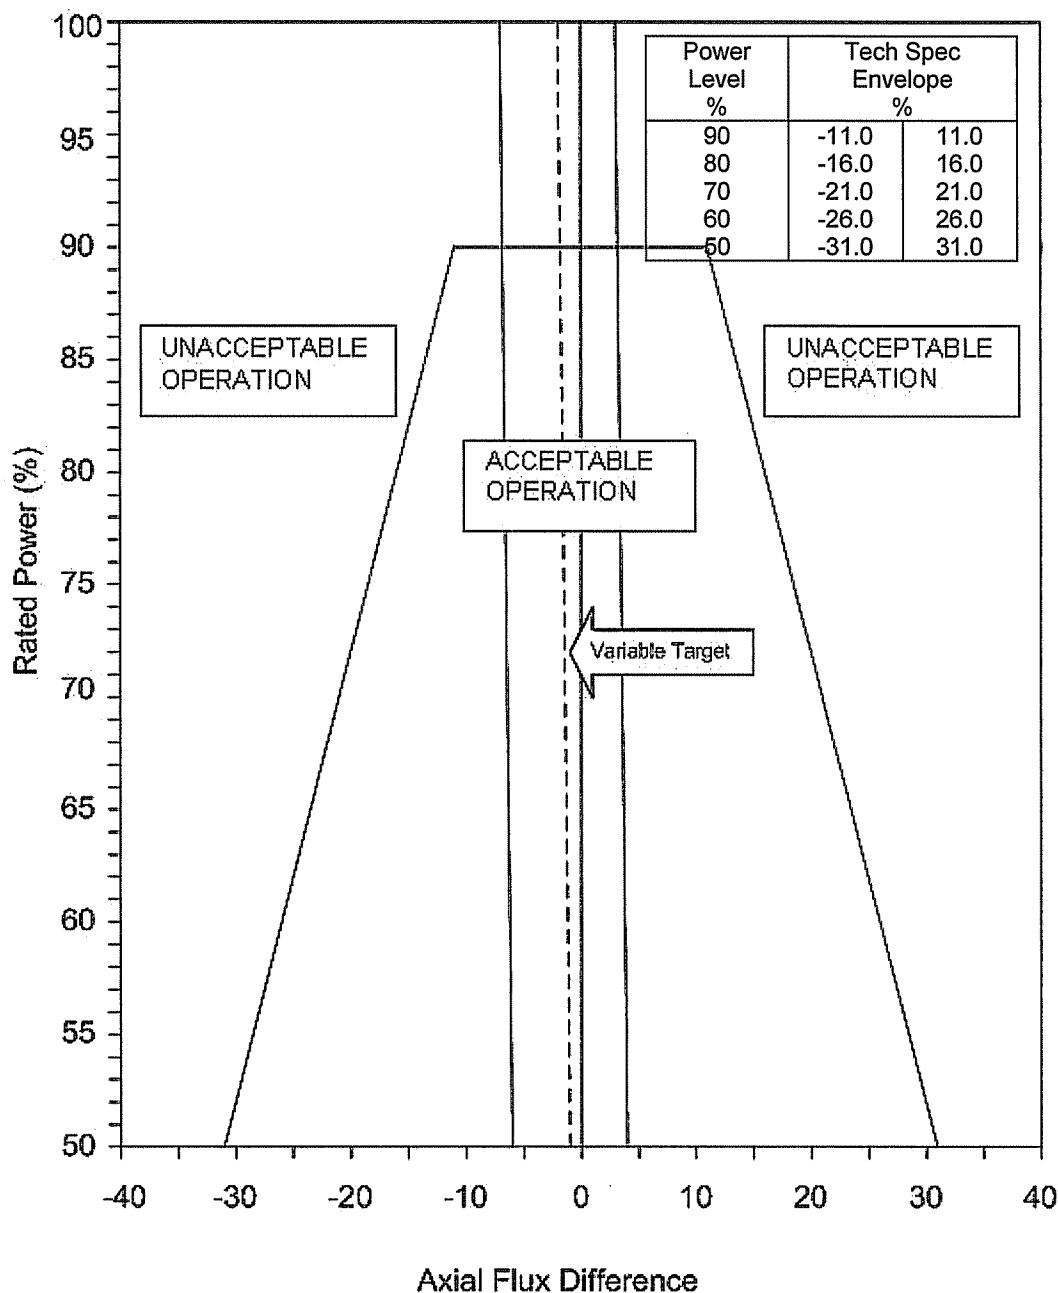

NOTE:

1. This figure represents the Constant Axial Offset Control (CAOC) band used in safety analyses, it may be administratively tightened depending on in-core flux map results. Refer to Figure 2 of ROD 1.2 for the administrative limit.
2. The AFD may deviate outside the target band with THERMAL POWER < 50% RTP.
3. The AFD target band is +/-5% for THERMAL POWER ≥ 15% RTP.

CORE OPERATING LIMITS REPORT (COLR)
UNIT 2 CYCLE 32

TABLE 1
NRC APPROVED METHODOLOGIES FOR COLR PARAMETERS

COLR Section	Parameter	NRC Approved Methodology
All	Reactor Thermal Output	<p>Caldon, Inc., Engineering Report-80P, "TOPICAL REPORT: Improving Thermal Power Accuracy and Plant Safety While Increasing Operating Power Level Using the LEFMTM System," Revision 0, Mar 1997.</p> <p>Caldon, Inc., Engineering Report-160P, "Supplement to Topical Report ER-80P: Basis for a Power Upate With the LEFMTM System," Revision 0, May 2000.</p>
2.1	Reactor Core Safety Limits	WCAP-9272-P-A, "Westinghouse Reload Safety Evaluation Methodology," July 1985
2.2	Shutdown Margin	WCAP-9272-P-A, "Westinghouse Reload Safety Evaluation Methodology," July 1985
2.3	Moderator Temperature Coefficient	WCAP-9272-P-A, "Westinghouse Reload Safety Evaluation Methodology," July 1985
2.4	Shutdown Bank Insertion Limit	WCAP-9272-P-A, "Westinghouse Reload Safety Evaluation Methodology," July 1985
2.5	Control Bank Insertion Limits	WCAP-9272-P-A, "Westinghouse Reload Safety Evaluation Methodology," July 1985
2.6	Nuclear Heat Flux Hot Channel Factor ($F_Q(Z)$)	<p>WCAP-8403 (non-proprietary), "Power Distribution Control and Load Following Procedures," Westinghouse Electric Corporation, September 1974.</p> <p>WCAP-14449-P-A, "Application of Best Estimate Large Break LOCA Methodology to Westinghouse PWRs with Upper Plenum Injection," Revision 1, October 1999 (cores containing 422V + fuel)</p> <p>WCAP-16009-P-A, "Realistic Large-Break LOCA Evaluation Methodology Using the Automated Statistical Treatment of Uncertainty Method (ASTRUM)," January 2005.</p> <p>WCAP-10054-P-A, "Westinghouse Small Break ECCS Evaluation Model Using the NOTRUMP Code," August 1985</p> <p>WCAP-10054-P-A, "Addendum to the Westinghouse Small Break ECCS Evaluation Model Using the NOTRUMP Code: Safety Injection into the Broken Loop and COSI Condensation Model," Addendum 2, Revision 1, July 1997</p>

CORE OPERATING LIMITS REPORT (COLR)
UNIT 2 CYCLE 32

TABLE 1
NRC APPROVED METHODOLOGIES FOR COLR PARAMETERS

COLR Section	Parameter	NRC Approved Methodology
2.7	Nuclear Enthalpy Rise Hot Channel Factor ($F_{\Delta H}^N$)	WCAP-9272-P-A, "Westinghouse Reload Safety Evaluation Methodology," July 1985 WCAP-16259-P-A, "Westinghouse Methodology for Applications of 3-D Transient Neutronics to Non-LOCA Accident Analysis," August 2006.
2.8	Axial Flux Difference (AFD)	WCAP-8403 (nonproprietary), "Power Distribution Control and Load Following Procedures," Westinghouse Electric Corporation, September 1974. NS-TMA-2198, Westinghouse to NRC Letter Attachment: "Operation and Safety Analysis Aspects of an Improved Load Follow Package," January 31, 1980. NS-CE-687, "Westinghouse to NRC Letter," July 16, 1975.
2.9	Overtemperature ΔT Setpoint	WCAP-8745-P-A, "Design Bases for the Thermal Overpower ΔT and Thermal Overtemperature ΔT Trip Functions," September 1986
2.10	Overpower ΔT Setpoint	WCAP-8745-P-A, "Design Bases for the Thermal Overpower ΔT and Thermal Overtemperature ΔT Trip Functions," September 1986
2.11	RCS Pressure, Temperature, and Flow Departure from Nucleate Boiling (DNB) Limits	WCAP-11397-P-A, "Revised Thermal Design Procedure," April 1989, for those events analyzed using RTDP WCAP-14787-P, Rev. 3, "Westinghouse Revised Thermal Design Procedure Instrument Uncertainty Methodology for Wisconsin Electric Power Company Point Beach Units 1 & 2 Power Uprate (1775 MWt Core Power with Feedwater Venturis, or 1800 MWt Core Power with LEFM on Feedwater Header)", February 2009. WCAP-9272-P-A, "Westinghouse Reload Safety Evaluation Methodology," July 1985 for those events not utilizing RTDP
2.12	Refueling Boron Concentration	WCAP-9272-P-A, "Westinghouse Reload Safety Evaluation Methodology," July 1985