

**NRC DISTRIBUTION FOR PART 50 DOCKET MATERIAL
(TEMPORARY FORM)**

CONTROL NO: 9487

FILE: INCIDENT REPORT FILE

FROM: Northern States Power Co. Minneapolis, Minnesota J.G. Keppler		DATE OF DOC 9-5-75	DATE REC'D 9-8-75	LTR	TWX	RPT XX	OTHER
TO:		ORIG None	CC	OTHER	SENT AEC PDR <u>XXX</u>		
NRC					SENT LOCAL PDR <u>XXX</u>		
CLASS	UNCLASS XX	PROP INFO	INPUT	NO CYS REC'D 1	DOCKET NO: 50-263		

DESCRIPTION:
Letter trans the following.....

ENCLOSURES:

Abnormal Occurrence # 75-16, on 8-26-75,
Concerning Inoperable HPCI Turbine Steam Supply
Valve.....

(1 Copy Enclosure Received)

PLANT NAME: Monticello

FOR ACTION/INFORMATION

SAB 9-8-75

BUTLER (L) W/ Copies	SCHWENCER (L) W/ Copies	ZIEMANN (L) W/3 Copies	REGAN (E) W/ Copies
CLARK (L) W/ Copies	STOLZ (L) W/ Copies	DICKER (E) W/ Copies	LEAR (L) W/ Copies
PARR (L) W/ Copies	VASSALLO (L) W/ Copies	KNIGHTON (E) W/ Copies	SPELS W/ Copies
KNIEL (L) W/ Copies	PURPLE (L) W/ Copies	YOUNGBLOOD (E) W/ Copies	W/ Copies

**DO NOT REMOVE
ACKNOWLEDGED**

INTERNAL DISTRIBUTION

<u>REG FILE</u> - NRC PDR - OGC, ROOM P-506A - GOSSICK/STAFF - CASE - GIAMBUSO - BOYD - MOORE (L) - DEYOUNG (L) - SKOVHOLT (L) - GOLLER (L) (Ltr) - P. COLLINS - DENISE - REG OPR - FILE & REGION (2) - MPC/PE (3) - STEELE	<u>TECH REVIEW</u> - SCHROEDER - MACCARY - KNIGHT - PAWLICKI - SHAO ** STELLO ** HOUSTON ** NOVAK - ROSS - IPPOLITO - TEDESCO - J. COLLINS - LAINAS - BENAROYA - VOLLMER	<u>DENTON</u> ** GRIMES - GAMMILL - KASTNER - BALLARD - SPANGLER <u>ENVIRO</u> - MULLER - DICKER - KNIGHTON - YOUNGBLOOD - REGAN - PROJECT LDR - HARLESS	<u>LIC ASST</u> - R. DIGGS (L) - H. GEARIN (L) - E. GOULBOURNE (L) - P. KREUTZER (E) - J. LEE (L) - M. RUSHBROOK (L) - S. REED (E) - M. SERVICE (L) - S. SHEPPARD (L) - M. SLATER (E) - H. SMITH (L) - S. TEETS (L) - G. WILLIAMS (E) - V. WILSON (L) - R. INGRAM (L) - M. DUNCAN (E)	<u>A/T IND</u> - BRAITMAN - SALTZMAN - MELTZ <u>PLANS</u> - MCDONALD - CHAPMAN - DUBE (Ltr) - E. COUPE - PETERSON - HARTFIELD (2) - KLECKER - EISENHUT - WIGGINTON - F. WILLIAMS - HANAUER
---	---	---	---	---

EXTERNAL DISTRIBUTION

1 - LOCAL PDR Minneapolis, Minnesota	1 - NATIONAL LABS	1 - PDR-SAN/LA/NY
1 - TIC (ABERNATHY) (1)(2)(10)	1 - W. PENNINGTON, Rm E-201 GT	1 - BROOKHAVEN NAT LAB
1 - NSIC (BUCHANAN)	1 - CONSULTANTS	1 - G. ULRIKSON, ORNL
1 - ASLB	NEWMARK/BLUME/AGBABIAN	1 - AGMED (RUTH GUSSMAN) Rm B-127 GT
1 - Newton Anderson		1 - J. D. RUNKLES, Rm E-201 GT

ACRS sent to L.A. R. Diggs
** SEND ONLY TEN DAY REPORTS

AD-1
4

NSP

Regulatory


File Cy.

NORTHERN STATES POWER COMPANY

MINNEAPOLIS, MINNESOTA 55401

September 5, 1975

Mr. R. S. Boyd, Acting Director
Division of Reactor Licensing
U. S. Nuclear Regulatory Commission
Washington, DC 20555

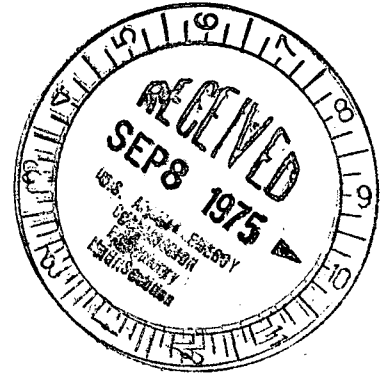

MONTICELLO NUCLEAR GENERATING PLANT
Docket No. 50-263 License No. DPR-22

Inoperable HPCI Turbine Steam Supply Valve


The Licensee Event Report for this occurrence is reproduced on the back of this letter.

Yours very truly,

L. O. Mayer, PE
Manager, Nuclear Support Services

LOM/MHV/deb

cc: J. G. Keppler
G. Charnoff
MPCA
Attn: J. W. Ferman

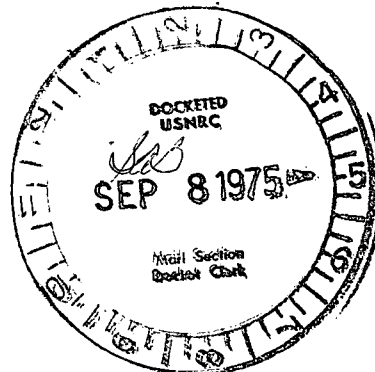

9487

LICENSEE EVENT REPORT

CONTROL BLOCK:

--	--	--	--	--	--

1 6

[PLEASE PRINT ALL REQUIRED INFORMATION]

LICENSEE NAME					LICENSE NUMBER								LICENSE TYPE				EVENT TYPE						
01	M	N	M	N	P	1	0	0	-	0	0	0	0	-	0	0	4	1	1	1	0	1	
7	8	9				14	15									25	26				30	31	32

CATEGORY		REPORT TYPE	REPORT SOURCE	DOCKET NUMBER					EVENT DATE					REPORT DATE											
01	CON'T	P	0	T	L	0	5	0	-	0	2	6	3	0	8	2	6	7	5	0	9	0	5	7	5
7	8	57	58	59	60	61							68	69						74	75				80

EVENT	DESCRIPTION
1	...
2	...
3	...
4	...
5	...
6	...
7	...
8	...
9	...
10	...
11	...
12	...
13	...
14	...
15	...
16	...
17	...
18	...
19	...
20	...
21	...
22	...
23	...
24	...
25	...
26	...
27	...
28	...
29	...
30	...
31	...
32	...
33	...
34	...
35	...
36	...
37	...
38	...
39	...
40	...
41	...
42	...
43	...
44	...
45	...
46	...
47	...
48	...
49	...
50	...
51	...
52	...
53	...
54	...
55	...
56	...
57	...
58	...
59	...
60	...
61	...
62	...
63	...
64	...
65	...
66	...
67	...
68	...
69	...
70	...
71	...
72	...
73	...
74	...
75	...
76	...
77	...
78	...
79	...
80	...
81	...
82	...
83	...
84	...
85	...
86	...
87	...
88	...
89	...
90	...
91	...
92	...
93	...
94	...
95	...
96	...
97	...
98	...
99	...
100	...

02	During normal plant operations, it was discovered that the control circuit for valve	80
7	8	9
03	MO-2036, Steam Supply to HPCI Turbine, was de-energized. It was found that the	80
7	8	9
04	motor control unit undervoltage relay had opened. APRS system was available and	80
7	8	9
05	operable. One previously reported similar event on RCIC System. Affected coil re-	80
7	8	9
06	placed in kind. (A0263/75-16)	80
7	8	9
PRIME		
7	8	9

SYSTEM CODE		CAUSE CODE	COMPONENT CODE					PRIME COMPONENT SUPPLIER	COMPONENT MANUFACTURER				VIOLATION			
0	7	S	F	E	R	E	L	A	Y	X	N	G	O	8	0	N
7	8	9	10	11	12	13	14	15	16	17	43	44	45	46	47	48

CAUSE DESCRIPTION

08	7	8	9	A GE Manufacturing Co. 393B20902 relay coil open circuited, causing MO-2036 to lose	80
09	7	8	9	control voltage. Relay coil replaced in kind.	80
10	7	8	9		80
	7	8	9		80

FACILITY STATUS		% POWER			OTHER STATUS		METHOD OF DISCOVERY		DISCOVERY DESCRIPTION	
11	E	0	6	5	NA		B	NA		
7	8	9	10	12	13	44	45	46	80	

FORM OF ACTIVITY RELEASED		CONTENT OF RELEASE		AMOUNT OF ACTIVITY		LOCATION OF RELEASE	
1	2	Z		NA		NA	
7	8	9	10	11	44	45	80

PERSONNEL EXPOSURES

NUMBER			TYPE	DESCRIPTION
13	000	Z	NA	

PERSONNEL INJURIES

NUMBER				DESCRIPTION	
1	4	0	0	0	NA

OFFSITE CONSEQUENCES

15	NA
7 8 9	80

LOSS OR DAMAGE TO FACILITY

TYPE			DESCRIPTION
16	Z		NA

PUBLICITY

17	NA
----	----

ADDITIONAL FACTORS

18	NA
7 8 9	80

19 80

NAME: T. W. Grue

PHONE: (612) 295-5151