


# LNP COL 2.4-2

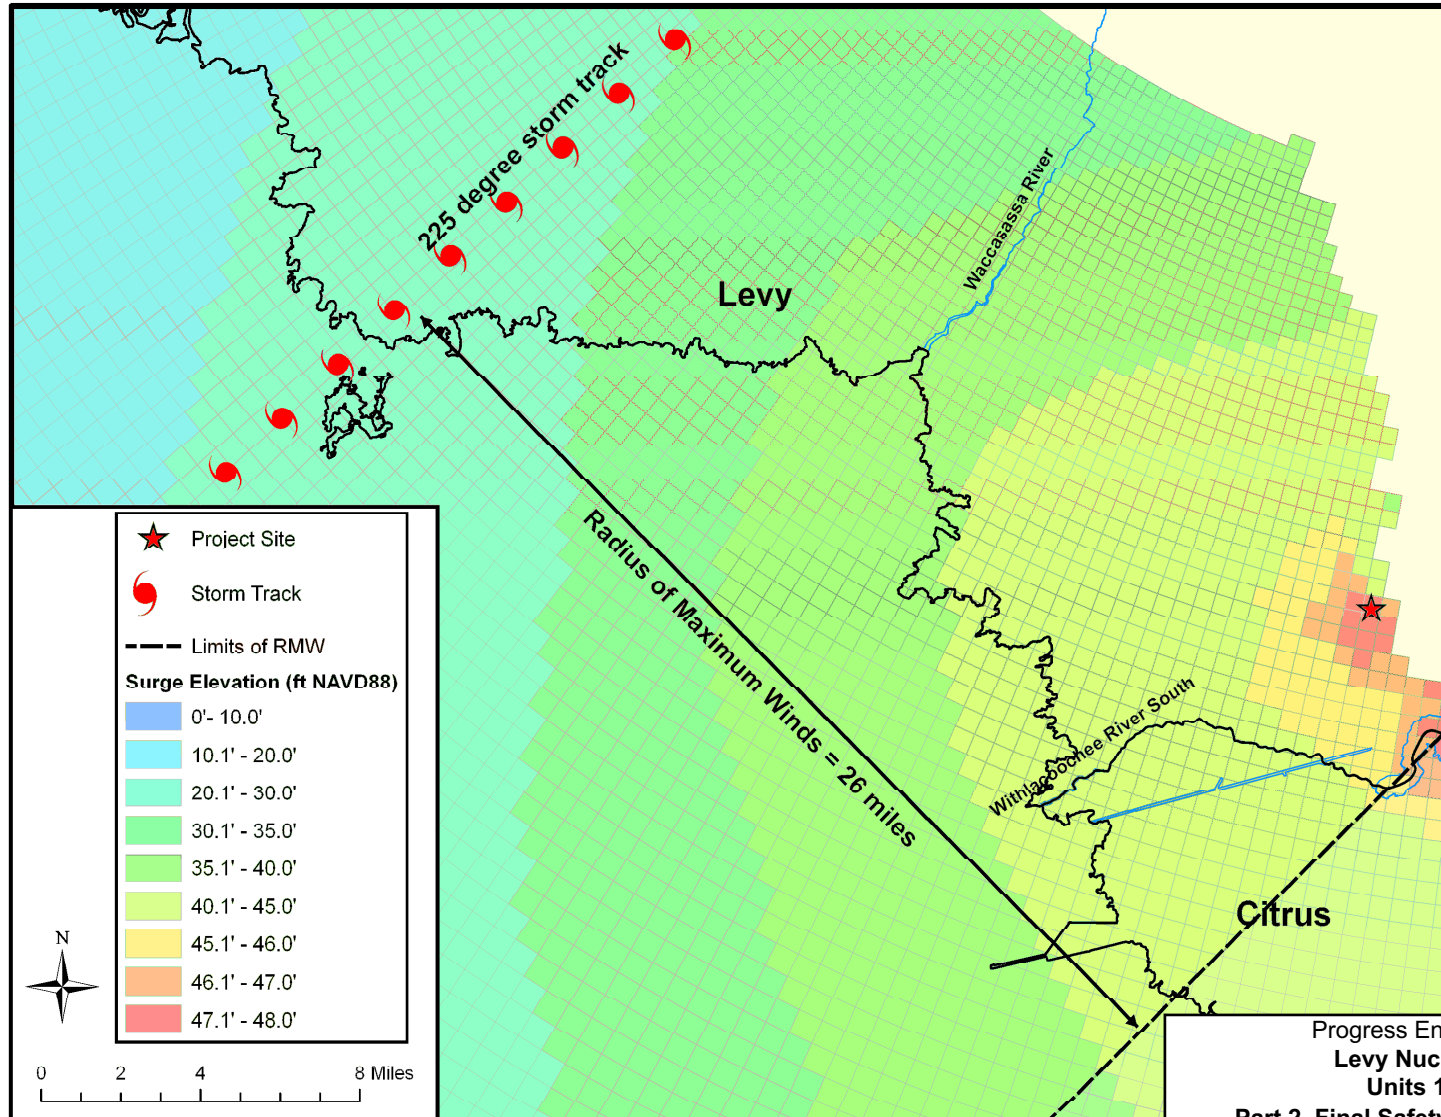

Progress Energy Florida  
**Levy Nuclear Plant  
 Units 1 and 2**  
**Part 2, Final Safety Analysis Report**

PMH Parameters and Maximum Surge  
 at LNP Site for Scenario 1  
 FIGURE 2.4.5-240

Rev 3