


LNP COL 2.4-2

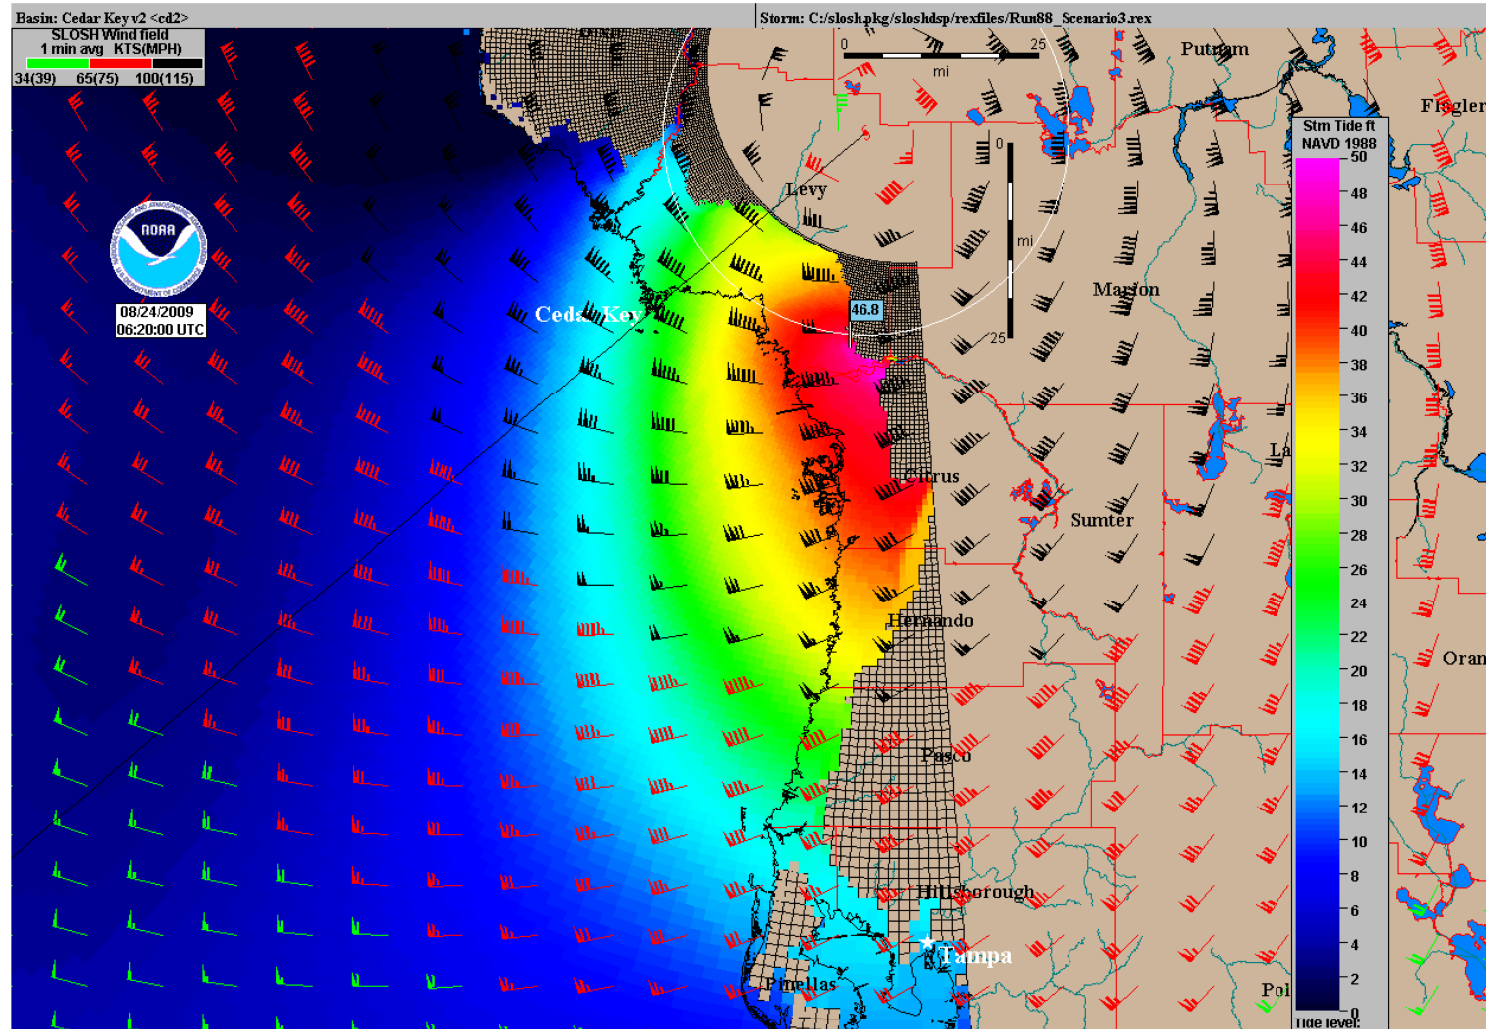

Progress Energy Florida
Levy Nuclear Plant
Units 1 and 2
Part 2, Final Safety Analysis Report

SLOSH Display Map for the Case Producing Maximum
Surge at LNP Site for Scenario 3
FIGURE 2.4.5-243

Rev 3