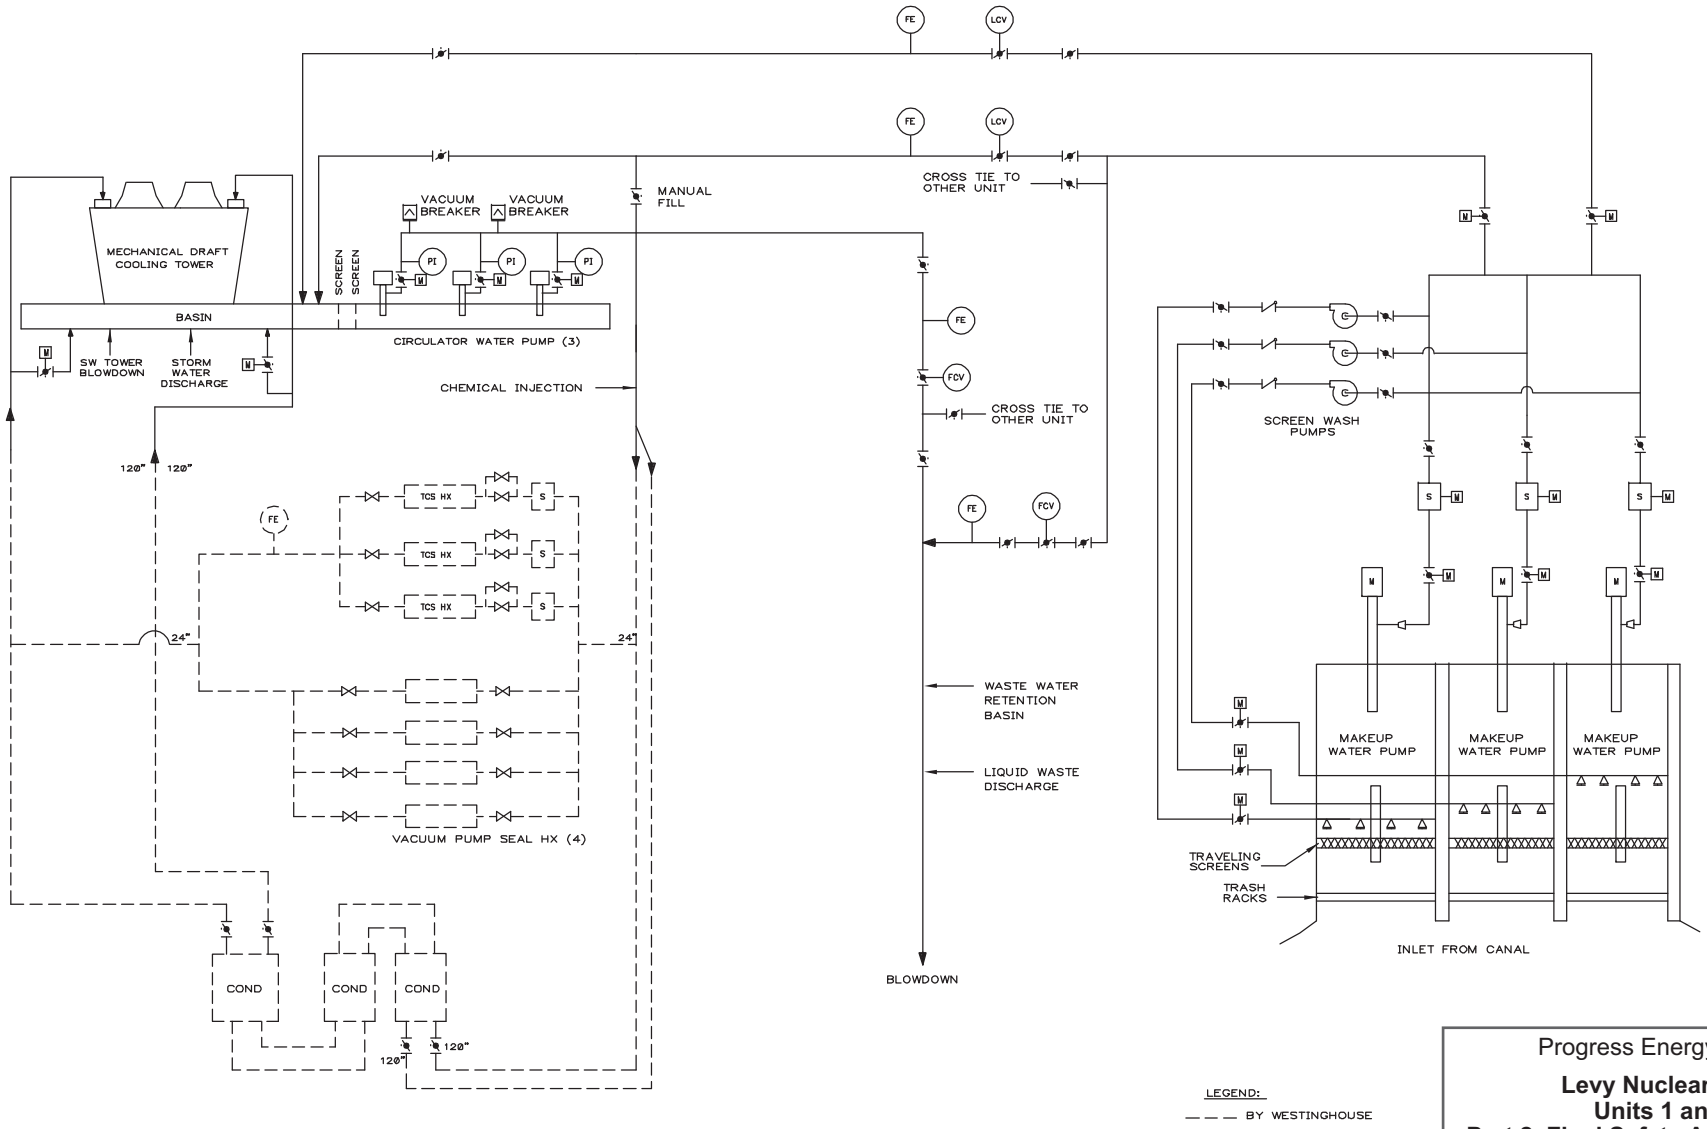

Progress Energy Florida

Levy Nuclear Plant
Units 1 and 2
Part 2, Final Safety Analysis Report

Circulating Water System and Raw Water System (Saltwater Subsystem)

FIGURE 10.4-201

Rev 4