

FINAL SAFETY ANALYSIS REPORT

CHAPTER 8

ELECTRIC POWER

8.0 ELECTRIC POWER

This chapter of the U.S. EPR Final Safety Analysis Report (FSAR) is incorporated by reference with supplements as identified in the following sections.

8.1 INTRODUCTION

This section of the U.S. EPR FSAR is incorporated by reference with the following supplements.

8.1.1 Offsite Power Description

The U.S. EPR FSAR includes the following COL Item in Section 8.1.1:

A COL applicant that references the U.S. EPR design certification will provide site-specific information describing the interface between the offsite transmission system, and the nuclear unit, including switchyard interconnections.

This COL Item is addressed as follows:

{The BBNPP 500 kV transmission system consists of two offsite circuits, one circuit connects the BBNPP site to the existing Susquehanna 500 kV Yard via a 500 kV, 4260 MVA line and one circuit connects the BBNPP site to the Susquehanna 500 kV Yard 2 via a 500 kV, 4260 MVA line. Each circuit is on individual towers. The general routing of the lines is shown on Figure 8.1-1.

The BBNPP is connected to the BBNPP switchyard by means of five overhead lines.}

The interface between the transmission system and the nuclear unit is further described in Section 8.2.

8.1.2 Onsite Power System Description

No departures or supplements.

8.1.3 Safety-Related Loads

The U.S. EPR FSAR includes the following COL Item in Section 8.1.3:

A COL applicant that references the U.S. EPR design certification will identify site-specific loading differences that raise the EDG or Class 1E battery loading and demonstrate the electrical distribution system is adequately sized for the additional load.

This COL Item is addressed as follows:

{The loads powered from the safety-related sources for the U.S. EPR are specified in U.S. EPR FSAR Tables 8.3-4, 8.3-5, 8.3-6, and 8.3-7. Additional site-specific loads powered from the station EDGs are specified in Table 8.1-1, Table 8.1-2, Table 8.1-3, and Table 8.1-4. This information supplements U.S. EPR FSAR Tables 8.3-4, 8.3-5, 8.3-6, and 8.3-7. The site-specific loads are within the design margin of the EDGs. Onsite DC power system nominal load values are specified in U.S. EPR FSAR Tables 8.3-12 through 8.3-15. Additional site-specific loads from the Class 1E battery source include an additional feeder breaker on the 31/2/3/4BDD bus that provides electrical power to the 6.9 kV to 480 V ESWEMS transformers. Each of these feeder breaker require steady state control power of 0.04 kW. The site-specific Class 1E control power demand is within the design margin of the EUPS Battery Sizing Calculation and does not change the DC load requirements specified in the U.S. EPR FSAR Tables 8.3-12 through 8.3-15.}

8.1.4 Design Bases**8.1.4.1 Offsite Power System**

No departures or supplements.

8.1.4.2 Onsite Power System

No departures or supplements.

8.1.4.3 Criteria, Regulatory Guides, Standards, and Technical Positions

No departures or supplements.

8.1.4.4 NRC Generic Letters

The information requested by the NRC in Generic Letter 2006-02 (NRC, 2006), as indicated in U.S. EPR FSAR Section 8.2.1.1, is presented in Section 8.2.1.1.

8.1.5 References

{**NRC, 2006.** Grid Reliability and the Impact on Plant Risk and Operability of Offsite Power, NRC Generic Letter 2006-02, U.S. Nuclear Regulatory Commission, February 2006.}

Table 8.1-1— {Division 1 Emergency Diesel Generator Nominal Loads}

Time Seq. (s)	Load Description	Volts	Rating (hp/kW)	Alternate Feed Load (kW)	Operating Load LOOP (kW)	Operating Load DBA/ LOOP (kW)
Load Step Group 1						
15	ESWEMS Pumphouse ventilation system emergency condensing unit	480	45 Bhp		37.3(1)	37.3(1)
15	ESWEMS Pumphouse ventilation system emergency cooling fan	480	10 Bhp		8.3(1)	8.3(1)
15	ESWEMS Pumphouse ventilation pump room electric heater (safety-related) (2 per division, 25 kW each)	480	50 kW		0(1)	0(1)
15	ESWEMS Pumphouse ventilation system intake control valve	480	2 Bhp		0(2)	0(2)
15	ESWEMS Pumphouse flushing line valve	480	2 Bhp		0(2)	0(2)
15	ESWEMS recirculation control valve	480	2 Bhp		0(2)	0(2)
15	ESWEMS automatic strainer	480	.25 Bhp		0(2)	0(2)
15	Estimated site-specific load contribution from transformer and cable losses		9 kW		9	9
15	Allowance for future small loads		5 kW		5	5
Subtotal of Additional Loads for Load Step Group 1					59.6	59.6
Additional Manually Connected Loads						
N/A(3)	Emergency makeup pump	480	15 hp		11.2	11.2
Total of Additional Manually Connected Loads					11.2	11.2
Notes:						
1. Cooling systems are assumed to be operating and heating systems are off.						
2. Auxiliary loads (sumps, screens, MOVs, etc.) not included in load totals due to infrequent operation and short duration of operation.						
3. The emergency makeup pump is not required to run during the first 72 hours of a DBE.						

Table 8.1-2— {Division 2 Emergency Diesel Generator Nominal Loads}

Time Seq. (s)	Load Description	Volts	Rating (hp/kW)	Alternate Feed Load (kW)	Operating Load LOOP (kW)	Operating Load DBA/ LOOP (kW)
Load Step Group 1						
15	ESWEMS Pumphouse ventilation system emergency condensing unit	480	45 Bhp		37.3(1)	37.3(1)
15	ESWEMS Pumphouse ventilation system emergency cooling fan	480	10 Bhp		8.3(1)	8.3(1)
15	ESWEMS Pumphouse ventilation pump room electric heater (safety-related) (2 per division, 25 kW each)	480	50 kW		0(1)	0(1)
15	ESWEMS Pumphouse ventilation system intake control valve	480	2 Bhp		0(2)	0(2)
15	ESWEMS Pumphouse flushing line valve	480	2 Bhp		0(2)	0(2)
15	ESWEMS recirculation control valve	480	2 Bhp		0(2)	0(2)
15	ESWEMS automatic strainer	480	.25 Bhp		0(2)	0(2)
15	Estimated site-specific load contribution from transformer and cable losses		9 kW		9	9
15	Allowance for future small loads		5 kW		5	5
Subtotal of Additional Loads for Load Step Group 1					59.6	59.6
Additional Manually Connected Loads						
N/A(3)	Emergency makeup pump	480	15 hp		11.2	11.2
Total of Additional Manually Connected Loads					11.2	11.2
Notes: 1. Cooling systems are assumed to be operating and heating systems are off. 2. Auxiliary loads (sumps, screens, MOVs, etc.) not included in load totals due to infrequent operation and short duration of operation. 3. The emergency makeup pump is not required to run during the first 72 hours of a DBE.						


Table 8.1-3— {Division 3 Emergency Diesel Generator Nominal Loads}

Time Seq. (s)	Load Description	Volts	Rating (hp/kW)	Alternate Feed Load (kW)	Operating Load LOOP (kW)	Operating Load DBA/ LOOP (kW)
Load Step Group 1						
15	ESWEMS Pumphouse ventilation system emergency condensing unit	480	45 Bhp		37.3(1)	37.3(1)
15	ESWEMS Pumphouse ventilation system emergency cooling fan	480	10 Bhp		8.3(1)	8.3(1)
15	ESWEMS Pumphouse ventilation pump room electric heater (safety-related) (2 per division, 25 kW each)	480	50 kW		0(1)	0(1)
15	ESWEMS Pumphouse ventilation system intake control valve	480	2 Bhp		0(2)	0(2)
15	ESWEMS Pumphouse flushing line valve	480	2 Bhp		0(2)	0(2)
15	ESWEMS recirculation control valve	480	2 Bhp		0(2)	0(2)
15	ESWEMS automatic strainer	480	.25 Bhp		0(2)	0(2)
15	Estimated site-specific load contribution from transformer and cable losses		9 kW		9	9
15	Allowance for future small loads		5 kW		5	5
Subtotal of Additional Loads for Load Step Group 1					59.6	59.6
Additional Manually Connected Loads						
N/A(3)	Emergency makeup pump	480	15 hp		11.2	11.2
Total of Additional Manually Connected Loads					11.2	11.2
Notes: 1. Cooling systems are assumed to be operating and heating systems are off. 2. Auxiliary loads (sumps, screens, MOVs, etc.) not included in load totals due to infrequent operation and short duration of operation. 3. The emergency makeup pump is not required to run during the first 72 hours of a DBE.						

Table 8.1-4— {Division 4 Emergency Diesel Generator Nominal Loads}

Time Seq. (s)	Load Description	Volts	Rating (hp/kW)	Alternate Feed Load (kW)	Operating Load LOOP (kW)	Operating Load DBA/ LOOP (kW)
Load Step Group 1						
15	ESWEMS Pumphouse ventilation system emergency condensing unit	480	45 Bhp		37.3(1)	37.3(1)
15	ESWEMS Pumphouse ventilation system emergency cooling fan	480	10 Bhp		8.3(1)	8.3(1)
15	ESWEMS Pumphouse ventilation pump room electric heater (safety-related) (2 per division, 25 kW each)	480	50 kW		0(1)	0(1)
15	ESWEMS Pumphouse ventilation system intake control valve	480	2 Bhp		0(2)	0(2)
15	ESWEMS Pumphouse flushing line valve	480	2 Bhp		0(2)	0(2)
15	ESWEMS recirculation control valve	480	2 Bhp		0(2)	0(2)
15	ESWEMS automatic strainer	480	.25 Bhp		0(2)	0(2)
15	Estimated site-specific load contribution from transformer and cable losses		9 kW		9	9
15	Allowance for future small loads		5 kW		5	5
Subtotal of Additional Loads for Load Step Group 1					59.6	59.6
Additional Manually Connected Loads						
N/A(3)	Emergency makeup pump	480	15 hp		11.2	11.2
Total of Additional Manually Connected Loads					11.2	11.2
Notes: 1 Cooling systems are assumed to be operating and heating systems are off. 2. Auxiliary loads (sumps, screens, MOVs, etc.) not included in load totals due to infrequent operation and short duration of operation. 3. The emergency makeup pump is not required to run during the first 72 hours of a DBE.						

Figure 8.1-1—{BBNPP Site 500 kV Circuit Corridors}

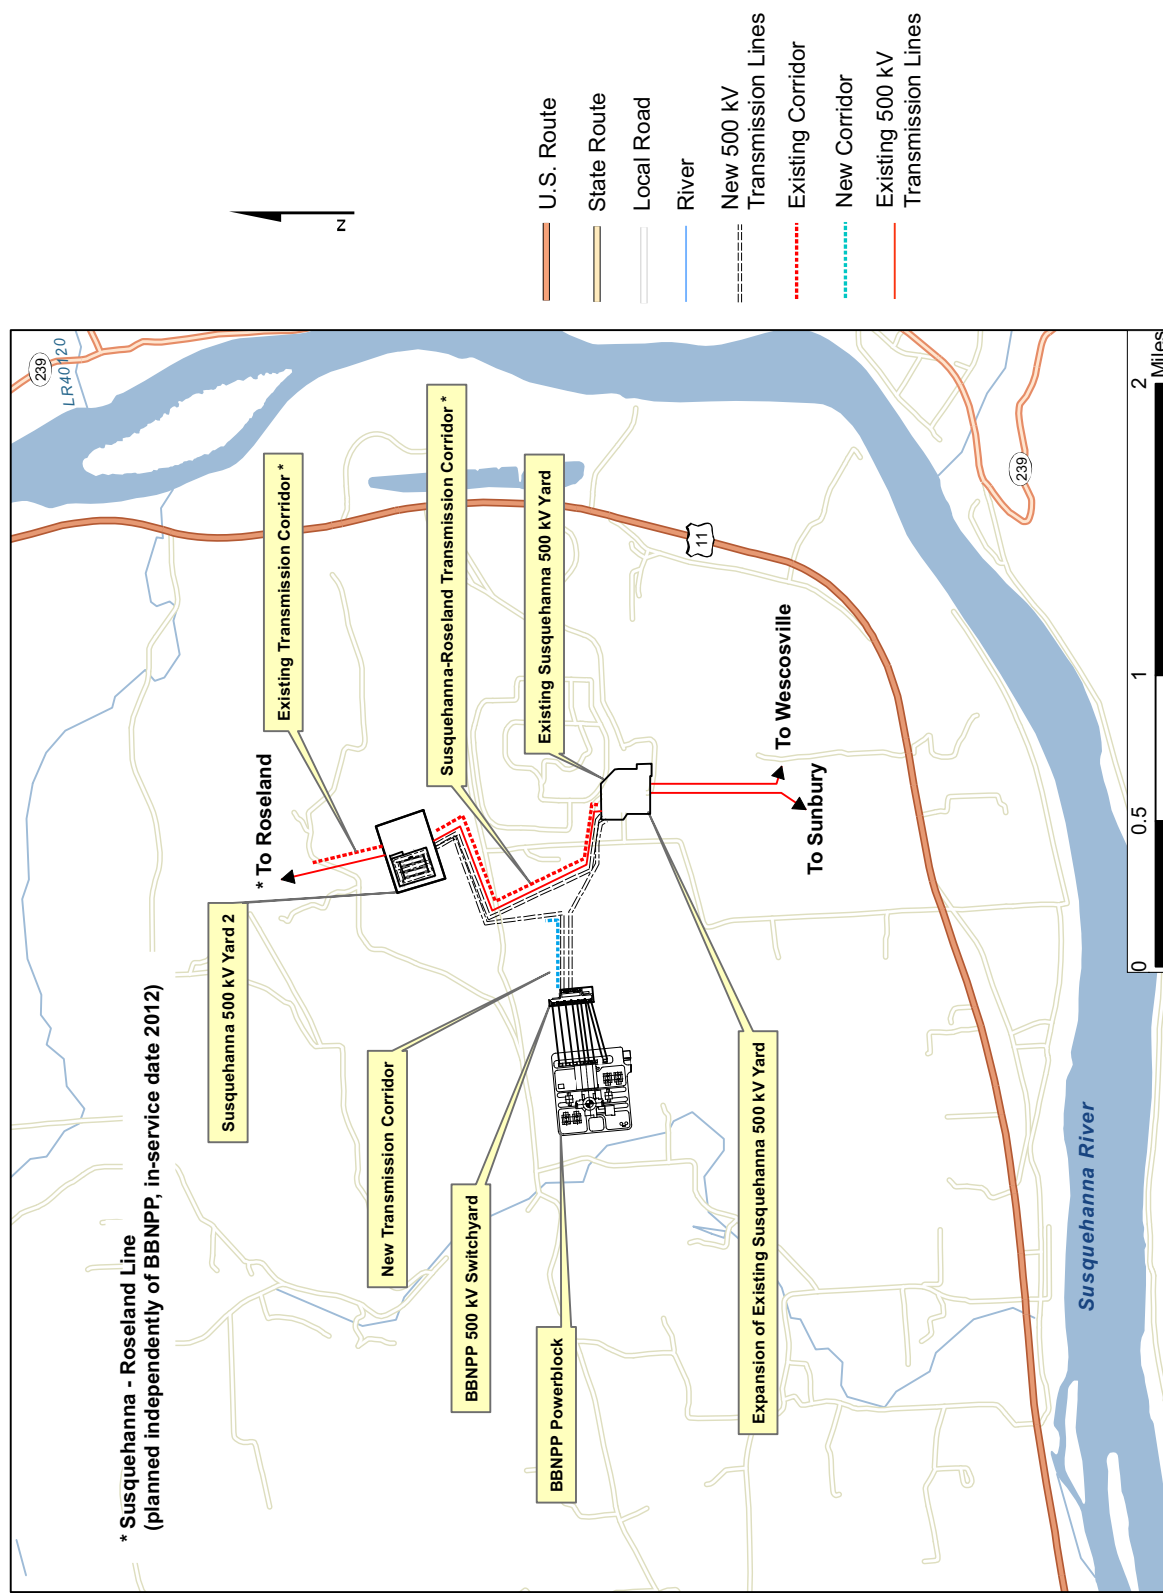

8.2 OFFSITE POWER SYSTEM

This section of the U.S. EPR FSAR is incorporated by reference with the following supplements.

8.2.1 Description

8.2.1.1 Offsite Power

The U.S. EPR FSAR includes the following COL Item in Section 8.2.1.1:

A COL applicant that references the U.S. EPR design certification will provide site-specific information regarding the offsite transmission system and connections to the station switchyard.

This COL Item is addressed as follows:

{The new BBNPP switchyard is connected to BBNPP by means of five overhead lines. |

- ◆ One line connects to the plant main transformer and is used for power export to the transmission system.
- ◆ Four lines connect to the auxiliary transformers. (Two emergency auxiliary transformers (EATs) and two normal auxiliary transformers (NATs).) |

In addition, two normally energized, physically independent transmission lines, designed and located to minimize the likelihood of their simultaneous failure under operating, postulated accident, and postulated adverse environmental conditions, including transmission line tower failure or transmission line breaking; connect the BBNPP switchyard to the transmission system:

- ◆ One new approximately 0.5 mi (0.8 km) long overhead 500 kV transmission line connects the new BBNPP switchyard to an expansion of the existing Susquehanna 500 kV Yard. |
- ◆ One new approximately 0.75 mi (1.2 km) long overhead 500 kV transmission line connects the new BBNPP switchyard to the new Susquehanna 500 kV Yard 2. |

Design details of the two transmission lines that connect the BBNPP site to the PPL Electric Utilities Corporation (PPL EU) transmission system are shown in the Table 8.2-1. Figure 8.2-1 depicts the 500 kV transmission configuration.

The two overhead 500 kV transmission lines provide the two preferred sources of power for the reactor protection system and engineered safety features (ESFs) during normal, abnormal, and accident conditions.

The BBNPP is located adjacent to the existing Susquehanna Steam Electric Station (SSES). As such, significant transmission infrastructure exists within close proximity to the BBNPP site. In addition to existing transmission infrastructure, PPL EU is developing a new 500 kV transmission line from the existing Susquehanna 500 kV Yard to the Roseland Substation (New Jersey). This expansion effort is a PJM Regional Transmission Expansion Plan (RTEP) initiative. PJM has determined that this new 500 kV line is required for grid reliability in the region without considering whether BBNPP is constructed. The in-service date of the Susquehanna-Roseland RTEP project is planned for 2012 and is expected to precede the completion of construction of the Bell Bend Nuclear Power Plant.

BBNPP transmission lines will utilize one new on-site corridor and the on-site Susquehanna-Roseland corridor for interconnections to the existing offsite power transmission grid as shown in Figure 8.2-1. The two circuits are supported on separate structures, which are located to minimize the likelihood of simultaneous failure. Transmission tower separation, line installation, and clearances are consistent with the National Electrical Safety Code (NESC), PPL EU transmission line standards, and PPL requirements. Basic tower structural design parameters, including the number of conductors, height, materials, color, and finish are consistent with PPL EU transmission line design standards. Adequate clearance will be provided to ensure that both of these Bell Bend transmission lines will not be lost in the event of a tower collapse.

The transmission system consists of two circuits. One circuit consists of a single three-phase 500 kV transmission line from the BBNPP site to the Susquehanna 500 kV Yard via breakers CB 10 and 11. The other circuit consists of a single three-phase 500 kV transmission line from the BBNPP site to the new Susquehanna 500 kV Yard 2 via breakers CB 7 and 8.

Both circuits in the new on-site corridor join the Susquehanna-Roseland corridor from the new Susquehanna 500 kV Yard 2 as it turns east towards the existing Susquehanna 500 kV Yard, as shown on Figure 8.2-1. The interconnection layout of these transmission lines is shown in Figure 8.2-2.

The new BBNPP 500 kV Yard is described in Section 8.2.1.2, Station Switchyard. The Susquehanna 500 kV Yard 2 is a new facility that will be located directly on the Susquehanna-Roseland corridor, as shown in Figure 8.2-3. The existing Susquehanna 500 kV Yard will be expanded by two bays to accommodate the new Bell Bend connection, as shown in Figure 8.2-4.

The U.S. EPR FSAR includes the following COL Item in Section 8.2.1.1:

A COL applicant that references the U.S. EPR design certification will provide site-specific information regarding the communication agreements and protocols between the station and the transmission system operator, independent system operator, or reliability coordinator and authority. Additionally, the applicant will provide a description of the analysis tool used by the transmission operator to determine, in real time, the impact that the loss or unavailability of various transmission system elements will have on the condition of the transmission system to provide post-trip voltages at the switchyard. The information provided will be consistent with information requested in NRC generic letter 2006-02.

This COL Item is addressed as follows:

{The BBNPP site lies within the service territory of PPL EU. The plant will utilize transmission facilities that are owned by PPL EU under the direction and control of the PJM interconnection. PPL EU, PJM and the BBNPP operator will have formal agreements and protocols in place to provide safe and reliable operation of the transmission system and equipment at BBNPP.

The addition of a large generating unit such as BBNPP requires completion of the PJM Large Generator Interconnection Procedure (LGIP). This procedure requires that a series of progressively refined studies be performed to identify transmission system modifications to accommodate the new generating unit (combined turbine-generator-exciter) and the main step-up transformer(s) including modifications to substations and switchyards.

The reliability of the PJM system is continuously (real time) analyzed through PJM's Energy Management System (EMS) program.

In accordance with PJM manual requirements that implement the Operating Agreement, both the transmission owner (PPL EU) and PJM continuously monitor and evaluate grid reliability and switchyard voltages. PPL EU will inform BBNPP of any grid instability or voltage inadequacies and PPL EU will ensure local voltage requirements are maintained as required by the nuclear plant. However, in special grid emergency situations warranting immediate, coordinated action, PJM can initiate joint communications with the transmission owner (PPL EU), the marketing operations center (PPL EnergyPlus generation dispatch center) and the plant operator (BBNPP).

BBNPP reviews the transmission system parameters and informs PPL EU (via the PPL EnergyPlus generation dispatch center) immediately prior to initiating any plant activities that may affect grid reliability. In addition, plant operators inform PPL EU via the generation dispatch center of changes in generation ramp rates and notify them of any developing problems that may impact generation.

A formal agreement between BBNPP and PJM will establish the requirements for transmission system studies and analyses. PJM will perform short-term grid analyses to support BBNPP plant startup and normal shutdown.

The agreement between PJM and BBNPP will establish protocols for the plant to remain cognizant of grid vulnerabilities to make informed decisions regarding maintenance activities critical to the electrical system. During plant operation, PPL EU and PJM continuously monitor real-time power flows and assess contingencies. Operational planning studies are also performed using offline power flow study tools to assess near term operating conditions under varying load, generation, and transmission topology patterns.}

8.2.1.2 Station Switchyard

The U.S. EPR FSAR includes the following COL Item in Section 8.2.1.2:

A COL applicant that references the U.S. EPR design certification will provide site-specific information for the switchyard layout design.

This COL Item is addressed as follows:

{The new 500 kV Gas Insulated Switchyard (GIS) for BBNPP has been designed and is sized and configured to accommodate the output of BBNPP. The location of the BBNPP switchyard is on the BBNPP site approximately 500 ft (152 m) east of BBNPP and approximately 2510 ft (765 m) west of the existing Susquehanna 500 kV Yard. The BBNPP 500 kV switchyard transmits electrical power output from BBNPP to the transmission system. The BBNPP switchyard layout and location are shown on Figure 8.2-1. The GIS will be designed, tested, and installed in accordance with the applicable codes and standards in Section 8.2.3.

A single line of the BBNPP switchyard layout design, which incorporates a breaker-and-a-half / double breaker scheme, is presented in Figure 8.2-2. Circuit breakers and disconnect switches are sized and designed in accordance with IEEE Standard C37.06 (IEEE, 2000a). All circuit breakers are equipped with dual trip coils. The 500 kV circuit breakers in the switchyard are rated according to the following criteria.

- ◆ Circuit breaker continuous current ratings are chosen such that no single contingency in the switchyard (e.g., a breaker being out for maintenance) will result in a load exceeding 100% of the nameplate continuous current rating of the breaker.
- ◆ Interrupting duties are specified such that no fault occurring on the system, operating in steady-state conditions will exceed the breaker's nameplate interrupting capability.
- ◆ Momentary ratings are specified such that no fault occurring on the system, operating in steady-state conditions will exceed the breaker's nameplate momentary rating.
- ◆ Voltage ratings are specified to be greater than the maximum expected operating voltage.

The design of the BBNPP switchyard includes six bays in the configuration. The breaker-and-a-half/double breaker switchyard arrangement offers the operating flexibility to maintain the anticipated operational containment integrity and other vital functions in the event of postulated failures as described in the Failure Modes and Effects Analysis (FMEA) as described in Section 8.2.2.4 and U.S. EPR FSAR Section 8.2.2.4. Some of the specific advantages of the breaker-and-a-half/double breaker switchyard arrangement are as follows.

- ◆ Any transmission line into the switchyard can be cleared either under normal or fault conditions without affecting any other transmission line or bus.
- ◆ Either bus can be cleared under normal or fault conditions without interruption of any transmission line or the other bus.
- ◆ Any circuit breaker can be isolated for maintenance or inspection without interruption of any transmission line or bus.
- ◆ A fault in a tie breaker or failure of the breaker to trip for a line fault results only in the loss of its two adjacent circuits until it can be isolated by disconnect switches.

A fault in a bus side breaker or failure of the breaker to trip for a line or generator fault results only in the loss of the adjacent circuits and the adjacent bus until it can be isolated by disconnect switches.} The U.S. EPR FSAR includes the following COL Item in Section 8.2.1.2:

A COL applicant that references the U.S. EPR design certification will provide site-specific information regarding indication and control of switchyard components.

This COL Item is addressed as follows:

{A control house is located along the southern side of the switchyard to support control and protection requirements. Control power for switchyard breakers required to connect or disconnect any components of BBNPP from the transmission system is provided by the switchyard batteries. There is a dual set of batteries located inside the switchyard control house. Switchyard breakers operate to clear a fault on any auxiliary transformer and for system faults such as bus differential or breaker failure. A switchyard DC system undervoltage condition is alarmed in the main control room.

BBNPP owns and maintains all equipment in the Bell Bend 500kV Switchyard. However, administrative control of the Bell Bend switchyard breakers is shared between BBNPP and PJM. BBNPP has jurisdictional control and normally operates the breakers connecting the Main

Step-Up (MSU) transformers and the auxiliary transformers. PJM has jurisdictional control and has, via delegation to PPL EU, the ability to operate the breakers associated with the offsite (grid interface) connecting transmission lines. One circuit from the BBNPP site to the existing Susquehanna 500 kV Yard is via breakers CB 10 and 11. The other circuit is from the BBNPP site to the new Susquehanna 500 kV Yard 2 via breakers CB 7 and 8. PJM will retain jurisdictional control of these breakers to operate them as part of the network. Local tripping control is also provided at the circuit breakers. Disconnect switches are provided to individually isolate each circuit breaker from the switchyard bus and associated lines. This permits individual breaker maintenance and testing to proceed while the switchyard and lines remain energized.}

The U.S. EPR FSAR includes the following COL Item in Section 8.2.1.2:

A COL applicant that references the U.S. EPR design certification will provide site-specific information for the protective devices that control the switchyard breakers and other switchyard relay devices.

This COL Item is addressed as follows:

{Electrical protection of circuits from the BBNPP switchyard is provided by a primary and secondary relaying scheme. The current input for the protective relaying schemes come from separate sets of circuit breaker bushing current transformers. Also, the control power for all primary and secondary relaying schemes is supplied from separate switchyard 125 VDC battery systems. These schemes are used for the following:

- ◆ The scheme is used on each of the two 500 kV transmission circuits from the BBNPP 500 kV switchyard to the transmission system. The potential input for the primary and secondary transmission circuit relaying systems is supplied from fused branch circuits originating from a set of coupling capacitor potential devices connected to the associated transmission circuit.
- ◆ The switchyard buses use a primary and backup scheme. The zone of protection of each 500 kV bus includes all the 500 kV circuit breakers adjacent to the protected bus.
- ◆ Line protection for the MSU transformer and auxiliary transformers use primary and backup schemes.

In addition to the above described relaying systems, each of the 500 kV circuit breakers has an associated circuit breaker failure relaying system. A circuit breaker failure scheme is provided in the unlikely event a circuit breaker fails to trip. If a breaker fails to open coincident with a line fault, tripping of all breakers adjacent to the failed breaker will occur. If the failed breaker is the center breaker, then only the remaining bus breaker will trip resulting in the undesired loss of the other line in the bay. If the failed breaker is a bus breaker then all breakers connected to the same bus will be tripped. Assuming all bus and center breakers are normally closed, the remaining bus will continue to supply all line elements.

For the two 125 VDC batteries located in the BBNPP 500 kV switchyard control house, each battery has its own battery charger. Each battery charger is connected to separate 480 VAC distribution panel boards also located in the control house. The switchyard 125 VDC battery systems are independent of the BBNPP non-Class 1E and Class 1E battery systems.

PJM is the Transmission System Operator (TSO) and Reliability Coordinator for the PJM RTO (Regional Transmission Operator), responsible for regional Reliability coordination as defined

in the NERC (North American Electric Reliability Corporation) and Regional Standards and applicable PJM Operating Manuals. PJM operates the transmission grid in compliance with good utility practice, NERC standards, and PJM policies, guidelines and operating procedures.

PPL Electric Utilities, as the Transmission System Owner (TO) interfacing with BBNPP, is required to operate its transmission facilities in accordance with the PJM Operating Manuals and follow PJM instructions related to PJM responsibilities.

PJM Manual 03, Transmission Operations, is one of a series of manuals within the PJM Transmission set. This manual focuses on specific transmission conditions and procedures for the operation of Designated Transmission Facilities. PJM Manual 03 includes a specific section titled, Notification and Mitigation Protocols for Nuclear Plant Voltage Limits. The purpose of this section is to ensure that nuclear plant operators are notified whenever actual or post-contingency voltages (ie., loss of a given generation or transmission facility otherwise referred to as N-1) critical to ensuring that safety systems will work properly, are determined to be at or below acceptable limits.

The PJM Energy Management System (EMS) models and operates to the most restrictive substation voltage limit for both actual and N-1 contingency conditions. PJM will notify nuclear plants (including BBNPP) if the EMS results indicate nuclear substation voltage limits are or could be exceeded. This notification should occur within 15 minutes for voltage contingency violations and immediately for actual voltage limit violations. To the extent practicable, PJM will remedy the violation within 30 minutes.

Communications generally take place between PJM and the Transmission System Owner (PPL EU in the case of BBNPP). However, if there is a potential for confusion or miscommunication, PJM can talk directly with affected nuclear plants. If direct communication is deemed necessary, the call will typically be three-way between PJM, the nuclear plant, and the Transmission System Owner.

While PJM generally will not provide transmission operation information to any individual market participant without providing that information to all market participants, the manual recognizes the unique condition where the public health and safety is dependent upon reliable power to a nuclear power plant, and permits PJM operators to provide nuclear power plants with actual voltage at the plant location, the post-contingency voltage at the plant location, and the limiting contingency causing the violation.

In addition to these requirements, PJM Manual 03 requires that nuclear power plants be notified (via the Transmission System Owner) if the ability to perform voltage drop/postcontingency calculations is lost for any reason.

BBNPP will have instructions to comply with NERC and PJM requirements requiring notification to the TSO of:

- ◆ Any unplanned changes to the main generator output (real or reactive load), including the duration of the change
- ◆ Any changes to the status of the main generator automatic voltage regulator (e.g., a transfer to manual voltage control from automatic), including the expected duration of the change

- ◆ Any inability to comply with reliability directives received from the TSO when such actions would violate safety, equipment, regulatory, or statutory requirements

(The above notifications will be made as soon as practicable but generally not to exceed 30 minutes)

- ◆ Main Generator outages
- ◆ Changes in plant conditions that may affect the interconnection such as:
 - a. Sabotage
 - b. Power changes
 - c. Switchyard operations
 - d. Plans to conduct trip sensitive operations or tests

Additionally, notifications to NERC are required for events such as severe grid voltage/frequency disturbances.

Operators will receive classroom and simulator training on recognition of grid conditions, selecting the appropriate procedure for response, and procedure usage as part of the standard operator training program. Knowledge gained in this training will be tested by written quizzes and evaluated simulator scenarios.

No formal training or testing regarding the TSO protocols is given to operators or maintenance personnel}

8.2.1.3 Transformer Area

No departures or supplements.

8.2.2 Analysis

No departures or supplements.

8.2.2.1 Compliance with GDC 2

No departures or supplements.

8.2.2.2 Compliance with GDC 4

No departures or supplements.

8.2.2.3 Compliance with GDC 5

No departures or supplements.

8.2.2.4 Compliance with GDC 17

The U.S. EPR FSAR includes the following COL Item in Section 8.2.2.4:

A COL applicant that references the U.S. EPR design certification will provide a site-specific grid stability analysis. The results of the analysis will demonstrate that:

- ◆ The PPS is not degraded below a level that will activate EPSS degraded grid protection actions after any of the following single contingencies:

- ◆ U.S. EPR turbine-generator trip.
- ◆ Loss of the largest unit supplying the grid.
- ◆ Loss of the largest transmission circuit or inter-tie.
- ◆ Loss of the largest load on the grid.
- ◆ The transmission system will not subject the reactor coolant pumps to a sustained frequency decay of greater than 3.5 Hz/sec as bounded by the decrease in reactor coolant system flow rate transient and accident analysis described in Section 15.3.2.

This COL Item is addressed as follows:

{There are two relevant PJM studies for BBNPP; the preliminary Susquehanna 1600 MW R01-R02 Impact Study Re-study (SIS) (PJM, 2008a), and the PJM Preliminary Stability Study for R01-R02, Bell Bend 500KV-1800MW (PSS) (PJM, 2008b.) The SIS projects the impact that BBNPP will have on the network, including a brief description of the transmission lines and substations, and the PSS shows that PJM Generator Interconnection for Bell Bend is stable for all tested conditions.

The SIS states that the work will include the construction of a new 500kV switchyard, called Susquehanna 500kV Yard 2. The yard will be breaker and a half construction with a north and south bus, and room for 4 bays. The initial construction of this yard will be bay 2 and bay 4 with bay 3 left vacant and bay 1 left open for expansion, as shown in Figure 8.2-3. The yard will have three new 500 kV circuit breakers, associated disconnect switches, and controls.

For both transmission lines from the BBNPP Switchyard, PPL EU will:

- ◆ Design and construct 500 kV single-circuit transmission lines on self-supporting steel H-frame poles, each line, within a 200 ft R/W, using bundled 1590 ACAR. These lines will be dedicated to only the Bell Bend NPP facility. These lines will be part of the PPL EU 500kV network, and may have network flows on them. One of the lines will be connected into the existing Susquehanna 500kV Yard at Bay 7N and the other line will be connected into the new Susquehanna 500kV Yard 2 at Bay 4S.
- ◆ Install one ½-inch extra-high-strength (EHS) overhead ground wire (OHGW) on each transmission line.
- ◆ Install one fiber optic grounding wire (OPGW) on each transmission line.

The Susquehanna-Roseland 500kV line, which is planned to be completed and in service during 2012, will be split near the new Susquehanna 500kV Yard 2, and re-terminate the lines into the yard. The renamed Roseland-Susquehanna 500kV Yard 2 line will terminate at Susquehanna 500kV Yard 2 at bay position 2N. The renamed Susquehanna 500kV Yard 2-Susquehanna 500kV Yard line will terminate at Susquehanna 500kV Yard #2 bay position 2S, as shown in Figure 8.2-3.

The PSS analyzed transient stability for the addition of BBNPP, and was prepared using PJM's planning criteria against the 2012 summer peak conditions load and identified design requirements necessary to maintain the reliability of the transmission system. The criteria are based upon PJM planning procedures, NERC Planning Standards, and RFC Regional Reliability

Council planning criteria. For the stability analysis, light loading (50% of peak loading) is utilized with maximum generation.

The computer analysis was performed using the Siemens Power Technology International PSS/E Software. The analysis examined conditions involving loss of the largest generating unit, loss of the most critical transmission line, and multiple facility contingencies.

The results of the PSS conclude that with the additional generating capacity of BBNPP, the transmission system remains stable under the analyzed conditions, preserving the grid connection, and supporting the normal and shutdown requirements of BBNPP. There is no restrictive output limitation during an outage of any one of the two transmission lines to BBNPP switchyard. However, there is a design requirement identified in the PSS to ensure that the system remains stable (i.e., dual-pilot relaying on the renamed Susquehanna Yard 2 -Lackawanna line; both clearing times are contingent on the breaker at Lackawanna having right-of-way to close first; a reclose time of 1 second is adequate at Lackawanna.) Lackawanna will be the first substation on the renamed Susquehanna Yard 2 - Roseland 500 kV circuit.

The stability results tabulated in the conservative Bell Bend 1926MW (1800MW plus 7% stability margin) Output Fault List and Results, show that PJM Generator Interconnection R02 "Bell Bend 500kV" is stable for all tested conditions. With the additional generating capacity of BBNPP, the transmission system remains stable under the analyzed conditions, preserving the grid connection, and supporting the normal and shutdown requirements of BBNPP.

The studies were run under 2012 light load conditions, with Bell Bend at 1800 MW (versus the nominal 1600 MW) plus an additional 7% stability margin (1926 MW), and the new Susquehanna-Roseland 500kV line operating in service. The PJM Stability Study does not address the underlying need for the Susquehanna/Roseland 500 kV transmission line, which has been separately and independently determined as part of the PJM Regional Transmission Expansion Plan (RTEP) process.

Based on the stability results, PJM recommended the installation of a maximum of a 3-cycle (3~) breakers at both ends of the renamed Susquehanna-Lackawanna 500kV line to provide adequate instantaneous clearing times.

Summary of PJM recommendations:

- ◆ 3-cycle (or less) breakers should be used at both ends of the line
- ◆ Dual-pilot relaying shall be required on the line
- ◆ Lackawanna breaker(s) shall have reclosing right of way on the Susquehanna-Lackawanna 500kV line
- ◆ A reclosing delay time of one (1) second (60~) or longer shall be used at Lackawanna

These modifications will be completed prior to initial fuel load.

A PJM System Voltage Study (PJM, 2008c) was performed to determine the maximum and minimum voltage that the switchyard can maintain without any reactive support from BBNPP. This study was prepared using the same reliability planning criteria as was used on the SIS.

The load flow was performed using the Siemens PSS/E Software. The load flow analysis included the station service loads and multiple system contingencies.

The results of the study conclude that the new BBNPP substation 500 kV bus will operate within an acceptable voltage range to satisfy PJM Planning Reliability Criteria for pre-contingency conditions (500-550 kV) and post contingency conditions (5% max. voltage drop) with BBNPP at zero reactive power output. During periods of instability, or analyzed switchyard voltages lower than the allowed limit, the transmission operator will notify BBNPP. The PJM dispatcher can request synchronous condensers and switchable capacitors to be placed in service, have operating generators supply maximum MVAR or if needed manual load dump can be initiated.

The U.S. EPR FSAR states that the plant will operate with a transmission system operating voltage range of $\pm 10\%$. However, based on the above site specific voltage study BBNPP may be designed to operate with a -5%, +10% transmission system operating voltage range.

Based on the results of the System Voltage Study the grid will not be lost due to the loss of the largest generating unit (i.e., BBNPP) or the loss of the most critical transmission line or the loss of the largest load on the grid. The design (i.e., tap range & bus regulation voltage setting) of the on-load tap changers for each EAT will ensure that the downstream EPSS 6.9 kV buses will have sufficient voltage to preclude the degraded voltage protection scheme from separating the buses from the preferred power source as described in the U.S. EPR FSAR Section 8.3.1.1.3. A site specific system calculation will be performed to confirm the design. See Chapter 16, Technical Specifications, Section 3.3.1, for specific degraded grid voltage protection settings.

Grid availability in the region over the past 26 years was also examined and it was confirmed that the system has been highly reliable with minimal forced outages. During these component outage occurrences, the transmission grid as a whole has remained available for 99.65% of the time, with a total of 47 forced outages in the 26 year period. Most of the outages were due to relay failure, system design, or unknown. Past operating experience, covering outage information over a span of approximately 26 years, from June 8, 1981 through June 27, 2007, which includes the North-East Black Out of August 14 2003, was reviewed and the conclusion was that:

"None of the outages involved the simultaneous outage of more than one line, and the BBNPP switchyards will be designed so that the loss of a single line does not result in the loss of power to the station auxiliary power system."

During the North-East Black Out, the transmission grid transient in the afternoon of August 14 2003, the Susquehanna Steam Electric Station did not experience any adjustment in MW load on either unit. Voltage fluctuations were observed on the grid, but they did not result in any equipment problems and both Susquehanna units responded as designed.

Failure rates of individual transmission facilities are low in the PPL territory. PPL EU has and continues to adhere to the planning and design standards associated with the bulk electric system, as identified in the PPL EU Reliability Principles & Practices, and other PJM documents. Consequently, the system is expected to be resilient to individual equipment outages cascading into widespread system interruptions. A review of grid performance verifies that there have been no widespread system interruptions. As viewed from the Susquehanna 500 kV switchyard, the PPL EU transmission grid has been available for the entire period.

The PJM grid is maintained at 60Hz. During a system underfrequency condition, the Mid-Atlantic region of PJM utilizes an automatic load shedding scheme which will drop load by 30% in 10% increments at 59.3 Hz, 58.9 Hz & 58.5 Hz.

A review of the grid frequency data for the last five years (including the Northeast Blackout of 2003) indicates that the frequency decay rate during disturbances on the Eastern Interconnection (which includes the PJM Territory) was much less than 3.5 Hz/sec. The worst decay rate during this time period occurred on August 4, 2007 and was due to a 4400 MW generation loss event (largest disturbance on the grid since August 2003 blackout) which resulted in a sustained decay rate of 0.015 Hz/sec. As such, the reactor coolant pumps are not expected to be subject to a sustained frequency decay greater than 3.5 Hz/sec.

Failure Mode and Effects Analysis

A failure mode and effects analysis (FMEA) of the switchyard components has been performed to assess the possibility of simultaneous failure of both circuits for BBNPP as a result of single events, such as a breaker not operating during fault conditions, a spurious relay trip, a loss of a control circuit power supply, or a fault in a switchyard bus or transformer. This FMEA supplements the FMEA described in U.S. EPR FSAR Section 8.2.2.4.

The 500 kV components addressed in this FMEA are as follows and a summary of the results of this FMEA is presented below.

- ◆ Transmission System
- ◆ Transmission Line Towers
- ◆ Transmission Line Conductors
- ◆ Switchyard
- ◆ Circuit Breakers
- ◆ Disconnect Switches

Transmission System Failure Mode Evaluation

The offsite power system is comprised and built with sufficient capacity and capability to assure that design limits and design conditions, relative to the offsite power system, maintain their function in the event of a postulated accident.

The transmission system associated with the BBNPP is designed and constructed so that no loss of offsite power to the 500 kV switchyard is experienced with the occurrence of any of the following events:

- ◆ Loss of one transmission circuit.
- ◆ Loss of a generator.
- ◆ A three phase fault occurring on any transmission circuit which is cleared by primary or backup relaying.

The offsite electric power system supplies at least two preferred power circuits, which will be physically independent and separate. These lines are located to minimize the likelihood of simultaneous failure under operating, postulated accident, and postulated adverse

environmental conditions. The preferred circuits are maintained and connected to the BBNPP MSU transformer via the BBNPP switchyard. Transmission tower separation, line installation, and clearances are consistent with the National Electrical Safety Code (NESC), PPL EU transmission line standards, and PPL requirements. Basic tower structural design parameters, including the number of conductors, height, materials, color, and finish are consistent with PPL EU transmission line design standards. Adequate clearance will be provided to ensure that both of the Bell Bend transmission lines will not be lost in the event of a tower collapse.

Transmission Line Tower Failure Mode Evaluation

The new 500 kV towers will be designed and constructed using a transmission tower design providing clearances consistent with the National Electrical Safety Code and PPL EU engineering standards. All existing towers are grounded with either ground rods or a counterpoise ground system. All new transmission line towers will be constructed and grounded using the same methods.

Failure of any one tower or failure of any components within the tower structure, due to structural failure can at most disrupt and cause a loss of one of the preferred sources of power. The spacing of the towers between adjacent preferred sources is designed to account for the collapse of any one tower.

Therefore, one of the preferred sources of power remains available for this failure mode in order to maintain the containment integrity and other vital functions in the event of a postulated accident.

Transmission Line Conductors Failure Mode Evaluation

The new transmission lines will have conductors sized to accommodate the load as a result of BBNPP.

All new 500 kV BBNPP transmission lines will be constructed to provide clearances consistent with the National Electrical Safety Code and PPL EU engineering standards. At a minimum, all clearances for high voltage conductors above grade would be equal to or exceed present clearance minimums. High voltage conductor span lengths are engineered to establish the required installation guidelines and tensions for each line. All transmission lines crossing roads and railroads comply with the National Electrical Safety Code and PPL EU engineering standards. The new transmission lines are configured to preclude the crossing of other preferred transmission lines.

Failure of a line conductor would cause the loss of one preferred source of power but not more than one. Therefore, a minimum of one preferred source of power remains available for this failure mode in order to maintain the containment integrity and other vital functions in the event of a postulated accident.

Switchyard Failure Mode Evaluation

As indicated in Figure 8.2-2, a breaker-and-a-half/double breaker scheme is incorporated in the design of the 500 kV switchyard at BBNPP. The 500 kV equipment in the BBNPP switchyard is all rated and positioned within the bus configuration according to the following criteria in order to maintain load flow incoming and outgoing from the unit.

- ◆ Equipment continuous current ratings are chosen such that no single contingency in the switchyard (e.g., a breaker being out of for maintenance) can result in current exceeding 100% of the continuous current rating of the equipment.

- ◆ Interrupting duties are specified such that no faults occurring on the system exceed the equipment rating.
- ◆ Momentary ratings are specified such that no fault occurring on the system exceeds the equipment momentary rating.
- ◆ Voltage ratings are specified to be greater than the maximum expected operating voltage.

The breaker-and-a-half /double breaker switchyard arrangement offers the following flexibility to control a failed condition within the switchyard.

- ◆ Any faulted transmission line into the switchyard can be isolated without affecting any other transmission line.
- ◆ Either bus can be isolated without interruption of any transmission line or other bus.
- ◆ Each battery charger is connected to a separate 480 VAC distribution panel board located in the 500 kV switchyard control house.
- ◆ A primary and secondary relaying system is included on each of the two 500 kV transmission circuits from the 500 kV switchyard to the PPL EU grid. All relay schemes used for protection of the offsite power circuits and the switching station equipment include primary and backup protection features. All breakers are equipped with dual trip coils. Each protection system (i.e. primary and secondary) which supplies a trip signal is connected to a separate trip coil.
- ◆ Instrumentation and control circuits of the main power offsite circuit (i.e., normal preferred power circuit) are separated from the instrumentation and control circuits for the reserve power circuit (i.e., alternate preferred power circuit).
- ◆ The current input for the primary and secondary transmission circuit relaying systems is supplied from separate sets of circuit breaker bushing current transformers. The potential input for the primary and secondary transmission circuit relaying systems is supplied from fused branch circuits originating from a set of coupling capacitor potential devices connected to the associated transmission circuit. The control power for the primary and secondary transmission circuit relaying systems is supplied from separate 125 VDC systems.
- ◆ A primary and secondary relay system is included for protection of each of the 500 kV switchyard buses. The zone of protection of each 500 kV bus protection system includes all the 500 kV circuit breakers adjacent to the protected bus. The primary relay is the instantaneous high impedance type used for bus protection to detect both phase and ground faults. This relay is connected in conjunction with auxiliary relays and pilot wire relaying to form a differential protection, instantaneous auxiliary tripping, and transferred tripping relay system. The secondary relay system is a duplicate of the primary relay system.
- ◆ The current input for the primary and secondary 500 kV bus relaying systems is supplied from separate sets of 500 kV circuit breaker bushing current transformers. The control power for the relay terminals of the primary and secondary 500 kV bus relaying systems located in the 500 kV switchyard control house is supplied from separate 125 VDC systems.

- ◆ A primary and secondary relay system is included on each of the circuits connecting the MSU transformer, EATs and the NATs to their respective 500 kV switchyard position. The zone of protection of the MSU associated circuit connection protection system includes two associated circuit breakers at the 500 kV switchyard and the high side bushings of the MSU transformer. The secondary relay system is a duplicate of the primary relay system.
- ◆ The current input for the primary and secondary windings of the MSU transformer, EATs and the NATs relaying systems are supplied from separate sets of bushing current transformers. The current transformers are located on the circuit breaker bushings. The control power for the relay terminals of the primary and secondary MSU circuit connection relaying systems located in the 500 kV switchyard control house are supplied from separate 125 VDC systems. The control power for the relay terminals of the primary and secondary MSU, EATs and NATs circuit connection relaying systems located at the unit relay room are supplied from the respective unit non-Class 1E 125 VDC battery systems.
- ◆ Spurious relay operation within the switchyard that trips associated protection system will not impact any primary or backup system.

Therefore, a minimum of one preferred source of power remains available for this failure mode in order to maintain the containment integrity and other vital safety functions in the event of a postulated accidents.

Circuit Breakers Failure Mode Evaluation

As indicated in Figure 8.2-2, a breaker-and-a-half/double breaker scheme is incorporated in the design of the 500 kV switchyard for BBNPP. The 500 kV equipment in the BBNPP switchyard is rated and positioned within the bus configuration according to the following criteria in order to maintain load flow incoming and outgoing from the units:

- ◆ Circuit breaker continuous current ratings are chosen such that no single contingency in the switchyard (e.g., a breaker being out for maintenance) will result in a load exceeding 100% of the nameplate continuous current rating of the breaker.
- ◆ Interrupting duties are specified such that no fault occurring on the system, operating in steady-state conditions will exceed the breaker's nameplate interrupting capability.
- ◆ Any circuit breaker can be isolated for maintenance or inspection without interruption of any transmission line or bus.
- ◆ A fault in a tie breaker or failure of the breaker to trip for a line or generator fault results only in the loss of its two adjacent circuits until it can be isolated by disconnect switches.
- ◆ A fault in a bus side breaker or failure of the breaker to trip for a line fault results only in the loss of the adjacent circuits and the adjacent bus until it can be isolated by disconnect switches.

In addition to the above described 500 kV BBNPP switchyard relaying systems, each of the 500 kV circuit breakers has a primary protection relay and a backup protection relay. The primary relay scheme is a different type or manufacture from the backup relay scheme. This will preclude common mode failure issues with the protection relays.

The primary and secondary relaying systems of the 500 kV switchyard for BBNPP are connected to separate trip circuits in each 500 kV circuit breaker. The control power provided for the 500 kV switchyard primary and secondary relaying protection and breaker control circuits consists of two independent 125 VDC systems.

Disconnect Switch(s) Failure Mode Evaluation

All 500 kV disconnect switches have a momentary rating higher than the available short circuit level. The disconnect switches are implemented into the switchyard configuration to isolate main power circuits that have failed or are out for maintenance. A failure of the disconnect switch results only in the loss of the circuit in which it is connected.

Therefore, a minimum of one preferred source of power remains available for this failure mode in order to maintain the containment integrity and other vital functions in the event of a postulated accident.

FMEA Conclusion

The finding of this FMEA analysis is that there are no single failures which would cause the simultaneous failure of both preferred sources of offsite power.}

8.2.2.5 Compliance with GDC 18

The U.S. EPR FSAR includes the following COL Item in Section 8.2.2.5:

A COL applicant that references the U.S. EPR design certification will provide site-specific information for the station switchyard equipment inspection and testing plan.

This COL Item is addressed as follows:

{BBNPP shall establish an interface agreement that defines the interfaces and working relationships between various BBNPP site organizations and PPL EU to ensure the offsite power design requirements for the transmission facilities are maintained. The agreement defines the necessary requirements for operation, maintenance, calibration, testing and modification of transmission lines, switchyards, and related equipment. PPL EU is responsible for maintaining these facilities.

For performance of maintenance, testing, calibration and inspection, PPL EU follows its own field test manuals, vendor manuals and drawings, industry's maintenance practices and conforms to Federal Energy Regulatory Commission (FERC) requirements.

The BBNPP 500 kV Switchyard grounding and lightning protection systems will meet the requirements of GDC 18 and comply with testing and inspection requirements in accordance with Regulatory Guide 1.204 (NRC, 2005).

Regular inspections and maintenance of the transmission system and right-of-ways will be performed. These inspections and maintenance include patrols and maintenance of transmission line hardware on a periodic and as-needed basis. Vegetation maintenance may include tree trimming and application of herbicide. Maintenance of the proposed onsite corridors including vegetation management will be implemented under the existing PPL EU Corporation procedure.

Additionally, the following major inspection and maintenance activities are performed on the PPL EU transmission system:

- ◆ Support initial acceptance and commissioning inspections and tests.
- ◆ Perform periodic line equipment and right-of-way inspections via foot patrol.
- ◆ Perform periodic routine overhead line equipment and right-of-way inspections via contract helicopter services.
- ◆ Perform periodic comprehensive overhead line equipment and right-of-way inspections via contract helicopter services.
- ◆ Perform preventative maintenance repairs of deficiencies found during inspections that are required to ensure line availability and reliability.
- ◆ Deficiencies unable to be repaired via contract helicopter will be completed with line outage coordinated with BBNPP.

Multiple levels of inspection and maintenance are performed on the BBNPP and Susquehanna 500 kV switchyards and associated switchyards and substation facilities. This inspection and maintenance is as follows.

- ◆ Support initial acceptance and commissioning inspections and tests.
- ◆ Walk-throughs and visual inspections of each substation facility including, but not limited to, reading and recording of equipment counters and meters, site temperature and conditions, and equipment condition.
- ◆ Protective relay system testing including: visual inspection, calibration, verification of current and potential inputs, functional trip testing, and correct operation of relay communication equipment.
- ◆ AC Power Factor testing and oil sampling of large power transformers. Oil samples are evaluated through the use of gas chromatography and dielectric breakdown analysis.
- ◆ Several levels of inspection and maintenance for power circuit breakers. The frequency of each is a function of the number of operations and the length of time in service. External visual inspection of all functional systems, an external test, and an internal inspection. Frequency of the various maintenance/inspection efforts is based on a combination of operating history of the type of breaker, industry practice and manufacturer's recommended maintenance requirements.
- ◆ Periodically service motor-operated disconnect switches.
- ◆ Check GIS SF₆ gas density weekly or bi-weekly per instruction of BBNPP GIS Supplier.
- ◆ Inspect and test operating components inside SF₆ gas chamber per instructions of BBNPP GIS Supplier.
- ◆ The testing will performed to check:
 - a. functionality of GIS System

- b. commissioning of GIS System and the associated GIS components per instructions of the BBNPP GIS Supplier
 - c. periodic operations and maintenance of individual GIS components per instructions of BBNPP GIS Supplier.
- ◆ Testing and handling of SF₆ (e.g., leakage detection, gas density, etc.) per instructions of BBNPP GIS Supplier.
- ◆ Testing and inspecting operating components inside the SF₆ gas chamber per instructions of the BBNPP GIS Supplier.
- ◆ Thermography is used periodically to identify potential thermal heating issues on buses, conductors, connectors and switches.
- ◆ Maintenance of battery systems is performed on a periodic basis, to test battery impedance and inter-cell connection resistance, battery capacity and includes quarterly visual inspections, verification of battery voltage, and verification of electrolyte level.}

8.2.2.6 Compliance with GDC 33, GDC 34, GDC 35, GDC 38, GDC 41, and GDC 44

No departures or supplements.

8.2.2.7 Compliance with 10 CFR 50.63

The U.S. EPR FSAR includes the following COL Item in Section 8.2.2.7:

A COL applicant that references the U.S. EPR design certification will provide site-specific information that identifies actions necessary to restore offsite power and use available nearby power sources when offsite power is unavailable.

This COL Item is addressed as follows:

{BBNPP} includes two redundant SBO diesel generators designed in accordance with 10 CFR 50.63 (CFR, 2008) and Regulatory Guide 1.155 (NRC, 1988). As such, reliance on additional offsite power sources as an alternate AC source is not required. {There are no special local power sources that can be made available to re-supply the plant following a loss of the offsite power grid or an SBO. However, actions necessary to restore offsite power are identified as part of the procedures and training provided to plant operators for an SBO event described in response to the COL Item in Section 8.4.2.6.4.}

8.2.2.8 Compliance with 10 CFR 50.65(a)(4)

No departures or supplements.

8.2.2.9 Compliance with Branch Technical Position 8-3

No departures or supplements.

8.2.2.10 Compliance with Branch Technical Position 8-6

No departures or supplements.

8.2.3 References

{ANSI, 1982. Standard Temperature Measurement Thermocouples, ANSI MC96.1, American National Standards Institute, 1982.

ANSI/ASME, 2007a. ANSI/ASME Boiler Pressure Vessel Code, Section VIII: Pressure Vessels Division 1, American National Standards Institute/ American Society of Mechanical Engineers, 2007.

ANSI/ASME, 2007b. Power Piping, ANSI/ASME B31.1, American National Standards Institute/ American Society of Mechanical Engineers, 2007.

ANSI/IEEE, 1996. Specifications for Electromagnetic Noise and Field Strength Instrumentation, ANSI/IEEE C63.2, American National Standards Institute, 1996.

ASTM, 2000. Specification for Sulfur Hexafluoride, ASTM D2472, ASTM International, 2000.

CENELEC, 1986. Specification for Cast Aluminum Alloy Enclosures for Gas Filled High Voltage Switchgear and Controlgear, CENELEC EN 50 052, European Committee for Electrotechnical Standardization, 1986.

CENELEC, 1989. Specification for Wrought Aluminum and Aluminum Alloy Enclosures for Gas Filled High Voltage Switchgear and Controlgear, CENELEC EN 50 064, European Committee for Electrotechnical Standardization, 1989.

CENELEC, 1991. Specification for Welded Composite Enclosures of Cast and Wrought Aluminum Alloys for Gas Filled High Voltage Switchgear and Controlgear, CENELEC EN 50 069, European Committee for Electrotechnical Standardization, 1991.

CENELEC, 1992. Specification for Cast Resin Partitions for Metal Enclosed Gas Filled High Voltage Switchgear and Controlgear, CENELEC EN 50 089. European Committee for Electrotechnical Standardization, 1992.

CFR, 2008. Loss of All Alternating current Power, Title 10. Code of Federal Regulations, Part 50.63, U.S. Nuclear Regulatory Commission, 2008.

IEC, 2000. Partial Discharge Measurements, IEC 60270, International Electrotechnical Commission, 2000.

IEC, 2003a. High voltage switchgear and controlgear - Part 203: Gas-insulated metal-enclosed switchgear for rated voltages above 52kV, IEC 62271-203, International Electrotechnical Commission, 2003.

IEC, 2003b. Instrument transformers - Part 1: Current transformers , IEC 60044-1, Edition 1.2 International Electrotechnical Commission, 2003.

IEC, 2004. Guidelines for the checking and treatment of sulfur hexafluoride (SF₆) taken from electrical equipment and specification for its re-use, IEC 60480, Second Edition, International Electrotechnical Commission, 2004.

IEC, 2005. Specification of technical grade sulfur hexafluoride (SF₆) for use in electrical equipment - Edition 2, IEC 60376, International Electrotechnical Commission, 2005.

- IEC, 2006.** High-voltage test techniques, IEC 60060-1 (1998), 60060-2 (1994), 60060-3 (2006), International Electrotechnical Commission, 2006.
- IEC, 2007.** High-voltage switchgear and controlgear - Part 1: Common specifications, IEC 62271-1, International Electrotechnical Commission, 2007.
- IEC, 2008a.** High-voltage switchgear and controlgear - Part 100: High-voltage alternating current circuit breakers, IEC 62271-100, International Electrotechnical Commission, 2008.
- IEC, 2008b.** High-voltage switchgear and controlgear - Part 303: Use and handling of sulphur hexafluoride (SF₆), IEC TR 62271-303, Edition 1.0, International Electrotechnical Commission, 2008.
- IEEE, [R2005].** IEEE Guide for Moisture Measurement and Control in SF₆ Gas-Insulated Equipment, IEEE 1125, Institute of Electrical and Electronics Engineers, 1993.
- IEEE, 1995.** Guide for the Application, Installation, Operation, and Maintenance of High-Voltage Air Disconnecting and Load Interrupter Switches, IEEE C37.35, Institute of Electrical and Electronics Engineers, 1995.
- IEEE, 1996a.** IEEE Recommended Practice for Determining the Electric Power Station Ground Potential Rise and Induced Voltage from a Power Fault, IEEE 367, Institute of Electrical and Electronics Engineers, 1996.
- IEEE, 1996b.** Guide to Direct Lightning Stroke Shielding of Substations, IEEE 998, Institute of Electrical and Electronic Engineers, 1996.
- IEEE, 1996c.** Guide to Specifications for Gas-Insulated, Electric Power Substation Equipment, IEEE C37.123, Institute of Electrical and Electronics Engineers, 1996.
- IEEE, 1997.** IEEE Standard Definitions and Requirements for High Voltage Air Switches, IEEE C37.30, Institute of Electrical and Electronics Engineers, 1997.
- IEEE, 1999.** IEEE Applications Guide for AC High Voltage Circuit Breakers on a Symmetrical Current Basis, IEEE C37.010, Institute of Electrical and Electronics Engineers, 1999.
- IEEE, 2000a.** IEEE Standard for AC High-Voltage Circuit Breakers on a Symmetrical Current Basis-Preferred Ratings and Related Required Capabilities, IEEE std C37.06-2000, Institute of Electrical and Electronics Engineers, 2000.
- IEEE, 2000b.** Performance Characteristics and Dimensions for Outdoor Apparatus Bushings, IEEE C57.19.01, Institute of Electrical and Electronics Engineers, 2000.
- IEEE, 2000c.** IEEE Guide for Safety in AC Subgrounding, IEEE 80, Institute of Electrical Engineers, 2000.
- IEEE, [R2002].** IEEE Standard for Gas Insulated Substations, IEEE C37.122, Institute of Electrical and Electronics Engineers, 2002.
- IEEE, 2005a.** IEEE Standard for Metal Oxide Surge Arresters for AC Power Circuits (>1 kV), IEEE C62.11, Institute of Electrical and Electronics Engineers, 2005.

IEEE, 2005b. IEEE Recommended Practice for Seismic Design of Substations, IEEE 693, Institute of Electrical and Electronics Engineers, 2005.

IEEE, [R2006]. IEEE Standard Rating Structure for AC High Voltage Circuit Breakers Rated on a Symmetrical Current Basis, IEEE C37.04, Institute of Electrical and Electronics Engineers, 2006.

IEEE, [2007]. IEEE Standard Rating Structure for AC High Voltage Circuit Breakers Rated on a Symmetrical Current Basis, IEEE C37.09, Institute of Electrical and Electronics Engineers, 2007.

IEEE, 2007. Standard of Common Requirements for High Voltage Power Switchgear Rated Above 1000 V, IEEE C37.100.1, Institute of Electrical and Electronics Engineers, 2007.

IEEE, [R2008]. IEEE Guide for Evaluating the Effect of Solar Radiation on Outdoor Metal Enclosed Switchgear, IEEE C37.24, Institute of Electrical and Electronics Engineers, 2008.

IEEE, 2008. Requirements for Instrument Transformers, IEEE C57.13, Institute of Electrical and Electronics Engineers, 2008.

IEEE, 2009. Standard test Procedure and requirements for High Voltage Alternating Current Cable Terminations, IEEE 48, Institute of Electrical and Electronics Engineers, 2009.

NEMA SG 11-2008. Guide For Handling And Maintenance Of Alternating Current Outdoor High-Voltage Circuit Breakers, NEMA SG 11-2008, National Electrical Manufacturers Association, 2009.

NRC, 1988. Station Blackout, Regulatory Guide 1.155, U.S. Nuclear Regulatory Commission, August 1988.

NRC, 2005. Guidelines for Lightning Protection of Nuclear Power Plants, Regulatory Guide 1.204, U.S. Nuclear Regulatory Commission, November 2005.

PJM, 2008a. PJM Generator Interconnection R01/R02 Susquehanna 1600 MW Impact Study Re-study, DMS #500623, September 2008.

PJM, 2008b. Preliminary Stability Study for R01-R02, Bell Bend 500KV-1800MW, June 2008.

PJM, 2008c. PJM Generator Interconnection R01/R02 Susquehanna 1600 MW Voltage Study, Final, August 2008.}

Table 8.2-1— {PPL EU Transmission System Circuits Connected to the BBNPP Site}

TERMINATION	NOMINAL VOLTAGE	THERMAL CAPACITY	APPROXIMATE LENGTH
Susquehanna Yard	500 kV	4260 MVA	0.5 mi (0.8 km)
Susquehanna Yard 2	500 kV	4260 MVA	0.75 mi (1.2 km)

Figure 8.2-1 — {BBNPP 500kV Switchyard and Transmission Line Layout}

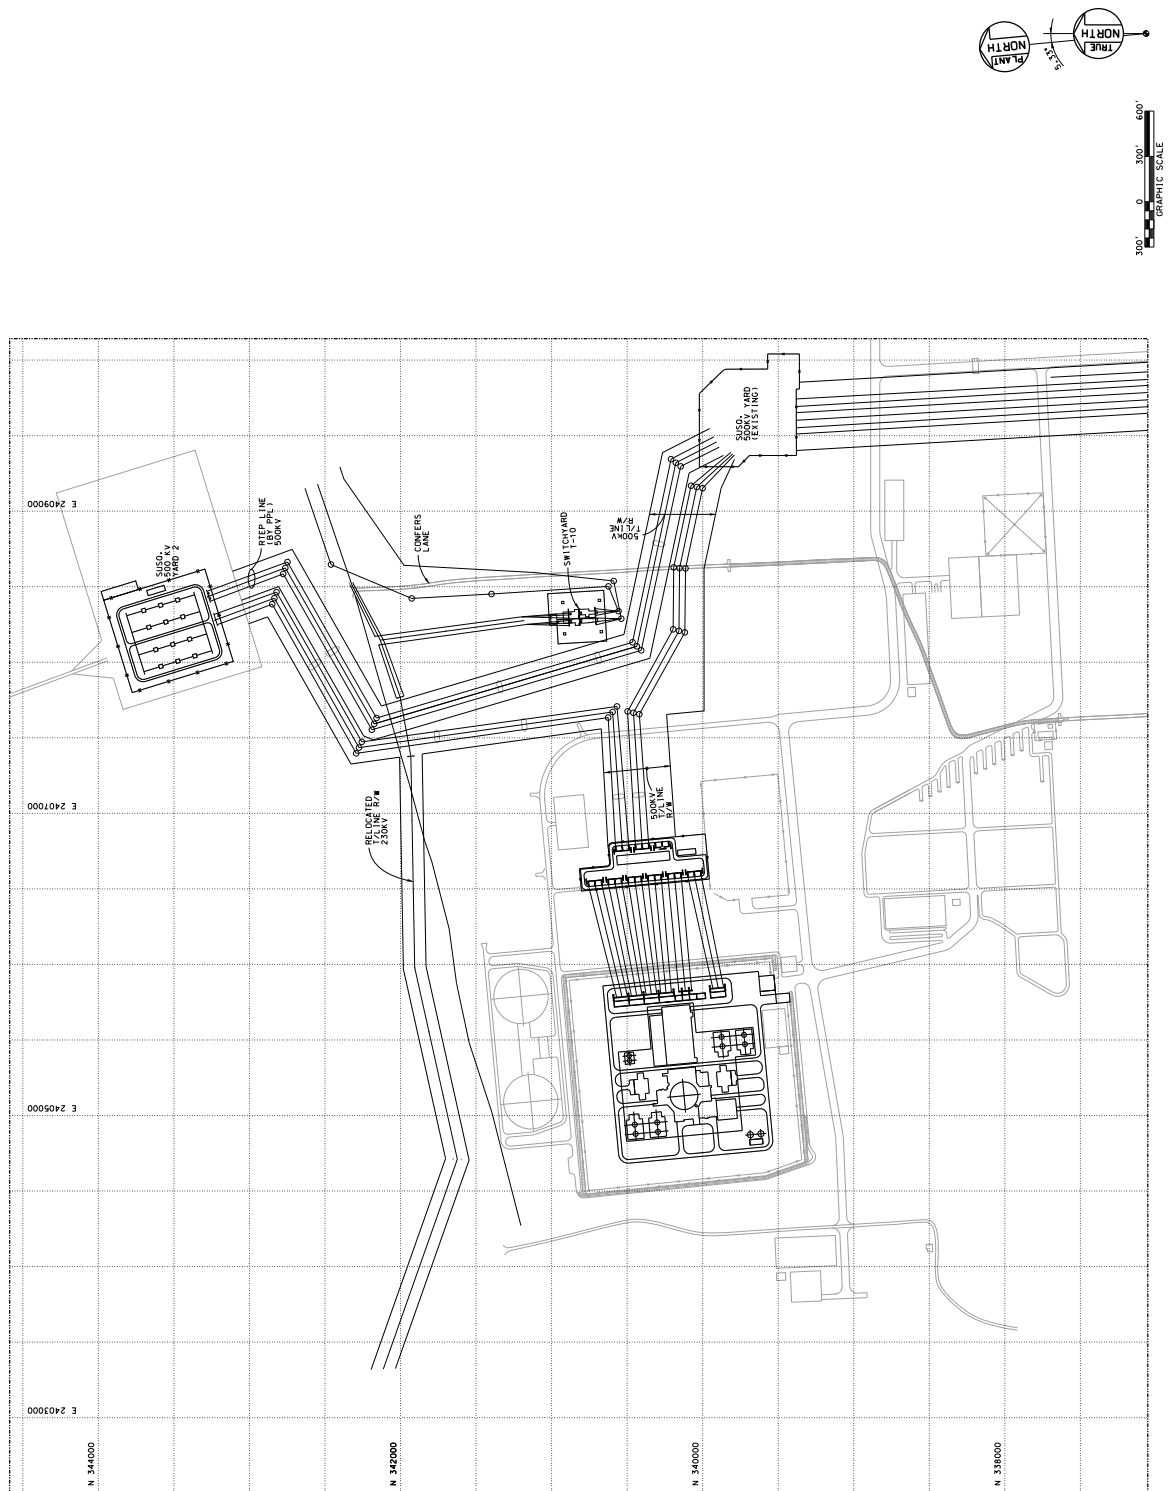


Figure 8.2-2— {BBNPP 500kV Switchyard Single Line Diagram}

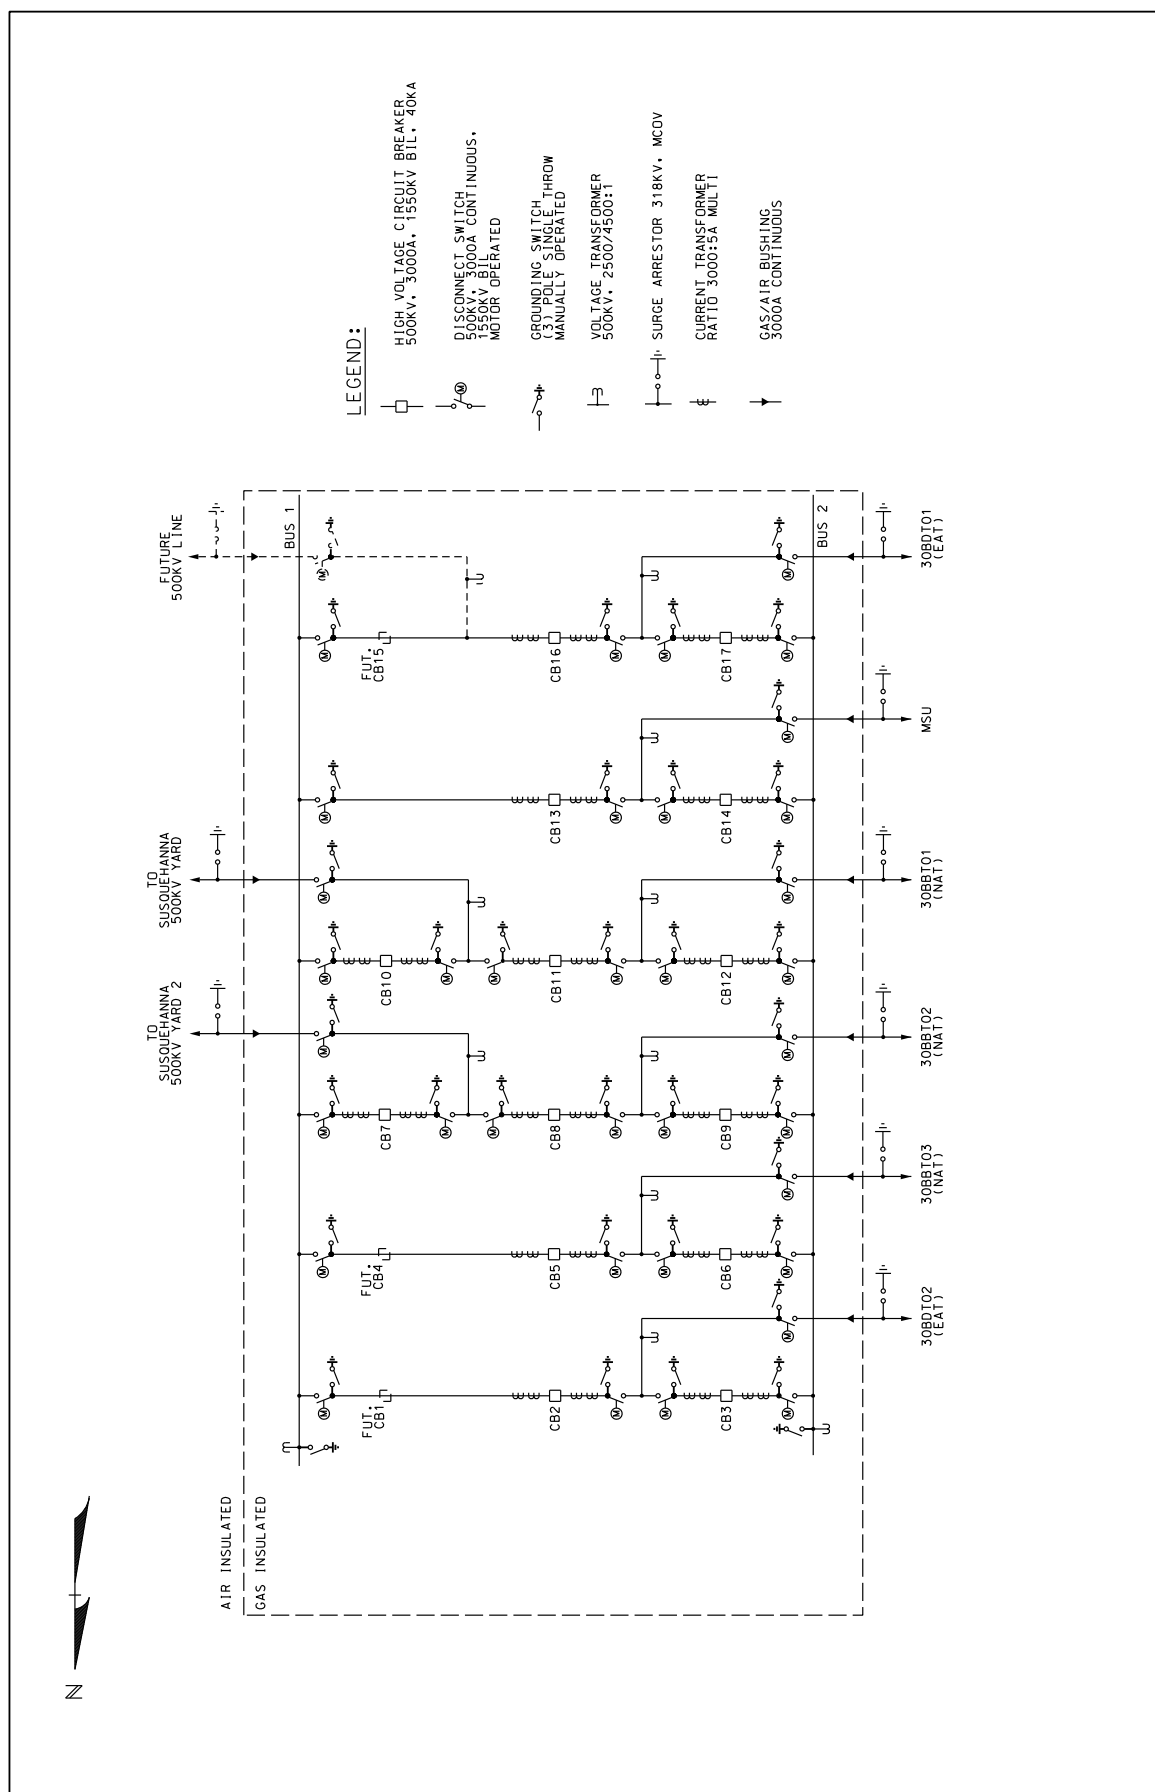


Figure 8.2-3—{Susquehanna 500kV, Yard 2}

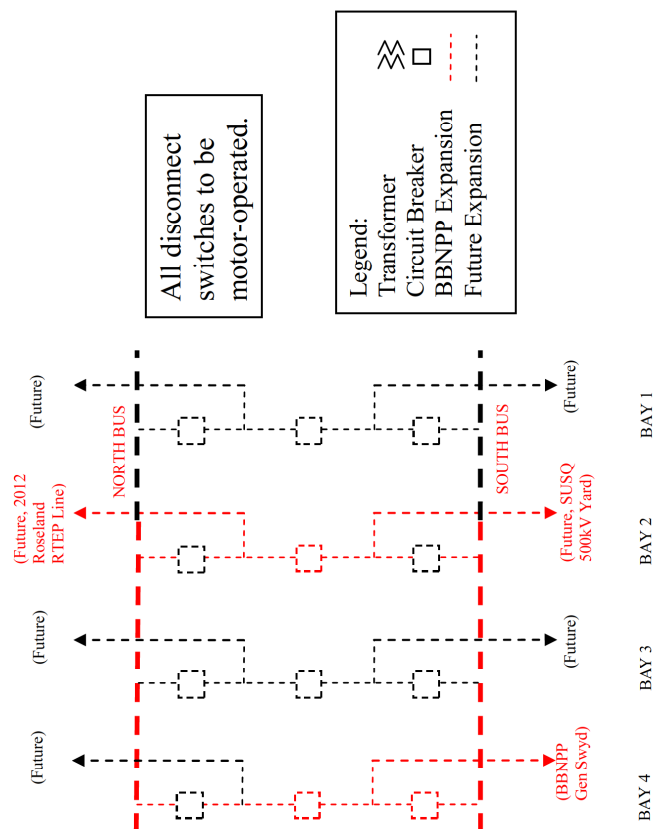
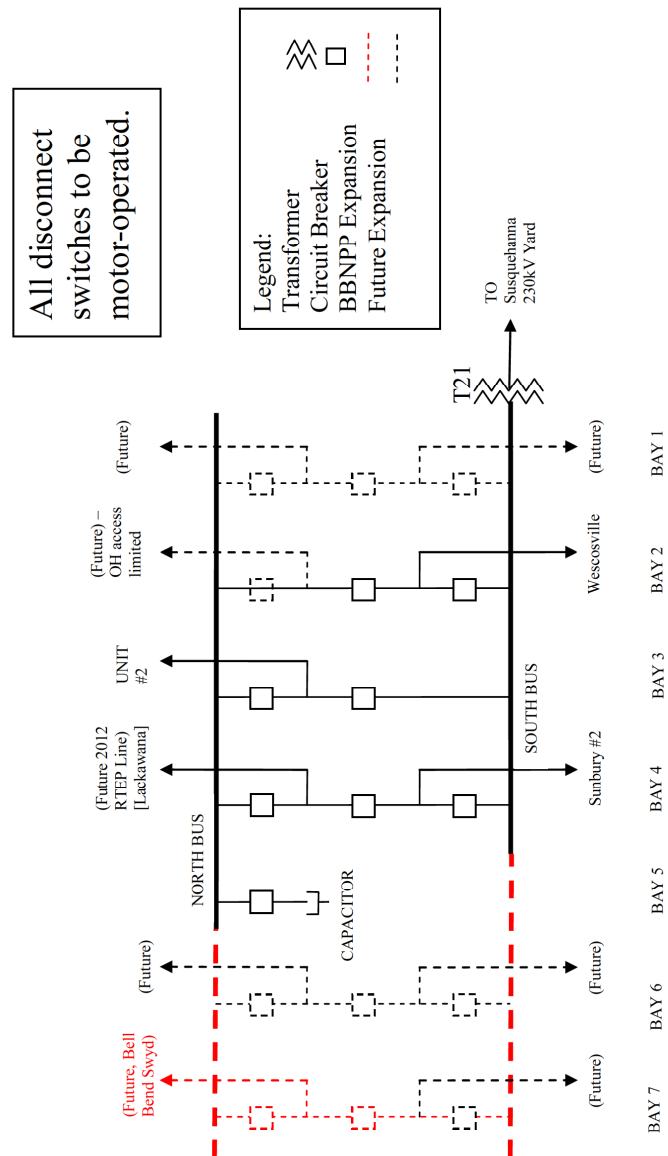


Figure 8.2-4—{Susquehanna 500kV Yard}

8.3 ONSITE POWER SYSTEM

This section of the U.S. EPR FSAR is incorporated by reference with the following supplements and departure.

8.3.1 Alternating Current Power Systems

8.3.1.1 Description

Additional site-specific loads powered from the station EDGs are specified in Table 8.1-1, Table 8.1-2, Table 8.1-3, and Table 8.1-4. These tables supplement the information provided in U.S. EPR FSAR Tables 8.3-4, 8.3-5, 8.3-6, and 8.3-7.

{Figure 8.3-1 (Sheets 1 through 3) and Figure 8.3-2 (Sheets 1 through 5)} provide the site-specific modifications to the Emergency and Normal Power Supply Systems Single Line Diagrams. This information supplements U.S. EPR FSAR Figures 8.3-2 and 8.3-3. The site-specific load analysis is provided in Section 8.1.3.

Table 8.3-1 identifies the nominal ratings for the site-specific AC power system main components. This information supplements U.S. EPR FSAR Table 8.3-1.

8.3.1.1.1 Emergency Power Supply System

{There are four divisions of Emergency Power Supply System (EPSS) distribution equipment for the Essential Service Water Emergency Makeup System (ESWEMS). The EPSS distribution equipment for the ESWEMS is located in the Seismic Category 1 ESWEMS Pumphouse. Each division of EPSS distribution equipment is located in the respective Seismic Category 1 Safeguards Building (SB), Essential Service Water Pump Building (ESWPB), ESWEMS Pumphouse, or Diesel Generator Building, which provides physical separation from the redundant equipment.}

The site-specific EPSS distribution switchgear and nominal bus voltages are shown in Table 8.3-2. This information supplements U.S. EPR FSAR Table 8.3-2.

8.3.1.1.2 Normal Power Supply System

{The U.S. EPR FSAR Normal Power Supply System (NPSS) includes conceptual design information for the portion of the distribution system that supplies the Circulating Water Supply System components. The NPSS conceptual design information is identified by double brackets in Table 8.3-3 and Figure 8.3-3. The following 480 V AC load centers are identified as conceptual design information in Table 8.3-3: 31BFG, 31BFF, 32BFG, 32BFF, 33BFG, 33BFF, 34BFG, and 34BFF. These load centers, the distribution transformers that supply them, and downstream motor control centers are also identified as conceptual information in Figure 8.3-3.

The above conceptual design information is replaced with site-specific information as follows: 480 V AC load centers 31BFG, 32BFG, 33BFF, 33BFG, 34BFF, and 34BFG are not used, while load centers 31BFF and 32BFF are incorporated by reference. The changes result from BBNPP utilizing natural draft cooling towers rather than mechanical draft cooling towers.

The site-specific NPSS includes additional non-Class 1E 6.9 kV switchgear 33/34BBE to provide power to the cooling tower makeup pumps and raw water supply system pumps. The switchgear are located in the BBNPP Intake Structure.}

8.3.1.1.3 Electric Circuit Protection and Coordination

No departures or supplements.

8.3.1.1.4 Onsite AC Power System Controls and Instrumentation

No departures or supplements.

8.3.1.1.5 Standby AC Emergency Diesel Generators

The U.S. EPR FSAR includes the following COL Item in Section 8.3.1.1.5:

A COL applicant that references the U.S. EPR design certification will monitor and maintain EDG reliability during plant operations to verify the selected reliability level target is being achieved as intended by RG 1.155.

This COL Item is addressed as follows:

{PPL Bell Bend, LLC} shall monitor and maintain EDG reliability to verify the selected reliability level goal of 0.95 is being achieved as intended by Regulatory Guide 1.155 (NRC, 1988).

8.3.1.1.6 Station Blackout Diesel Generators

No departures or supplements.

8.3.1.1.7 Electrical Equipment Layout

{The electrical distribution system components distribute power to safety-related and non-safety related loads in the Reactor Building, Safeguards Buildings, Diesel Buildings, Essential Service Water Pump Buildings, Turbine Island, Fuel Building, Nuclear Auxiliary Building, Access Building, Cooling Water Structure, ESWEMS Pumphouse, BBNPP Intake Structure, Switchyard, and Radioactive Waste Processing Building.

EPSS 6.9 kV switchgear, 480 Vac load centers, MCCs and distribution transformers, are located in electrical switchgear rooms in Seismic Category 1 buildings. The electrical equipment is located in the Safeguards Building, Essential Service Water Pump Building, ESWEMS Pumphouse, or Diesel Building associated with its division.}

8.3.1.1.8 Raceway and Cable Routing

{Each group is separated by placing the ac power distribution equipment in the divisional Safeguards Building, Essential Service Water Pump Building, ESWEMS Pumphouse, and Diesel Building.}

The U.S. EPR FSAR includes the following COL Item in Section 8.3.1.1.8:

A COL applicant that references the U.S. EPR design certification will describe inspection, testing, and monitoring programs to detect the degradation of inaccessible or underground power cables that support EDGs, offsite power, ESW, and other systems that are within the scope of 10 CFR 50.65.

This COL Item is addressed as follows:

{The site-specific cables routed in buried electrical duct banks within the scope of 10 CFR 50.65 traverse from each Essential Service Water Building to the ESWEMS Pumphouse. The insulation of site-specific and underground power cables described in the U.S. EPR FSAR that is within

the scope of 10 CFR 50.65 will be tested as part of routine maintenance. Any negative trends of the tested cables are identified and tracked in the corrective action process, which includes extent of condition considerations. The raceway and cable routing design, including load group segregation and other design aspects described in U.S. EPR FSAR, Section 8.3.1.1.8 is incorporated by reference.}

8.3.1.1.9 Independence of Redundant Systems

{Redundant Class 1E switchgear, load centers and MCCs are located in their respective division Safeguards Building, Essential Service Water (ESW) Pump building, ESWEMS Pumphouse, or Diesel Generator Building. Redundant equipment independence, including cabling independence and separation, described in the U.S. EPR FSAR, Section 8.3.1.1.9 is incorporated by reference.}

8.3.1.1.10 Containment Electrical Penetrations

No departures or supplements.

8.3.1.1.11 Criteria for Class 1E Motors

No departures or supplements.

8.3.1.1.12 Overload Protection for Motor-Operated Safety-Related Valves

No departures or supplements.

8.3.1.1.13 Physical Identification of Safety-Related Equipment

No departures or supplements.

8.3.1.1.14 Electrical Heat Tracing

No departures or supplements.

{Section 8.3.1.1.15 is added as a supplement to the U. S. EPR FSAR.

8.3.1.1.15 Cathodic Protection System

The Cathodic Protection (CP) system for the underground metallic pipe is designed, installed, and maintained in accordance with NACE Standard SP0169-2007 (NACE, 2007).

Underground metallic pipes are coated, or coated and wrapped, in accordance with Section 5 of NACE Standard SP0169-2007 (NACE, 2007). The need for cathodic protection for particular piping is determined based on the piping material, soil resistivity, and ground water chemistry data. Cathodic protection is achieved by providing impressed current from a rectifier power supply source through anodes. These anodes are installed in an interconnected distributed shallow ground bed configuration or in a linear anode configuration, depending on local conditions. Where linear anodes are used, the anodes are installed parallel and in close proximity to the piping being protected. Due to the extensive network of underground piping, an interconnected system is provided with rectifiers sized to include the ground grid, which is connected to the cathodically protected buried pipes. Therefore, any incidental contact between pipe and grounded structures will not adversely affect CP system performance.

A localized sacrificial or galvanic anode CP system shall be used for the buried metallic pipes that are not connected to the station grounding grid or that are located in outlying areas.

Test stations for voltage, current or resistance measurements are provided in accordance with Section 4.5.0 of NACE Standard SP0169-2007 (NACE, 2007) to facilitate CP testing.}

8.3.1.2 Analysis

No departures or supplements.

8.3.1.2.1 Compliance with GDC 2

No departures or supplements.

8.3.1.2.2 Compliance with GDC 4

No departures or supplements.

8.3.1.2.3 Compliance with GDC 5

No departures or supplements.

8.3.1.2.4 Compliance with GDC 17

{Each EPSS division is located in an independent Seismic Category I Safeguards Building, Essential Service Water Pump Building, Diesel Building, or ESWEMS Pumphouse which is physically separated into four divisions.}

8.3.1.2.5 Compliance with GDC 18

No departures or supplements.

8.3.1.2.6 Compliance with GDC 33, GDC 34, GDC 35, GDC 38, GDC 41, and GDC 44

No departures or supplements.

8.3.1.2.7 Compliance with GDC 50

No departures or supplements.

8.3.1.2.8 Compliance with 10 CFR 50.63

No departures or supplements.

8.3.1.2.9 Compliance with 10 CFR 50.65(a)(4)

No departures or supplements.

8.3.1.2.10 Compliance with 10 CFR 50.34 Pertaining to Three Mile Island Action Plan Requirements

No departures or supplements.

8.3.1.2.11 Branch Technical Positions

No departures or supplements.

8.3.1.3 Electrical Power System Calculations and Distribution System Studies for AC Systems

The U.S. EPR FSAR includes the following conceptual design information in Section 8.3.1.3: Figure 8.3-4 [[Typical Station Grounding Grid]]

The conceptual design information is addressed as follows:

{The above U.S. EPR FSAR conceptual design information, including U.S. EPR FSAR Figure 8.3-4, is applicable to BBNPP. Additionally, the site-specific ESWEMS is designed with lightning protection and grounding consistent with the U.S. EPR FSAR Tier 2, Section 8.3.1.3.5 and 8.3.1.3.8.}

The switchyard grounding grid is interconnected with the Nuclear Island and power block ground grid. The switchyard ground grid, including conductor sizing, matrix pattern spacing, and connection with the power block ground grid is determined using the regulatory guidance and industry standards described in U.S. EPR FSAR Section 8.3.1.3.8.}

8.3.2 DC Power Systems

No departures or supplements.

8.3.3 References

{**NACE, 2007.** NACE International Standard Practice SP0169-2007, Control of External Corrosion on Underground or Submerged Metallic Piping Systems, March 2007.}

NRC, 1988. Station Blackout, Regulatory Guide 1.155, U.S. Nuclear Regulatory Commission, August 1988.}

**Table 8.3-1 — {BBNPP Onsite AC Power System Component
Data Nominal Values}**

Component	Nominal Ratings
EPSS Distribution Transformers 31BMT05, 32BMT05 33BMT05, 34BMT05	Dry Type 60 Hz, three phase, air cooled 6.9 kV to 480 Vac 500 kVA

**Table 8.3-2— {BBNPP EPSS Switchgear, Load Center,
and Motor Control Center Numbering and Nominal
Voltage}**

Nominal Voltage Level	Division	Switchgear / Load Center / Motor Control Center
480 V MCC	1	31BNG01 ⁽¹⁾
480 V MCC	2	32BNG01 ⁽¹⁾
480 V MCC	3	33BNG01 ⁽¹⁾
480 V MCC	4	34BNG01 ⁽¹⁾

(1) Equipment located in the respective divisional pump bay of the ESWEMS Pumphouse.

**Table 8.3-3— {BBNPP Normal Power Supply System
Switchgear Numbering and Nominal Voltage }**

Nominal Voltage Level	Train	Bus / Load Center
6.9 kV Switchgear	3	33BBE ⁽¹⁾⁽²⁾
6.9 kV Switchgear	4	34BBE ⁽¹⁾⁽²⁾

(1) Equipment located in the BBNPP Intake Structure.

(2) U.S. EPR FSAR Table 8.3-3 identifies 480 V AC Load Centers 31BFF, 31BFG, 32BFF, 32BFG, 33BFF, 33BFG, 34BFF, and 34BFG as conceptual information. The site-specific design does not utilize 480 V AC load centers 31BFG, 32BFG, 33BFF, 33BFG, 34BFF, and 34BFG. Load Centers 31BFF and 32BFF are incorporated by reference. Site-specific 6.9 kV switchgear 33BBE and 34BBE provide power to the cooling tower makeup pumps and raw water supply system pumps.

Figure 8.3-1 — {BNPP Emergency Power Supply System Single Line Drawing}
(Page 1 of 3)


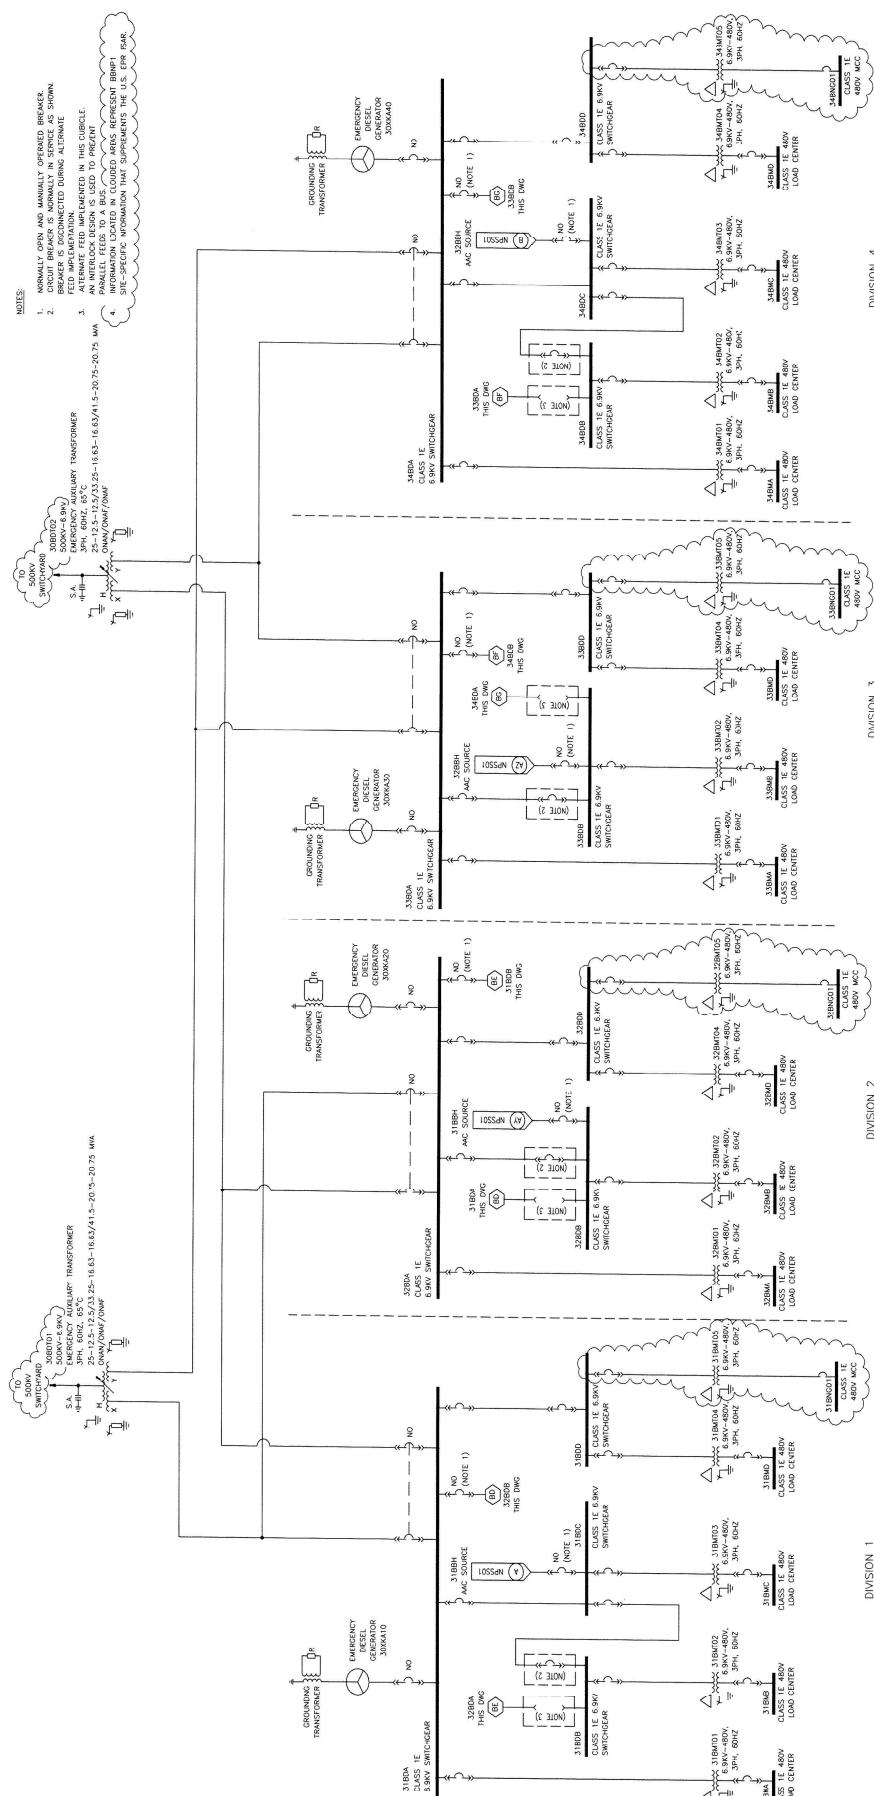



Figure 8.3-1 — {BBNPP Emergency Power Supply System Single Line Drawing}
(Page 2 of 3)

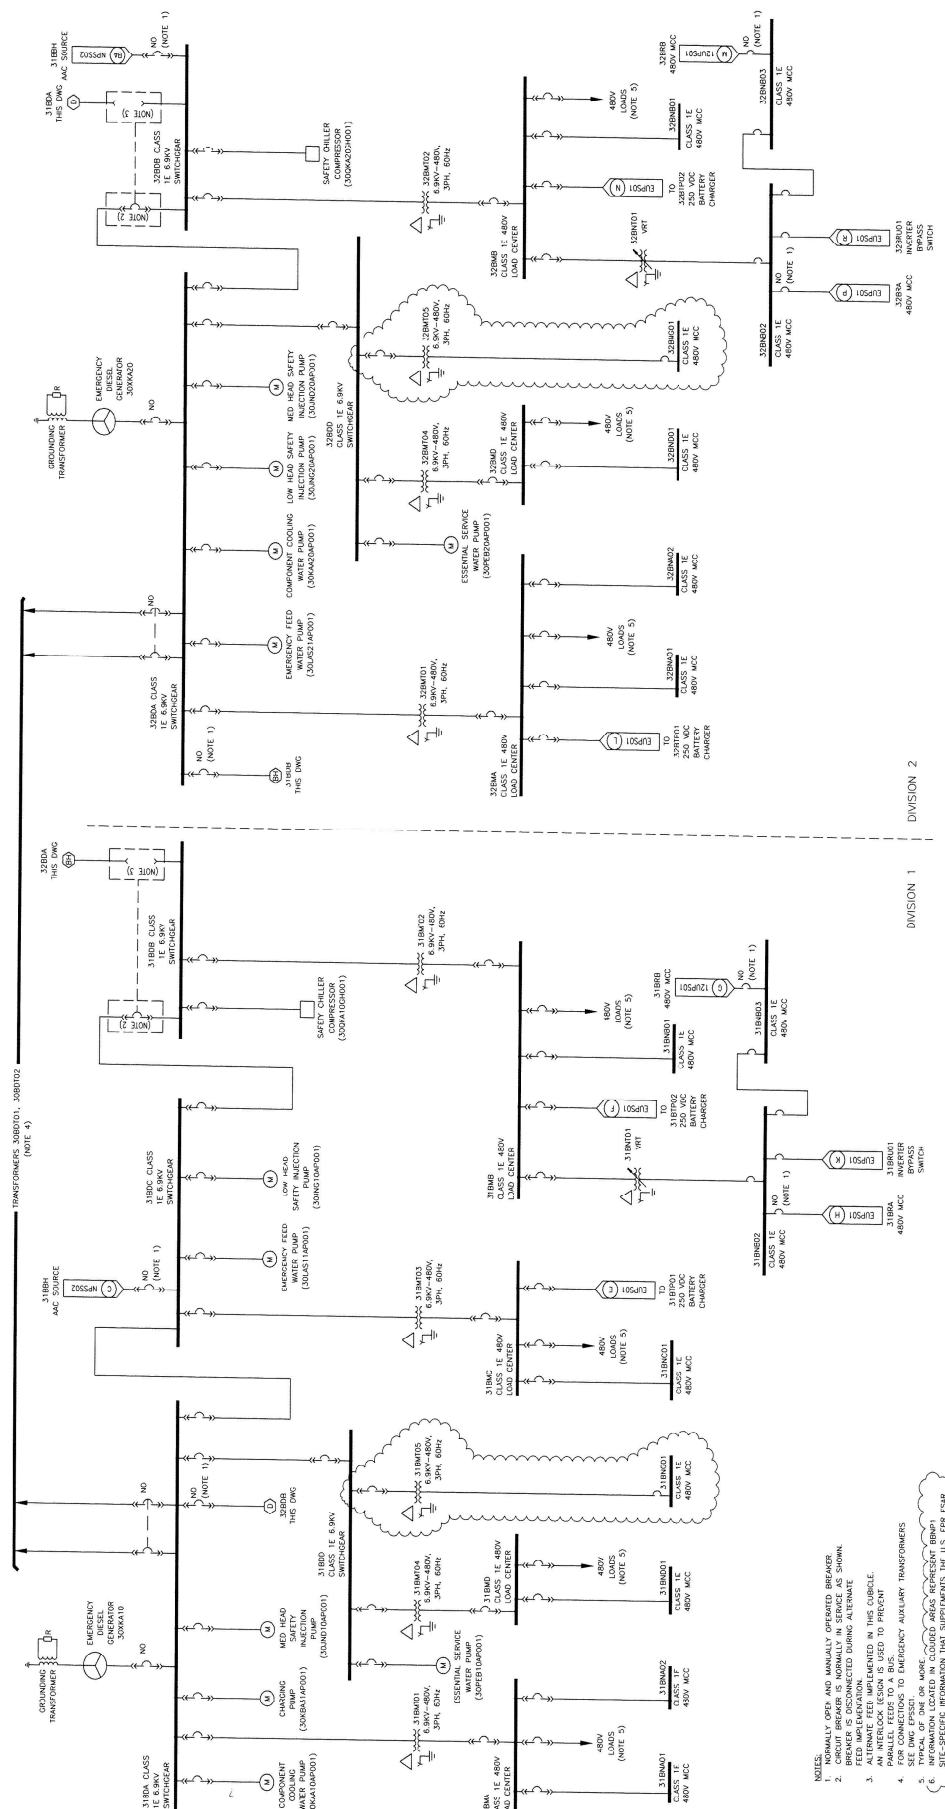


NOTES:

1. MANUALLY OPERED AND MANUALLY OPERATED BREAKER
2. CIRCUIT BREAKER IS NORMALLY IN OPEN POSITION
3. BREAKER IS DISCONNECTED DURING ALTERNATE FEED IMPLEMENTATION
4. ALTERNATE FEED IMPLEMENTED IN THIS CURCLE
5. AN INTERLOCK (DESIGN IS USED TO PREVENT PARALLEL FEEDS TO A BUS.
6. FOR CONNECTIONS TO EMERGENCY AUXILIARY TRANSFORMERS SEE DWG EPCSD-1
7. SEE DWG EPCSD-2
8. SEE DWG EPCSD-3
9. SEE DWG EPCSD-4
10. SEE DWG EPCSD-5
11. SEE DWG EPCSD-6
12. SEE DWG EPCSD-7
13. SEE DWG EPCSD-8
14. SEE DWG EPCSD-9
15. SEE DWG EPCSD-10
16. SEE DWG EPCSD-11
17. SEE DWG EPCSD-12
18. SEE DWG EPCSD-13
19. SEE DWG EPCSD-14
20. SEE DWG EPCSD-15
21. SEE DWG EPCSD-16
22. SEE DWG EPCSD-17
23. SEE DWG EPCSD-18
24. SEE DWG EPCSD-19
25. SEE DWG EPCSD-20
26. SEE DWG EPCSD-21
27. SEE DWG EPCSD-22
28. SEE DWG EPCSD-23
29. SEE DWG EPCSD-24
30. SEE DWG EPCSD-25
31. SEE DWG EPCSD-26
32. SEE DWG EPCSD-27
33. SEE DWG EPCSD-28
34. SEE DWG EPCSD-29
35. SEE DWG EPCSD-30
36. SEE DWG EPCSD-31
37. SEE DWG EPCSD-32
38. SEE DWG EPCSD-33
39. SEE DWG EPCSD-34
40. SEE DWG EPCSD-35
41. SEE DWG EPCSD-36
42. SEE DWG EPCSD-37
43. SEE DWG EPCSD-38
44. SEE DWG EPCSD-39
45. SEE DWG EPCSD-40
46. SEE DWG EPCSD-41
47. SEE DWG EPCSD-42
48. SEE DWG EPCSD-43
49. SEE DWG EPCSD-44
50. SEE DWG EPCSD-45
51. SEE DWG EPCSD-46
52. SEE DWG EPCSD-47
53. SEE DWG EPCSD-48
54. SEE DWG EPCSD-49
55. SEE DWG EPCSD-50
56. SEE DWG EPCSD-51
57. SEE DWG EPCSD-52
58. SEE DWG EPCSD-53
59. SEE DWG EPCSD-54
60. SEE DWG EPCSD-55
61. SEE DWG EPCSD-56
62. SEE DWG EPCSD-57
63. SEE DWG EPCSD-58
64. SEE DWG EPCSD-59
65. SEE DWG EPCSD-60
66. SEE DWG EPCSD-61
67. SEE DWG EPCSD-62
68. SEE DWG EPCSD-63
69. SEE DWG EPCSD-64
70. SEE DWG EPCSD-65
71. SEE DWG EPCSD-66
72. SEE DWG EPCSD-67
73. SEE DWG EPCSD-68
74. SEE DWG EPCSD-69
75. SEE DWG EPCSD-70
76. SEE DWG EPCSD-71
77. SEE DWG EPCSD-72
78. SEE DWG EPCSD-73
79. SEE DWG EPCSD-74
80. SEE DWG EPCSD-75
81. SEE DWG EPCSD-76
82. SEE DWG EPCSD-77
83. SEE DWG EPCSD-78
84. SEE DWG EPCSD-79
85. SEE DWG EPCSD-80
86. SEE DWG EPCSD-81
87. SEE DWG EPCSD-82
88. SEE DWG EPCSD-83
89. SEE DWG EPCSD-84
90. SEE DWG EPCSD-85
91. SEE DWG EPCSD-86
92. SEE DWG EPCSD-87
93. SEE DWG EPCSD-88
94. SEE DWG EPCSD-89
95. SEE DWG EPCSD-90
96. SEE DWG EPCSD-91
97. SEE DWG EPCSD-92
98. SEE DWG EPCSD-93
99. SEE DWG EPCSD-94
100. SEE DWG EPCSD-95
101. SEE DWG EPCSD-96
102. SEE DWG EPCSD-97
103. SEE DWG EPCSD-98
104. SEE DWG EPCSD-99
105. SEE DWG EPCSD-100
106. SEE DWG EPCSD-101
107. SEE DWG EPCSD-102
108. SEE DWG EPCSD-103
109. SEE DWG EPCSD-104
110. SEE DWG EPCSD-105
111. SEE DWG EPCSD-106
112. SEE DWG EPCSD-107
113. SEE DWG EPCSD-108
114. SEE DWG EPCSD-109
115. SEE DWG EPCSD-110
116. SEE DWG EPCSD-111
117. SEE DWG EPCSD-112
118. SEE DWG EPCSD-113
119. SEE DWG EPCSD-114
120. SEE DWG EPCSD-115
121. SEE DWG EPCSD-116
122. SEE DWG EPCSD-117
123. SEE DWG EPCSD-118
124. SEE DWG EPCSD-119
125. SEE DWG EPCSD-120
126. SEE DWG EPCSD-121
127. SEE DWG EPCSD-122
128. SEE DWG EPCSD-123
129. SEE DWG EPCSD-124
130. SEE DWG EPCSD-125
131. SEE DWG EPCSD-126
132. SEE DWG EPCSD-127
133. SEE DWG EPCSD-128
134. SEE DWG EPCSD-129
135. SEE DWG EPCSD-130
136. SEE DWG EPCSD-131
137. SEE DWG EPCSD-132
138. SEE DWG EPCSD-133
139. SEE DWG EPCSD-134
140. SEE DWG EPCSD-135
141. SEE DWG EPCSD-136
142. SEE DWG EPCSD-137
143. SEE DWG EPCSD-138
144. SEE DWG EPCSD-139
145. SEE DWG EPCSD-140
146. SEE DWG EPCSD-141
147. SEE DWG EPCSD-142
148. SEE DWG EPCSD-143
149. SEE DWG EPCSD-144
150. SEE DWG EPCSD-145
151. SEE DWG EPCSD-146
152. SEE DWG EPCSD-147
153. SEE DWG EPCSD-148
154. SEE DWG EPCSD-149
155. SEE DWG EPCSD-150
156. SEE DWG EPCSD-151
157. SEE DWG EPCSD-152
158. SEE DWG EPCSD-153
159. SEE DWG EPCSD-154
160. SEE DWG EPCSD-155
161. SEE DWG EPCSD-156
162. SEE DWG EPCSD-157
163. SEE DWG EPCSD-158
164. SEE DWG EPCSD-159
165. SEE DWG EPCSD-160
166. SEE DWG EPCSD-161
167. SEE DWG EPCSD-162
168. SEE DWG EPCSD-163
169. SEE DWG EPCSD-164
170. SEE DWG EPCSD-165
171. SEE DWG EPCSD-166
172. SEE DWG EPCSD-167
173. SEE DWG EPCSD-168
174. SEE DWG EPCSD-169
175. SEE DWG EPCSD-170
176. SEE DWG EPCSD-171
177. SEE DWG EPCSD-172
178. SEE DWG EPCSD-173
179. SEE DWG EPCSD-174
180. SEE DWG EPCSD-175
181. SEE DWG EPCSD-176
182. SEE DWG EPCSD-177
183. SEE DWG EPCSD-178
184. SEE DWG EPCSD-179
185. SEE DWG EPCSD-180
186. SEE DWG EPCSD-181
187. SEE DWG EPCSD-182
188. SEE DWG EPCSD-183
189. SEE DWG EPCSD-184
190. SEE DWG EPCSD-185
191. SEE DWG EPCSD-186
192. SEE DWG EPCSD-187
193. SEE DWG EPCSD-188
194. SEE DWG EPCSD-189
195. SEE DWG EPCSD-190
196. SEE DWG EPCSD-191
197. SEE DWG EPCSD-192
198. SEE DWG EPCSD-193
199. SEE DWG EPCSD-194
200. SEE DWG EPCSD-195
201. SEE DWG EPCSD-196
202. SEE DWG EPCSD-197
203. SEE DWG EPCSD-198
204. SEE DWG EPCSD-199
205. SEE DWG EPCSD-200
206. SEE DWG EPCSD-201
207. SEE DWG EPCSD-202
208. SEE DWG EPCSD-203
209. SEE DWG EPCSD-204
210. SEE DWG EPCSD-205
211. SEE DWG EPCSD-206
212. SEE DWG EPCSD-207
213. SEE DWG EPCSD-208
214. SEE DWG EPCSD-209
215. SEE DWG EPCSD-210
216. SEE DWG EPCSD-211
217. SEE DWG EPCSD-212
218. SEE DWG EPCSD-213
219. SEE DWG EPCSD-214
220. SEE DWG EPCSD-215
221. SEE DWG EPCSD-216
222. SEE DWG EPCSD-217
223. SEE DWG EPCSD-218
224. SEE DWG EPCSD-219
225. SEE DWG EPC

Figure 8.3-1 — {BNPP Emergency Power Supply System Single Line Drawing}
(Page 3 of 3)

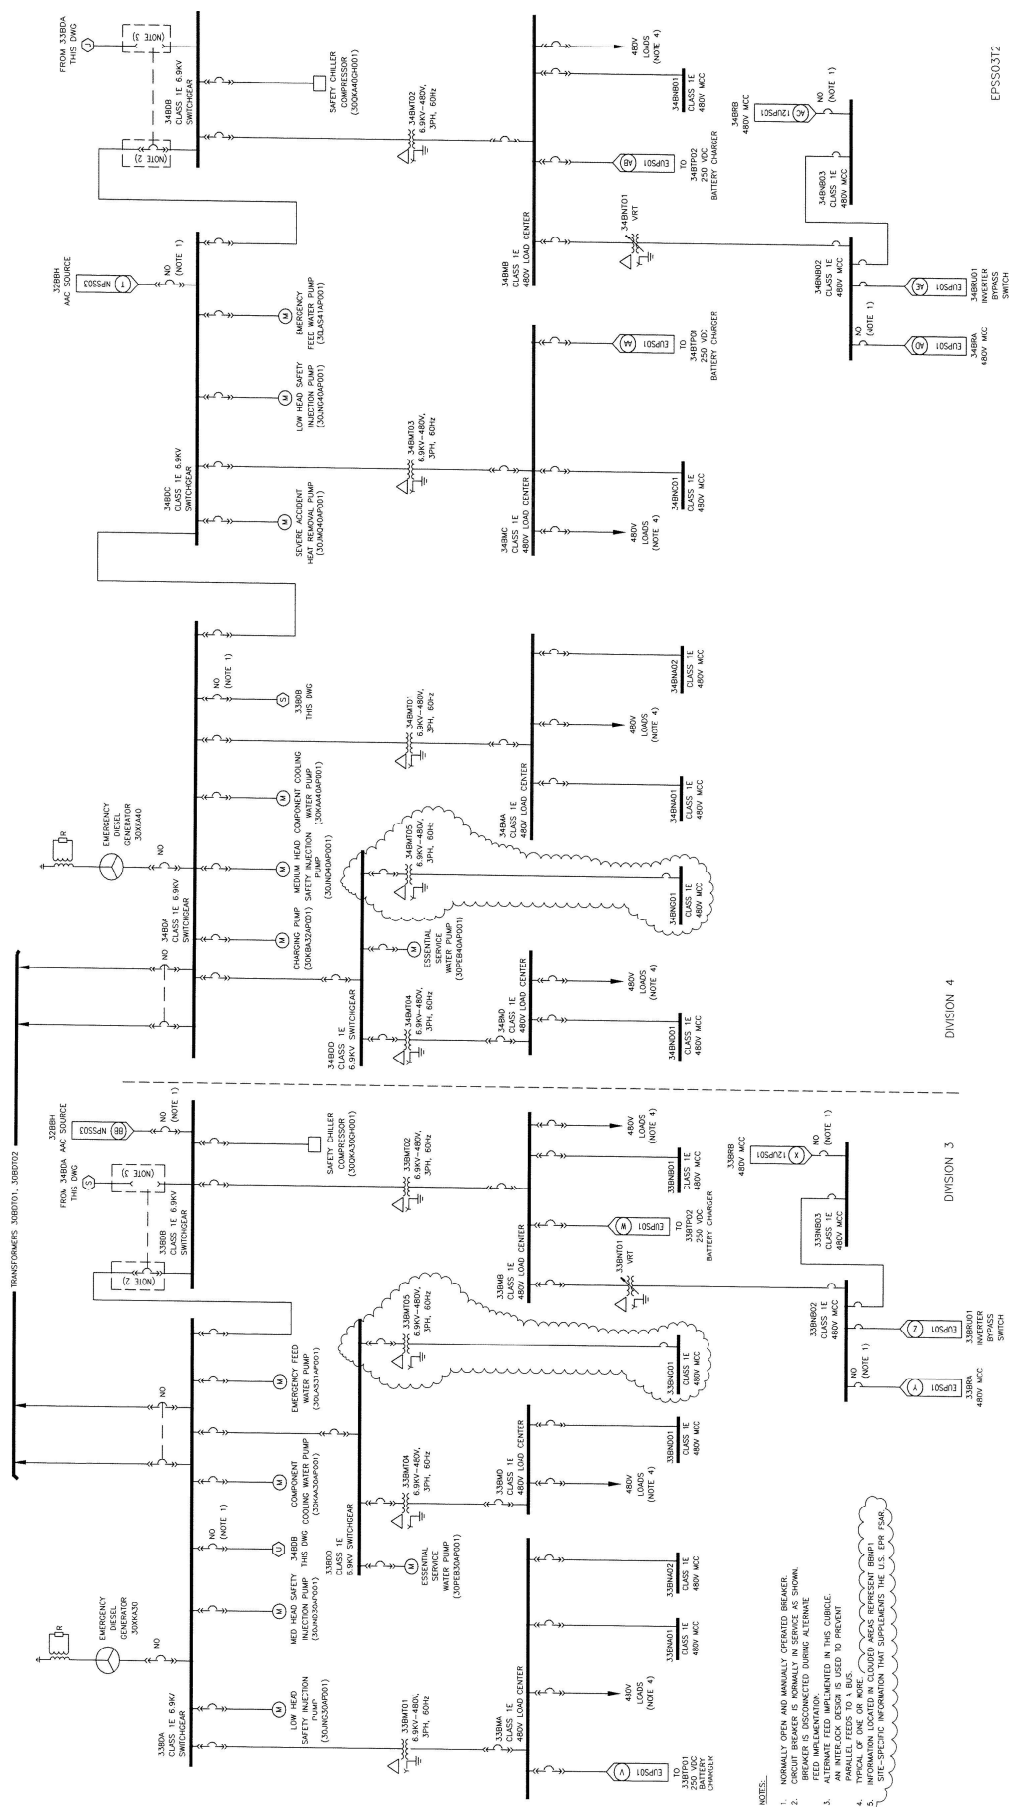

(Page 1 of 4)

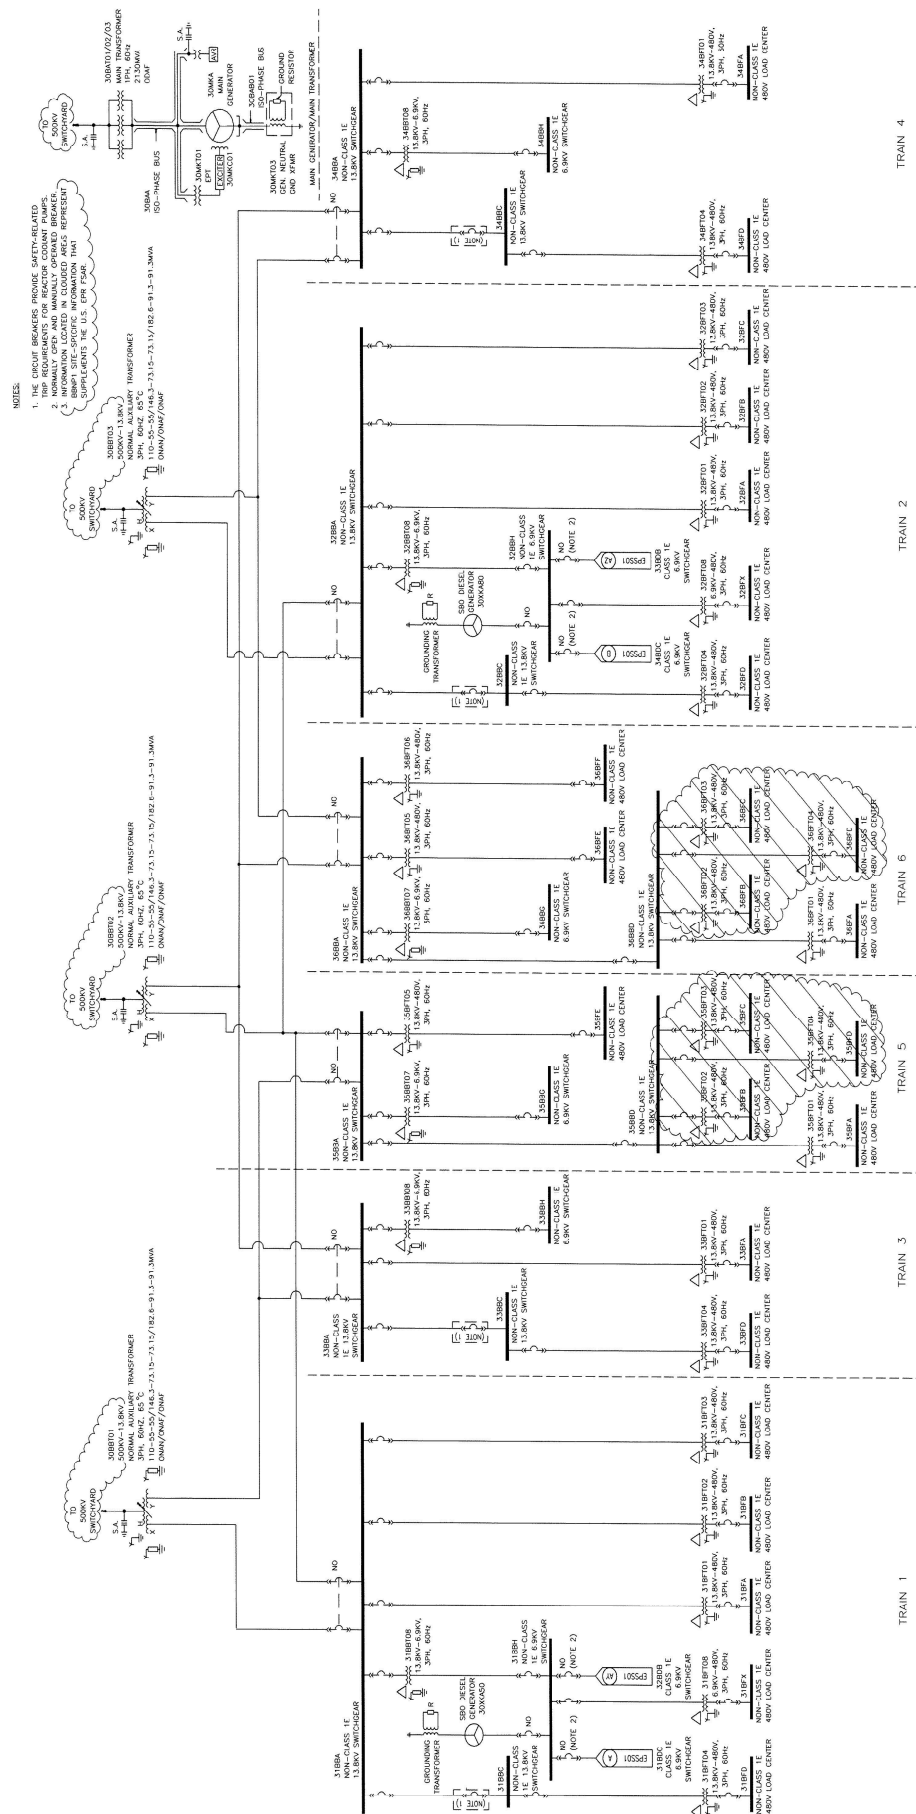

(Page 2 of 4)



- NOTES:**
1. THE CIRCUIT BREAKERS PROVIDE SAFETY-RELATED TRIP REQUIREMENTS FOR REACTOR COOLANT PUMPS.
 2. NORMALLY OPEN AND MANUALLY OPERATED BREAKER.
 3. FOR CONNECTIONS TO NORMAL AUXILIARY TRANSFORMERS SEE DWG NPSS01

1987
1988

Figure 8.3-2—{BBNPP Normal Power Supply System Single Line Drawing}
(Page 3 of 4)

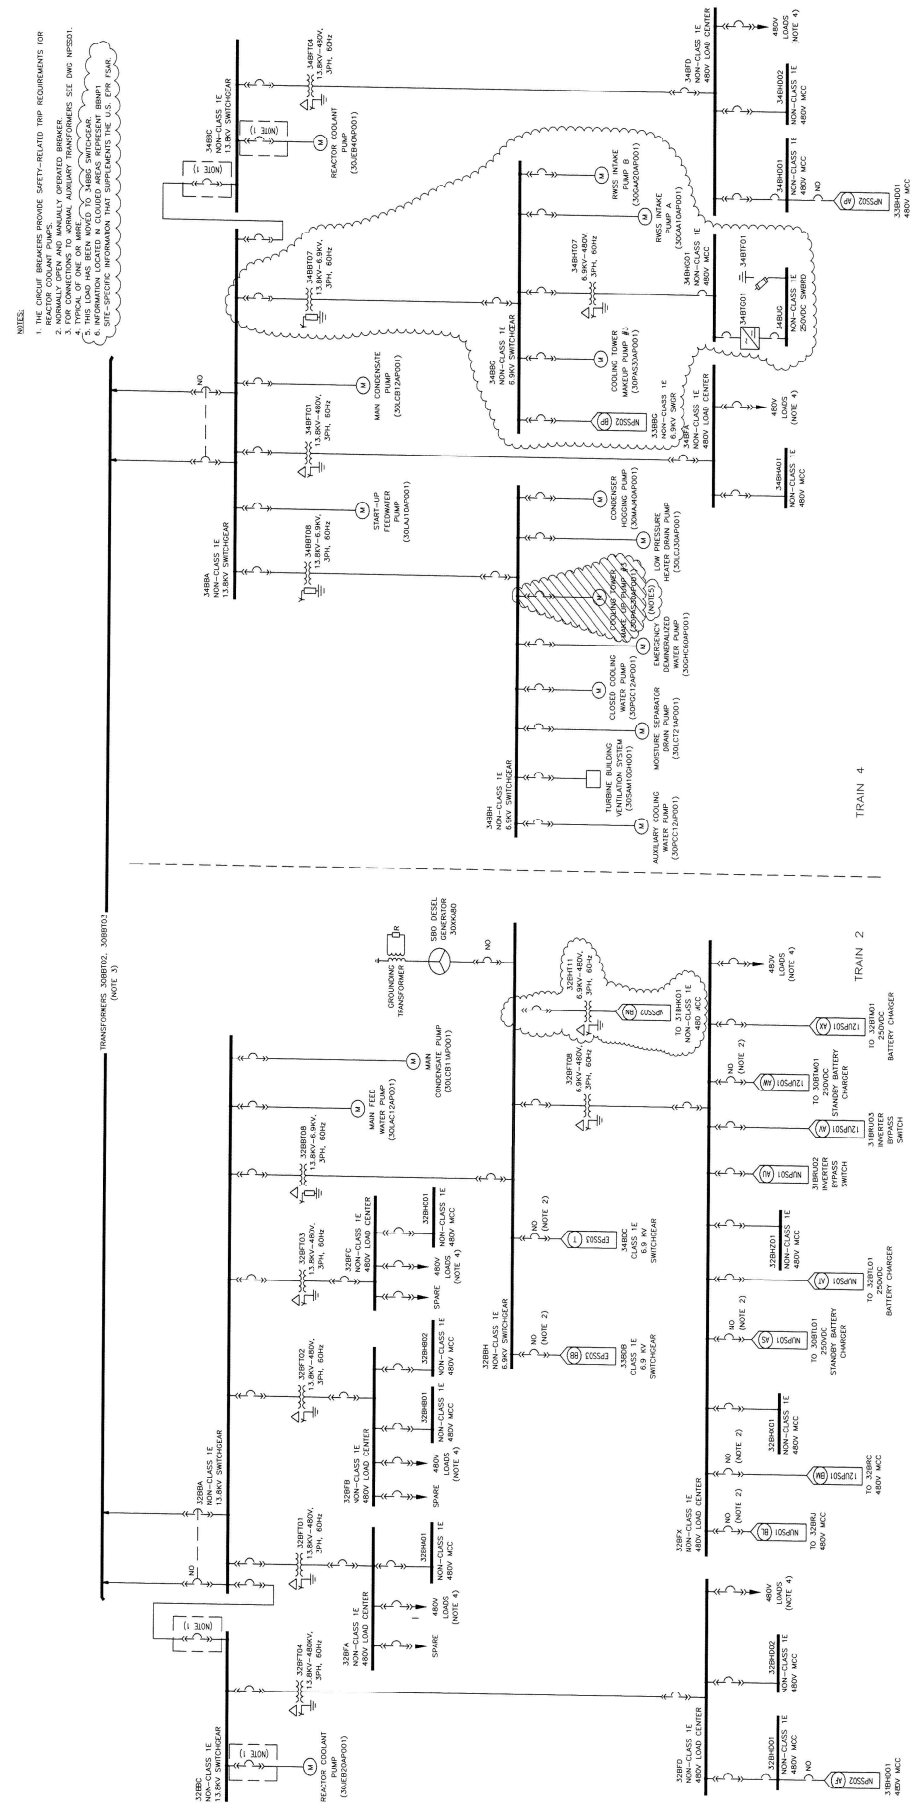


Figure 8.3.2— {BBNPP Normal Power Supply System Single Line Drawing}
(Page 4 of 4)

8.4 STATION BLACKOUT

This section of the U.S. EPR FSAR is incorporated by reference with the following supplements.

8.4.1 Description

No departures or supplements.

8.4.1.1 Station Blackout Diesel Generators

No departures or supplements.

8.4.1.2 Generator

No departures or supplements.

8.4.1.3 Alternate AC Power System Performance

The U.S. EPR FSAR includes the following COL Item in Section 8.4.1.3:

A COL applicant that references the U.S. EPR design certification will provide site-specific information that identifies any additional local power sources and transmission paths that could be made available to resupply the power plant following a LOOP.

This COL Item is addressed as follows:

{The BBNPP switchyard will be located less than 1 mi (1.6 km) from the existing Susquehanna 500 kV switchyard. There are no special local sources that can be made available to re-supply power to the plant following loss of a grid or an SBO. However, the normal connections will include one 500 kV connection to the existing Susquehanna 500 kV switchyard and one connection to the new Susquehanna 500 kV Yard 2.}

8.4.1.4 Periodic Testing

No departures or supplements.

8.4.2 Analysis

No departures or supplements.

8.4.2.1 10 CFR 50.2-Definitions and Introduction

No departures or supplements.

8.4.2.2 10 CFR 50.63-Loss of All Alternating Current Power

No departures or supplements.

8.4.2.3 10 CFR 50.65-Requirements for Monitoring the Effectiveness of Maintenance of Nuclear Power Plants

No departures or supplements.

8.4.2.4 Appendix A to 10 CFR 50, GDC for Nuclear Power Plants

No departures or supplements.

8.4.2.5 RG 1.9-Application Testing of Safety-Related Diesel Generators in Nuclear Power Plants-Revision 4

No departures or supplements.

8.4.2.6 RG 1.155-Station Blackout

No departures or supplements.

8.4.2.6.1 RG 1.155 C.3.1-Minimum Acceptable Station Blackout Duration Capability (Station Blackout Coping Duration)

{The SBO rule requires applicants to assess the capability of their plants to maintain adequate core cooling and appropriate containment integrity during SBO. Regulatory Guide (RG) 1.155 presents a method acceptable for determining the specified duration for which a plant should be able to withstand an SBO. This method results in selecting a minimum SBO capability of eight hours, based on a comparison of plant characteristics with those factors that have been identified as significantly affecting the risk from an SBO. As described in U.S. EPR FSAR Section 8.4.2.6.1, eight hours is the highest coping duration that can result from applying the RG 1.155 method to the U.S. EPR design.

RG 1.155, Table 2, specifies the required duration of an SBO, based on four factors. The first factor is the redundancy of the on-site Emergency AC (EAC) power sources (i.e. the number of power sources available minus the number needed for decay heat removal). The U.S. EPR design requires one emergency power source for decay heat removal; four are provided. From RG 1.155 Table 3 - Emergency AC (EAC) Power Configuration Groups, Group A is selected.

The second factor is emergency diesel generator (EDG) reliability. RG 1.155 uses two EDG reliability targets (0.95, 0.975) for each EDG in EAC Configuration Group A. In accordance with RG 1.155, Regulatory Position 1.1, the minimum EDG reliability should be targeted at 0.95 per demand for plants in EAC Configuration Groups A, B, and C. The reliability target (0.95) is used for BBNPP.

The third factor is the expected frequency of loss of off-site power (LOOP) events. This factor is developed from site-specific data. From RG 1.155 Table 5, Definitions of Independence of Offsite Power Groups, Group I-2 is selected. This category is applicable to a plant with Class 1 E buses normally designed to be connected to the preferred or alternate power sources and the safe shutdown buses normally aligned to the same preferred power source with either an automatic or manual transfer to the remaining preferred or alternate AC power source. RG 1.155 Table 6, Definitions of Severe Weather (SW) Groups, combines the expectations of snowfall, tornadoes, hurricanes, other high wind events (75-125 mph), and vulnerability to salt spray. SW Group 5 (the most conservative selection) is selected for BBNPP. No credit is taken for "enhanced recovery" following a loss of offsite power due to severe weather: therefore, Severe Weather Recovery (SWR) Group 2 is chosen from RG 1.155 Table 7, Definitions of Severe Weather Recovery (SWR) Groups. With respect to RG 1.155, Table 8, Definitions of Extremely Severe Weather (ESW) Groups, Group 2 is selected based on the existing Susquehanna data found in Table B-1 of NUREG-1776, Regulatory Effectiveness of the Station Blackout Rule (NRC, 2003). From Table 4, Offsite Power Design Characteristic Groups, the combination of any offsite power independence "I" Group, SW Group 5, SWR Group 2, and any ESW Group requires assignment of off-site power design characteristic Group P3.

The fourth factor is the probable time needed to restore off-site power. When the SW Group 4 or 5 is selected, this factor has no impact on the coping duration time, so no additional information is required.

Based on the evaluation of the four factors presented in RG 1.155 for determining the specified duration of a station blackout, the BBNPP SBO coping duration is eight hours.

As referenced in BBNPP FSAR 8.3.1.1.5, BBNPP will monitor and maintain EDG reliability to verify the reliability goal of 0.95 is being achieved.}

8.4.2.6.2 RG 1.155 C.3.2-Evaluation of Plant-Specific Station Blackout Capability (Station Blackout Coping Capability)

No departures or supplements.

8.4.2.6.3 RG 1.155 C.3.3-Modification to Cope with Station Blackout — AAC Power Sources

No departures or supplements.

8.4.2.6.4 RG 1.155 C.3.4-Procedures and Training to Cope with Station Blackout (Procedures and Training)

The U.S. EPR FSAR includes the following COL Item in Section 8.4.2.6.4:

A COL applicant that references the U.S. EPR design certification will address the RG 1.155 guidance related to procedures and training to cope with SBO.

This COL Item is addressed as follows:

Specific items covered related to procedures and training include:

- ◆ Regulatory Position C.1.3-guidelines and procedures for actions to restore emergency AC power when the emergency AC power system is unavailable will be integrated with plant-specific technical guidelines and emergency operating procedures.
- ◆ Regulatory Position C.2- procedures will include the actions necessary to restore offsite power and use nearby power sources when offsite power is unavailable.
- ◆ Regulatory Position C.3.4-procedures and training will include operator actions necessary to cope with a station blackout for at least the duration determined according to RG 1.155 regulatory position C.3.1 and will include the operator actions necessary to restore normal decay heat removal once AC power is restored.

Procedures and training shall include the operator actions necessary to cope with a station blackout for at least the duration determined according to Regulatory Guide 1.155 (NRC, 1988), Regulatory Position C.3.1, and shall include the operator actions necessary to restore normal decay heat removal once AC power is restored. Procedures and training shall also include actions to restore emergency AC power when the emergency AC power system is unavailable and actions that are necessary to restore offsite power.

Procedures shall be integrated with the plant-specific technical guidelines and emergency operating procedure program, consistent with Supplement 1 to NUREG-0737 (NRC, 1982). The

task analysis portion of the emergency operating procedure program shall include an analysis of instrumentation adequacy during a station blackout.

8.4.2.7 Quality Assurance

No departures or supplements.

8.4.3 References

{**NRC, 1982.** Supplement 1 to NUREG-0737 – Requirements for Emergency Response Capability, Generic Letter 82-33, U.S. Nuclear Regulatory Commission, December 1982. |

NRC, 1988. Station Blackout, Regulatory Guide 1.155, U.S. Nuclear Regulatory Commission, August 1988. |

NRC, 2003. Regulatory Effectiveness of the Station Blackout Rule, NUREG-1776, U.S. Nuclear Regulatory Commission, August 2003.} |