

Figure 9.2-7 Reactor Service Water System P&ID (Sheet 1 of 3)

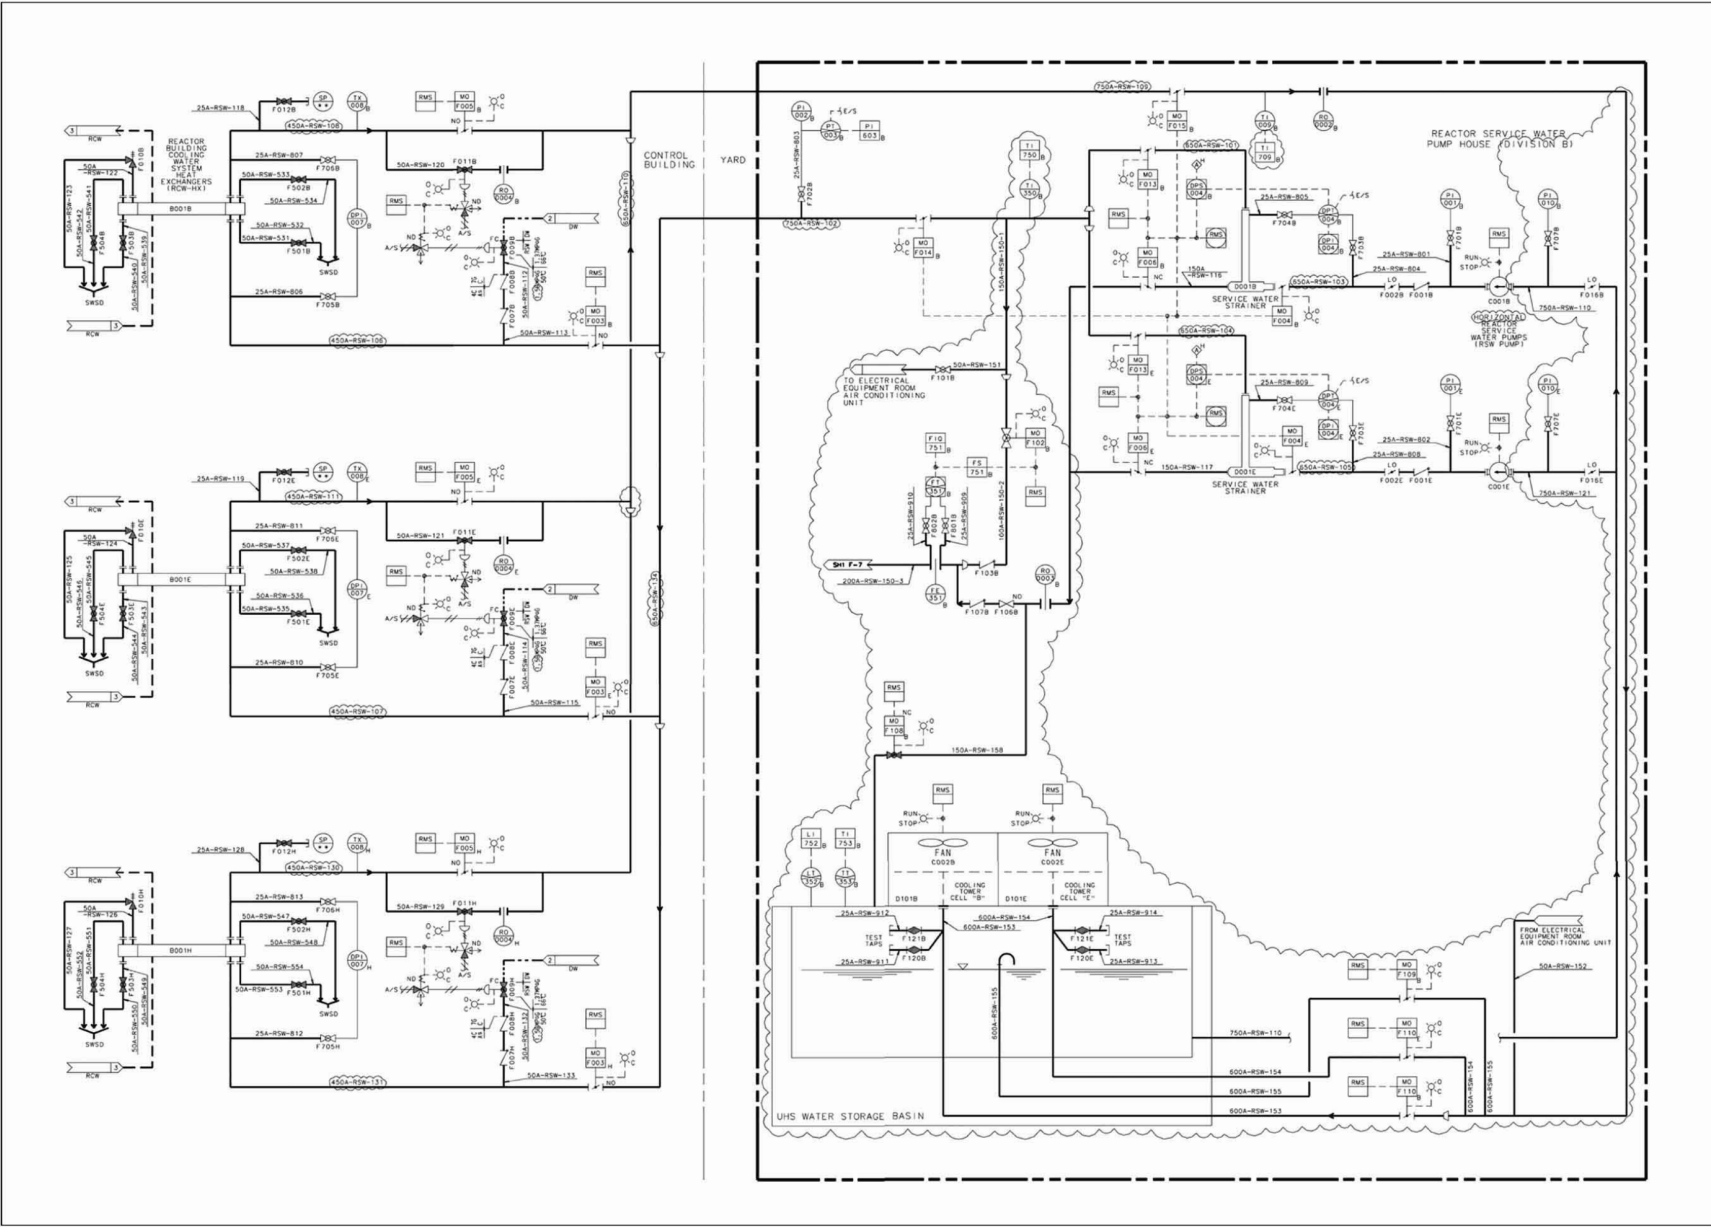


Figure 9.2-7 Reactor Service Water System P&ID (Sheet 2 of 3)

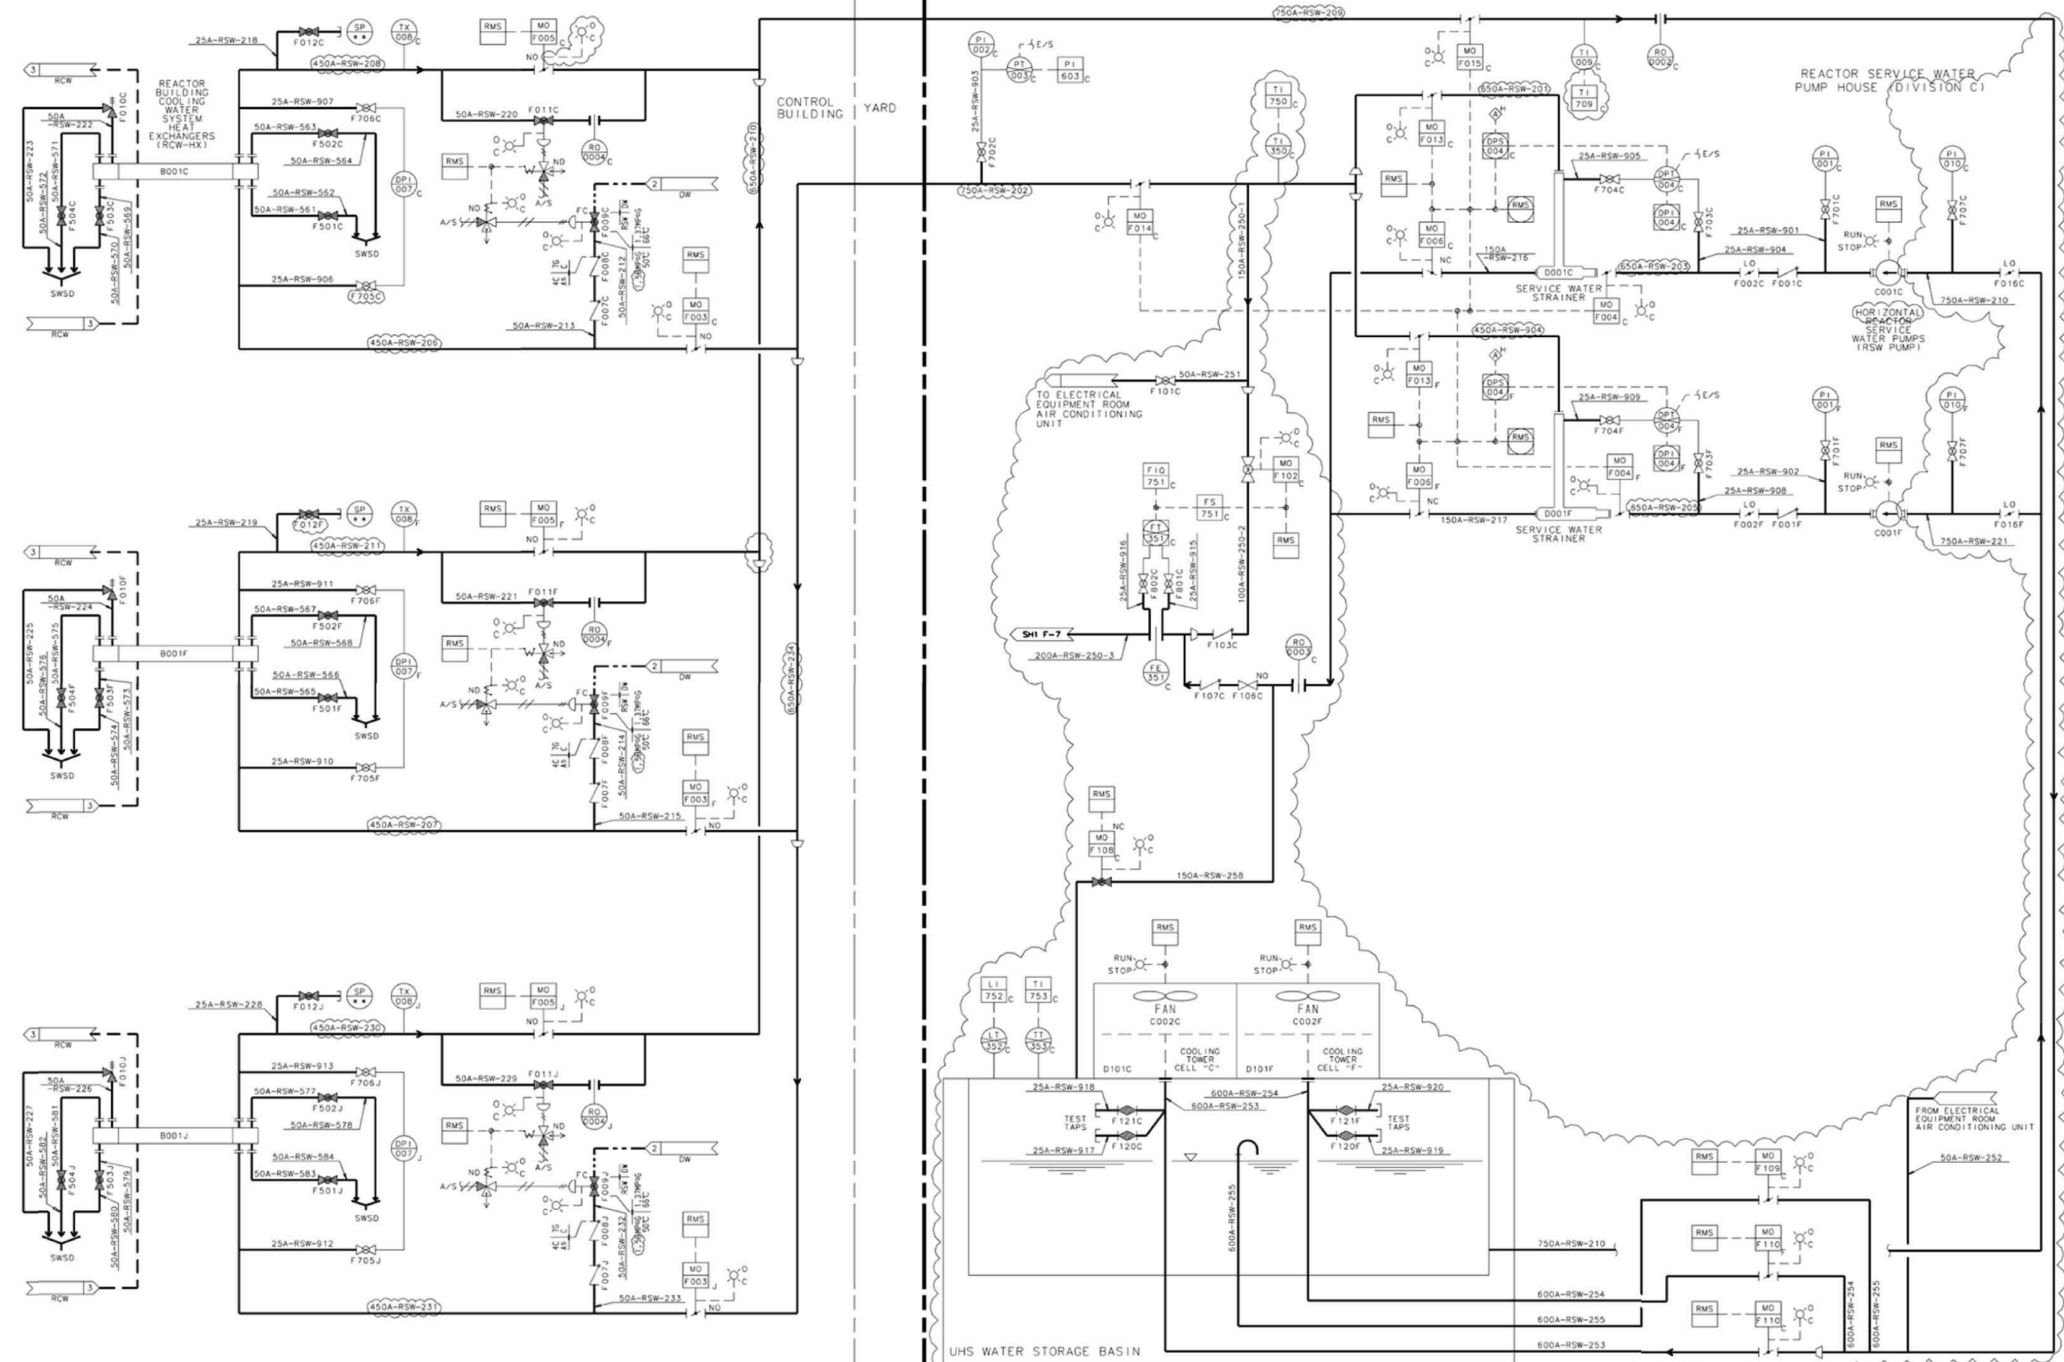


Figure 9.2-7 Reactor Service Water System P&ID (Sheet 3 of 3)



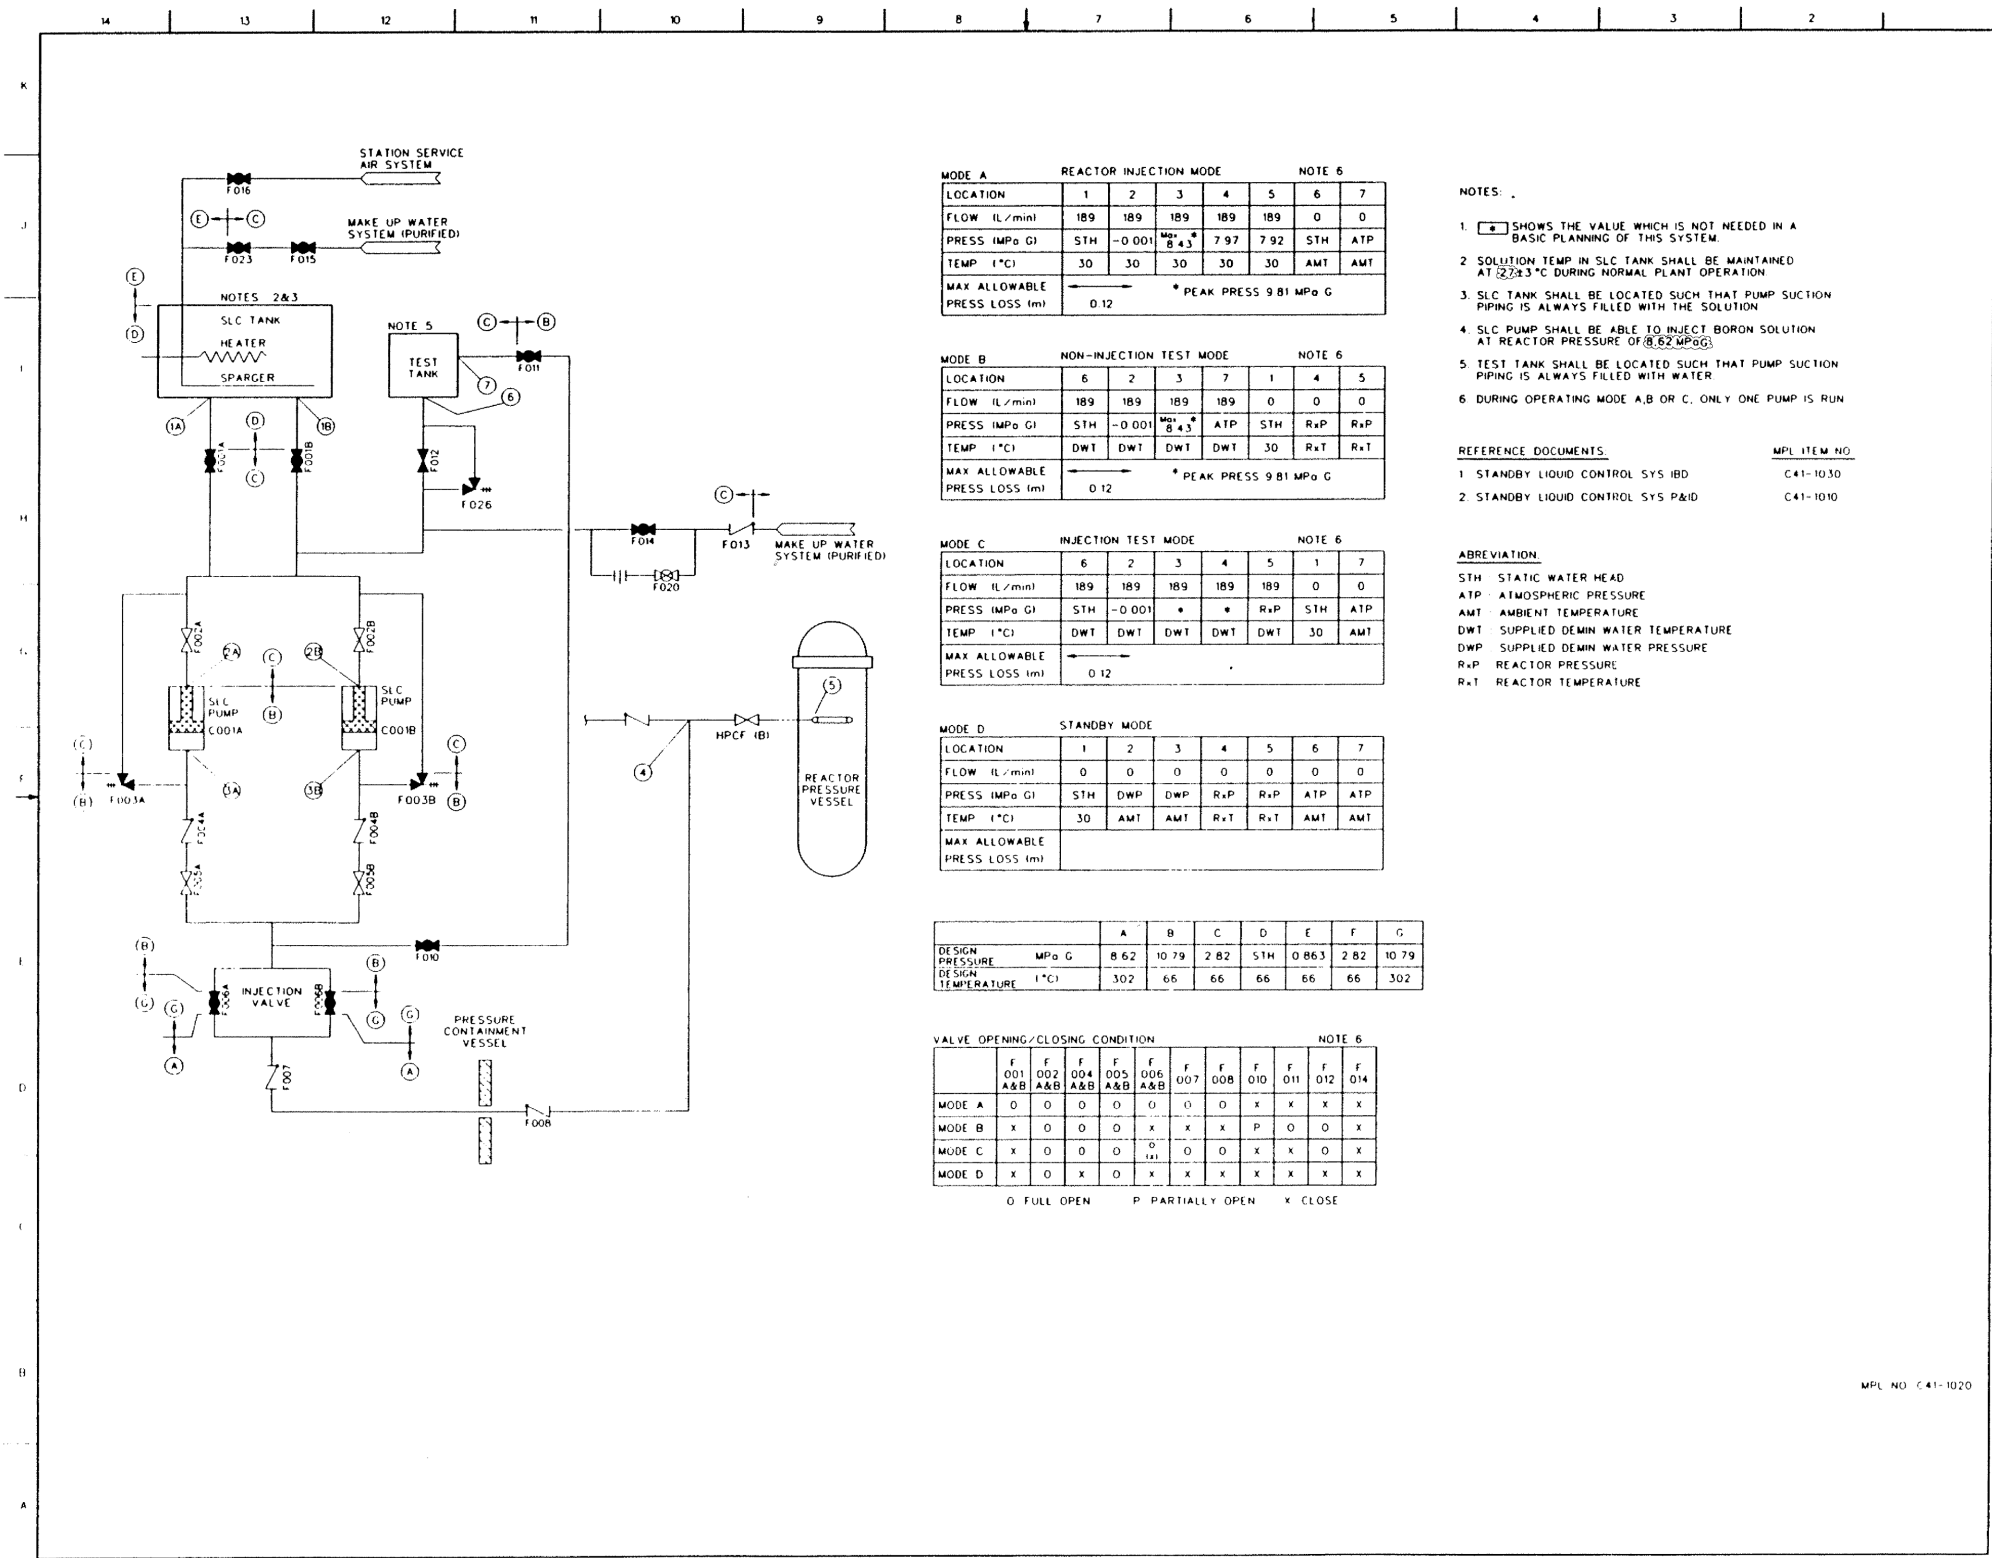


Figure 9.3-1a Standby Liquid Control System PFD

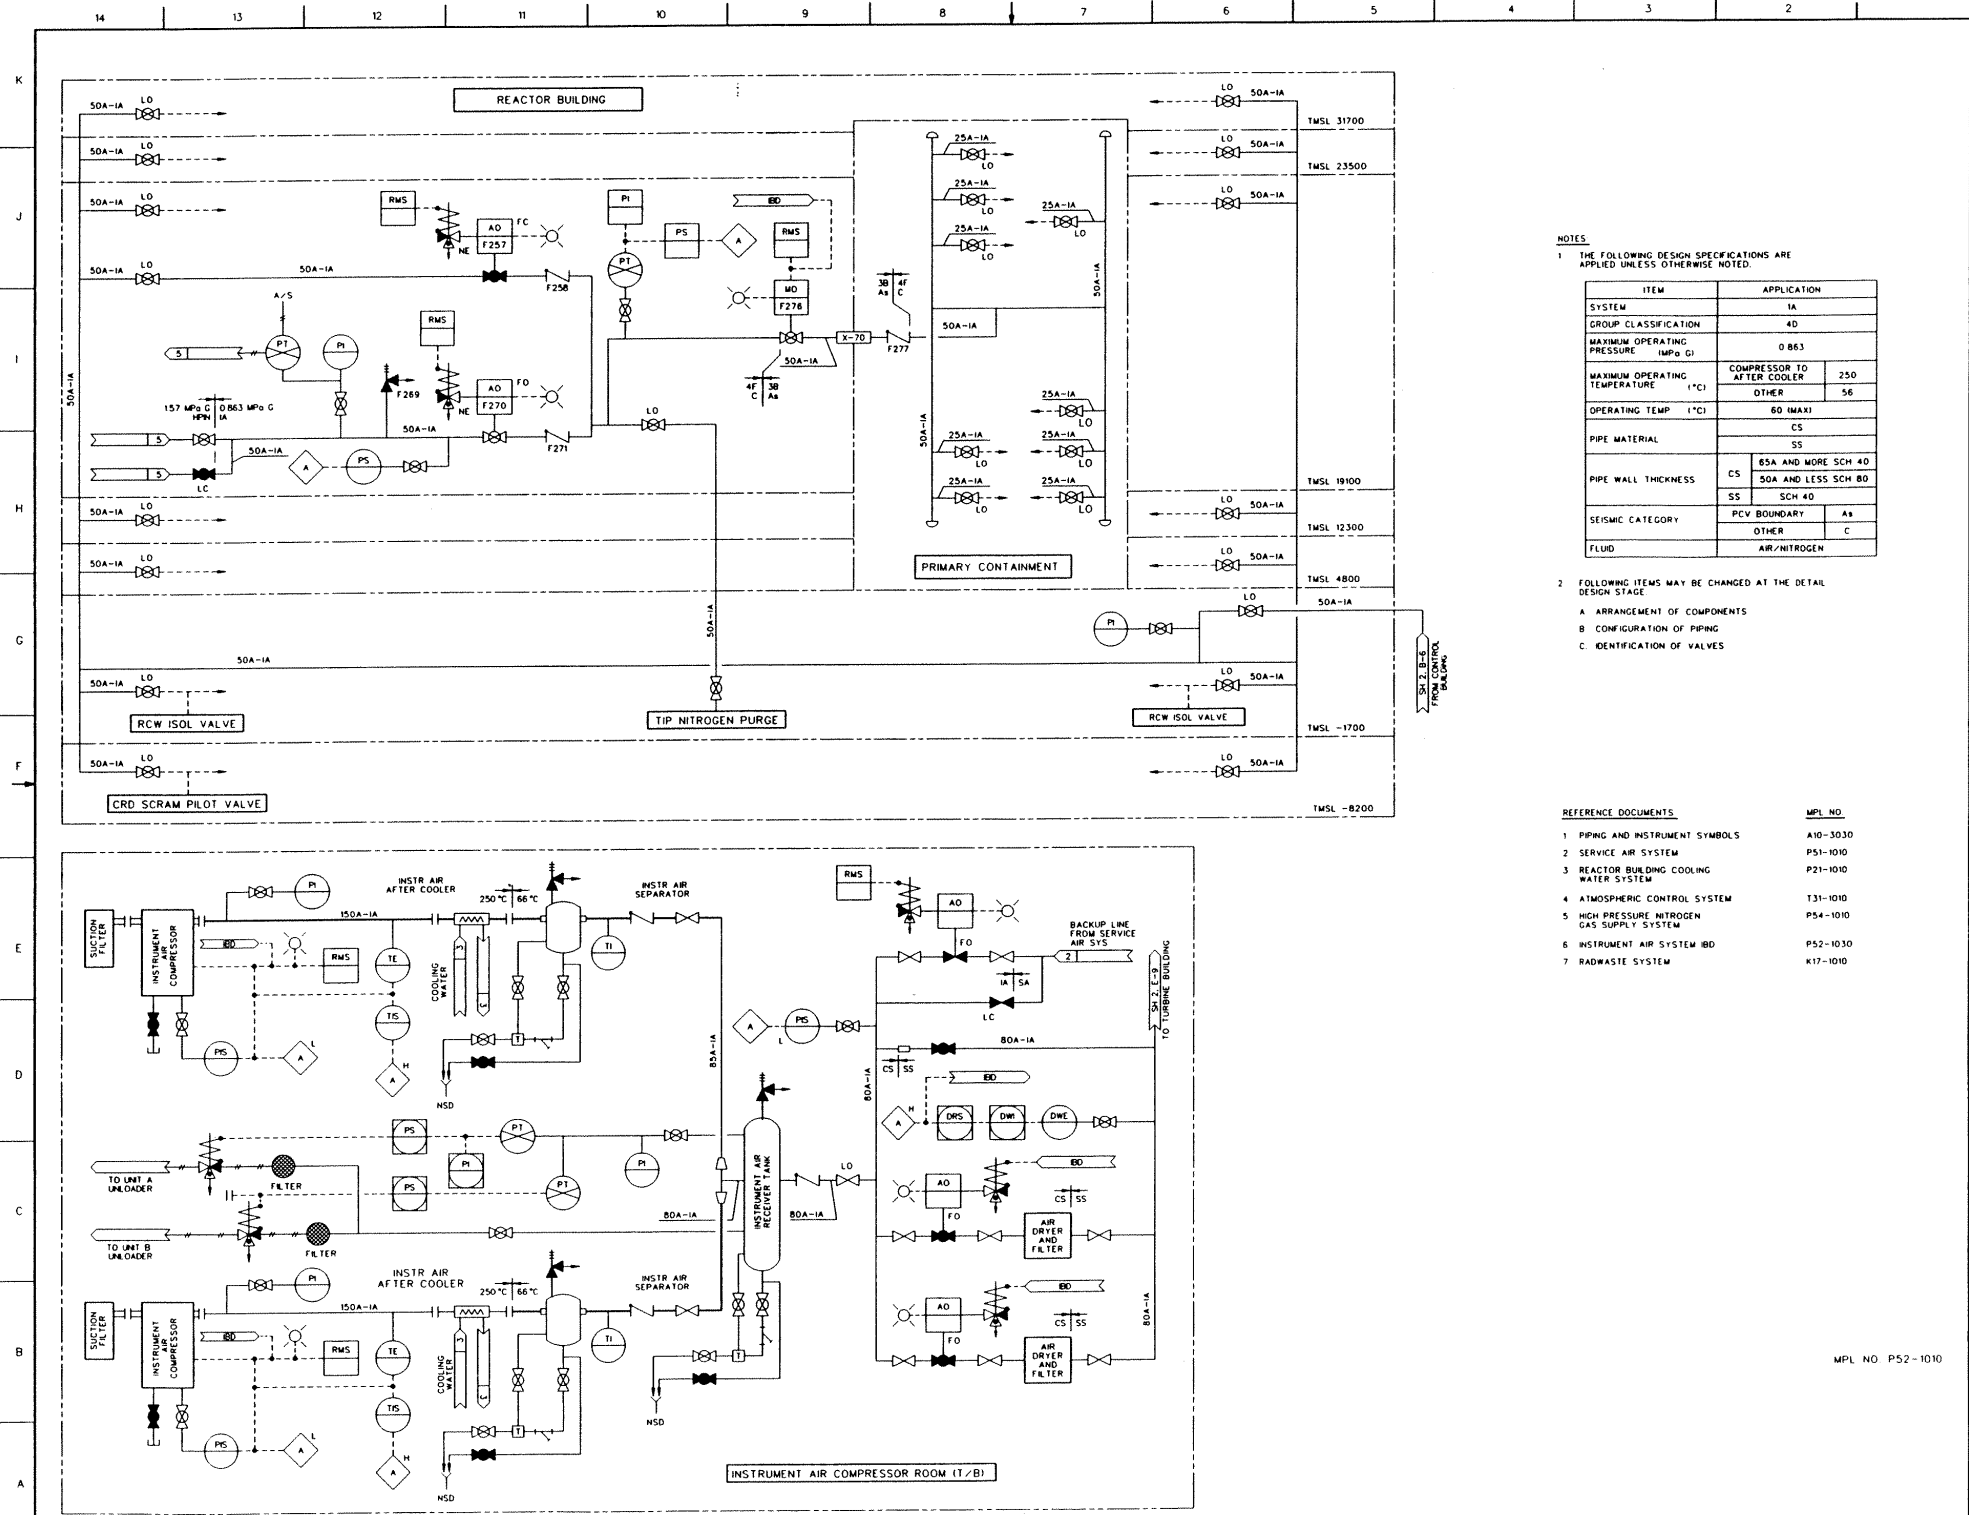


Figure 9.3-6 Instrument Air System P&ID (Sheet 1 of 2)

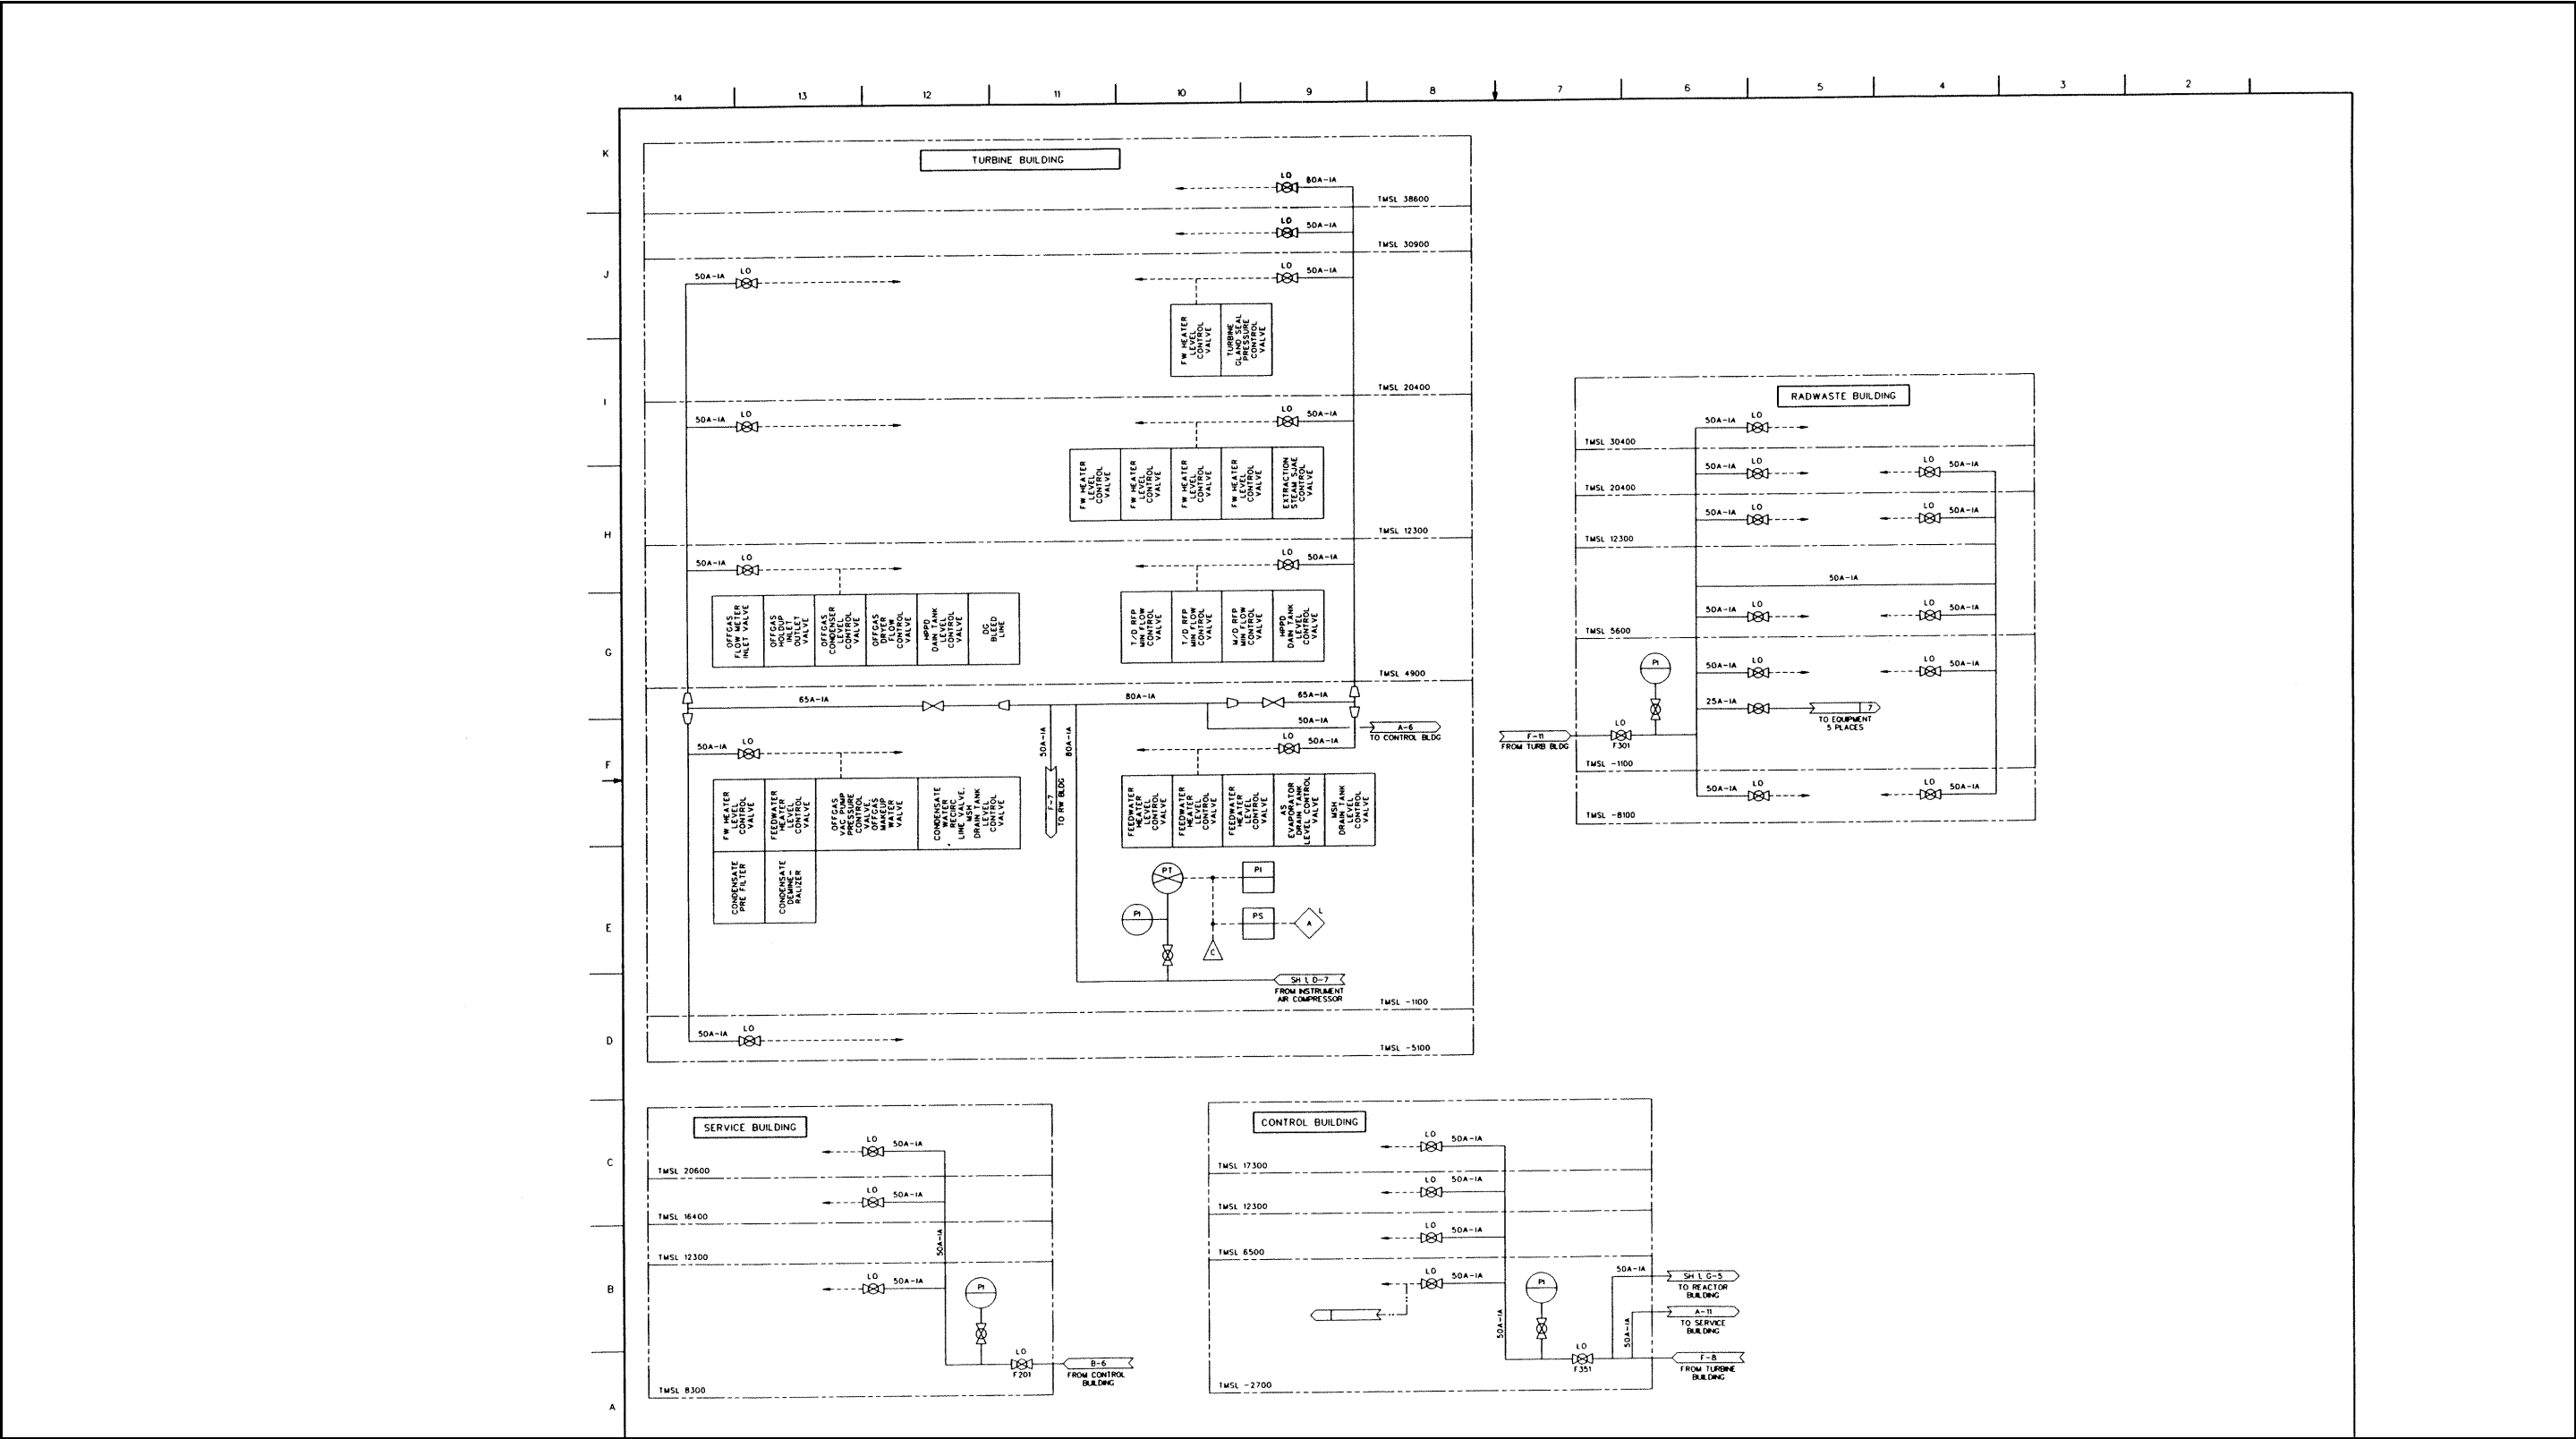


Figure 9.3-6 Instrument Air System P&ID (Sheet 2 of 2)

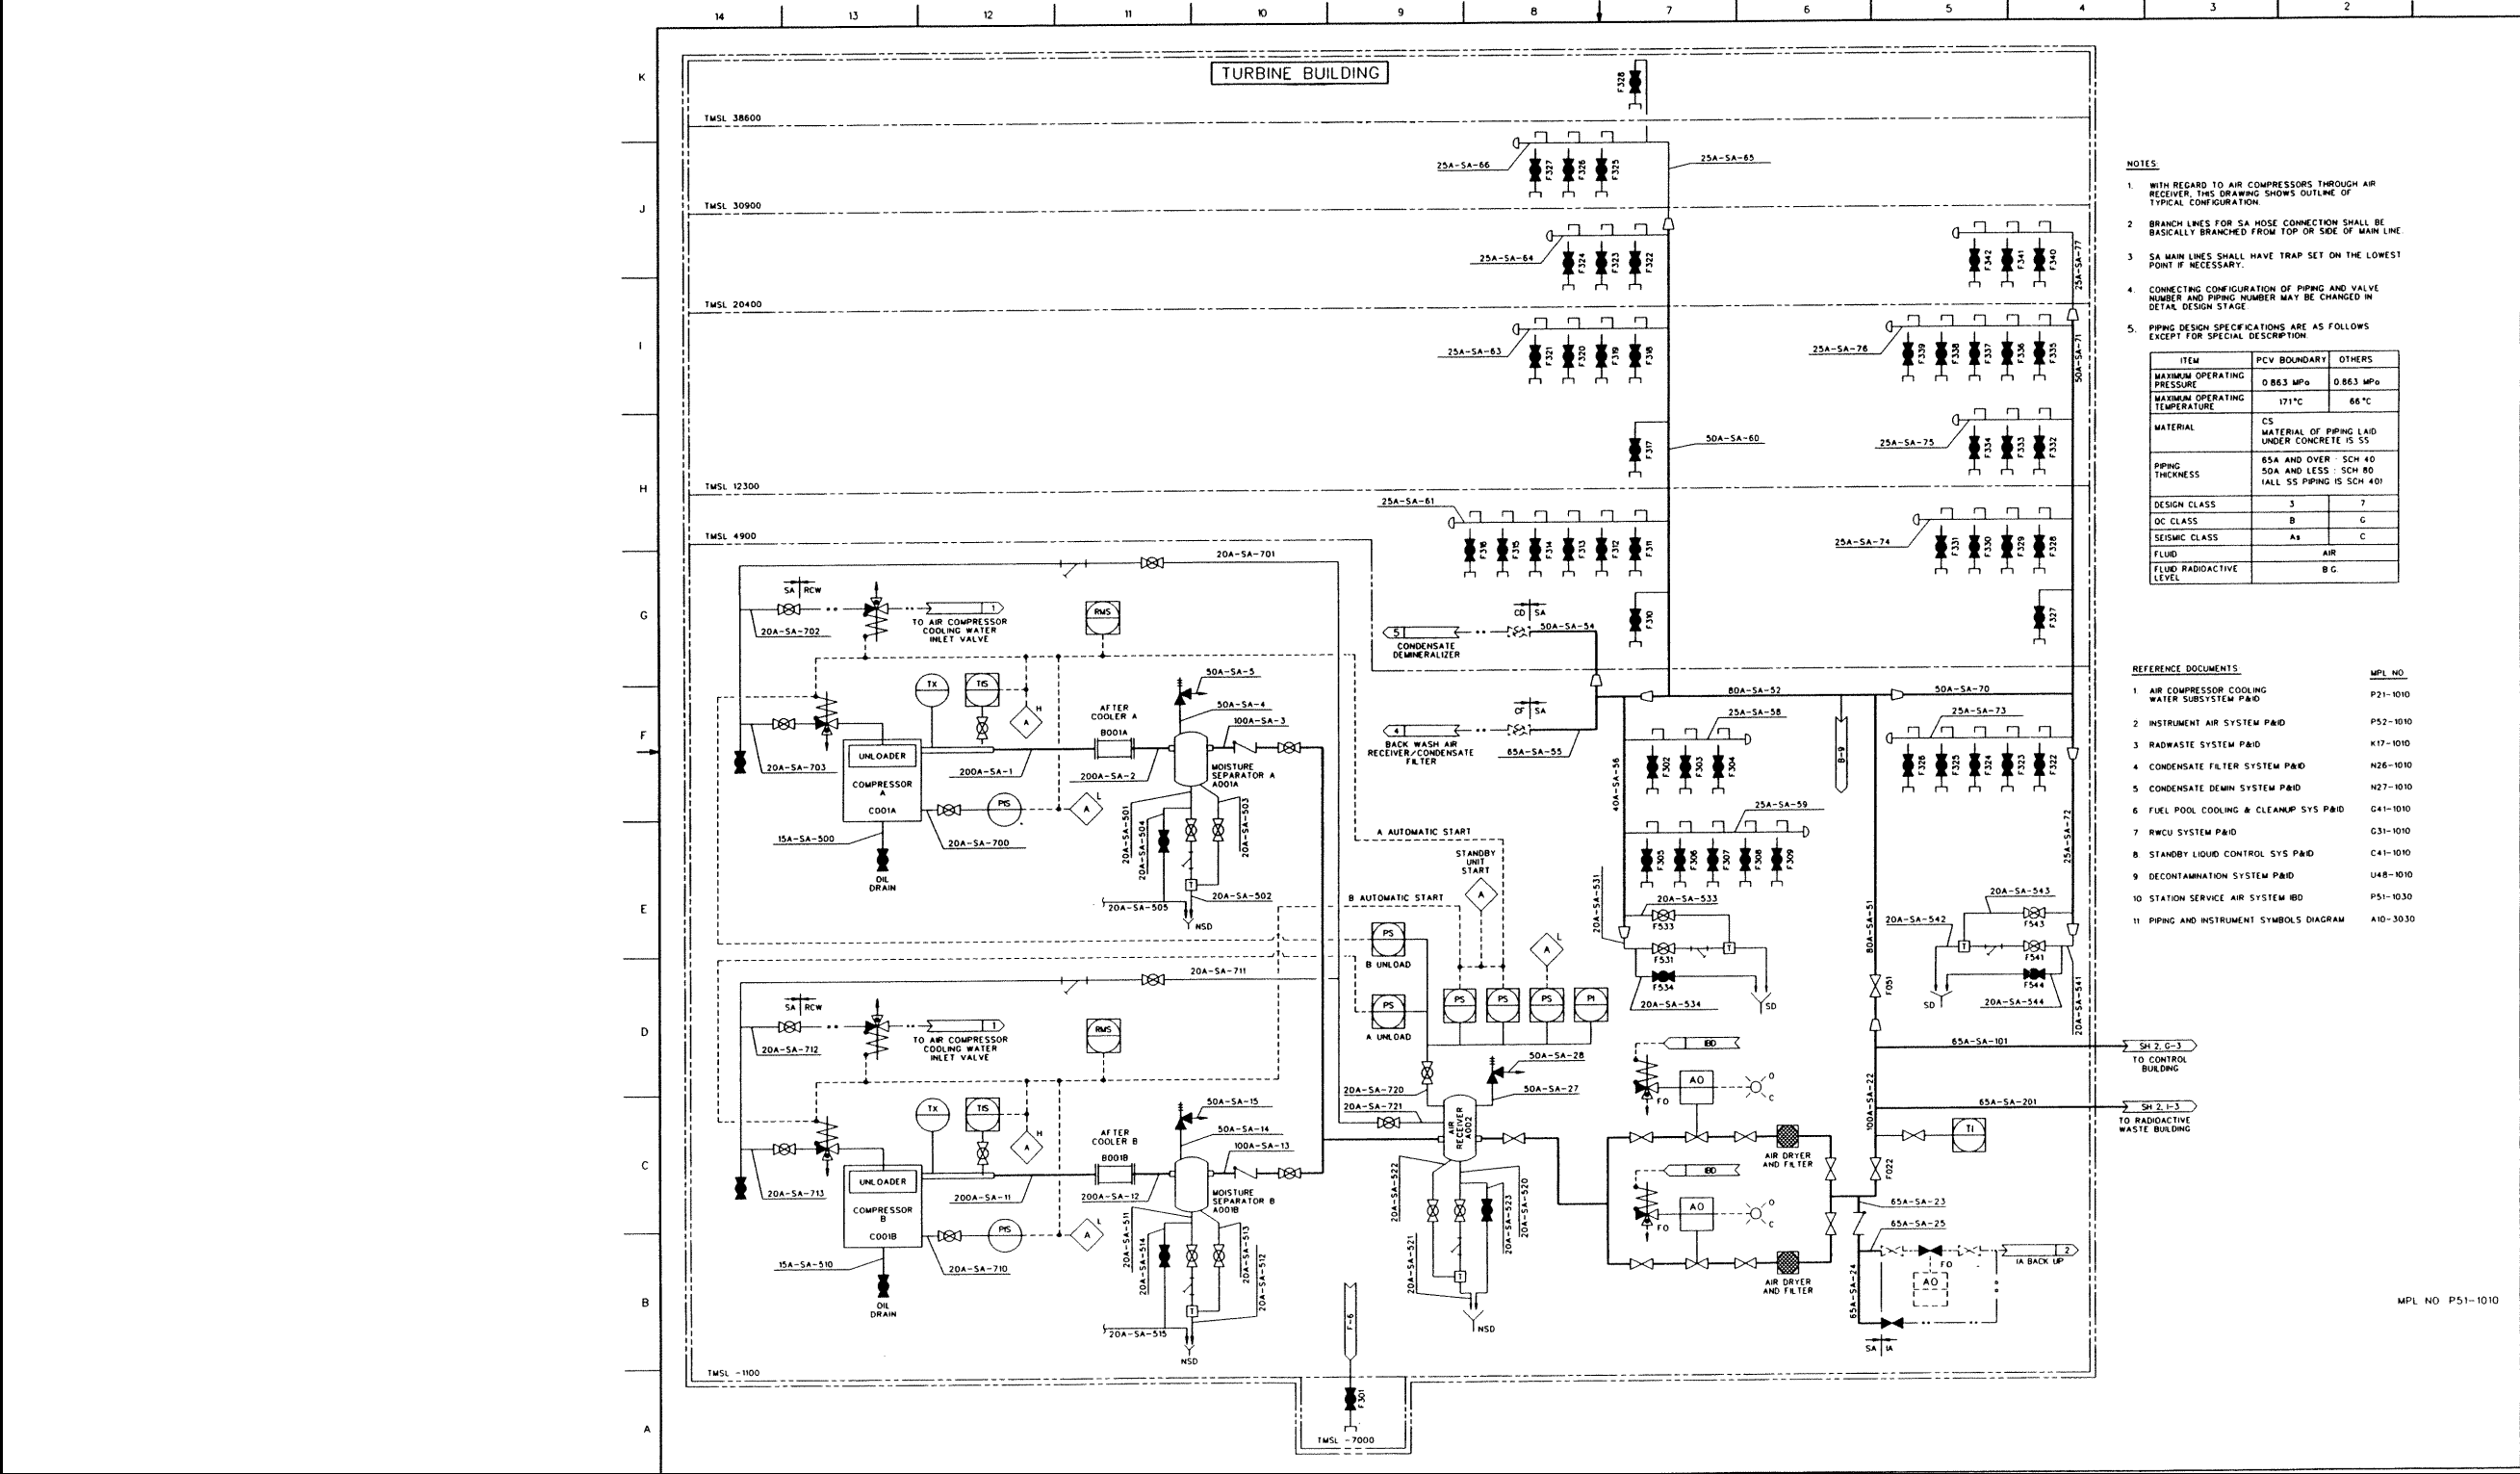


Figure 9.3-7 Service Air System P&ID (Sheet 1 of 2)

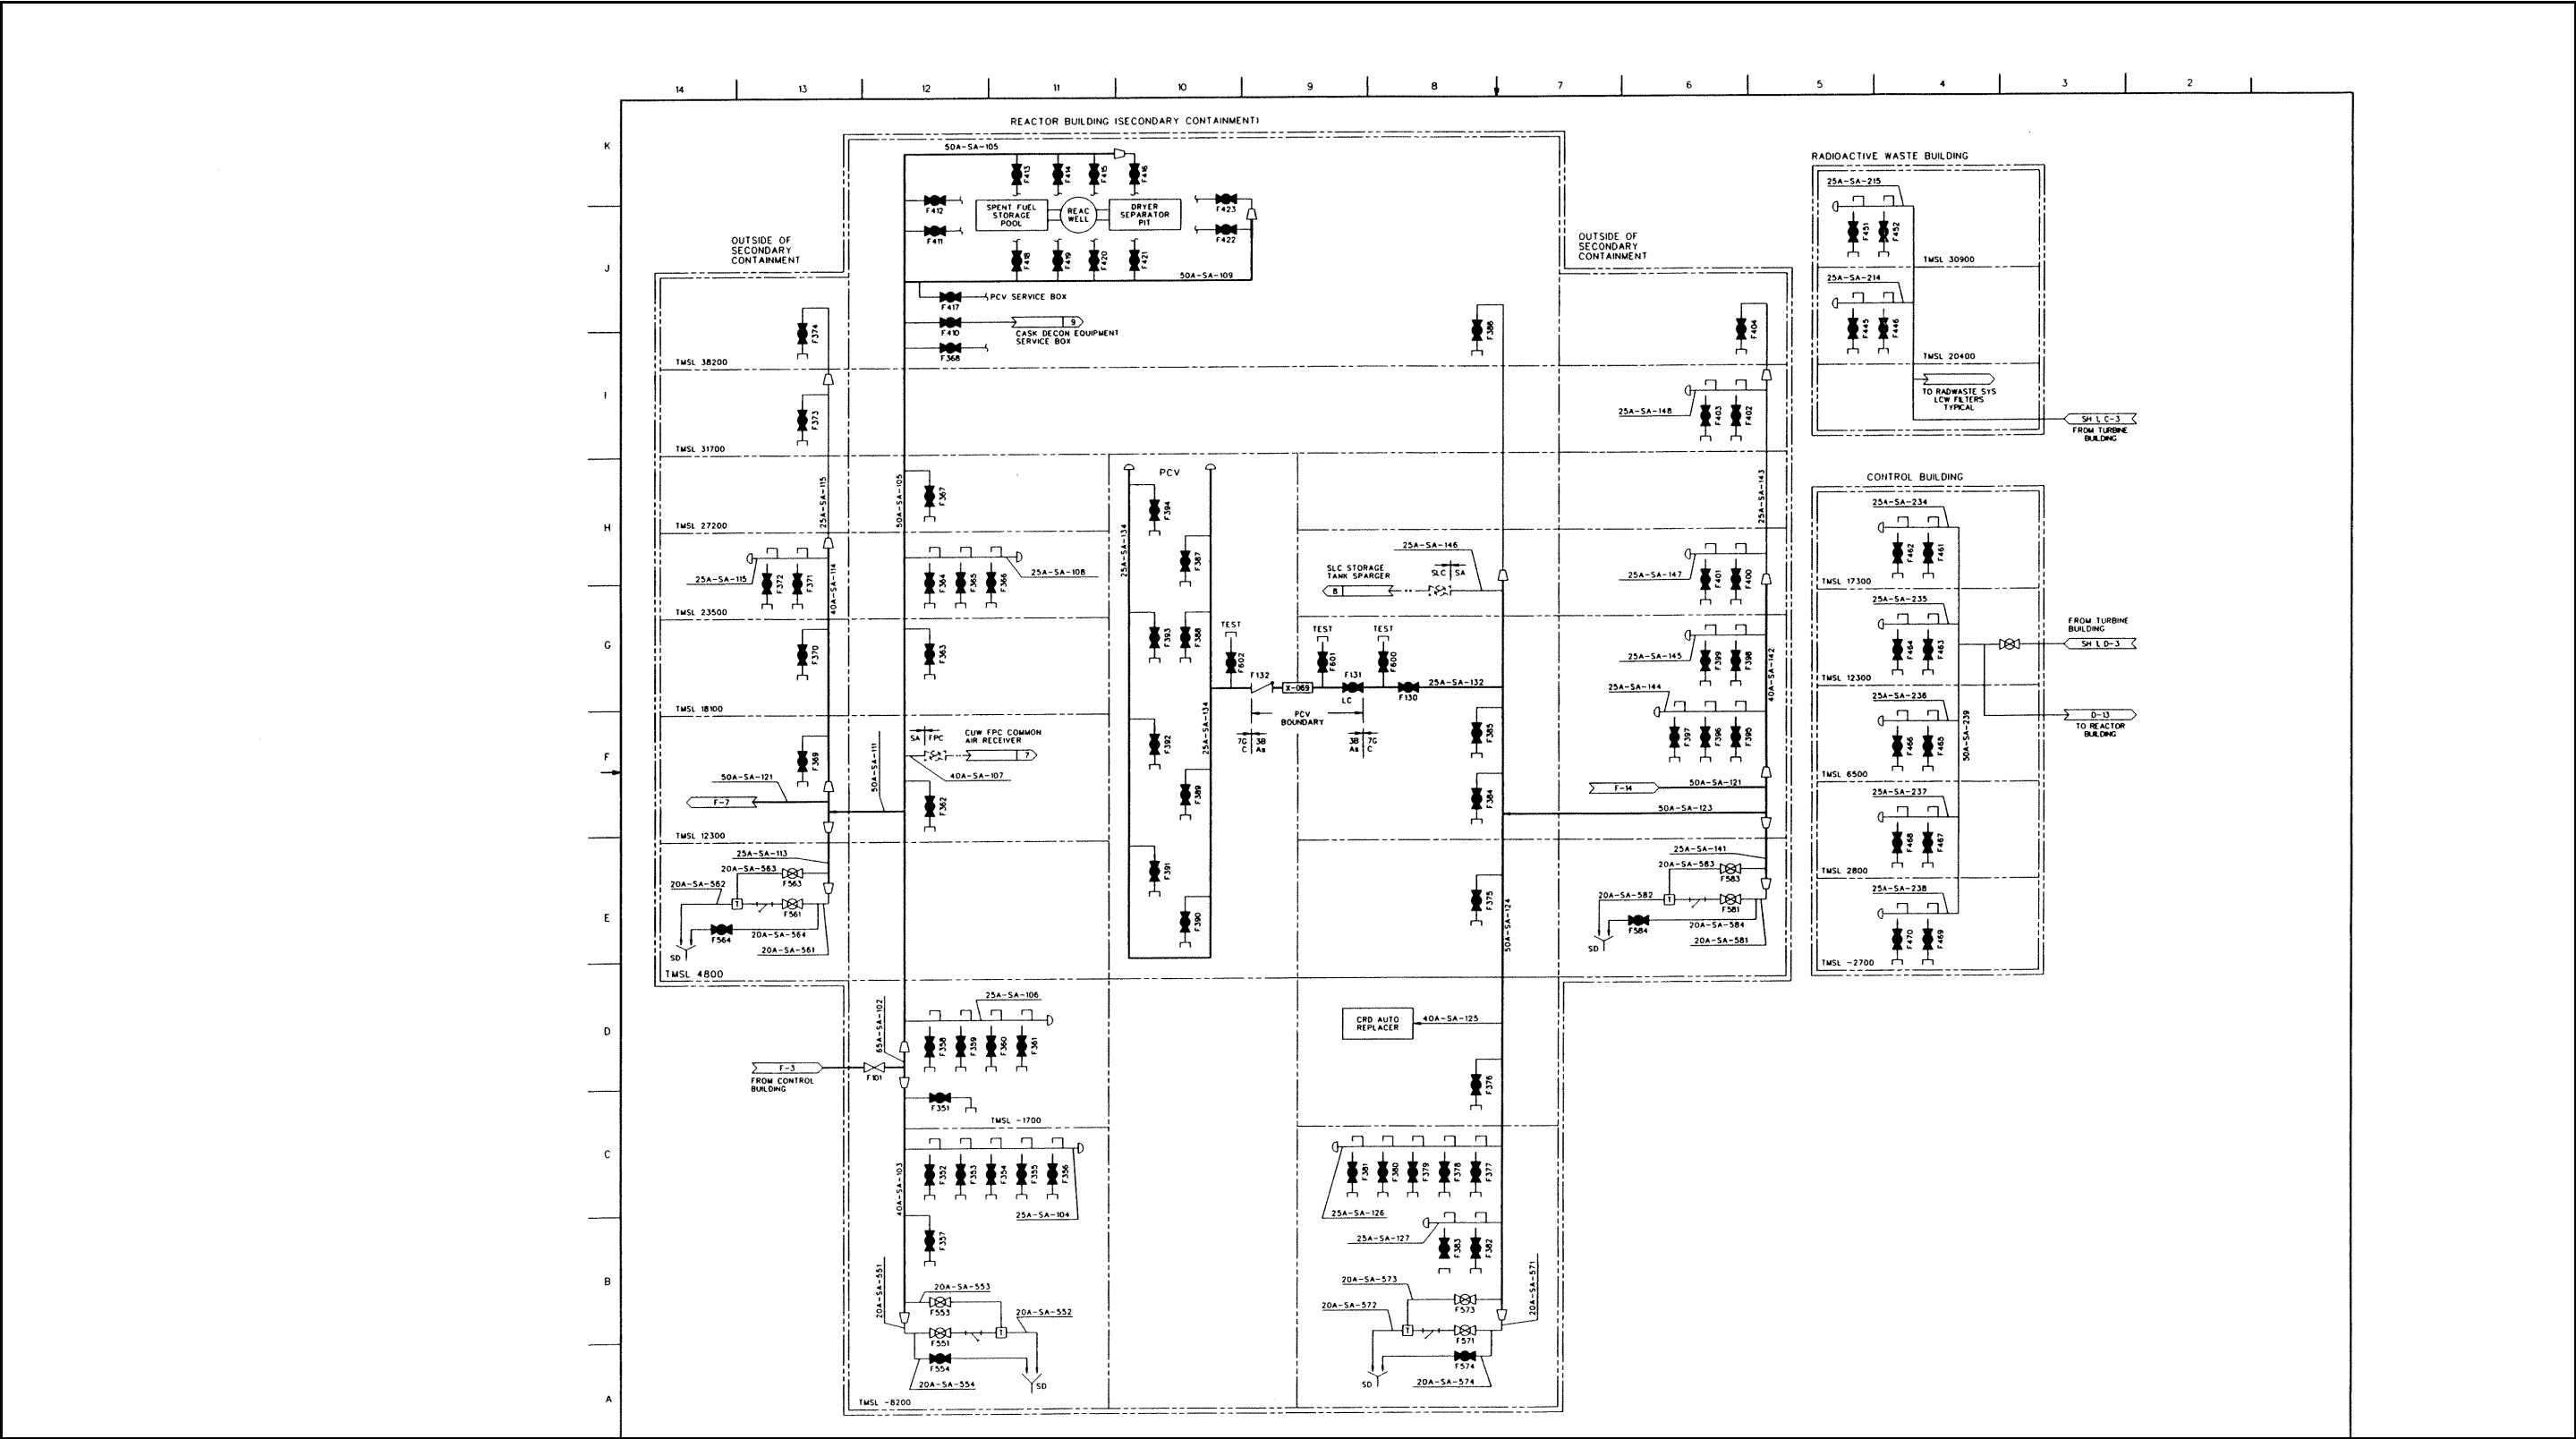


Figure 9.3-7 Service Air System P&ID (Sheet 2 of 2)





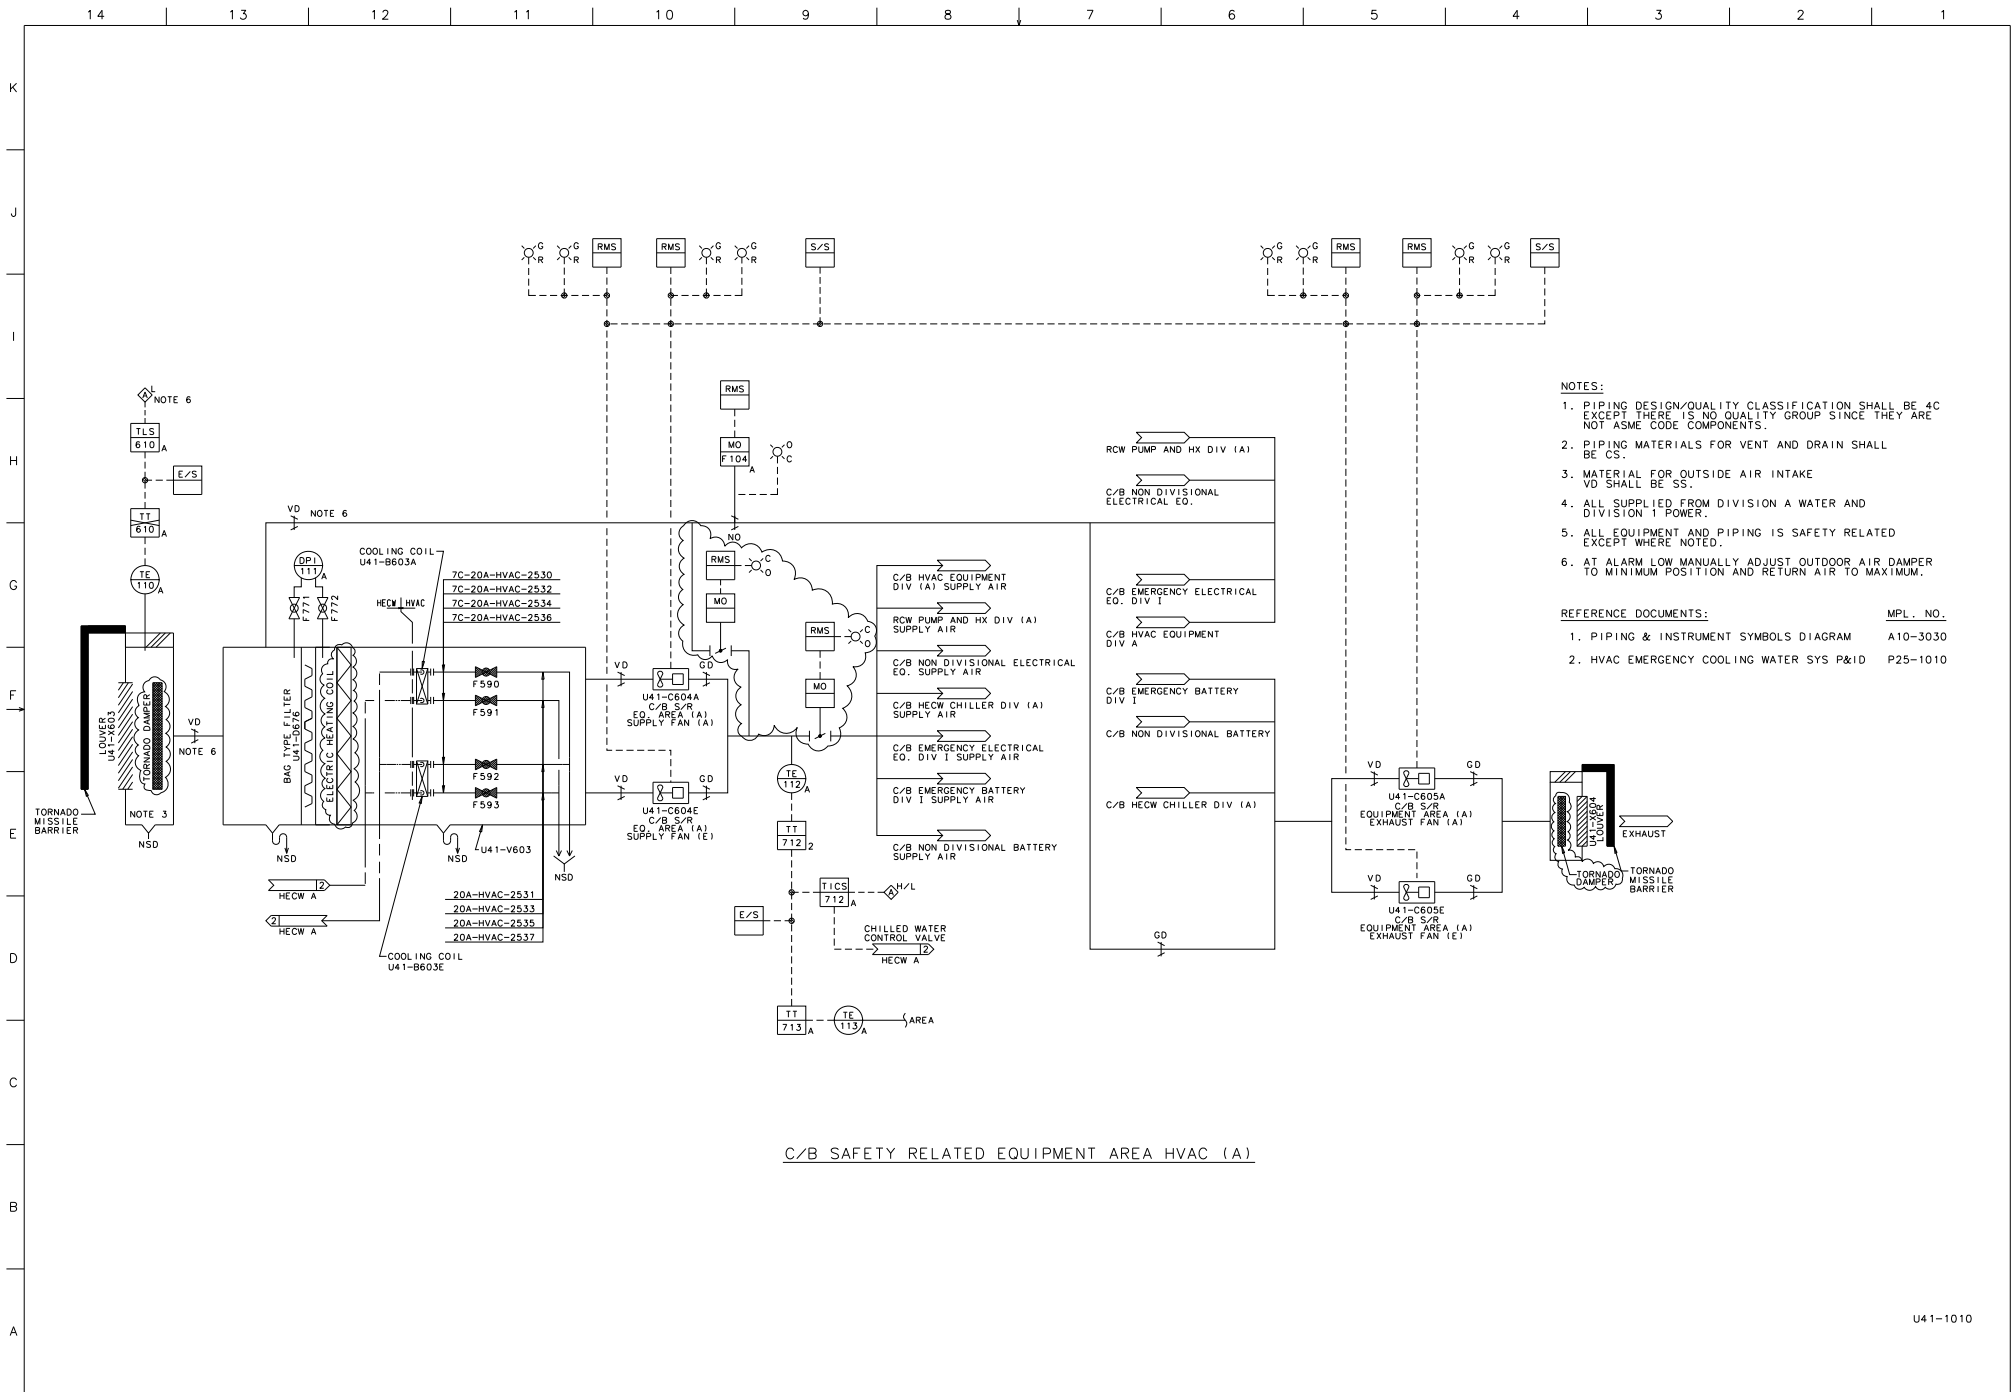


Figure 9.4-1 Control Building HVAC Flow Diagram (Sheet 3 of 5)



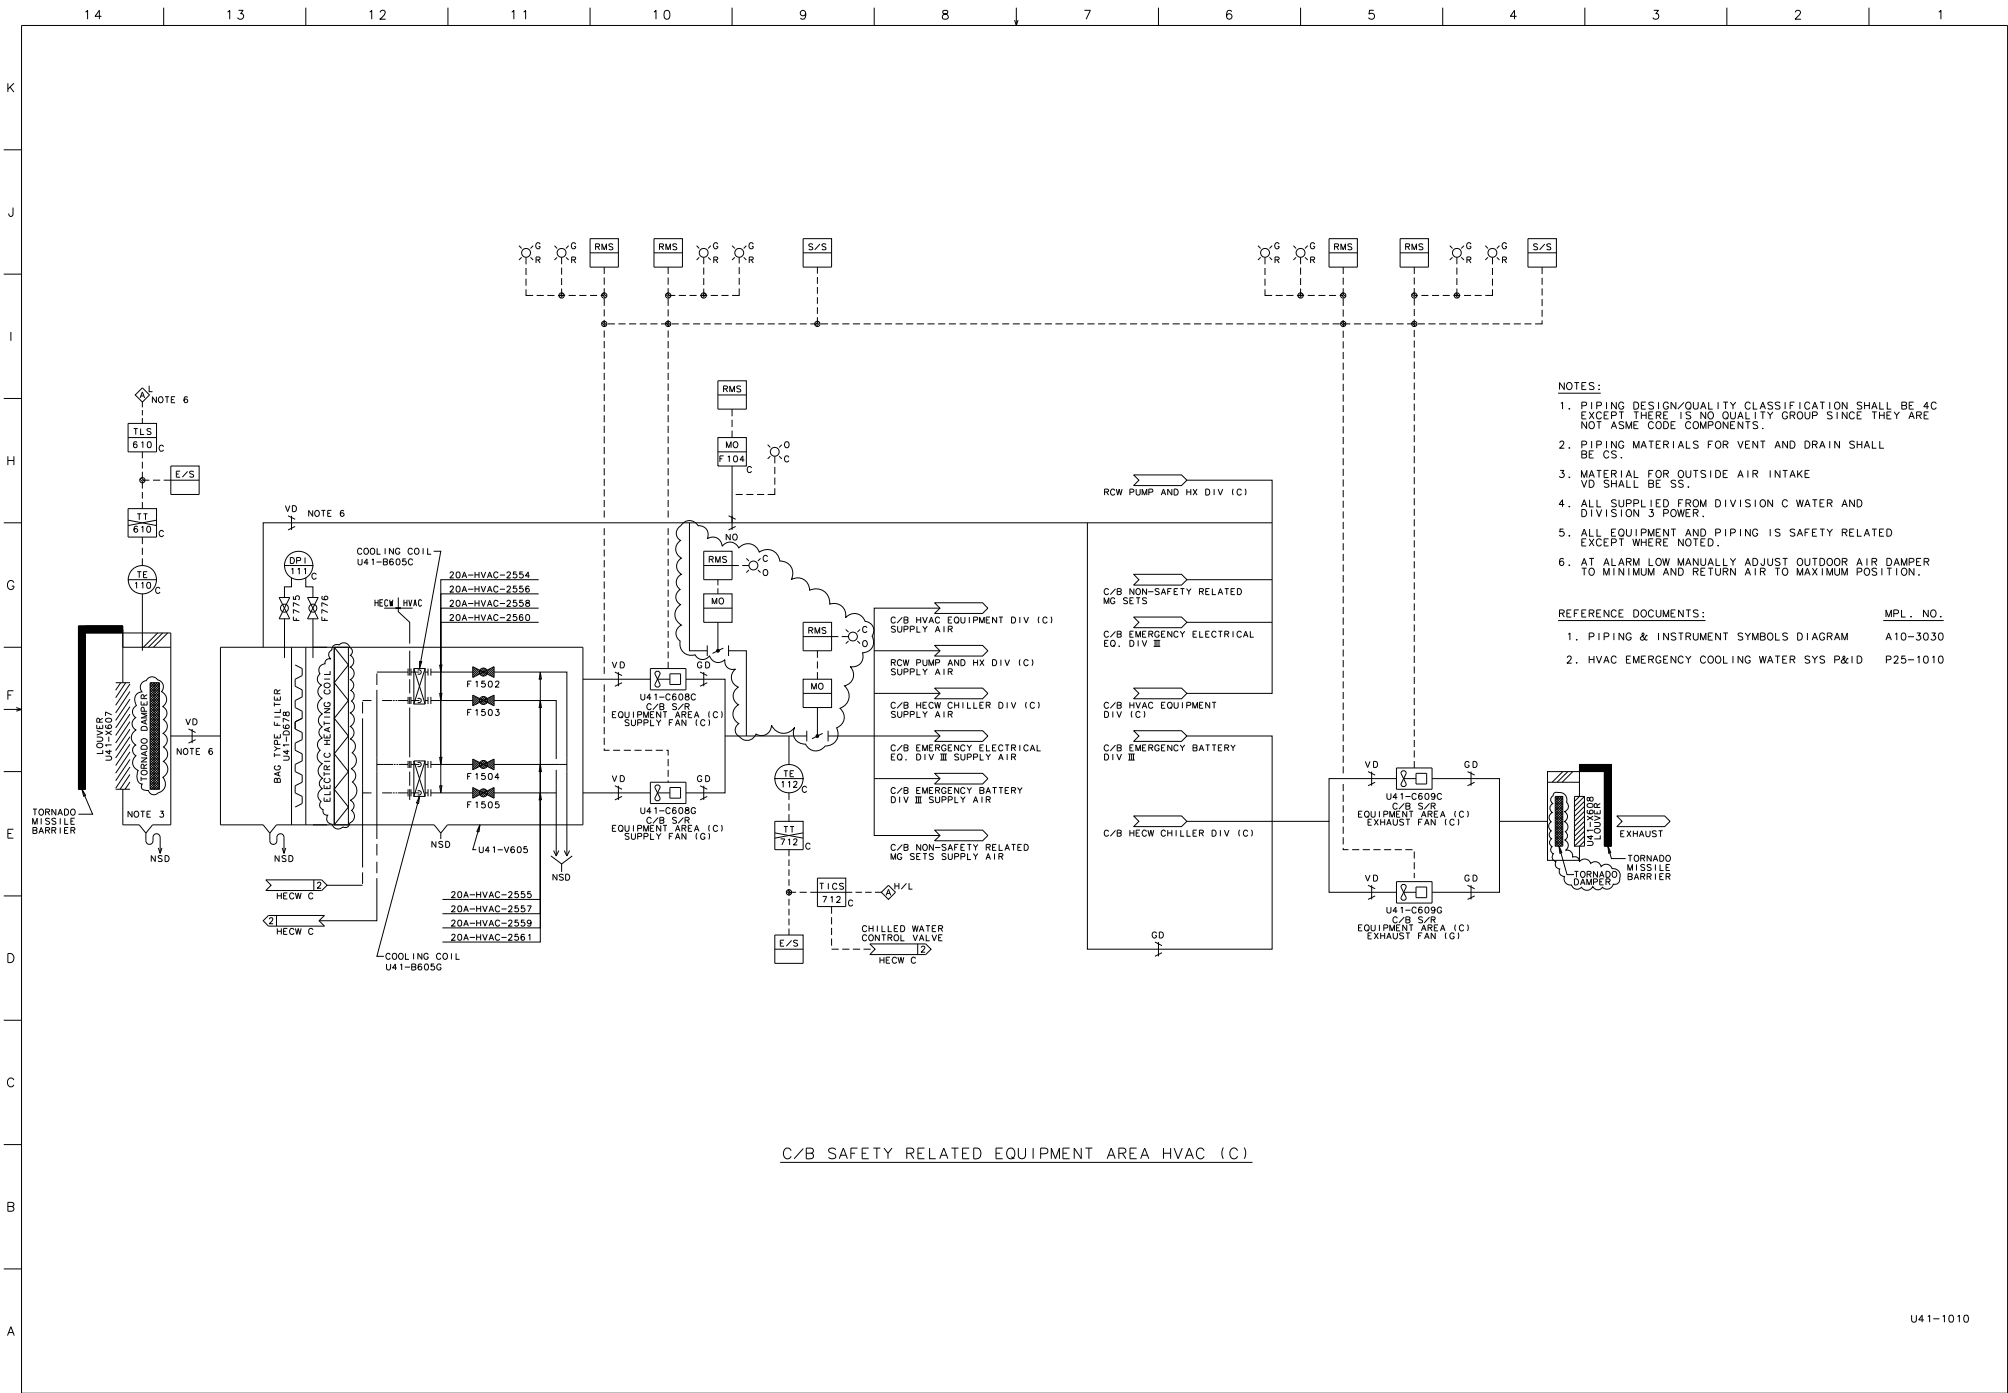


Figure 9.4-1 Control Building HVAC Flow Diagram (Sheet 5 of 5)

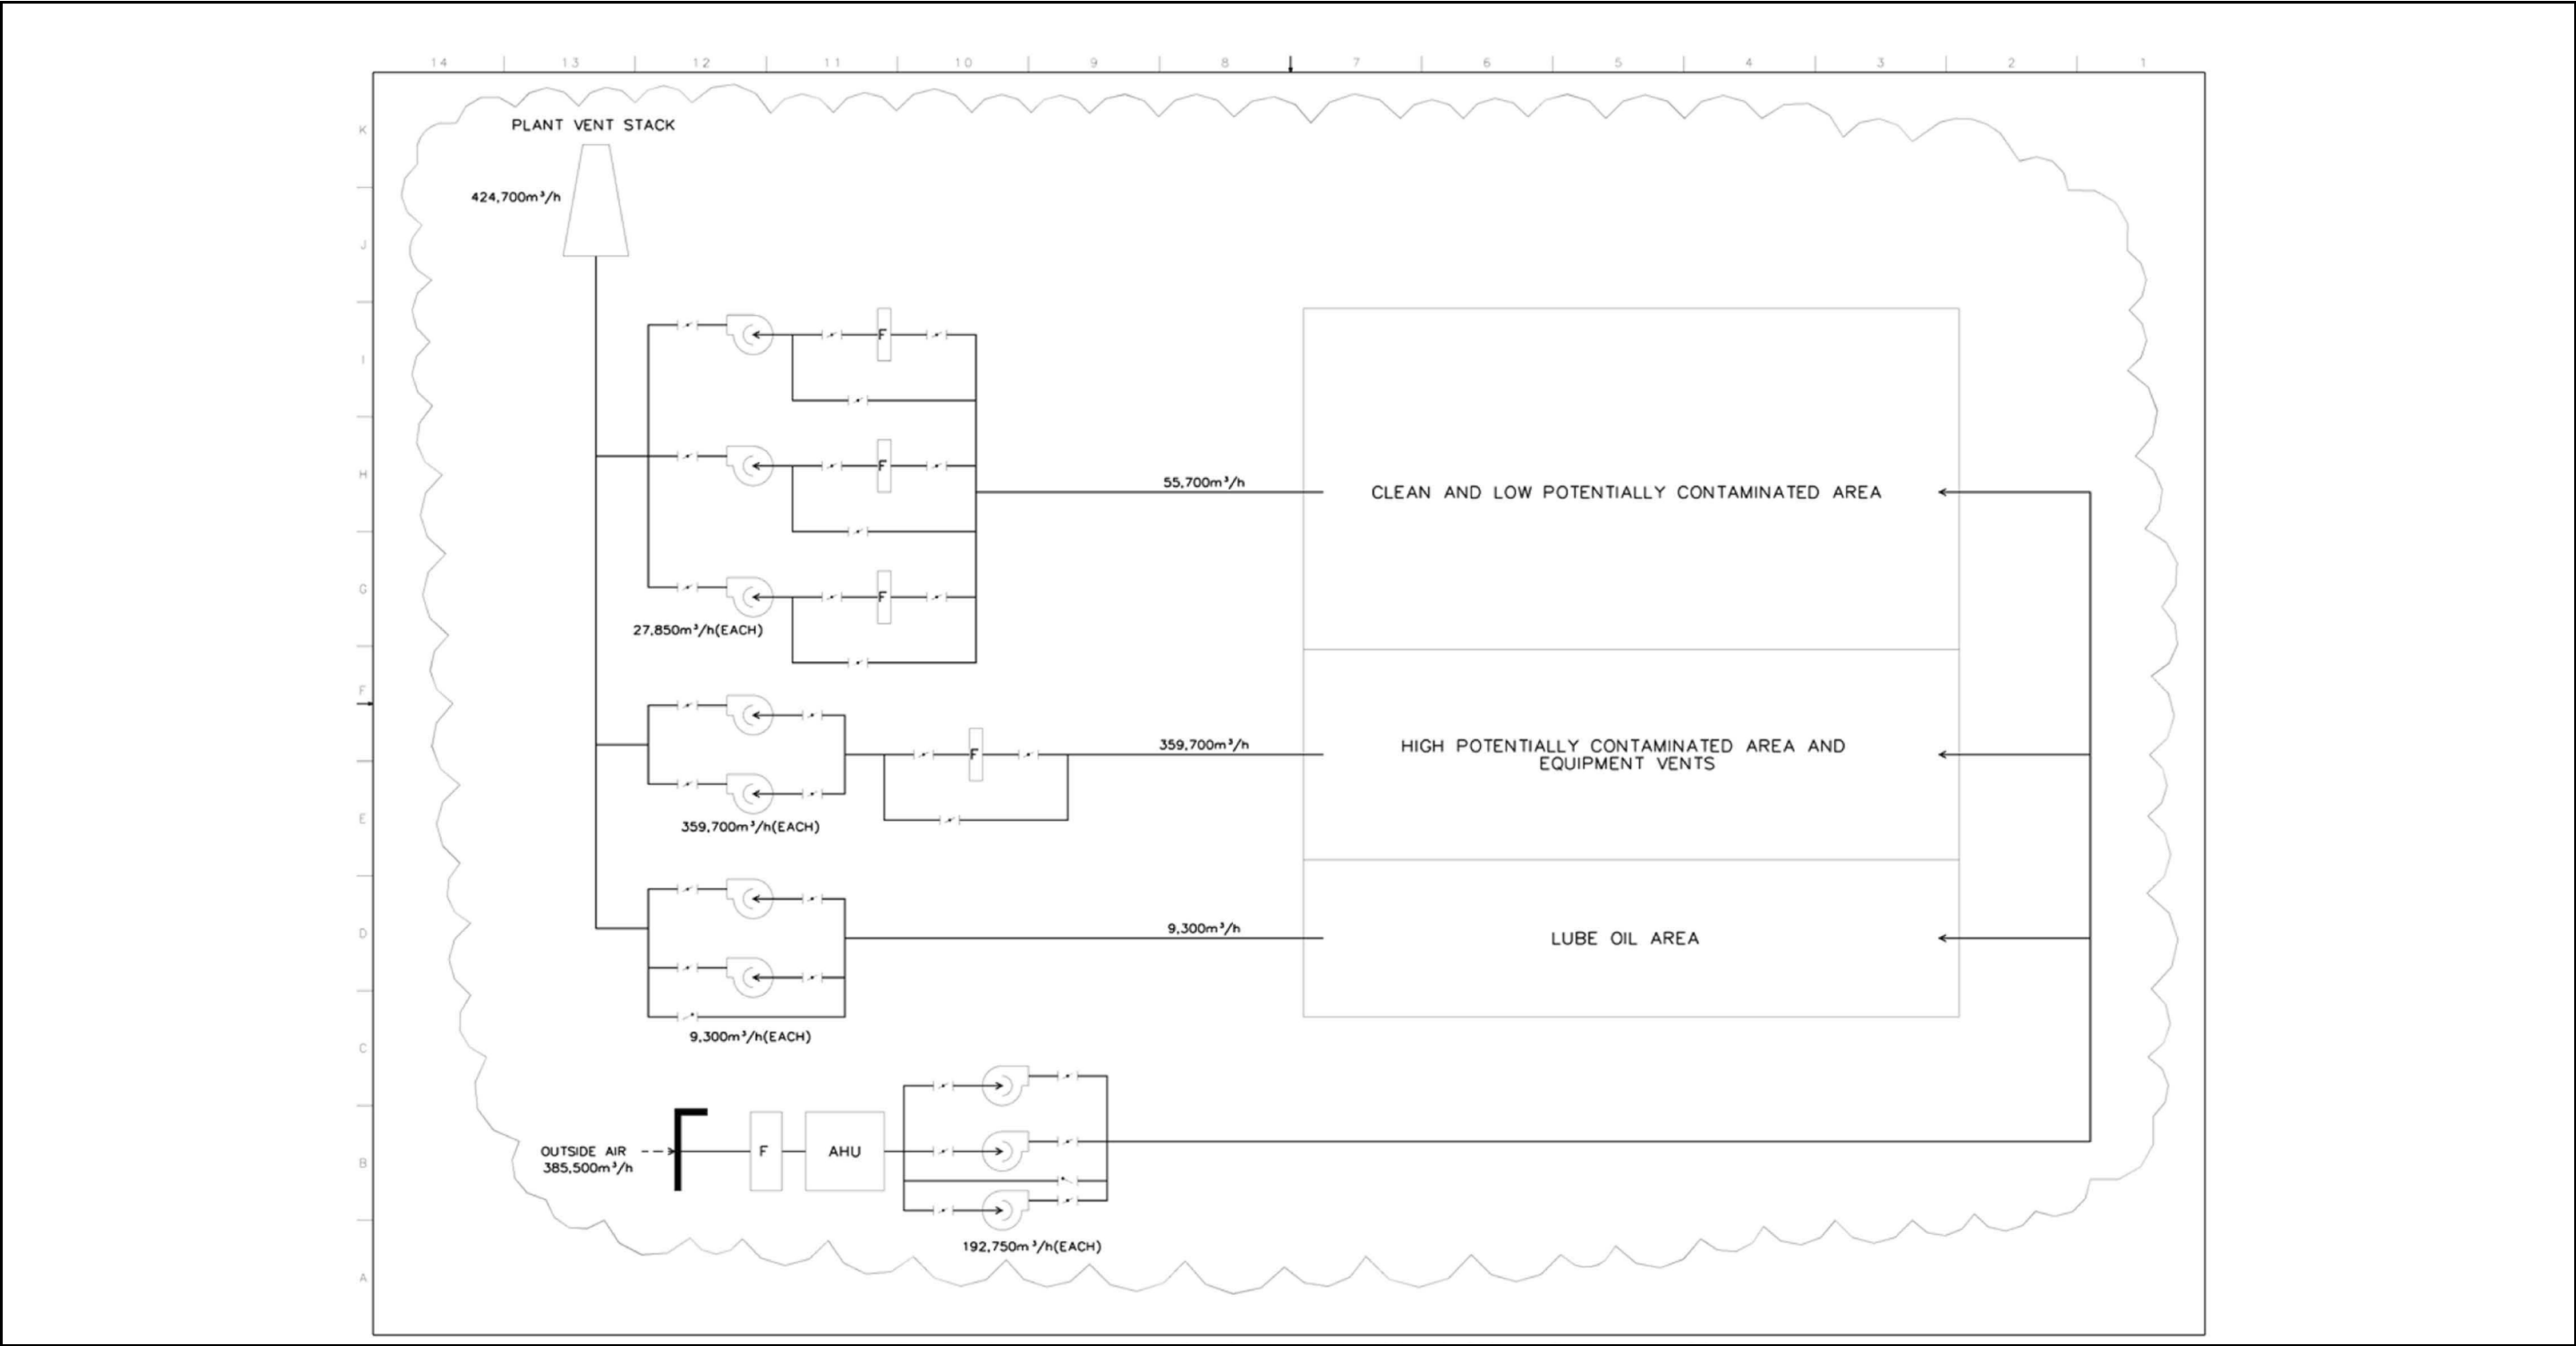
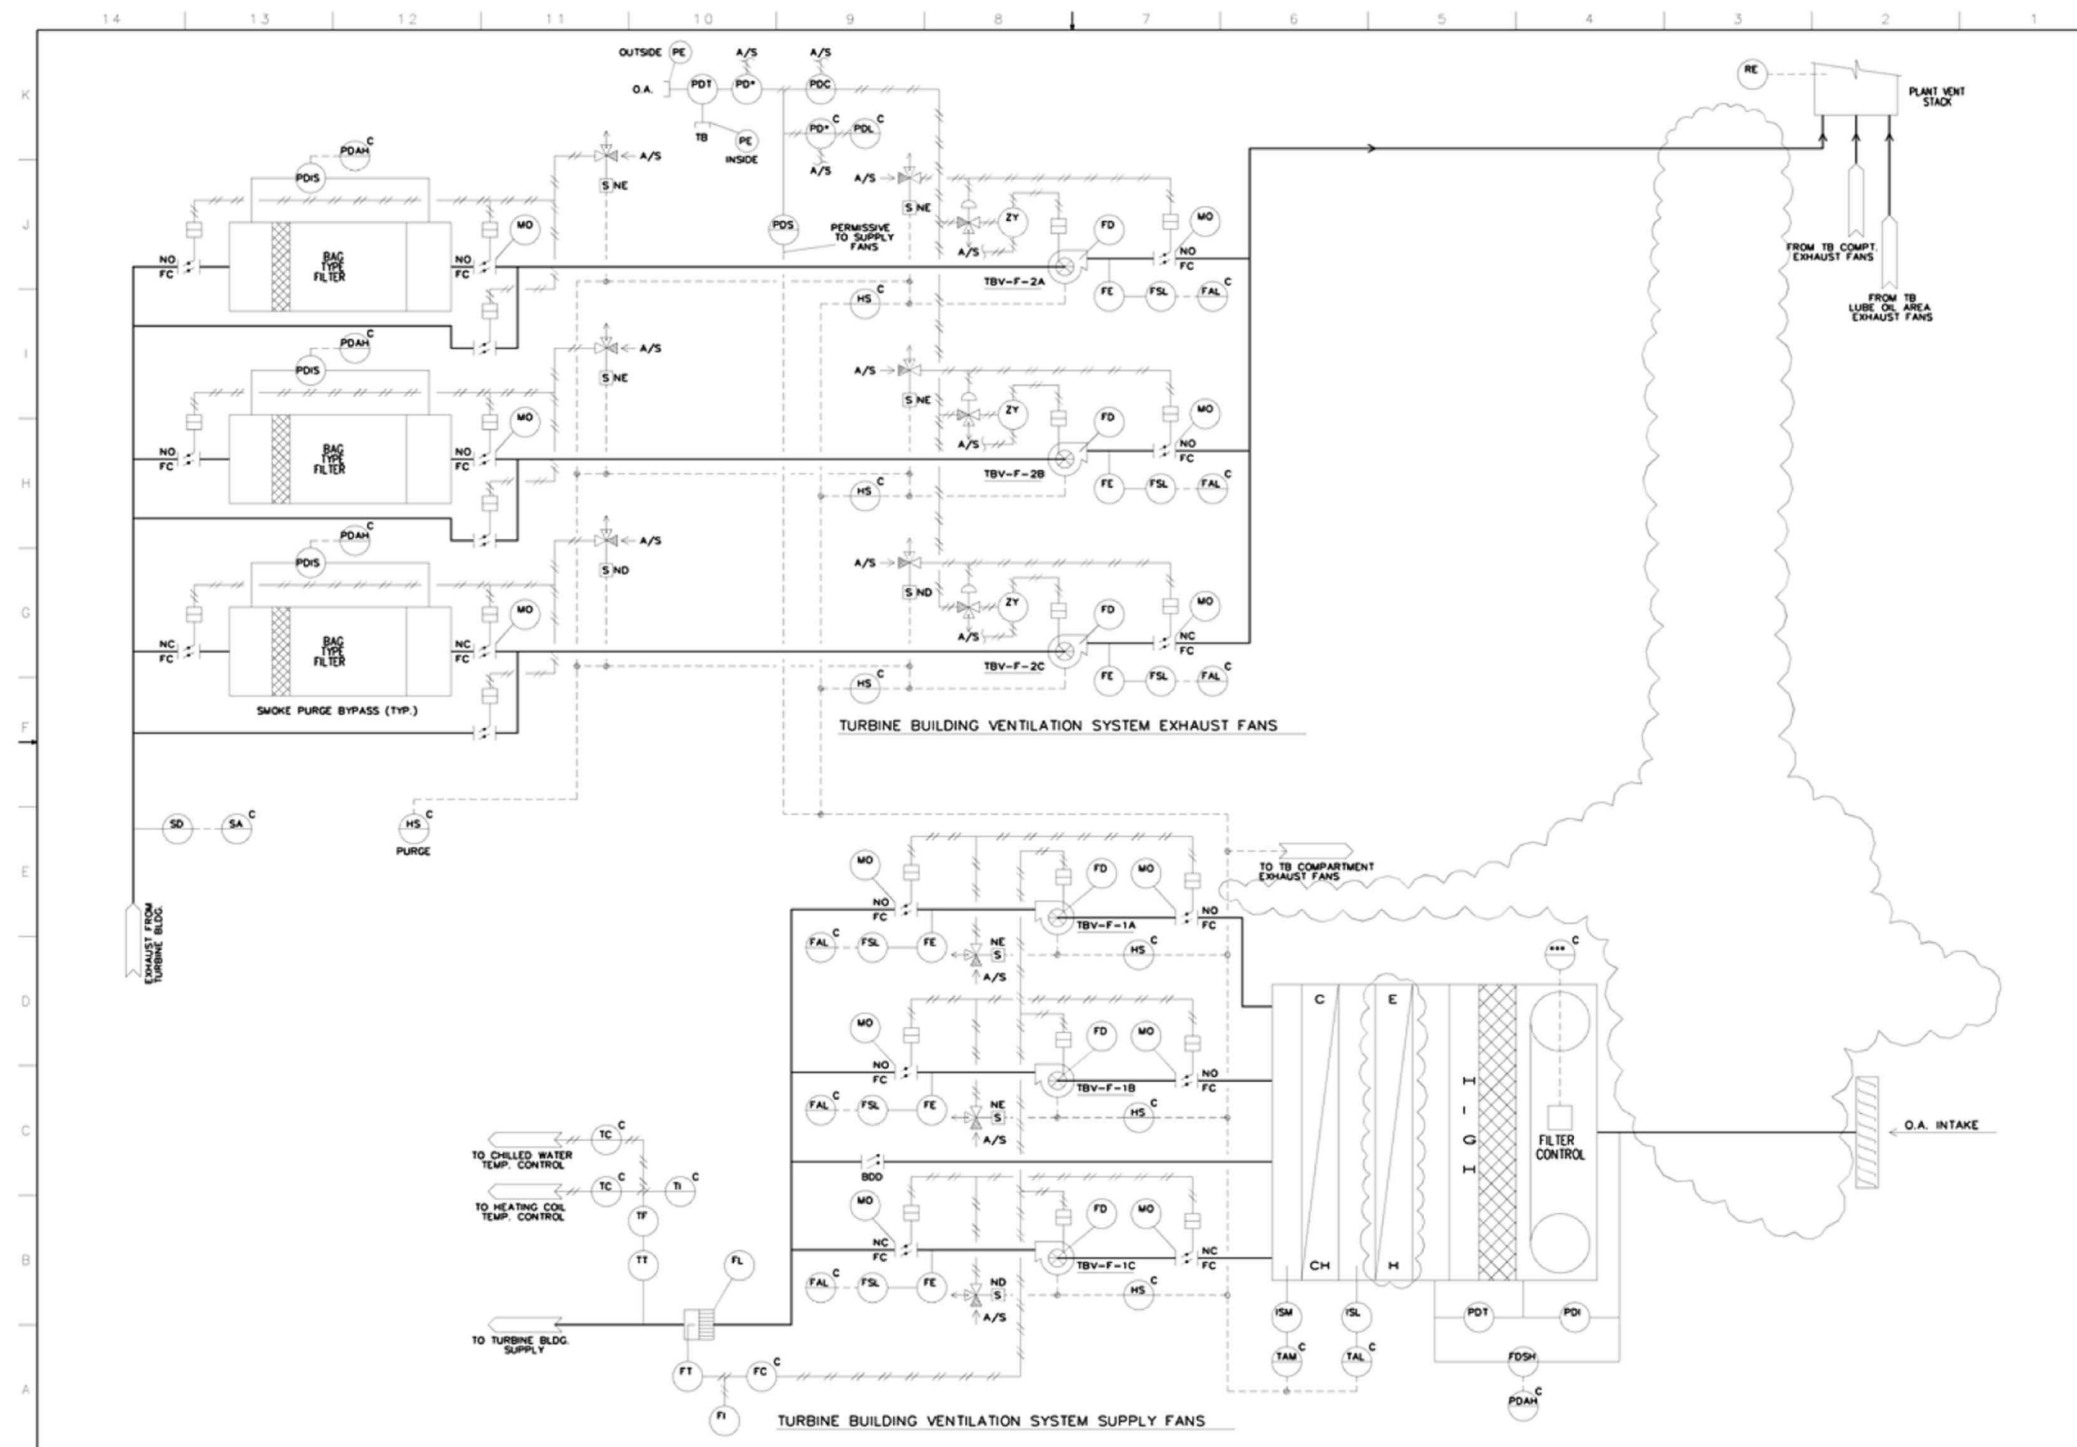


Figure 9.4-2a Turbine Building Ventilation System Air Flow Diagram



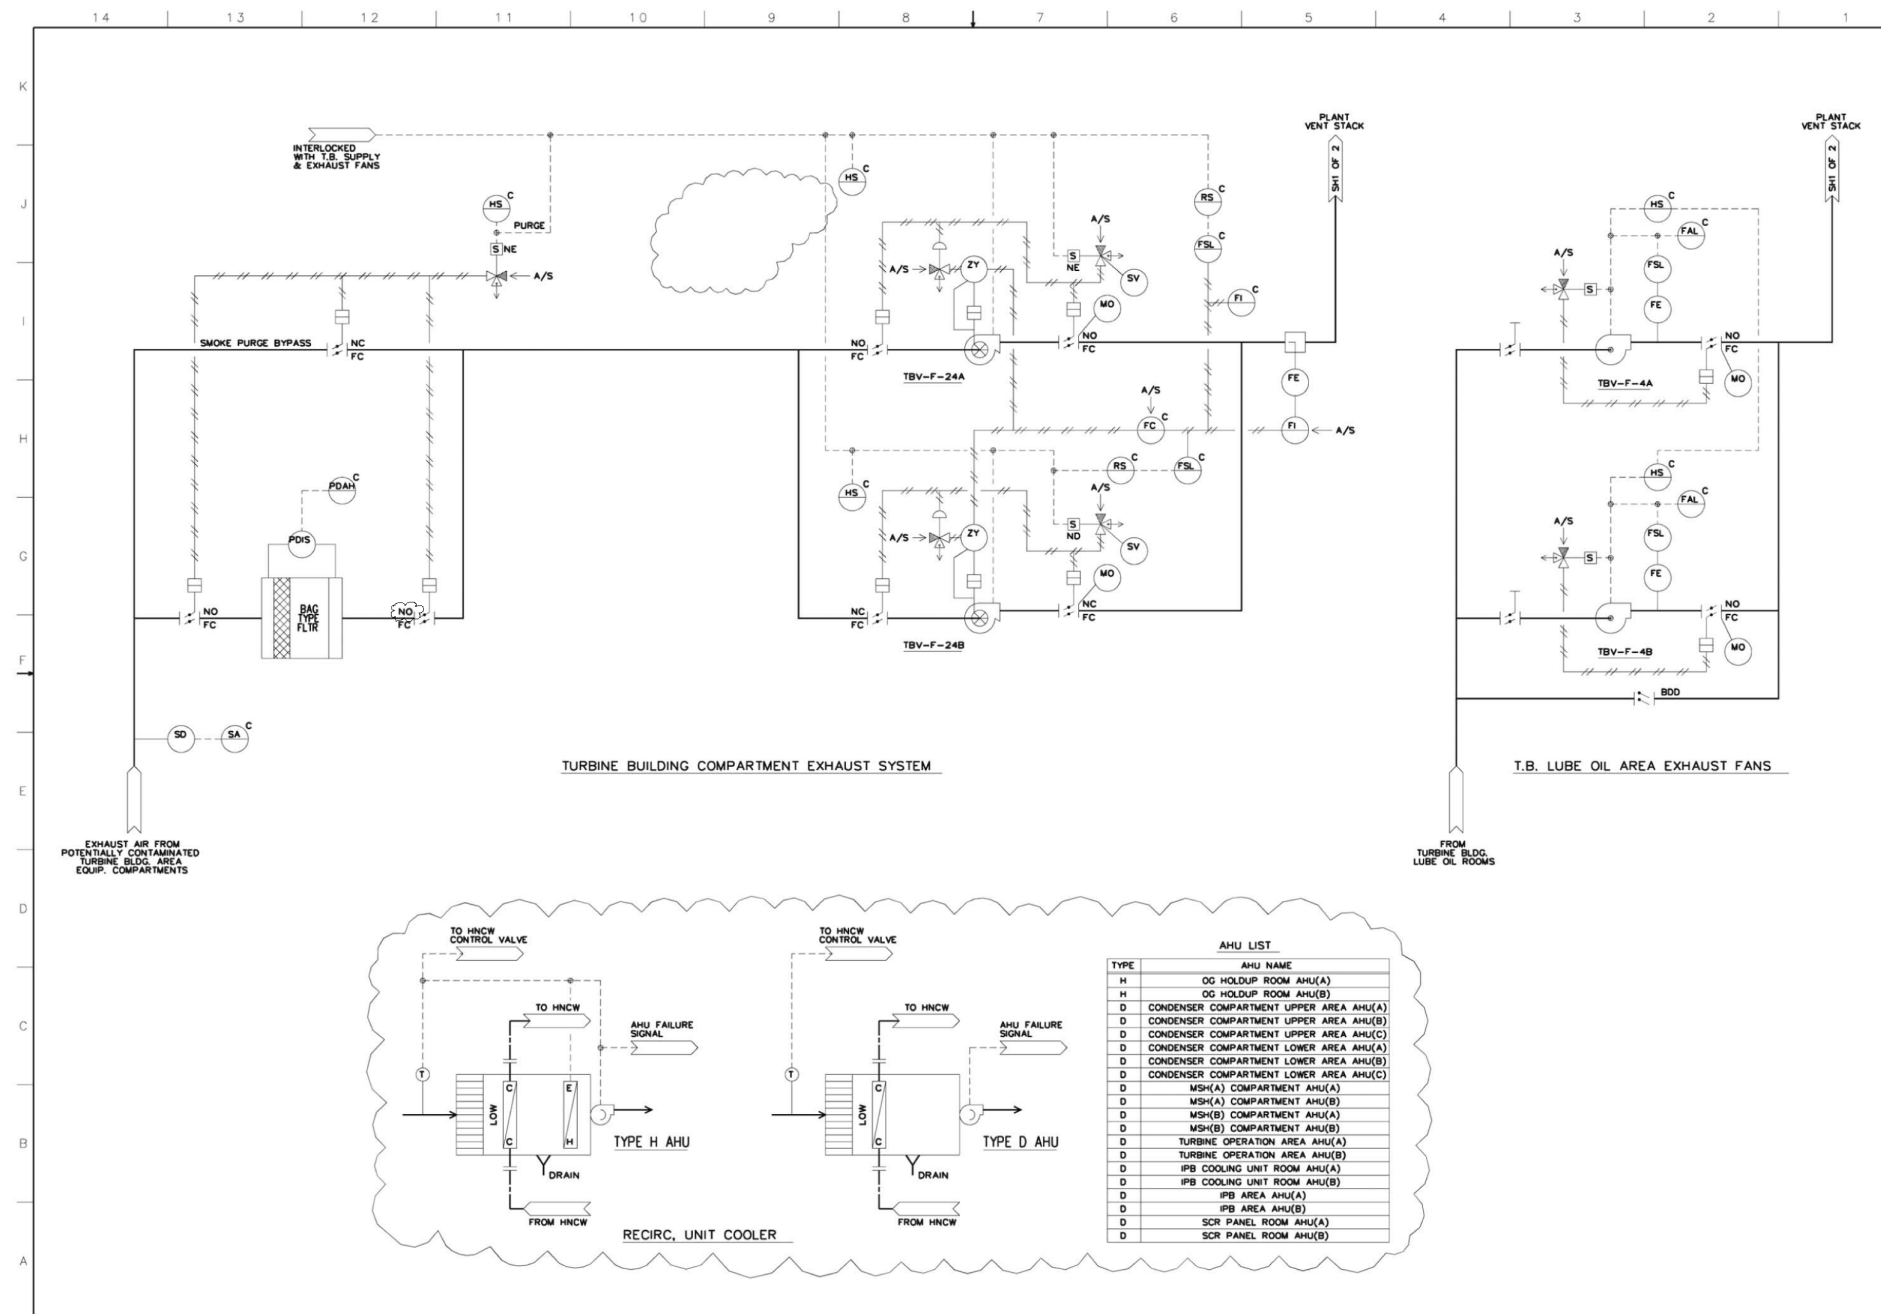


Figure 9.4-2b Turbine Building Ventilation System Control Diagram (Sheet 2 of 2)

Figure 9.4-3 Secondary Containment HVAC System P&ID (Sheet 1 of 3)

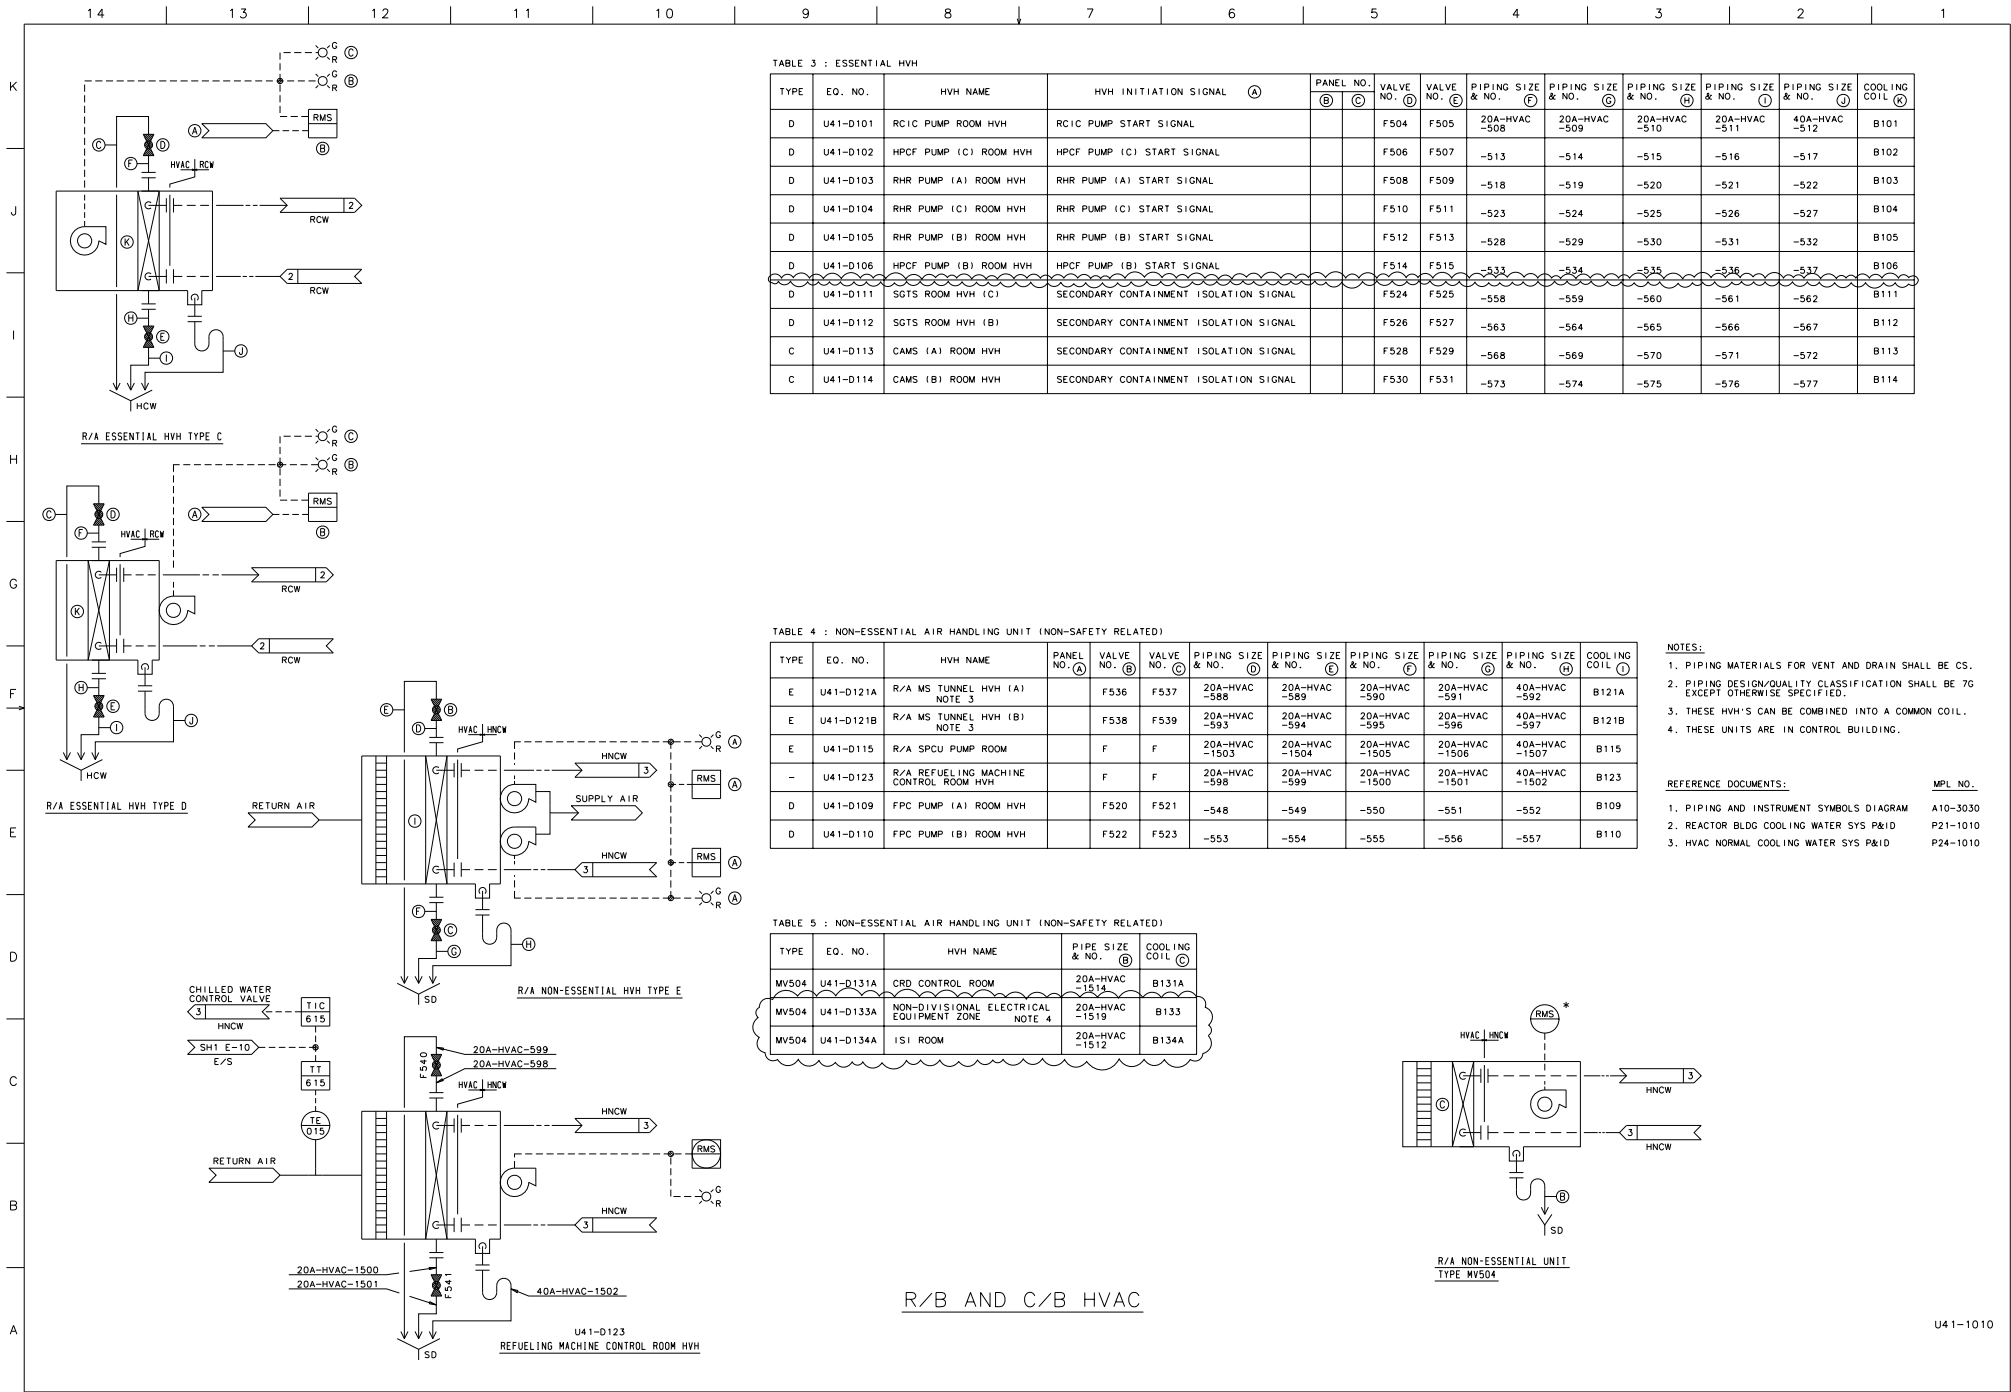


Figure 9.4-3 Secondary Containment HVAC System P&ID (Sheet 2 of 3)

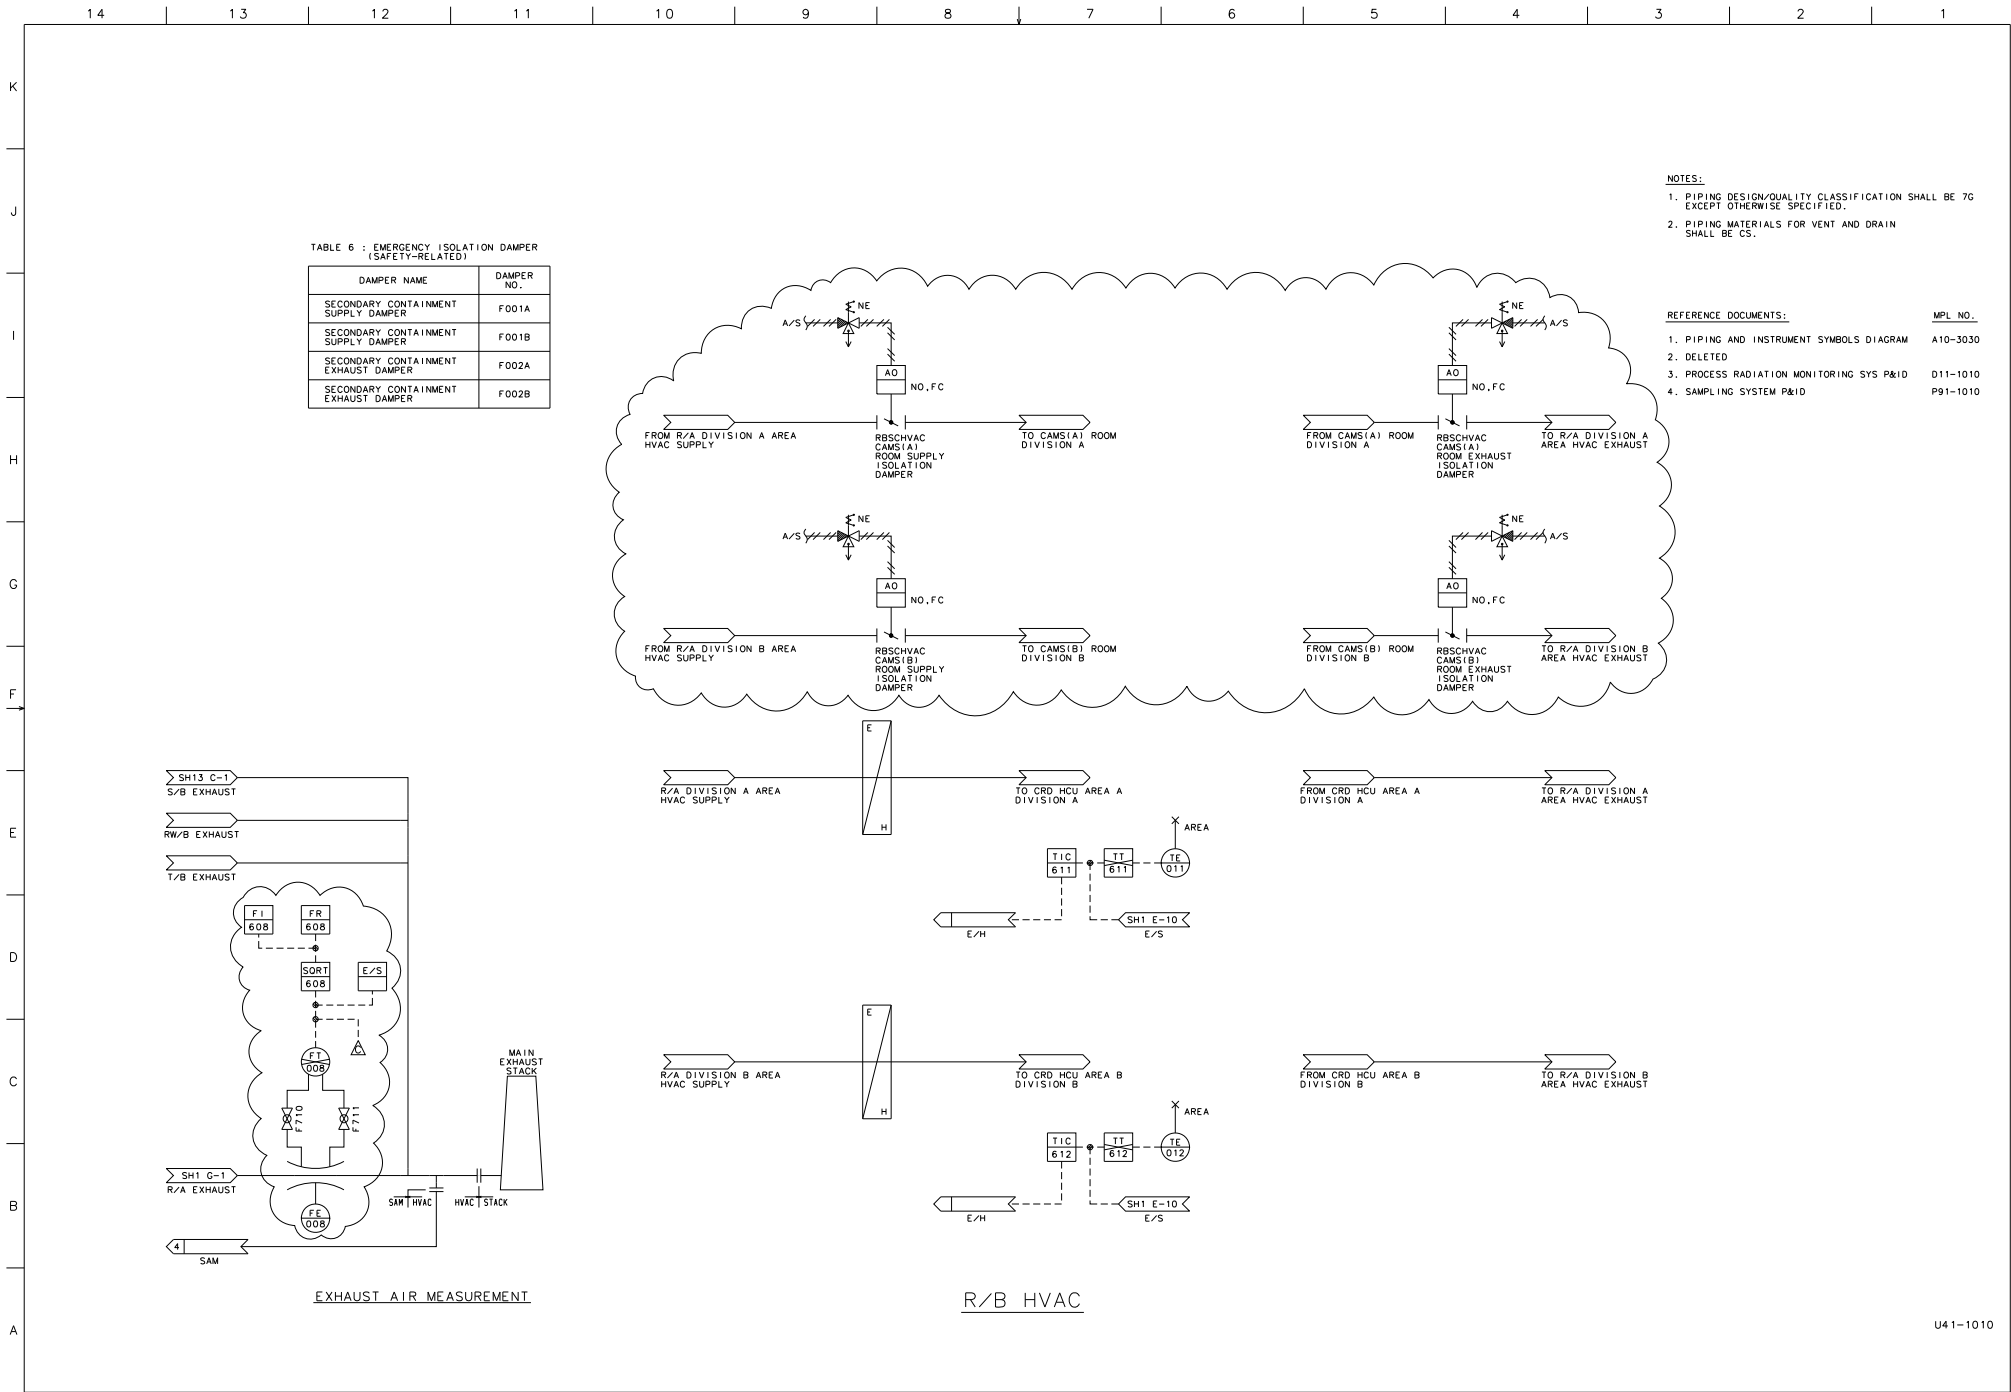


Figure 9.4-3 Secondary Containment HVAC System P&ID (Sheet 3 of 3)

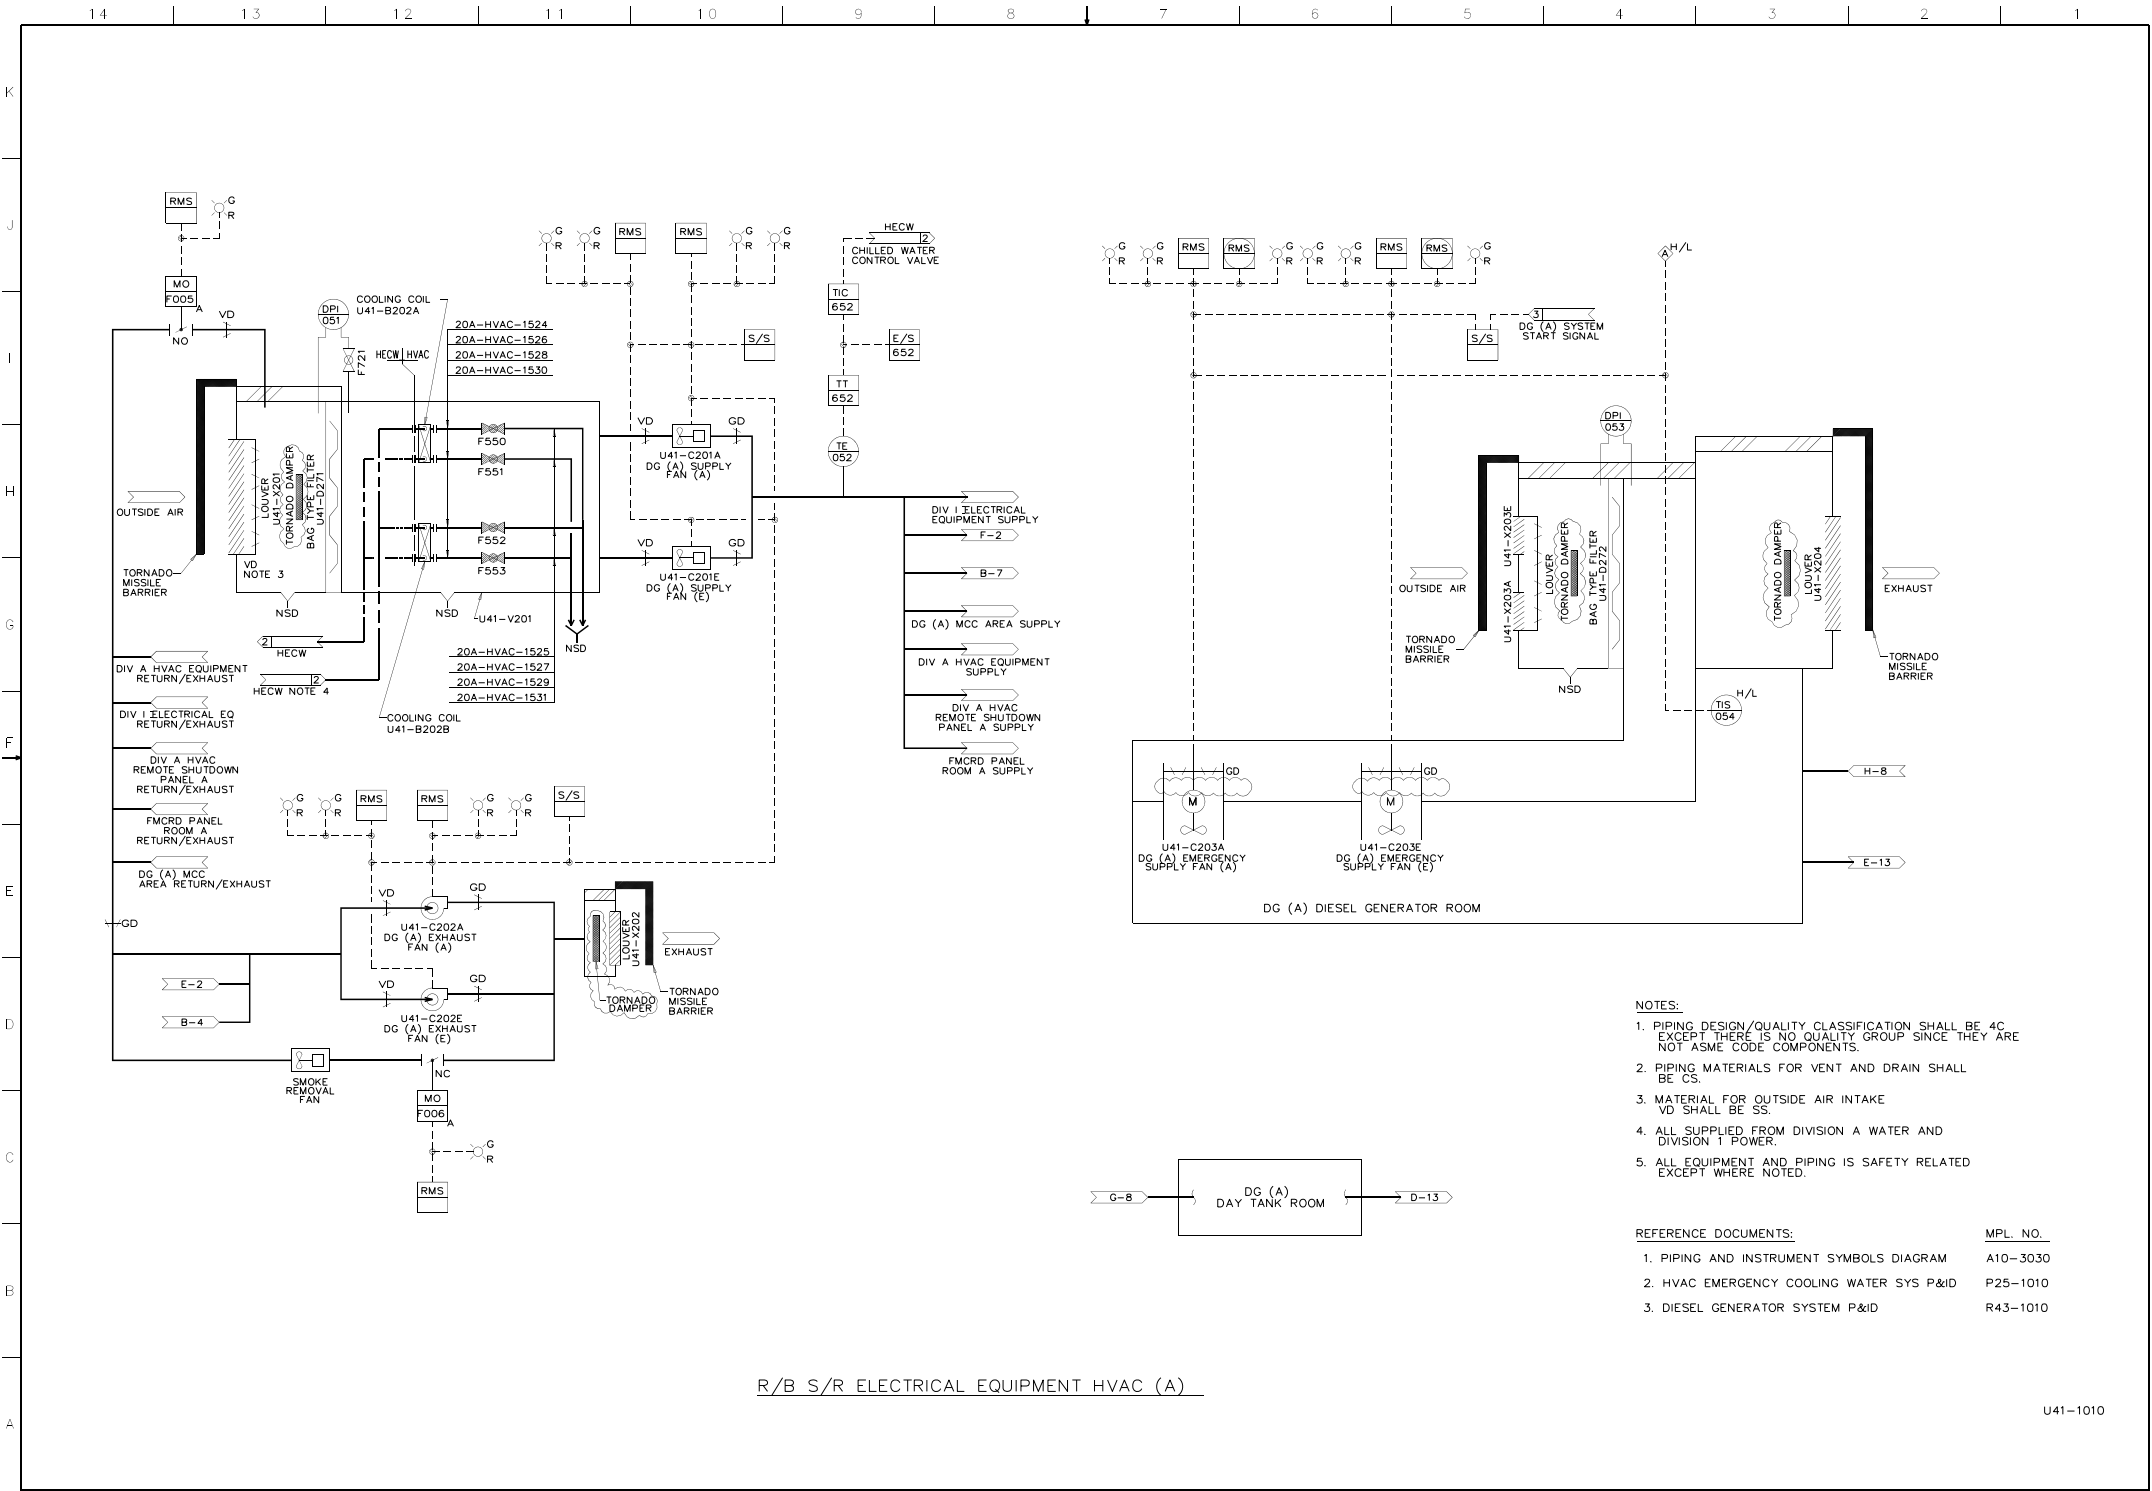


Figure 9.4-4 R/B Safety-Related Electrical Equipment HVAC System (Sheet 1 of 3)



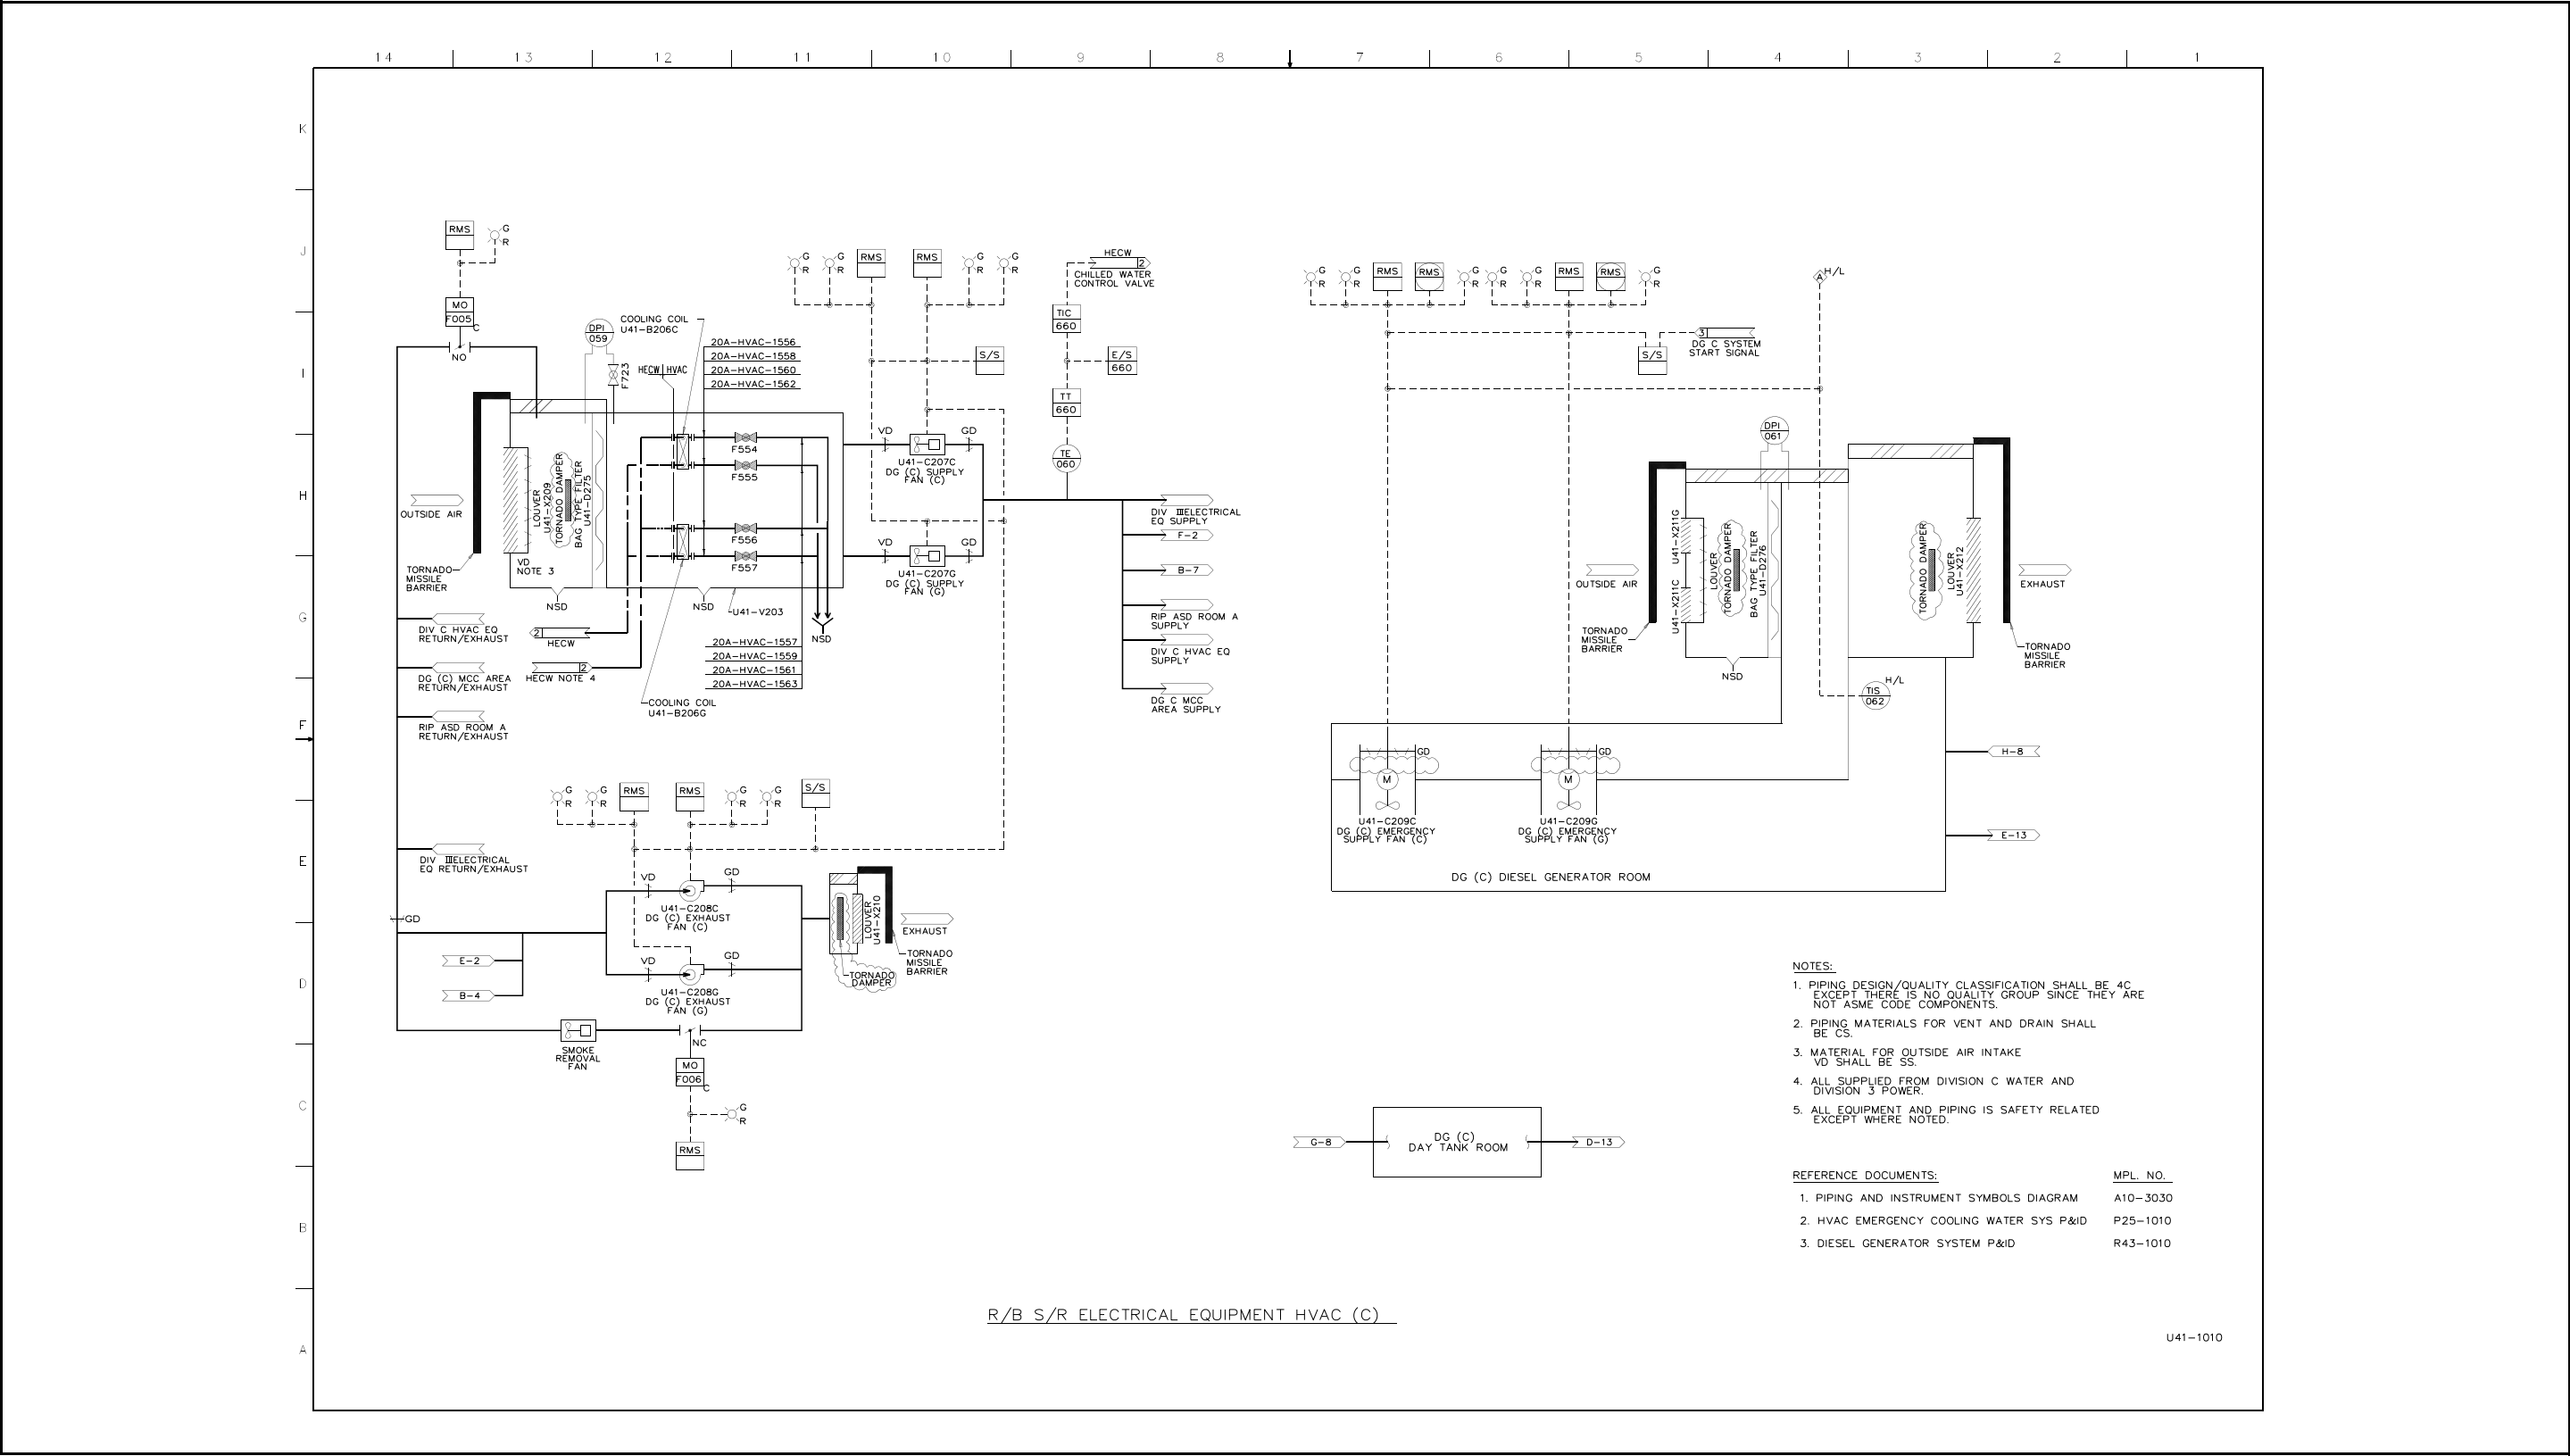


Figure 9.4-4 R/B Safety-Related Electrical Equipment HVAC System (Sheet 3 of 3)