



**Figure 9.4.11-1—Essential Service Water Pump Building Ventilation System**

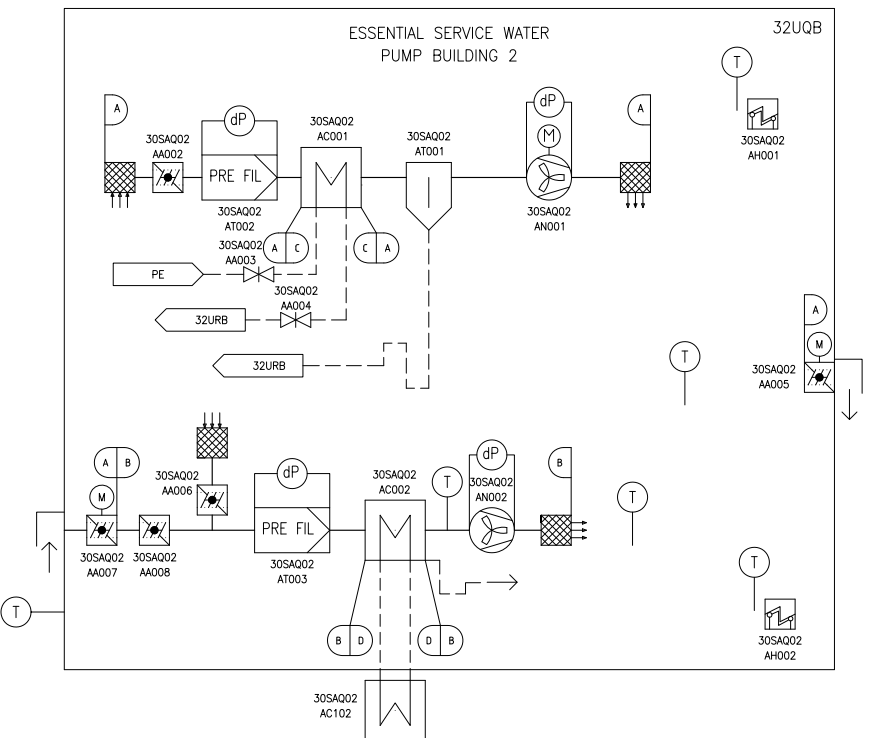

31AQ	-	ESSENTIAL	SERVICE	WATER	PUMP	BUILDING	VENTILATION	SYSTEM
PE	-	ESSENTIAL	SERVICE	WATER	SYSTEM			
31UQB	-	ESSENTIAL	SERVICE	WATER	PUMP	BUILDING	1	
32UQB	-	ESSENTIAL	SERVICE	WATER	PUMP	BUILDING	2	
33UQB	-	ESSENTIAL	SERVICE	WATER	PUMP	BUILDING	3	
34UQB	-	ESSENTIAL	SERVICE	WATER	PUMP	BUILDING	4	
31UR	-	ESSENTIAL	SERVICE	WATER	COOLING	TOWER	STRUCTURE	BUILDING 1
32UR	-	ESSENTIAL	SERVICE	WATER	COOLING	TOWER	STRUCTURE	BUILDING 2
33UR	-	ESSENTIAL	SERVICE	WATER	COOLING	TOWER	STRUCTURE	BUILDING 3
34UR	-	ESSENTIAL	SERVICE	WATER	COOLING	TOWER	STRUCTURE	BUILDING 4

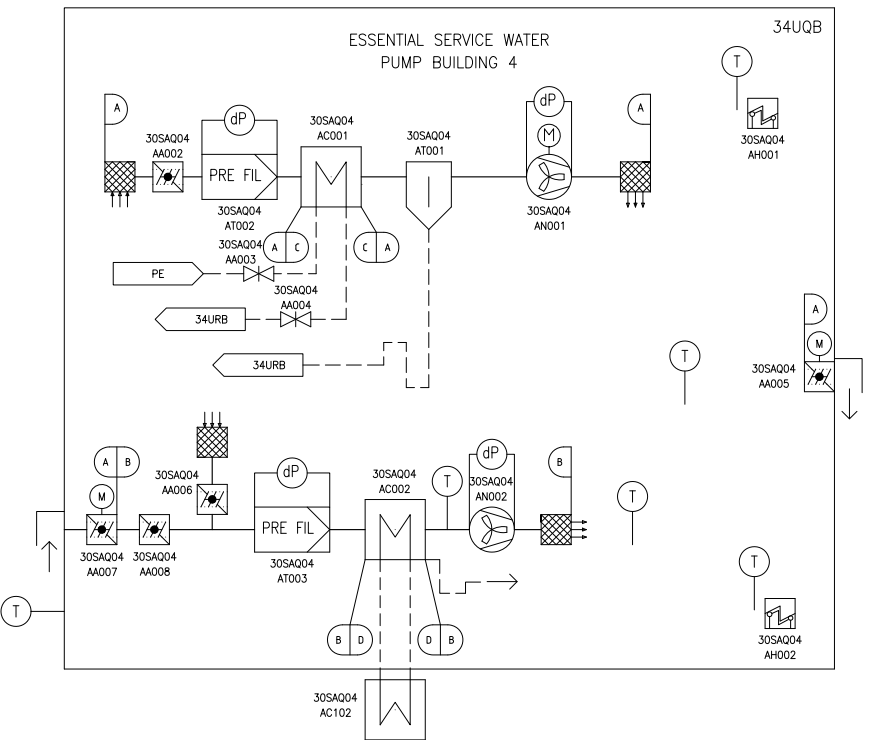

D	D	II
C	C	I
B	N/A	II
A	N/A	I
DESIGN AREA	SSC QUALITY GROUP	SSC SEISMIC CLASS

REV 004  
SAQ01T2