


- NOTES**
- 1. CONTACT CLOSING ON STM GEN. 1A ISOL. SIGNAL
 - 2. INSTALLATION BY FIELD
 - 3. SPLICED IN AUX. LIMIT SWITCH HOUSING.

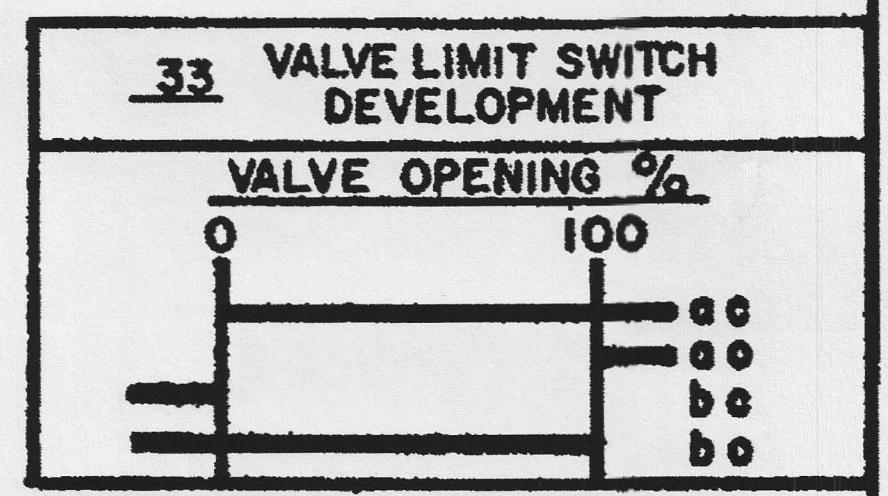

APPROVED FOR CONSTRUCTION

RI:CE-06858 3-9-78

NUCLEAR SAFETY RELATED

EBASCO SERVICES INCORPORATED		CAROLINA POWER & LIGHT CO. SHEARON HARRIS NUCLEAR P.R. UNIT NO.1		CAR 2166 B-401 SHEET 1944
8	INCORPORATED EC# 67152	ELECTRONICALLY SIGNED	DIV. 1 & C DR. PT. CH. H. HUSS DATE NOV. 28, 1977	
REV	DESCRIPTION	APPROVAL	APPROVED [Signature]	

AUXILIARY FEEDWATER TO STEAM GEN. 1A
REG. VALVE (FCV-2051A-SA) 3AF-FISA-1

VALVE 3AF-FISA-1 (FCV-2051A-SA) (1364-42206)
REF DWG: LOGIC DIAGRAM CAR-2166, G-427

4-20 MA DC
MODULATE

FAILS OPEN (1364-52839)
HYDROMOTOR ACTUATOR